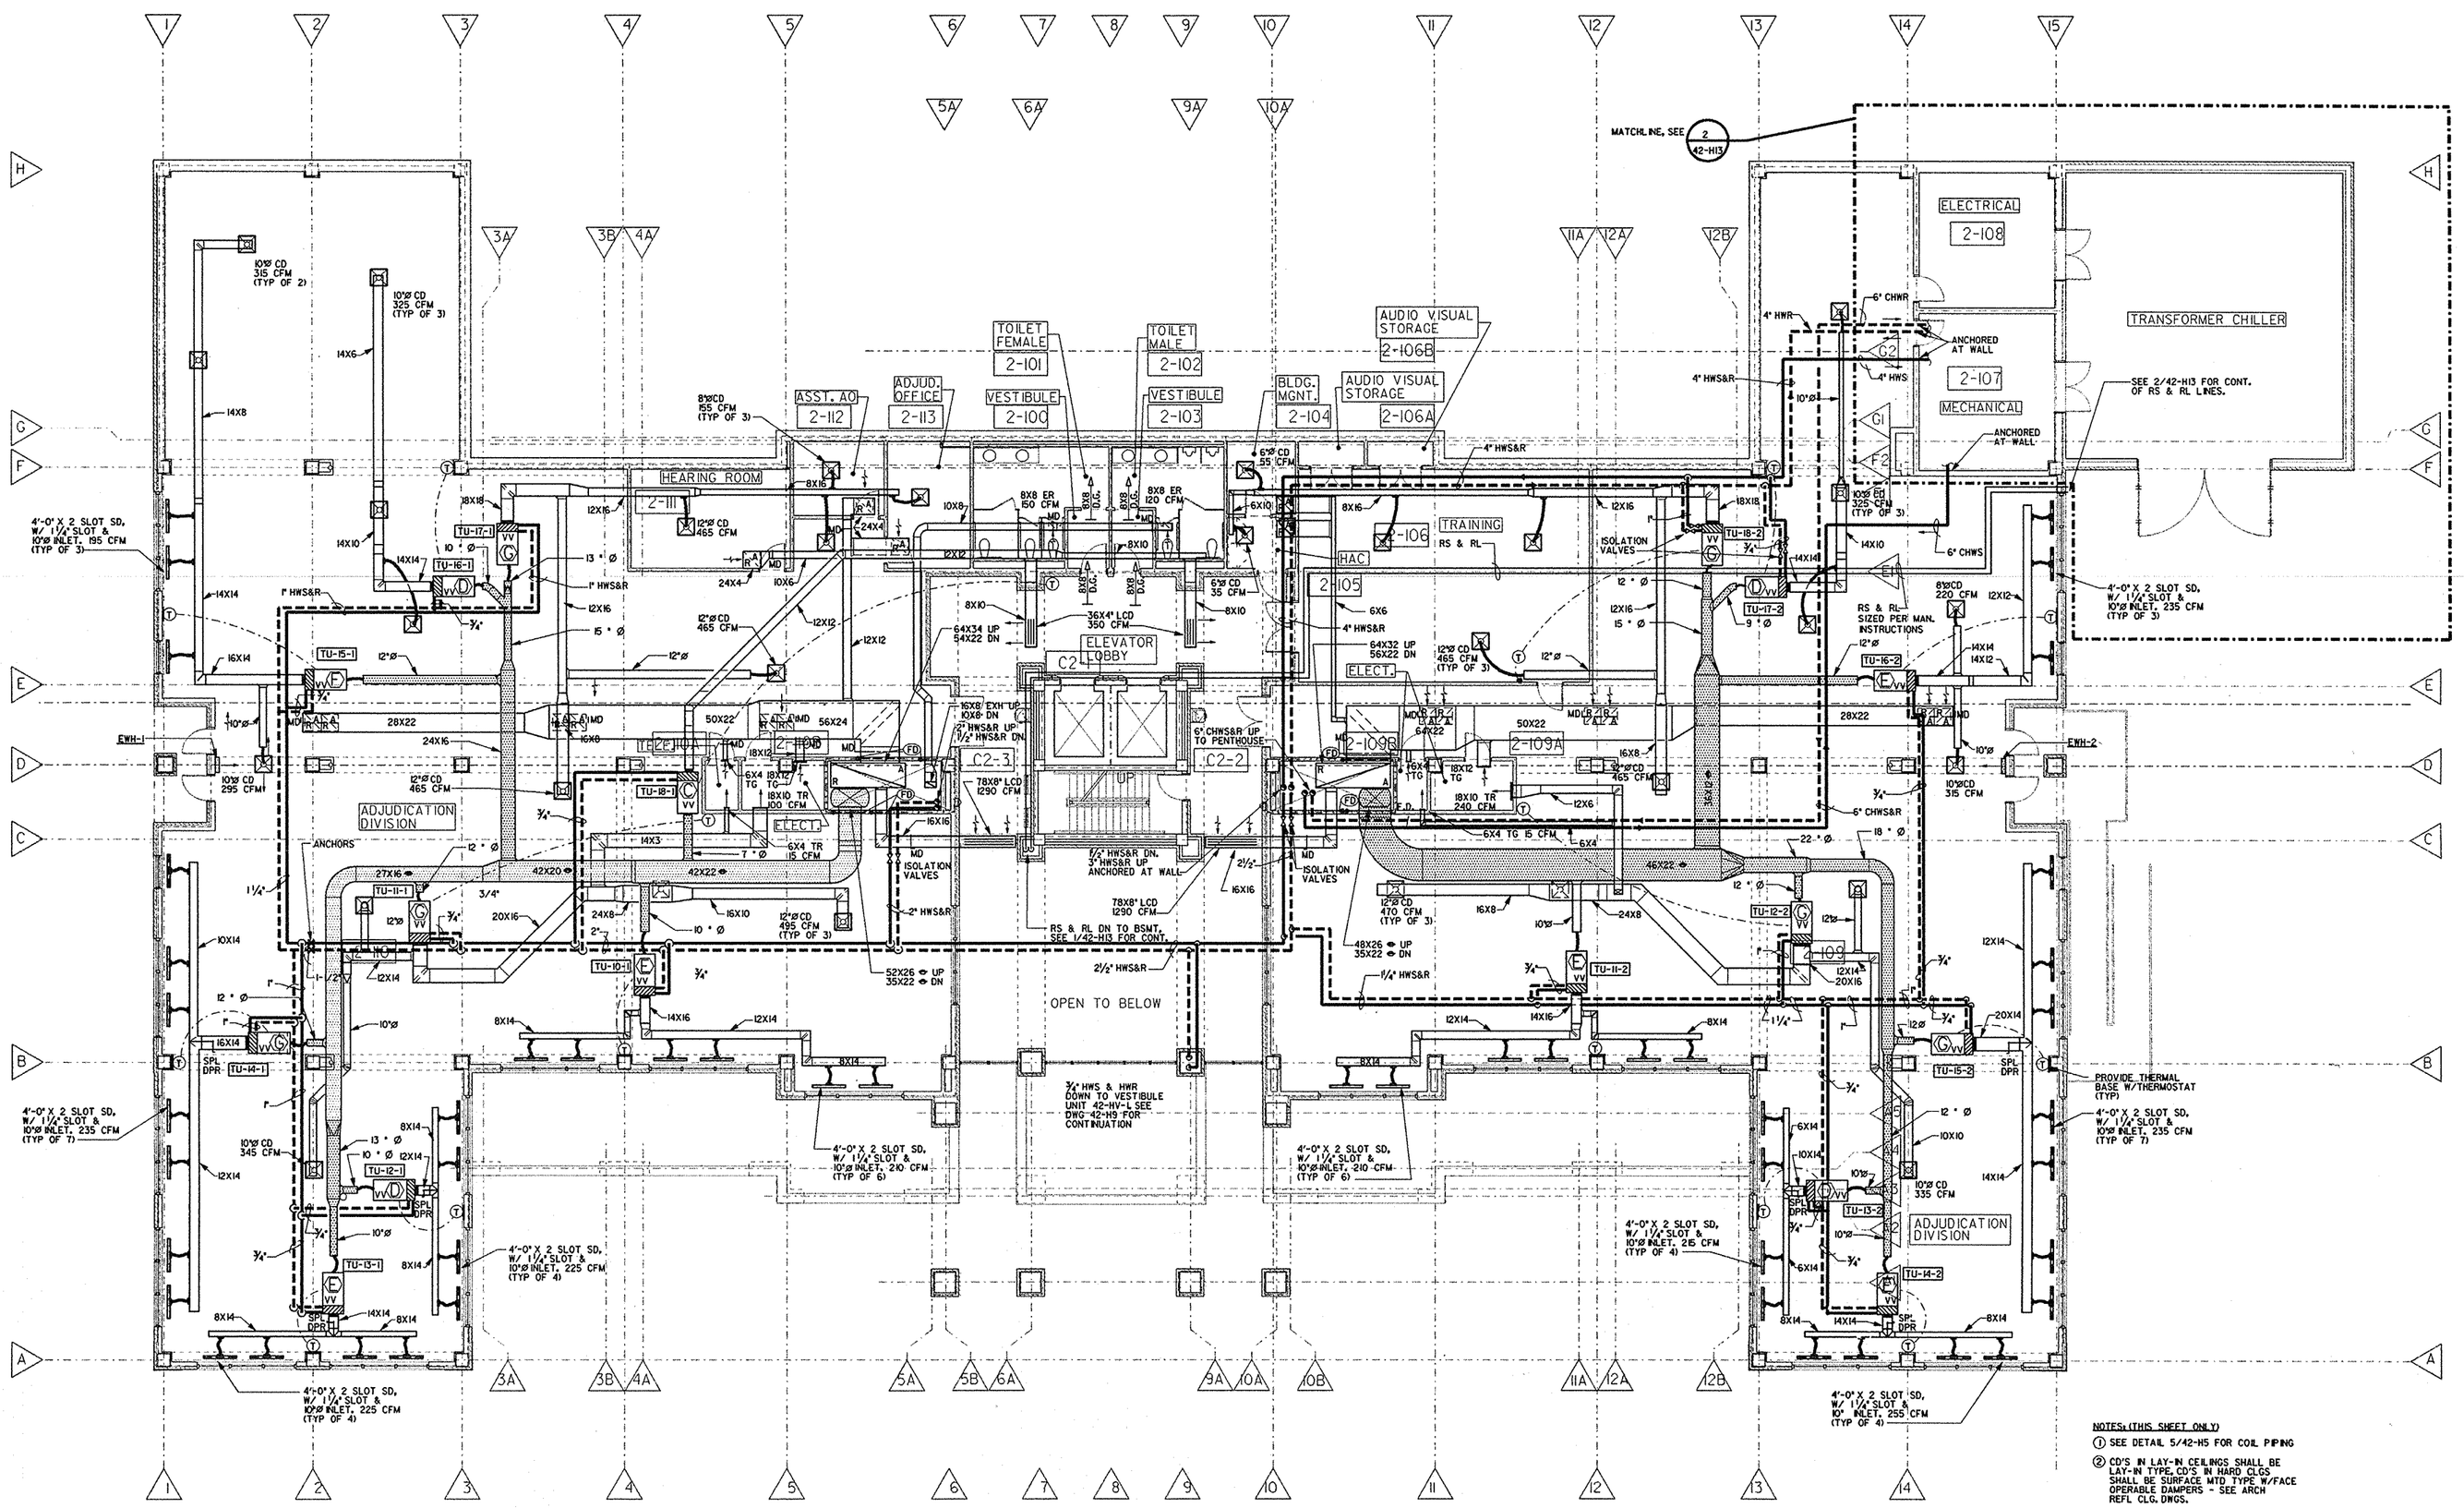

1/42-H10 SECOND FLOOR PLAN - HVAC

SCALE: 1/8" = 1'-0"

one-eigth inch = one foot

NOTES: (THIS SHEET ONLY)

1. SEE DETAIL 5/42-H5 FOR COIL PIPING
2. CD'S IN LAY-IN CEILINGS SHALL BE LAY-IN TYPE, CD'S IN HARD CLGS SHALL BE SURFACE MTD TYPE W/FACE OPERABLE DAMPERS - SEE ARCH REFL CLG. DWGS.
3. ALL MEDIUM PRESSURE DUCT SHALL BE ROUND OR FLAT OVAL UNO. TAKE-OFFS SHALL BE WITH 90° OR 45° BRANCH DUCTS AND CONICAL ENTRY USING 30° ANGLE FOR CONES.

Fully Sprinklered

Revisions	Date

2WR
Watson Watson Rutland / Architects Inc.
166 Commerce Street
P.O. Box 4834
Montgomery, Alabama 36104
205)263-6401

Drawing Title: Second Floor Plan

Approved: Area Project Manger

Project Title: Relocate Regional Office to Department Owned Grounds

Building Number: 42

Location: VMAC Montgomery, Al.

Checked

Drawn

Date: 27 JANUARY 92

Project No. 322-002

DRAWING NO. 42-H10

Dwg. 11 of 134

Office of Facilities

Department of Veterans Affairs

VA FORM 08-6231A, JAN 1990