


**D.X. COIL PIPING DETAIL**  
**NOT TO SCALE**

NOT TO SCALE

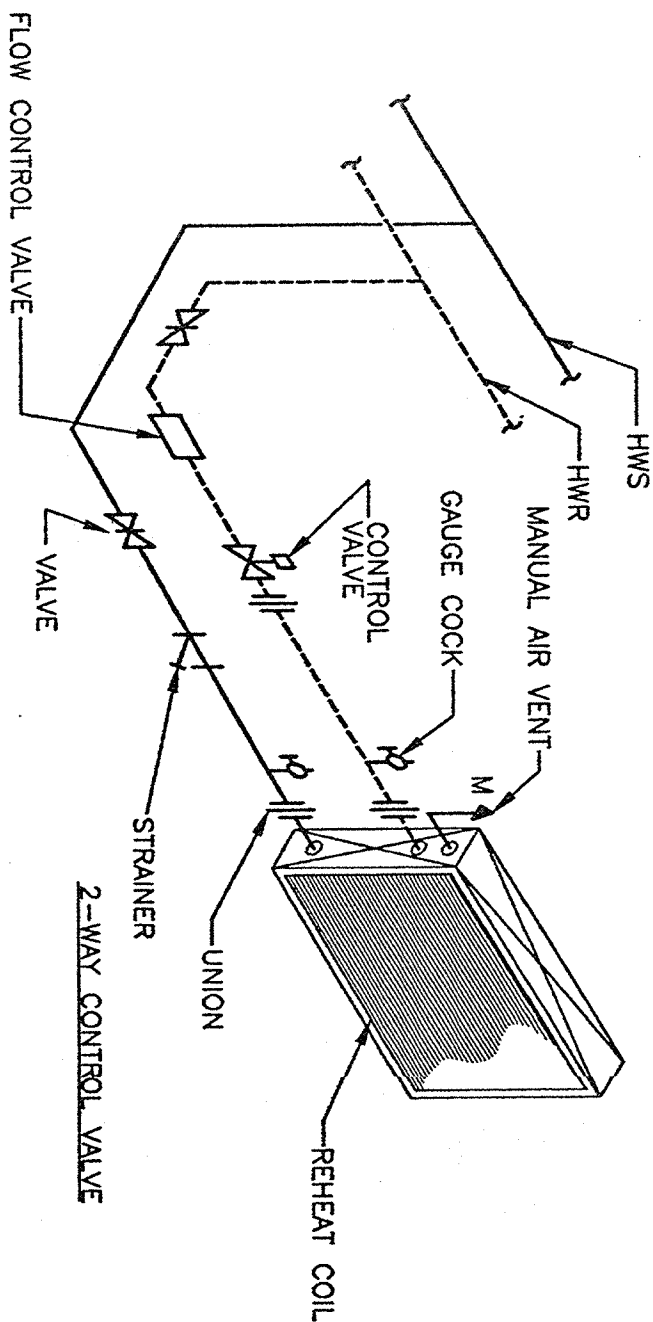


NOTE:  
1.) HOT WATER CONNECTIONS FOR 3-WAY CONTROL VALVES SAME EXCEPT FOR  
ADDED BY-PASS LINE AND BALANCING COCK

2.) ALL CONTROL VALVES TO BE 3-WAY UNLESS NOTED OTHERWISE ON AIRPORT  
TERMINAL UNITS SCHEDULE.

**TYPICAL REHEAT COIL CONNECTION DETAIL**


NO SCALE

!!!! DESIGNER NOTE !!! ONLY USE THIS CONNECTION DETAIL WHEN SEQUENCE CALLS FOR FAILURE OR SHUTDOWN TO CLOSE TO THE COIL

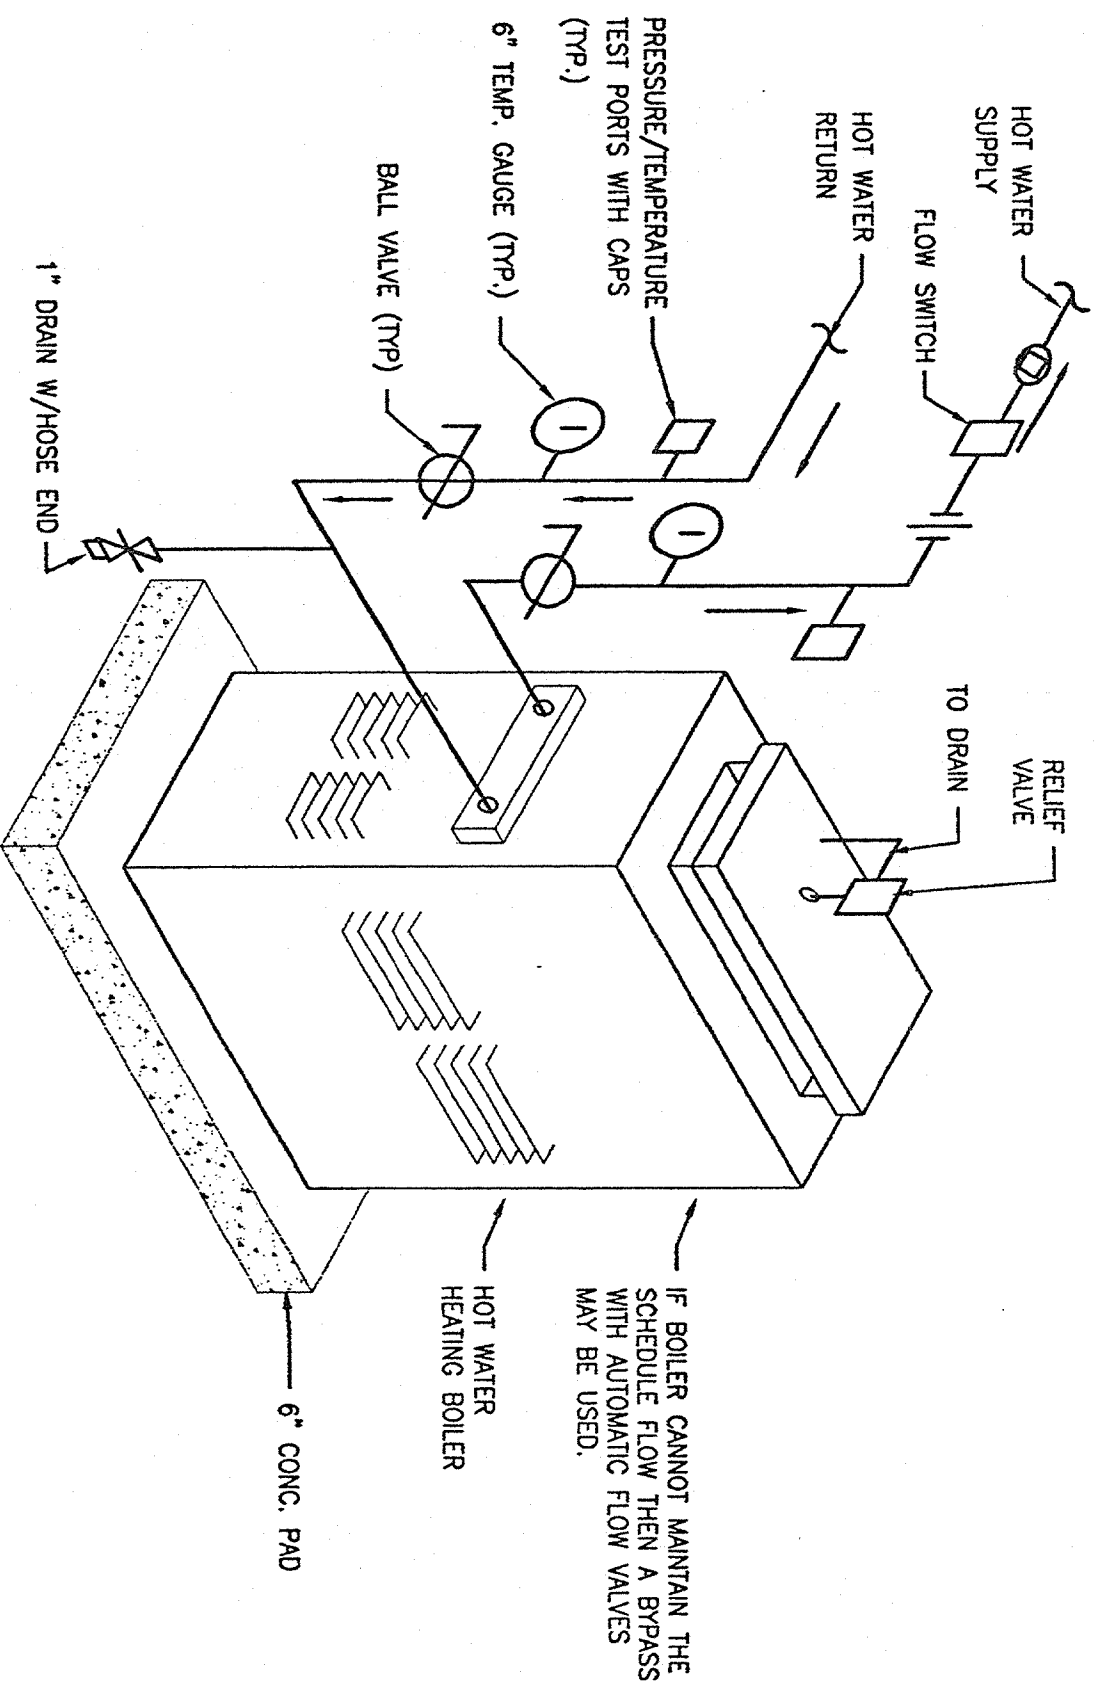

## HOT WATER HEATING BOILER CONNECTIONS

NOT TO SCALE

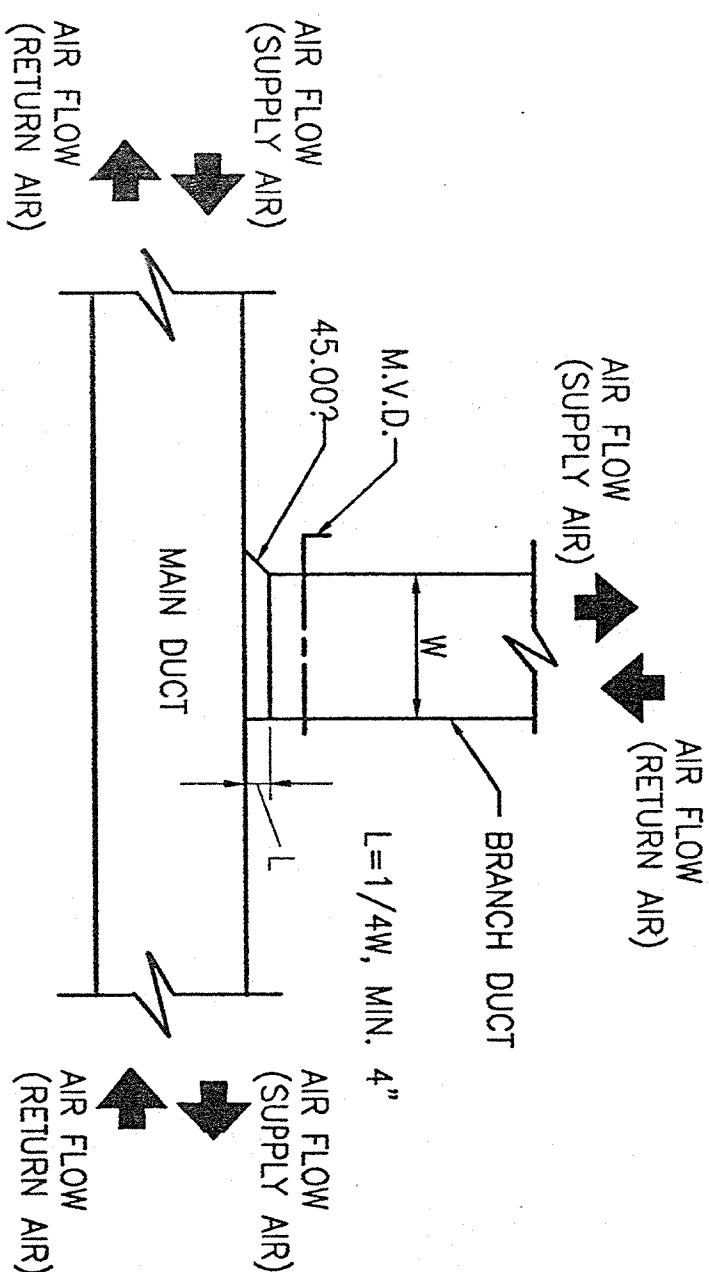

## **SUPPLY AND RETURN AIR DUCT BRANCH CONNECTION**

NOT TO SCALE

[illegible]

# OWASSWEILER ARCHITECT

VIA REGIONAL OFFICE  
345 PERRY HILL ROAD  
MONTGOMERY, ALABAMA

[illegible]