




A. REFER TO DRAWING E001 FOR TYPICAL SYMBOLS AND ABBREVIATIONS USED IN THIS DRAWING.

B. COORDINATE LOCATIONS OF ALL PLUMBING AND HVAC EQUIPMENT PRIOR TO ROUGH-IN.


1. GROUND BUS BAR. SEE DETAIL E2/E501
2. SEE DETAIL F1/E502
3. MOUNT DUPLEX RECEPTACLE FLUSH ON CEILING. COORDINATE EXACT PLACEMENT WITH ARCHITECTURAL REFLECTED CEILING PLAN, SHEET AE108. COVER PLATE TO BE WHITE VINYL.
4. INTERLOCK WITH RANGE RECEPTACLE FOR HOOD SUPPRESSION POWER SHUT OFF.
5. RANGE RECEPTACLE PROVIDED BY RANGE HOOD SUPPLIER INSTALLED AND WIRED BY ELECTRICAL.

 (2) HOUR FIRE BARRIER
 CMU, SEE ARCHITECTURAL PLANS FOR SIZES

THE MECHANICAL CONTRACTOR SHALL TAKE THE LEAD IN PREPARATION OF COORDINATION DRAWINGS. SUCH DRAWINGS SHALL BE ARRANGED AND DESIGNED THROUGHOUT AND FROM COORDINATION WITH ALL OTHER MAJOR AND MINOR SUBCONTRACTORS AND THE GENERAL CONTRACTOR. PROVIDE PLAN VIEWS, SECTIONS AND ELEVATIONS AS REQUIRED TO FULLY COORDINATE ALL MECHANICAL WORK WITH ALL OTHER WORK. PROVIDE ALL LOCAL (AT NOT LESS THAN 3/8" = 1'-0") DRAWINGS SHALL SHOW, BUT NOT BE LIMITED TO: ALL WALL RATINGS; ALL DUCTWORK; AIR DISTRIBUTION; MECHANICAL EQUIPMENT; MECHANICAL PIPING; FIRE PROTECTION PIPING; ALL PLUMBING PIPE; CABLE TRAYS (WITH ELEVATIONS NOTED); LIGHTING FIXTURES (WHEN CEILING MOUNTED); CEILING GRID AND HANGERS; CEILING ACCESS PANELS; EXHAUST FANS; EXHAUST SYSTEMS; ALARM DEVICES AND SPEAKERS (WHERE CEILING MOUNTED); ELECTRICAL CONDUITS LARGER THAN 2-INCH DIAMETER; ELECTRICAL BUSWAY AND REQUIRED CLEARANCES; EQUIPMENT PROVIDED BY OTHERS THAT PROJECT INTO CEILING CAVITIES OR IMPEDER THE LOCAL ACCESS TO CEILING CAVITIES. PROVIDE SECTION CUTS THROUGH ALL SECTIONS SHALL BE CUT THROUGH AREAS SHOWING MATERIALS AND SYSTEMS OF ALL CONTRACTS. IF THERE ARE ANY OUTSTANDING ISSUES THAT CANNOT BE RESOLVED, CONSULT WITH THE ARCHITECT AND/OR ENGINEER (THROUGH THE V.A. C/O) FOR CLARIFICATION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE COORDINATION. IT IS IMPORTANT TO NOTE THAT FABRICATION CANNOT BEGIN UNTIL COORDINATION DRAWINGS HAVE BEEN APPROVED. ANY MATERIAL, EQUIPMENT, SYSTEMS, ETC., PROCUREMENT OR INSTALLATION COMMENCED PRIOR TO APPROVAL IS TAKEN AT THE CONTRACTORS OWN RISK AND MAY HAVE TO BE MODIFIED, MOVED AND/OR RECONFIGURED AT THE CONTRACTORS OWN RISK AND COST.



Department of Veterans Affairs
William Jennings Bryan Dorn
VA Medical Center
6439 Garners Ferry Road
Columbia, SC 29209

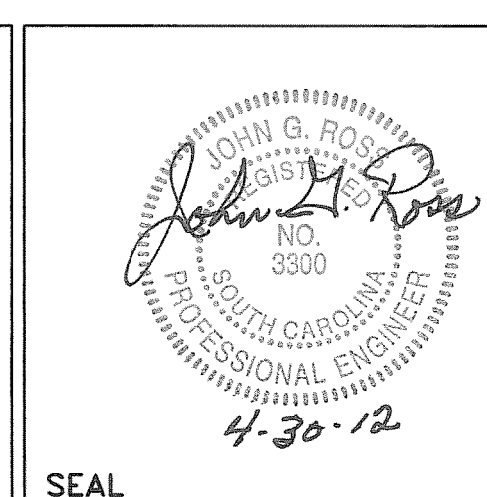

Architect/Engineer Address

**Harrell,
Salkruff
&
Hopper**

Design & Management Solutions for the Built Environment

8016 TOWER POINT DRIVE
CHARLOTTE, NC 28227

WWW.HSHPC.COM

COPYRIGHT © 2011 HARRELL, SALKRUFF & HOPPER, PC
HSH PROJECT # 11015

P 704.814.1324
F 704.321.0833

Recommended Approvals:	
1. MEDICAL DIRECTOR	6. OPERATIONS SERVICE LINE MANAGER
2. ASSOCIATE DIRECTOR	7. INFECTION CONTROL MANAGER
3. CHIEF OF STAFF	8. SAFETY MANAGER
4. ASSOC. DIRECTOR	9. GENERAL ENGINEER
5. SERVICE LINE MGRS.	10. COTR

Drawing Title	PARTIAL FIRST FLOOR POWER PLAN SOUTH
	<p>* BUILDING IS FULLY SPRINKLERED *</p>

Project Title REPLACE BOILER PLANT/ COGEN/CHP		
Drawn DC	Building Number 21	AutoCAD File Name
Checked	Reviewed	Const. Contract No

Date	APRIL 30, 2012
Project Number	544-11-101
DRAWING No.	EP103

Veterans
Affairs