

- 1 REPAIR ALL SURFACE IMPERFECTIONS ON CONCRETE SLAB SURFACES BY FILLING & SEALING WITH EPOXY MANUFACTURER'S RECOMMENDED MATERIAL. ALL OPEN CRACKS IN CONCRETE MUST BE REPAIRED. (TNEPEC SERIES 120 VINESTER SYSTEM OR APPROVED EQUAL) LARGE BUGHOLES AND OTHER CAVITIES SHALL BE FILLED.
- 2 SAW CUT AT TRANSITIONS (EPOXY FLOORING VS NON EPOXY FLOORING), SEE DETAIL D1/AS-601.
- 3 APPLY HEAVY DUTY, NON-CLIMATIC RESINOUS SEAMLESS EPOXY SYSTEM OF PRIMER, INTERMEDIATE COATS, FINISH COATS AND ALUMINATIC POLYURETHANE SEALER PER MANUFACTURER'S RECOMMENDATION AND PROJECT SPECIFICATIONS. APPLY INTEGRAL COVE BASE SEE SHEET AS 601 FOR DETAILS.
- 4 CONTRACTOR TO SUBMIT PHASING CONSTRUCTION PLAN TO VA FOR APPROVAL PRIOR TO EPOXY APPLICATION. APPLY EPOXY IN DIFFERENT ROOMS BASED ON APPROVED PHASING PLAN. APPLY INTEGRAL COVE BASE, SEE PHASING PLAN.
- 5 PROVIDE POSITIVE SLOPS AT 1/8" PER FOOT MINIMUM TO FLOOR SINKS AND DRAINS WITH EPOXY FLOORING APPLICATION.
- 6 PATCH, REPAIR AND PAINT ALL WALL SURFACES PER FINISH SCHEDULE. PREPARE DRYWALL SURFACES FOR APPLICATION OF STAINLESS STEEL WAINSCOT WHERE APPLICABLE, SEE DETAIL B1/AS-601.
- 7 PROTECT FLOORING AND ALL ADJOINING SURFACES DURING APPLICATION OF STAINLESS STEEL WAINSCOT.
- 8 AFTER EPOXY FLOORING IS FULLY CURED, REINSTALL THE FOOD WARMER/COOLER BASE STATION PER MANUFACTURER'S INSTALLATION INSTRUCTION BY BURLUDGE.
- 9 TRANSPORT FROM TEMPORARY STORAGE AND REINSTALL ALL EQUIPMENT THAT WAS REMOVED FOR EPOXY FLOORING INSTALLATION, AFTER FLOORING IS COMPLETELY CURED PER EPOXY MANUFACTURER'S RECOMMENDATION. RECONNECT ALL PLUMBING, UTILITIES, ELECTRICAL TO ALL EQUIPMENT FOR A SAFE AND SECURE OPERATION. PROTECT THE NEWLY INSTALLED EPOXY FLOORING WHILE REINSTALLATION OF EQUIPMENT. SEE G1-003 FOR PLUMBING FOOD SERVICE REMOVAL AND REINSTALLATION NOTES.
- 10 REMOVE ALL TEMPORARY PARTITIONS, CAPPING OF SUPPLY AIR, TEMPORARY GASKETING AT THE DOOR ETC., AFTER COMPLETION OF WORK.
- 11 INSTALL EPOXY TO MATCH EXISTING AT TRANSITIONS BETWEEN NEW EPOXY FLOORING AND ADJOINING SURFACES, SEE DETAIL D1/AS-601.
- 12 REPAIR CRACKS IN CONCRETE WITH ENGINEERED CEMENT SURFACES PROVIDE REPAIR PROCEDURE FOR REVIEW AND APPROVAL. USE ARDEX OR APPROVED EQUAL. APPLY COATING TO MATCH EXISTING.
- 13 REPLACE DAMAGED TILES (MINIMUM OF 10 TILES FOR BIDDING PURPOSE) WITH MATCHING TILE FINISH. SEE SPECIFICATION #09 30 00.
- 14 EXISTING FLOOR DRAIN SEE DETAIL D2/AS-601 FOR EPOXY FLOORING TERMINATION DETAIL.FIELD VERIFY QUANTITY AND LOCATION.
- 15 EXISTING CLEAN OUT SEE DETAIL D2/AS-601 FOR EPOXY FLOORING TERMINATION DETAIL.FIELD VERIFY QUANTITY AND LOCATION.
- 16 EXISTING FLOOR SINK SEE DETAIL C1/AS-601 FOR EPOXY FLOORING TERMINATION DETAIL.FIELD VERIFY QUANTITY AND LOCATION.

A	PROVIDE WALL PAINT
B	PROVIDE STAINLESS STEEL WAINSCOT SEE DETAIL B1/AS-601
C	PROVIDE 6" CONTINUOUS EPOXY FLOORING INTEGRAL BASE SEE DETAIL A1/AS-601
D	PROVIDE 6" CONTINUOUS EPOXY FLOORING INTEGRAL BASE SEE DETAIL A2/AS-601


KEY PLAN

SCALE 1/4"=1'-0"



SCALE 1/4"=1'-0"

	CONSULTANTS:

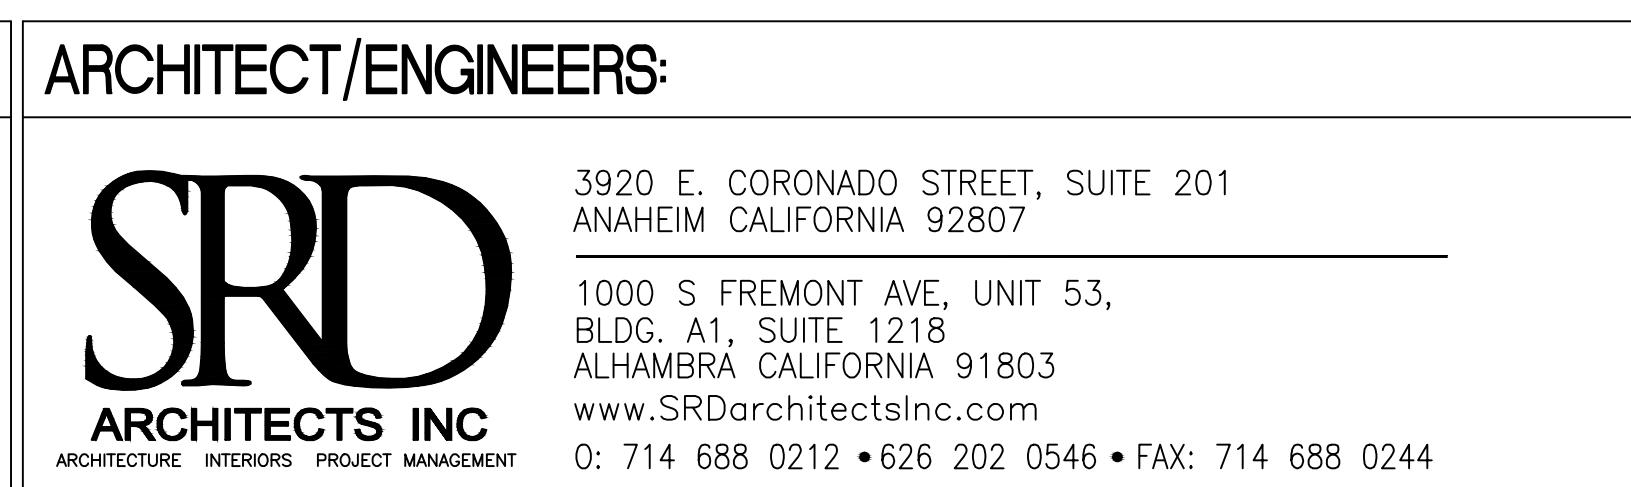

Project Title		Project Number	
REPLACE EPOXY FLOORING IN BUILDING 20		691A4-13-116SM	
Location		Building Number	
1611 PLUMMER STREET SEPULVEDA, CA 91343		20	
Date	Checked	Drawing Number	
05/15/2013	W.H.	AS-101	
	Drawn	Dwg. 7 of 8	
	M.K.		

 Department of
Veterans Affairs