
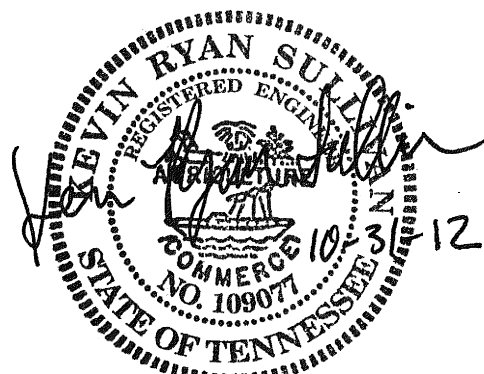


- A. WHERE A FEEDER IS DEMOLISHED, ALL COMPONENTS OF THE FEEDER SHALL BE REMOVED. THIS INCLUDES, BUT IS NOT LIMITED TO, CONDUCTORS, CONDUITS, JUNCTION BOXES, WIREWAYS, HANGERS, SPLICERS, AND OTHER MATERIALS, DEVICES AND APPURTENANCES ASSOCIATED WITH THE FEEDER INSTALLATION. WHERE DEMOLISHED MATERIALS PENETRATE RATED PARTITIONS, PROVIDE MATERIALS TO SEAL PENETRATION TO MAINTAIN THE RATING OF THE PARTITION.
- B. EXISTING RECESSED PANELBOARDS THAT ARE DEMOLISHED SHALL BE REMOVED IN THEIR ENTIRETY AND THE WALLS PATCHED TO MATCH EXISTING FINISHES. SEE NATIONAL PANEL PLANS. RECESSED PANEL BOXES SHALL NOT BE USED AS A JUNCTION BOX.
- C. EXISTING BRANCH CIRCUITS FROM DEMOLISHED PANELS TO REMAIN UNLESS NOTED OTHERWISE. REFER TO SHEET ES.002 FOR REQUIREMENTS.



**GOBBELL HAYS PARTNERS, INC.**  
ARCHITECTURE • ENGINEERING  
ENVIRONMENT • HEALTH • SAFETY

217 Fifth Avenue North  
Nashville, TN 37219  
ph: 615-254-8500  
fax: 615-256-3439  
[www.ghp1.com](http://www.ghp1.com)

Date :	OCTOBER 31, 2012
Project No. :	626A4-11-202
Drawing No.	5-ED.300
Dwg.	75 Of 97

Department of  
Veterans Affairs