




three inches = one foot
one and one-half inches = one foot
one inch = one foot
three-quarters inch = one foot
one-half inch = one foot
three-eighths inch = one foot
one-quarter inch = one foot
one-eighth inch = one foot

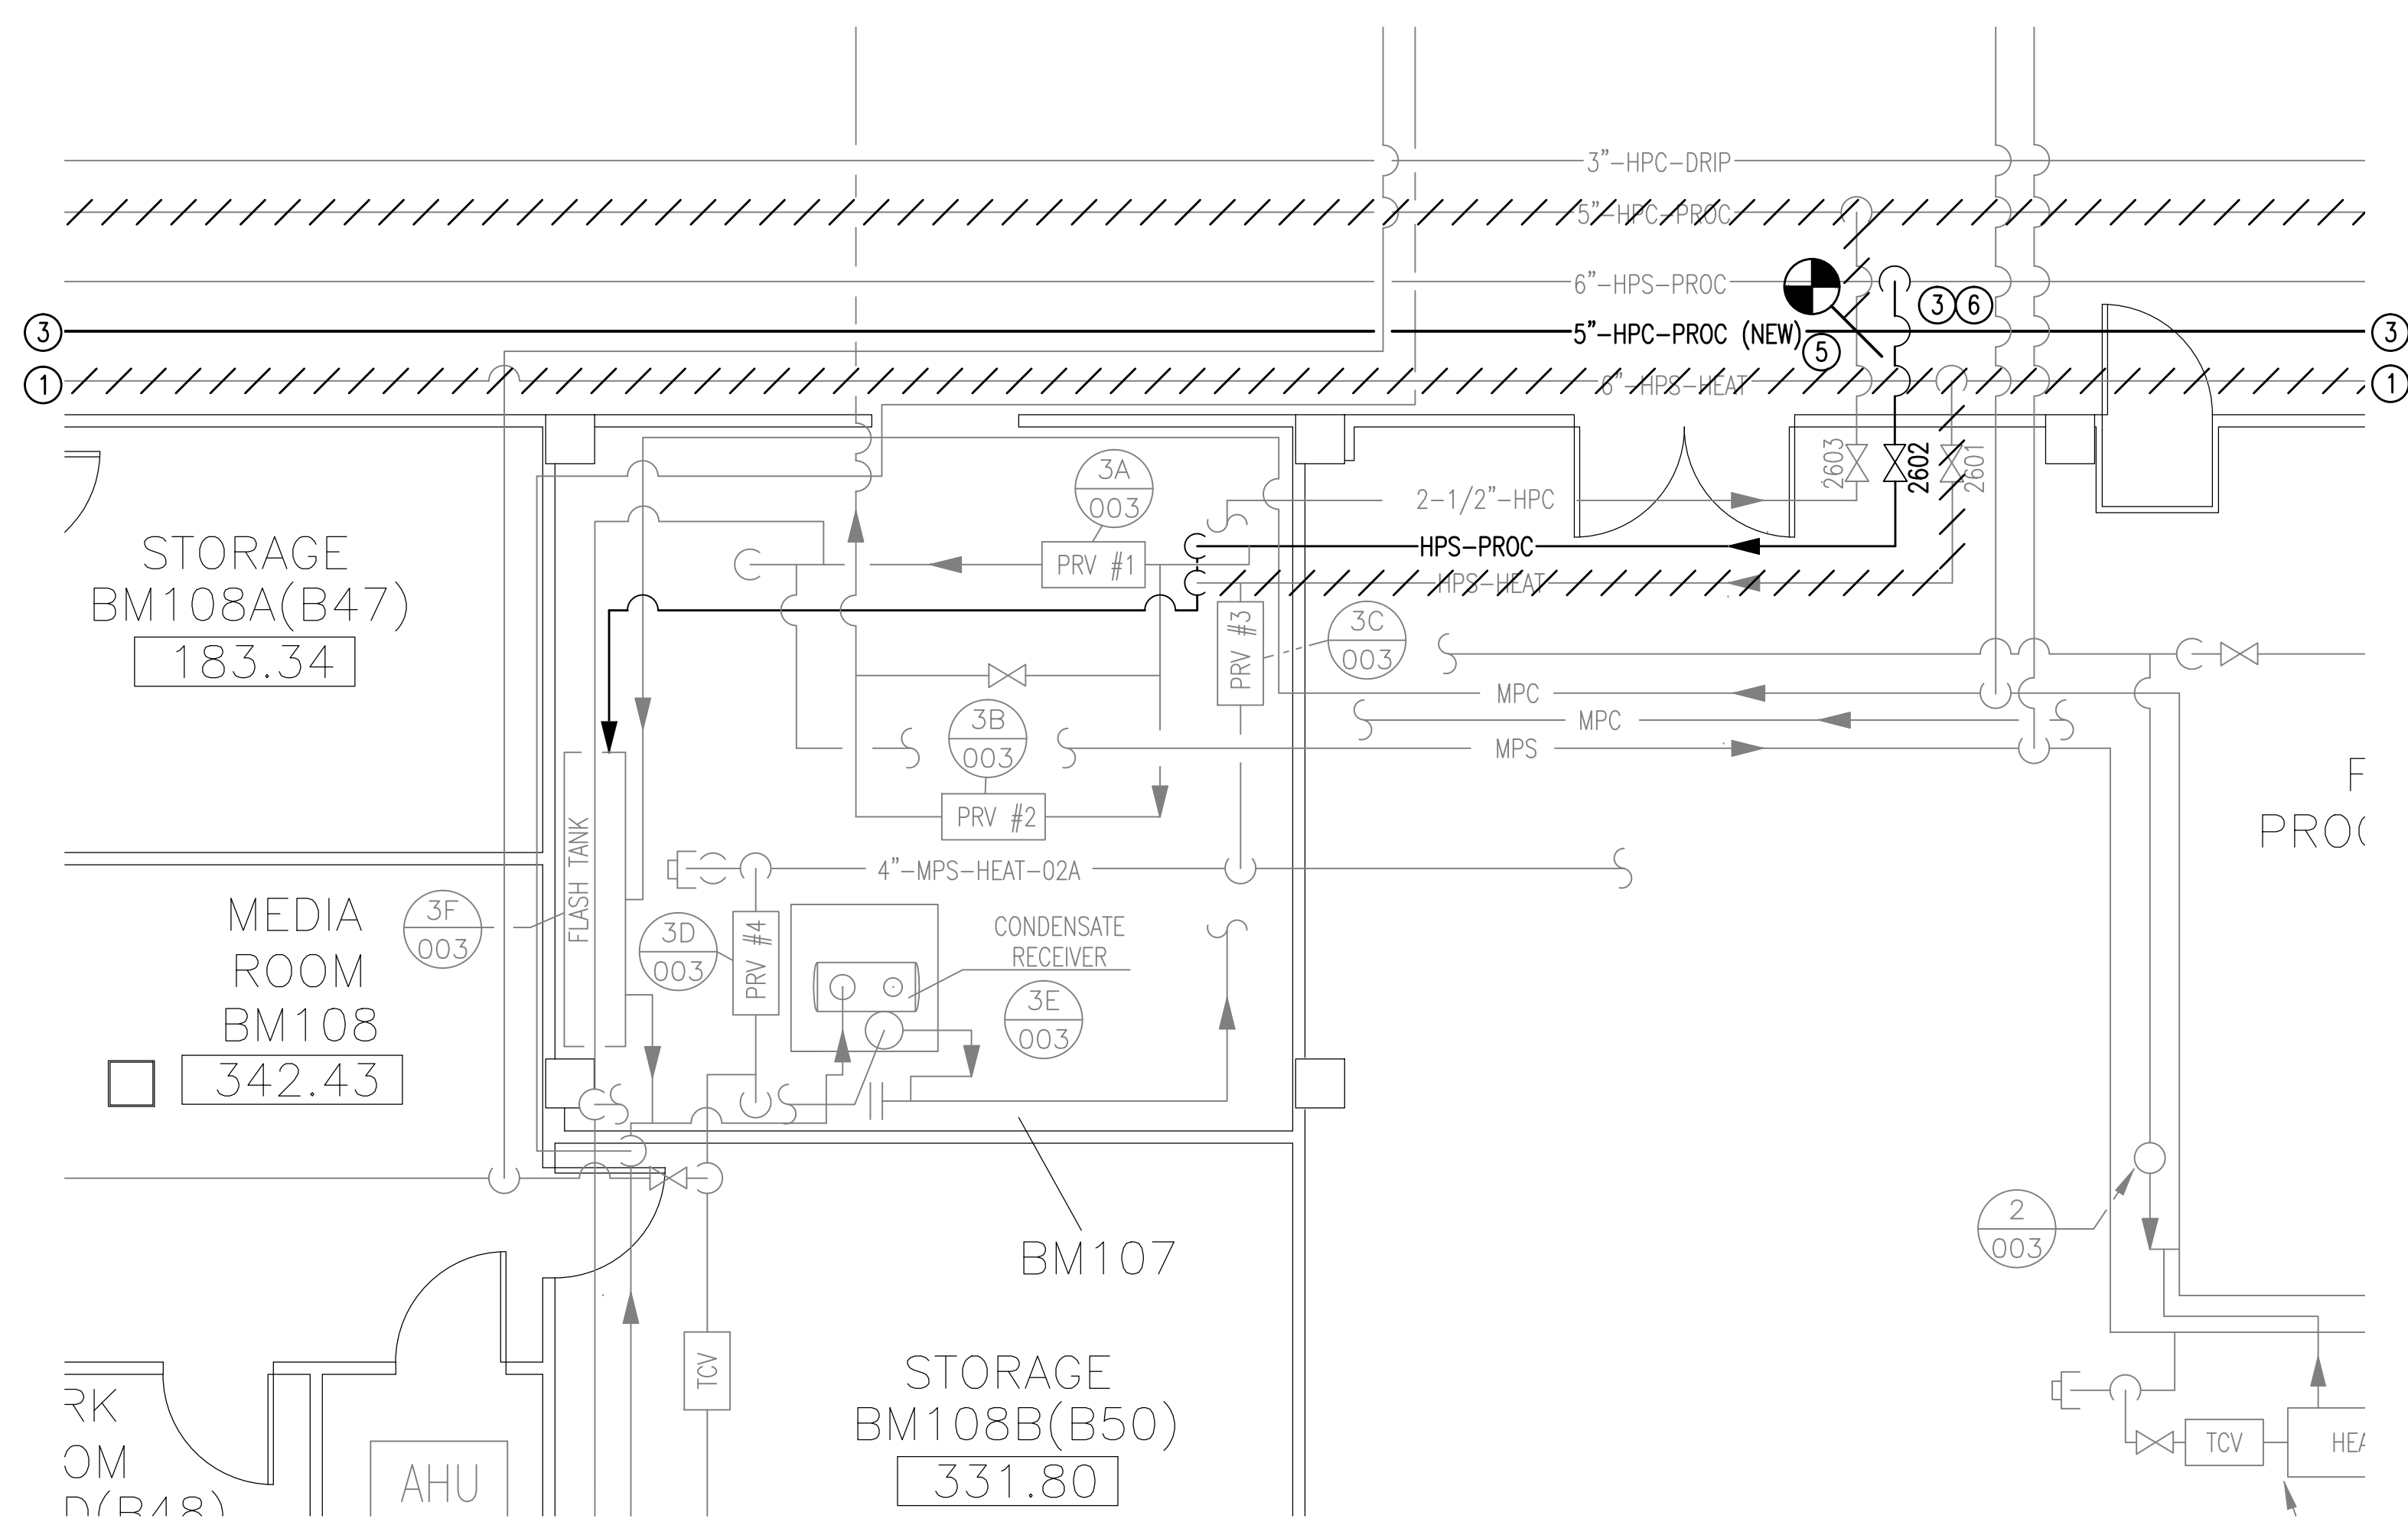


MECHANICAL ROOM BM107 ENLARGED
SCALE: 1/4" = 1'-0"

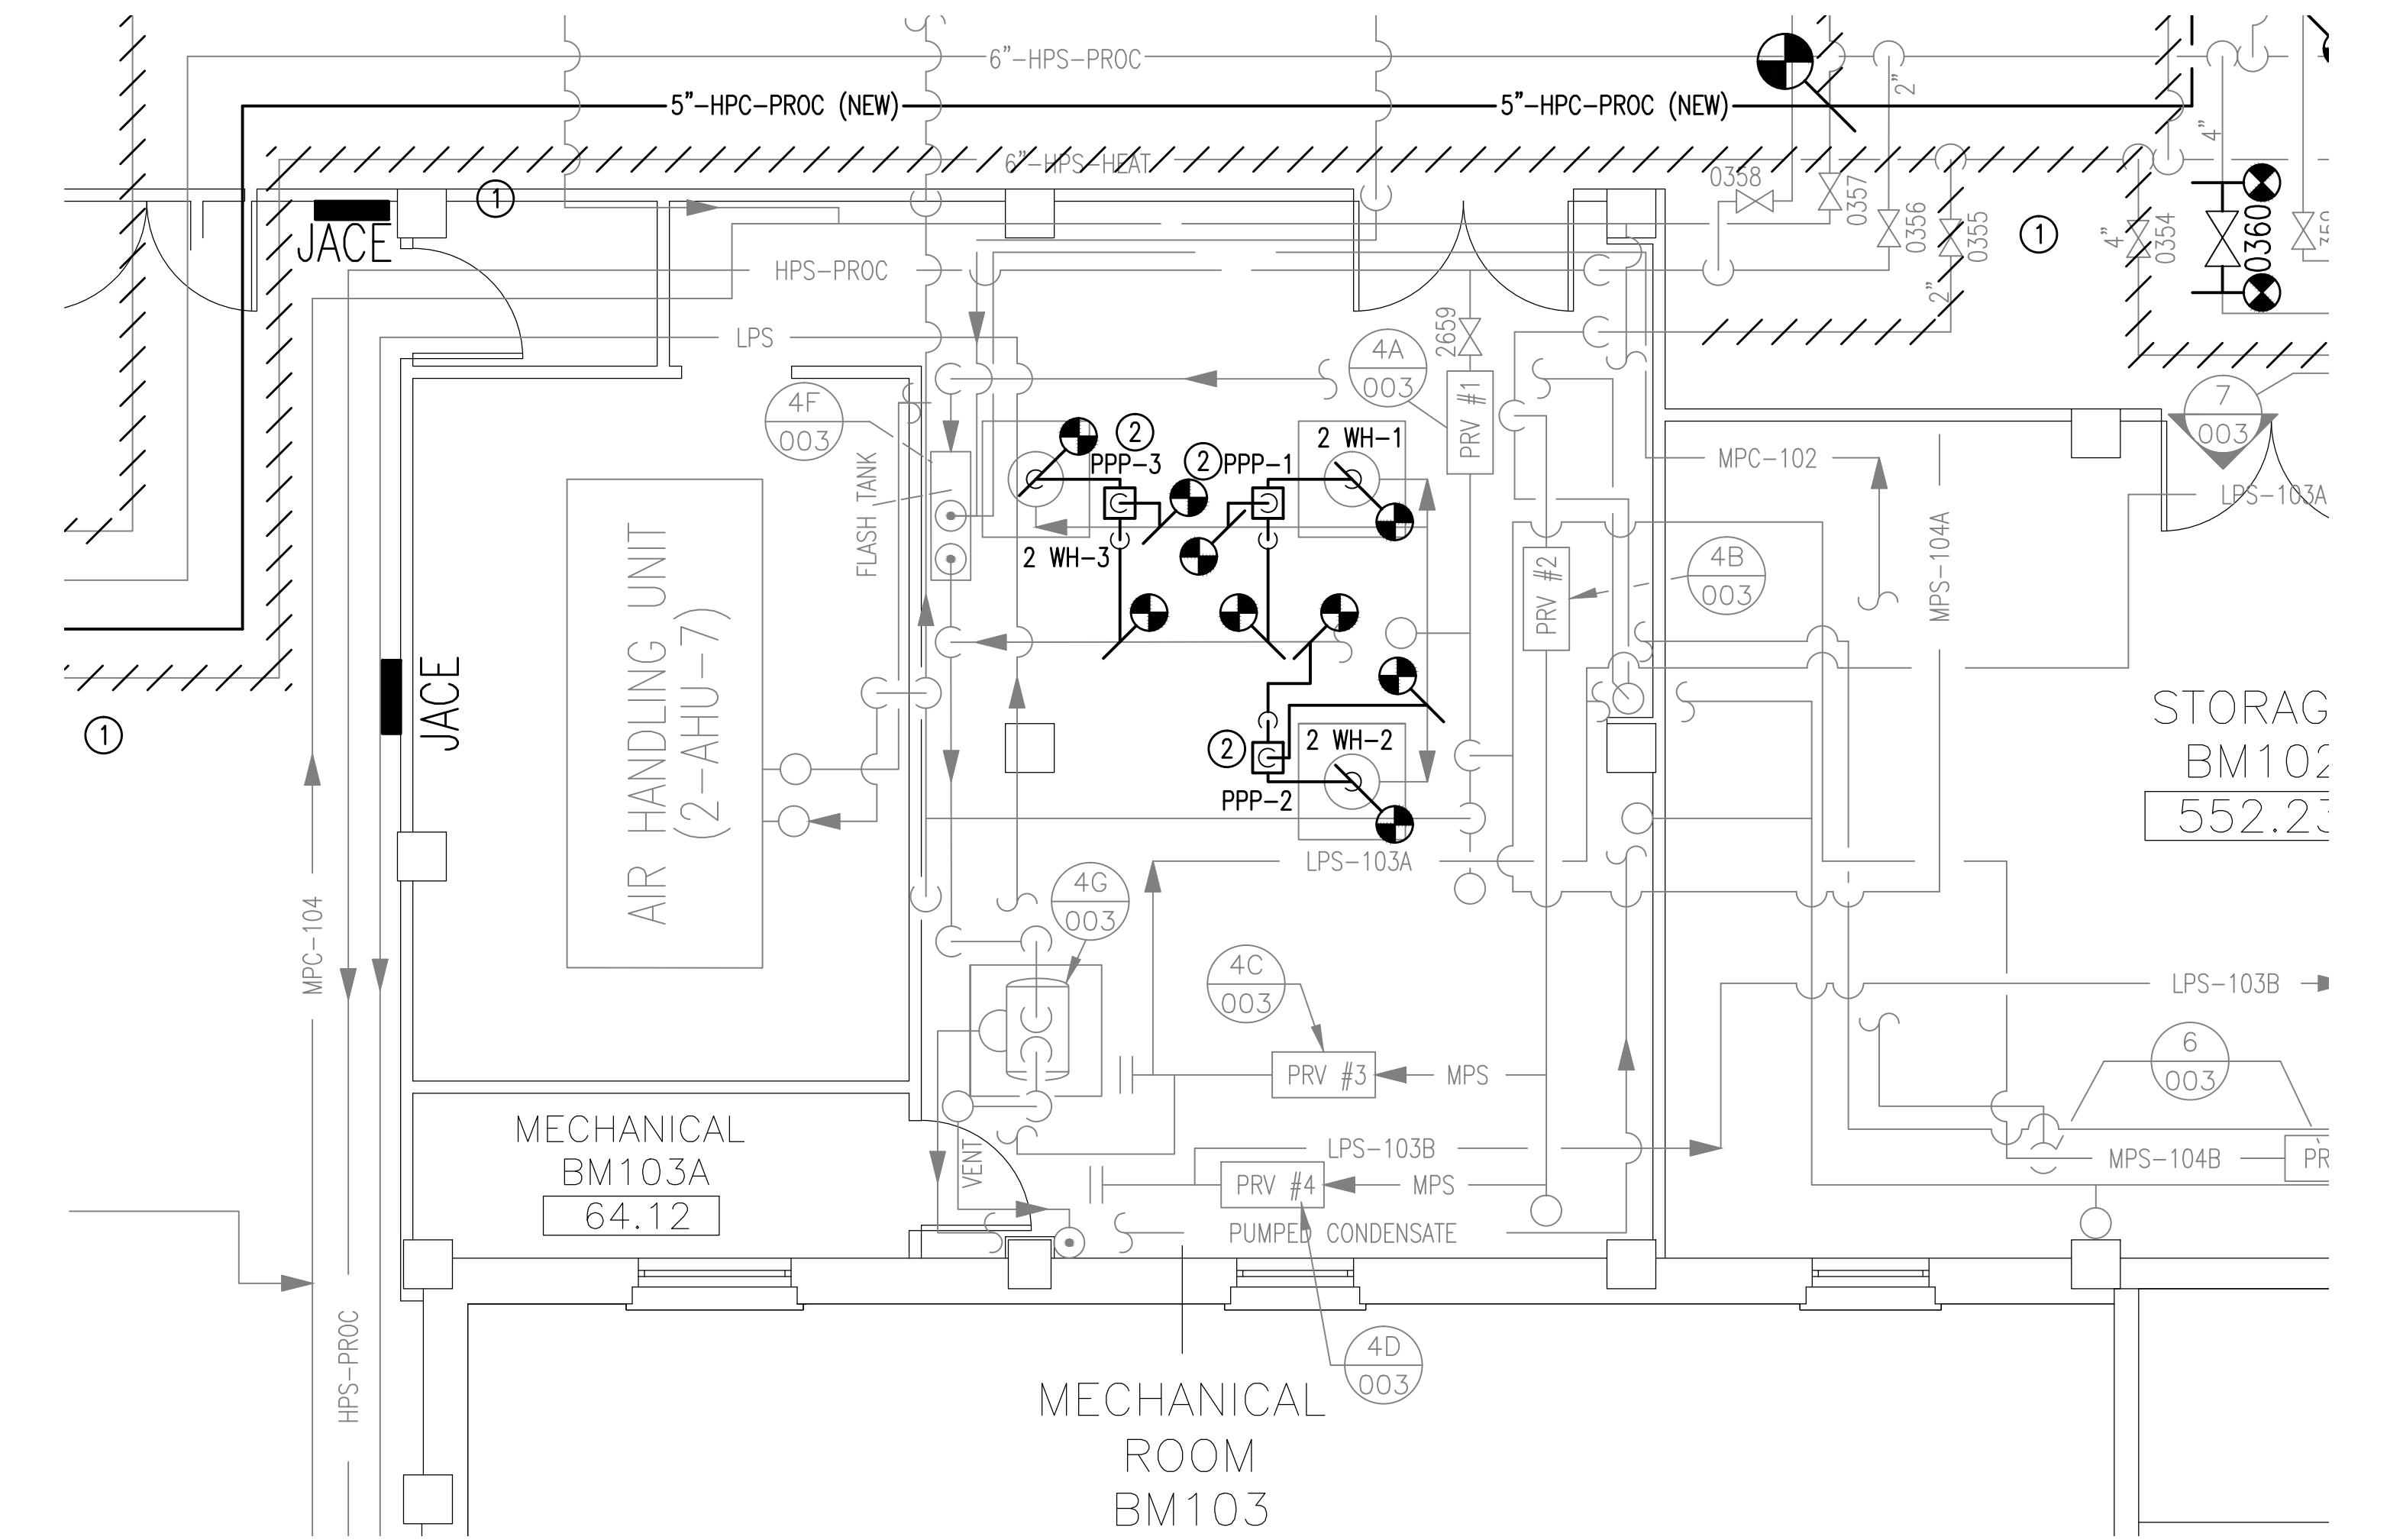

MECHANICAL ROOM BM103 ENLARGED
SCALE: 1/4" = 1'-0"

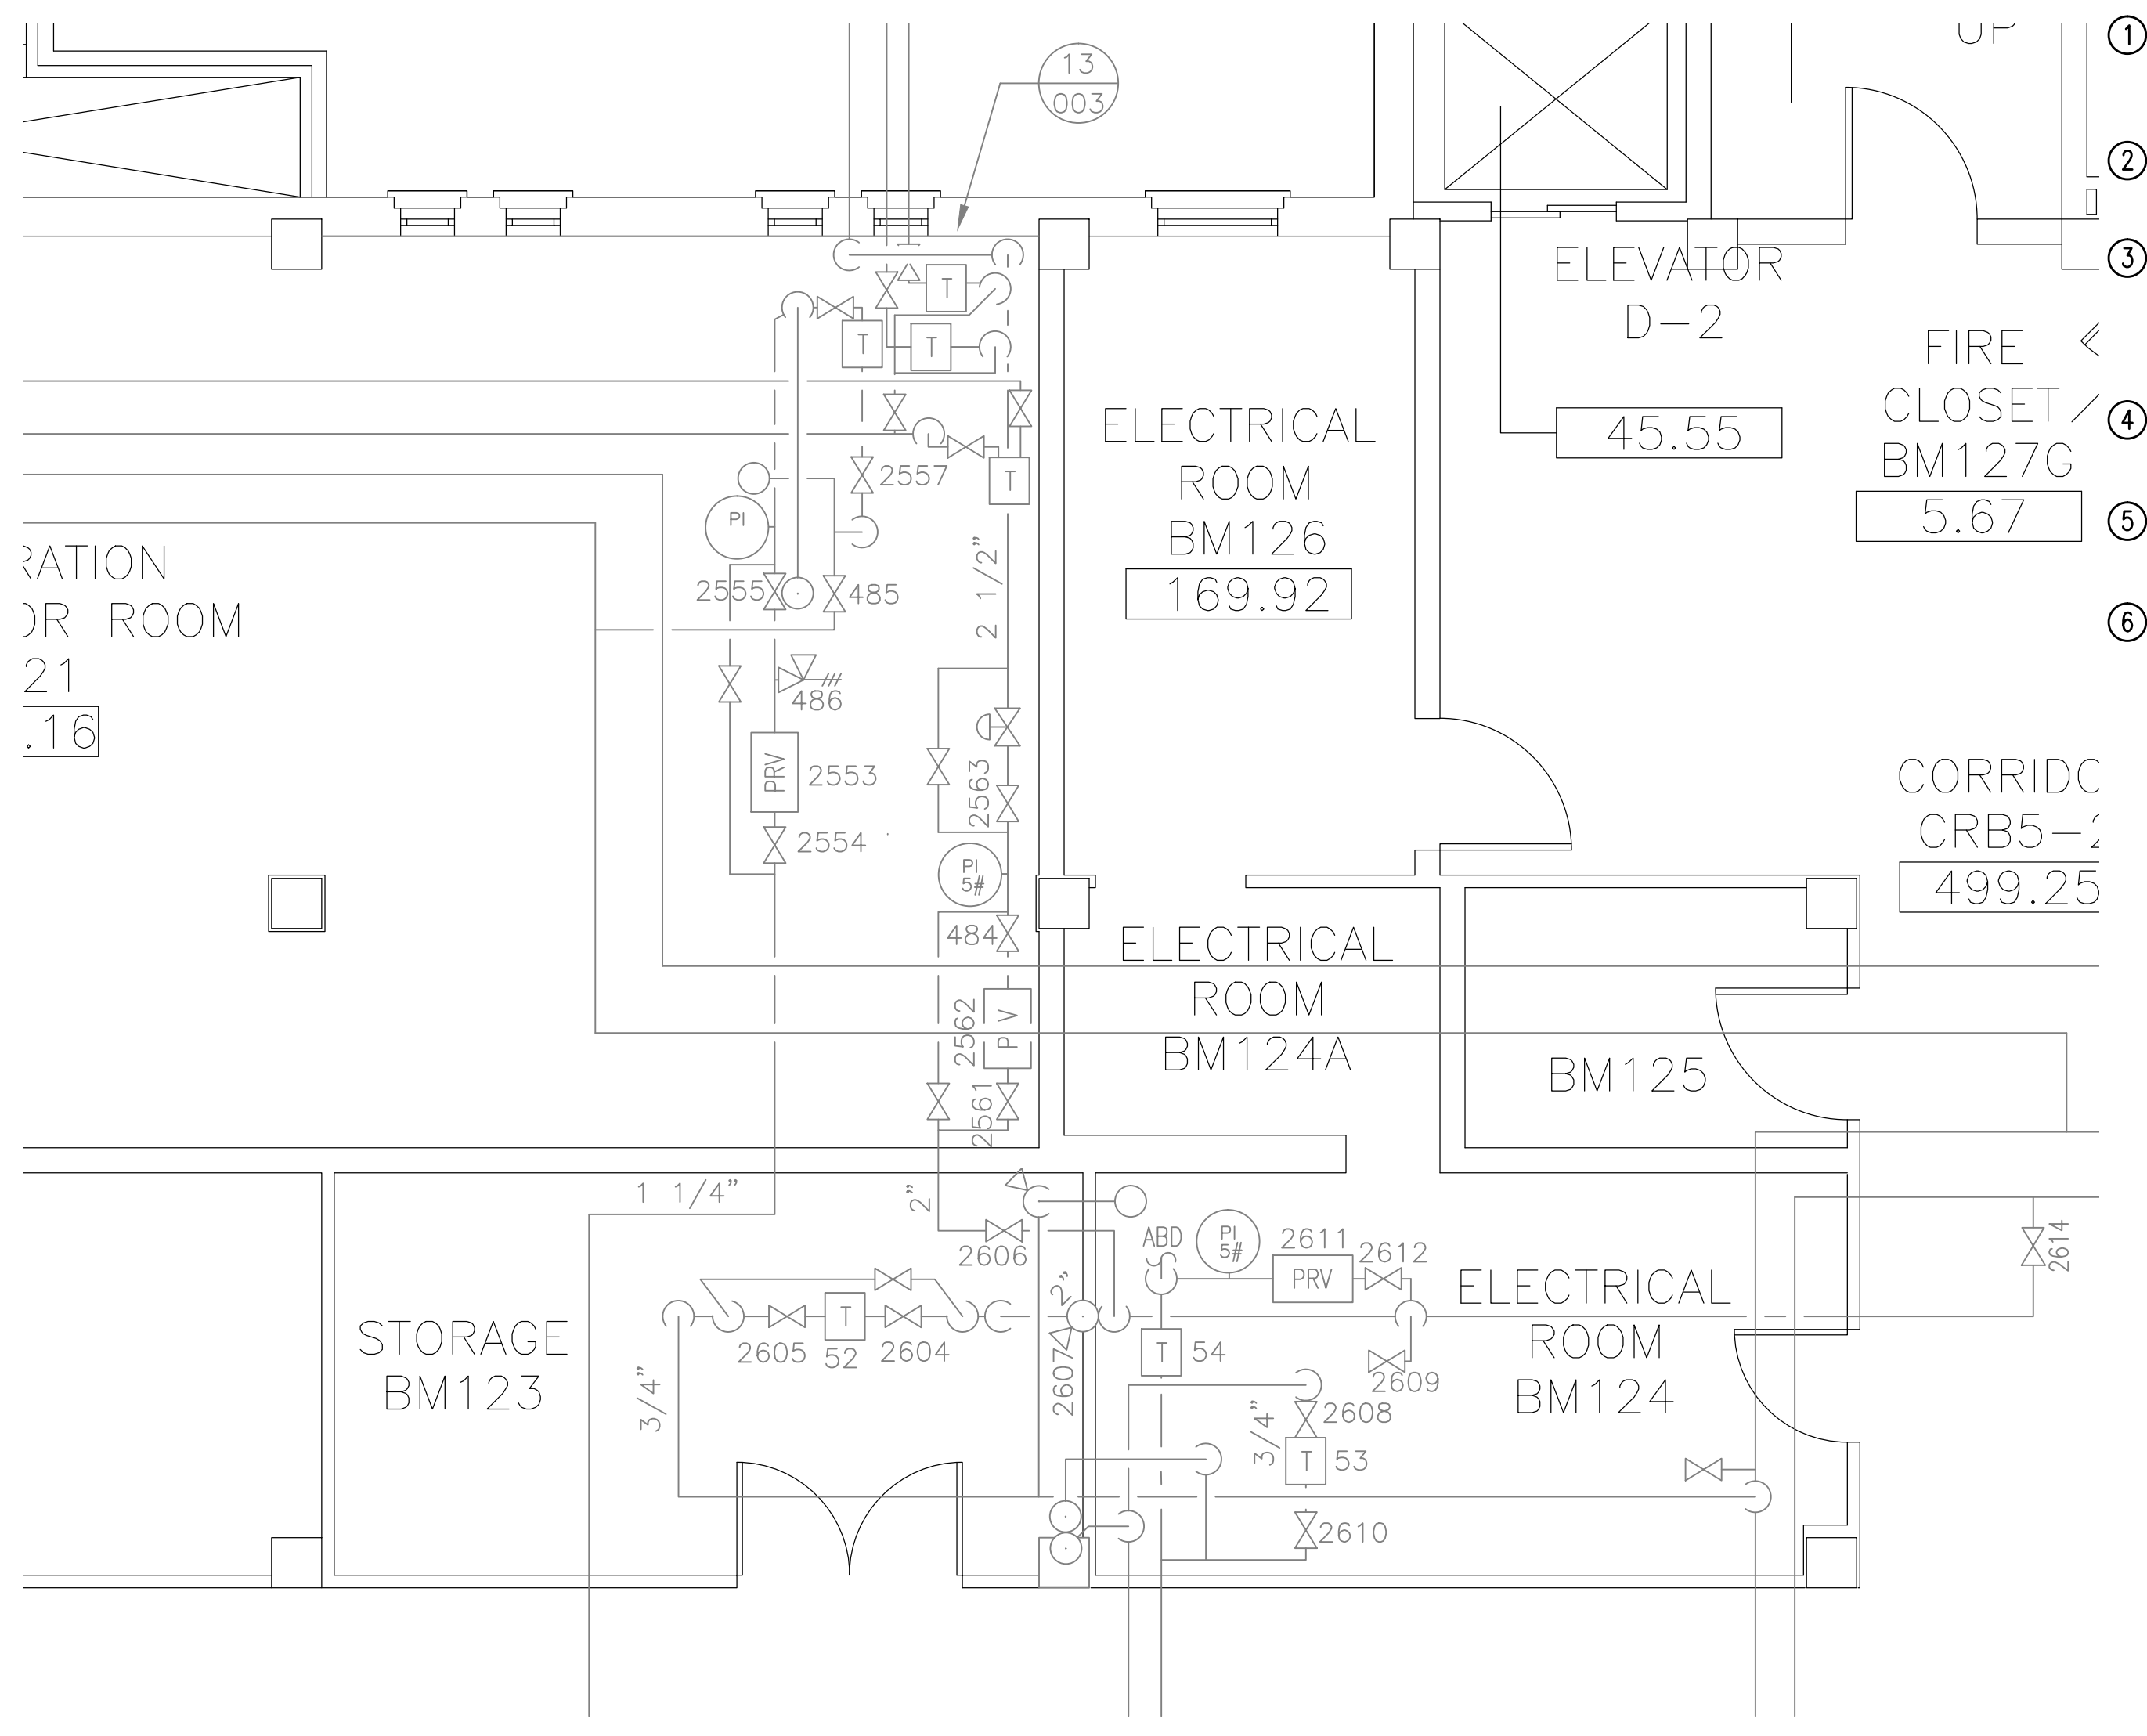




ELECTRICAL ROOM BM124 ENLARGED
SCALE: 1/4" = 1'-0"

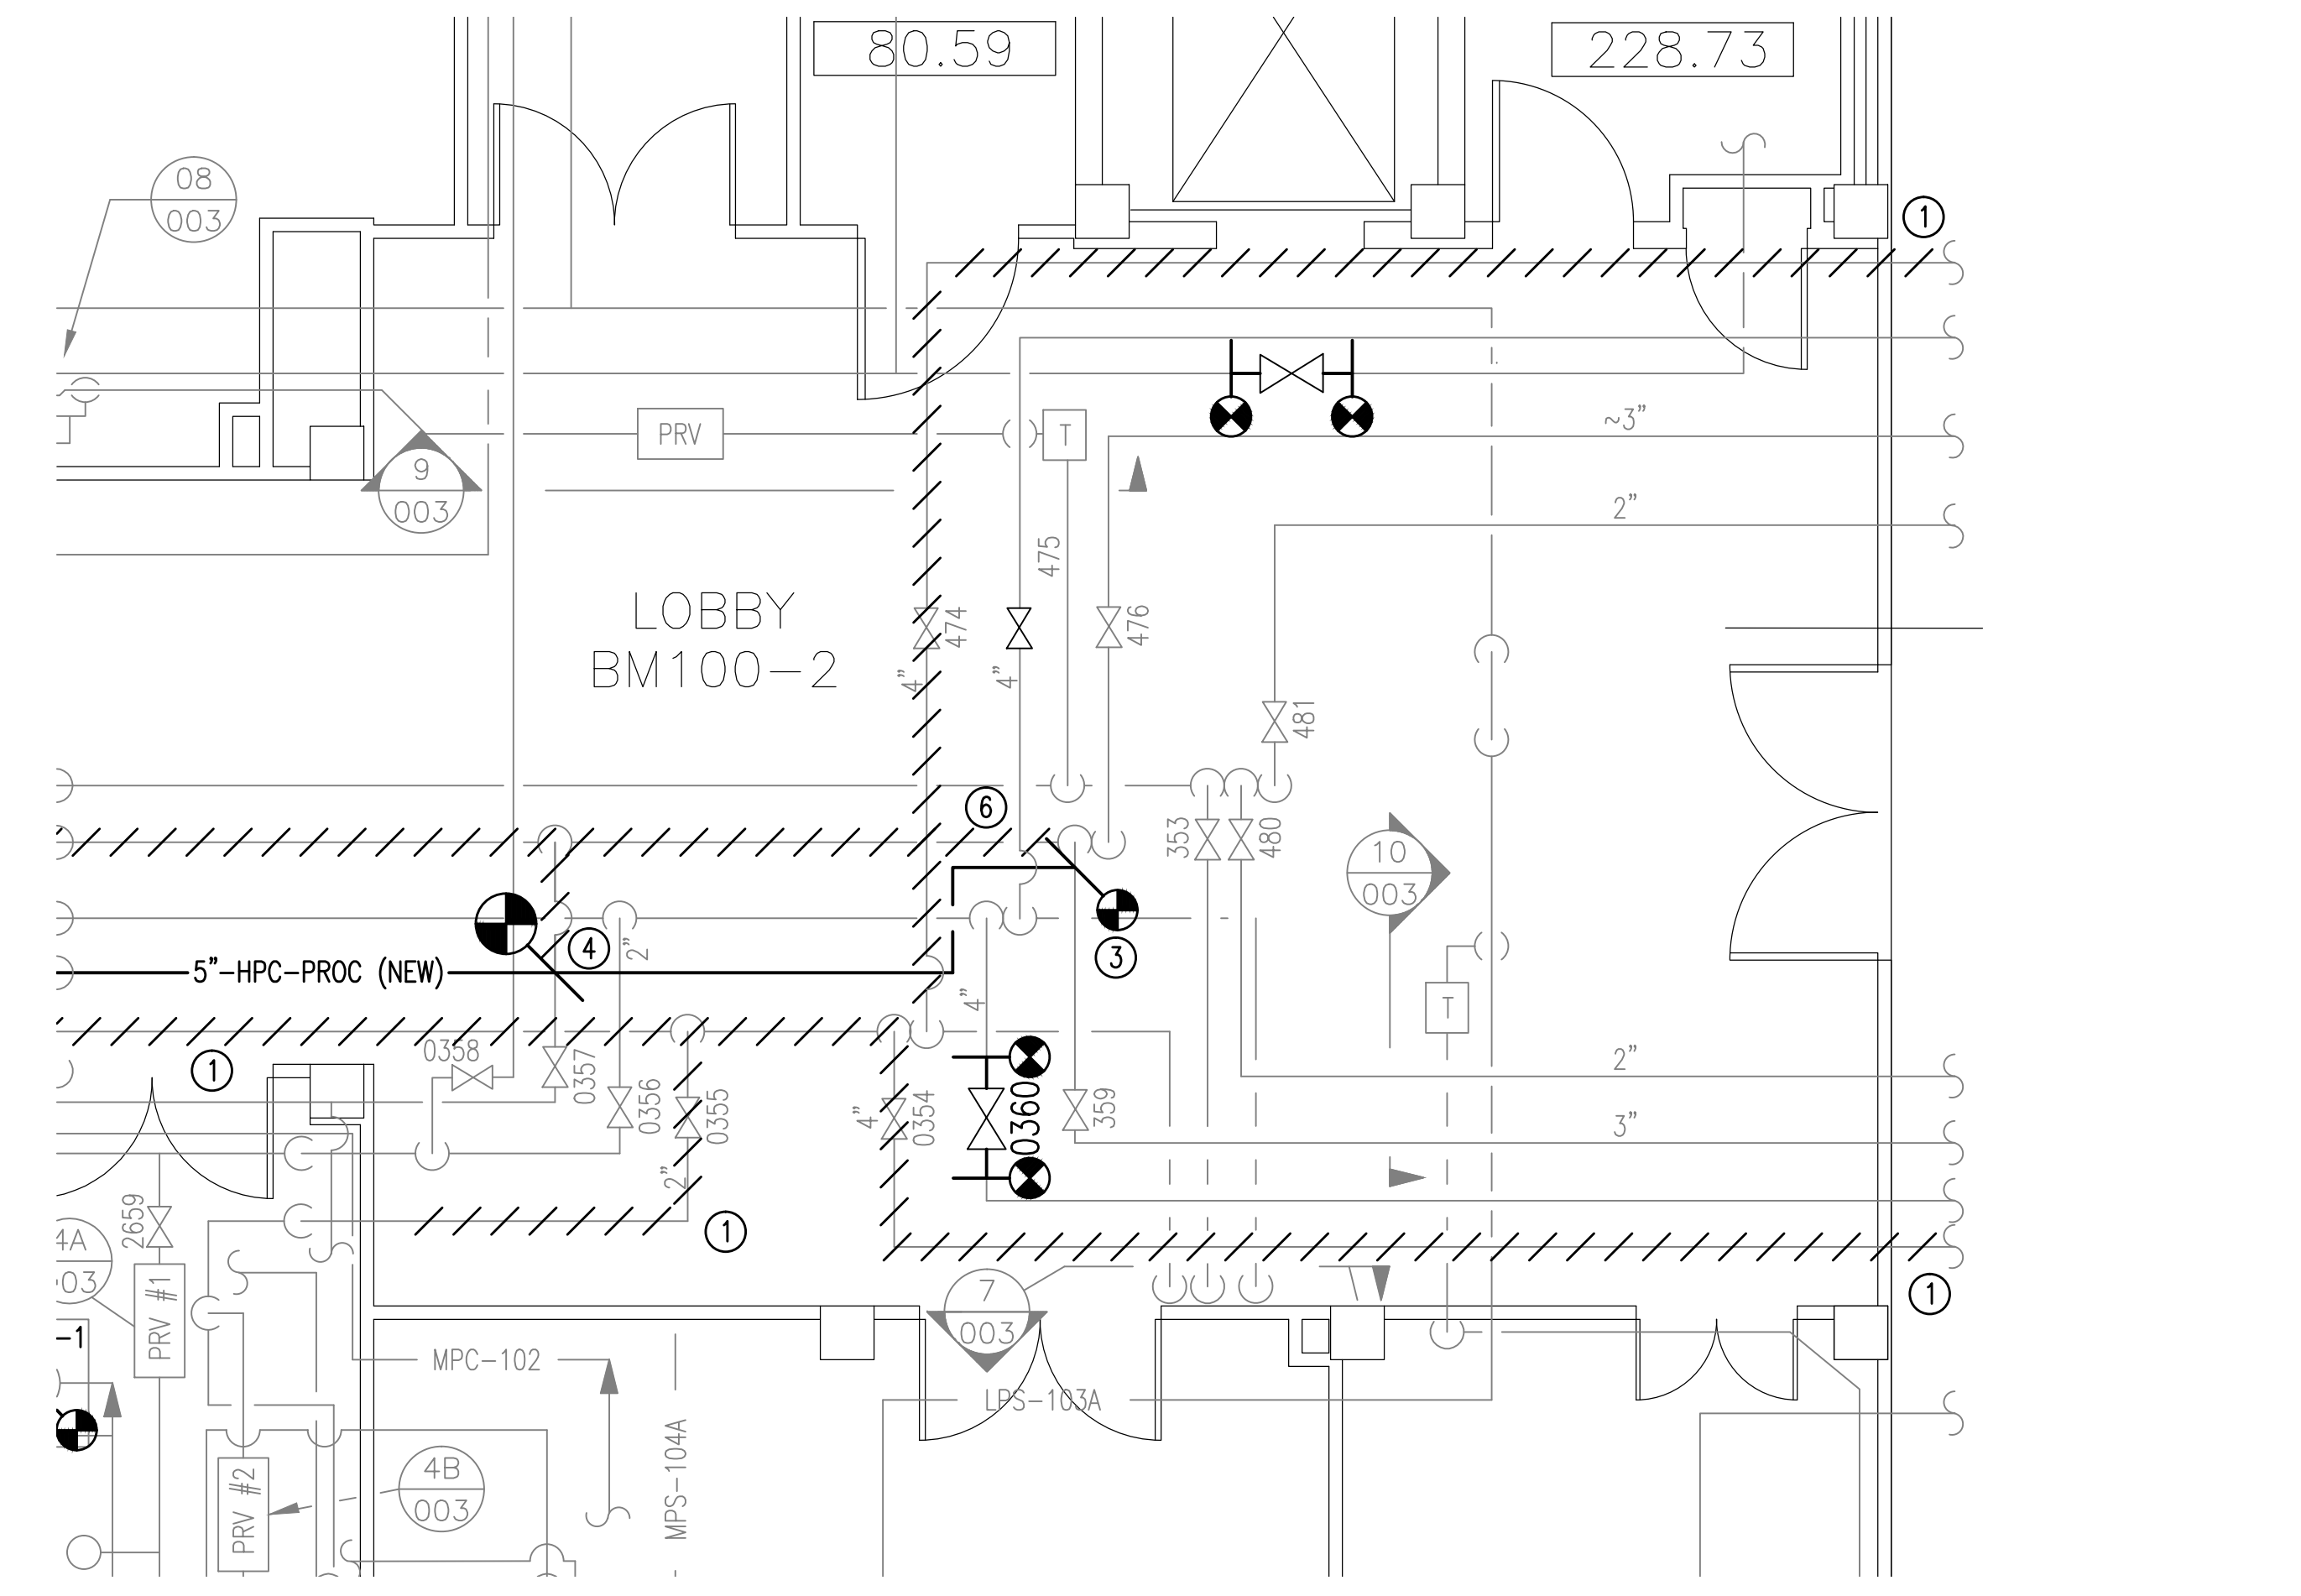

LOBBY BM100-2 ENLARGED
SCALE: 1/4" = 1'-0"

- NOTES:**
(THIS SHEET ONLY)
- 1 REMOVE AND HAUL AWAY IN ITS ENTIRETY HPS HEATING STEAM PIPING. TURN OVER TO VA COTR ALL VALVES AND STEAM TRAP TAGS THAT ARE NOT REUSED.
 - 2 PROVIDE INDICATED AUTOMATIC PUMP TRAP AS SCHEDULED. SEE DETAILS (TYPE 1) ON SHEET I-1.04.
 - 3 AFTER HPS HEATING STEAM PIPING IS REMOVED, INSTALL IN ITS PLACE 5" HPC RETURN PIPING FROM THIS LOCATION TO BUILDING 27. SEE SHEET 27-G-001. MAKE CONNECTION HERE SO THAT ONLY BUILDING 2 IS NOT RETURNING TO STEAM PLANT.
 - 4 AFTER NEW 5" HPC IS IN SERVICE, DISCONNECT THIS LINE FROM VALVE NO. 0357 AND CONNECT TO NEW 5" HPC LINE.
 - 5 AFTER NEW 5" HPC IS IN SERVICE, DISCONNECT THIS LINE FROM VALVE NO. 2603 AND CONNECT TO NEW 5" HPC LINE.
 - 6 AFTER NEW 5" HPC IS INSTALLED AND OPERATING REMOVE AND HAUL AWAY THE NOW ABANDONED 5" HPC FROM THIS LOCATION ALL THE WAY TO THE VALVE LOCATION IN BUILDING 27. SEE SHEET 27-G-001.

		<div> APPLIED ENGINEERING SOLUTIONS 440 Martin Luther King, Jr. Blvd., Suite 401 Macon, Georgia 31201 (478) 314-1270 www.aes-pe.com</div>	<div> KEY PLAN SCALE: NONE</div>	<div> Professional Engineer LINDO J. CAMEJO No. 2545 State of Georgia Mechanical Engineering</div>	Drawing Title		Project Title		Date	
BUILDING 2 ENLARGED PLANS					STEAM AND CONDENSATE PIPING SYSTEM STUDY		JUNE 22, 2012			
					Building Number 2	Checked PJC	Drawn JSW	Project No. 557-10-109		
FINAL SUBMITTAL					Location CARL VINSON VA MEDICAL CENTER DUBLIN, GEORGIA		DRAWING NO. 02-G-002			
Revisions		Date		Dwg. 12 of 87		Veterans Administration				

VA FORM 08-531A, MAR 1994

U.S. GOVERNMENT PRINTING OFFICE: 1984-0-440-100