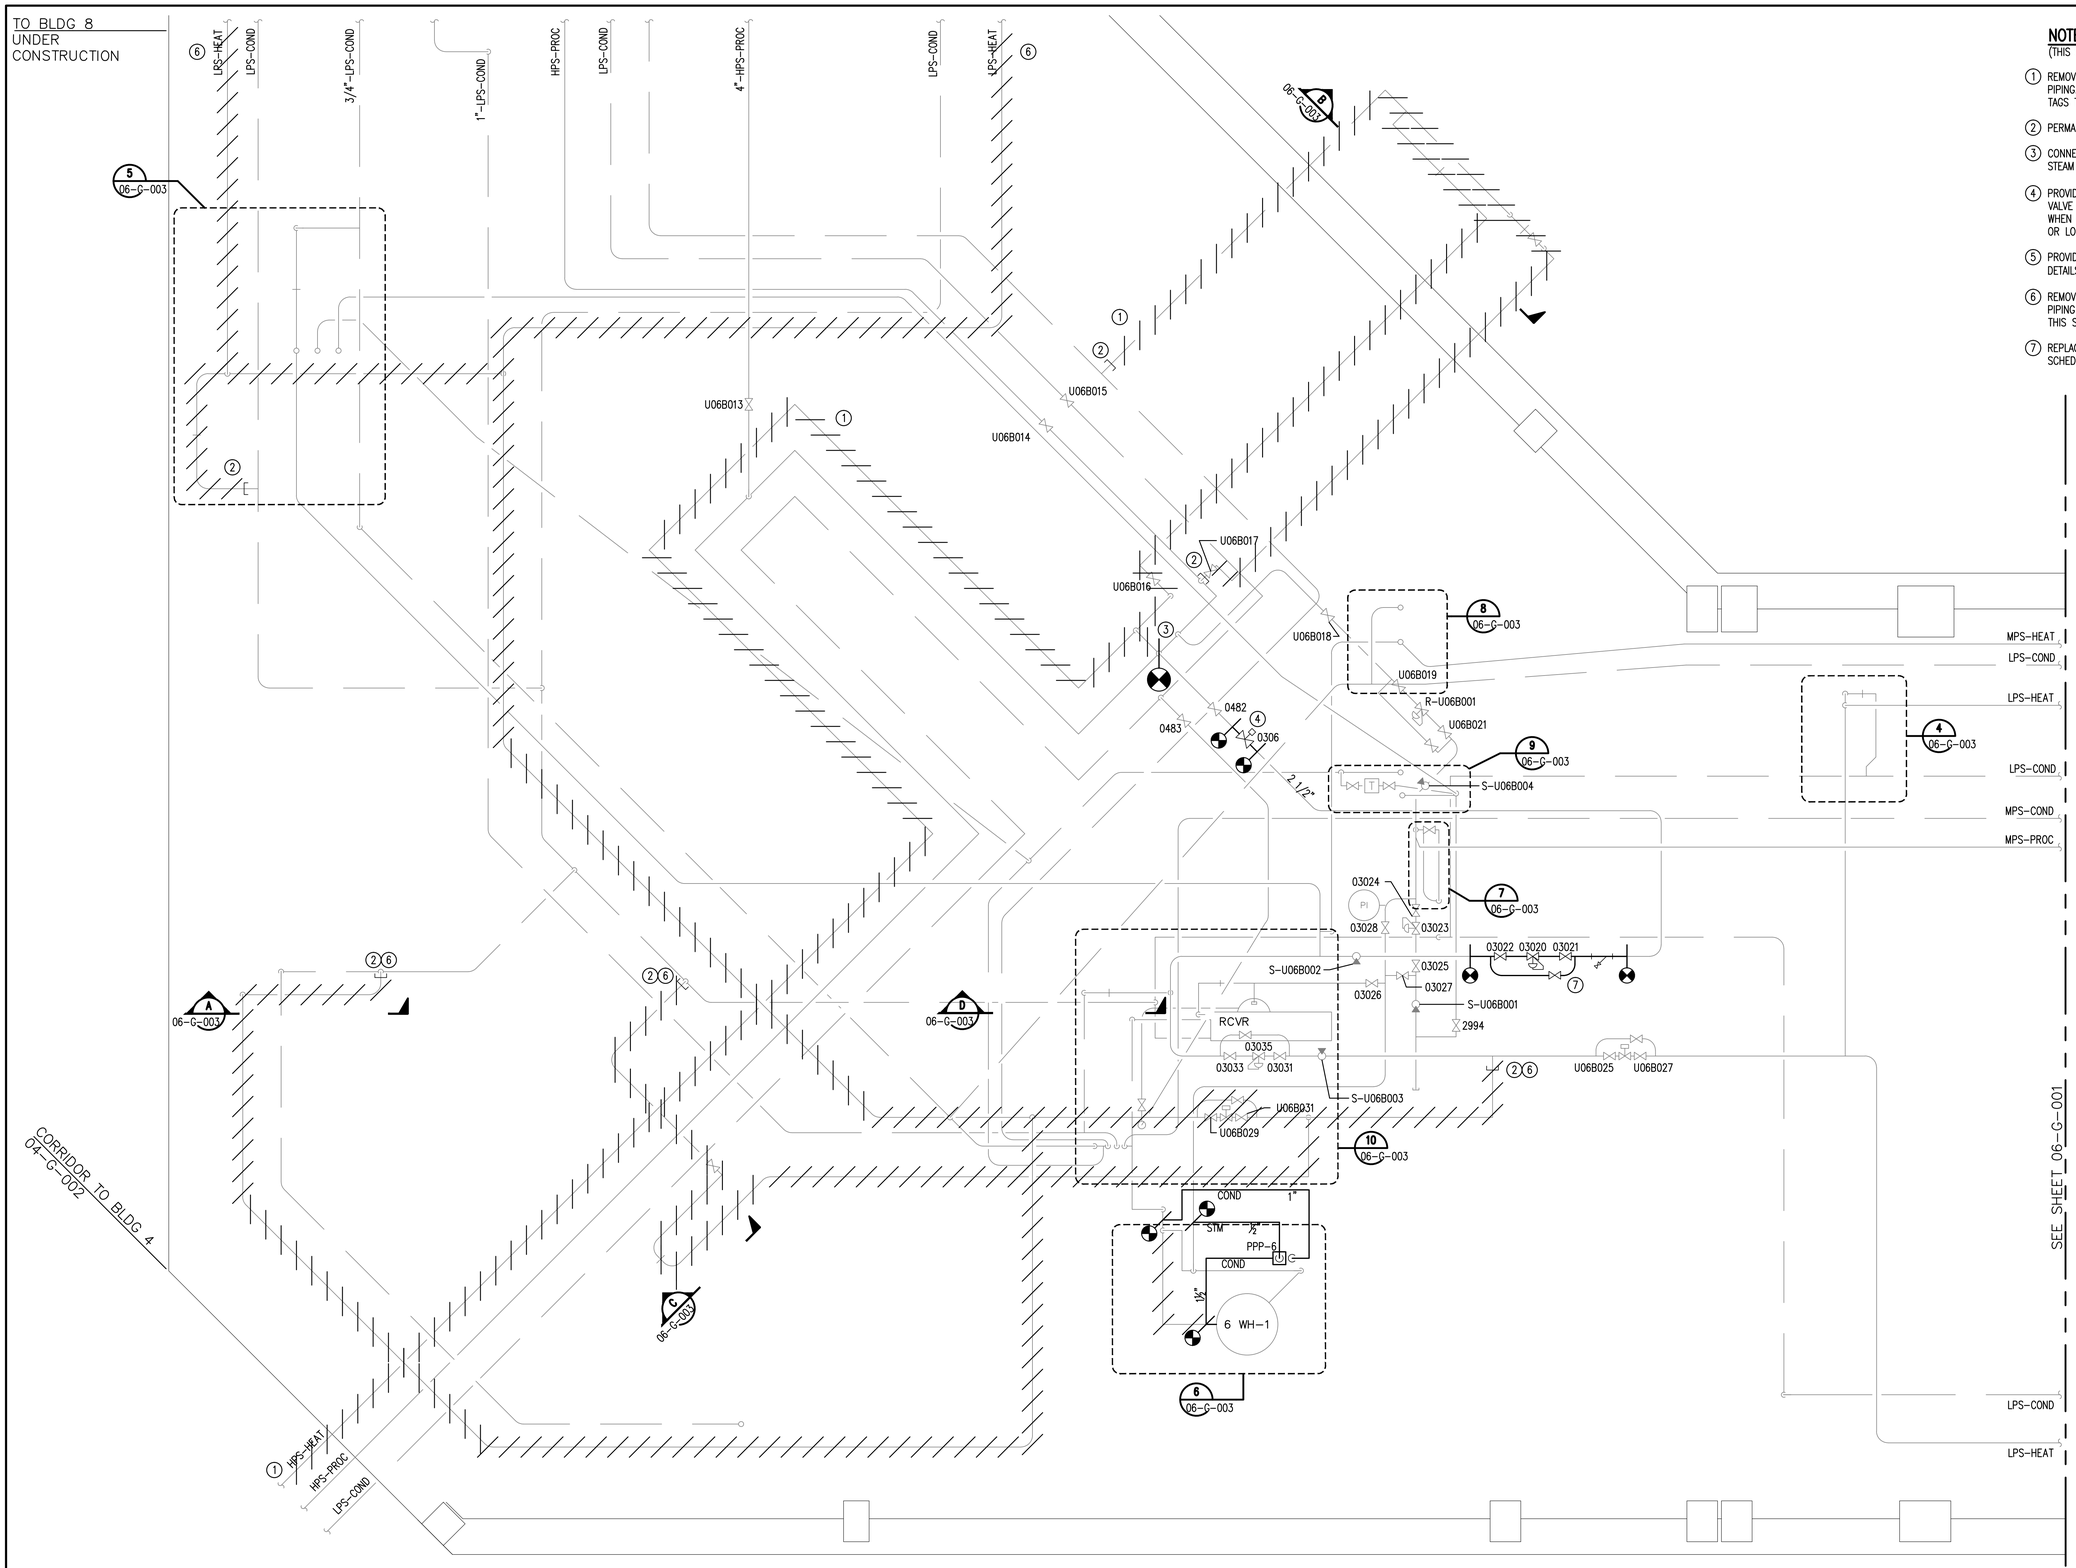

NOTES:
(THIS SHEET ONLY)

1. REMOVE AND HAUL AWAY IN ITS ENTIRETY HPS HEATING STEAM PIPING. TURN OVER TO VA COTR ALL VALVES AND STEAM TRAP TAGS THAT ARE NOT REUSED.
2. PERMANENTLY CAP BRANCH LINE AS CLOSE TO MAIN AS POSSIBLE.
3. CONNECT PIPE PROVIDING STEAM TO PRV 03020 TO HPS PROCESS STEAM TO THIS APPROXIMATE LOCATION.
4. PROVIDE 2½" AUTOMATIC ELECTRIC ACTUATED NORMALLY CLOSED VALVE AND CONNECT TO TRIDIUM CONTROL SYSTEM TO OPEN VALVE WHEN OUTSIDE AIR TEMPERATURE IS BELOW 55°f FOR 5 MINUTES OR LONGER. REUSE VALVE TAG 0306.
5. PROVIDE INDICATED AUTOMATIC PUMP TRAP AS SCHEDULED. SEE DETAILS (TYPE 1) ON SHEET I1.04.
6. REMOVE AND HAUL AWAY IN ITS ENTIRETY LPS HEATING STEAM PIPING FROM BUILDING 8 CRAWL SPACE TO LOCATIONS SHOWN ON THIS SHEET.
7. REPLACE EXISTING HEATING ONLY PRESSURE REDUCING STATION AS SCHEDULED AND DETAILED.

BUILDING 6
CRAWL SPACE ENLARGED PLAN
SCALE: 1/2" = 1'-0"

Revisions	Date

APPLIED ENGINEERING SOLUTIONS
440 Martin Luther King, Jr. Blvd., Suite 401
Macon, Georgia 31201
(478) 314-1270
www.aes-pe.com

KEY PLAN
SCALE: NONE

GEORGIA REGISTERED PROFESSIONAL ENGINEER NO. 21245 PEDRO J. CAMEJO

Drawing Title	Project Title	Date
DETAIL	STEAM AND CONDENSATE PIPING SYSTEM STUDY	JUNE 22, 2012
		Project No. 557-10-109
FINAL SUBMITTAL	Building Number 6 / Checked PJC / Drawn JSW	DRAWING NO. 06-G-002
	Location CARL VINSON VA MEDICAL CENTER DUBLIN, GEORGIA	Dwg. 39 Of 87

Veterans Administration

VA FORM 08-6231A, MAR 1984

U.S.GOVERNMENT PRINTING OFFICE:1984-440-467