NOTES:
(THIS SHEET ONLY)

(1) REPAIR EXISTING SPIRAX SARCO:
MODEL PPC 3x2 CONDENSATE PUMP
NUMBER 289 LOCATED IN ROOM BM 100-15 BY REPLACING THE ENTIRE VALVE ASSEMBLY. SEE CONDENSATE PUMP VALVE ASSEMBLY REPLACEMENT DETAIL ON SHEET I-1.03.

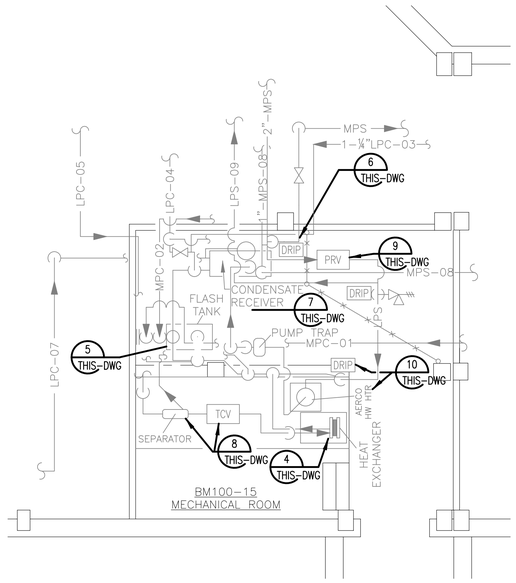

DETAIL 3
SCALE: NONE

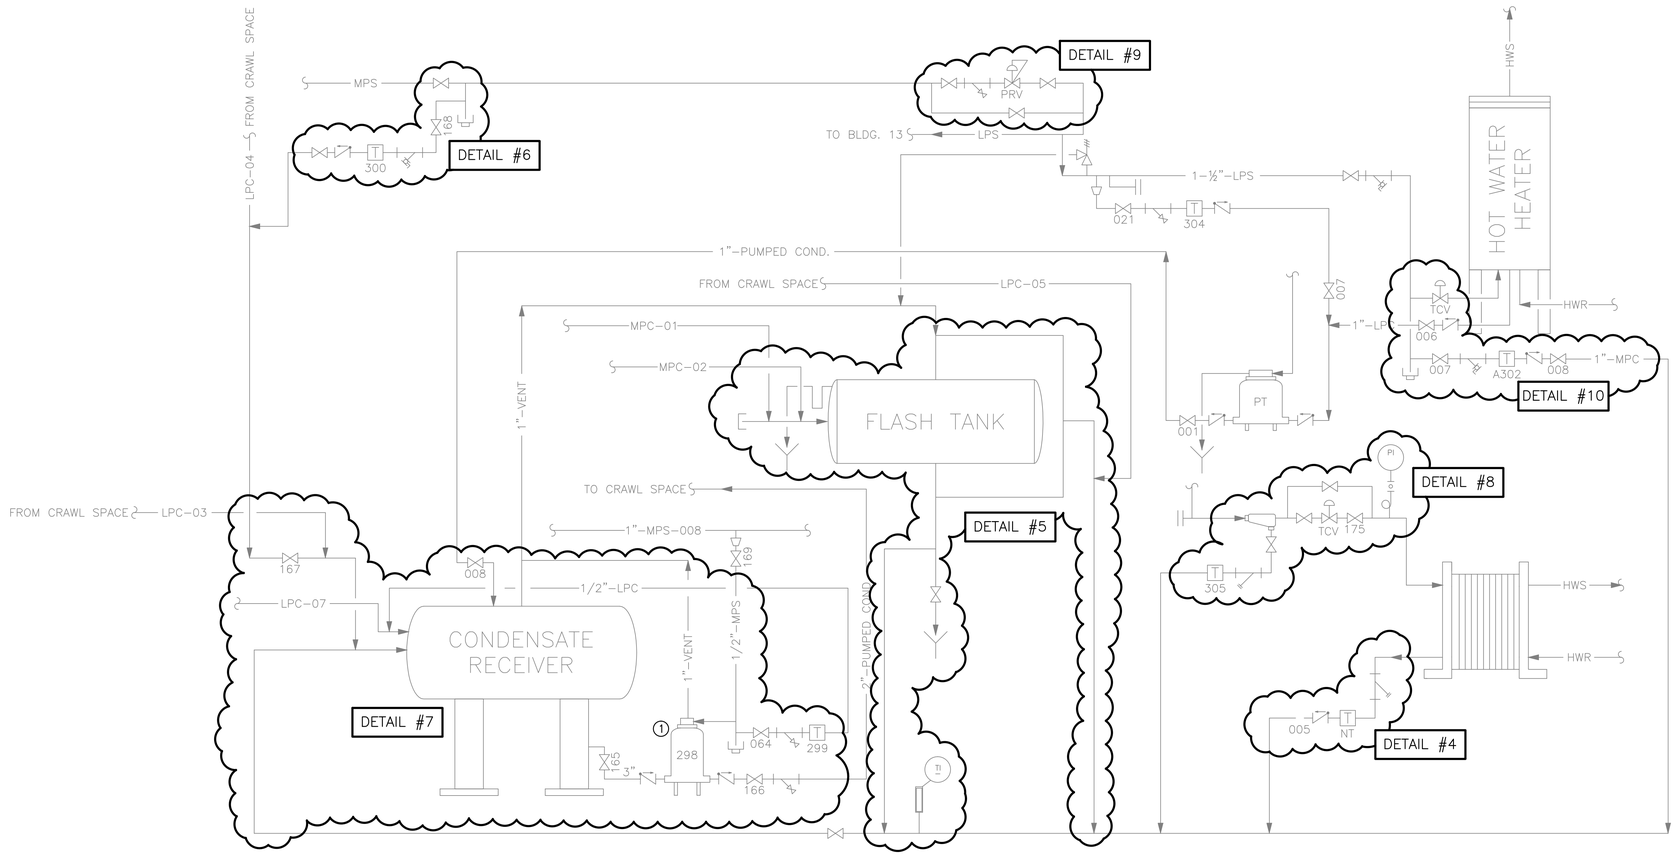

DETAILS
SCALE: NONE

Revisions	Date

APPLIED ENGINEERING SOLUTIONS
440 Martin Luther King, Jr. Blvd., Suite 401
Macon, Georgia 31201
(478) 314-1270
www.aes-pe.com



GEORGIA REGISTERED NO. 21945 PROFESSIONAL ENGINEER PEDRO J. CAMEJO

Drawing Title	DETAILS
	FINAL SUBMITTAL
Project Title	STEAM AND CONDENSATE PIPING SYSTEM STUDY
Building Number	15
Checked	PJC
Drawn	JSW
Location	CARL VINSON VA MEDICAL CENTER DUBLIN, GEORGIA
Date	JUNE 22, 2012
Project No.	557-10-109
DRAWING NO.	15-G-003
Dwg. 73 Of 87	

Veterans Administration

VA FORM 08-6231A, MAR 1984

U.S.GOVERNMENT PRINTING OFFICE:1984-440-467