



A three inches = one foot  
 B one and one-half inches = one foot  
 C one inch = one foot  
 D three-quarters inch = one foot  
 E one-half inch = one foot  
 F three-eighths inch = one foot  
 G one-quarter inch = one foot  
 H one-eighth inch = one foot

- NOTES:**  
 (THIS SHEET ONLY)
- ① REPAIR EXISTING SPIRAX SARCO: MODEL PPC 3x2 CONDENSATE PUMP NUMBER 219 LOCATED IN ROOM BM 109-16 BY REPLACING THE ENTIRE VALVE ASSEMBLY. SEE CONDENSATE PUMP VALVE ASSEMBLY REPLACEMENT DETAIL ON SHEET I-1.03.
  - ② 1" CONDENSATE FROM NEW PPP-9. SEE SHEET 16-G-003.

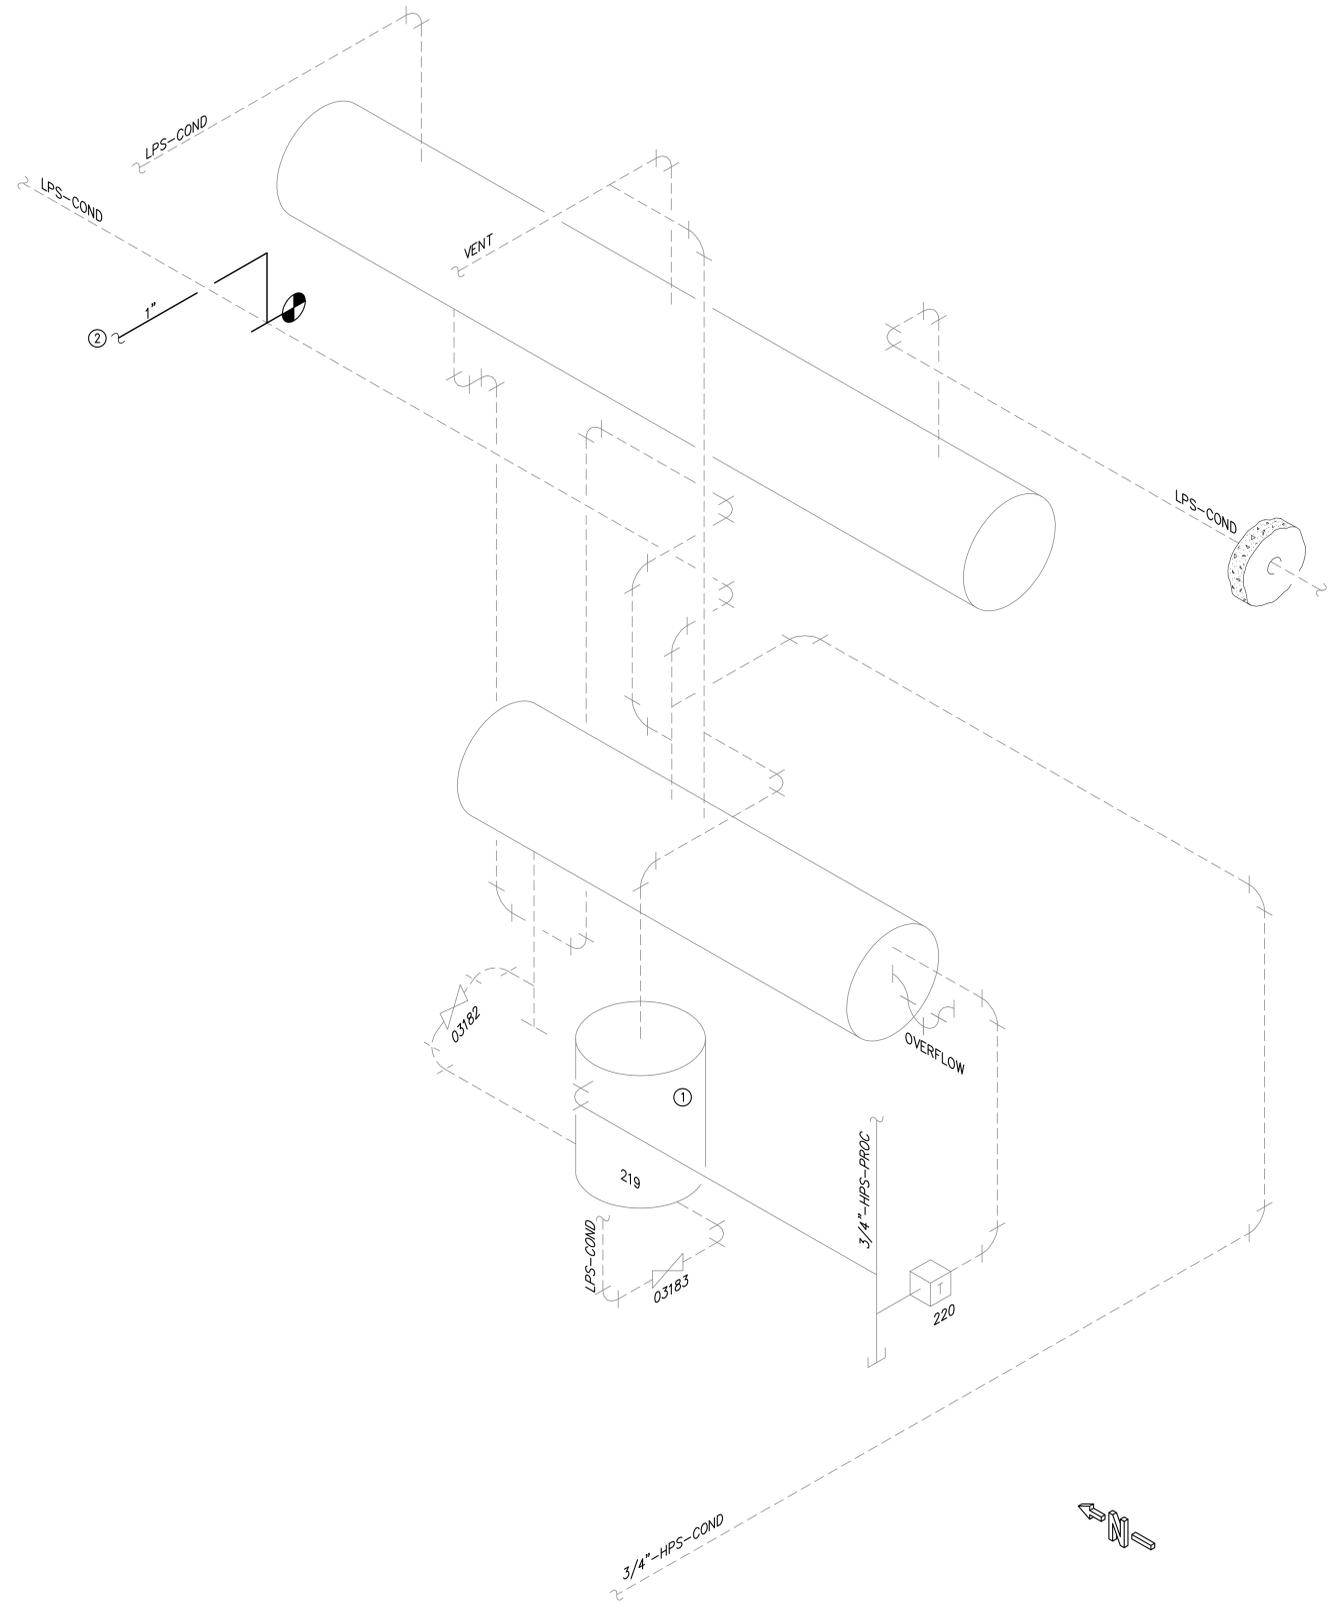

**DETAIL 7**  
 SCALE: NONE

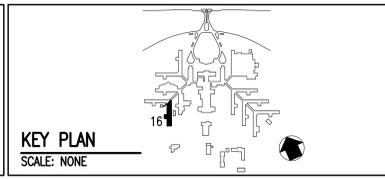

Revisions	Date

**APPLIED ENGINEERING SOLUTIONS**  
 440 Martin Luther King, Jr. Blvd., Suite 401  
 Macon, Georgia 31201  
 (478) 314-1270  
 www.aes-pe.com


Drawing Title <b>DETAILS</b>	Project Title <b>STEAM AND CONDENSATE PIPING SYSTEM STUDY</b>			Date JUNE 22, 2012
	Building Number 16	Checked PJC	Drawn JSW	Project No. 557-10-109
FINAL SUBMITTAL		Location CARL VINSON VA MEDICAL CENTER DUBLIN, GEORGIA		Drawing No. <b>16-G-004</b> Dwg. 78 Of 87

Veterans Administration