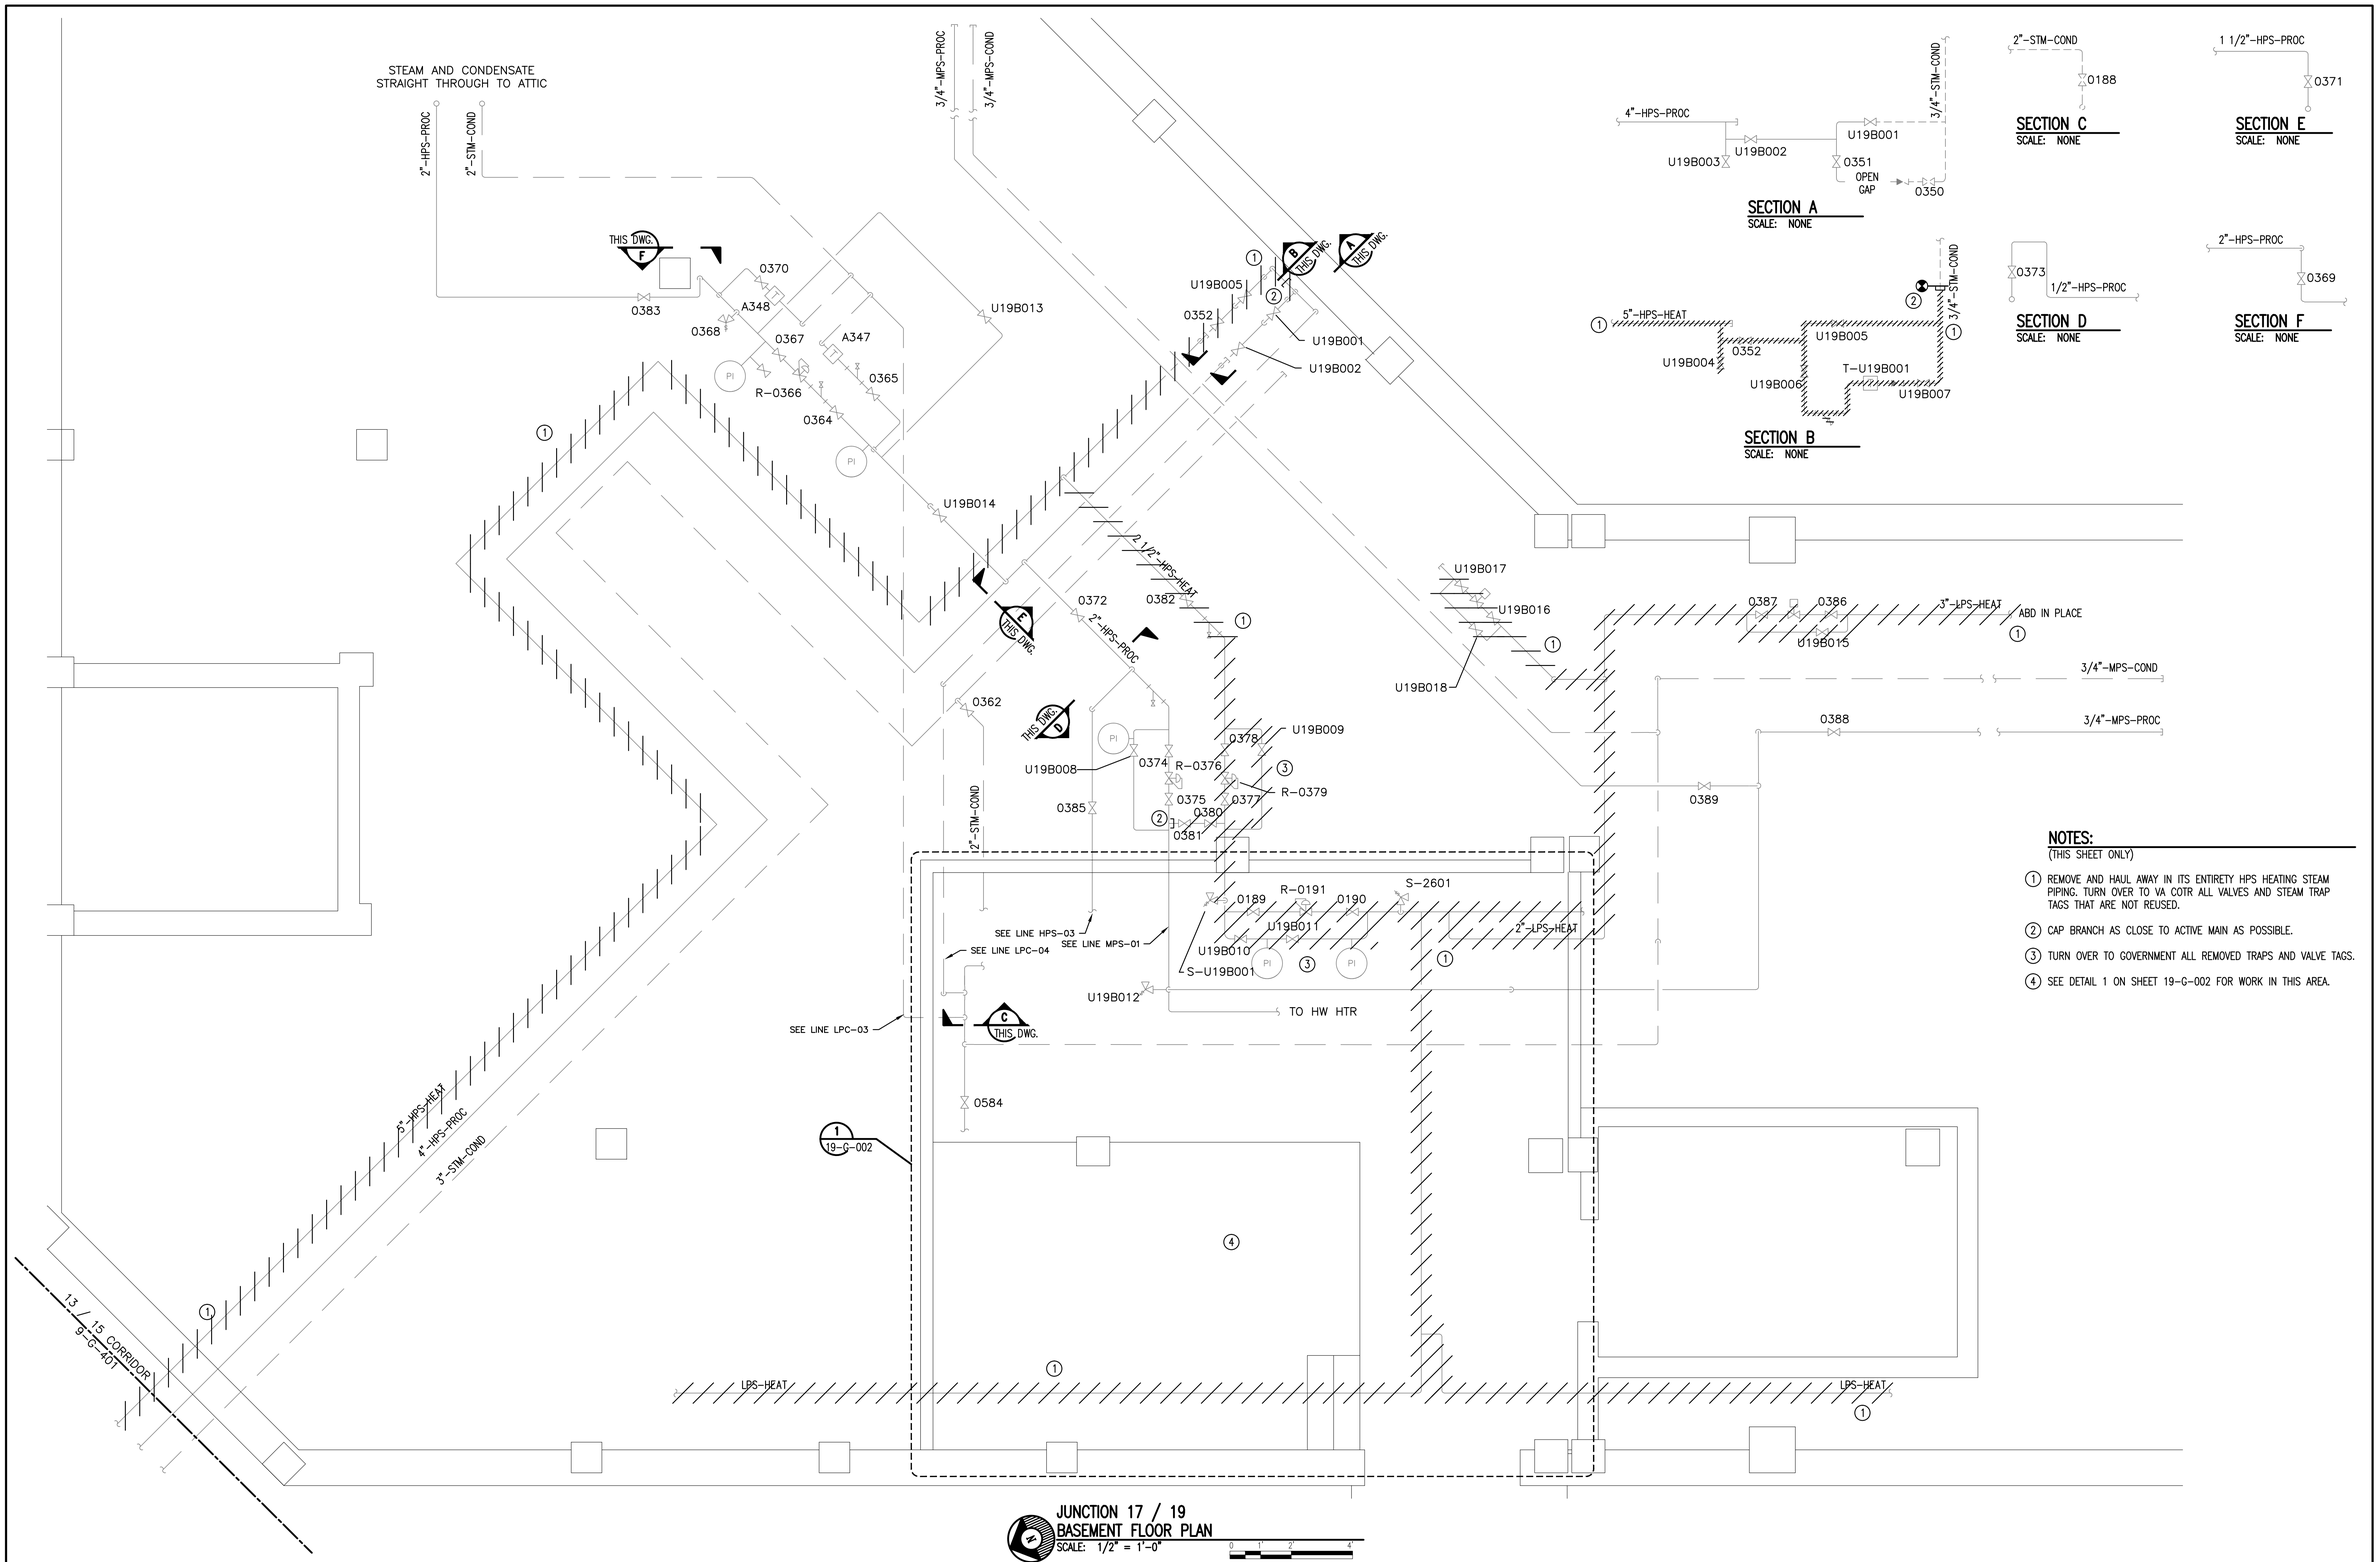

NOTES:
(THIS SHEET ONLY)

1. REMOVE AND HAUL AWAY IN ITS ENTIRETY HPS HEATING STEAM PIPING. TURN OVER TO VA COTR ALL VALVES AND STEAM TRAP TAGS THAT ARE NOT REUSED.
2. CAP BRANCH AS CLOSE TO ACTIVE MAIN AS POSSIBLE.
3. TURN OVER TO GOVERNMENT ALL REMOVED TRAPS AND VALVE TAGS.
4. SEE DETAIL 1 ON SHEET 19-G-002 FOR WORK IN THIS AREA.

JUNCTION 17 / 19
BASEMENT FLOOR PLAN
SCALE: 1/2" = 1'-0"

Revisions	Date

APPLIED ENGINEERING SOLUTIONS
440 Martin Luther King, Jr. Blvd., Suite 401
Macon, Georgia 31201
(478) 314-1270
www.aes-pe.com

KEY PLAN
SCALE: NONE

GEORGIA REGISTERED PROFESSIONAL ENGINEER NO. 12245 PEDRO J. CAMEJO

Drawing Title	JUNCTION 17 / 19 BASEMENT FLOOR PLAN
Project Title	STEAM AND CONDENSATE PIPING SYSTEM STUDY
Date	JUNE 22, 2012
Project No.	557-10-109
Building Number	19
Checked	PJC
Drawn	JSW
DRAWING NO.	19-G-001
Location	CARL VINSON VA MEDICAL CENTER DUBLIN, GEORGIA
Dwg.	79 Of 87

FINAL SUBMITTAL

Veterans Administration

VA FORM 08-6231A, MAR 1984
U.S.GOVERNMENT PRINTING OFFICE:1984-440-467