


1
2
3
4
5
6
7
8

A
B
C
D
E


one inch = one foot
three-quarters inch = one foot
one-half inch = one foot
three-eighths inch = one foot
one-quarter inch = one foot
one-eighth inch = one foot

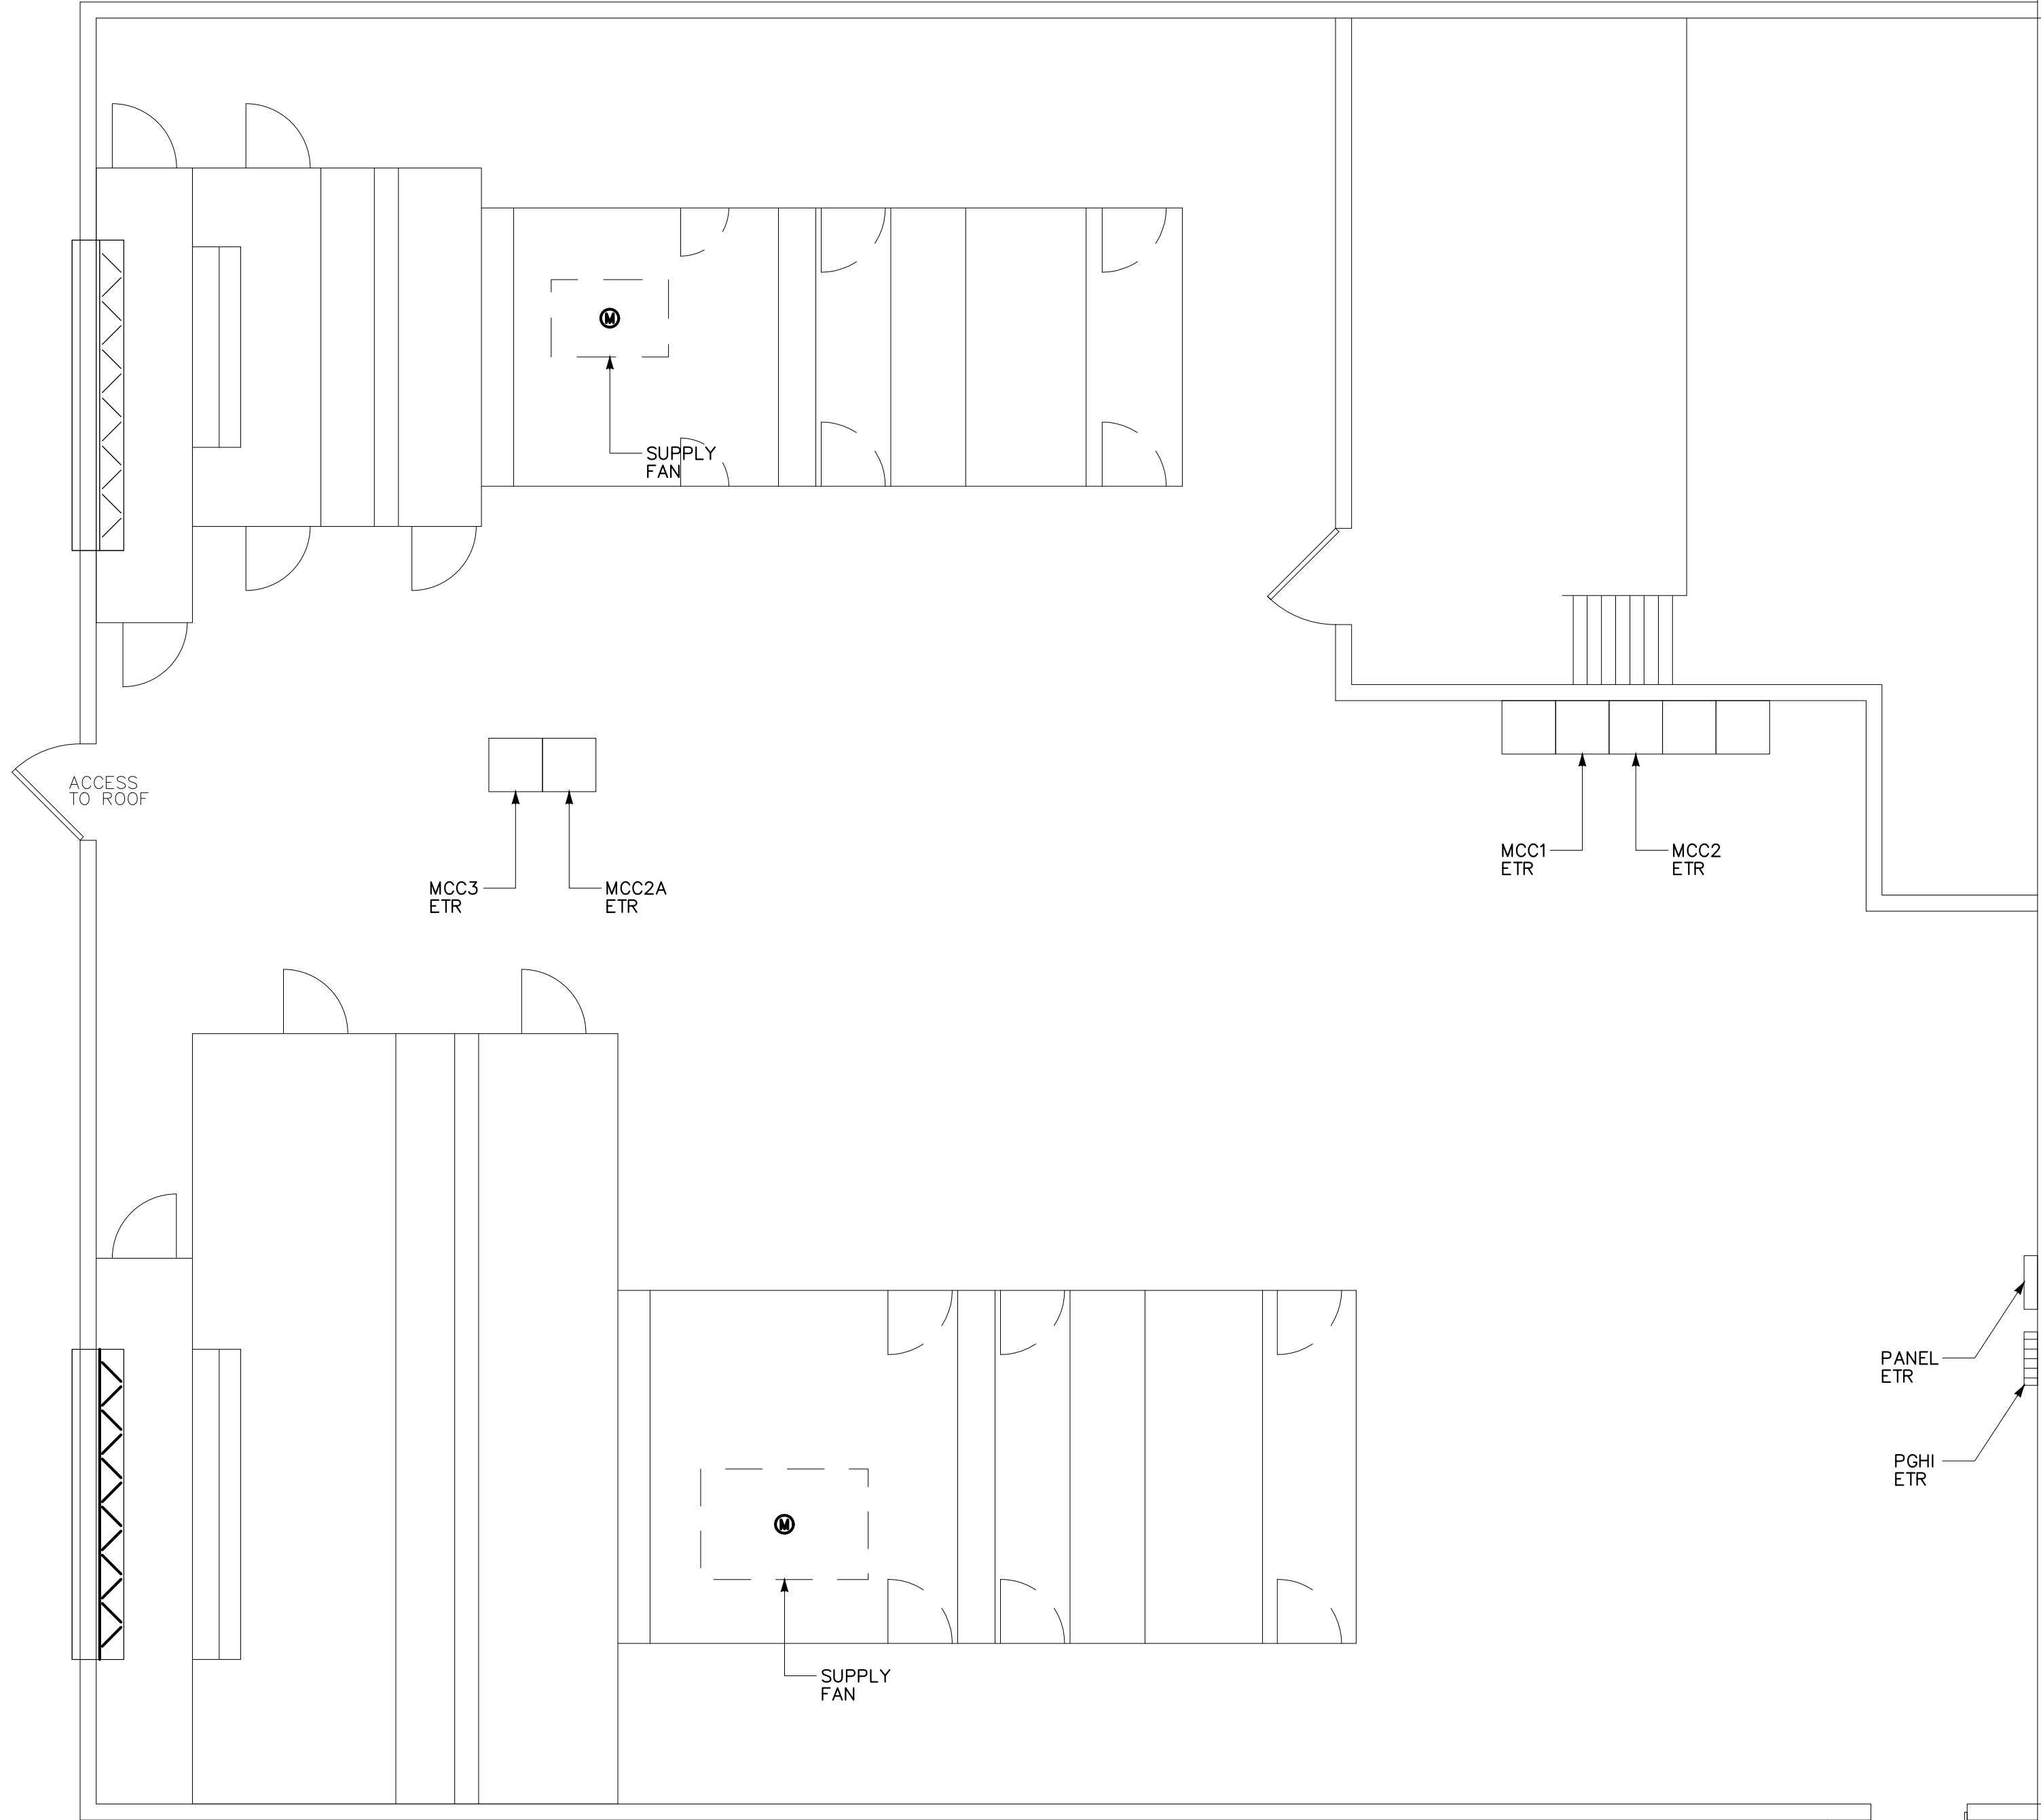

E-WING MECHANICAL PENTHOUSE – REMOVAL 1
?" = 1'-0"

GENERAL NOTES:


- A. DISCONNECT AND REMOVE ALL EXISTING ELECTRICAL EQUIPMENT, WIRING, AND RACEWAYS IN DASHED LINE STYLE UNLESS NOTED TO REMAIN OR BE RELOCATED. DISCONNECT AND REMOVE ALL EXISTING LIGHT FIXTURES, HVAC EQUIPMENT, STARTERS, WIRING DEVICES, SPECIAL SYSTEMS DEVICES, AND ALL ASSOCIATED BRANCH CIRCUIT WIRING, SPECIAL SYSTEMS WIRING, AND RACEWAYS. WHERE EXISTING DEVICES ARE NOT BEING REUSED, THEY AND THEIR ASSOCIATED WIRING AND RACEWAYS SHALL BE COMPLETELY REMOVED BACK TO SOURCE.
- B. DISCONNECT AND REMOVE ALL EMPTY AND ABANDONED RACEWAYS UNLESS NOTED OTHERWISE. CUT FLUSH WITH FLOOR WHERE APPLICABLE AND PLUG WITH GROUT.
- C. COORDINATE ALL REMOVAL WORK WITH OTHER TRADES. PROVIDE ALL WIRING AND CONNECTIONS REQUIRED TO MAINTAIN BRANCH CIRCUIT OR SPECIAL SYSTEMS CIRCUIT CONTINUITY TO DEVICES AND EQUIPMENT TO REMAIN WHETHER LOCATED WITHIN OR OUTSIDE OF THE PROJECT BOUNDARY.
- D. "ETR" ADJACENT TO A DEVICE, FIXTURE, OR PIECE OF EQUIPMENT INDICATES ITEM SHALL REMAIN. MAINTAIN EXISTING ELECTRICAL CONNECTIONS UNLESS OTHERWISE NOTED.

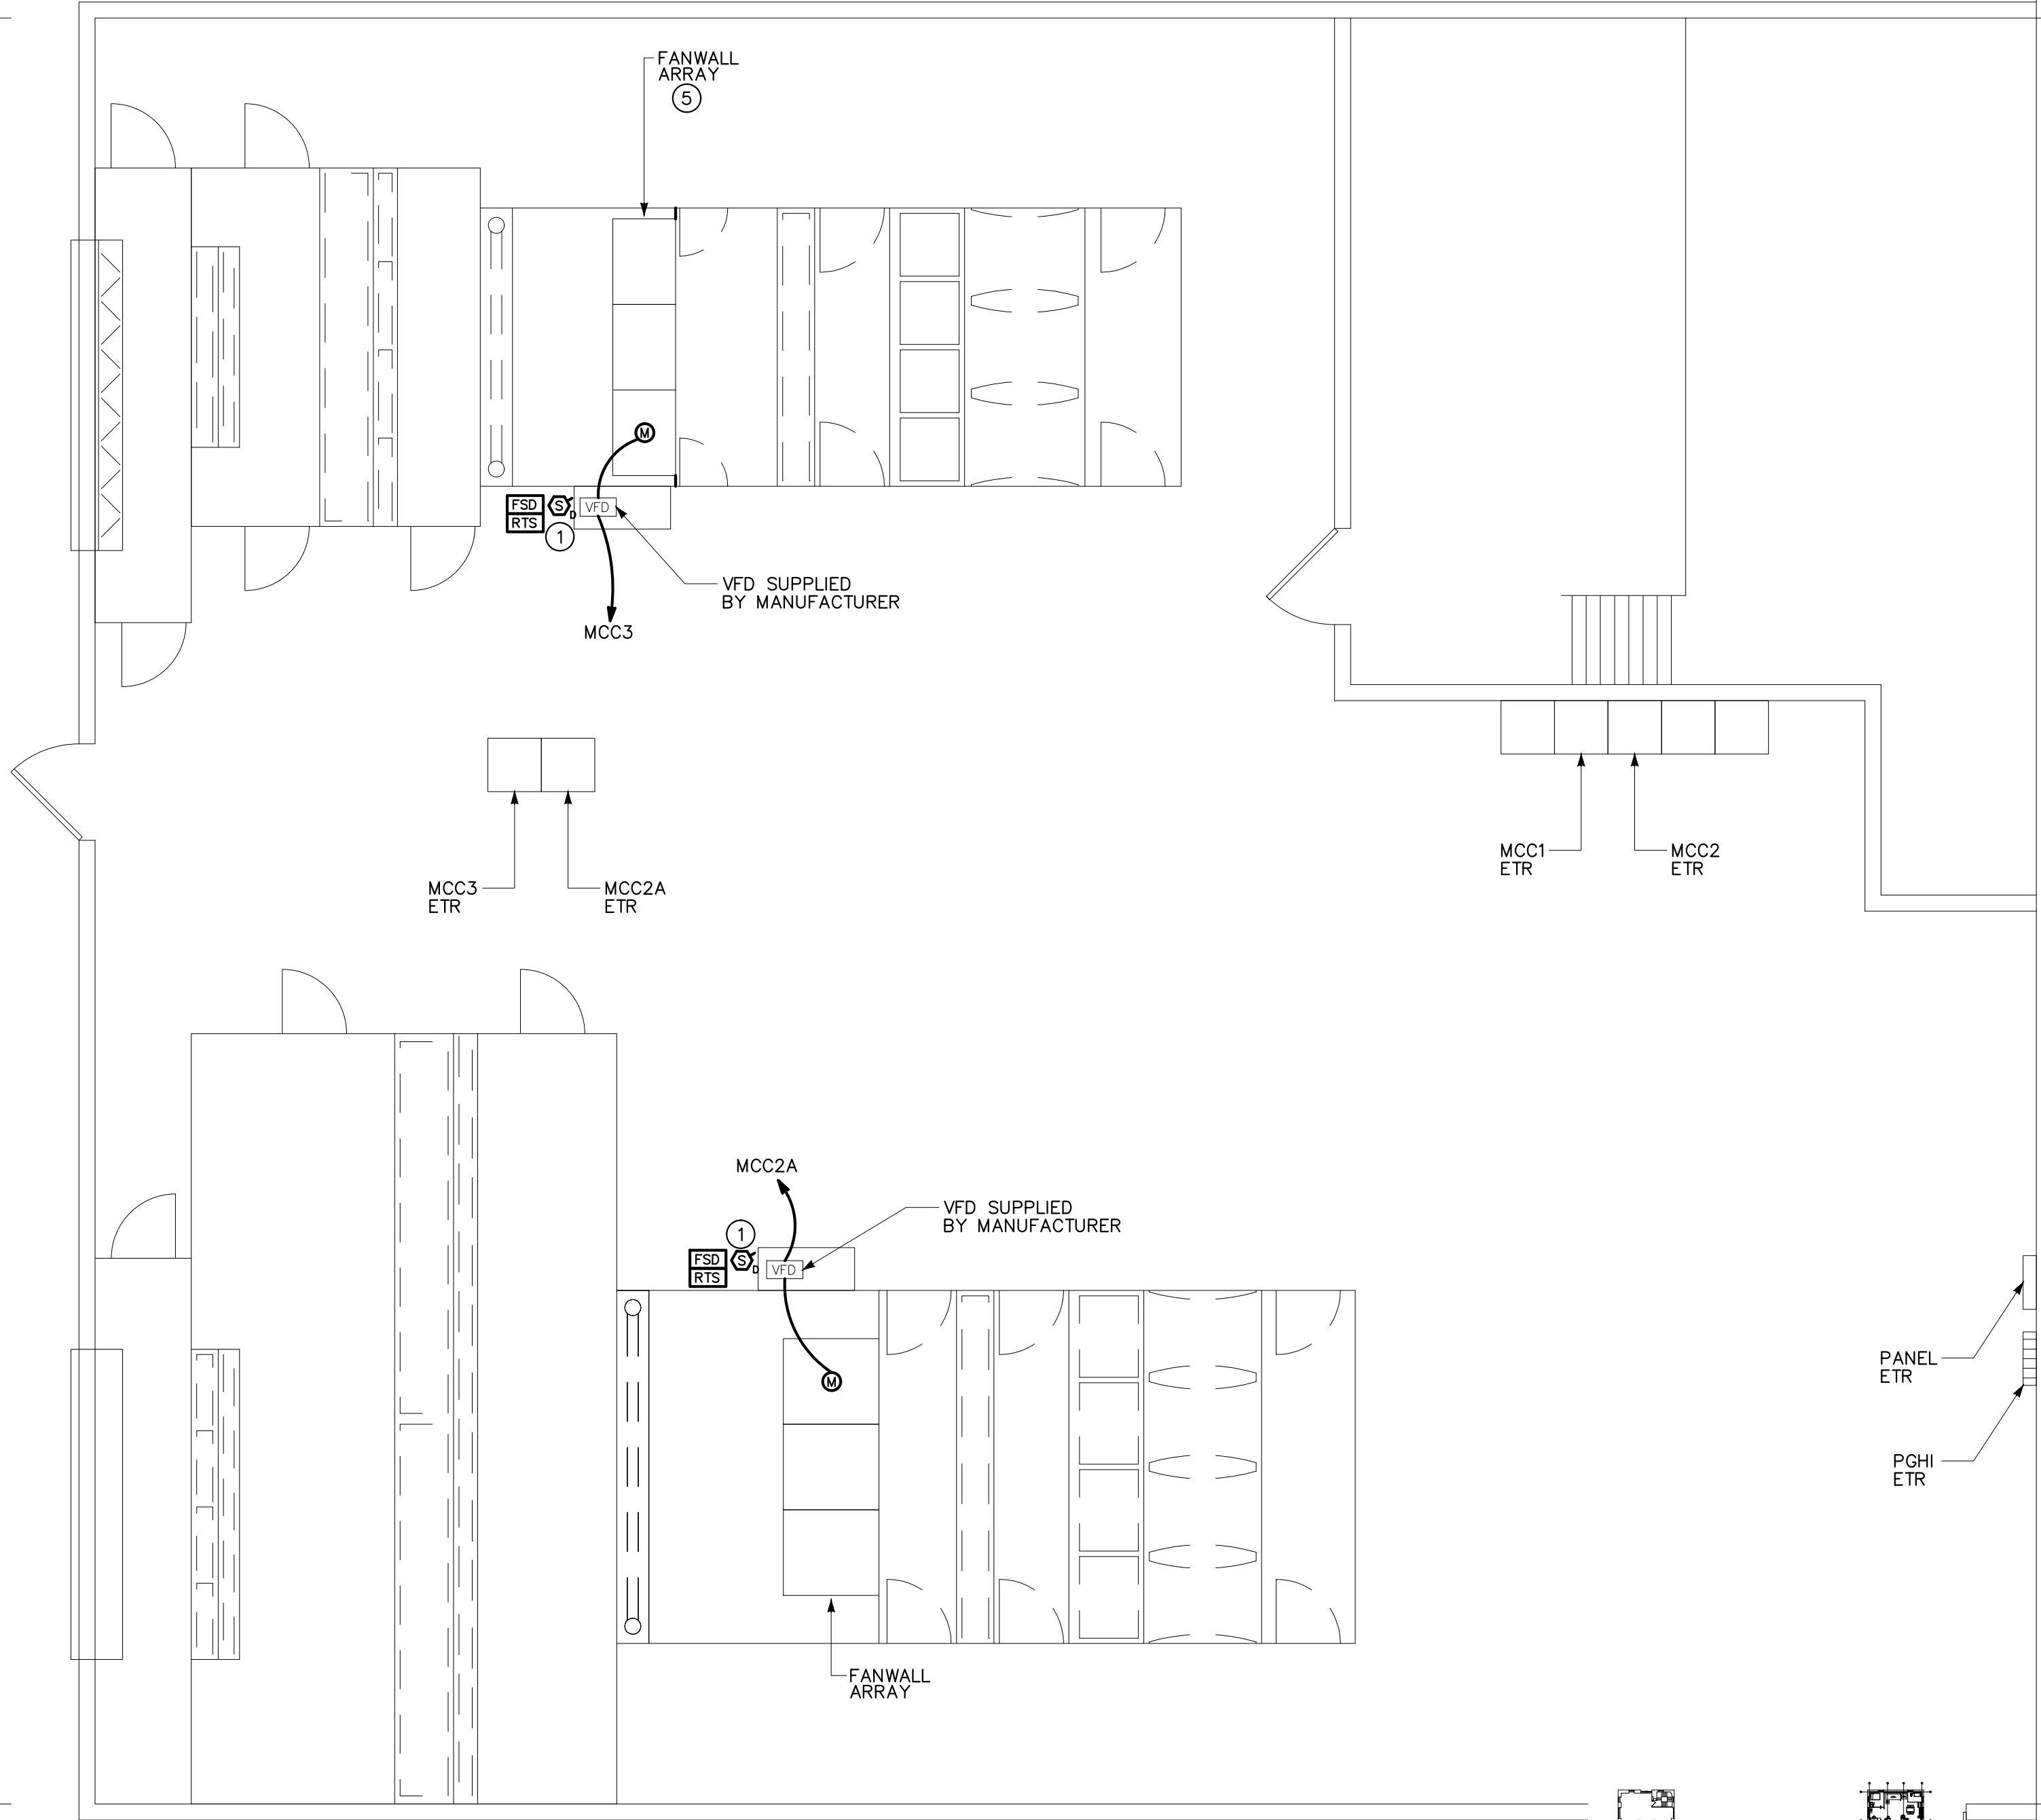

E-WING MECHANICAL PENTHOUSE – NEW WORK 2
?" = 1'-0"

DRAWING NOTES:

- ① PROVIDE DUCT TYPE SMOKE DETECTOR AND TIE INTO EXISTING BUILDING FACP. TEST DEVICE TO ENSURE PROPER OPERATION.

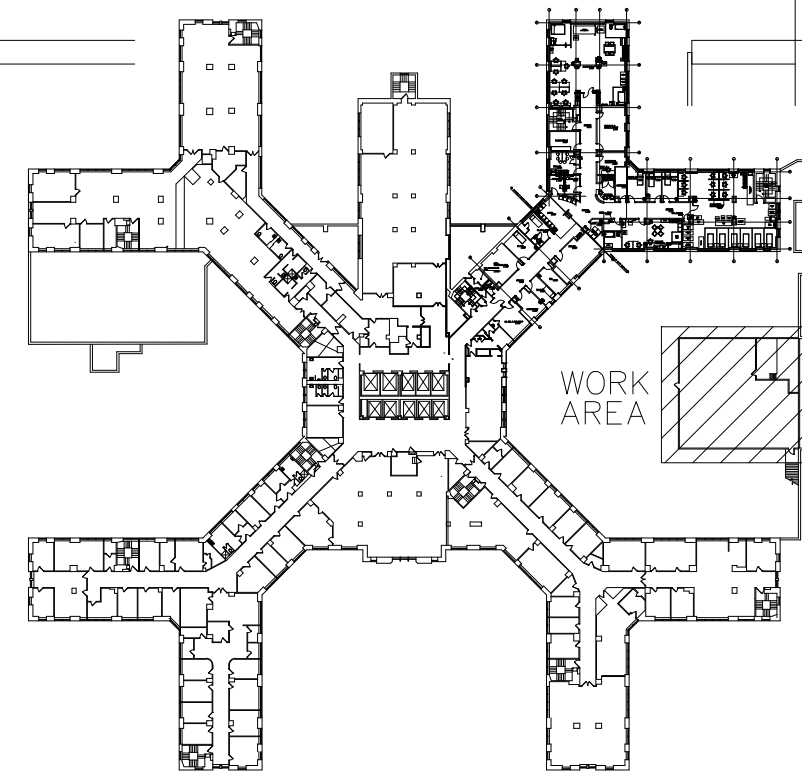

KEYPLAN
NO SCALE

| | |
|---------------|----------|
| ISSUE FOR BID | 11/06/13 |
| Revisions | Date |

VA WESTERN NEW YORK HEALTHCARE SYSTEM
3495 BAILEY AVENUE
BUFFALO, NEW YORK 14215

IBC ENGINEERING, P.C.
2495 MAIN STREET, SUITE 318
BUFFALO, NEW YORK 14214

| | | | |
|----------------------|------|---------------------|------|
| CLINICAL ENGINEERING | DATE | ENGINEERING MANAGER | DATE |
| INFECTION CONTROL | DATE | CARELINE MANAGER | DATE |
| SAFETY OFFICER | DATE | CHIEF OF STAFF | DATE |

| | |
|---|------|
| Drawing Title | |
| E-WING ELECTRICAL PENTHOUSE PLAN – REMOVAL & NEW WORK | |
| MEDICAL CENTER DIRECTOR | DATE |
| ASSOCIATE MEDICAL CENTER DIRECTOR | DATE |

| | | |
|--|----------------|--------------|
| Project Title | | |
| E-WING FANWALL INSTALLATION | | |
| Building Number 1 | Checked CDW | Drawn JTR |
| Location V.A.M.C. BUFFALO, NEW YORK | | |

| |
|----------------------------|
| Date SEPTEMBER 27, 2013 |
| Station No. 528 |
| 14-S04- E100 |

