



DEMOLITION NOTES

1. REMOVE ALL OBSOLETE ELECTRICAL EQUIPMENT, FIXTURES, CONDUIT, WIRING, CONTROLS, HANGERS, PADS, AND SUPPORTS UNLESS OTHERWISE INDICATED TO REMAIN. DISCONNECT CIRCUIT AND WIRING FROM EQUIPMENT WHICH IS TO BE REMOVED BY OBTAINING AND OBTAINING THE NECESSARY PERMITS FOR DISCONNECT AND REMOVED. CONDUIT MADE OBSOLETE BY THE NEW CONSTRUCTION SHALL BE REMOVED OR SECURELY SEALED AND CAPPED ABOVE CEILINGS, BELOW FLOORS, GRADE OR IN WALLS AND IN WALLS OR CEILING CONCEALED BY NEW CONSTRUCTION. ALL REMOVED PIPING AND WIRING REMOVED FROM THE EXISTING ELECTRICAL SYSTEMS SHALL NOT BE USED IN THE INSTALLATION OF THE NEW SYSTEMS.
2. DEMOLITION INCLUDES, BUT IS NOT LIMITED TO, REMOVAL AND LEGAL DISPOSAL OF EQUIPMENT AND SYSTEMS MADE OBSOLETE AND/OR REPLACED BY NEW WORK. DEMOLITION INCLUDES RELOCATION OR REINSTALLATION, DISCONNECTIONS AND RECONNECTIONS, REPAIRS, SERVICES, SUPPORTS, GRANTING COMPLIANCE WITH PIPING, TEMPORARY CAPPING, AND ROUTING OF TEMPORARY SERVICES TO PERMIT NEW RENOVATION WORK TO PROCEED.
3. THE DEMOLITION WORK INDICATED ON THE DRAWING IS INTENDED TO ASSIST THE CONTRACTOR AND GIVE GENERAL INFORMATION. NOT ALL DEMOLITION OR TEMPORARY CONNECTIONS ARE SHOWN. PRIOR TO SUBMITTING BID, THE CONTRACTOR SHALL VISIT THE PROJECT SITE AND CONDUCT A NEW OR RE-EXISTING DEMOLITION SURVEY RESPONSIBLE TO DETERMINE THE FULL EXTENT OF DEMOLITION, AND INCLUDE ALL REQUIRED DEMOLITION WORK IN HIS BID, WHETHER OR NOT SPECIFICALLY SHOWN ON THE DRAWING. ALL ITEMS AND MATERIALS TO BE REMOVED OR DEMOLITION SURVEY TO BE REMOVED OF ALL ITEMS AND MATERIALS, EXCEPT ANY ITEMS SPECIFICALLY DESIGNATED BY THE OWNER TO BE SALVAGED. REMOVE AND REPLACE THE DESIGNATED SALVAGED EQUIPMENT IN A LOCATION DIRECTED BY THE OWNER AT NO ADDITIONAL EXPENSE.
4. REFER TO MECHANICAL DEMOLITION DRAWINGS AS WELL AS THE DRAWINGS FOR ELECTRICAL EQUIPMENT THAT HAVE BEEN IDENTIFIED FOR NEW CONSTRUCTION AND RENOVATIONS AND EXTENT OF AREA TO BE DEMOLISHED. DISCONNECT POWER AND CONTROLS SERVING SUCH DEVICES AND EQUIPMENT WHETHER OR NOT SPECIFICALLY SHOWN ON ELECTRICAL DRAWINGS TO FACILITATE DEMOLITION AND NEW CONSTRUCTION.
5. IN ALL AREAS WHERE PATCHING IS REQUIRED, THE ELECTRICAL CONTRACTOR SHALL PATCH THE SUBSURFACE WHERE THE NEW SURFACE IS TO BE FINISHED BY THE GENERAL CONTRACTOR. THE SUBSURFACE MUST BE PROVIDED SO THAT IT DOES NOT INHIBIT THE INSTALLATION OF OR AFFECT THE APPEARANCE OF THE NEW FINISH. IF A NEW FINISH WILL NOT BE PROVIDED BY THE GENERAL CONTRACTOR, THE ELECTRICAL CONTRACTOR IS RESPONSIBLE TO PATCH THE SURROUNDING SURFACE TO MATCH EXISTING.
6. MAINTAIN CONTINUITY OF EXISTING CIRCUITS FOR EQUIPMENT AND DEVICES TO REMAIN. IF A DEVICE OR EQUIPMENT IS REMOVED AND IS PART OF AN EXISTING CIRCUIT TO REMAIN, THE CIRCUIT SHALL BE RESTORED TO IT'S ORIGINAL CONDITION.

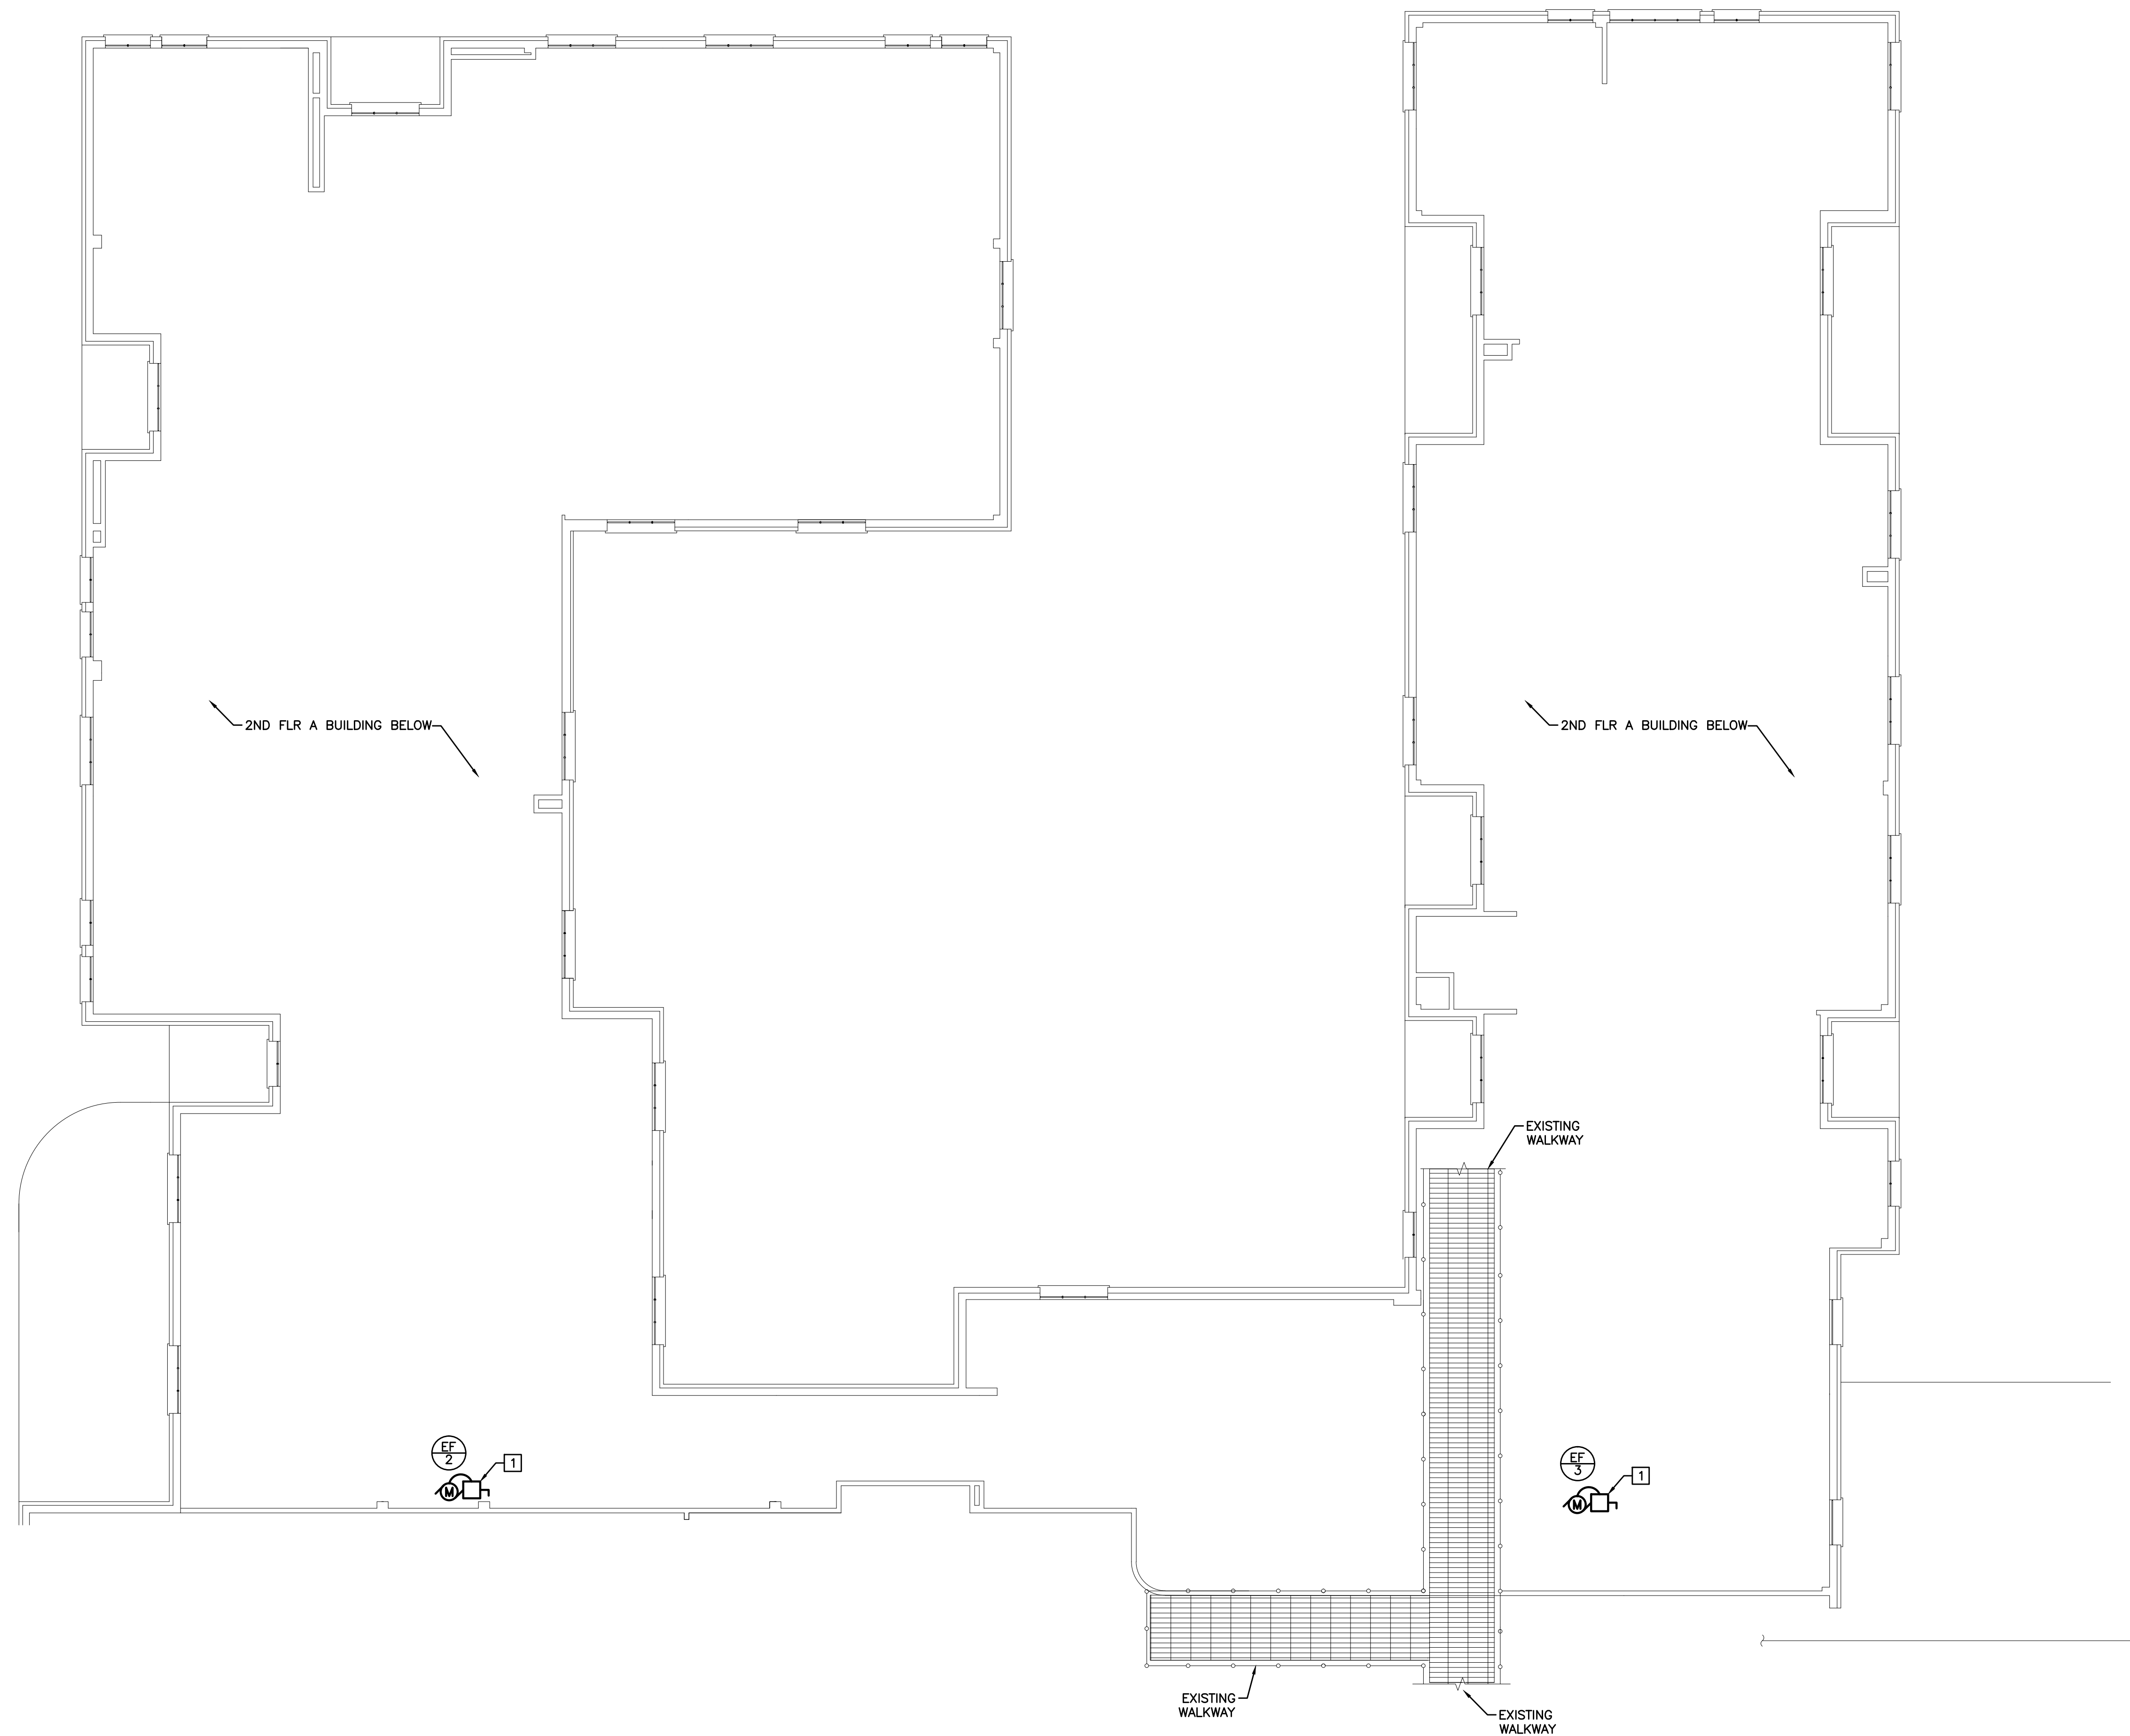


KEYED DEMOLITION NOTES

- 1** REMOVE EXISTING CIRCUITING FROM SOURCE PANEL TO DISCONNECT. REMOVE WIRING, CONDUIT AND DISCONNECT.

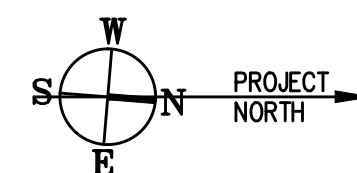

1 WING A & B ATTIC FLOOR ELECTRICAL DEMOLITION PLAN  
E101 SCALE: 1/8" = 1'-0"

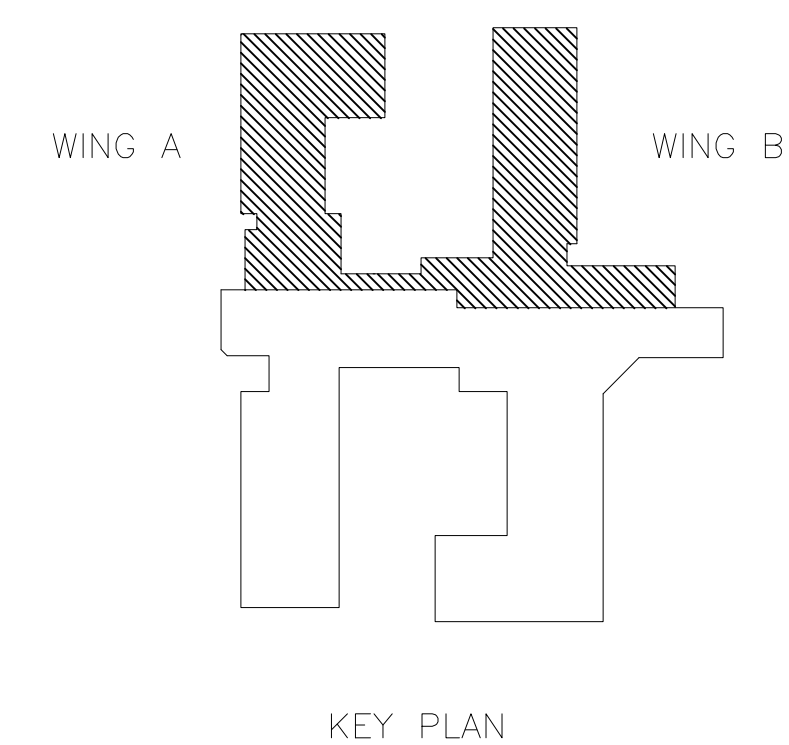[illegible]