

MSG

REMARKS: UL LISTED FOR SERVICE ENTRANCE RATED

MARK	LOAD DESCRIPTION	C LOAD KVA	CIRCUIT BREAKER FRAME KVA SWITCH SIZE	CIRCUIT BREAKER FUSE SIZE	DEVICE TYPE	FEEDER	
						3 PHASE / 3 WIRE SIZE	1 PHASE / 2 WIRE SIZE
1	PANEL HEB	M	800	225	CIRCUIT BREAKER	1	4/0 4
2	TN1	M	800	175	CIRCUIT BREAKER	1	2/0 6
3	MOTOR CONTROL CENTER	M	800	800	CIRCUIT BREAKER	2	4/0 1 3
4	PANEL HBI/HB2	M	800	400	CIRCUIT BREAKER	2	3/0 2 3
5	BOILER WA TN2	M	800	125	CIRCUIT BREAKER	1	3/0 6 1-1/2
6	TVSS	M	800	125	CIRCUIT BREAKER	1	4 1 6 2
7	SPACE ONLY		800				
8	SPACE ONLY		800				

PRIMARY	GND. ELECTRODE	CONNECTED
---------	----------------	-----------

TRANSFORMER DESIGNATION	PERIOD FROM	PHASE RATING	PRIMARY VOLTAGE (L-L)	SECONDARY VOLTAGE (L-L)	SIZE (L-L)(H)	CONDUCTOR	ONDS. ELECTRODE	CONNECTED LOAD	DEMAND LOAD	REMARKS	
			(L-L)	(L-L)	(L-L)(H)			KVA	SEC. SIDE KVA	SEC. SIDE AMPS	
TN1	MSG	112.5	3	480	208	120	1	138.2	376.3	156.5	434.4
TN2	MSG	75	3	480	208	120	2	1	0.0	0.0	0.0
TN3	HB3	15	3	480	208	120	8	3/4	0.0	0.0	0.0
UT1	N/A	15	3	480	277			637.6	766.9	739.3	889.3

BUS NUMBER: 36 AMPERE RATING: 100

LUG OPTIONS:

[illegible][illegible]

Recommended Approvals:

Recommended Approvals:	
1. MEDICAL DIRECTOR	6. OPERATIONS SERVICE LINE MANAGER
2. ASSOCIATE DIRECTOR	7. INFECTION CONTROL MANAGER
3. CHIEF OF STAFF	8. SAFETY MANAGER
4. ASSOC. DIRECTOR	9. GENERAL ENGINEER
5. SERVICE LINE MGRS.	10. COTR

Architect/Engineer Address

Harrell, Saltrick & Hopper

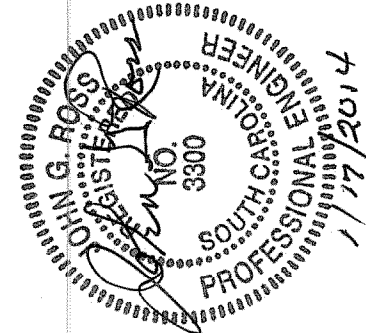
Design & Management Solutions for the Built Environment


8016 TOWER POINT DRIVE
CHARLOTTE, NC 28227

704.684.1320
F 704.351.0833

www.hsh.com

COPYRIGHT © 2011 HARRELL, SALTRICK & HOPPER, PC
HSH PROJECT # 11095

[illegible]

Date APRIL 30, 2012	Project Number 544-11-101	DRAWING No. E605	 Veterans Affairs
------------------------	------------------------------	----------------------------	--