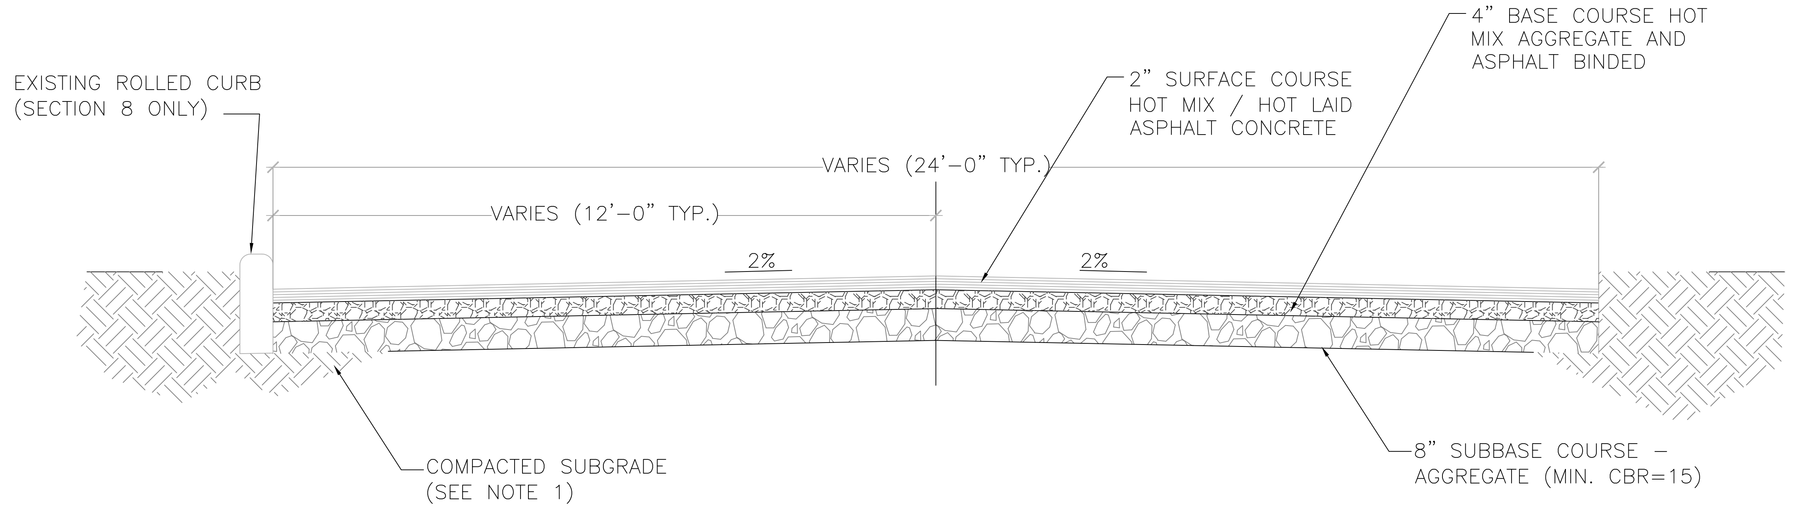

GENERAL PAVING NOTES:

1. PRIOR TO COMPACTION AND PLACEMENT OF GRANULAR SUBBASE, THE CUT AREA SHALL BE REVIEWED AND PROOFTESTED FOR STABILITY BY A GEOTECHNICAL ENGINEER. IF COMPACTION IS REQUIRED, COMPACTION SHALL BE IN ACCORDANCE WITH ASTM D698.

2. REFER TO SPECIFICATIONS SECTION 02514 FOR WORK AND MATERIAL RELATED TO ASPHALT CONCRETE PAVING.

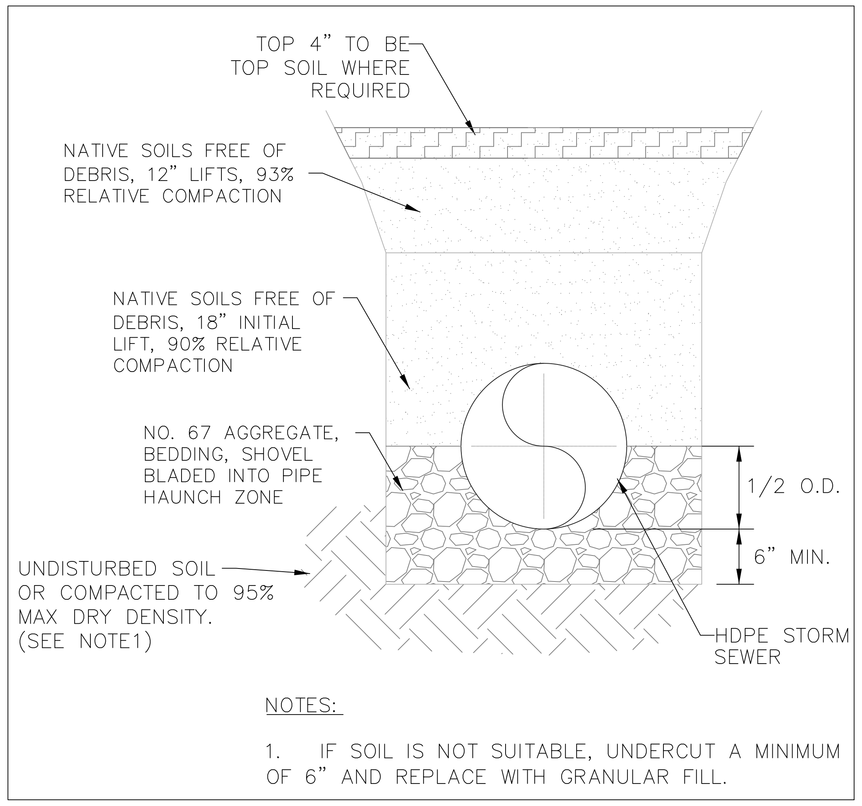

NOTES:

1. IF SOIL IS NOT SUITABLE, UNDERCUT A MINIMUM OF 6" AND REPLACE WITH GRANULAR FILL.

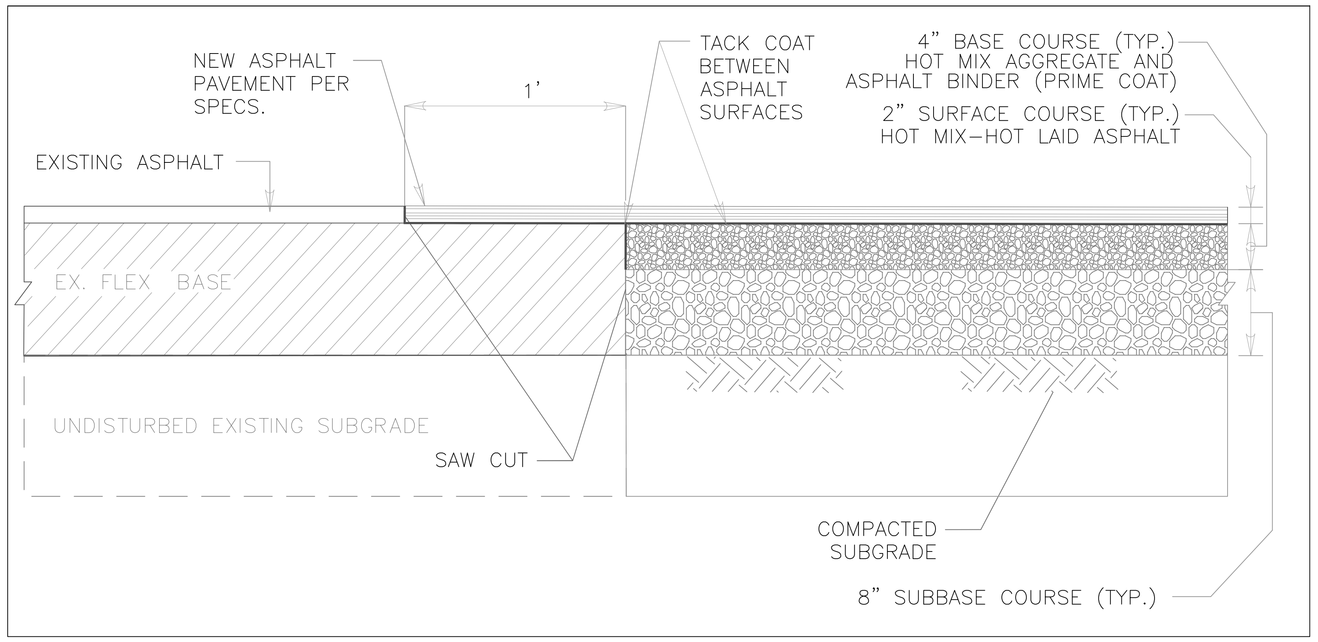

Revisions	Date

NATIONAL CEMETERY ADMINISTRATION

Drawing Title: **ROADWAY AND CIVIL DETAILS**	Project Title: **REPAIR STORM DRAIN CULVERT**		Date: **10/24/2013**
			Project No.: **844-14-101**
Approved: Division Chief	Building Number: *****	Checked	Drawn: **CFC**
Approved: Service Director	Location: **FORT GIBSON NATIONAL CEMETERY**		DRAWING NO. **L-202** Dwg. **7** Of **7**