


- MECHANICAL NOTES:**
- ① Location of new exhaust duct tie into existing duct.
 - ② New location of supply, adjust and balance.
 - ③ Relocate fire sprinkler heads as required.
 - ④ Change sprinkler heads in existing bathrooms to quick response heads as required.

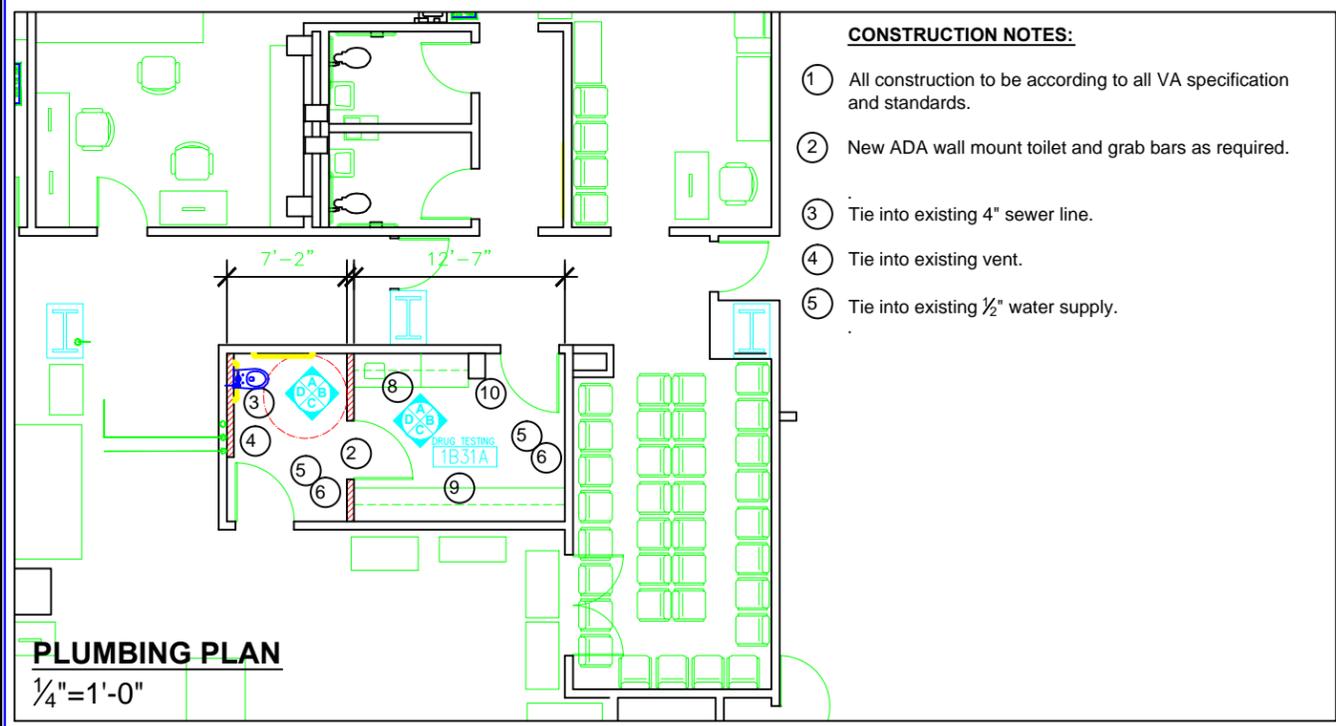

- CONSTRUCTION NOTES:**
- ① All construction to be according to all VA specification and standards.
 - ② New ADA wall mount toilet and grab bars as required.
 - ③ Tie into existing 4" sewer line.
 - ④ Tie into existing vent.
 - ⑤ Tie into existing 1/2" water supply.

Revisions	Date

CAD Information CAD/FY06/XXX	Drawing Title PLUMBING PLAN HVAC PLAN	Project Title RENOVATE FOR DRUG SCREENING PROGRAM	Date 8/18/06	DRAWING No. H-1 3 of 3
			Project No. 660-14-09S	
Approved	Approved Medical Center Director	Drawn	Building Number B.1	
Approved	Approved Chief, Engineering	Checked		

B-14 1st FLOOR
1/32"=1'-0"



Department of
Veterans Affairs