


- DRAWING NOTES: (APPLY TO THIS DRAWING ONLY)
1. ALL RETURN AND EXHAUST REGISTERS ARE 8" X 4" UNLESS OTHERWISE NOTED.
  2. ALL SUPPLY DIFFUSERS ARE 6" X 6" UNLESS OTHERWISE NOTED.
  3. ALL SUPPLY DIFFUSERS SHALL BE 4-WAY FLOW UNLESS OTHERWISE INDICATED.
  4. ALL SUPPLY DIFFUSERS ARE TYPE "A" UNLESS OTHERWISE NOTED.
  5. ALL RETURN AND EXHAUST REGISTERS ARE TYPE "A" UNLESS OTHERWISE NOTED.
  6. ALL TERMINAL BOXES IN INTERSTITIAL SPACE SHALL HAVE ACCESS LOCATED ON TOP OF BOX EXCEPT TO BOXES LOCATED IN ZONE 2 OR AS OTHERWISE INDICATED.
  7. ALL RADIATION SHALL BE TYPE "A" WITH TYPE 11 CONTROL.

SPECIAL NOTES: (APPLY TO THIS DRAWING ONLY)

1. PROVIDE ACCESS IN BOTTOM OF BOX.
2. 12 X 10 DUCT ON TO H-48, 875 CFM, WITH VO.
3. TWO 24 X 12 TRANSFER GRILLES.
4. TWO 30 X 12 TRANSFER GRILLES.
5. 36 X 12 TYPE B HOOD, 1-4012 240 CFM, OVER HW 576.
6. 48 X 12 TYPE B HOOD, 1-4013 320 CFM, OVER VS260.
7. 1" CN AND 1012 RATED, 3/4" COIL WATER TO CONDENSER 1" TO ROOM DISCHARGE TO DRAIN, 3 GPM MAX.
8. UP TO HW 534.
9. DIFFUSER LAYOUT, DUCT ARRANGEMENT AND SIZING SHALL BE SIMILAR TO ROOM 3C137.
10. 8 X 8 CD 130.
11. DIFFUSER LAYOUT, DUCT ARRANGEMENT AND SIZING SHALL BE SIMILAR TO ROOM 3C135.
12. NIGHTSTAY FOR I-AC17.

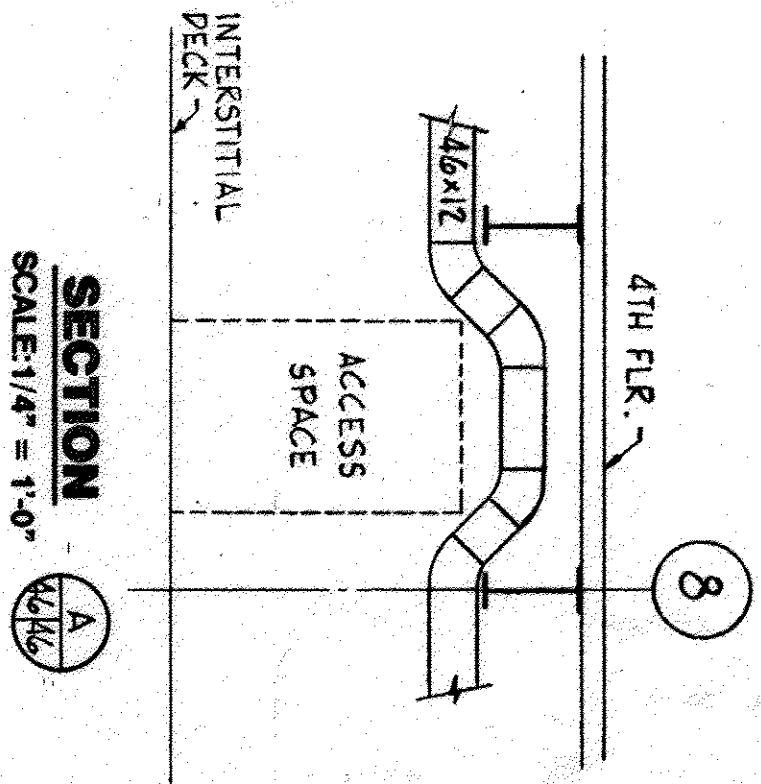

ROOM NO.	ROOM NAME
3C100	SERVICE BAY
3C100A	TELEPHONE CLOSET
3C100B	SIGNAL CLOSET
3C101	WASH STERILIZATION
3C102	COMMON EQUIP. INSTRUMENT ROOM
3C103	REFRIG.
3C105	LABORATORY
3C106	LABORATORY
3C107	LABORATORY
3C108	LABORATORY
3C109	LABORATORY
3C110	SECRETARIAT/CLERICAL
3C110A	OFFICE
3C110B	OFFICE
3C111	OFFICE
3C112	LABORATORY
3C113	LABORATORY
3C114	LABORATORY
3C115	LABORATORY
3C116	LABORATORY
3C117	LABORATORY
3C118	LABORATORY
3C119	CLEAN LINEN
3C120	COMMON EQUIP. INSTRUMENT ROOM
3C121	K. TOILET
3C122	K. TOILET
3C123	K. TOILET
3C124	LABORATORY
3C125	LABORATORY
3C126	LABORATORY
3C127	LABORATORY
3C128	LABORATORY
3C129	LABORATORY
3C130	LABORATORY
3C131	LABORATORY
3C132	LABORATORY
3C133	LABORATORY
3C134	LABORATORY
3C135	LABORATORY
3C136	LABORATORY
3C137	LABORATORY
3C138	LABORATORY
3C139	STAFF ROOM
3C140	ELECTRICAL CLOSET
3C141	H.A.C.

ROOM NO.	ROOM NAME
3C-21	CORR1100R
3C-22	CORR1100R
3C-23	CORR1100R
3C-24	CORR1100R
3C-25	CORR1100R
3C-26	CORR1100R
3C-27	CORR1100R
3C-28	CORR1100R
<u>DEPARTMENTAL NAMES</u>	
<u>THIRD FLOOR AREA C</u>	
<u>MEDICAL RESEARCH AND DEVELOPMENT (BIOMEDICAL RESEARCH)</u>	