


GENERAL NOTES:

- A. ALL EXISTING UNUSED FIRE ALARM CIRCUIT RACEWAY/CONDUIT SHALL BE REMOVED IN ITS ENTIRETY BACK TO NEAREST JUNCTION OR CONTROL PANEL.
- B. IN LOCATIONS WHERE FIRE ALARM DEVICES ARE REMOVED AND NO REPLACEMENT DEVICE IS SCHEDULED FOR INSTALLATION, CUT, PATCH, AND PAINT WALL BEHIND REMOVED DEVICE TO MATCH EXISTING WALL CONDITIONS.
- C. "ETR" ADJACENT TO A DEVICE, FIXTURE, OR PIECE OF EQUIPMENT INDICATES ITEM SHALL REMAIN. MAINTAIN EXISTING ELECTRICAL CONNECTIONS UNLESS OTHERWISE NOTED.
- D. "ERL" ADJACENT TO A DEVICE, FIXTURE, OR PIECE OF EQUIPMENT INDICATES EXISTING ITEM SHALL BE RELOCATED, DISCONNECT AND REMOVE, REINSTALL AT NEW LOCATION AND RECONNECT ITEM AS REQUIRED.

REMOVAL NOTES:

- 1 REMOVE AUDIO NOTIFICATION APPLIANCE AND SYSTEM WIRING BACK TO NEXT DEVICE IN LINE.
- 2 REMOVE AUDIO NOTIFICATION APPLIANCE. MAINTAIN INTEGRITY OF 18AWG SYSTEM CABLE FOR CONNECTION TO NEW DEVICE.

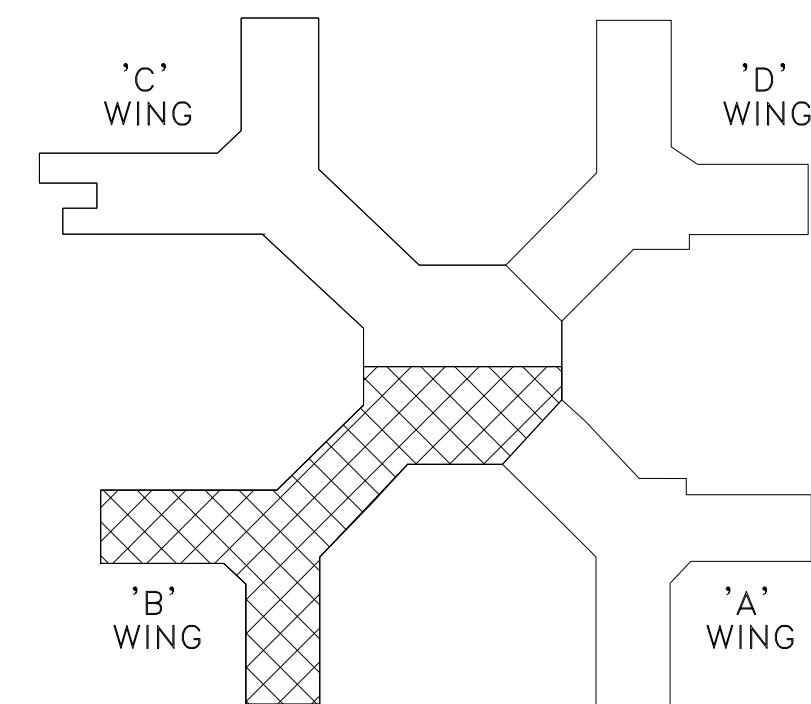

NO HANGERS SHALL BE
CONNECTED TO EXISTING
CONCRETE BEAMS. ALL HANGERS
SHALL BE SECURED FROM THE
DECK.



TENTH FLOOR

KEY PLAN

NO SCALE

VA WESTERN NEW YORK HEALTHCARE SYSTEM 3495 BAILEY AVENUE BUFFALO, NEW YORK 14215		CLINICAL ENGINEERING	DATE	ENGINEERING MANAGER	DATE	Drawing Title 10TH FLOOR REMOVAL PLAN – "B" WING	Project Title 10TH FLOOR FIRE ALARM UPDATES			Date FEBRUARY 7, 2014			
										Station No. 528			
ISSUE FOR BID	02/07/14	INFECTION CONTROL	DATE	CARELINE MANAGER	DATE	MEDICAL CENTER DIRECTOR	DATE	Building Number 1	Checked CDW	Drawn JTR			08-116-ED101
Revisions	Date	SAFETY OFFICER	DATE	CHIEF OF STAFF	DATE	ASSOCIATE MEDICAL CENTER DIRECTOR	DATE	Location V.A.M.C. BUFFALO, NEW YORK					