

# *Leon Environmental Services*

Richard "Danny" Leon CAC # 04-3708  
Tommy Leon CAC # 05-3882

October 24, 2013

Tim Butler  
P&H Foreman  
**VA Central CA Health Care System**  
2615 E. Clinton Ave.  
Fresno, CA 93703

**Re: Limited Lead Samples by XRF  
VA Central CA Health Care System  
2615 E. Clinton Ave.  
Fresno, CA  
Job No. L28-13**

Dear Tim:

Attached are the Lead sampling results for the above referenced building. This report includes conclusions, recommendations and analysis results. If you have any questions or need additional information, please do not hesitate to call.

Thank you for using Leon Environmental Services. We look forward to working with you in the future.

Respectfully,

Tommy Leon  
Certified DHS Inspector Assessor  
Certification No. #5157

5637 N. Figarden Dr., Suite 104, Fresno, CA 93722  
Phone: 559.274.9200 Fax: 559.274.9240 Email: LeonEnviro@comcast.net

Appendix B - VA Fresno 7th Floor Abatement & Demolition

# Leon Environmental Services

5637 N. Figarden Dr., Suite 104, Fresno, CA 93722  
Phone: 559.274.9200 Fax: 559.274.9240 Email: LeonEnviro@comcast.net

## LEAD BASED PAINT ANALYSIS RESULTS

A Lead Base Paint inspection was performed by **Leon Environmental Services** on the **7<sup>th</sup> Floor** of the **VA Hospital Fresno, 2615 E. Clinton Ave., Fresno, CA**. The sample collection areas were determined by the information given to the inspector by **Tim Butler** about the impending remodel/renovation that is planned for this building. All paint samples were analyzed HUD Guidelines by XRF. The samples listed below are positive for lead at greater than 1.0 mg/cm<sup>2</sup> level by XRF established by HUD to be considered a Lead Based Paint (LBP). ***Please see Diagram for Lead Base Paint locations.***

Sample	Sample Location	Type	Substrate	Color	XRF Result (mg/cm <sup>2</sup> )	LBP
96	E715 A Wall	Paint	Plaster	White	11.6	Yes
97	E715 A Wall	Paint	Plaster	White	7.2	Yes
99	E715 C Wall	Paint	Plaster	White	10.2	Yes
100	E715 D Wall	Paint	Plaster	White	13.3	Yes
128	E729 C Wall	Paint	Plaster	White	6.9	Yes
130	E729 C Door Trim	Paint	Metal	Grey	4.7	Yes
160	E726 A Wall	Paint	Plaster	White	3.3	Yes
162	E726 C Wall	Paint	Plaster	White	6.4	Yes
166	E705 A Wall	Paint	Plaster	White	9.2	Yes
169	E705 C Wall	Paint	Plaster	White	7.7	Yes
192	E701 C Wall	Paint	Plaster	White	1.8	Yes
326	W720 Floor	Paint	Concrete	White	1	Yes
327	W720 Floor	Paint	Concrete	White	1.6	Yes
328	W720 Floor	Paint	Concrete	Green	1.1	Yes
354	W721 A Wall	Paint	Plaster	White	5.5	Yes

**Lead Limited Survey: 7<sup>th</sup> Floor VA Central California Health Care System**  
**2615 E. Clinton Avenue Fresno, CA**  
**L28-13**

391	W723 A Wall	Paint	Plaster	White	2.5	Yes
397	W723 A Door Trim	Paint	Metal	White	4.4	Yes
405	W713 A Door Trim	Paint	Metal	White	5.7	Yes
416	W713 Closet A Door Trim	Paint	Metal	White	1.4	Yes
432	W715 D Wall	Paint	Plaster	White	1.9	Yes
463	W709 B Wall	Paint	Plaster	White	2.2	Yes
523	CORR7U5 C Wall	Paint	Plaster	White	1.4	Yes
529	E703ICORR C Wall	Paint	Plaster	White	1.2	Yes
537	E712CORR C Wall	Paint	Plaster	Grey	1.2	Yes
548	FELEVCORR B WALL	Paint	Plaster	White	1	Yes

\***A** Wall/Door Direction points towards E. Clinton Ave. (South Wall), **B-D** follow clockwise.

All loose and flaky LBP should be removed prior to demolition or renovation, collected and handled as one waste stream. Based on the levels of LBP identified in the building survey, Leon Environmental recommends that only qualified Lead Abatement Company with properly trained and equipped individuals be used on this project. Procedures and engineering controls must be designed to follow CALOSHA and Department of Health Services (State of California) requirements.

LEAD BASED PAINT ANALYSIS RESULTS
-----------------------------------

A total of 05 ceramic tiles & 05 paint chip samples were collected by Leon Environmental Services. The sample collection areas were determined by the information given to the inspector by **Tim Butler** about the impending remodel/renovation that is planned for this building. All lead paint samples were analyzed by Atomic Absorption via EPA method SW-846 7420M by EMC Labs Inc. Results are reported in percent by weight. The samples listed below are positive for lead at greater than 0.5% by weight level established by HUD to be considered a Lead Based Paint (LBP).

Sample	Location	Material	Reporting Limit	%Pb By Weight	LBP
L05	7 <sup>th</sup> Floor W705 Wall	Beige Ceramic Tile	0.100	1.67	Yes

**Lead Limited Survey: 7<sup>th</sup> Floor VA Central California Health Care System**  
**2615 E. Clinton Avenue Fresno, CA**  
**L28-13**

BRL – Below Reportable Limits

The Beige Ceramic Tile (sample L05) located on the walls of room W705 tested for this survey was above the 0.5% by weight level established by HUD to be considered a Lead Based Paint (LBP). All homes and buildings built prior to 1978 are assumed to contain Lead Based Paint. Lead safe work practices should be in place during all any construction or demolition that would affect these areas.

LBP COMMENTS AND RECOMMENDATIONS
----------------------------------

The federal and CALOSHA regulations for lead in construction do not specify a level of a lead in paint that classifies it as LBP. However, federal and state OSHA regulations specify **airborne lead levels** that should not be exceeded during construction without appropriate protection and training.

The action level for lead is 30 micrograms per cubic meter of air ( $\mu\text{g}/\text{m}^3$ ) and the permissible exposure limit (PEL) is  $50\mu\text{g}/\text{m}^3$ . These airborne lead levels can be exceeded during construction or demolition activities such as scraping, sanding, grinding, blasting, and torching LBP surfaces, even when levels of lead in paint are far below the HUD definition of LBP of  $1.0 \text{ mg}/\text{cm}^2$  or 0.5 percent lead by weight. OSHA Lead in Construction Standard Cal/OSHA 8 CCR 1532.1 shall apply whenever construction work is conducted where employees may be exposed to lead.

Beginning April 2010, new federal law (**EPA RRP rule**) will require that contractors performing renovation, repair and painting projects that disturb lead-based paint in homes, child care facilities and schools built before 1978 that a child under age six visits regularly to be certified and follow specific work practices to prevent lead contamination. Also, beginning April 2010, federal law will require contractors that disturb lead-based paint in homes, child care facilities and schools, built before 1978 to be certified and follow specific work practices to prevent lead contamination.

LBP CONCLUSIONS AND REGULATIONS
---------------------------------

The Department of Housing and Urban Development (HUD) considers a paint to be a lead-based paint hazard when the content of the paint exceeds 0.5% or 5000ppm. California Occupational Safety and Health (OSHA) regulations require employee personnel monitoring at any detectable levels until statistically reliable results indicate that exposure will remain consistently below the OSHA Action Level of 30 micrograms/ $\text{m}^3$  and the Permissible Exposure Level of 50 micrograms/ $\text{m}^3$  for an 8 hour day. The employer must then produce a "Negative Exposure Assessment" to indicate that it is not possible with the specific lead-based paint product to create excessive lead exposure levels.

**Lead Limited Survey: 7<sup>th</sup> Floor VA Central California Health Care System**  
**2615 E. Clinton Avenue Fresno, CA**  
**L28-13**

LIMITATIONS OF LIABILITY
--------------------------

Conclusions and recommendations presented in this report are qualitative judgments based on the prevailing regulations and accepted industry standards at the time of the report issuance. Leon Environmental Services provides no other guarantees, either expressed or implied. All quantities of materials listed herein are estimates for sampling purposes only, and should be verified by Owner representative or an abatement / demolition contractor prior to asbestos abatement or demolition.

The nature of demolition is such that materials can be uncovered which previously were unknown to exist. Therefore, Leon Environmental Services cannot be responsible for materials not previously detected due to lack of accessibility or concealment, although every effort was made during the inspection to detect all suspect materials. If any suspect materials other than those included herein are discovered during renovation or demolition, it must be assumed that the materials are asbestos containing, and should be treated accordingly until further testing and analysis is performed.

The data interpretations and recommendations are based solely on information available to Leon Environmental Services at the time of our inspection. The customer recognizes that site conditions or accessibility may vary, from those encountered at the time of our inspection and sample collection. Varying conditions or access could result in additional information that would lead us to revise conclusions and recommendations. Leon Environmental Services will not be responsible for the interpretation or use by others of information contained within this report.

---

Thomas Leon  
Certified Asbestos Consultant  
Certification No. 05-3882  
State of California Department of Public Health  
Lead Inspector Assessor # 5157

Date

\*Abbreviation Key:

*Asbestos Containing Material — ACM (equal to or greater than 0.1% by weight)*

*Vinyl Asbestos Tile — VAT*

*No Asbestos Detected--N.A.D or N.D.*

*Homogeneous—H*


*Not Sampled—NS*

# Leon Environmental Services

5637 N. Fig Garden Dr., Suite 101, Fresno, CA 93722

Phone: 559.274.9200 Fax: 559.274.9240

**Lead Base Paint Location Diagram**  
**2615 E. Clinton Ave. Fresno, CA, CA (7<sup>th</sup> Floor-XRF Testing)**  
**Job L28-13 (Tim Butler/VA Hospital)**  
**Drawing not to scale**

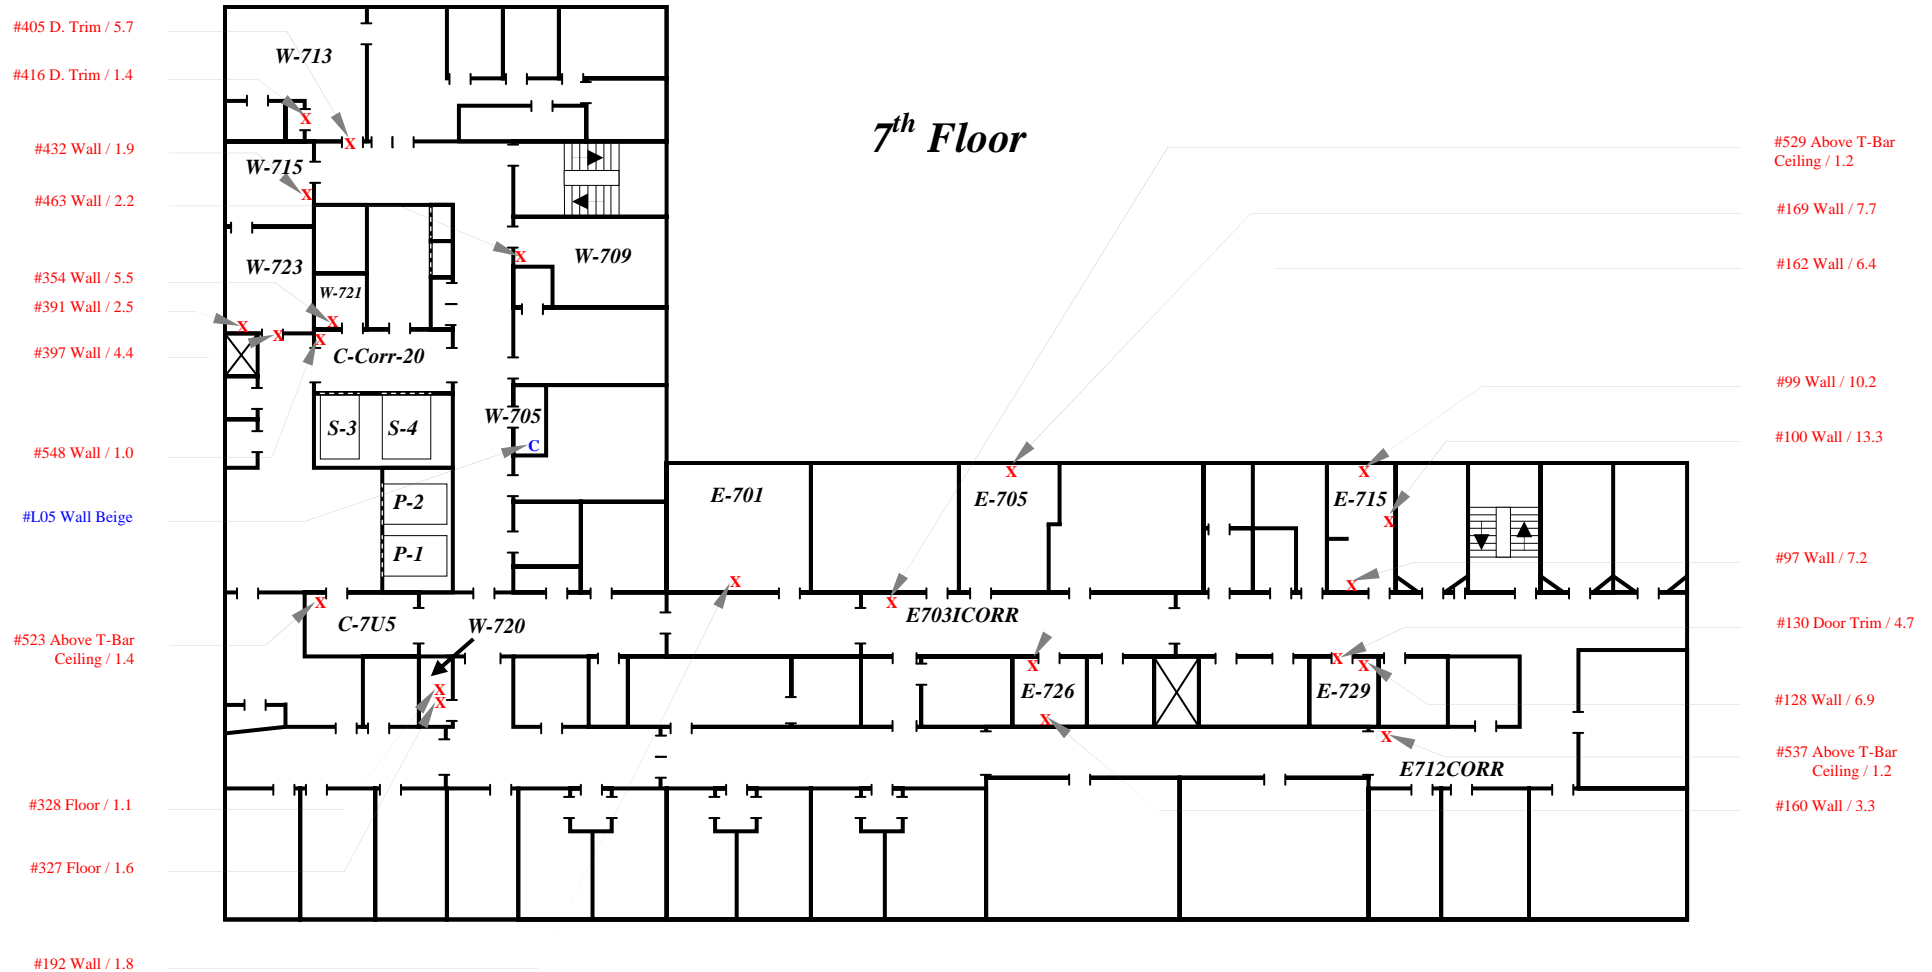

**C** = Positive Ceramic Tile Sample  
**X** = Positive XRF Samples



Reading No	Type	Units	Component	Substrate	Side	Color	Site	Floor	Room	Results	PbC
1	SHUTTER_CAL	cps	Calibration								2.07
2	PAINT	mg / cm ^2	Calibration							Positive	1.10
3	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E719	Negative	0.13
4	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E719	Negative	0.15
5	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E719	Negative	0.14
6	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E719	Negative	< LOD
7	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	E719	Null	0.01
8	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	E719	Negative	0.00
9	PAINT	mg / cm ^2	WINDOW TRIM	PLASTER	C	WHITE	L28-13	7th	E719	Null	0.40
10	PAINT	mg / cm ^2	WINDOW TRIM	METAL	C	WHITE	L28-13	7th	E719	Negative	0.08
11	PAINT	mg / cm ^2	BASEBOARD	CONCRETE	A	WHITE	L28-13	7th	E719	Negative	0.00
12	PAINT	mg / cm ^2	BASEBOARD	CONCRETE	B	WHITE	L28-13	7th	E719	Negative	0.00
13	PAINT	mg / cm ^2	BASEBOARD	CONCRETE	C	WHITE	L28-13	7th	E719	Negative	0.00
14	PAINT	mg / cm ^2	BASEBOARD	CONCRETE	D	WHITE	L28-13	7th	E719	Negative	0.00
15	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	GREY	L28-13	7th	E719	Negative	< LOD
16	PAINT	mg / cm ^2	DOOR	METAL	A	GREY	L28-13	7th	E719	Negative	0.00
17	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E721	Negative	0.00
18	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E721	Negative	0.00
19	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E721	Negative	0.00
20	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E721	Negative	0.00
21	PAINT	mg / cm ^2	BASEBOARD	CONCRETE	A	WHITE	L28-13	7th	E721	Negative	0.00
22	PAINT	mg / cm ^2	BASEBOARD	CONCRETE	B	WHITE	L28-13	7th	E721	Negative	0.00
23	PAINT	mg / cm ^2	BASEBOARD	CONCRETE	C	WHITE	L28-13	7th	E721	Negative	0.00
24	PAINT	mg / cm ^2	BASEBOARD	CONCRETE	D	WHITE	L28-13	7th	E721	Negative	0.00
25	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	E721	Negative	0.00
26	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	GREY	L28-13	7th	E721	Negative	0.06
27	PAINT	mg / cm ^2	DOOR	METAL	A	GREY	L28-13	7th	E721	Negative	0.00
28	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E718	Negative	0.15
29	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E718	Negative	0.11
30	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E718	Negative	0.00
31	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E718	Negative	< LOD
32	PAINT	mg / cm ^2	WINDOW	METAL	D	WHITE	L28-13	7th	E718	Negative	0.19
33	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	E718	Negative	< LOD
34	PAINT	mg / cm ^2	BASEBOARD	CONCRETE	A	WHITE	L28-13	7th	E718	Negative	0.00

Reading No	Type	Units	Component	Substrate	Side	Color	Site	Floor	Room	Results	PbC
35	PAINT	mg / cm ^2	BASEBOARD	CONCRETE	B	WHITE	L28-13	7th	E718	Negative	0.00
36	PAINT	mg / cm ^2	BASEBOARD	CONCRETE	D	WHITE	L28-13	7th	E718	Negative	0.00
37	PAINT	mg / cm ^2	DOOR	WOOD	B	BROWN	L28-13	7th	E718	Negative	0.00
38	PAINT	mg / cm ^2	DOOR TRIM	METAL	B	GREY	L28-13	7th	E718	Negative	0.23
39	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E716	Negative	0.17
40	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E716	Negative	0.01
41	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E716	Negative	0.00
42	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E716	Negative	0.24
43	PAINT	mg / cm ^2	BASEBOARD	CONCRETE	A	WHITE	L28-13	7th	E716	Negative	0.00
44	PAINT	mg / cm ^2	BASEBOARD	CONCRETE	C	WHITE	L28-13	7th	E716	Negative	0.00
45	PAINT	mg / cm ^2	BASEBOARD	CONCRETE	D	WHITE	L28-13	7th	E716	Negative	0.00
46	PAINT	mg / cm ^2	CEILING	CONCRETE		WHITE	L28-13	7th	E716	Negative	0.21
47	PAINT	mg / cm ^2	DOOR TRIM	METAL	C	GREY	L28-13	7th	E716	Negative	0.15
48	PAINT	mg / cm ^2	DOOR	WOOD	C	BROWN	L28-13	7th	E716	Negative	0.00
49	PAINT	mg / cm ^2	WALL	WOOD	A	WHITE	L28-13	7th	E714	Negative	0.00
50	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E714	Negative	0.00
51	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E714	Negative	0.00
52	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E714	Negative	0.00
53	PAINT	mg / cm ^2	WINDOW	METAL	A	WHITE	L28-13	7th	E714	Negative	0.23
54	PAINT	mg / cm ^2	WINDOW	METAL	C	WHITE	L28-13	7th	E714	Negative	0.40
55	PAINT	mg / cm ^2	WINDOW	GLASS	C	WHITE	L28-13	7th	E714	Negative	0.01
56	PAINT	mg / cm ^2	CEILING	WOOD 1x1 ACT		WHITE	L28-13	7th	E714	Negative	0.00
57	PAINT	mg / cm ^2	DOOR TRIM	METAL	C	GREY	L28-13	7th	E714	Negative	0.50
58	PAINT	mg / cm ^2	DOOR	WOOD	C	BROWN	L28-13	7th	E714	Negative	0.00
59	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E731	Negative	0.00
60	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E731	Negative	0.00
61	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E731	Negative	0.00
62	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E731	Negative	0.00
63	PAINT	mg / cm ^2	CEILING GRID	METAL		WHITE	L28-13	7th	E731	Negative	0.00
64	PAINT	mg / cm ^2	CEILING ACP	DRYWALL		WHITE	L28-13	7th	E731	Negative	< LOD
65	PAINT	mg / cm ^2	DOOR	WOOD	A	BROWN	L28-13	7th	E731	Negative	0.00
66	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E712	Negative	0.00
67	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E712	Negative	0.00
68	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E712	Negative	0.01



Reading No	Type	Units	Component	Substrate	Side	Color	Site	Floor	Room	Results	PbC
69	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E712	Negative	0.00
70	PAINT	mg / cm ^2	WINDOW	METAL	A	WHITE	L28-13	7th	E712	Negative	0.28
71	PAINT	mg / cm ^2	CABINET	WOOD	B	WHITE	L28-13	7th	E712	Negative	0.00
72	PAINT	mg / cm ^2	CEILING	1x1 ACT		WHITE	L28-13	7th	E712	Negative	0.00
73	PAINT	mg / cm ^2	DOOR TRIM	METAL	C	GREY	L28-13	7th	E712	Negative	0.00
74	PAINT	mg / cm ^2	DOOR	WOOD	C	BROWN	L28-13	7th	E712	Negative	0.00
75	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E710	Negative	0.00
76	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E710	Negative	0.00
77	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E710	Negative	0.00
78	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E710	Negative	0.00
79	PAINT	mg / cm ^2	WINDOW APRO	PLASTER	A	WHITE	L28-13	7th	E710	Negative	0.01
80	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	E710	Negative	0.01
81	PAINT	mg / cm ^2	DOOR TRIM	METAL	C	GREY	L28-13	7th	E710	Negative	0.00
82	PAINT	mg / cm ^2	DOOR	WOOD	C	BROWN	L28-13	7th	E710	Negative	0.00
83	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	E708	Null	0.00
84	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E708	Negative	0.02
85	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E708	Negative	0.00
86	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E708	Negative	0.00
87	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E708	Negative	0.00
88	PAINT	mg / cm ^2	DOOR TRIM	METAL	C	GREY	L28-13	7th	E708	Negative	0.00
89	PAINT	mg / cm ^2	DOOR	WOOD	C	BROWN	L28-13	7th	E708	Negative	0.00
90	PAINT	mg / cm ^2	WALL	PLASTER	B	YELLOW	L28-13	7th	E34 H-W	Negative	0.11
91	PAINT	mg / cm ^2	WALL	PLASTER	C	YELLOW	L28-13	7th	E34 H-W	Negative	0.16
92	PAINT	mg / cm ^2	CEILING	PLASTER		YELLOW	L28-13	7th	E34 H-W	Negative	0.20
93	PAINT	mg / cm ^2	BOOKCASE	WOOD		YELLOW	L28-13	7th	E34 H-W	Negative	0.00
94	PAINT	mg / cm ^2	DOOR	WOOD	A	BROWN	L28-13	7th	E34 H-W	Negative	0.02
95	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	GREY	L28-13	7th	E34 H-W	Negative	0.12
96	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E715	Positive	11.60
97	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E715	Positive	7.20
98	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E715	Negative	0.00
99	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E715	Positive	10.20
100	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E715	Positive	13.30
101	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E715	Negative	0.00
102	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E715	Negative	0.00

Reading No	Type	Units	Component	Substrate	Side	Color	Site	Floor	Room	Results	PbC
103	PAINT	mg / cm ^2	CEILING	PLASTER	UPPER	WHITE	L28-13	7th	E715	Negative	0.16
104	PAINT	mg / cm ^2	CEILING	PLASTER	LOWER	WHITE	L28-13	7th	E715	Negative	0.13
105	PAINT	mg / cm ^2	WINDOW	METAL	C	WHITE	L28-13	7th	E715	Negative	0.06
106	PAINT	mg / cm ^2	DOOR	WOOD	A	WHITE	L28-13	7th	E715	Negative	0.01
107	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	GREY	L28-13	7th	E715	Negative	0.11
108	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E713	Negative	0.00
109	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E713	Negative	0.20
110	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E713	Negative	0.40
111	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E713	Null	0.04
112	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E713	Negative	0.08
113	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	E713	Null	0.17
114	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	E713	Negative	0.30
115	PAINT	mg / cm ^2	DOOR TRIM	METAL		GREY	L28-13	7th	E713	Negative	0.06
116	PAINT	mg / cm ^2	DOOR	WOOD	A	BROWN	L28-13	7th	E713	Negative	0.00
117	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E730	Negative	0.00
118	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E730	Negative	0.00
119	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E730	Negative	0.00
120	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E730	Negative	0.00
121	PAINT	mg / cm ^2	DOOR TRIM	METAL	C	GREY	L28-13	7th	E730	Negative	0.00
122	PAINT	mg / cm ^2	DOOR	WOOD	C	BROWN	L28-13	7th	E730	Negative	0.00
123	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	E711	Negative	0.00
124	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	GREY	L28-13	7th	E711	Negative	0.08
125	PAINT	mg / cm ^2	DOOR	WOOD	A	BROWN	L28-13	7th	E711	Negative	0.00
126	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E729	Negative	0.03
127	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E729	Negative	0.01
128	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E729	Positive	6.90
129	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E729	Negative	0.00
130	PAINT	mg / cm ^2	DOOR TRIM	METAL	C	GREY	L28-13	7th	E729	Positive	4.70
131	PAINT	mg / cm ^2	DOOR	WOOD	C	BROWN	L28-13	7th	E729	Negative	0.00
132	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E709a	Negative	0.00
133	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E709a	Negative	0.07
134	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E709a	Negative	0.00
135	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E709a	Negative	0.00
136	PAINT	mg / cm ^2	CEILING	1x1 ACT		WHITE	L28-13	7th	E709a	Null	0.00

Reading No	Type	Units	Component	Substrate	Side	Color	Site	Floor	Room	Results	PbC
137	PAINT	mg / cm ^2	CEILING	1x1 ACT		WHITE	L28-13	7th	E709a	Negative	0.01
138	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E709	Negative	0.00
139	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E709	Negative	0.00
140	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E709	Negative	0.00
141	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E709	Negative	0.00
142	PAINT	mg / cm ^2	DOOR TRIM	METAL	C	WHITE	L28-13	7th	E709	Negative	0.08
143	PAINT	mg / cm ^2	DOOR	WOOD	C	BROWN	L28-13	7th	E709	Negative	0.00
144	PAINT	mg / cm ^2	DOOR	METAL	A	GREY	L28-13	7th	E709	Negative	0.13
145	PAINT	mg / cm ^2	DOOR	WOOD	A	BROWN	L28-13	7th	E709	Negative	0.00
146	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E707	Negative	0.00
147	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E707	Negative	0.00
148	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E707	Negative	0.40
149	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E707	Negative	0.00
150	PAINT	mg / cm ^2	WINDOW	METAL	C	WHITE	L28-13	7th	E707	Negative	0.11
151	PAINT	mg / cm ^2	CEILING	1x1 ACT		WHITE	L28-13	7th	E707	Negative	0.00
152	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	GREY	L28-13	7th	E707	Negative	0.11
153	PAINT	mg / cm ^2	DOOR	WOOD	A	BROWN	L28-13	7th	E707	Negative	0.06
154	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E727	Negative	0.00
155	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E727	Negative	0.00
156	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E727	Negative	0.00
157	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E727	Negative	0.01
158	PAINT	mg / cm ^2	DOOR TRIM	METAL	C	WHITE	L28-13	7th	E727	Negative	0.10
159	PAINT	mg / cm ^2	DOOR	WOOD	C	BROWN	L28-13	7th	E727	Negative	0.03
160	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E726	Positive	3.30
161	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E726	Negative	0.00
162	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E726	Positive	6.40
163	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E726	Negative	0.00
164	PAINT	mg / cm ^2	DOOR TRIM	METAL	C	WHITE	L28-13	7th	E726	Negative	0.50
165	PAINT	mg / cm ^2	DOOR	WOOD	C	BROWN	L28-13	7th	E726	Negative	0.02
166	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E705	Positive	9.20
167	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E705	Negative	0.01
168	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E705	Negative	0.00
169	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E705	Positive	7.70
170	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E705	Negative	0.03

Reading No	Type	Units	Component	Substrate	Side	Color	Site	Floor	Room	Results	PbC
171	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	GREY	L28-13	7th	E705	Negative	0.15
172	PAINT	mg / cm ^2	DOOR	WOOD	A	BROWN	L28-13	7th	E705	Negative	0.01
173	PAINT	mg / cm ^2	CEILING	1x1 ACT		WHITE	L28-13	7th	E705	Negative	0.50
174	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E717	Negative	0.09
175	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E717	Negative	0.00
176	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E717	Negative	0.00
177	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E717	Negative	0.12
178	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	E717	Negative	0.05
179	PAINT	mg / cm ^2	DOOR	METAL		GREY	L28-13	7th	E717	Negative	0.00
180	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	GREY	L28-13	7th	E717	Negative	0.20
181	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E703	Negative	0.01
182	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E703	Negative	0.00
183	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E703	Negative	0.01
184	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E703	Negative	0.01
185	PAINT	mg / cm ^2	WINDOW	METAL	C	WHITE	L28-13	7th	E703	Negative	0.19
186	PAINT	mg / cm ^2	CEILING	METAL GRID		WHITE	L28-13	7th	E703	Negative	0.00
187	PAINT	mg / cm ^2	CEILING	2x4 ACP		WHITE	L28-13	7th	E703	Negative	0.00
188	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	GREY	L28-13	7th	E703	Negative	0.09
189	PAINT	mg / cm ^2	DOOR	WOOD	A	BROWN	L28-13	7th	E703	Negative	0.01
190	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E701	Negative	0.00
191	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E701	Negative	0.00
192	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E701	Positive	1.80
193	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E701	Negative	0.00
194	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E701	Negative	0.00
195	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E701	Negative	0.00
196	PAINT	mg / cm ^2	WINDOW	METAL	C	WHITE	L28-13	7th	E701	Negative	0.03
197	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	GREY	L28-13	7th	E701	Negative	0.00
198	PAINT	mg / cm ^2	DOOR	WOOD	A	BROWN	L28-13	7th	E701	Negative	0.00
199	PAINT	mg / cm ^2	WALL	PLASTER	A	BLUE	L28-13	7th	W714	Negative	0.00
200	PAINT	mg / cm ^2	WALL	PLASTER	B	BLUE	L28-13	7th	W714	Negative	0.00
201	PAINT	mg / cm ^2	WALL	PLASTER	C	BLUE	L28-13	7th	W714	Negative	< LOD
202	PAINT	mg / cm ^2	WALL	PLASTER	D	BLUE	L28-13	7th	W714	Negative	0.00
203	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	BLUE	L28-13	7th	W714	Negative	0.01
204	PAINT	mg / cm ^2	DOOR	WOOD	A	BROWN	L28-13	7th	W714	Negative	0.01

Reading No	Type	Units	Component	Substrate	Side	Color	Site	Floor	Room	Results	PbC
205	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	W724	Null	0.30
206	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	W724	Null	0.18
207	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	W724	Negative	0.20
208	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	W724	Negative	0.00
209	PAINT	mg / cm ^2	DOOR TRIM	METAL	C	GREY	L28-13	7th	W724	Negative	0.16
210	PAINT	mg / cm ^2	DOOR	WOOD	C	BROWN	L28-13	7th	W724	Negative	0.01
211	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E706	Negative	0.23
212	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E706	Negative	0.00
213	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E706	Negative	0.00
214	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E706	Negative	0.50
215	PAINT	mg / cm ^2	WINDOW	METAL	A	WHITE	L28-13	7th	E706	Negative	0.06
216	PAINT	mg / cm ^2	DOOR	METAL	B	GREY	L28-13	7th	E706	Negative	0.00
217	PAINT	mg / cm ^2	DOOR	WOOD	B	BROWN	L28-13	7th	E706	Negative	0.00
218	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E704	Negative	0.00
219	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E704	Negative	0.01
220	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E704	Negative	0.00
221	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E704	Negative	0.00
222	PAINT	mg / cm ^2	WINDOW	METAL	A	WHITE	L28-13	7th	E704	Negative	0.16
223	PAINT	mg / cm ^2	DOOR TRIM	METAL	D	GREY	L28-13	7th	E704	Negative	0.00
224	PAINT	mg / cm ^2	DOOR	WOOD	D	BROWN	L28-13	7th	E704	Negative	0.00
225	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E724	Negative	0.00
226	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E724	Negative	0.00
227	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E724	Negative	0.00
228	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E724	Negative	0.00
229	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	E724	Negative	0.00
230	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	GREY	L28-13	7th	E724	Negative	0.00
231	PAINT	mg / cm ^2	FIREPLACE	WOOD	A	BROWN	L28-13	7th	E724	Negative	0.00
232	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E723	Negative	0.00
233	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E723	Negative	0.00
234	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	E723	Negative	0.00
235	PAINT	mg / cm ^2	DOOR	WOOD		BROWN	L28-13	7th	E723	Negative	0.00
236	PAINT	mg / cm ^2	DOOR TRIM	WOOD	A	GRAY	L28-13	7th	E723	Negative	0.00
237	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E702	Negative	0.17
238	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E702	Negative	0.00

Reading No	Type	Units	Component	Substrate	Side	Color	Site	Floor	Room	Results	PbC
239	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E702	Negative	0.00
240	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E702	Negative	0.00
241	PAINT	mg / cm ^2	WINDOW	METAL	A	WHITE	L28-13	7th	E702	Negative	0.14
242	PAINT	mg / cm ^2	WINDOW	METAL	A	WHITE	L28-13	7th	E702	Negative	0.06
243	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E700	Negative	0.23
244	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E700	Negative	0.24
245	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E700	Negative	0.00
246	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E700	Negative	0.00
247	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	E700	Null	0.19
248	PAINT	mg / cm ^2	DOOR	WOOD	D	WHITE	L28-13	7th	E700	Negative	0.00
249	PAINT	mg / cm ^2	DOOR TRIM	WOOD	D	GRAY	L28-13	7th	E700	Negative	0.00
250	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W722	Negative	0.00
251	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W722	Negative	0.00
252	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W722	Negative	0.00
253	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W722	Negative	0.00
254	PAINT	mg / cm ^2	DOOR	WOOD	A	BROWN	L28-13	7th	W722	Negative	0.02
255	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W712	Negative	0.18
256	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W712	Negative	0.00
257	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W712	Negative	0.17
258	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W712	Negative	0.50
259	PAINT	mg / cm ^2	WINDOW	METAL	A	WHITE	L28-13	7th	W712	Negative	0.11
260	PAINT	mg / cm ^2	WINDOW	METAL	C	WHITE	L28-13	7th	W712	Negative	0.08
261	PAINT	mg / cm ^2	WINDOW	GLASS	C	WHITE	L28-13	7th	W712	Negative	0.00
262	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	W712	Negative	0.00
263	PAINT	mg / cm ^2	DOOR TRIM	METAL	C	GREY	L28-13	7th	W712	Negative	0.00
264	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W710	Negative	0.14
265	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W710	Negative	0.00
266	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W710	Negative	0.14
267	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W710	Negative	0.00
268	PAINT	mg / cm ^2	DOOR	WOOD	C	BROWN	L28-13	7th	W710	Negative	0.00
269	PAINT	mg / cm ^2	DOOR YRIM	METAL	C	GREY	L28-13	7th	W710	Negative	0.00
270	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W706	Negative	0.12
271	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W706	Negative	0.11
272	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W706	Negative	0.07



Reading No	Type	Units	Component	Substrate	Side	Color	Site	Floor	Room	Results	PbC
273	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W706	Negative	0.26
274	PAINT	mg / cm ^2	WINDOW	METAL	A	WHITE	L28-13	7th	W706	Negative	0.08
275	PAINT	mg / cm ^2	DOOR	WOOD	C	BROWN	L28-13	7th	W706	Negative	0.02
276	PAINT	mg / cm ^2	DOOR TRIM	METAL	C	GREY	L28-13	7th	W706	Negative	0.06
277	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W708	Negative	0.23
278	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W708	Negative	0.09
279	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W708	Negative	0.00
280	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W708	Negative	0.00
281	PAINT	mg / cm ^2	WINDOW	METAL	A	WHITE	L28-13	7th	W708	Negative	0.10
282	PAINT	mg / cm ^2	DOOR	WOOD	C	BROWN	L28-13	7th	W708	Negative	0.01
283	PAINT	mg / cm ^2	DOOR TRIM	METAL	C	GREY	L28-13	7th	W708	Negative	0.26
284	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W704	Negative	0.15
285	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W704	Negative	0.13
286	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W704	Negative	0.50
287	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W704	Negative	0.18
288	PAINT	mg / cm ^2	WINDOW	METAL	A	WHITE	L28-13	7th	W704	Negative	0.10
289	PAINT	mg / cm ^2	DOOR	WOOD	C	BROWN	L28-13	7th	W704	Negative	0.03
290	PAINT	mg / cm ^2	DOOR TRIM	METAL	C	GREY	L28-13	7th	W704	Negative	0.10
291	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W702	Negative	0.17
292	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W702	Negative	0.10
293	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W702	Negative	0.23
294	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W702	Negative	0.20
295	PAINT	mg / cm ^2	WINDOW	METAL	A	WHITE	L28-13	7th	W702	Negative	0.13
296	PAINT	mg / cm ^2	DOOR	WOOD	C	BROWN	L28-13	7th	W702	Negative	0.01
297	PAINT	mg / cm ^2	DOOR TRIM	METAL	C	GREY	L28-13	7th	W702	Negative	0.30
298	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W700	Negative	0.00
299	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W700	Negative	0.25
300	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W700	Negative	0.00
301	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W700	Negative	0.00
302	PAINT	mg / cm ^2	DOOR	WOOD	A	BROWN	L28-13	7th	W700	Negative	0.00
303	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	GREY	L28-13	7th	W700	Negative	0.00
304	PAINT	mg / cm ^2	DOOR	WOOD	C	BROWN	L28-13	7th	W700	Negative	0.02
305	PAINT	mg / cm ^2	WINDOW	METAL	B	WHITE	L28-13	7th	W700	Negative	0.11
306	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W700A	Negative	0.08

Reading No	Type	Units	Component	Substrate	Side	Color	Site	Floor	Room	Results	PbC
307	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W700A	Negative	0.09
308	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W700A	Negative	< LOD
309	PAINT	mg / cm ^2	WINDOW	METAL	B	WHITE	L28-13	7th	W700A	Negative	0.06
310	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	W700A	Negative	0.26
311	PAINT	mg / cm ^2	DOOR	WOOD	C	BROWN	L28-13	7th	W700A	Negative	0.00
312	PAINT	mg / cm ^2	DOOR TRIM	METAL	C	GREY	L28-13	7th	W700A	Negative	0.40
313	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W718	Null	0.00
314	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W718	Negative	< LOD
315	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W718	Negative	0.00
316	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W718	Negative	0.00
317	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W718	Negative	0.50
318	PAINT	mg / cm ^2	DOOR	WOOD	A	BROWN	L28-13	7th	W718	Negative	0.01
319	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	GREY	L28-13	7th	W718	Negative	0.00
320	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W720	Negative	0.06
321	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W720	Null	0.00
322	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W720	Negative	0.00
323	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W720	Null	0.01
324	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W720	Negative	0.04
325	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W720	Negative	< LOD
326	PAINT	mg / cm ^2	FLOOR	CONCRETE		WHITE	L28-13	7th	W720	Null	1.00
327	PAINT	mg / cm ^2	FLOOR	CONCRETE		WHITE	L28-13	7th	W720	Positive	1.60
328	PAINT	mg / cm ^2	FLOOR	CONCRETE		GREEN	L28-13	7th	W720	Positive	1.10
329	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE		7th	W720	Negative	0.00
330	SHUTTER_CAL	cps	Calibration								2.48
331	PAINT	mg / cm ^2	Calibration							Positive	1.00
332	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W707	Negative	0.16
333	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W707	Negative	0.06
334	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W707	Negative	0.14
335	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W707	Negative	0.01
336	PAINT	mg / cm ^2	WINDOW	METAL	D	WHITE	L28-13	7th	W707	Negative	0.11
337	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	W707	Negative	< LOD
338	PAINT	mg / cm ^2	DOOR	WOOD	B	BROWN	L28-13	7th	W707	Negative	0.01
339	PAINT	mg / cm ^2	DOOR TRIM	METAL	B	WHITE	L28-13	7th	W707	Negative	0.17
340	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	WHITE	L28-13	7th	W707A	Negative	0.40



Reading No	Type	Units	Component	Substrate	Side	Color	Site	Floor	Room	Results	PbC
341	PAINT	mg / cm ^2	DOOR	WOOD	A	BROWN	L28-13	7th	W707A	Negative	0.02
342	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W707A	Negative	0.10
343	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W707A	Negative	< LOD
344	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W707A	Negative	0.09
345	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W707A	Negative	0.14
346	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	W707A	Negative	< LOD
347	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W703	Negative	0.00
348	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W703	Negative	0.00
349	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W703	Negative	< LOD
350	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W703	Negative	0.00
351	PAINT	mg / cm ^2	WINDOW	METAL	D	WHITE	L28-13	7th	W703	Negative	0.13
352	PAINT	mg / cm ^2	DOOR	WOOD	B	BROWN	L28-13	7th	W703	Negative	0.00
353	PAINT	mg / cm ^2	DOOR TRIM	METAL	B	GREY	L28-13	7th	W703	Negative	0.20
354	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W721	Positive	5.50
355	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W721	Negative	0.09
356	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W721	Negative	0.08
357	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W721	Negative	0.00
358	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	W721	Null	0.00
359	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	W721	Negative	0.14
360	PAINT	mg / cm ^2	DOOR	WOOD	A	BROWN	L28-13	7th	W721	Negative	0.07
361	PAINT	mg / cm ^2	DOOR TRIM	WOOD	A	GREY	L28-13	7th	W721	Negative	0.30
362	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W719	Negative	0.13
363	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W719	Negative	0.30
364	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W719	Negative	0.12
365	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W719	Negative	0.00
366	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	W719	Negative	0.00
367	PAINT	mg / cm ^2	DOOR	WOOD	A	BROWN	L28-13	7th	W719	Negative	0.04
368	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	GREY	L28-13	7th	W719	Negative	0.19
369	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W725	Negative	0.13
370	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W725	Negative	0.20
371	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W725	Negative	0.16
372	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W725	Null	0.09
373	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W725	Negative	0.08
374	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	W725	Negative	0.17

Reading No	Type	Units	Component	Substrate	Side	Color	Site	Floor	Room	Results	PbC
375	PAINT	mg / cm ^2	DOOR	WOOD	D	BROWN	L28-13	7th	W725	Negative	0.03
376	PAINT	mg / cm ^2	DOOR TRIM	METAL	D	GREY	L28-13	7th	W725	Negative	0.11
377	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W727	Negative	0.15
378	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W727	Negative	0.23
379	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W727	Negative	0.08
380	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W727	Negative	0.13
381	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	W727	Negative	0.13
382	PAINT	mg / cm ^2	DOOR TRIM	METAL	D	GREY	L28-13	7th	W727	Negative	0.07
383	PAINT	mg / cm ^2	DOOR	WOOD	D	BROWN	L28-13	7th	W727	Negative	0.02
384	PAINT	mg / cm ^2	WALL	PLASTER	A	YELLOW	L28-13	7th	W701	Negative	0.00
385	PAINT	mg / cm ^2	WALL	PLASTER	B	YELLOW	L28-13	7th	W701	Negative	0.00
386	PAINT	mg / cm ^2	WALL	PLASTER	D	YELLOW	L28-13	7th	W701	Negative	0.13
387	PAINT	mg / cm ^2	CABINET	METAL	C	YELLOW	L28-13	7th	W701	Negative	0.00
388	PAINT	mg / cm ^2	CEILING	PLASTER		YELLOW	L28-13	7th	W701	Negative	0.03
389	PAINT	mg / cm ^2	DOOR TRIM	METAL	B	BEIGE	L28-13	7th	W701	Negative	0.02
390	PAINT	mg / cm ^2	DOOR	WOOD	B	BROWN	L28-13	7th	W701	Negative	0.00
391	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W723	Positive	2.50
392	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W723	Negative	0.29
393	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W723	Negative	0.00
394	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W723	Negative	0.00
395	PAINT	mg / cm ^2	CEILING	1x1 ACT		WHITE	L28-13	7th	W723	Negative	0.00
396	PAINT	mg / cm ^2	WINDOW	METAL	B	WHITE	L28-13	7th	W723	Negative	0.09
397	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	WHITE	L28-13	7th	W723	Positive	4.40
398	PAINT	mg / cm ^2	DOOR	WOOD	A	BROWN	L28-13	7th	W723	Negative	0.01
399	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W713	Negative	0.40
400	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W713	Negative	0.16
401	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W713	Negative	0.28
402	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W713	Negative	0.01
403	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	W713	Negative	< LOD
404	PAINT	mg / cm ^2	WINDOW	METAL	C	WHITE	L28-13	7th	W713	Negative	0.12
405	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	WHITE	L28-13	7th	W713	Positive	5.70
406	PAINT	mg / cm ^2	DOOR TRIM	WOOD	A	BROWN	L28-13	7th	W713	Negative	0.06
407	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W713A	Negative	0.03
408	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W713A	Negative	0.05

Reading No	Type	Units	Component	Substrate	Side	Color	Site	Floor	Room	Results	PbC
409	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W713A	Negative	0.08
410	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	W713A	Negative	0.13
411	PAINT	mg / cm ^2	DOOR TRIM	METAL	C	WHITE	L28-13	7th	W713A	Negative	0.12
412	PAINT	mg / cm ^2	DOOR	WOOD	C	BROWN	L28-13	7th	W713A	Negative	0.01
413	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W713 CLOSET	Negative	0.13
414	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W713 CLOSET	Negative	0.15
415	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W713 CLOSET	Null	0.06
416	PAINT	mg / cm ^2	DOOR TRIM	METAL	D	WHITE	L28-13	7th	W713 CLOSET	Positive	1.40
417	SHUTTER_CAL	cps	Calibration								2.19
418	PAINT	mg / cm ^2	Calibration							Positive	1.10
419	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E728	Negative	0.00
420	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E728	Negative	0.00
421	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E728	Negative	0.00
422	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E728	Negative	0.00
423	PAINT	mg / cm ^2	DOOR TRIM	METAL	C	GREY	L28-13	7th	E728	Negative	0.02
424	PAINT	mg / cm ^2	DOOR	WOOD	C	BROWN	L28-13	7th	E728	Negative	0.01
425	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	CORR20	Negative	0.60
426	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	CORR20	Negative	0.40
427	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	CORR20	Null	0.27
428	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	CORR20	Null	0.24
429	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W715	Negative	0.00
430	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W715	Negative	0.40
431	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W715	Negative	0.11
432	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W715	Positive	1.90
433	PAINT	mg / cm ^2	WINDOW	METAL	B	WHITE	L28-13	7th	W715	Negative	0.15
434	PAINT	mg / cm ^2	CEILING	1x1ACT		WHITE	L28-13	7th	W715	Negative	0.03
435	PAINT	mg / cm ^2	DOOR	METAL	D	GREY	L28-13	7th	W715	Negative	0.23
436	PAINT	mg / cm ^2	DOOR	WOOD	D	BROWN	L28-13	7th	W715	Negative	0.02
437	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W711C	Negative	0.00
438	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W711C	Negative	0.00
439	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W711C	Negative	0.01
440	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W711C	Negative	0.00
441	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	GREY	L28-13	7th	W711C	Negative	0.00
442	PAINT	mg / cm ^2	DOOR	WOOD	A	BROWN	L28-13	7th	W711C	Negative	0.00

Reading No	Type	Units	Component	Substrate	Side	Color	Site	Floor	Room	Results	PbC
443	PAINT	mg / cm ^2	DOOR TRIM	METAL	B	GREY	L28-13	7th	W711C	Negative	0.00
444	PAINT	mg / cm ^2	DOOR	WOOD	B	BROWN	L28-13	7th	W711B	Negative	0.00
445	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W711D	Negative	0.00
446	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W711D	Negative	0.01
447	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W711D	Negative	0.01
448	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W711D	Negative	0.00
449	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	GREY	L28-13	7th	W711D	Negative	0.02
450	PAINT	mg / cm ^2	DOOR	WOOD	A	BROWN	L28-13	7th	W711D	Negative	0.00
451	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W711A	Negative	0.30
452	PAINT	mg / cm ^2	DOOR FRAME	METAL	C	GREY	L28-13	7th	W711A	Negative	0.02
453	PAINT	mg / cm ^2	DOOR	WOOD	C	BROWN	L28-13	7th	W711A	Negative	0.03
454	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W711	Negative	0.00
455	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W711	Negative	0.04
456	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W711	Negative	0.01
457	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W711	Negative	0.00
458	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	WHITE	L28-13	7th	W711	Negative	0.10
459	PAINT	mg / cm ^2	DOOR	WOOD	A	BROWN	L28-13	7th	W711	Negative	0.02
460	PAINT	mg / cm ^2	DOOR TRIM	METAL	B	GREY	L28-13	7th	W711	Negative	0.04
461	PAINT	mg / cm ^2	DOOR	WOOD	B	BROWN	L28-13	7th	W711	Negative	0.07
462	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W709	Negative	0.00
463	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W709	Positive	2.20
464	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W709	Negative	0.10
465	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W709	Negative	0.00
466	PAINT	mg / cm ^2	DOOR TRIM	METAL	B	GREY	L28-13	7th	W709	Negative	0.24
467	PAINT	mg / cm ^2	DOOR	WOOD	B	BROWN	L28-13	7th	W709	Negative	0.02
468	PAINT	mg / cm ^2	WALL	PLASTER	A	GREEN	L28-13	7th	W717	Negative	0.15
469	PAINT	mg / cm ^2	WALL	WOOD	B	GREEN	L28-13	7th	W717	Negative	0.00
470	PAINT	mg / cm ^2	WALL	PLASTER	C	GREEN	L28-13	7th	W717	Negative	0.06
471	PAINT	mg / cm ^2	CEILING	PLASTER		GREEN	L28-13	7th	W717	Null	0.08
472	PAINT	mg / cm ^2	DOOR	WOOD	D	BROWN	L28-13	7th	W717	Negative	0.03
473	PAINT	mg / cm ^2	DOOR trim	METAL	D	GREY	L28-13	7th	W717	Negative	0.24
474	PAINT	mg / cm ^2	CEILING	PLASTER		WHITE	L28-13	7th	W705	Negative	0.00
475	PAINT	mg / cm ^2	WALL	PLASTER	A	GREY	L28-13	7th	E715CORR	Negative	0.00
476	PAINT	mg / cm ^2	WALL	PLASTER	B	GREY	L28-13	7th	E715CORR	Negative	0.00

Reading No	Type	Units	Component	Substrate	Side	Color	Site	Floor	Room	Results	PbC
477	PAINT	mg / cm ^2	WALL	PLASTER	C	GREY	L28-13	7th	E715CORR	Negative	0.00
478	PAINT	mg / cm ^2	DOOR TRIM	METAL	B	GREY	L28-13	7th	E715CORR	Negative	0.14
479	PAINT	mg / cm ^2	WALL	PLASTER	A	GREY	L28-13	7th	E714CORR	Negative	0.02
480	PAINT	mg / cm ^2	WALL	PLASTER	B	GREY	L28-13	7th	E714CORR	Negative	0.00
481	PAINT	mg / cm ^2	WALL	PLASTER	C	GREY	L28-13	7th	E714CORR	Negative	0.00
482	PAINT	mg / cm ^2	WALL	PLASTER	D	GREY	L28-13	7th	E714CORR	Negative	0.00
483	PAINT	mg / cm ^2	DOOR TRIM	METAL	B	GREY	L28-13	7th	E714CORR	Negative	0.29
484	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E708CORR	Negative	0.00
485	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E708CORR	Negative	0.00
486	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E708CORR	Negative	0.00
487	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E708CORR	Negative	0.00
488	PAINT	mg / cm ^2	DOOR	METAL	B	GREY	L28-13	7th	E708CORR	Negative	< LOD
489	PAINT	mg / cm ^2	WALL	PLASTER	A	GREY	L28-13	7th	E704CORR	Negative	0.00
490	PAINT	mg / cm ^2	WALL	PLASTER	C	GREY	L28-13	7th	E704CORR	Negative	0.00
491	PAINT	mg / cm ^2	WALL	PLASTER	D	GREY	L28-13	7th	E704CORR	Negative	0.00
492	PAINT	mg / cm ^2	DOOR TRIM	METAL	B	GREY	L28-13	7th	E704CORR	Negative	0.00
493	PAINT	mg / cm ^2	DOOR	METAL	B	GREY	L28-13	7th	E704CORR	Negative	0.00
494	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E706ENTRY	Negative	0.00
495	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E706ENTRY	Negative	0.00
496	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E706ENTRY	Negative	0.00
497	PAINT	mg / cm ^2	DOOR TRIM	METAL	C	GREY	L28-13	7th	E706ENTRY	Negative	0.05
498	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E702ENTRY	Negative	0.00
499	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	E702ENTRY	Negative	0.00
500	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	E702ENTRY	Negative	0.00
501	PAINT	mg / cm ^2	DOOR TRIM	METAL	C	GREY	L28-13	7th	E702ENTRY	Negative	0.06
502	PAINT	mg / cm ^2	WALL	PLASTER	A	GREY	L28-13	7th	E701CORR	Negative	0.02
503	PAINT	mg / cm ^2	WALL	PLASTER	B	GREY	L28-13	7th	E701CORR	Negative	0.00
504	PAINT	mg / cm ^2	WALL	PLASTER	C	GREY	L28-13	7th	E701CORR	Negative	0.00
505	PAINT	mg / cm ^2	WALL	PLASTER	D	GREY	L28-13	7th	E701CORR	Null	0.00
506	PAINT	mg / cm ^2	DOOR TRIM	METAL	B	GREY	L28-13	7th	E701CORR	Negative	0.00
507	PAINT	mg / cm ^2	WALL	PLASTER	A	GREY	L28-13	7th	W714CORR	Negative	0.00
508	PAINT	mg / cm ^2	WALL	PLASTER	B	GREY	L28-13	7th	W714CORR	Negative	0.00
509	PAINT	mg / cm ^2	WALL	PLASTER	C	GREY	L28-13	7th	W714CORR	Negative	0.02
510	PAINT	mg / cm ^2	WALL	PLASTER	D	GREY	L28-13	7th	W714CORR	Negative	0.00

Reading No	Type	Units	Component	Substrate	Side	Color	Site	Floor	Room	Results	PbC
511	PAINT	mg / cm ^2	DOOR TRIM	METAL	B	GREY	L28-13	7th	W714CORR	Negative	0.15
512	PAINT	mg / cm ^2	WALL	PLASTER	A	GREY	L28-13	7th	W706CORR	Negative	0.00
513	PAINT	mg / cm ^2	WALL	PLASTER	B	GREY	L28-13	7th	W706CORR	Negative	0.50
514	PAINT	mg / cm ^2	WALL	METAL	B	WHITE	L28-13	7th	W706CORR	Negative	0.08
515	PAINT	mg / cm ^2	WALL	PLASTER	C	GREY	L28-13	7th	W706CORR	Negative	0.05
516	PAINT	mg / cm ^2	WALL	PLASTER	D	GREY	L28-13	7th	W706CORR	Negative	0.00
517	PAINT	mg / cm ^2	DOOR	METAL	D	GREY	L28-13	7th	W706CORR	Negative	0.02
518	PAINT	mg / cm ^2	WALL	PLASTER	A	GREY	L28-13	7th	CORR7U5	Negative	0.01
519	PAINT	mg / cm ^2	WALL	PLASTER	B	GREY	L28-13	7th	CORR7U5	Negative	0.01
520	PAINT	mg / cm ^2	WALL	PLASTER	C	GREY	L28-13	7th	CORR7U5	Negative	0.22
521	PAINT	mg / cm ^2	WALL	PLASTER	C	GREY	L28-13	7th	CORR7U5	Null	0.20
522	PAINT	mg / cm ^2	WALL	PLASTER	C	GREY	L28-13	7th	CORR7U5	Null	1.20
523	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	CORR7U5	Positive	1.40
524	PAINT	mg / cm ^2	DOOR	METAL	D	GREY	L28-13	7th	CORR7U5	Negative	0.30
525	PAINT	mg / cm ^2	WINDOW	METAL	A	GREY	L28-13	7th	CORR7U5	Negative	0.10
526	PAINT	mg / cm ^2	WINDOW	METAL	B	GREY	L28-13	7th	CORR7U5	Negative	0.00
527	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W716CORR	Negative	0.03
528	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E703lcorr	Null	0.05
529	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	E703lcorr	Null	1.20
530	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	E715CORR	Negative	0.02
531	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	STAIR 1	Negative	0.01
532	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	STAIR 1	Negative	0.11
533	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	STAIR 1	Null	0.08
534	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	STAIR 1	Negative	0.18
535	PAINT	mg / cm ^2	DOOR	WOOD	A	WHITE	L28-13	7th	STAIR 1	Negative	0.00
536	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	GREY	L28-13	7th	STAIR 1	Negative	< LOD
537	PAINT	mg / cm ^2	WALL	PLASTER	C	GREY	L28-13	7th	E712CORR	Null	1.20
538	PAINT	mg / cm ^2	WALL	PLASTER	A	GREY	L28-13	7th	E704CORR	Negative	0.00
539	PAINT	mg / cm ^2	WALL	PLASTER	A	GREY	L28-13	7th	W704corr	Null	0.80
540	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W705corr	Negative	0.23
541	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W705corr	Null	0.19
542	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W705corr	Negative	0.22
543	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W705corr	Negative	0.14
544	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	W705corr	Negative	0.60



Reading No	Type	Units	Component	Substrate	Side	Color	Site	Floor	Room	Results	PbC
545	PAINT	mg / cm ^2	DOOR TRIM	METAL	A	GREY	L28-13	7th	W705corr	Negative	0.24
546	PAINT	mg / cm ^2	DOOR TRIM	METAL	B	GREY	L28-13	7th	W705corr	Negative	0.29
547	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	FELVCORR	Negative	0.21
548	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	FELVCORR	Null	1.00
549	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	FELVCORR	Negative	0.11
550	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	FELVCORR	Null	0.20
551	PAINT	mg / cm ^2	WALL	PLASTER	D	WHITE	L28-13	7th	FELVCORR	Null	0.90
552	PAINT	mg / cm ^2	DOOR TRIM	METAL	D	GREY	L28-13	7th	FELVCORR	Negative	0.14
553	PAINT	mg / cm ^2	F ELEV 3	METAL	A	BROWN	L28-13	7th	FELVCORR	Negative	0.00
554	PAINT	mg / cm ^2	F ELEV 4	METAL	A	BROWN	L28-13	7th	FELVCORR	Negative	0.00
555	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	W715corr	Negative	0.20
556	PAINT	mg / cm ^2	WALL	PLASTER	B	WHITE	L28-13	7th	W715corr	Negative	0.12
557	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	W715corr	Negative	0.19
558	PAINT	mg / cm ^2	WALL	PLASTER	A	WHITE	L28-13	7th	STAIR 2	Negative	0.17
559	PAINT	mg / cm ^2	WALL	PLASTER	B	BEIGE	L28-13	7th	STAIR 2	Negative	0.09
560	PAINT	mg / cm ^2	WALL	PLASTER	C	WHITE	L28-13	7th	STAIR 2	Negative	0.11
561	PAINT	mg / cm ^2	DOOR	METAL	B	GREY	L28-13	7th	STAIR 2	Negative	0.00
562	PAINT	mg / cm ^2	DOOR TRIM	METAL	B	GREY	L28-13	7th	STAIR 2	Negative	0.07
563	PAINT	mg / cm ^2	WALL	PLASTER	A	GREY	L28-13	7th	WAITING RM	Negative	0.05
564	PAINT	mg / cm ^2	WALL	PLASTER	B	GREY	L28-13	7th	WAITING RM	Negative	0.00
565	PAINT	mg / cm ^2	WALL	PLASTER	C	GREY	L28-13	7th	WAITING RM	Negative	0.00
566	PAINT	mg / cm ^2	WALL	PLASTER	D	GREY	L28-13	7th	WAITING RM	Negative	0.00
567	PAINT	mg / cm ^2	P ELEV 1	METAL	D	BROWN	L28-13	7th	WAITING RM	Negative	0.00
568	PAINT	mg / cm ^2	P ELEV 2	METAL	D	BROWN	L28-13	7th	WAITING RM	Negative	0.00
569	PAINT	mg / cm ^2	WALL	PLASTER	B	GREY	L28-13	7th	W723corr	Null	0.00
570	PAINT	mg / cm ^2	WALL	PLASTER	B	GREY	L28-13	7th	W723corr	Negative	0.01
571	PAINT	mg / cm ^2	WALL	PLASTER	C	GREY	L28-13	7th	W723corr	Negative	0.00
572	PAINT	mg / cm ^2	WALL	PLASTER	D	GREY	L28-13	7th	W723corr	Negative	0.00
573	PAINT	mg / cm ^2	DOOR TRIM	METAL	D	GREY	L28-13	7th	W723corr	Negative	0.23



9830 South 51<sup>st</sup> Street, Suite B-109 / PHOENIX, ARIZONA 85044 / 480-940-5294 or 800-362-3373 / FAX 480-893-1726  
emclab@emclabs.com

**LEAD (Pb) IN PAINT CHIP SAMPLES**  
**EMC SOP METHOD #L01/1 EPA SW-846 METHOD 7420**

<b>EMC LAB #:</b> L50507			<b>DATE RECEIVED:</b> 10/21/13		
<b>CLIENT:</b> Leon Environmental			<b>REPORT DATE:</b> 10/21/13		
			<b>DATE OF ANALYSIS:</b> 10/21/13		
<b>CLIENT ADDRESS:</b> 5637 N. Fig Garden Drive Suite #104 Fresno, CA 93722			<b>P.O. NO.:</b>		
<b>PROJECT NAME:</b> VA Hospital 7 <sup>th</sup> Floor-2615 E. Clinton, Fresno, CA			<b>PROJECT NO.:</b> L28-13		


EMC # L50507-	SAMPLE DATE /13	CLIENT SAMPLE #	DESCRIPTION	REPORTING LIMIT (%Pb by weight)	%Pb BY WEIGHT
1	10/18	L01	7 <sup>th</sup> Floor E711 Wall/Off White/Ceramic Tile	0.010	0.010
2	10/18	L02	7 <sup>th</sup> Floor W725 Wall/Cream/Ceramic Tile	0.010	BRL
3	10/18	L03	7 <sup>th</sup> Floor W701 Corr. Wall/Green/Ceramic Tile	0.010	BRL
4	10/18	L04	7 <sup>th</sup> Floor W725 Floor/Brown/Ceramic Tile	0.010	BRL
5	10/18	L05	7 <sup>th</sup> Floor W705 Wall/Beige/Ceramic Tile	0.100	1.67^
6	10/18	L06	7 <sup>th</sup> Floor W719 Ceiling/White/Paint	0.010	BRL
7	10/18	L07	7 <sup>th</sup> Floor W707 Corr. Wall/White/Paint	0.010	0.150
8	10/18	L08	7 <sup>th</sup> Floor W720 Ceiling/Off White/Paint	0.010	BRL
9	10/18	L09	7 <sup>th</sup> Floor W701 Wall/Cream/Paint	0.010	0.029
10	10/18	L10	7 <sup>th</sup> Floor W724 Ceiling/Cream/Paint	0.010	0.169


^ = Dilution Factor Changed    \* = Excessive Substrate May Bias Sample Results    **BRL** = Below Reportable Limits    # = Very Small Amount Of Sample Submitted, May Affect Result

This report applies to the standards or procedures identified and to the samples tested only. The test results are not necessarily indicative or representative of the qualities of the lot from which the sample was taken or of apparently identical or similar products, nor do they represent an ongoing quality assurance program unless so noted. Unless otherwise noted, all quality control analyses for the samples noted above were within acceptable limits.

Where it is noted that a sample with excessive substrate was submitted for laboratory analysis, such analysis may be biased. The lead content of such sample may, in actuality, be greater than reported. EMC makes no warranty, express or implied, as to the accuracy of the analysis of samples noted to have been submitted with excessive substrate. Resampling is recommended in such situations to verify original laboratory results.

These reports are for the exclusive use of the addressed client and are rendered upon the condition that they will not be reproduced wholly or in part for advertising or other purposes over our signature or in connection with our name without special written permission. Samples not destroyed in testing are retained a maximum of sixty (60) days.

**ANALYST:**   
Jason Thompson

**QA COORDINATOR:**   
Kurt Kettler



# CHAIN OF CUSTODY

EMC Laboratories  
9830 S. 51<sup>ST</sup> St., Ste B-109  
Phoenix, AZ 85044  
(800) 362-3373 Fax (480) 893-1726

LAB#: 250507  
TAT: Rush  
Rec'd: 10/21/13  
EMC USE ONLY

COMPANY NAME: Leon Environmental  
5637 N. Fig Garden Drive Suite#104  
Fresno Ca 93722

BILL TO: (If Different Location)

CONTACT: Tommy Leon  
Phone/Fax: 559-274-9200 / 559-274-9240  
Email: leonenviro@comcast.net

Now Accepting: VISA - MASTERCARD

Price Quoted: \$\_\_\_\_ / Sample \$\_\_\_\_ / Layers

## COMPLETE ITEMS 1-4: (Failure to complete any items may cause a delay in processing or analyzing your samples)

1. **TURNAROUND TIME:** [4hr rush] [8hr rush] [1-Day] [2-Day] [3-Day] [5-Day] [6-10 Day]

\*\*\*\*Prior confirmation of turnaround time is required

\*\*\*\*Additional charges for rush analysis (please call marketing department for pricing details)

\*\*\*\*Laboratory analysis may be subject to delay if credit terms are not met

2. **TYPE OF ANALYSIS:** [Bulk-PLM] [Air-PCM] [Lead] [Point Count] [Fungi: AOC, W-C, Bulk, Swab, Tape]

3. **DISPOSAL INSTRUCTIONS:** [Dispose of samples at EMC] / [Return samples to me at my expense]

(If you do not indicate preference, EMC will dispose of samples 60 days from analysis.)

4. **Project Name:** VA HOSPITAL 7th FLOOR 2615 E. CLINTON FRESNO, CA

P.O. Number: \_\_\_\_\_ Project Number: L28-13

EMC SAMPLE #	CLIENT SAMPLE #	DATE & TIME SAMPLED	LOCATION/MATERIAL TYPE	Samples Accepted Yes / No	AIR SAMPLE INFO / COMMENTS		
					ON	OFF	FLOW RATE
10	L01			Y N			
				Y N			
				Y N			
				Y N			
				Y N			
				Y N			
				Y N			
				Y N			
				Y N			
				Y N			

**\* SEE ATTACHED**

**FORM**

SPECIAL INSTRUCTIONS: PAINT CHIP BY WEIGHT

Sample Collector: (Print) Joshua Cooke

(Signature) [Signature]

Relinquished by: [Signature] Date/Time: 10/18/13 Received by: [Signature] Date/Time: 10/21/13

Relinquished by: [Signature] Date/Time: 10/21/13 Received by: [Signature] Date/Time: 10/21/13

Relinquished by: \_\_\_\_\_ Date/Time: \_\_\_\_\_ Received by: \_\_\_\_\_ Date/Time: \_\_\_\_\_

\*\* In the event of any dispute between the above parties for these services or otherwise, parties agree that jurisdiction and venue will be in Phoenix, Arizona and prevailing party will be entitled to attorney's fees and court costs.

Leon Environmental Services

563<sup>rd</sup> N. Figgorden Dr., Suite 104, Fresno, CA 93722 Phone: 559.274.9200 Fax: 559.274.9240 E-mail: [leontavira@comcast.net](mailto:leontavira@comcast.net)

Customer: TIM BULLER

Company VA CENTRAL CA HEALTH CARE SYSTEM

Date: 10/01/23

Job No. L20-13

Analysis PLM

**Turn Around:**

8hr Rush

## Same Day

24hr

48hr

**3-5 days**

Inspection Site: VA HOSPITAL 7th Floor; 2615 E. CLINTON AVE FRESNO, CA

[illegible]

Relinquished

10/3

Received

ed 17

1

10/21/3