



NOTE:
FLEXIBLE DUCT CONNECTIONS SHALL BE INSTALLED TO
ADC STANDARDS AND SEALED TO UL STANDARDS PER
AMC 603 AND 604.2.1. AS A MINIMUM, THE
CONTRACTOR SHALL SECURE THE FLEXIBLE DUCT TO
GRILLE AND METAL DUCT WITH DRAWBANDS, AND WRAP
3" WIDE ALUMINUM TAPE EQUAL TO HARDCAST "FOIL GRIP"
AROUND DRAWBAND AND EXPOSED END OF
FLEXIBLE DUCT INSULATION.

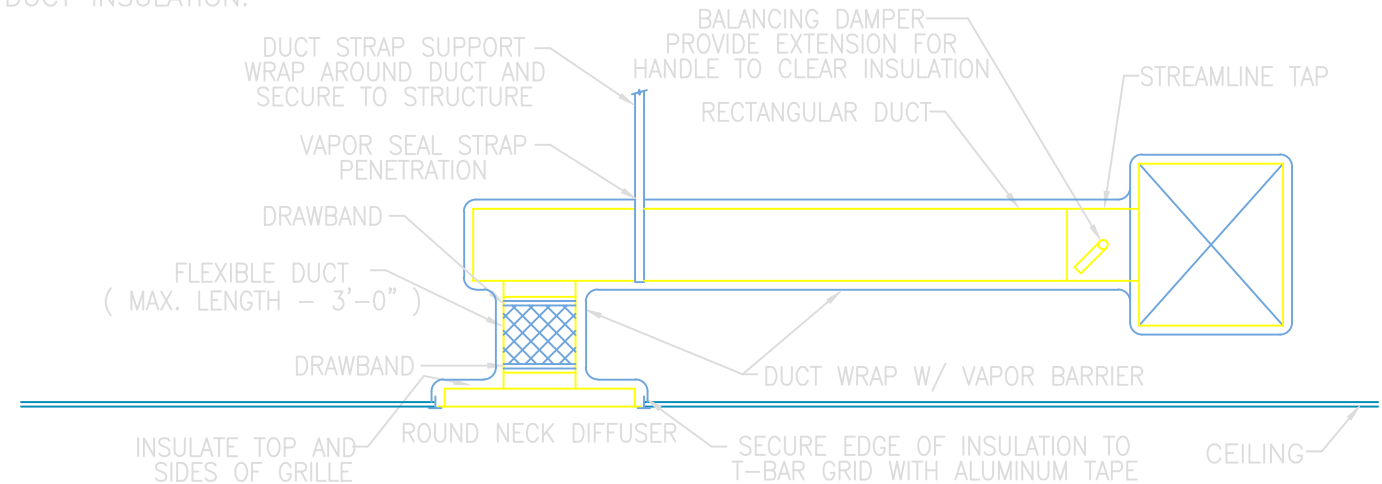


1 TYPICAL DIFFUSER CONNECTION TO RECTANGULAR DUCT DETAIL
NOT TO SCALE


NOTE:
FLEXIBLE DUCT CONNECTIONS SHALL BE INSTALLED TO
ADC STANDARDS AND SEALED TO UL STANDARDS PER
AMC 603 AND 604.2.1. AS A MINIMUM, THE
CONTRACTOR SHALL SECURE THE FLEXIBLE DUCT TO
ENDS OF METAL DUCT WITH DRAWBANDS, AND WRAP 3"
WIDE ALUMINUM TAPE EQUAL TO HARDCAST "FOIL GRIP"
AROUND DRAWBAND AND EXPOSED END OF FLEXIBLE
DUCT INSULATION.

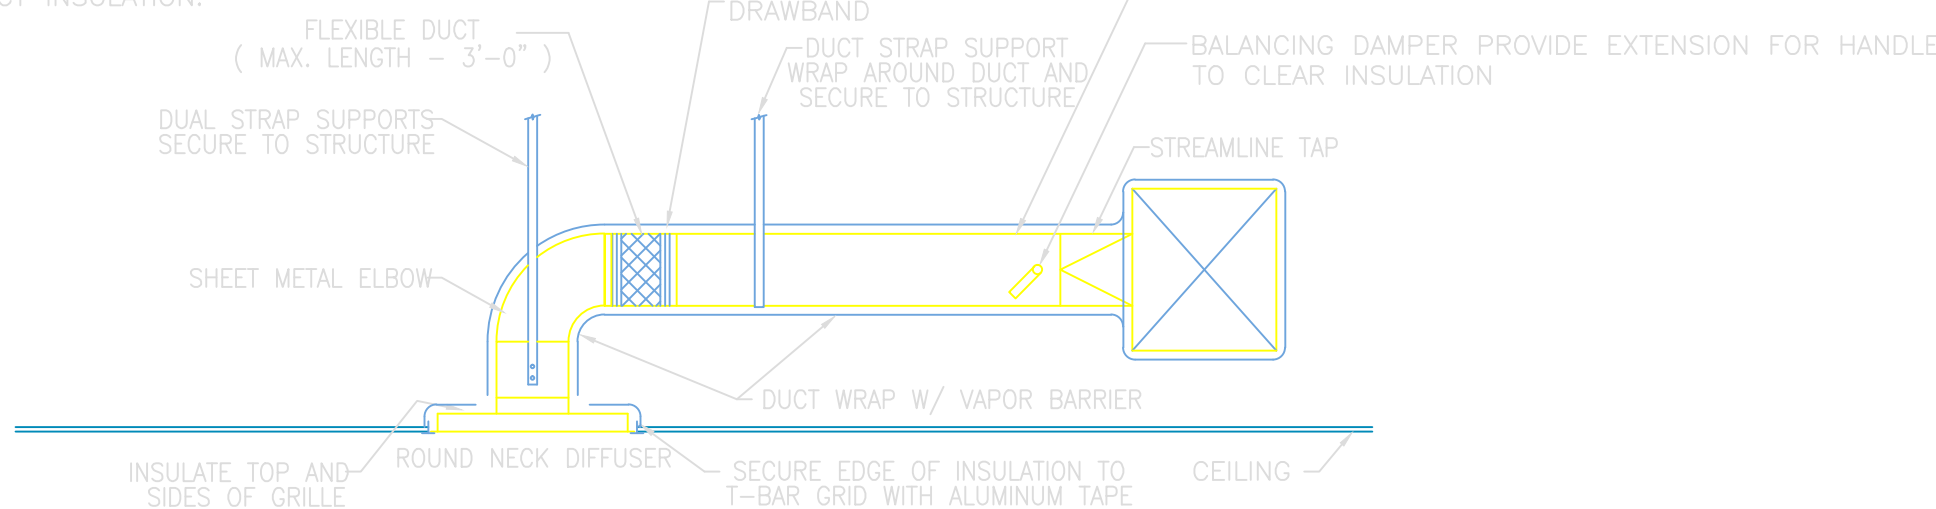


2 TYPICAL DIFFUSER CONNECTION TO ROUND DUCT DETAIL
NOT TO SCALE

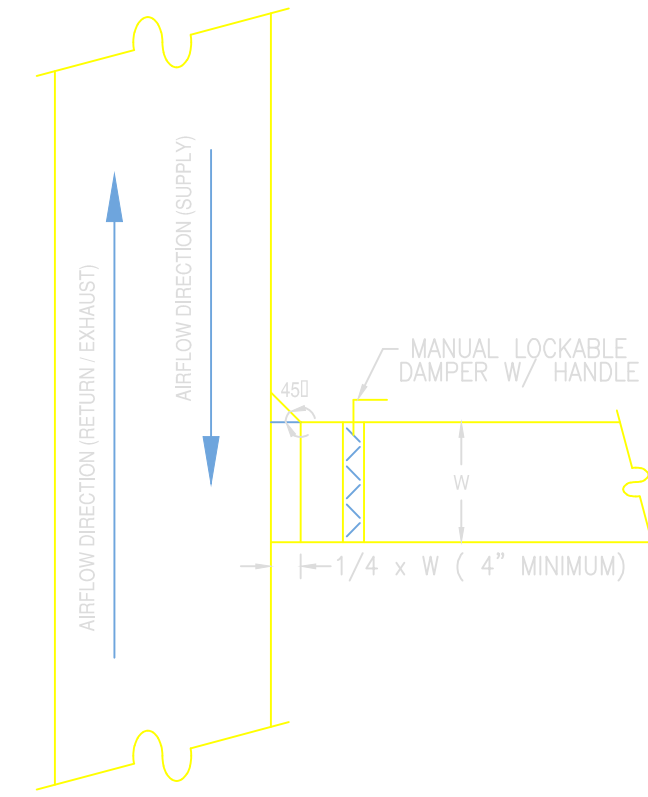


3 TYPICAL RECTANGULAR BRANCH
DUCT CONNECTION DETAIL
NOT TO SCALE

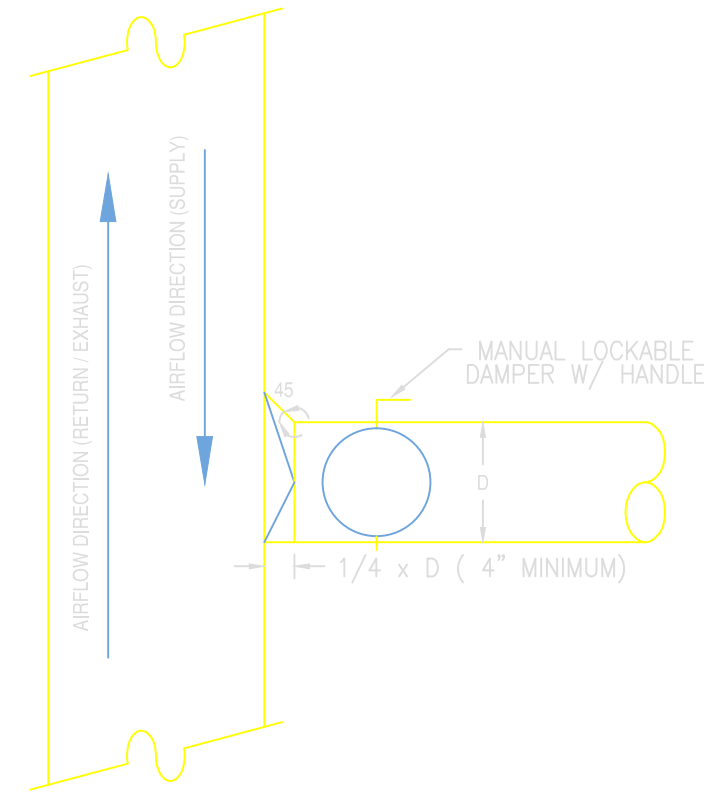


4 TYPICAL ROUND BRANCH
DUCT CONNECTION DETAIL
NOT TO SCALE

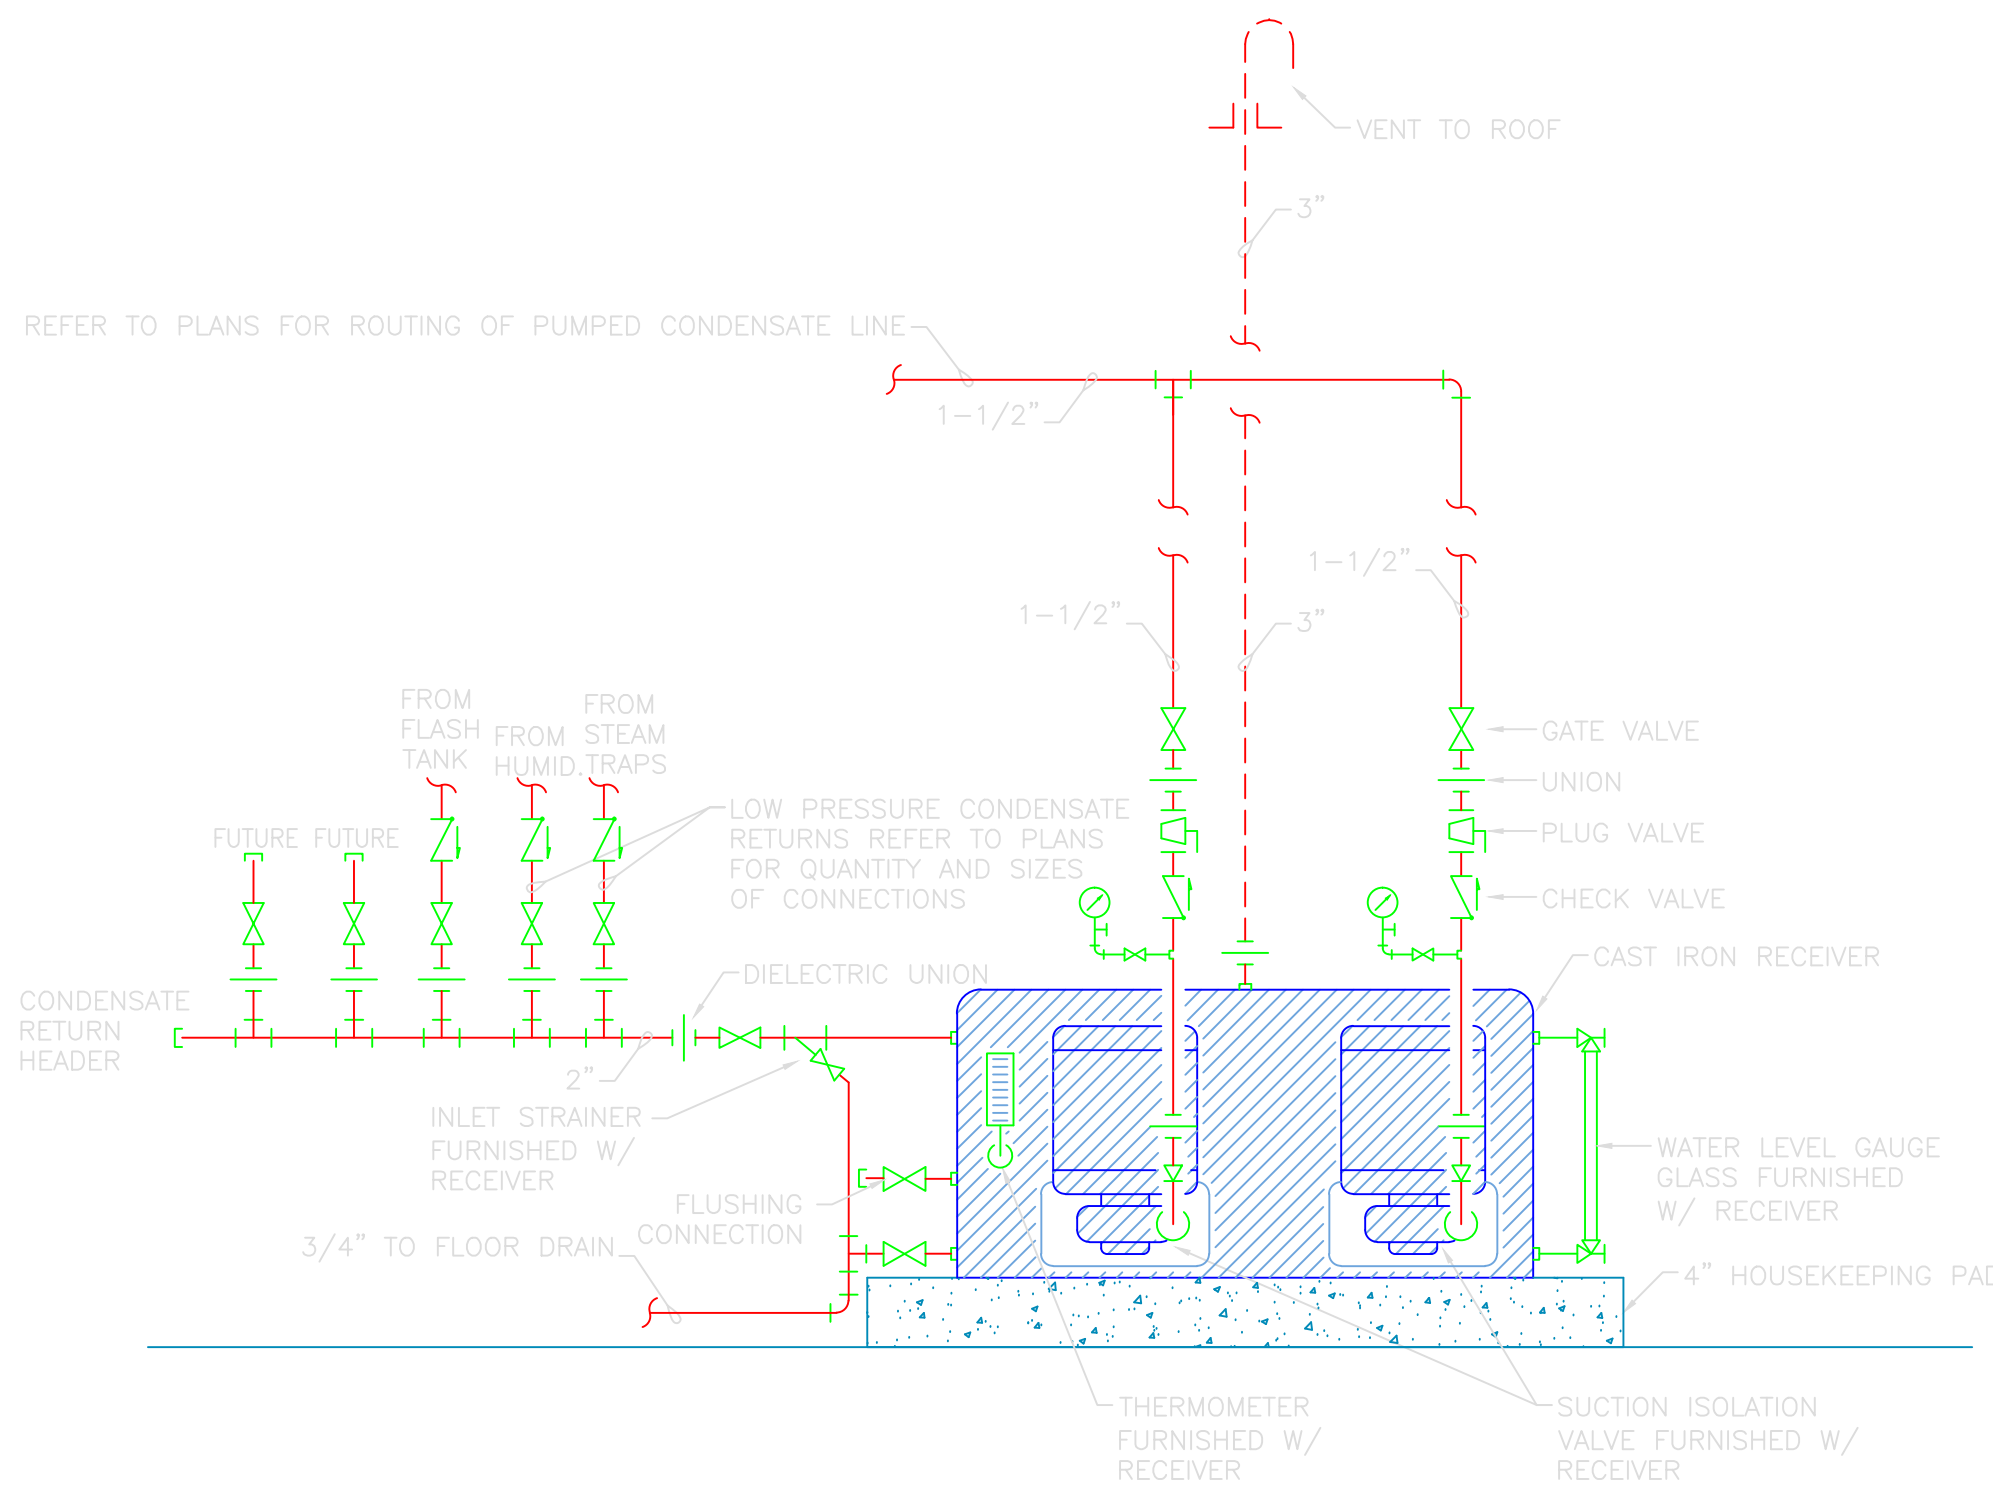


5 CONDENSATE RETURN PUMP PIPING DETAIL
NOT TO SCALE

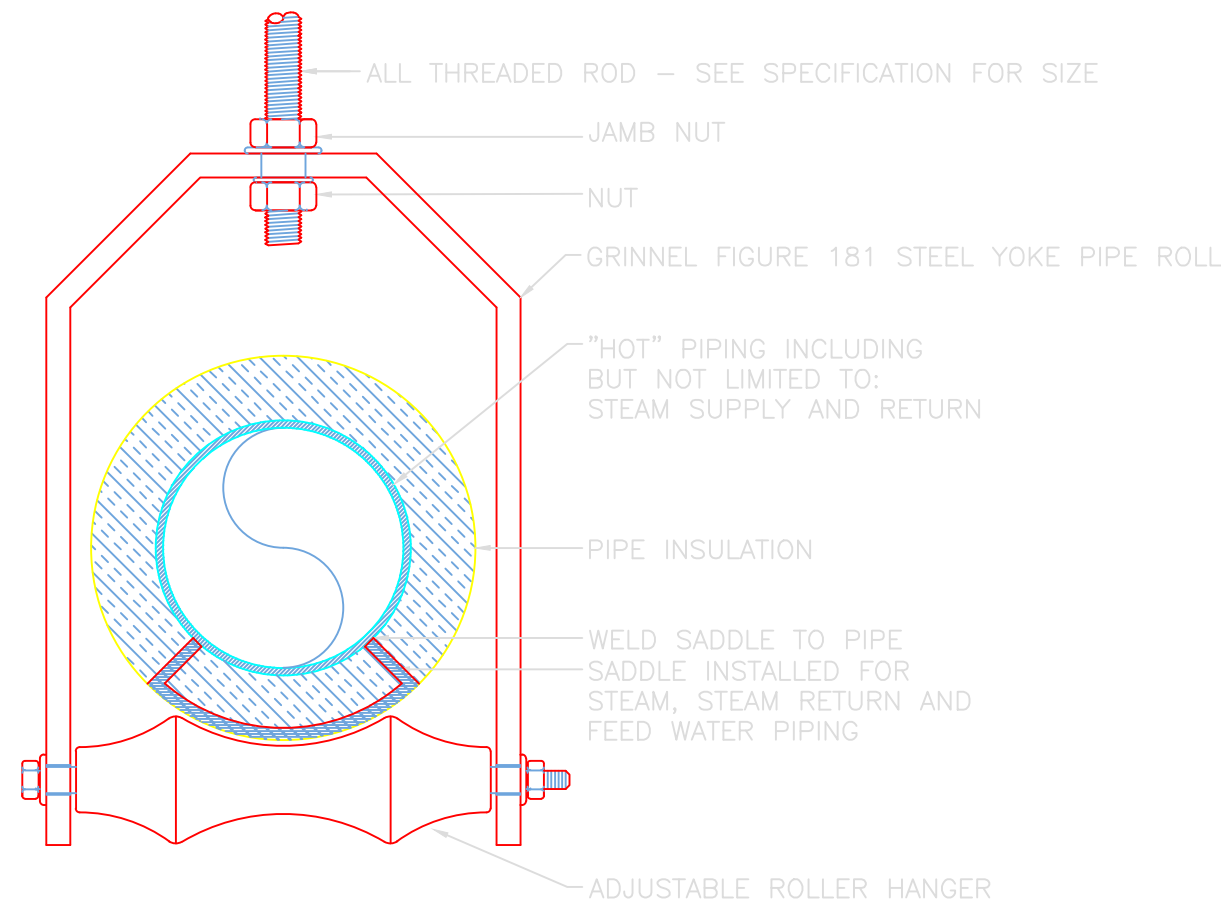

6 ROLLER PIPE HANGER DETAIL
NOT TO SCALE

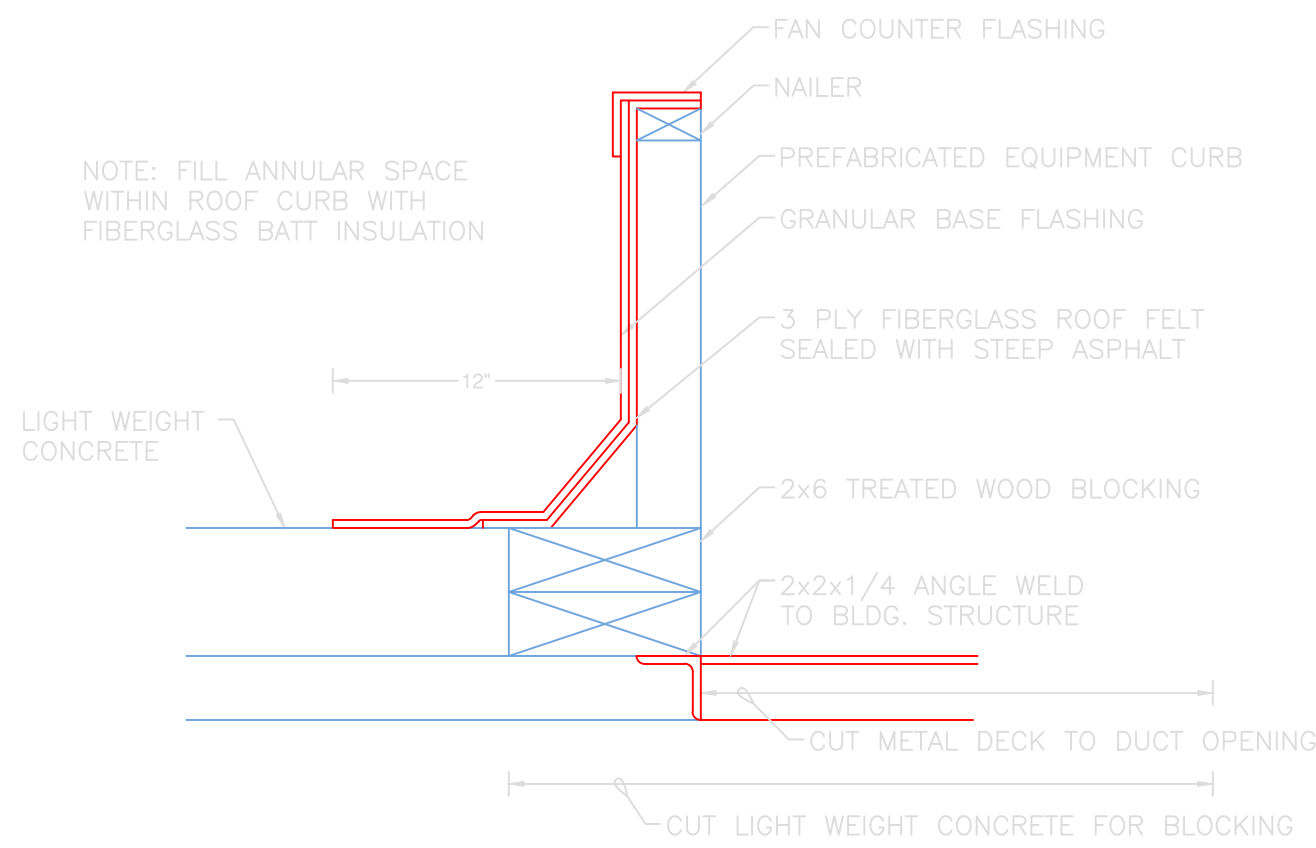

7 EXHAUST FAN CURB DETAIL
NOT TO SCALE

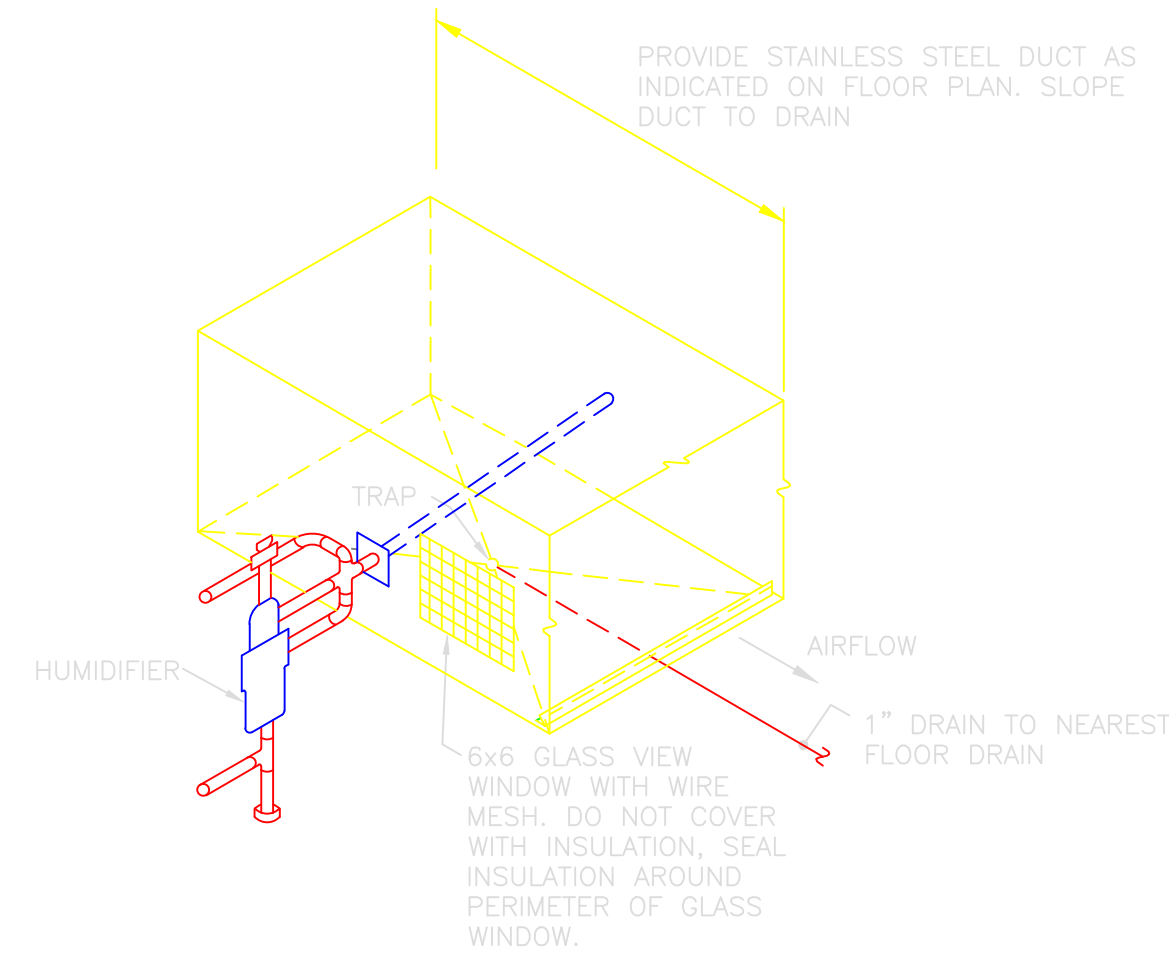

8 HUMIDIFIER DUCT DETAIL
NOT TO SCALE

USE APPLICABLE DETAILS

Revisions	Date	Approved: Medical Center Director	Seals	TAGGART FOSTER-CURRENCE GRAY ARCHITECTS, INC. 4500 Burrow Drive North Little Rock, AR 72116 Phone: 501-758-7443 Fax: 501-753-7309 www.taggarch.com	Drawing Title DETAILS - HVAC	Project Title JLM MEMORIAL VETERAN'S HOSPITAL - EXPAND MICU			Date NOV 2013	Office of Facilities	DEPARTMENT OF VETERANS AFFAIRS
		Approved: Associate Director				Project No. XXXXX			Project No. XXXXX		
		Approved: Chief Of Staff				Building Number 1-JLM	Checked JM	Modified P&D	DRAWING NO. MH-6R		
						Location CAVHS LITTLE ROCK, AR			Dwg 6 Of 12		