

**DEPARTMENT OF VETERANS AFFAIRS
VHA MASTER SPECIFICATIONS****TABLE OF CONTENTS
Section 00 01 10**

| | DIVISION 00 - SPECIAL SECTIONS | DATE |
|-------------|--|-------------|
| 00 01 15 | List of Drawing Sheets | 09-11 |
| | DIVISION 01 - GENERAL REQUIREMENTS | |
| | | |
| 01 00 00 | General Requirements | 10-12 |
| 01 33 23 | Shop Drawings, Product Data, and Samples | 11-08 |
| 01 42 19 | Reference Standards | 09-11 |
| 01 57 19 | Temporary Environmental Controls | 01-11 |
| 01 91 00 | General Commissioning Requirements | 05-11 |
| | | |
| | DIVISION 02 – EXISTING CONDITIONS | |
| | | |
| 02 41 00 | Demolition | 06-10 |
| 02 82 13.13 | Pipe Insulation – Glovebag Asbestos Abatement | 07-11 |
| 02 82 13.31 | Asbestos Gasket Abatement | 07-11 |
| | | |
| | DIVISION 05 – METALS | |
| | | |
| 05 50 00 | Metal Fabrications | 09-11 |
| | | |
| | DIVISION 07 - THERMAL AND MOISTURE PROTECTION | |
| | | |
| 07 84 00 | Firestopping | 10-11 |
| 07 92 00 | Joint Sealants | 12-11 |
| | | |
| | DIVISION 22 – PLUMBING | |
| | | |
| 22 05 11 | Common Work Results for Plumbing | 04-11 |
| 22 05 12 | General Motor Requirements for Plumbing Equipment | 12-09 |
| 22 05 19 | Meters and Gages for Plumbing Piping | 02-10 |
| 22 05 23 | General-Duty Valves for Plumbing Piping | 12-09 |
| 22 07 11 | Plumbing Insulation | 05-11 |
| 22 08 00 | Commissioning of Plumbing Systems | 07-10 |
| 22 11 00 | Facility Water Distribution | 05-11 |
| 22 11 23 | Domestic Water Pumps | 11-10 |
| | | |
| | DIVISION 23 – HEATING, VENTILATING, AND AIR CONDITIONING (HVAC) | |
| | | |
| 23 05 11 | Common Work Results for HVAC | 11-10 |
| 23 05 12 | General Motor Requirements for HVAC and Steam Generation Equipment | 11-10 |
| 23 05 41 | Noise and Vibration Control for HVAC Piping and Equipment | 11-10 |
| 23 05 93 | Testing, Adjusting, and Balancing for HVAC | 05-11 |

| | | |
|----------|--|-------|
| 23 07 11 | HVAC and Boiler Plant Insulation | 05-11 |
| 23 08 00 | Commissioning of HVAC | 07-10 |
| 23 09 23 | Direct-Digital Control System for HVAC | 09-11 |
| 23 21 13 | Hydronic Piping | 09-12 |
| 23 21 23 | Hydronic Pumps | 02-10 |
| 23 22 13 | Steam and Condensate Heating Piping | 03-10 |
| 23 25 00 | HVAC Water Treatment | 02-10 |
| 23 82 00 | Convection Heating and Cooling Units | 04-11 |
| | | |
| | DIVISION 26 – ELECTRICAL | |
| | | |
| 26 05 11 | Requirements for Electrical Installations | 12-12 |
| 26 05 19 | Low-Voltage Electrical Power Conductors and Cables | 12-12 |
| 26 05 26 | Grounding and Bonding for Electrical Systems | 12-12 |
| 26 05 33 | Raceway and Boxes for Electrical Systems | 09-10 |
| 26 24 16 | Panelboards | 12-12 |
| 26 29 11 | Motor Controllers | 12-12 |
| 26 29 21 | Enclosed Switches and Circuit Breakers | 12-12 |
| 26 43 13 | Surge Protector Device | 12-12 |
| | | |
| | DIVISION 26 – EARTHWORK | |
| | | |
| 31 20 00 | Earthwork | 10-12 |
| | | |

**SECTION 00 01 15
LIST OF DRAWING SHEETS**

The drawings listed below accompanying this specification form a part of the contract.

Drawing No.Title**GENERAL**

| | |
|----|-----------------------|
| C1 | COVER SHEET AND INDEX |
|----|-----------------------|

HEATING, VENTILATING, AIR CONDITIONING

| | |
|--------|--|
| H1 | LEGEND AND GENERAL NOTES |
| H2 | SCHEDULES |
| H3 | DETAILS |
| H4 | DETAILS |
| H5 | 10 TH FLOOR PENTHOUSE PIPING SCHEMATIC, CONTROLS AND AUTOMATION |
| H6 | BASEMENT C-SECTION MECHANICAL ROOM PIPING SCHEMATIC, CONTROLS AND AUTOMATION |
| H7 | SUB-BASEMENT SERVICE ROOM PIPING SCHEMATIC, CONTROLS AND AUTOMATION |
| H8 | BUILDING 15 BASEMENT MECHANICAL ROOM PIPING SCHEMATIC, CONTROLS AND AUTOMATION |
| H9 | CONTROLS AND AUTOMATION |
| S-MD1 | SITE PLAN |
| 1-MD1 | BUILDING 1 CONSTRUCTION AREA KEYPLANS |
| 1-DS1 | SUB-BASEMENT CRAWL SPACE AREA A – DEMOLITION |
| 1-MS1 | SUB-BASEMENT CRAWL SPACE AREA A – NEW WORK |
| 1-DS2 | SUB-BASEMENT CRAWL SPACE AREA B – DEMOLITION |
| 1-MS2 | SUB-BASEMENT CRAWL SPACE AREA B – NEW WORK |
| 1-MDS3 | SUB-BASEMENT CRAWL SPACE AREA C – DEMOLITION AND NEW WORK |
| 1-DS4 | SUB-BASEMENT SERVICE ROOM – DEMOLITION |
| 1-MS4 | SUB-BASEMENT SERVICE ROOM – NEW WORK |
| 1-DB1 | PARTIAL BASEMENT FLOOR PLANS – DEMOLITION |
| 1-DB1A | PARTIAL BASEMENT FLOOR PLANS – DEMOLITION (ALTERNATE) |
| 1-MB1 | PARTIAL BASEMENT FLOOR PLANS – NEW WORK |
| 1-MB1A | PARTIAL BASEMENT FLOOR PLANS – NEW WORK (ALTERNATE) |
| 1-MDB2 | PARTIAL BASEMENT FLOOR PLANS – DEMOLITION AND NEW WORK |
| 1-MDB3 | PARTIAL BASEMENT FLOOR PLAN – DEMOLITION AND NEW WORK |
| 1-D41 | FOURTH FLOOR PENTHOUSE – DEMOLITION |
| 1-M41 | FOURTH FLOOR PENTHOUSE – NEW WORK |
| 1-MD42 | PARTIAL THIRD AND FOURTH FLOOR PLANS – DEMOLITION AND NEW WORK |
| 1-MD51 | FIFTH FLOOR PENTHOUSE – DEMOLITION AND NEW WORK |
| 1-MD61 | PARTIAL SIXTH FLOOR PLANS – DEMOLITION AND NEW WORK |

VA-XX

VA CINCINNATI PROJECT NO. 539-13-107
REPLACE HOSPITAL STEAM HEATING SYSTEMS

| | |
|---------|---|
| 1-MD81 | PARTIAL EIGHTH FLOOR PLANS – DEMOLITION AND NEW WORK |
| 1-M91 | PARTIAL NINTH FLOOR PLAN – NEW WORK |
| 1-MD92 | NINTH FLOOR MECHANICAL ROOM – DEMOLITION AND NEW WORK |
| 1-MD101 | TENTH FLOOR PENTHOUSE – DEMOLITION AND NEW WORK |
| 1-MDR1 | SOUTH (AHU-2) RISER SHAFT FLOOR PLANS – DEMOLITION AND NEW WORK |
| 1-MDR2 | NORTH (AHU-3) RISER SHAFT FLOOR PLANS – DEMOLITION AND NEW WORK |
| 1-MDV1 | PARTIAL FLOOR PLANS – TERMINAL UNIT CONTROL VALVE REPLACEMENTS |
| 1-MDV2 | PARTIAL FLOOR PLANS – TERMINAL UNIT CONTROL VALVE REPLACEMENTS |
| 8-D1 | BUILDINGS 8 & 13 DEMOLITION PLANS |
| 8-M1 | BUILDINGS 8 & 13 NEW WORK PLANS |
| 15-DB1 | BUILDING 15 BASEMENT – DEMOLITION |
| 15-DB1A | BUILDING 15 BASEMENT – DEMOLITION (ALTERNATE) |
| 15-MB1 | BUILDINGS 15 & 14 BASEMENT FLOOR PLANS – NEW WORK |
| 15-MB1A | BUILDINGS 15 & 14 BASEMENT FLOOR PLANS – NEW WORK (ALTERNATE) |

ELECTRICAL

| | |
|--------|-----------------------------|
| E1 | LEGEND AND INDEX |
| E2 | SCHEDULES & DETAIL |
| 1-ES1 | SERVICE ROOM PLAN |
| 1-EB1 | BASEMENT FLOOR PLAN |
| 1-E51 | FIFTH FLOOR PENTHOUSE PLAN |
| 1-E101 | TENTH FLOOR PENTHOUSE PLANS |
| 15-EB1 | BUILDING 15 BASEMENT |

--- END ---

**SECTION 01 00 00
GENERAL REQUIREMENTS****TABLE OF CONTENTS**

| | |
|--|----|
| SECTION 00 01 15 LIST OF DRAWING SHEETS | 1 |
| 1.1 GENERAL INTENTION | 1 |
| 1.2 STATEMENT OF BID ITEM(S) | 2 |
| 1.3 construction security requirements | 3 |
| 1.4 FIRE SAFETY | 4 |
| 1.5 OPERATIONS AND STORAGE AREAS | 6 |
| 1.6 ALTERATIONS | 9 |
| 1.7 INFECTION PREVENTION MEASURES | 10 |
| 1.8 DISPOSAL AND RETENTION | 12 |
| 1.9 PROTECTION OF EXISTING VEGETATION, STRUCTURES, EQUIPMENT, UTILITIES, AND IMPROVEMENTS | 12 |
| 1.10 RESTORATION | 13 |
| 1.11 As-Built Drawings | 14 |
| 1.12 USE OF ROADWAYS | 14 |
| 1.13 TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT | 14 |

| | |
|--|----|
| 1.14 TEMPORARY USE OF EXISTING ELEVATORS | 15 |
| 1.15 TEMPORARY TOILETS | 16 |
| 1.16 AVAILABILITY AND USE OF UTILITY SERVICES..... | 16 |
| 1.17 TESTS | 17 |
| 1.18 INSTRUCTIONS | 17 |
| 1.19 GOVERNMENT-FURNISHED PROPERTY | 18 |
| 1.20 RELOCATED EQUIPMENT/ITEMS..... | 19 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 AVAILABILITY OF SPECIFICATIONS LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS FPMR PART 101-29 (FAR 52.211-1) (AUG 1998) | 1 |
| 1.3 AVAILABILITY FOR EXAMINATION OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM descriptions (FAR 52.211-4) (JUN 1988) | 1 |
| 1.4 AVAILABILITY OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS (FAR 52.211-3) (JUN 1988) | 1 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 QUALITY CONTROL | 1 |

| | |
|---|----|
| 1.3 references | 1 |
| 1.4 SUBMITTALS | 2 |
| 1.5 PROTECTION OF ENVIRONMENTAL RESOURCES | 3 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 Contractual Relationships | 2 |
| 1.3 RELATED WORK | 3 |
| 1.4 SUMMARY | 3 |
| 1.5 DEFINITIONS | 3 |
| 1.6 SYSTEMS TO BE COMMISSIONED | 4 |
| 1.7 COMMISSIONING TEAM | 5 |
| 1.8 VA'S COMMISSIONING RESPONSIBILITIES | 5 |
| 1.9 CONTRACTOR'S COMMISSIONING RESPONSIBILITIES | 6 |
| 1.10 COMMISSIONING AGENT'S RESPONSIBILITIES | 6 |
| 1.11 COMMISSIONING DOCUMENTATION | 8 |
| 1.12 SUBMITTALS | 11 |
| 1.13 COMMISSIONING PROCESS | 12 |

| | |
|---|----|
| 1.14 QUALITY ASSURANCE | 13 |
| 1.15 COORDINATION | 13 |
| part 2 - PRODUCTS | 14 |
| 2.1 TEST EQUIPMENT | 14 |
| part 3 - EXECUTION | 14 |
| 3.1 STARTUP, INITIAL CHECKOUT, AND PRE-FUNCTIONAL CHECKLISTS | 14 |
| 3.2 DEFICIENCIES, NONCONFORMANCE, AND APPROVAL IN CHECKLISTS AND STARTUP | 16 |
| 3.3 PHASED COMMISSIONING | 16 |
| 3.4 TRENDING AND ALARMS | 16 |
| 3.5 SYSTEMS FUNCTIONAL PERFORMANCE TESTING | 32 |
| 3.6 DOCUMENTATION, NONCONFORMANCE AND APPROVAL OF TESTS | 35 |
| 3.7 DEFERRED TESTING | 37 |
| 3.8 OPERATION AND MAINTENANCE TRAINING REQUIREMENTS | 38 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION: | 1 |
| 1.2 RELATED WORK: | 1 |
| 1.3 PROTECTION: | 1 |

| | |
|---|---|
| 1.4 UTILITY SERVICES: | 2 |
| PART 2 - PRODUCTS (Not Used) | 2 |
| PART 3 – EXECUTION | 2 |
| 3.1 DEMOLITION: | 2 |
| 3.2 CLEAN-UP: | 3 |
| PART 1 - GENERAL | 1 |
| 1.1 SUMMARY OF THE WORK | 1 |
| 1.1.1 CONTRACT DOCUMENTS AND RELATED REQUIREMENTS | 1 |
| 1.1.2 EXTENT OF WORK | 1 |
| 1.1.3 RELATED WORK | 1 |
| 1.1.4 TASKS | 2 |
| 1.1.5 ABATEMENT CONTRACTOR USE OF PREMISES | 2 |
| 1.2 VARIATIONS IN QUANTITY | 2 |
| 1.3 STOP ASBESTOS REMOVAL | 2 |
| 1.4 DEFINITIONS | 3 |
| 1.4.1 GENERAL | 3 |
| 1.4.2 GLOSSARY | 3 |

| | |
|---|----|
| 1.4.3 REFERENCED STANDARDS ORGANIZATIONS | 8 |
| 1.5 APPLICABLE CODES AND REGULATIONS | 9 |
| 1.5.1 GENERAL APPLICABILITY OF CODES, REGULATIONS, AND STANDARDS | 9 |
| 1.5.2 Asbestos Abatement CONTRACTOR RESPONSIBILITY | 9 |
| 1.5.3 FEDERAL REQUIREMENTS | 10 |
| 1.5.4 STATE REQUIREMENTS | 10 |
| 1.5.5 LOCAL REQUIREMENTS | 10 |
| 1.5.6 STANDARDS | 10 |
| 1.5.7 EPA GUIDANCE DOCUMENTS | 11 |
| 1.5.8 NOTICES | 11 |
| 1.5.9 PERMITS/LICENSES | 11 |
| 1.5.10 POSTING AND FILING OF REGULATIONS | 11 |
| 1.5.11 VA RESPONSIBILITIES | 11 |
| 1.5.12 EMERGENCY ACTION PLAN AND ARRANGEMENTS | 11 |
| 1.5.14 PRE-Construction MEETING | 12 |
| 1.6 PROJECT COORDINATION | 12 |
| 1.6.1 PERSONNEL | 13 |

| | |
|--|----|
| 1.7 RESPIRATORY PROTECTION | 13 |
| 1.7.1 GENERAL - RESPIRATORY PROTECTION PROGRAM | 13 |
| 1.7.2 RESPIRATORY PROTECTION PROGRAM COORDINATOR | 14 |
| 1.7.3 SELECTION AND USE OF RESPIRATORS | 14 |
| 1.7.4 MINIMUM RESPIRATORY PROTECTION | 14 |
| 1.7.5 MEDICAL WRITTEN OPINION | 14 |
| 1.7.6 RESPIRATOR FIT TEST | 14 |
| 1.7.7 RESPIRATOR FIT CHECK | 14 |
| 1.7.8 MAINTENANCE AND CARE OF RESPIRATORS | 14 |
| 1.8 WORKER PROTECTION | 14 |
| 1.8.1 TRAINING OF ABATEMENT PERSONNEL | 14 |
| 1.8.2 MEDICAL EXAMINATIONS | 15 |
| 1.8.3 personal PROTECTIVE EQUIPMENT | 15 |
| 1.8.4 REGULATED AREA ENTRY PROCEDURE | 15 |
| 1.8.5 DECONTAMINATION PROCEDURE | 15 |
| 1.8.6 REGULATED AREA REQUIREMENTS | 15 |
| 1.9 DECONTAMINATION FACILITIES | 16 |

| | |
|---|----|
| 1.9.1 DESCRIPTION | 16 |
| 1.9.2 GENERAL REQUIREMENTS | 16 |
| 1.9.3 TEMPORARY FACILITIES TO THE PDF and w/EDF | 16 |
| 1.9.4 PERSONNEL DECONTAMINATION FACILITY (PDF)..... | 16 |
| 1.9.5 waste/EQUIPMENT DECONTAMINATION FACILITY (w/EDF) | 17 |
| 1.9.6 waste/EQUIPMENT DECONTAMINATION PROCEDURES..... | 18 |
| PART 2 - PRODUCTS, MATERIALS AND EQUIPMENT | 18 |
| 2.1 MATERIALS AND EQUIPMENT | 18 |
| 2.1.1 GENERAL REQUIREMENTS (all abatement projects) | 18 |
| 2.1.2 NEGATIVE PRESSURE FILTRATION SYSTEM..... | 19 |
| 2.1.3 DESIGN AND LAYOUT | 20 |
| 2.1.4 NEGATIVE AIR MACHINES (HEPA UNITS) | 20 |
| 2.1.5 PRESSURE DIFFERENTIAL | 21 |
| 2.2 CONTAINMENT BARRIERS AND COVERINGS IN THE REGULATED AREA | 21 |
| 2.2.1 GENERAL | 21 |
| 2.2.2 PREPARATION PRIOR TO SEALING THE REGULATED AREA..... | 21 |
| 2.2.3 CONTROLLING ACCESS TO THE REGULATED AREA..... | 21 |

| | | |
|---|----------|----|
| 2.2.4 CRITICAL BARRIERS | 21 | |
| 2.2.5 SECONDARY BARRIERS | 22 | |
| 2.2.6 EXTENSION OF THE REGULATED AREA | 22 | |
| 2.2.7 FIRESTOPPING | 22 | |
| 2.3 MONITORING, INSPECTION AND TESTING | 22 | |
| 2.3.1 GENERAL | 22 | |
| 2.3.2 SCOPE OF SERVICES OF THE VPIH/cih CONSULTANT | 23 | |
| 2.3.3 MONITORING, INSPECTION AND TESTING BY CONTRACTOR | CPIH/CIH | 23 |
| 2.4 Asbestos hazard abatement plan | 24 | |
| 2.5 SUBMITTALS | 24 | |
| 2.5.1 PRE-start MEETING SUBMITTALS | 24 | |
| 2.5.2 SUBMITTALS DURING ABATEMENT | 25 | |
| 2.5.3 SUBMITTALS AT COMPLETION OF ABATEMENT | 26 | |
| 2.6 ENCAPSULANTS | 26 | |
| 2.6.1 TYPES OF ENCAPSULANTS | 26 | |
| 2.6.2 PERFORMANCE REQUIREMENTS | 26 | |
| 2.7 CERTIFICATES OF COMPLIANCE | 27 | |

| | |
|--|----|
| 2.8 RECYCLABLE PROTECTIVE CLOTHING | 27 |
| PART 3 – EXECUTION | 27 |
| 3.1 REGULATED AREA PREPARATIONS | 27 |
| 3.1.1 SITE SECURITY | 27 |
| 3.1.2 OSHA DANGER SIGNS | 27 |
| 3.1.3.1 SHUT DOWN - LOCK OUT ELECTRICAL | 28 |
| 3.1.3.2 SHUT DOWN - LOCK OUT HVAC | 28 |
| 3.1.4 CONTAINMENT BARRIERS AND COVERINGS FOR THE REGULATED AREA | 28 |
| 3.1.4.1 GENERAL | 28 |
| 3.1.4.2 PREPARATION PRIOR TO SEALING OFF | 28 |
| 3.1.4.3 CONTROLLING ACCESS TO THE REGULATED AREA | 28 |
| 3.1.4.4 CRITICAL BARRIERS | 28 |
| 3.1.4.5 EXTENSION OF THE REGULATED AREA | 29 |
| 3.1.4.6 floor barriers | 29 |
| 3.1.5 SANITARY FACILITIES | 29 |
| 3.1.6 Pre-Cleaning | 29 |
| 3.1.6.1 PRE-CLEANING MOVABLE OBJECTS | 29 |

| | |
|---|----|
| 3.1.6.2 PRE-CLEANING FIXED OBJECTS | 29 |
| 3.1.6.3 PRE-CLEANING SURFACES IN THE REGULATED AREA | 29 |
| 3.1.7 PRE-ABATEMENT ACTIVITIES | 30 |
| 3.1.7.1 PRE-ABATEMENT MEETING | 30 |
| 3.1.7.2 PRE-ABATEMENT INSPECTIONS AND PREPARATIONS | 30 |
| 3.1.7.3 PRE-ABATEMENT CONSTRUCTION AND OPERATIONS | 30 |
| 3.2 REMOVAL OF piping ACM | 31 |
| 3.2.1 WETTING MATERIALS | 31 |
| 3.2.2 SECONDARY BARRIER AND WALKWAYS | 31 |
| 3.2.3 WET REMOVAL OF ACM | 31 |
| 3.3 GLOVEBAG REMOVAL PROCEDURES | 31 |
| 3.3.1 GENERAL | 31 |
| 3.3.2 NEGATIVE PRESSURE GLOVEBAG PROCEDURE | 32 |
| 3.4 LOCKDOWN ENCAPSULATION | 32 |
| 3.4.1 GENERAL | 32 |
| 3.4.2 SEALING EXPOSED EDGES | 32 |
| 3.5 DISPOSAL OF ACM WASTE MATERIALS | 33 |

| | |
|--|----|
| 3.5.1 GENERAL | 33 |
| 3.5.2 PROCEDURES | 33 |
| 3.6 PROJECT DECONTAMINATION | 33 |
| 3.6.1 GENERAL | 33 |
| 3.6.2 REGULATED AREA CLEARANCE | 33 |
| 3.6.3 WORK DESCRIPTION | 33 |
| 3.6.4 PRE-DECONTAMINATION CONDITIONS | 34 |
| 3.6.5 FIRST CLEANING | 34 |
| 3.6.6 PRE-CLEARANCE INSPECTION AND TESTING | 34 |
| 3.6.7 LOCKDOWN ENCAPSULATION OF ABATED SURFACES | 34 |
| 3.7 FINAL VISUAL INSPECTIONs AND AIR CLEARANCE TESTING | 34 |
| 3.7.1 GENERAL | 34 |
| 3.7.2 FINAL VISUAL INSPECTION | 34 |
| 3.7.3 FINAL AIR CLEARANCE TESTING | 34 |
| 3.7.4 FINAL AIR CLEARANCE PROCEDURES | 35 |
| 3.7.5 CLEARANCE SAMPLING USING PCM | 35 |
| 3.7.6 CLEARANCE SAMPLING USING TEM | 35 |

| | |
|--|----|
| 3.7.7 LABORATORY TESTING OF PCM SAMPLES | 35 |
| 3.7.8 LABORATORY TESTING OF TEM SAMPLES | 36 |
| 3.8 ABATEMENT CLOSEOUT AND CERTIFICATE OF COMPLIANCE | 36 |
| 3.8.1 COMPLETION OF ABATEMENT WORK | 36 |
| 3.8.2 CERTIFICATE OF COMPLETION BY CONTRACTOR | 36 |
| 3.8.3 WORK SHIFTS | 36 |
| 3.8.4 RE-INSULATION | 36 |
| ATTACHMENT #1 | 37 |
| PART 1 - GENERAL | 1 |
| 1.1 SUMMARY OF THE WORK | 1 |
| 1.1.1 CONTRACT DOCUMENTS AND RELATED REQUIREMENTS | 1 |
| 1.1.2 EXTENT OF WORK | 1 |
| 1.1.3 RELATED WORK | 1 |
| 1.1.4 TASKS | 1 |
| 1.1.5 ABATEMENT CONTRACTOR USE OF PREMISES | 1 |
| 1.2 VARIATIONS IN QUANTITY | 2 |
| 1.3 STOP ASBESTOS REMOVAL | 2 |

| | |
|---|----|
| 1.4 DEFINITIONS | 2 |
| 1.4.1 GENERAL | 2 |
| 1.4.2 GLOSSARY | 3 |
| 1.4.3 REFERENCED STANDARDS ORGANIZATIONS | 7 |
| 1.5 APPLICABLE CODES AND REGULATIONS | 9 |
| 1.5.1 GENERAL APPLICABILITY OF CODES, REGULATIONS, AND STANDARDS | 9 |
| 1.5.2 CONTRACTOR RESPONSIBILITY | 9 |
| 1.5.3 FEDERAL REQUIREMENTS | 9 |
| 1.5.4 STATE REQUIREMENTS | 10 |
| 1.5.5 LOCAL REQUIREMENTS | 10 |
| 1.5.6 STANDARDS | 10 |
| 1.5.7 EPA GUIDANCE DOCUMENTS | 10 |
| 1.5.8 NOTICES | 10 |
| 1.5.9 PERMITS/LICENSES | 10 |
| 1.5.10 POSTING AND FILING OF REGULATIONS | 11 |
| 1.5.11 VA RESPONSIBILITIES | 11 |
| 1.5.13 EMERGENCY ACTION PLAN AND ARRANGEMENTS | 11 |

| | |
|--|----|
| 1.5.14 PRE-construction MEETING | 12 |
| 1.6 PROJECT COORDINATION | 12 |
| 1.6.1 PERSONNEL | 12 |
| 1.7 RESPIRATORY PROTECTION | 13 |
| 1.7.1 GENERAL - RESPIRATORY PROTECTION PROGRAM | 13 |
| 1.7.2 RESPIRATORY PROTECTION PROGRAM COORDINATOR | 13 |
| 1.7.3 SELECTION AND USE OF RESPIRATORS | 13 |
| 1.7.4 MINIMUM RESPIRATORY PROTECTION | 13 |
| 1.7.5 MEDICAL WRITTEN OPINION | 14 |
| 1.7.6 RESPIRATOR FIT TEST | 14 |
| 1.7.7 RESPIRATOR FIT CHECK | 14 |
| 1.7.8 MAINTENANCE AND CARE OF RESPIRATORS | 14 |
| 1.8 WORKER PROTECTION | 14 |
| 1.8.1 TRAINING OF ABATEMENT PERSONNEL | 14 |
| 1.8.2 MEDICAL EXAMINATIONS | 14 |
| 1.8.3 PERSONAL PROTECTIVE EQUIPMENT | 14 |
| 1.8.4 REGULATED AREA ENTRY PROCEDURE | 14 |

| | |
|--|----|
| 1.8.5 DECONTAMINATION PROCEDURE | 15 |
| 1.8.6 REGULATED AREA REQUIREMENTS | 15 |
| PART 2 - PRODUCTS, MATERIALS AND EQUIPMENT | 15 |
| 2.1 MATERIALS AND EQUIPMENT | 15 |
| 2.1.1 GENERAL REQUIREMENTS (all abatement projects) | 15 |
| 2.2 CONTAINMENT BARRIERS AND COVERINGS IN THE REGULATED AREA | 16 |
| 2.2.1 GENERAL | 16 |
| 2.2.3 CONTROLLING ACCESS TO THE REGULATED AREA..... | 17 |
| 2.2.4 CRITICAL BARRIERS | 17 |
| 2.2.5 secondary barriers | 17 |
| 2.2.6 EXTENSION OF THE REGULATED AREA | 17 |
| 2.3 MONITORING, INSPECTION AND TESTING | 17 |
| 2.3.1 GENERAL | 17 |
| 2.3.2 SCOPE OF SERVICES OF THE VPIH/CIH CONSULTANT | 18 |
| 2.3.3 MONITORING, INSPECTION AND TESTING BY CONTRACTOR CPIH/CIH | 19 |
| 2.4 asbestos hazard abatement plan | 19 |

| | |
|--|----|
| 2.5 SUBMITTALS | 20 |
| 2.5.1 PRE-start MEETING SUBMITTALS | 20 |
| 2.5.2 SUBMITTALS DURING ABATEMENT | 21 |
| 2.5.3 SUBMITTALS AT COMPLETION OF ABATEMENT | 21 |
| PART 3 - EXECUTION | 21 |
| 3.1 REGULATED AREA PREPARATIONS | 21 |
| 3.1.1 SITE SECURITY | 21 |
| 3.1.2 OSHA DANGER SIGNS | 22 |
| 3.1.3 SHUT DOWN - LOCK OUT ELECTRICAL | 22 |
| 3.1.4 SHUT DOWN - LOCK OUT HVAC | 22 |
| 3.1.5 LOCAL EXHAUST VENTILATION | 22 |
| 3.1.6 CONTAINMENT BARRIERS AND COVERINGS FOR THE REGULATED AREA | 23 |
| 3.1.6.1 GENERAL | 23 |
| 3.1.6.2 PREPARATION PRIOR TO SEALING OFF | 23 |
| 3.1.6.3 CONTROLLING ACCESS TO THE REGULATED AREA | 23 |
| 3.1.6.4 CRITICAL BARRIERS | 23 |
| 3.1.6.5 EXTENSION OF THE REGULATED AREA | 23 |

| | | |
|---|----|----|
| 3.1.7 PERSONAL PROTECTIVE EQUIPMENT | 23 | |
| 3.1.8 SANITARY FACILITIES | 23 | |
| 3.1.9 Pre-cleaning | 24 | |
| 3.1.9.1 PRE-CLEANING MOVABLE OBJECTS | 24 | |
| 3.1.9.2 PRE-CLEANING FIXED OBJECTS | 24 | |
| 3.1.9.3 PRE-CLEANING SURFACES IN THE REGULATED AREA | 24 | |
| 3.1.10 PRE-ABATEMENT ACTIVITIES | 24 | |
| 3.1.10.1 PRE-ABATEMENT MEETING | 24 | |
| 3.1.10.2 PRE-ABATEMENT INSPECTIONS AND PREPARATIONS | 24 | |
| 3.1.10.3 PRE-ABATEMENT CONSTRUCTION AND OPERATIONS | 25 | |
| 3.2 REMOVAL OF CLASS II Gasket MATERIALS | | 25 |
| GENERAL | 25 | |
| 3.3.1 GENERAL | 26 | |
| 3.4 PROJECT DECONTAMINATION | | 27 |
| 3.4.1 GENERAL | 27 | |
| 3.4.2 REGULATED AREA CLEARANCE | 27 | |
| 3.4.3 WORK DESCRIPTION | 27 | |

| | |
|--|----|
| 3.4.4 PRE-DECONTAMINATION CONDITIONS | 27 |
| 3.4.5. CLEANING | 27 |
| 3.5VISUAL INSPECTION AND AIR CLEARANCE TESTING | 27 |
| 3.5.1 GENERAL | 27 |
| 3.5.2 VISUAL INSPECTION | 28 |
| 3.5.3 AIR CLEARANCE TESTING | 28 |
| 3.5.4 final AIR CLEARANCE PROCEDURES | 28 |
| 3.6 ABATEMENT CLOSEOUT AND CERTIFICATE OF COMPLIANCE | 28 |
| 3.6.1 COMPLETION OF ABATEMENT WORK | 28 |
| 3.6.2 CERTIFICATE OF COMPLETION BY CONTRACTOR | 28 |
| 3.6.3 WORK SHIFTS | 29 |
| ATTACHMENT #1 | 30 |
| ATTACHMENT #3 | 32 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 SUBMITTALS | 1 |

| | |
|---|---|
| 1.4 QUALITY ASSURANCE | 1 |
| 1.5 APPLICABLE PUBLICATIONS | 2 |
| PART 2 - PRODUCTS | 3 |
| 2.1 DESIGN CRITERIA | 3 |
| 2.2 MATERIALS | 3 |
| 2.3 HARDWARE | 4 |
| 2.4 FABRICATION GENERAL | 4 |
| 2.5 SUPPORTS | 7 |
| 2.6 GUARDS | 7 |
| PART 3 - EXECUTION | 8 |
| 3.1 INSTALLATION, GENERAL | 8 |
| 3.2 INSTALLATION OF SUPPORTS | 8 |
| 3.3 GUARDS | 9 |
| 3.4 STEEL COMPONENTS FOR MILLWORK ITEMS | 9 |
| 3.5 CLEAN AND ADJUSTING | 9 |
| PART 1 GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |

| | |
|--|---|
| 1.2 RELATED WORK | 1 |
| 1.3 SUBMITTALS | 1 |
| 1.4 DELIVERY AND STORAGE | 1 |
| 1.5 warranty | 1 |
| 1.6 QUALITY ASSURANCE | 1 |
| 1.7 APPLICABLE PUBLICATIONS | 1 |
| PART 2 - PRODUCTS | 2 |
| 2.1 FIRESTOP SYSTEMS | 2 |
| 2.2 SMOKE STOPPING IN SMOKE PARTITIONS | 2 |
| PART 3 - EXECUTION | 3 |
| 3.1 EXAMINATION | 3 |
| 3.2 PREPARATION | 3 |
| 3.3 INSTALLATION | 3 |
| 3.4 CLEAN-UP AND ACCEPTANCE OF WORK | 3 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION: | 1 |
| 1.2 RELATED WORK: | 1 |

| | |
|--|---|
| 1.3 QUALITY CONTROL: | 1 |
| 1.4 SUBMITTALS: | 2 |
| 1.5 PROJECT CONDITIONS: | 2 |
| 1.6 DELIVERY, HANDLING, AND STORAGE: | 2 |
| 1.7 DEFINITIONS: | 2 |
| 1.8 warranty: | 2 |
| 1.9 APPLICABLE PUBLICATIONS: | 3 |
| PART 2 - PRODUCTS | 3 |
| 2.1 SEALANTS: | 3 |
| 2.2 CAULKING COMPOUND: | 5 |
| 2.3 COLOR: | 5 |
| 2.4 JOINT SEALANT BACKING: | 5 |
| 2.5 FILLER: | 6 |
| 2.6 PRIMER: | 6 |
| 2.7 CLEANERS-NON POURIOUS SURFACES: | 6 |
| PART 3 - EXECUTION | 6 |
| 3.1 INSPECTION: | 6 |

| | |
|--|----|
| 3.2 PREPARATIONS: | 6 |
| 3.3 BACKING INSTALLATION: | 7 |
| 3.4 SEALANT DEPTHS AND GEOMETRY: | 8 |
| 3.5 INSTALLATION: | 8 |
| 3.6 FIELD QUALITY CONTROL: | 9 |
| 3.7 CLEANING: | 9 |
| 3.8 LOCATIONS: | 9 |
| 1.5 DELIVERY, STORAGE AND HANDLING | 4 |
| 2.1 FACTORY-ASSEMBLED PRODUCTS | 5 |
| 2.2 COMPATIBILITY OF RELATED EQUIPMENT | 5 |
| 2.3 SAFETY GUARDS | 6 |
| 2.4 LIFTING ATTACHMENTS | 6 |
| 2.13 ASBESTOS | 12 |
| 3.2 TEMPORARY PIPING AND EQUIPMENT | 14 |
| 3.3 RIGGING | 14 |
| 3.6 Plumbing systems DEMOLITION | 16 |
| 3.7 CLEANING AND PAINTING | 16 |

| | |
|--|----|
| 3.8 IDENTIFICATION SIGNS | 17 |
| 3.11 OPERATION AND MAINTENANCE MANUALS | 18 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION: | 1 |
| 1.2 RELATED WORK: | 1 |
| 1.4 APPLICABLE PUBLICATIONS: | 1 |
| PART 2 - PRODUCTS | 2 |
| 2.1 MOTORS: | 2 |
| PART 3 - EXECUTION | 5 |
| 3.1 INSTALLATION: | 5 |
| 3.2 FIELD TESTS | 5 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 SUBMITTALS | 1 |
| 1.4 APPLICABLE PUBLICATIONS | 1 |
| 1.5 AS-BUILT DOCUMENTATION | 1 |

| | |
|---|---|
| PART 2 – PRODUCTS | 2 |
| 2.1 PRESSURE GAGES FOR WATER USAGE | 2 |
| PART 3 - EXECUTION | 2 |
| 3.1 INSTALLATION | 2 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 SUBMITTALS | 1 |
| 1.4 APPLICABLE PUBLICATIONS | 1 |
| 1.5 DELIVERY, STORAGE, AND HANDLING | 2 |
| PART 2 - PRODUCTS | 2 |
| 2.1 VALVES | 2 |
| 2.2 BACKFLOW PREVENTERS | 3 |
| PART 3 - EXECUTION | 4 |
| 3.1 eXAMINATION | 4 |
| 3.2 VALVE INSTALLATION | 5 |
| 3.3 ADJUSTING | 5 |

| | |
|--|----|
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 2.3 INSULATION FACINGS AND JACKETS | 5 |
| 2.4 pipe covering protection saddles | 6 |
| 2.5 adhesive, Mastic, Cement | 6 |
| 2.6 Mechanical Fasteners | 6 |
| 2.7 Reinforcement and Finishes | 6 |
| 2.8 Firestopping Material | 7 |
| 2.9 flame and smoke | 7 |
| 3.2 INSULATION INSTALLATION | 8 |
| 3.3 commissioning | 10 |
| 3.4 PIPE INSULATION SCHEDULE | 10 |
| part 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 SUMMARY | 1 |
| 1.4 DEFINITIONS | 1 |

| | |
|---|---|
| 1.5 COMMISSIONED SYSTEMS | 1 |
| 1.6 SUBMITTALS | 1 |
| PART 2 - PRODUCTS (Not Used) | 2 |
| PART 3 - EXECUTION | 2 |
| 3.1 PRE-FUNCTIONAL CHECKLISTS | 2 |
| 3.2 CONTRACTORS TESTS | 2 |
| 3.3 SYSTEMS FUNCTIONAL PERFORMANCE TESTING: | 2 |
| 3.4 TRAINING OF VA PERSONNEL | 3 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 SUBMITTALS | 1 |
| 1.4 APPLICABLE PUBLICATIONS | 1 |
| 1.5 QUALITY ASSURANCE | 3 |
| 1.6 SPARE PARTS | 3 |
| PART 2 - PRODUCTS | 3 |
| 2.1 ABOVE GROUND (INTERIOR) WATER PIPING | 3 |

| | |
|---|---|
| 2.2 STRAINERS | 4 |
| 2.3 DIELECTRIC FITTINGS | 4 |
| 2.4 STERILIZATION CHEMICALS | 4 |
| PART 3 - EXECUTION | 4 |
| 3.1 INSTALLATION | 4 |
| 3.2 TESTS | 6 |
| 3.3 STERILIZATION | 6 |
| 3.4 commissioning | 6 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 SUBMITTALS | 1 |
| 1.4 APPLICABLE PUBLICATIONS | 1 |
| PART 2 - PRODUCTS | 2 |
| 2.1 INLINE HOT WATER RECIRCULATING PUMP | 2 |
| PART 3 - EXECUTION | 2 |
| 3.1 startup and testing | 2 |

| | |
|--|---|
| 3.2 commissioning | 2 |
| 3.3 demonstration and training | 3 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 QUALITY ASSURANCE | 1 |
| 1.4 SUBMITTALS | 3 |
| 1.5 APPLICABLE PUBLICATIONS | 4 |
| 1.6 DELIVERY, STORAGE AND HANDLING | 5 |
| 1.7 JOB CONDITIONS – work in existing Building | 6 |
| PART 2 - PRODUCTS | 7 |
| 2.1 FACTORY-ASSEMBLED PRODUCTS | 7 |
| 2.2 COMPATIBILITY OF RELATED EQUIPMENT | 7 |
| 2.3 DRIVE GUARDS | 7 |
| 2.4 LIFTING ATTACHMENTS | 8 |
| 2.5 ELECTRIC MOTORS | 8 |
| 2.6 VARIABLE SPEED MOTOR CONTROLLERS | 8 |

| | |
|--|----|
| 2.7 EQUIPMENT AND MATERIALS IDENTIFICATION | 8 |
| 2.8 FIRESTOPPING | 9 |
| 2.9 GALVANIZED REPAIR COMPOUND | 9 |
| 2.10 hvac PIPE AND EQUIPMENT SUPPORTS AND RESTRAINTS | 9 |
| 2.11 PIPE PENETRATIONS | 11 |
| 2.12 SPECIAL TOOLS AND LUBRICANTS | 12 |
| 2.13 WALL, FLOOR AND CEILING PLATES | 13 |
| 2.14 ASBESTOS | 13 |
| PART 3 - EXECUTION | 13 |
| 3.1 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING | 13 |
| 3.2 TEMPORARY PIPING AND EQUIPMENT | 15 |
| 3.3 RIGGING | 15 |
| 3.4 PIPE AND EQUIPMENT SUPPORTS | 16 |
| 3.5 MECHANICAL DEMOLITION | 17 |
| 3.6 CLEANING AND PAINTING | 17 |
| 3.7 IDENTIFICATION SIGNS | 18 |
| 3.8 MOTOR AND DRIVE ALIGNMENT | 19 |

| | |
|--|----|
| 3.9 LUBRICATION | 19 |
| 3.10 commissioning | 19 |
| 3.11 STARTUP AND TEMPORARY OPERATION | 20 |
| 3.12 OPERATING AND PERFORMANCE TESTS | 20 |
| 3.13 INSTRUCTIONS TO VA PERSONNEL | 20 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION: | 1 |
| 1.2 RELATED WORK: | 1 |
| 1.3 SUBMITTALS: | 1 |
| 1.4 APPLICABLE PUBLICATIONS: | 1 |
| PART 2 - PRODUCTS | 2 |
| 2.1 MOTORS: | 2 |
| PART 3 - EXECUTION | 5 |
| 3.1 INSTALLATION: | 5 |
| 3.2 FIELD TESTS | 5 |
| 3.3 startup and testing | 5 |
| 3.4 commissioning | 5 |

| | |
|---|---|
| 3.5 Demonstration and training | 5 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 QUALITY ASSURANCE | 1 |
| 1.4 SUBMITTALS | 2 |
| 1.5 APPLICABLE PUBLICATIONS | 3 |
| PART 2 - PRODUCTS | 4 |
| 2.1 GENERAL Requirements | 4 |
| 2.2 VIBRATION ISOLATORS | 4 |
| PART 3 - EXECUTION | 5 |
| 3.1 INSTALLATION | 5 |
| 3.2 ADJUSTING | 5 |
| 3.3 commissioning | 5 |
| 3.4 SELECTION GUIDE FOR VIBRATION ISOLATORS | 6 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |

| | |
|--------------------------------------|---|
| 1.2 RELATED WORK | 1 |
| 1.3 QUALITY ASSURANCE | 2 |
| 1.4 SUBMITTALS | 3 |
| 1.5 APPLICABLE PUBLICATIONS | 4 |
| PART 2 - PRODUCTS | 4 |
| 2.1 INSULATION REPAIR MATERIAL | 4 |
| PART 3 - EXECUTION | 4 |
| 3.1 GENERAL | 4 |
| 3.2 design review report | 4 |
| 3.3 systems inspection report | 4 |
| 3.4 system readiness report | 4 |
| 3.5 tab reports | 5 |
| 3.6 TAB PROCEDURES | 5 |
| 3.7 VIBRATION TESTING | 5 |
| 3.8 SOUND TESTING | 6 |
| 3.9 Marking of Settings | 7 |
| 3.10 Phasing | 7 |

| | |
|--|---|
| 3.11 COMmissioning | 7 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 2 |
| 1.3 QUALITY ASSURANCE | 2 |
| 1.4 SUBMITTALS | 4 |
| 1.5 STORAGE AND HANDLING OF MATERIAL | 4 |
| 1.6 APPLICABLE PUBLICATIONS | 4 |
| PART 2 - PRODUCTS | 6 |
| 2.1 MINERAL FIBER or fiber glass | 6 |
| 2.2 CELLULAR GLASS closed-cell | 6 |
| 2.3 INSULATION FACINGS AND JACKETS | 6 |
| 2.5 Removable insulation jackets | 7 |
| 2.6 pipe covering protection saddles | 7 |
| 2.7 adhesive, Mastic, Cement | 8 |
| 2.8 Mechanical Fasteners | 8 |
| 2.9 Reinforcement and Finishes | 8 |

| | |
|-------------------------------------|----|
| 2.10 Firestopping Material | 8 |
| 2.11 flame and smoke | 8 |
| PART 3 - EXECUTION | 9 |
| 3.1 GENERAL REQUIREMENTS | 9 |
| 3.2 INSULATION INSTALLATION | 10 |
| 3.3 commissioning | 12 |
| 3.4 PIPE INSULATION SCHEDULE | 12 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 SUMMARY | 1 |
| 1.4 DEFINITIONS | 1 |
| 1.5 COMMISSIONED SYSTEMS | 1 |
| 1.6 SUBMITTALS | 2 |
| PART 2 - PRODUCTS (Not Used) | 2 |
| PART 3 - EXECUTION | 2 |
| 3.1 PRE-FUNCTIONAL CHECKLISTS | 2 |

| | |
|--|----|
| 3.2 CONTRACTORS TESTS | 2 |
| 3.3 SYSTEMS FUNCTIONAL PERFORMANCE TESTING: | 3 |
| 3.4 TRAINING OF VA PERSONNEL | 3 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 4 |
| 1.3 definitionS | 4 |
| 1.4 quality assurance | 8 |
| 1.5 performance | 9 |
| 1.6 Warranty | 11 |
| 1.7 SUBMITTALS | 11 |
| 1.8 INSTRUCTIONS | 13 |
| 1.9 project CONDITIONS (Environmental Conditions of Operation) | 13 |
| 1.10 applicable publications | 14 |
| PART 2 - PRODUCTS | 15 |
| 2.1 MATERIALS | 15 |
| 2.2 Controls System Architecture | 15 |

| | |
|---|----|
| 2.3 COMMUNICATION | 16 |
| 2.4 Engineering Control Center (ECC) | 17 |
| 2.5 PORTABLE OPERATOR'S TERMINAL (pot) | 17 |
| 2.6 BACnet protocol analyzer | 18 |
| 2.7 NETWORK AND DEVICE NAMING CONVENTION | 18 |
| 2.8 BACnet DEVICES | 19 |
| 2.9 CONTROLLERS | 19 |
| 2.10 sensors (air, water and steam) | 22 |
| 2.11 Control cables | 24 |
| 2.12 THERMOSTATS AND HUMIDISTATS | 25 |
| 2.13 FINAL CONTROL ELEMENTS AND OPERATORS | 25 |
| PART 3 - EXECUTION | 26 |
| 3.1 INSTALLATION | 26 |
| 3.2 SYSTEM VALIDATION AND DEMONSTRATION | 29 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |

| | |
|---|----|
| 1.3 QUALITY ASSURANCE | 1 |
| 1.4 SUBMITTALS | 1 |
| 1.5 APPLICABLE PUBLICATIONS | 2 |
| 1.6 Spare parts | 5 |
| PART 2 - PRODUCTS | 5 |
| 2.1 PIPE AND EQUIPMENT SUPPORTS, PIPE SLEEVES, AND WALL AND CEILING PLATES | 5 |
| 2.2 PIPE AND TUBING | 5 |
| 2.3 FITTINGS FOR STEEL PIPE | 5 |
| 2.4 FITTINGS FOR COPPER TUBING | 6 |
| 2.5 DIELECTRIC FITTINGS | 6 |
| 2.6 SCREWED JOINTS | 6 |
| 2.7 VALVES | 6 |
| 2.8 STRAINERS | 9 |
| 2.9 FLEXIBLE CONNECTORS FOR WATER SERVICE | 9 |
| 2.10 HYDRONIC SYSTEM COMPONENTS | 9 |
| 2.11 WATER FILTERS AND POT CHEMICAL FEEDERS | 9 |
| 2.12 GAGES, PRESSURE AND COMPOUND | 10 |

| | |
|--|----|
| 2.13 PRESSURE/TEMPERATURE TEST PROVISIONS | 10 |
| 2.14 THERMOMETERS | 10 |
| 2.15 FIRESTOPPING MATERIAL | 10 |
| PART 3 - EXECUTION | 10 |
| 3.1 GENERAL | 10 |
| 3.2 PIPE JOINTS | 12 |
| 3.3 LEAK TESTING ABOVEGROUND PIPING | 12 |
| 3.4 FLUSHING AND CLEANING PIPING SYSTEMS | 12 |
| 3.5 WATER TREATMENT | 13 |
| 3.6 OPERATING AND PERFORMANCE TEST AND INSTRUCTION | 13 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 QUALITY ASSURANCE | 1 |
| 1.4 SUBMITTALS | 2 |
| 1.5 APPLICABLE PUBLICATIONS | 2 |
| 1.6 Definitions | 2 |

| | |
|---|---|
| 1.7 SPARE MATERIALS | 3 |
| PART 2 - PRODUCTS | 3 |
| 2.1 CENTRIFUGAL PUMPS, BRONZE FITTED | 3 |
| PART 3 – EXECUTION | 4 |
| 3.1 INSTALLATION | 4 |
| 3.2 START-UP | 4 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 QUALITY ASSURANCE | 1 |
| 1.4 SUBMITTALS | 1 |
| 1.5 APPLICABLE PUBLICATIONS | 2 |
| PART 2 - PRODUCTS | 3 |
| 2.1 PIPE AND EQUIPMENT SUPPORTS, PIPE SLEEVES, AND WALL AND CEILING PLATES | 3 |
| 2.2 PIPE AND TUBING | 3 |
| 2.3 FITTINGS FOR STEEL PIPE | 4 |
| 2.4 FITTINGS FOR COPPER TUBING | 4 |

| | |
|--|----|
| 2.5 DIELECTRIC FITTINGS | 4 |
| 2.6 VALVES | 5 |
| 2.7 STRAINERS | 6 |
| 2.8 STEAM SYSTEM COMPONENTS | 7 |
| 2.9 GAGES, PRESSURE AND COMPOUND | 11 |
| 2.10 PRESSURE/TEMPERATURE TEST PROVISIONS | 11 |
| 2.11 FIRESTOPPING MATERIAL | 11 |
| PART 3 - EXECUTION | 11 |
| 3.1 GENERAL | 11 |
| L.Provide a 25 mm (1 inch) bypass pipe with globe valve for warm-up on all butterfly valves, gate valves | |
| 3.2 PIPE JOINTS | 13 |
| 3.3 STEAM TRAP PIPING | 13 |
| 3.4 LEAK TESTING | 13 |
| 3.5 FLUSHING AND CLEANING PIPING SYSTEMS | 13 |
| 3.6 OPERATING AND PERFORMANCE TEST AND INSTRUCTION | 13 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |

| | |
|---|---|
| 1.2 RELATED WORK | 1 |
| 1.3 QUALITY ASSURANCE | 1 |
| 1.4 SUBMITTALS | 1 |
| 1.5 APPLICABLE PUBLICATIONS | 2 |
| PART 2 - PRODUCTS | 2 |
| 2.1 CLEANING COMPOUNDS | 2 |
| 2.2 CHEMICAL TREATMENT FOR CLOSED LOOP SYSTEMS..... | 2 |
| 2.3 EQUIPMENT AND MATERIALS IDENTIFICATION | 3 |
| PART 3 - EXECUTION | 3 |
| 3.1 INSTALLATION | 3 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 QUALITY ASSURANCE | 1 |
| 1.4 SUBMITTALS | 1 |
| 1.5 APPLICABLE PUBLICATIONS | 1 |
| 1.6 GUARANTY | 2 |

| | |
|--|---|
| PART 2 - PRODUCTS | 2 |
| 2.1 UNIT HEATERS | 2 |
| PART 3 - EXECUTION | 2 |
| 3.1 INSTALLATION | 2 |
| 3.2 OPERATIONAL TEST | 2 |
| 3.3 STARTup and testing | 2 |
| 3.4 COMmissioning | 3 |
| 3.5 demonstration and training | 3 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 MINIMUM REQUIREMENTS | 1 |
| 1.3 TEST STANDARDS | 1 |
| 1.4 QUALIFICATIONS (PRODUCTS AND SERVICES) | 2 |
| 1.5 APPLICABLE PUBLICATIONS | 2 |
| 1.6 MANUFACTURED PRODUCTS | 2 |
| 1.7 variations from contract requirements | 3 |
| 1.8 MATERIALS AND EQUIPMENT PROTECTION | 3 |

| | |
|---|---|
| 1.9 WORK PERFORMANCE | 3 |
| 1.10 EQUIPMENT INSTALLATION AND REQUIREMENTS..... | 4 |
| 1.11 EQUIPMENT IDENTIFICATION | 4 |
| 1.12 SUBMITTALS | 5 |
| 1.13 SINGULAR NUMBER..... | 6 |
| 1.14 Acceptance Checks and Tests | 6 |
| 1.15 WARRANTY | 6 |
| 1.16 instruction | 7 |
| 1.17 DRAWINGS AND SPECIFICATIONS | 7 |
| 1.18 Record Drawings | 8 |
| 1.19 Final Inspection and Punch List..... | 8 |
| PART 2 - PRODUCTS (Not used)..... | 9 |
| PART 3 - EXECUTION (Not used) | 9 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 quality ASSURANCE | 1 |

| | |
|---|---|
| 1.4 FACTORY TESTS | 1 |
| 1.5 SUBMITTALS | 1 |
| 1.6 APPLICABLE PUBLICATIONS | 2 |
| PART 2 - PRODUCTS | 2 |
| 2.1 conductors and CABLES | 2 |
| 2.2 SPLICES | 3 |
| 2.3 CONNECTORS and terminations | 3 |
| 2.4 CONTROL WIRING | 4 |
| 2.5 WIRE LUBRICATING COMPOUND | 4 |
| PART 3 - EXECUTION | 4 |
| 3.1 GENERAL | 4 |
| 3.2 SPLICE and termination INSTALLATION | 5 |
| 3.3 conductor identification | 5 |
| 3.4 FEEDER conductor IDENTIFICATION | 5 |
| 3.5 existing conductors | 5 |
| 3.6 CONTROL WIRING INSTALLATION | 5 |
| 3.7 CONTROL wiring IDENTIFICATION | 5 |

| | |
|--|---|
| 3.8 Acceptance Checks and Tests | 5 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 quality ASSURANCE | 1 |
| 1.4 SUBMITTALS | 1 |
| 1.5 APPLICABLE PUBLICATIONS | 2 |
| PART 2 - PRODUCTS | 2 |
| 2.1 GROUNDING AND BONDING CONDUCTORS | 2 |
| PART 3 - EXECUTION | 2 |
| 3.1 GENERAL | 2 |
| 3.2 raceway | 3 |
| 3.3 corrosion inhibitors | 3 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 quality ASSURANCE | 1 |

| | |
|--|---|
| 1.4 SUBMITTALS | 1 |
| 1.5 APPLICABLE PUBLICATIONS | 2 |
| PART 2 - PRODUCTS | 2 |
| 2.1 MATERIAL | 2 |
| PART 3 - EXECUTION | 4 |
| 3.1 PENETRATIONS | 4 |
| 3.2 INSTALLATION, GENERAL | 5 |
| 3.3 CONCEALED WORK INSTALLATION | 6 |
| 3.4 EXPOSED WORK INSTALLATION | 6 |
| 3.5 MOTORS AND VIBRATING EQUIPMENT | 6 |
| 3.6 EXPANSION JOINTS | 6 |
| 3.7 CONDUIT SUPPORTS, INSTALLATION | 7 |
| 3.8 BOX INSTALLATION | 7 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 quality ASSURANCE | 1 |

| | |
|--|---|
| 1.4 SUBMITTALS | 1 |
| 1.5 APPLICABLE PUBLICATIONS | 2 |
| PART 2 - PRODUCTS | 2 |
| 2.1 general requirements | 2 |
| 2.2 enclosures and trims | 3 |
| 2.3 MOLDED CASE CIRCUIT BREAKERS | 3 |
| 2.4 Surge PROTECTIVE DEVICES | 4 |
| PART 3 - EXECUTION | 4 |
| 3.1 INSTALLATION | 4 |
| 3.2 Acceptance Checks and Tests | 4 |
| 3.3 Follow-Up Verification | 5 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 quality ASSURANCE | 1 |
| 1.4 SUBMITTALS | 1 |
| 1.5 APPLICABLE PUBLICATIONS | 2 |

| | |
|---|---|
| PART 2 - PRODUCTS | 3 |
| 2.1 MOTOR CONTROLLERS | 3 |
| 2.2 MAGNETIC MOTOR CONTROLLERS | 4 |
| 2.3 low-voltage VARIABLE FREQUENCY DRIVES (VFD) | 4 |
| PART 3 - EXECUTION | 7 |
| 3.1 INSTALLATION | 7 |
| 3.2 Acceptance Checks and Tests | 7 |
| 3.3 FOLLOW-UP VERIFICATION | 8 |
| 3.4 SPARE PARTS | 8 |
| 3.5 INSTRUCTION | 8 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 quality ASSURANCE | 1 |
| 1.4 SUBMITTALS | 1 |
| 1.5 APPLICABLE PUBLICATIONS | 2 |
| PART 2 - PRODUCTS | 2 |

| | |
|--|---|
| 2.1 FUSED SWITCHES RATED 600 AMPERES AND LESS | 2 |
| 2.2 UNFUSED SWITCHES RATED 600 AMPERES AND LESS..... | 3 |
| PART 3 - EXECUTION | 3 |
| 3.1 INSTALLATION | 3 |
| 3.2 Acceptance Checks and Tests | 3 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 QUALITY ASSURANCE | 1 |
| 1.4 SUBMITTALS | 1 |
| 1.5 APPLICABLE PUBLICATIONS | 1 |
| PART 2 - PRODUCTS | 2 |
| 2.1 PANELBOARD TVSS | 2 |
| 2.3 ENCLOSURES | 2 |
| PART 3 - EXECUTION | 2 |
| 3.1 INSTALLATION | 2 |
| 3.2 Acceptance Checks and Tests | 3 |

| | |
|---|---|
| 3.3 Follow-Up Verification | 3 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION OF WORK: | 1 |
| 1.2 DEFINITIONS: | 1 |
| 1.3 RELATED WORK: | 2 |
| 1.4 CLASSIFICATION OF EXCAVATION: | 2 |
| 1.5 APPLICABLE PUBLICATIONS: | 3 |
| PART 2 - PRODUCTS | 4 |
| 2.1 MATERIALS: | 4 |
| PART 3 - EXECUTION | 5 |
| 3.1 SITE PREPARATION: | 5 |
| 3.2 EXCAVATION: | 5 |
| 3.3 FILLING AND BACKFILLING: | 7 |
| 3.4 Disposal of unsuitable and excess excavated material: | 8 |
| 3.5 CLEAN UP: | 8 |

**SECTION 01 00 00
GENERAL REQUIREMENTS****1.1 GENERAL INTENTION**

- A. Contractor shall completely prepare site for building operations, including demolition and removal of existing structures, and furnish labor and materials and perform work for "Replace Hospital Steam Heating Systems" as required by drawings and specifications.
- B. Medical Center Engineering Officer will schedule a pre-bid site walk-through for all contractors wishing to see the site. No other access will be permitted.
- C. Offices of Heapy Engineering, as Architect-Engineers, will render certain technical services during construction. Such services shall be considered as advisory to the Government and shall not be construed as expressing or implying a contractual act of the Government without affirmations by Contracting Officer or his duly authorized representative.
- D. Before placement and installation of work subject to tests by testing laboratory retained by Department of Veterans Affairs, the Contractor shall notify the COTR in sufficient time to enable testing laboratory personnel to be present at the site in time for proper taking and testing of specimens and field inspection. Such prior notice shall be not less than three work days unless otherwise designated by the COTR.
- E. All employees of general contractor and subcontractors shall comply with VA security management program and obtain permission of the VA police, be identified by project and employer, and restricted from unauthorized access.
- F. Prior to commencing work, general contractor shall provide proof that a OSHA certified "competent person" (CP) (29 CFR 1926.20(b)(2)) will maintain a presence at the work site whenever the general or subcontractors are present.
- G. Training:
 - 1. All employees of general contractor or subcontractors shall have the 10-hour OSHA certified Construction Safety course and /or other relevant competency training, as determined by VA CP with input from the ICRA team.
 - 2. Submit training records of all such employees for approval before the start of work.
- H. VHA Directive 2011-36, Safety and Health during Construction, dated 9/22/2011 in its entirety is made a part of this section.
- I. VA will evaluate and consider past safety records of prospective contractors in awarding contracts. At a minimum, Contractors must not have more than three serious, or one repeat, or one willful OSHA violation(s) in the past 3 years, or any significant environmental penalties. Additionally, Contractors must have an Experience Modification Rate (EMR) of equal to or less than 1.0 (EMR of 1.0 indicates that a Contractor had an average insurance claim's rate for worker injuries).

1.2 STATEMENT OF BID ITEM(S)

- A. BID ITEM #1: BASE BID ALL WORK: work shall include all labor, material, equipment and supervision required to complete project "Replace Hospital Steam Heating Systems" at the Department of Veterans Affairs Medical Center, 3200 Vine Street, Cincinnati, Ohio 45220. Work includes general construction, alterations, mechanical and electrical work, utility systems, demolition and certain other items shown and specified. All phases of work shall be complete within 540 calendar days after receipt of Notice to Proceed.
- B. BID ITEM #2: DEDUCT ALTERNATE NO. 1: All work in BID ITEM #1, BASE BID except DELETE all labor and materials associated with the construction, alterations, mechanical and electrical work associated with all work in the 4th floor penthouse (Sheets 1-D41 and 1-M41), all work in the 9th floor mechanical room (Sheet 1-MD92), color coded PVC jacketing over existing pipe insulation in the sub-basement tank room, and all work in Building 8 & 13 with the exception of new moisture separator and new safety relief valve (Sheets 8-D1 and 8-M1). All phases of work shall be complete within 540 calendar days after receipt of Notice to Proceed.
- C. BID ITEM #3: DEDUCT ALTERNATE NO. 2: All work in BID ITEM #1, BASE BID except DELETE all work as specified in DEDUCT ALTERNATE #1 and DELETE all labor and materials associated with the construction, alterations, mechanical and electrical work associated with all work in the "A" side of the sub-basement crawl space with the exception of extension of new steam & condensate piping to the kitchen and replacement of south riser shaft steam & condensate piping (Sheets 1-DS1 & 1-MS1), and all labor and materials associated with the construction, alterations, mechanical and electrical work associated with all work in the "B" side of the sub-basement crawl space with the exception of extension of new steam & condensate piping and new domestic hot water supply & return piping to Building 15, and replacement of existing drip trap assembly on AHU-1 steam pipes (Sheets 1-DS2 & 1-MS2). All phases of work shall be complete within 540 calendar days after receipt of Notice to Proceed.
- D. BID ITEM #4: DEDUCT ALTERNATE NO. 3: All work in BID ITEM #1, BASE BID except DELETE all work as specified in DEDUCT ALTERNATE #1 and DELETE all work as specified in DEDUCT ALTERNATE #2 and DELETE all labor and materials associated with the construction, alterations, mechanical and electrical work associated with existing site manholes (partial Sheet S-MD1), all work in "High Crawl Space" (partial Sheet 1-MDB3), automatic pump traps for AHU-26 & 27 (partial Sheets 1-DB1 & 1-MB1), all work in 5th floor penthouse and associated scope on 4th floor below, except as noted (full/partial Sheets H9, 1-MD51, 1-MD42, 1-E51), all work in Building 15 except new domestic hot water piping mains and new high pressure steam & pumped condensate pipe mains (full/partial Sheets H8, 15-DB1, 15-MB1, 15-EB1), and replacement of existing 2-way air terminal unit control valves with 3-way control valves (Sheets 1-MDV1 & 1-MDV2). All phases of work shall be complete within 540 calendar days after receipt of Notice to Proceed.

1.3 CONSTRUCTION SECURITY REQUIREMENTS**A. Security Plan:**

1. The security plan defines both physical and administrative security procedures that will remain effective for the entire duration of the project.
2. The General Contractor is responsible for assuring that all sub-contractors working on the project and their employees also comply with these regulations.
3. Contractor is responsible for all safety signage.

B. Security Procedures:

1. General Contractor's employees shall not enter the project site without appropriate identification badge, issued by the VA at the campus police station. VA Form 0711 shall be completed for each construction worker, with associated background check performed, prior to this badge being issued. Contractor employees may also be subject to inspection of their personal effects when entering or leaving the project site.
2. For working outside the "regular hours" as defined in the contract, The General Contractor shall give 3 days notice to the Contracting Officer so that security arrangements can be provided for the employees. This notice is separate from any notices required for utility shutdown described later in this section.
3. No photography of VA premises is allowed without written permission of the Contracting Officer.
4. VA reserves the right to close down or shut down the project site and order General Contractor's employees off the premises in the event of a national emergency. The General Contractor may return to the site only with the written approval of the Contracting Officer.

C. Key Control:

1. Contractor is responsible for securing their construction site. For interior projects, this means a full height barricade to the deck, where required and appropriate.
2. The General Contractor shall provide duplicate keys and lock combinations to the COTR for the purpose of security inspections of every area of project including tool boxes and parked machines and take any emergency action.

D. Document Control:

1. Before starting any work, the General Contractor/Sub Contractors shall submit an electronic security memorandum describing the approach to following goals and maintaining confidentiality of "sensitive information".
2. The General Contractor is responsible for safekeeping of all drawings, project manual and other project information. This information shall be shared only with those with a specific need to accomplish the project.
3. Certain documents, sketches, videos or photographs and drawings may be marked "Law Enforcement Sensitive" or "Sensitive Unclassified". Secure such information in separate

- containers and limit the access to only those who will need it for the project. Return the information to the Contracting Officer upon request.
4. These security documents shall not be removed or transmitted from the project site without the written approval of Contracting Officer.
 5. All paper waste or electronic media such as CD's and diskettes shall be shredded and destroyed in a manner acceptable to the VA.
 6. Notify Contracting Officer and Site Security Officer immediately when there is a loss or compromise of "sensitive information".
 7. All electronic information shall be stored in specified location following VA standards and procedures using an Engineering Document Management Software (EDMS).
 - a. Security, access and maintenance of all project drawings, both scanned and electronic shall be performed and tracked through the EDMS system.
 - b. "Sensitive information" including drawings and other documents may be attached to e-mail provided all VA encryption procedures are followed.
- E. Motor Vehicle Restrictions
1. Vehicle authorization request shall be required for any vehicle entering the site and such request shall be submitted 24 hours before the date and time of access. Access shall be restricted to picking up and dropping off materials and supplies.
 2. There will be no parking allowed by any Contractors on Cincinnati VA campus.

1.4 FIRE SAFETY

- A. Applicable Publications: Publications listed below form part of this Article to extent referenced. Publications are referenced in text by basic designations only.
1. American Society for Testing and Materials (ASTM):
 - E84-2009Surface Burning Characteristics of Building Materials
 2. National Fire Protection Association (NFPA):
 - 10-2010.....Standard for Portable Fire Extinguishers
 - 30-2008.....Flammable and Combustible Liquids Code
 - 51B-2009Standard for Fire Prevention During Welding, Cutting and Other Hot Work
 - 70-2011.....National Electrical Code
 - 241-2009.....Standard for Safeguarding Construction, Alteration, and Demolition Operations
 3. Occupational Safety and Health Administration (OSHA):
 - 29 CFR 1926Safety and Health Regulations for Construction
- B. Fire Safety Plan: Establish and maintain a fire protection program in accordance with 29 CFR 1926. Prior to start of work, prepare a plan detailing project-specific fire safety measures, including periodic status reports, and submit to COTR and Facility Safety Officer for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS,

PRODUCT DATA AND SAMPLES Prior to any worker for the contractor or subcontractors beginning work, they shall undergo a safety briefing provided by the general contractor's competent person per OSHA requirements. This briefing shall include information on the construction limits, VAMC safety guidelines, means of egress, break areas, work hours, locations of restrooms, use of VAMC equipment, etc. Documentation shall be provided to the COTR that individuals have undergone contractor's safety briefing.

- C. Site and Building Access: Maintain free and unobstructed access to facility emergency services and for fire, police and other emergency response forces in accordance with NFPA 241.
- D. Separate temporary facilities, such as trailers, storage sheds, and dumpsters, from existing buildings and new construction by distances in accordance with NFPA 241. For small facilities with less than 6 m (20 feet) exposing overall length, separate by 3m (10 feet).
- E. Temporary Construction Partitions:
 - 1. Install and maintain temporary construction partitions to provide smoke-tight separations between construction areas and adjoining areas. Construct partitions of gypsum board or treated plywood (flame spread rating of 25 or less in accordance with ASTM E84) on both sides of fire retardant treated wood or metal steel studs. Extend the partitions through suspended ceilings to floor slab deck or roof. Seal joints and penetrations. At door openings, install Class C, ¾ hour fire/smoke rated doors with self-closing devices.
 - 2. Install one-hour fire-rated temporary construction partitions as shown on drawings to maintain integrity of existing exit stair enclosures, exit passageways, fire-rated enclosures of hazardous areas, horizontal exits, smoke barriers, vertical shafts and openings enclosures.
 - 3. Close openings in smoke barriers and fire-rated construction to maintain fire ratings. Seal penetrations with listed through-penetration firestop materials in accordance with Section 07 84 00, FIRESTOPPING.
- F. Temporary Heating and Electrical: Install, use and maintain installations in accordance with 29 CFR 1926, NFPA 241 and NFPA 70.
- G. Means of Egress: Do not block exiting for occupied buildings, including paths from exits to roads. Minimize disruptions and coordinate with COTR and facility Safety Officer.
- H. Egress Routes for Construction Workers: Maintain free and unobstructed egress. Inspect daily. Report findings and corrective actions weekly to COTR and facility Safety Officer.
- I. Fire Extinguishers: Provide and maintain extinguishers in construction areas and temporary storage areas in accordance with 29 CFR 1926, NFPA 241 and NFPA 10.
- J. Flammable and Combustible Liquids: Store, dispense and use liquids in accordance with 29 CFR 1926, NFPA 241 and NFPA 30.
- K. Existing Fire Protection: Do not impair automatic sprinklers, smoke and heat detection, and fire alarm systems, except for portions immediately under construction, and temporarily for connections. Provide fire watch for impairments more than 4 hours in a 24-hour period. Request interruptions in accordance with Article, OPERATIONS AND STORAGE AREAS, and coordinate

with COTR and facility Safety Officer. All existing or temporary fire protection systems (fire alarms, sprinklers) located in construction areas shall be tested as coordinated with the medical center. Parameters for the testing and results of any tests performed shall be recorded by the medical center and copies provided to the COTR.

- L. Smoke Detectors: Prevent accidental operation. Remove temporary covers at end of work operations each day. Coordinate with COTR and facility Safety Officer .
- M. Hot Work: Perform and safeguard hot work operations in accordance with NFPA 241 and NFPA 51B. Coordinate with COTR. Obtain permits from facility Safety Officer at least 72 hours in advance. Designate contractor's responsible project-site fire prevention program manager to permit hot work.
- N. Fire Hazard Prevention and Safety Inspections: Inspect entire construction areas weekly. Coordinate with, and report findings and corrective actions weekly to COTR and facility Safety Officer.
- O. Smoking: Smoking is prohibited on the VA campus except in designated smoking rest areas.
- P. Dispose of waste and debris in accordance with NFPA 241. Remove from buildings daily.
- Q. Perform other construction, alteration and demolition operations in accordance with 29 CFR 1926.
- R. If required, submit documentation to the COTR that personnel have been trained in the fire safety aspects of working in areas with impaired structural or compartmentalization features.

1.5 OPERATIONS AND STORAGE AREAS

- A. The Contractor shall confine all operations (including storage of materials) on Government premises to areas authorized or approved by the Contracting Officer. The Contractor shall hold and save the Government, its officers and agents, free and harmless from liability of any nature occasioned by the Contractor's performance.
- B. Temporary buildings (e.g., storage sheds, shops, offices) and utilities may be erected by the Contractor only with the approval of the Contracting Officer and shall be built with labor and materials furnished by the Contractor without expense to the Government. The temporary buildings and utilities shall remain the property of the Contractor and shall be removed by the Contractor at its expense upon completion of the work. With the written consent of the Contracting Officer, the buildings and utilities may be abandoned and need not be removed.
- C. The Contractor shall, under regulations prescribed by the Contracting Officer, use only established roadways, or use temporary roadways constructed by the Contractor when and as authorized by the Contracting Officer. When materials are transported in prosecuting the work, vehicles shall not be loaded beyond the loading capacity recommended by the manufacturer of the vehicle or prescribed by any Federal, State, or local law or regulation. When it is necessary to cross curbs or sidewalks, the Contractor shall protect them from damage. The Contractor shall repair or pay for the repair of any damaged curbs, sidewalks, or roads.

(FAR 52.236-10)

- D. Working space and space available for storing materials shall be as determined by the COTR.

- E. Workmen are subject to rules of Medical Center applicable to their conduct.
- F. Execute work so as to interfere as little as possible with normal functioning of Medical Center as a whole, including operations of utility services, fire protection systems and any existing equipment, and with work being done by others. Use of equipment and tools that transmit vibrations and noises through the building structure, are not permitted in buildings that are occupied, during construction, jointly by patients or medical personnel, and Contractor's personnel, except as permitted by COTR where required by limited working space.
 - 1. Do not store materials and equipment in other than assigned areas.
 - 2. Schedule delivery of materials and equipment to immediate construction working areas within buildings in use by Department of Veterans Affairs in quantities sufficient for not more than two work days. Provide unobstructed access to Medical Center areas required to remain in operation.
 - 3. Where access by Medical Center personnel to vacated portions of buildings is not required, storage of Contractor's materials and equipment will be permitted subject to fire and safety requirements.
- G. Phasing: To insure such executions, Contractor shall furnish the COTR with a schedule of approximate phasing dates on which the Contractor intends to accomplish work in each specific area of site, building or portion thereof. In addition, Contractor shall notify the COTR 21 calendar days in advance of the proposed date of starting work in each specific area of site, building or portion thereof. Arrange such dates to insure accomplishment of this work in successive phases mutually agreeable to Medical Center Director, and COTR: see drawings.

Contractor shall take all measures and provide all material necessary for protecting existing equipment and property in affected areas of construction against dust and debris, so that equipment and affected areas to be used in the Medical Centers operations will not be hindered. Contractor shall permit access to Department of Veterans Affairs personnel and patients through other construction areas which serve as routes of access to such affected areas and equipment. Coordinate alteration work in areas occupied by Department of Veterans Affairs so that Medical Center operations will continue during the construction period.
- H. When a building is turned over to Contractor, Contractor shall accept entire responsibility therefore.
 - 1. Contractor shall maintain a minimum temperature of 4 degrees C (40 degrees F) at all times, except as otherwise specified.
 - 2. Contractor shall maintain in operating condition existing fire protection and alarm equipment. In connection with fire alarm equipment, Contractor shall make arrangements for pre-inspection of site with Fire Department or Company (Department of Veterans Affairs or municipal) whichever will be required to respond to an alarm from Contractor's employee or watchman.

- I. Utilities Services: Maintain existing utility services for Medical Center at all times. Provide temporary facilities, labor, materials, equipment, connections, and utilities to assure uninterrupted services. Where necessary to cut existing water, steam, gases, sewer or air pipes, or conduits, wires, cables, etc. of utility services or of fire protection systems and communications systems (including telephone), they shall be cut and capped at suitable places where shown; or, in absence of such indication, where directed by COTR.
 1. No utility service such as water, gas, steam, sewers or electricity, or fire protection systems and communications systems may be interrupted without prior approval of COTR. Electrical work shall be accomplished with all affected circuits or equipment de-energized. When an electrical outage cannot be accomplished, work on any energized circuits or equipment shall not commence without the Medical Center Director's prior knowledge and written approval. Refer to specification Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS for additional requirements.
 2. Contractor shall submit a request to interrupt any such services to COTR, in writing, 21 calendar days in advance of proposed interruption. Request shall state reason, date, exact time of, and approximate duration of such interruption.
 3. Contractor will be advised (in writing) of approval of request, or of which other date and/or time such interruption will cause least inconvenience to operations of Medical Center. Interruption time approved by Medical Center may occur at other than Contractor's normal working hours.
 4. Major interruptions of any system must be requested, in writing, at least 21 calendar days prior to the desired time and shall be performed as directed by the COTR.
 5. In case of a contract construction emergency, service will be interrupted on approval of COTR. Such approval will be confirmed in writing as soon as practical.
 6. Whenever it is required that a connection fee be paid to a public utility provider for new permanent service to the construction project, for such items as water, sewer, electricity, gas or steam, payment of such fee shall be the responsibility of the Government and not the Contractor.
- J. Abandoned Lines: All service lines such as wires, cables, conduits, ducts, pipes and the like, and their hangers or supports, which are to be abandoned but are not required to be entirely removed, shall be sealed, capped or plugged. The lines shall not be capped in finished areas, but shall be removed and sealed, capped or plugged in ceilings, within furred spaces, in unfinished areas, or within walls or partitions; so that they are completely behind the finished surfaces.
- K. To minimize interference of construction activities with flow of Medical Center traffic, comply with the following:
 1. Keep roads, walks and entrances to grounds, to parking and to occupied areas of buildings clear of construction materials, debris and standing construction equipment and vehicles.

2. Method and scheduling of required cutting, altering and removal of existing roads, walks and entrances must be approved by the COTR.
- L. Coordinate the work for this contract with other construction operations as directed by COTR. This includes the scheduling of traffic and the use of roadways, as specified in Article, USE OF ROADWAYS.

1.6 ALTERATIONS

- A. Survey: Before any work is started, the Contractor shall make a thorough survey with the COTR of areas of buildings in which alterations occur and areas which are anticipated routes of access, and furnish a report, signed by both, to the Contracting Officer. This report shall list by rooms and spaces:
 1. Existing condition and types of resilient flooring, doors, windows, walls and other surfaces not required to be altered throughout affected areas of building.
 2. Existence and conditions of items such as plumbing fixtures and accessories, electrical fixtures, equipment, venetian blinds, shades, etc., required by drawings to be either reused or relocated, or both.
 3. Shall note any discrepancies between drawings and existing conditions at site.
 4. Shall designate areas for working space, materials storage and routes of access to areas within buildings where alterations occur and which have been agreed upon by Contractor and COTR.
- B. Any items required by drawings to be either reused or relocated or both, found during this survey to be nonexistent, or in opinion of COTR, to be in such condition that their use is impossible or impractical, shall be furnished and/or replaced by Contractor with new items in accordance with specifications which will be furnished by Government. Provided the contract work is changed by reason of this subparagraph B, the contract will be modified accordingly, under provisions of clause entitled "DIFFERING SITE CONDITIONS" (FAR 52.236-2) and "CHANGES" (FAR 52.243-4 and VAAR 852.236-88).
- C. Re-Survey: Thirty days before expected partial or final inspection date, the Contractor and COTR together shall make a thorough re-survey of the areas of buildings involved. They shall furnish a report on conditions then existing, of resilient flooring, doors, windows, walls and other surfaces as compared with conditions of same as noted in first condition survey report:
 1. Re-survey report shall also list any damage caused by Contractor to such flooring and other surfaces, despite protection measures; and, will form basis for determining extent of repair work required of Contractor to restore damage caused by Contractor's workmen in executing work of this contract.
- D. Protection: Provide the following protective measures:
 1. Wherever existing roof surfaces are disturbed they shall be protected against water infiltration. In case of leaks, they shall be repaired immediately upon discovery.

2. Temporary protection against damage for portions of existing structures and grounds where work is to be done, materials handled and equipment moved and/or relocated.
3. Protection of interior of existing structures at all times, from damage, dust and weather inclemency. Wherever work is performed, floor surfaces that are to remain in place shall be adequately protected prior to starting work, and this protection shall be maintained intact until all work in the area is completed.

1.7 INFECTION PREVENTION MEASURES

- A. Implement the requirements of VAMC's Construction Health and Safety Team (CHST). CHST Group may monitor dust in the vicinity of the construction work and require the Contractor to take corrective action immediately if the safe levels are exceeded.
- B. Establish and maintain a dust control program as part of the contractor's infection preventive measures in accordance with the guidelines provided by CHST Group as specified here. Prior to start of work, prepare a plan detailing project-specific dust protection measures, including periodic status reports, and submit to COTR and Facility CHST team for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.
 1. All personnel involved in the construction or renovation activity shall be educated and trained in infection prevention measures established by the medical center.
- C. Medical center Infection Control personnel shall monitor for airborne disease (e.g. aspergillosis) as appropriate during construction. A baseline of conditions may be established by the medical center prior to the start of work and periodically during the construction stage to determine impact of construction activities on indoor air quality. In addition:
 1. The COTR and VAMC Infection Control personnel shall review pressure differential monitoring documentation to verify that pressure differentials in the construction zone and in the patient-care rooms are appropriate for their settings. The requirement for negative air pressure in the construction zone shall depend on the location and type of activity. Upon notification, the contractor shall implement corrective measures to restore proper pressure differentials as needed.
 2. In case of any problem, the medical center, along with assistance from the contractor, shall conduct an environmental assessment to find and eliminate the source.
- D. In general, following preventive measures shall be adopted during construction to keep down dust and prevent mold.
 1. Dampen debris to keep down dust and provide temporary construction partitions in existing structures where directed by COTR. Blank off ducts and diffusers to prevent circulation of dust into occupied areas during construction.
 2. Do not perform dust producing tasks within occupied areas without the approval of the COTR. For construction in any areas that will remain jointly occupied by the medical Center and Contractor's workers, the Contractor shall:

- a. Provide dust proof one-hour fire-rated temporary drywall construction barriers to completely separate construction from the operational areas of the hospital in order to contain dirt debris and dust. Barriers shall be sealed and made presentable on hospital occupied side. Install a self-closing rated door in a metal frame, commensurate with the partition, to allow worker access. Maintain negative air at all times – construction barriers shall include a negative pressure monitor to indicate negative pressure at all times. A fire retardant polystyrene, 6-mil thick or greater plastic barrier meeting local fire codes may be used where dust control is the only hazard, and an agreement is reached with the COTR and Medical Center.
- b. Use of negative pressure machines with HEPA filtration is required throughout entire construction process. Contractor shall verify that construction exhaust to exterior is not reintroduced to the medical center through intake vents, or building openings. Install HEPA (High Efficiency Particulate Accumulator) filter vacuum system rated at 95% capture of 0.3 microns including pollen, mold spores and dust particles. Insure continuous negative air pressures occurring within the work area. HEPA filters should have ASHRAE 85 or other prefilter to extend the useful life of the HEPA. Provide both primary and secondary filtrations units. Exhaust hoses shall be heavy duty, flexible steel reinforced and exhausted so that dust is not reintroduced to the medical center.
- c. Adhesive Walk-off/Carpet Walk-off Mats, minimum 600mm x 900mm (24" x 36"), shall be used at all interior transitions from the construction area to occupied medical center area. These mats shall be changed as often as required to maintain clean work areas directly outside construction area at all times.
- d. Vacuum and wet mop all transition areas from construction to the occupied medical center at the end of each workday. Vacuum shall utilize HEPA filtration. Maintain surrounding area frequently. Remove debris as they are created. Transport these outside the construction area in containers with tightly fitting lids.
- e. The contractor shall not haul debris through patient-care areas without prior approval of the COTR and the Medical Center. When, approved, debris shall be hauled in enclosed dust proof containers or wrapped in plastic and sealed with duct tape. No sharp objects should be allowed to cut through the plastic. Wipe down the exterior of the containers with a damp rag to remove dust. All equipment, tools, material, etc. transported through occupied areas shall be made free from dust and moisture by vacuuming and wipe down.
- f. Using a HEPA vacuum, clean inside the barrier and vacuum ceiling tile prior to replacement. Any ceiling access panels opened for investigation beyond sealed areas shall be sealed immediately when unattended.
- g. There shall be no standing water during construction. This includes water in equipment drip pans and open containers within the construction areas. All accidental spills must be

cleaned up and dried within 12 hours. Remove and dispose of porous materials that remain damp for more than 72 hours.

- h. At completion, remove construction barriers and ceiling protection carefully, outside of normal work hours. Vacuum and clean all surfaces free of dust after the removal.

E. Final Cleanup:

1. Upon completion of project, or as work progresses, remove all construction debris from above ceiling, vertical shafts and utility chases that have been part of the construction.
2. Perform HEPA vacuum cleaning of all surfaces in the construction area. This includes walls, ceilings, cabinets, furniture (built-in or free standing), partitions, flooring, etc.
3. All new air ducts shall be cleaned prior to final inspection.

1.8 DISPOSAL AND RETENTION

A. Materials and equipment accruing from work removed and from demolition of buildings or structures, or parts thereof, shall be disposed of as follows:

1. Reserved items which are to remain property of the Government are identified by attached tags or noted on drawings or in specifications as items to be stored. Items that remain property of the Government shall be removed or dislodged from present locations in such a manner as to prevent damage which would be detrimental to re-installation and reuse. Store such items where directed by COTR.
2. Items not reserved shall become property of the Contractor and be removed by Contractor from Medical Center.
3. Items of portable equipment and furnishings located in rooms and spaces in which work is to be done under this contract shall remain the property of the Government. When rooms and spaces are vacated by the Department of Veterans Affairs during the alteration period, such items which are NOT required by drawings and specifications to be either relocated or reused will be removed by the Government in advance of work to avoid interfering with Contractor's operation.

1.9 PROTECTION OF EXISTING VEGETATION, STRUCTURES, EQUIPMENT, UTILITIES, AND IMPROVEMENTS

- A. The Contractor shall preserve and protect all structures, equipment, and vegetation (such as trees, shrubs, and grass) on or adjacent to the work site, which are not to be removed and which do not unreasonably interfere with the work required under this contract. The Contractor shall only remove trees when specifically authorized to do so, and shall avoid damaging vegetation that will remain in place. If any limbs or branches of trees are broken during contract performance, or by the careless operation of equipment, or by workmen, the Contractor shall trim those limbs or branches with a clean cut and paint the cut with a tree-pruning compound as directed by the Contracting Officer.
- B. The Contractor shall protect from damage all existing improvements and utilities at or near the work site and on adjacent property of a third party, the locations of which are made known to or

should be known by the Contractor. The Contractor shall repair any damage to those facilities, including those that are the property of a third party, resulting from failure to comply with the requirements of this contract or failure to exercise reasonable care in performing the work. If the Contractor fails or refuses to repair the damage promptly, the Contracting Officer may have the necessary work performed and charge the cost to the Contractor.

(FAR 52.236-9)

- C. Refer to Section 01 57 19, TEMPORARY ENVIRONMENTAL CONTROLS, for additional requirements on protecting vegetation, soils and the environment. Refer to Articles, "Alterations", "Restoration", and "Operations and Storage Areas" for additional instructions concerning repair of damage to structures and site improvements.
- D. Refer to FAR clause 52.236-7, "Permits and Responsibilities," which is included in General Conditions. A National Pollutant Discharge Elimination System (NPDES) permit is required for this project. The Contractor is considered an "operator" under the permit and has extensive responsibility for compliance with permit requirements. VA will make the permit application available at the (appropriate medical center) office. The apparent low bidder, contractor and affected subcontractors shall furnish all information and certifications that are required to comply with the permit process and permit requirements. Many of the permit requirements will be satisfied by completing construction as shown and specified. Some requirements involve the Contractor's method of operations and operations planning and the Contractor is responsible for employing best management practices. The affected activities often include, but are not limited to the following:
- Designating areas for equipment maintenance and repair;
 - Providing waste receptacles at convenient locations and provide regular collection of wastes;
 - Locating equipment wash down areas on site, and provide appropriate control of wash-waters;
 - Providing protected storage areas for chemicals, paints, solvents, fertilizers, and other potentially toxic materials; and
 - Providing adequately maintained sanitary facilities.

1.10 RESTORATION

- A. Remove, cut, alter, replace, patch and repair existing work as necessary to install new work. Except as otherwise shown or specified, do not cut, alter or remove any structural work, and do not disturb any ducts, plumbing, steam, gas, or electric work without approval of the COTR. Existing work to be altered or extended and that is found to be defective in any way, shall be reported to the COTR before it is disturbed. Materials and workmanship used in restoring work, shall conform in type and quality to that of original existing construction, except as otherwise shown or specified.

- B. Upon completion of contract, deliver work complete and undamaged. Existing work (walls, ceilings, partitions, floors, mechanical and electrical work, lawns, paving, roads, walks, etc.) disturbed or removed as a result of performing required new work, shall be patched, repaired, reinstalled, or replaced with new work, and refinished and left in as good condition as existed before commencing work. Contractor shall utilize correct fire rated material for wall patches in rated walls.
- C. At Contractor's own expense, Contractor shall immediately restore to service and repair any damage caused by Contractor's workmen to existing piping and conduits, wires, cables, etc., of utility services or of fire protection systems and communications systems (including telephone) which are indicated on drawings and which are not scheduled for discontinuance or abandonment.
- D. Expense of repairs to such utilities and systems not shown on drawings or locations of which are unknown will be covered by adjustment to contract time and price in accordance with clause entitled "CHANGES" (FAR 52.243-4 and VAAR 852.236-88) and "DIFFERING SITE CONDITIONS" (FAR 52.236-2).

1.11 AS-BUILT DRAWINGS

- A. The contractor shall maintain two full size sets of as-built drawings which will be kept current during construction of the project, to include all contract changes, modifications and clarifications.
- B. All variations shall be shown in the same general detail as used in the contract drawings. To insure compliance, as-built drawings shall be made available for the COTR's review, as often as requested.
- C. Contractor shall deliver two approved completed sets of as-built drawings to the COTR within 15 calendar days after each completed phase and after the acceptance of the project by the COTR.
- D. Paragraphs A, B, & C shall also apply to all shop drawings.

1.12 USE OF ROADWAYS

- A. For hauling, use only established public roads and roads on Medical Center property and, when authorized by the COTR, such temporary roads which are necessary in the performance of contract work. Temporary roads shall be constructed by the Contractor at Contractor's expense. When necessary to cross curbing, sidewalks, or similar construction, they must be protected by well-constructed bridges.

1.13 TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT

- A. Use of new installed mechanical and electrical equipment to provide heat, ventilation, plumbing, light and power will be permitted subject to compliance with the following provisions:
 - 1. Permission to use each unit or system must be given by COTR. If the equipment is not installed and maintained in accordance with the following provisions, the COTR will withdraw permission for use of the equipment.

2. Electrical installations used by the equipment shall be completed in accordance with the drawings and specifications to prevent damage to the equipment and the electrical systems, i.e. transformers, relays, circuit breakers, fuses, conductors, motor controllers and their overload elements shall be properly sized, coordinated and adjusted. Voltage supplied to each item of equipment shall be verified to be correct and it shall be determined that motors are not overloaded. The electrical equipment shall be thoroughly cleaned before using it and again immediately before final inspection including vacuum cleaning and wiping clean interior and exterior surfaces.
 3. Units shall be properly lubricated, balanced, and aligned. Vibrations must be eliminated.
 4. Automatic temperature control systems for preheat coils shall function properly and all safety controls shall function to prevent coil freeze-up damage.
 5. The air filtering system utilized shall be that which is designed for the system when complete, and all filter elements shall be replaced at completion of construction and prior to testing and balancing of system.
 6. All components of heat production and distribution system, metering equipment, condensate returns, and other auxiliary facilities used in temporary service shall be cleaned prior to use; maintained to prevent corrosion internally and externally during use; and cleaned, maintained and inspected prior to acceptance by the Government.
- B. Prior to final inspection, the equipment or parts used which show wear and tear beyond normal, shall be replaced with identical replacements, at no additional cost to the Government.
- C. This paragraph shall not reduce the requirements of the mechanical and electrical specifications sections.

1.14 TEMPORARY USE OF EXISTING ELEVATORS

- A. Use of existing elevators for handling building materials and Contractor's personnel will be permitted subject to following provisions:
1. Contractor makes all arrangements with the COTR for use of elevators. The COTR will ascertain that elevators are in proper condition. Contractor may use elevators Nos. P-5 & P-6 in Building No. 1 for special nonrecurring time intervals when permission is granted. Personnel for operating elevators will not be provided by the Department of Veterans Affairs.
 2. Contractor covers and provides maximum protection of following elevator components:
 - a. Entrance jambs, heads soffits and threshold plates.
 - b. Entrance columns, canopy, return panels and inside surfaces of car enclosure walls.
 - c. Finish flooring.
 3. Government will accept hoisting ropes of elevator and rope of each speed governor if they are worn under normal operation. However, if these ropes are damaged by action of foreign matter such as sand, lime, grit, stones, etc., during temporary use, they shall be removed and replaced by new hoisting ropes.

1.15 TEMPORARY TOILETS

- A. Contractor may have for use of Contractor's workmen, such toilet accommodations as may be assigned to Contractor by Medical Center. Contractor shall keep such places clean and be responsible for any damage done thereto by Contractor's workmen. Failure to maintain satisfactory condition in toilets will deprive Contractor of the privilege to use such toilets.

1.16 AVAILABILITY AND USE OF UTILITY SERVICES

- A. The Government shall make all reasonably required amounts of utilities available to the Contractor from existing outlets and supplies, as specified in the contract. The amount to be paid by the Contractor for chargeable electrical services shall be the prevailing rates charged to the Government. The Contractor shall carefully conserve any utilities furnished without charge.
- B. The Contractor, at Contractor's expense and in a workmanlike manner satisfactory to the Contracting Officer, shall install and maintain all necessary temporary connections and distribution lines, and all meters required to measure the amount of electricity used for the purpose of determining charges. Before final acceptance of the work by the Government, the Contractor shall remove all the temporary connections, distribution lines, meters, and associated paraphernalia.
- C. Contractor shall install meters at Contractor's expense and furnish the Medical Center a monthly record of the Contractor's usage of electricity as hereinafter specified.
- D. Heat: Furnish temporary heat necessary to prevent injury to work and materials through dampness and cold. Use of open salamanders or any temporary heating devices which may be fire hazards or may smoke and damage finished work, will not be permitted. Maintain minimum temperatures as specified for various materials:
1. Obtain heat by connecting to Medical Center heating distribution system.
 - a. Steam is available at no cost to Contractor.
- E. Electricity (for Construction and Testing): Furnish all temporary electric services.
1. Obtain electricity by connecting to the Medical Center electrical distribution system. The Contractor shall meter and pay for electricity required for electric cranes and hoisting devices, electrical welding devices and any electrical heating devices providing temporary heat. Electricity for all other uses is available at no cost to the Contractor.
- F. Water (for Construction and Testing): Furnish temporary water service.
1. Obtain water by connecting to the Medical Center water distribution system. Provide reduced pressure backflow preventer at each connection. Water is available at no cost to the Contractor.
 2. Maintain connections, pipe, fittings and fixtures and conserve water-use so none is wasted. Failure to stop leakage or other wastes will be cause for revocation (at COTR's discretion) of use of water from Medical Center's system.
- G. Steam: Furnish steam system for testing required in various sections of specifications.
1. Obtain steam for testing by connecting to the Medical Center steam distribution system. Steam is available at no cost to the Contractor.

2. Maintain connections, pipe, fittings and fixtures and conserve steam-use so none is wasted. Failure to stop leakage or other waste will be cause for revocation (at COTR's discretion), of use of steam from the Medical Center's system.

1.17 TESTS

- A. Pre-test mechanical and electrical equipment and systems and make corrections required for proper operation of such systems before requesting final tests. Final test will not be conducted unless pre-tested.
- B. Conduct final tests required in various sections of specifications in presence of an authorized representative of the Contracting Officer. Contractor shall furnish all labor, materials, equipment, instruments, and forms, to conduct and record such tests.
- C. Mechanical and electrical systems shall be balanced, controlled and coordinated. A system is defined as the entire complex which must be coordinated to work together during normal operation to produce results for which the system is designed. For example, air conditioning supply air is only one part of entire system which provides comfort conditions for a building. Other related components are return air, exhaust air, steam, chilled water, refrigerant, hot water, controls and electricity, etc. Another example of a complex which involves several components of different disciplines is a boiler installation. Efficient and acceptable boiler operation depends upon the coordination and proper operation of fuel, combustion air, controls, steam, feedwater, condensate and other related components.
- D. All related components as defined above shall be functioning when any system component is tested. Tests shall be completed within a reasonably short period of time during which operating and environmental conditions remain reasonably constant.
- E. Individual test result of any component, where required, will only be accepted when submitted with the test results of related components and of the entire system.

1.18 INSTRUCTIONS

- A. Contractor shall furnish Maintenance and Operating manuals and verbal instructions when required by the various sections of the specifications and as hereinafter specified.
- B. Manuals: Maintenance and operating manuals (four copies each) for each separate piece of equipment shall be delivered to the COTR coincidental with the delivery of the equipment to the job site. Manuals shall be complete, detailed guides for the maintenance and operation of equipment. They shall include complete information necessary for starting, adjusting, maintaining in continuous operation for long periods of time and dismantling and reassembling of the complete units and sub-assembly components. Manuals shall include an index covering all component parts clearly cross-referenced to diagrams and illustrations. Illustrations shall include "exploded" views showing and identifying each separate item. Emphasis shall be placed on the use of special tools and instruments. The function of each piece of equipment, component, accessory and control shall be clearly and thoroughly explained. All necessary precautions for the operation of the equipment and the reason for each precaution shall be clearly set forth. Manuals must

reference the exact model, style and size of the piece of equipment and system being furnished. Manuals referencing equipment similar to but of a different model, style, and size than that furnished will not be accepted.

- C. Instructions: Contractor shall provide qualified, factory-trained manufacturers' representatives to give detailed instructions to assigned Department of Veterans Affairs personnel in the operation and complete maintenance for each piece of equipment. All such training will be at the job site. These requirements are more specifically detailed in the various technical sections. Instructions for different items of equipment that are component parts of a complete system, shall be given in an integrated, progressive manner. All instructors for every piece of component equipment in a system shall be available until instructions for all items included in the system have been completed. This is to assure proper instruction in the operation of inter-related systems. All instruction periods shall be at such times as scheduled by the COTR and shall be considered concluded only when the COTR is satisfied in regard to complete and thorough coverage. The Department of Veterans Affairs reserves the right to request the removal of, and substitution for, any instructor who, in the opinion of the COTR, does not demonstrate sufficient qualifications in accordance with requirements for instructors above.

1.19 GOVERNMENT-FURNISHED PROPERTY

- A. The Government shall deliver to the Contractor, the Government-furnished property shown on the drawings.
- B. Equipment furnished by Government to be installed by Contractor will be furnished to Contractor at the Medical Center.
- C. Storage space for equipment will be provided by the Government and the Contractor shall be prepared to unload and store such equipment therein upon its receipt at the Medical Center.
- D. Notify Contracting Officer in writing, 60 days in advance, of date on which Contractor will be prepared to receive equipment furnished by Government. Arrangements will then be made by the Government for delivery of equipment.
1. Immediately upon delivery of equipment, Contractor shall arrange for a joint inspection thereof with a representative of the Government. At such time the Contractor shall acknowledge receipt of equipment described, make notations, and immediately furnish the Government representative with a written statement as to its condition or shortages.
 2. Contractor thereafter is responsible for such equipment until such time as acceptance of contract work is made by the Government.
- E. Equipment furnished by the Government will be delivered in a partially assembled (knock down) condition in accordance with existing standard commercial practices, complete with all fittings, fastenings, and appliances necessary for connections to respective services installed under contract. All fittings and appliances (i.e., couplings, ells, tees, nipples, piping, conduits, cables, and the like) necessary to make the connection between the Government furnished equipment

item and the utility stub-up shall be furnished and installed by the contractor at no additional cost to the Government.

- F. Completely assemble and install the Government furnished equipment in place ready for proper operation in accordance with specifications and drawings.
- G. Furnish supervision of installation of equipment at construction site by qualified factory trained technicians regularly employed by the equipment manufacturer.

1.20 RELOCATED EQUIPMENT/ITEMS

- A. Contractor shall disconnect, dismantle as necessary, remove and reinstall in new location, all existing equipment and items indicated by symbol "R" or otherwise shown to be relocated by the Contractor.
- B. Perform relocation of such equipment or items at such times and in such a manner as directed by the COTR.
- C. Suitably cap existing service lines, such as steam, condensate return, water, drain, gas, air, vacuum and/or electrical, whenever such lines are disconnected from equipment to be relocated. Remove abandoned lines in finished areas and cap as specified herein before under paragraph "Abandoned Lines".
- D. Provide all mechanical and electrical service connections, fittings, fastenings and any other materials necessary for assembly and installation of relocated equipment; and leave such equipment in proper operating condition.
- E. Contractor shall employ services of an installation engineer, who is an authorized representative of the manufacturer of this equipment to supervise assembly and installation of existing equipment, required to be relocated.
- F. All service lines such as noted above for relocated equipment shall be in place at point of relocation ready for use before any existing equipment is disconnected. Make relocated existing equipment ready for operation or use immediately after reinstallation.

--- E N D ---

SECTION 01 33 23
SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES

- 1-1. Refer to Articles titled SPECIFICATIONS AND DRAWINGS FOR CONSTRUCTION (FAR 52.236-21) and, SPECIAL NOTES (VAAR 852.236-91), in GENERAL CONDITIONS.
- 1-2. For the purposes of this contract, samples, test reports, certificates, and manufacturers' literature and data shall also be subject to the previously referenced requirements. The following text refers to all items collectively as SUBMITTALS.
- 1-3. Submit for approval, all of the items specifically mentioned under the separate sections of the specification, with information sufficient to evidence full compliance with contract requirements. Materials, fabricated articles and the like to be installed in permanent work shall equal those of approved submittals. After an item has been approved, no change in brand or make will be permitted unless:
 - A. Satisfactory written evidence is presented to, and approved by Contracting Officer, that manufacturer cannot make scheduled delivery of approved item or;
 - B. Item delivered has been rejected and substitution of a suitable item is an urgent necessity or;
 - C. Other conditions become apparent which indicates approval of such substitute item to be in best interest of the Government.
- 1-4. Forward submittals in sufficient time to permit proper consideration and approval action by Government. Time submission to assure adequate lead time for procurement of contract - required items. Delays attributable to untimely and rejected submittals will not serve as a basis for extending contract time for completion.
- 1-5. Submittals will be reviewed for compliance with contract requirements by Architect-Engineer, and action thereon will be taken by COTR on behalf of the Contracting Officer.
- 1-6. Upon receipt of submittals, Architect-Engineer will assign a file number thereto. Contractor, in any subsequent correspondence, shall refer to this file and identification number to expedite replies relative to previously approved or disapproved submittals.
- 1-7. The Government reserves the right to require additional submittals, whether or not particularly mentioned in this contract. If additional submittals beyond those required by the contract are furnished pursuant to request therefor by Contracting Officer, adjustment in contract price and time will be made in accordance with Articles titled CHANGES (FAR 52.243-4) and CHANGES - SUPPLEMENT (VAAR 852.236-88) of the GENERAL CONDITIONS.
- 1-8. Schedules called for in specifications and shown on shop drawings shall be submitted for use and information of Department of Veterans Affairs and Architect-Engineer. However, the Contractor shall assume responsibility for coordinating and verifying schedules. The Contracting Officer and Architect-Engineer assumes no responsibility for checking schedules or layout drawings for exact sizes, exact numbers and detailed positioning of items.

- 1-9. Submittals must be submitted by Contractor only and shipped prepaid. Contracting Officer assumes no responsibility for checking quantities or exact numbers included in such submittals.
- A. Submit samples in single units unless otherwise specified. Submit shop drawings, schedules, manufacturers' literature and data, and certificates in quadruplicate, except where a greater number is specified.
 - B. Submittals will receive consideration only when covered by a transmittal letter signed by Contractor. Letter shall be sent via first class mail and shall contain the list of items, name of Medical Center, name of Contractor, contract number, applicable specification paragraph numbers, applicable drawing numbers (and other information required for exact identification of location for each item), manufacturer and brand, ASTM or Federal Specification Number (if any) and such additional information as may be required by specifications for particular item being furnished. In addition, catalogs shall be marked to indicate specific items submitted for approval.
 - 1. A copy of letter must be enclosed with items, and any items received without identification letter will be considered "unclaimed goods" and held for a limited time only.
 - 2. Each sample, certificate, manufacturers' literature and data shall be labeled to indicate the name and location of the Medical Center, name of Contractor, manufacturer, brand, contract number and ASTM or Federal Specification Number as applicable and location(s) on project.
 - 3. Required certificates shall be signed by an authorized representative of manufacturer or supplier of material, and by Contractor.
 - C. In addition to complying with the applicable requirements specified in preceding Article 1.9, samples which are required to have Laboratory Tests (those preceded by symbol "LT" under the separate sections of the specification shall be tested, at the expense of Contractor, in a commercial laboratory approved by Contracting Officer.
 - 1. Laboratory shall furnish Contracting Officer with a certificate stating that it is fully equipped and qualified to perform intended work, is fully acquainted with specification requirements and intended use of materials and is an independent establishment in no way connected with organization of Contractor or with manufacturer or supplier of materials to be tested.
 - 2. Certificates shall also set forth a list of comparable projects upon which laboratory has performed similar functions during past five years.
 - 3. Samples and laboratory tests shall be sent directly to approved commercial testing laboratory.
 - 4. Contractor shall send a copy of transmittal letter to both COTR and to Architect-Engineer simultaneously with submission of material to a commercial testing laboratory.
 - 5. Laboratory test reports shall be sent directly to COTR for appropriate action.
 - 6. Laboratory reports shall list contract specification test requirements and a comparative list of the laboratory test results. When tests show that the material meets specification requirements, the laboratory shall so certify on test report.
 - 7. Laboratory test reports shall also include a recommendation for approval or disapproval of tested item.

- D. If submittal samples have been disapproved, resubmit new samples as soon as possible after notification of disapproval. Such new samples shall be marked "Resubmitted Sample" in addition to containing other previously specified information required on label and in transmittal letter.
- E. Approved samples will be kept on file by the COTR at the site until completion of contract, at which time such samples will be delivered to Contractor as Contractor's property. Where noted in technical sections of specifications, approved samples in good condition may be used in their proper locations in contract work. At completion of contract, samples that are not approved will be returned to Contractor only upon request and at Contractor's expense. Such request should be made prior to completion of the contract. Disapproved samples that are not requested for return by Contractor will be discarded after completion of contract.
- F. Submittal drawings (shop, erection or setting drawings) and schedules, required for work of various trades, shall be checked before submission by technically qualified employees of Contractor for accuracy, completeness and compliance with contract requirements. These drawings and schedules shall be stamped and signed by Contractor certifying to such check.
 - 1. For each drawing required, submit one legible photographic paper or vellum reproducible.
 - 2. Reproducible shall be full size.
 - 3. Each drawing shall have marked thereon, proper descriptive title, including Medical Center location, project number, manufacturer's number, reference to contract drawing number, detail Section Number, and Specification Section Number.
 - 4. A space 120 mm by 125 mm (4-3/4 by 5 inches) shall be reserved on each drawing to accommodate approval or disapproval stamp.
 - 5. Submit drawings, ROLLED WITHIN A MAILING TUBE, fully protected for shipment.
 - 6. One reproducible print of approved or disapproved shop drawings will be forwarded to Contractor.
 - 7. When work is directly related and involves more than one trade, shop drawings shall be submitted to Architect-Engineer under one cover.
- 1-10. Samples, shop drawings, test reports, certificates and manufacturers' literature and data, shall be submitted for approval to

Heapy Engineering
1400 W. Dorothy Lane
Dayton, OH 45409

- 1-11. At the time of transmittal to the Architect-Engineer, the Contractor shall also send a copy of the complete submittal directly to the COTR.

--- E N D ---

**SECTION 01 42 19
REFERENCE STANDARDS****PART 1 - GENERAL****1.1 DESCRIPTION**

This section specifies the availability and source of references and standards specified in the project manual under paragraphs APPLICABLE PUBLICATIONS and/or shown on the drawings.

1.2 AVAILABILITY OF SPECIFICATIONS LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS FPMR PART 101-29 (FAR 52.211-1) (AUG 1998)

- A. The GSA Index of Federal Specifications, Standards and Commercial Item Descriptions, FPMR Part 101-29 and copies of specifications, standards, and commercial item descriptions cited in the solicitation may be obtained for a fee by submitting a request to – GSA Federal Supply Service, Specifications Section, Suite 8100, 470 East L'Enfant Plaza, SW, Washington, DC 20407, Telephone (202) 619-8925, Facsimile (202) 619-8978.
- B. If the General Services Administration, Department of Agriculture, or Department of Veterans Affairs issued this solicitation, a single copy of specifications, standards, and commercial item descriptions cited in this solicitation may be obtained free of charge by submitting a request to the addressee in paragraph (a) of this provision. Additional copies will be issued for a fee.

1.3 AVAILABILITY FOR EXAMINATION OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS (FAR 52.211-4) (JUN 1988)

The specifications and standards cited in this solicitation can be examined at the following location:

DEPARTMENT OF VETERANS AFFAIRS
Office of Construction & Facilities Management
Facilities Quality Service (00CFM1A)
425 Eye Street N.W, (sixth floor)
Washington, DC 20001
Telephone Numbers: (202) 632-5249 or (202) 632-5178
Between 9:00 AM - 3:00 PM

1.4 AVAILABILITY OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS (FAR 52.211-3) (JUN 1988)

The specifications cited in this solicitation may be obtained from the associations or organizations listed below.

- AA Aluminum Association Inc.
<http://www.aluminum.org>
- AABC Associated Air Balance Council
<http://www.aabchq.com>

| | |
|--------|---|
| AAMA | American Architectural Manufacturer's Association http://www.aamanet.org |
| AAN | American Nursery and Landscape Association http://www.anla.org |
| AASHTO | American Association of State Highway and Transportation Officials http://www.aashto.org |
| AATCC | American Association of Textile Chemists and Colorists http://www.aatcc.org |
| ACGIH | American Conference of Governmental Industrial Hygienists http://www.acgih.org |
| ACI | American Concrete Institute http://www.aci-int.net |
| ACPA | American Concrete Pipe Association http://www.concrete-pipe.org |
| ACPPA | American Concrete Pressure Pipe Association http://www.acppa.org |
| ADC | Air Diffusion Council http://flexibleduct.org |
| AGA | American Gas Association http://www.aga.org |
| AGC | Associated General Contractors of America http://www.agc.org |
| AGMA | American Gear Manufacturers Association, Inc. http://www.agma.org |
| AHAM | Association of Home Appliance Manufacturers http://www.aham.org |
| AISC | American Institute of Steel Construction http://www.aisc.org |
| AISI | American Iron and Steel Institute http://www.steel.org |
| AITC | American Institute of Timber Construction http://www.aitc-glulam.org |
| AMCA | Air Movement and Control Association, Inc. http://www.amca.org |
| ANLA | American Nursery & Landscape Association http://www.anla.org |
| ANSI | American National Standards Institute, Inc. http://www.ansi.org |

| | |
|--------|--|
| APA | The Engineered Wood Association http://www.apawood.org |
| ARI | Air-Conditioning and Refrigeration Institute http://www.ari.org |
| ASAE | American Society of Agricultural Engineers http://www.asae.org |
| ASCE | American Society of Civil Engineers http://www.asce.org |
| ASHRAE | American Society of Heating, Refrigerating, and Air-Conditioning Engineers http://www.ashrae.org |
| ASME | American Society of Mechanical Engineers http://www.asme.org |
| ASSE | American Society of Sanitary Engineering http://www.asse-plumbing.org |
| ASTM | American Society for Testing and Materials http://www.astm.org |
| AWI | Architectural Woodwork Institute http://www.awinet.org |
| AWS | American Welding Society http://www.aws.org |
| AWWA | American Water Works Association http://www.awwa.org |
| BHMA | Builders Hardware Manufacturers Association http://www.buildershardware.com |
| BIA | Brick Institute of America http://www.bia.org |
| CAGI | Compressed Air and Gas Institute http://www.cagi.org |
| CGA | Compressed Gas Association, Inc. http://www.cganet.com |
| CI | The Chlorine Institute, Inc. http://www.chlorineinstitute.org |
| CISCA | Ceilings and Interior Systems Construction Association http://www.cisca.org |
| CISPI | Cast Iron Soil Pipe Institute http://www.cispi.org |

| | |
|-------|---|
| CLFMI | Chain Link Fence Manufacturers Institute http://www.chainlinkinfo.org |
| CPMB | Concrete Plant Manufacturers Bureau http://www.cpmmb.org |
| CRA | California Redwood Association http://www.calredwood.org |
| CRSI | Concrete Reinforcing Steel Institute http://www.crsi.org |
| CTI | Cooling Technology Institute http://www.cti.org |
| DHI | Door and Hardware Institute http://www.dhi.org |
| EGSA | Electrical Generating Systems Association http://www.egsa.org |
| EEI | Edison Electric Institute http://www.eei.org |
| EPA | Environmental Protection Agency http://www.epa.gov |
| ETL | ETL Testing Laboratories, Inc. http://www.et1.com |
| FAA | Federal Aviation Administration http://www.faa.gov |
| FCC | Federal Communications Commission http://www.fcc.gov |
| FPS | The Forest Products Society http://www.forestprod.org |
| GANA | Glass Association of North America http://www.cssinfo.com/info/gana.html/ |
| FM | Factory Mutual Insurance http://www.fmglobal.com |
| GA | Gypsum Association http://www.gypsum.org |
| GSA | General Services Administration http://www.gsa.gov |
| HI | Hydraulic Institute http://www.pumps.org |
| HPVA | Hardwood Plywood & Veneer Association http://www.hpva.org |

| | |
|--------|--|
| ICBO | International Conference of Building Officials http://www.icbo.org |
| ICEA | Insulated Cable Engineers Association Inc. http://www.icea.net |
| ICAC | Institute of Clean Air Companies http://www.icac.com |
| IEEE | Institute of Electrical and Electronics Engineers http://www.ieee.org |
| IMSA | International Municipal Signal Association http://www.imsasafety.org |
| IPCEA | Insulated Power Cable Engineers Association |
| NBMA | Metal Buildings Manufacturers Association http://www.mbma.com |
| MSS | Manufacturers Standardization Society of the Valve and Fittings Industry Inc. http://www.mss-hq.com |
| NAAMM | National Association of Architectural Metal Manufacturers http://www.naamm.org |
| NAPHCC | Plumbing-Heating-Cooling Contractors Association http://www.phccweb.org |
| NBS | National Bureau of Standards See - NIST |
| NBBPVI | National Board of Boiler and Pressure Vessel Inspectors http://www.nationboard.org |
| NEC | National Electric Code See - NFPA National Fire Protection Association |
| NEMA | National Electrical Manufacturers Association http://www.nema.org |
| NFPA | National Fire Protection Association http://www.nfpa.org |
| NHLA | National Hardwood Lumber Association http://www.natlhardwood.org |
| NIH | National Institute of Health http://www.nih.gov |
| NIST | National Institute of Standards and Technology http://www.nist.gov |
| NLMA | Northeastern Lumber Manufacturers Association, Inc. http://www.nelma.org |

NPA National Particleboard Association
18928 Premiere Court
Gaithersburg, MD 20879
(301) 670-0604

NSF National Sanitation Foundation
<http://www.nsf.org>

NWWDA Window and Door Manufacturers Association
<http://www.nwwda.org>

OSHA Occupational Safety and Health Administration
Department of Labor
<http://www.osha.gov>

PCA Portland Cement Association
<http://www.portcement.org>

PCI Precast Prestressed Concrete Institute
<http://www.pci.org>

PPI The Plastic Pipe Institute
<http://www.plasticpipe.org>

PEI Porcelain Enamel Institute, Inc.
<http://www.porcelainenamel.com>

PTI Post-Tensioning Institute
<http://www.post-tensioning.org>

RFCI The Resilient Floor Covering Institute
<http://www.rfci.com>

RIS Redwood Inspection Service
See - CRA

RMA Rubber Manufacturers Association, Inc.
<http://www.rma.org>

SCMA Southern Cypress Manufacturers Association
<http://www.cypressinfo.org>

SDI Steel Door Institute
<http://www.steeldoor.org>

IGMA Insulating Glass Manufacturers Alliance
<http://www.igmaonline.org>

SJI Steel Joist Institute
<http://www.steeljoist.org>

SMACNA Sheet Metal and Air-Conditioning Contractors
National Association, Inc.
<http://www.smacna.org>

SSPC The Society for Protective Coatings
<http://www.sspc.org>

STI Steel Tank Institute
<http://www.steeltank.com>

SWI Steel Window Institute
<http://www.steelwindows.com>

TCA Tile Council of America, Inc.
<http://www.tileusa.com>

TEMA Tubular Exchange Manufacturers Association
<http://www.tema.org>

TPI Truss Plate Institute, Inc.
583 D'Onofrio Drive; Suite 200
Madison, WI 53719
(608) 833-5900

UBC The Uniform Building Code
See ICBO

UL Underwriters' Laboratories Incorporated
<http://www.ul.com>

ULC Underwriters' Laboratories of Canada
<http://www.ulc.ca>

WCLIB West Coast Lumber Inspection Bureau
6980 SW Varns Road, P.O. Box 23145
Portland, OR 97223
(503) 639-0651

WRCLA Western Red Cedar Lumber Association
P.O. Box 120786
New Brighton, MN 55112
(612) 633-4334

WWPA Western Wood Products Association
<http://www.wwpa.org>

- - - E N D - - -

SECTION 01 57 19
TEMPORARY ENVIRONMENTAL CONTROLS**PART 1 - GENERAL****1.1 DESCRIPTION**

- A. This section specifies the control of environmental pollution and damage that the Contractor must consider for air, water, and land resources. It includes management of visual aesthetics, noise, solid waste, radiant energy, and radioactive materials, as well as other pollutants and resources encountered or generated by the Contractor. The Contractor is obligated to consider specified control measures with the costs included within the various contract items of work.
- B. Environmental pollution and damage is defined as the presence of chemical, physical, or biological elements or agents which:
 - 1. Adversely effect human health or welfare,
 - 2. Unfavorably alter ecological balances of importance to human life,
 - 3. Effect other species of importance to humankind, or;
 - 4. Degrade the utility of the environment for aesthetic, cultural, and historical purposes.
- C. Definitions of Pollutants:
 - 1. Chemical Waste: Petroleum products, bituminous materials, salts, acids, alkalis, herbicides, pesticides, organic chemicals, and inorganic wastes.
 - 2. Debris: Combustible and noncombustible wastes, such as leaves, tree trimmings, ashes, and waste materials resulting from construction or maintenance and repair work.
 - 3. Solid Waste: Rubbish, debris, garbage, and other discarded solid materials resulting from industrial, commercial, and agricultural operations and from community activities.
 - 4. Rubbish: Combustible and noncombustible wastes such as paper, boxes, glass and crockery, metal and lumber scrap, tin cans, and bones.
 - 5. Sanitary Wastes:
 - a. Sewage: Domestic sanitary sewage and human and animal waste.
 - b. Garbage: Refuse and scraps resulting from preparation, cooking, dispensing, and consumption of food.

1.2 QUALITY CONTROL

- A. Establish and maintain quality control for the environmental protection of all items set forth herein.
- B. Record on daily reports any problems in complying with laws, regulations, and ordinances. Note any corrective action taken.

1.3 REFERENCES

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referred to in the text by basic designation only.
- B. U.S. National Archives and Records Administration (NARA):
33 CFR 328Definitions

1.4 SUBMITTALS

- A. In accordance with Section, 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:
1. Environmental Protection Plan: After the contract is awarded and prior to the commencement of the work, the Contractor shall meet with the COTR to discuss the proposed Environmental Protection Plan and to develop mutual understanding relative to details of environmental protection. Not more than 20 days after the meeting, the Contractor shall prepare and submit to the COTR for approval, a written and/or graphic Environmental Protection Plan including, but not limited to, the following:
 - a. Name(s) of person(s) within the Contractor's organization who is (are) responsible for ensuring adherence to the Environmental Protection Plan.
 - b. Name(s) and qualifications of person(s) responsible for manifesting hazardous waste to be removed from the site.
 - c. Name(s) and qualifications of person(s) responsible for training the Contractor's environmental protection personnel.
 - d. Description of the Contractor's environmental protection personnel training program.
 - e. A list of Federal, State, and local laws, regulations, and permits concerning environmental protection, pollution control, noise control and abatement that are applicable to the Contractor's proposed operations and the requirements imposed by those laws, regulations, and permits.
 - f. Methods for protection of features to be preserved within authorized work areas including trees, shrubs, vines, grasses, ground cover, landscape features, air and water quality, fish and wildlife, soil, historical, and archeological and cultural resources.
 - g. Procedures to provide the environmental protection that comply with the applicable laws and regulations. Describe the procedures to correct pollution of the environment due to accident, natural causes, or failure to follow the procedures as described in the Environmental Protection Plan.
 - h. Permits, licenses, and the location of the solid waste disposal area.
 - i. Environmental Monitoring Plans for the job site including land, water, air, and noise.
 - j. Work Area Plan showing the proposed activity in each portion of the area and identifying the areas of limited use or nonuse. Plan should include measures for marking the limits of use areas. This plan may be incorporated within the Erosion Control Plan.
- B. Approval of the Contractor's Environmental Protection Plan will not relieve the Contractor of responsibility for adequate and continued control of pollutants and other environmental protection measures.

1.5 PROTECTION OF ENVIRONMENTAL RESOURCES

- A. Protect environmental resources within the project boundaries and those affected outside the limits of permanent work during the entire period of this contract. Confine activities to areas defined by the specifications and drawings.
- B. Protection of Land Resources: Prior to construction, identify all land resources to be preserved within the work area. Do not remove, cut, deface, injure, or destroy land resources including trees, shrubs, vines, grasses, top soil, and land forms without permission from the COTR. Do not fasten or attach ropes, cables, or guys to trees for anchorage unless specifically authorized, or where special emergency use is permitted.
 - 1. Work Area Limits: Prior to any construction, mark the areas that require work to be performed under this contract. Mark or fence isolated areas within the general work area that are to be saved and protected. Protect monuments, works of art, and markers before construction operations begin. Convey to all personnel the purpose of marking and protecting all necessary objects.
 - 2. Protection of Landscape: Protect trees, shrubs, vines, grasses, land forms, and other landscape features shown on the drawings to be preserved by marking, fencing, or using any other approved techniques.
 - a. Box and protect from damage existing trees and shrubs to remain on the construction site.
 - b. Immediately repair all damage to existing trees and shrubs by trimming, cleaning, and painting with antiseptic tree paint.
 - c. Do not store building materials or perform construction activities closer to existing trees or shrubs than the farthest extension of their limbs.
 - 3. Handle and dispose of solid wastes in such a manner that will prevent contamination of the environment. Place solid wastes (excluding clearing debris) in containers that are emptied on a regular schedule. Transport all solid waste off Government property and dispose of waste in compliance with Federal, State, and local requirements.
 - 4. Store chemical waste away from the work areas in corrosion resistant containers and dispose of waste in accordance with Federal, State, and local regulations.
 - 5. Handle discarded materials other than those included in the solid waste category as directed by the COTR.
- C. Protection of Water Resources: Keep construction activities under surveillance, management, and control to avoid pollution of surface and ground waters and sewer systems. Implement management techniques to control water pollution by the listed construction activities that are included in this contract.
 - 1. Washing and Curing Water: Do not allow wastewater directly derived from construction activities to enter water areas. Collect and place wastewater in retention ponds allowing the suspended material to settle, the pollutants to separate, or the water to evaporate.

2. Control movement of materials and equipment at stream crossings during construction to prevent violation of water pollution control standards of the Federal, State, or local government.
 3. Monitor water areas affected by construction.
- D. Protection of Air Resources: Keep construction activities under surveillance, management, and control to minimize pollution of air resources. Burning is not permitted on the job site. Keep activities, equipment, processes, and work operated or performed, in strict accordance with the State of Ohio and Federal emission and performance laws and standards. Maintain ambient air quality standards set by the Environmental Protection Agency, for those construction operations and activities specified.
1. Particulates: Control dust particles, aerosols, and gaseous by-products from all construction activities, processing, and preparation of materials (such as from asphaltic batch plants) at all times, including weekends, holidays, and hours when work is not in progress.
 2. Particulates Control: Maintain all excavations, stockpiles, haul roads, permanent and temporary access roads, plant sites, spoil areas, borrow areas, and all other work areas within or outside the project boundaries free from particulates which would cause a hazard or a nuisance. Sprinklering, chemical treatment of an approved type, light bituminous treatment, baghouse, scrubbers, electrostatic precipitators, or other methods are permitted to control particulates in the work area.
 3. Hydrocarbons and Carbon Monoxide: Control monoxide emissions from equipment to Federal and State allowable limits.
 4. Odors: Control odors of construction activities and prevent obnoxious odors from occurring.
- E. Reduction of Noise: Minimize noise using every action possible. Perform noise-producing work in less sensitive hours of the day or week as directed by the COTR. Maintain noise-produced work at or below the decibel levels and within the time periods specified.
1. Perform construction activities involving repetitive, high-level impact noise only between 8:00 a.m. and 6:00 p.m. unless otherwise permitted by local ordinance or the COTR. Repetitive impact noise on the property shall not exceed the following dB limitations:

| Time Duration of Impact Noise | Sound Level in dB |
|-------------------------------------|-------------------|
| More than 12 minutes in any hour | 70 |
| Less than 30 seconds of any hour | 85 |
| Less than three minutes of any hour | 80 |
| Less than 12 minutes of any hour | 75 |

2. Provide sound-deadening devices on equipment and take noise abatement measures that are necessary to comply with the requirements of this contract, consisting of, but not limited to, the following:

- a. Maintain maximum permissible construction equipment noise levels at 15 m (50 feet) (dBA):

| EARTHMOVING | | MATERIALS HANDLING | |
|---------------|----|--------------------|----|
| FRONT LOADERS | 75 | CONCRETE MIXERS | 75 |
| BACKHOES | 75 | CONCRETE PUMPS | 75 |
| TRACTORS | 75 | CRANES | 75 |
| TRUCKS | 75 | DERRICKS IMPACT | 75 |
| PUMPS | 75 | JACK HAMMERS | 75 |
| GENERATORS | 75 | PNEUMATIC TOOLS | 80 |
| COMPRESSORS | 75 | SAWS | 75 |
| | | VIBRATORS | 75 |

- b. Use shields or other physical barriers to restrict noise transmission.
- c. Provide soundproof housings or enclosures for noise-producing machinery.
- d. Use efficient silencers on equipment air intakes.
- e. Use efficient intake and exhaust mufflers on internal combustion engines that are maintained so equipment performs below noise levels specified.
- f. Line hoppers and storage bins with sound deadening material.
- g. Conduct truck loading, unloading, and hauling operations so that noise is kept to a minimum.
3. Measure sound level for noise exposure due to the construction at least once every five successive working days while work is being performed above 55 dB(A) noise level. Measure noise exposure at the property line or 15 m (50 feet) from the noise source, whichever is greater. Measure the sound levels on the A weighing network of a General Purpose sound level meter at slow response. To minimize the effect of reflective sound waves at buildings, take measurements at 900 to 1800 mm (three to six feet) in front of any building face. Submit the recorded information to the COTR noting any problems and the alternatives for mitigating actions.
- F. Restoration of Damaged Property: If any direct or indirect damage is done to public or private property resulting from any act, omission, neglect, or misconduct, the Contractor shall restore the damaged property to a condition equal to that existing before the damage at no additional cost to the Government. Repair, rebuild, or restore property as directed or make good such damage in an acceptable manner.
- G. Final Clean-up: On completion of project and after removal of all debris, rubbish, and temporary construction, Contractor shall leave the construction area in a clean condition satisfactory to the COTR. Cleaning shall include off the station disposal of all items and materials not required to be salvaged, as well as all debris and rubbish resulting from demolition and new work operations.

- - - E N D - - -

SECTION 01 91 00**GENERAL COMMISSIONING REQUIREMENTS****PART 1 - GENERAL****1.1 DESCRIPTION**

- A. This Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS shall form the basis of the construction phase commissioning process and procedures. The Commissioning Agent shall add, modify, and refine the commissioning procedures, as approved by the Department of Veterans Affairs (VA), to suit field conditions and actual manufacturer's equipment, incorporate test data and procedure results, and provide detailed scheduling for all commissioning tasks.
- B. Various sections of the project specifications require equipment startup, testing, and adjusting services. Requirements for startup, testing, and adjusting services specified in the Division 22 and Division 23 series sections of these specifications are intended to be provided in coordination with the commissioning services and are not intended to duplicate services. The Contractor shall coordinate the work required by individual specification sections with the commissioning services requirements specified herein.
- C. Where individual testing, adjusting, or related services are required in the project specifications and not specifically required by this commissioning requirements specification, the specified services shall be provided and copies of documentation, as required by those specifications shall be submitted to the VA and the Commissioning Agent to be indexed for future reference.
- D. Where training or educational services for VA are required and specified in other sections of the specifications, including but not limited to Division 22 and Division 23 series sections of the specification, these services are intended to be provided in addition to the training and educational services specified herein.
- E. Commissioning is a systematic process of verifying that the building systems perform interactively according to the construction documents and the VA's operational needs. The commissioning process shall encompass and coordinate the system documentation, equipment startup, control system calibration, testing and balancing, performance testing and training. Commissioning during the construction, and post-occupancy phases is intended to achieve the following specific objectives according to the contract documents:
 - 1. Verify that the applicable equipment and systems are installed in accordance with the contract documents and according to the manufacturer's recommendations.
 - 2. Verify and document proper integrated performance of equipment and systems.
 - 3. Verify that all components requiring servicing can be accessed, serviced and removed without disturbing nearby components including ducts, piping, cabling or wiring.
 - 4. Document the successful achievement of the commissioning objectives listed above.
- F. The commissioning process does not take away from or reduce the responsibility of the Contractor to provide a finished and fully functioning product.

1.2 CONTRACTUAL RELATIONSHIPS

- A. For this construction project, the Department of Veterans Affairs contracts with a Contractor to provide construction services. The contracts are administered by the VA Contracting Officer and the Contracting Officers Technical Representative (COTR) as the designated representative of the Contracting Officer. On this project, the authority to modify the contract in any way is strictly limited to the authority of the Contracting Officer and the COTR.
- B. In this structure, only two contract parties are recognized and communications on contractual issues are strictly limited to VA COTR and the Contractor. It is the practice of the VA to require that communications between other parties to the contracts (Subcontractors and Vendors) be conducted through the COTR and Contractor. It is also the practice of the VA that communications between other parties of the project (Commissioning Agent and Architect/Engineer) be conducted through the COTR.
- C. Whole Building Commissioning is a process that relies upon frequent and direct communications, as well as collaboration between all parties to the construction process. By its nature, a high level of communication and cooperation between the Commissioning Agent and all other parties (Architects, Engineers, Subcontractors, Vendors, third party testing agencies, etc) is essential to the success of the Commissioning effort.
- D. With these fundamental practices in mind, the commissioning process described herein has been developed to recognize that, in the execution of the Commissioning Process, the Commissioning Agent must develop effective methods to communicate with every member of the construction team involved in delivering commissioned systems while simultaneously respecting the exclusive contract authority of the Contracting Officer and COTR. Thus, the procedures outlined in this specification must be executed within the following limitations:
 - 1. No communications (verbal or written) from the Commissioning Agent shall be deemed to constitute direction that modifies the terms of any contract between the Department of Veterans Affairs and the Contractor.
 - 2. Commissioning Issues identified by the Commissioning Agent will be delivered to the COTR and copied to the designated Commissioning Representatives for the Contractor and subcontractors on the Commissioning Team for information only in order to expedite the communication process. These issues must be understood as the professional opinion of the Commissioning Agent and as suggestions for resolution.
 - 3. In the event that any Commissioning Issues and suggested resolutions are deemed by the COTR to require either an official interpretation of the construction documents or require a modification of the contract documents, the Contracting Officer or COTR will issue an official directive to this effect.
 - 4. All parties to the Commissioning Process shall be individually responsible for alerting the COTR of any issues that they deem to constitute a potential contract change prior to acting on these issues.

5. Authority for resolution or modification of design and construction issues rests solely with the Contracting Officer or COTR, with appropriate technical guidance from the Architect/Engineer and/or Commissioning Agent.

1.3 RELATED WORK

- A. Section 01 00 00 GENERAL REQUIREMENTS.
- B. Section 22 08 00 COMMISSIONING OF PLUMBING SYSTEMS.
- C. Section 23 08 00 COMMISSIONING OF HVAC SYSTEMS.

1.4 SUMMARY

- A. This Section includes general requirements that apply to implementation of commissioning without regard to systems, subsystems, and equipment being commissioned.
- B. The commissioning activities have been developed to support the VA requirements to meet guidelines for Federal Leadership in Environmental, Energy, and Economic Performance.
- C. The commissioning activities have been developed to support delivery of project performance in accordance with the VA requirements developed for the project.

1.5 DEFINITIONS

- A. Architect: Includes Architect identified in the Contract for Construction between the Department of Veterans Affairs and Contractor, plus consultant/design professionals responsible for design of plumbing, HVAC, controls for HVAC systems, electrical, as well as other related systems.
- B. CA: Commissioning Agent.
- C. Commissioning Plan: a document that is an overall plan that outlines the commissioning process, commissioning team responsibilities, schedule for commissioning activities, and commissioning documents.
- D. Commissioning Issue: a condition in the installation or function of a component, piece of equipment or system that affects the system operations, maintenance, and/or repair.
- E. Commissioning Observation: a condition in the installation or function of a component, piece of equipment or system that may not be in compliance with the Contract Documents, or may not be in compliance with the manufacturer's installation instruction, or may not be in compliance with generally accepted industry standards.
- F. Systems Functional Performance Test: a test, or tests, of the dynamic function and operation of equipment and systems using manual (direct observation) or monitoring methods. Systems Functional Performance Testing is the dynamic testing of systems (rather than just components) under full operation (e.g., the chiller pump is tested interactively with the chiller functions to see if the pump ramps up and down to maintain the differential pressure setpoint). Systems are tested under various modes, such as during low cooling or heating loads, high loads, component failures, unoccupied, varying outside air temperatures, fire alarm, power failure, etc. The systems are run through all the control system's sequences of operation and components are verified to be responding as the sequences state. Traditional air or water test and balancing (TAB) is not

Systems Functional Performance Testing, in the commissioning sense of the word. TAB's primary work is setting up the system flows and pressures as specified, while System Functional Performance Testing is verifying that the system has already been set up properly and is functioning in accordance with the Construction Documents. The Commissioning Agent develops the Systems Functional Performance Test Procedures in a sequential written form, coordinates, witnesses, and documents the actual testing. Systems Functional Performance Testing is performed by the Contractor. Systems Functional Performance Tests are performed after startups, control systems are complete and operational, TAB functions and Pre-Functional Checklists are complete.

- G. System: A system is defined as the entire set of components, equipment, and subsystems which must be coordinated to work together during normal operation to produce results for which the system is designed. For example, air conditioning supply air is only one component of an entire system which provides comfort conditions for a building. Other related components are return air, exhaust air, steam supply, chilled water supply, refrigerant supply, hot water supply, controls and electrical service, etc. Another example of a system which involves several components of different disciplines is a boiler installation. Efficient and acceptable boiler operation depends upon the coordination and proper operation of the fuel supply, combustion air, controls, steam, feedwater supply, condensate return and other related components.
- H. Pre-Functional Checklist: a list of items provided by the Commissioning Agent to the Contractor that require inspection and elementary component tests conducted to verify proper installation of equipment. Pre-Functional Checklists are primarily static inspections and procedures to prepare the equipment or system for initial operation (e.g., belt tension, oil levels OK, labels affixed, gages in place, sensors calibrated, etc.). However, some Pre-Functional Checklist items entail simple testing of the function of a component, a piece of equipment or system (such as measuring the voltage imbalance on a three-phase pump motor of a chiller system). The term "Pre-Functional" refers to before Systems Functional Performance Testing. Pre-Functional Checklists augment and are combined with the manufacturer's startup checklist and the Contractor's Quality Control checklists.
- I. Seasonal Functional Performance Testing: a test or tests that are deferred until the system will experience conditions closer to their design conditions.
- J. VA: Includes the Contracting Officer, COTR, or other authorized representative of the Department of Veterans Affairs.
- K. TAB: Testing, Adjusting, and Balancing.

1.6 SYSTEMS TO BE COMMISSIONED

- A. Commissioning of a system or systems specified for this project is part of the construction process. Documentation and testing of these systems, is required in cooperation with the VA and the Commissioning Agent.
- B. The following systems will be commissioned as part of this project:

1. Plumbing (Division 22)
 - a. Domestic Hot Water systems (instruments and gages, hot water circulating pumps and motors, controls).
2. HVAC (Division 23)
 - a. Heating Hot Water Systems (Steam to hot water converters and control valves, controls, instrumentation and gages, heating water pumps and motors, Variable Speed Drives, air terminal unit 3-way control valve operation, pump minimum flow bypass control valve operation).
 - b. Condensate Return Systems (automatic pump traps).
 - c. Steam System (Controls, gages and instrumentation, pressure reducing valves, steam meters, steam humidifiers, steam reheat coil controls, safety relief valves,).
 - d. Direct Digital Control System (BACnet or similar Local Area Network (LAN), Operator Work Station hardware and software, building controller hardware and software, all sequences of operation, system accuracy and response time).
 - e. HVAC Water Treatment Systems (Closed circuits – including shot feeders and final water analysis).

1.7 COMMISSIONING TEAM

- A. Members Appointed by Contractor:
 1. Contractor: The designated person, company, or entity that plans, schedules and coordinates the commissioning activities for the construction team.
 2. Contractor's Commissioning Representative(s): Individual(s), each having authority to act on behalf of the entity he or she represents, explicitly organized to implement the commissioning process through coordinated actions. The commissioning team shall consist of, but not be limited to, representatives of Contractor, including Project Superintendent and subcontractors, installers, suppliers, and specialists deemed appropriate by the Department of Veterans Affairs (VA) and Commissioning Agent.
- B. Members Appointed by VA:
 1. Commissioning Agent: The designated person, company, or entity that plans, schedules, and coordinates the commissioning team to implement the commissioning process. The VA will engage the CxA under a separate contract.
 2. Representatives of the facility user and operation and maintenance personnel.
 3. Architect and engineering design professionals.

1.8 VA'S COMMISSIONING RESPONSIBILITIES

- A. Appoint an individual, company or firm to act as the Commissioning Agent.
- B. Assign operation and maintenance personnel and schedule them to participate in commissioning team activities including, but not limited to, the following:
 1. Coordination meetings.
 2. Training in operation and maintenance of systems, subsystems, and equipment.

3. Testing meetings.
 4. Witness and assist in Systems Functional Performance Testing.
 5. Demonstration of operation of systems, subsystems, and equipment.
- C. Provide the Construction Documents, prepared by Architect and approved by VA, to the Commissioning Agent and for use in managing the commissioning process, developing the commissioning plan, systems manuals, and reviewing the operation and maintenance training plan.

1.9 CONTRACTOR'S COMMISSIONING RESPONSIBILITIES

- A. The Contractor shall assign a Commissioning Manager to manage commissioning activities of the Contractor, and subcontractors.
- B. The Contractor shall ensure that the commissioning responsibilities outlined in these specifications are included in all subcontracts and that subcontractors comply with the requirements of these specifications.
- C. The Contractor shall ensure that each installing subcontractor shall assign representatives with expertise and authority to act on behalf of the subcontractor and schedule them to participate in and perform commissioning team activities including, but not limited to, the following:
 1. Participate in commissioning coordination meetings.
 2. Conduct operation and maintenance training sessions in accordance with approved training plans.
 3. Verify that Work is complete and systems are operational according to the Contract Documents, including calibration of instrumentation and controls.
 4. Evaluate commissioning issues and commissioning observations identified in the Commissioning Issues Log, field reports, test reports or other commissioning documents. In collaboration with entity responsible for system and equipment installation, recommend corrective action.
 5. Review and comment on commissioning documentation.
 6. Participate in meetings to coordinate Systems Functional Performance Testing.
 7. Provide schedule for operation and maintenance data submittals, equipment startup, and testing to Commissioning Agent for incorporation into the commissioning plan.
 8. Provide information to the Commissioning Agent for developing commissioning plan.
 9. Participate in training sessions for VA's operation and maintenance personnel.
 10. Provide technicians who are familiar with the construction and operation of installed systems and who shall develop specific test procedures to conduct Systems Functional Performance Testing of installed systems.

1.10 COMMISSIONING AGENT'S RESPONSIBILITIES

- A. Organize and lead the commissioning team.
- B. Prepare the commissioning plan. See Paragraph 1.11-A of this specification Section for further information.

- C. Review and comment on selected submittals from the Contractor for general conformance with the Construction Documents. Review and comment on the ability to test and operate the system and/or equipment, including providing gages, controls and other components required to operate, maintain, and test the system. Review and comment on performance expectations of systems and equipment and interfaces between systems relating to the Construction Documents.
- D. At the beginning of the construction phase, conduct an initial construction phase coordination meeting for the purpose of reviewing the commissioning activities and establishing tentative schedules for TAB Work; Pre-Functional Checklists, Systems Functional Performance Testing; and project completion.
- E. Convene commissioning team meetings for the purpose of coordination, communication, and conflict resolution; discuss status of the commissioning processes. Responsibilities include arranging for facilities, preparing agenda and attendance lists, and notifying participants. The Commissioning Agent shall prepare and distribute minutes to commissioning team members and attendees within five workdays of the commissioning meeting.
- F. Observe construction and report progress, observations and issues. Observe systems and equipment installation for adequate accessibility for maintenance and component replacement or repair, and for general conformance with the Construction Documents.
- G. Prepare Project specific Pre-Functional Checklists and Systems Functional Performance Test procedures.
- H. Coordinate Systems Functional Performance Testing schedule with the Contractor.
- I. Witness selected systems startups.
- J. Verify selected Pre-Functional Checklists completed and submitted by the Contractor.
- K. Witness and document Systems Functional Performance Testing.
- L. Compile test data, inspection reports, and certificates and include them in the systems manual and commissioning report.
- M. Prepare commissioning Field Observation Reports.
- N. Prepare the Final Commissioning Report.
- O. Return to the site at 10 months into the 12 month warranty period and review with facility staff the current building operation and the condition of outstanding issues related to the original and seasonal Systems Functional Performance Testing. Also interview facility staff and identify problems or concerns they have operating the building as originally intended. Identify areas that may come under warranty or under the original construction contract. Assist facility staff in developing reports, documents and requests for services to remedy outstanding problems.
- P. Assemble the final commissioning documentation, including the Final Commissioning Report and Addendum to the Final Commissioning Report.

1.11 COMMISSIONING DOCUMENTATION

- A. Commissioning Plan: A document, prepared by Commissioning Agent, that outlines the schedule, allocation of resources, and documentation requirements of the commissioning process, and shall include, but is not limited, to the following:
1. Plan for delivery and review of submittals, systems manuals, and other documents and reports. Identification of the relationship of these documents to other functions and a detailed description of submittals that are required to support the commissioning processes. Submittal dates shall include the latest date approved submittals must be received without adversely affecting commissioning plan.
 2. Description of the organization, layout, and content of commissioning documentation (including systems manual) and a detailed description of documents to be provided along with identification of responsible parties.
 3. Identification of systems and equipment to be commissioned.
 4. Schedule of Commissioning Coordination meetings.
 5. Identification of items that must be completed before the next operation can proceed.
 6. Description of responsibilities of commissioning team members.
 7. Description of observations to be made.
 - 8.
 9. Schedule for commissioning activities with dates coordinated with overall construction schedule.
 10. Process and schedule for documenting changes on a continuous basis to appear in Project Record Documents.
 11. Process and schedule for completing prestart and startup checklists for systems, subsystems, and equipment to be verified and tested.
 12. Preliminary Systems Functional Performance Test procedures.
- B. Systems Functional Performance Test Procedures: The Commissioning Agent will develop Systems Functional Performance Test Procedures for each system to be commissioned, including subsystems, or equipment and interfaces or interlocks with other systems. Systems Functional Performance Test Procedures will include a separate entry, with space for comments, for each item to be tested. Preliminary Systems Functional Performance Test Procedures will be provided to the VA, Architect/Engineer, and Contractor for review and comment. The Systems Performance Test Procedure will include test procedures for each mode of operation and provide space to indicate whether the mode under test responded as required. Each System Functional Performance Test procedure, regardless of system, subsystem, or equipment being tested, shall include, but not be limited to, the following:
1. Name and identification code of tested system.
 2. Test number.
 3. Time and date of test.

4. Indication of whether the record is for a first test or retest following correction of a problem or issue.
 5. Dated signatures of the person(s) performing test and of the witness, if applicable.
 6. Individuals present for test.
 7. Observations and Issues.
 8. Issue number, if any, generated as the result of test.
- C. Pre-Functional Checklists: The Commissioning Agent will prepare *Pre-Functional Checklists*. *Pre-Functional Checklists shall be completed* and signed by the Contractor, verifying that systems, subsystems, equipment, and associated controls are ready for testing. The Commissioning Agent will spot check Pre-Functional Checklists to verify accuracy and readiness for testing. Inaccurate or incomplete Pre-Functional Checklists shall be returned to the Contractor for correction and resubmission.
- D. Test and Inspection Reports: The Commissioning Agent will record test data, observations, and measurements on Systems Functional Performance Test Procedure. The report will also include recommendation for system acceptance or non-acceptance. Photographs, forms, and other means appropriate for the application shall be included with data. Commissioning Agent will compile test and inspection reports and test and inspection certificates and include them in systems manual and commissioning report.
- E. Corrective Action Documents: The Commissioning Agent will document corrective action taken for systems and equipment that fail tests. The documentation will include any required modifications to systems and equipment and/or revisions to test procedures, if any. The Commissioning Agent will witness and document any retesting of systems and/or equipment requiring corrective action and document retest results.
- F. Commissioning Issues Log: The Commissioning Agent will prepare and maintain Commissioning Issues Log that describes Commissioning Issues and Commissioning Observations that are identified during the Commissioning process. These observations and issues include, but are not limited to, those that are at variance with the Contract Documents. The Commissioning Issues Log will identify and track issues as they are encountered, the party responsible for resolution, progress toward resolution, and document how the issue was resolved. The Master Commissioning Issues Log will also track the status of unresolved issues.
1. Creating an Commissioning Issues Log Entry:
 - a. Identify the issue with unique numeric or alphanumeric identifier by which the issue may be tracked.
 - b. Assign a descriptive title for the issue.
 - c. Identify date and time of the issue.
 - d. Identify test number of test being performed at the time of the observation, if applicable, for cross reference.
 - e. Identify system, subsystem, and equipment to which the issue applies.

- f. Identify location of system, subsystem, and equipment.
 - g. Include information that may be helpful in diagnosing or evaluating the issue.
 - h. Note recommended corrective action.
 - i. Identify commissioning team member responsible for corrective action.
 - j. Identify expected date of correction.
 - k. Identify person that identified the issue.
2. Documenting Issue Resolution:
- a. Log date correction is completed or the issue is resolved.
 - b. Describe corrective action or resolution taken. Include description of diagnostic steps taken to determine root cause of the issue, if any.
 - c. Identify changes to the Contract Documents that may require action.
 - d. State that correction was completed and system, subsystem, and equipment are ready for retest, if applicable.
 - e. Identify person(s) who corrected or resolved the issue.
 - f. Identify person(s) verifying the issue resolution.
- G. Final Commissioning Report: The Commissioning Agent will document results of the commissioning process, including unresolved issues, and performance of systems, subsystems, and equipment. The Commissioning Report will indicate whether systems, subsystems, and equipment have been properly installed and are performing according to the Contract Documents. This report will be used by the Department of Veterans Affairs when determining that systems will be accepted. This report will be used to evaluate systems, subsystems, and equipment and will serve as a future reference document during VA occupancy and operation. It shall describe components and performance that exceed requirements of the Contract Documents and those that do not meet requirements of the Contract Documents. The commissioning report will include, but is not limited to, the following:
- 1. Lists and explanations of substitutions; compromises; variances with the Contract Documents; record of conditions; and, if appropriate, recommendations for resolution. Design Narrative documentation maintained by the Commissioning Agent.
 - 2. Commissioning plan.
 - 3. Pre-Functional Checklists completed by the Contractor, with annotation of the Commissioning Agent review and spot check.
 - 4. Systems Functional Performance Test Procedures, with annotation of test results and test completion.
 - 5. Commissioning Issues Log.
 - 6. Listing of deferred and off season test(s) not performed, including the schedule for their completion.
- H. Addendum to Final Commissioning Report: The Commissioning Agent will prepare an Addendum to the Final Commissioning Report near the end of the Warranty Period. The Addendum will

indicate whether systems, subsystems, and equipment are complete and continue to perform according to the Contract Documents. The Addendum to the Final Commissioning Report shall include, but is not limited to, the following:

1. Documentation of deferred and off season test(s) results.
2. Completed Systems Functional Performance Test Procedures for off season test(s).
3. Documentation that unresolved system performance issues have been resolved.
4. Updated Commissioning Issues Log, including status of unresolved issues.
5. Identification of potential Warranty Claims to be corrected by the Contractor.

1.12 SUBMITTALS

- A. Preliminary Commissioning Plan Submittal: The Commissioning Agent shall prepare a Preliminary Commissioning Plan based on the final Construction Documents. The Preliminary Commissioning Plan shall include information about the following commissioning activities:
1. The Commissioning Team: A list of commissioning team members by organization.
 2. Systems to be commissioned. A detailed list of systems to be commissioned for the project. This list also provides preliminary information on systems/equipment submittals to be reviewed by the Commissioning Agent; preliminary information on Pre-Functional Checklists that are to be completed; preliminary information on Systems Performance Testing, including information on testing sample size (where authorized by the VA).
 3. Commissioning Team Roles and Responsibilities: Preliminary roles and responsibilities for each Commissioning Team member.
 4. Commissioning Documents: A preliminary list of commissioning-related documents, include identification of the parties responsible for preparation, review, approval, and action on each document.
 5. Commissioning Activities Schedule: Identification of Commissioning Activities, including Systems Functional Testing, the expected duration and predecessors for the activity.
 6. Pre-Functional Checklists: Preliminary Pre-Functional Checklists for equipment, components, subsystems, and systems to be commissioned. These Preliminary Pre-Functional Checklists provide guidance on the level of detailed information the Contractor shall include on the final submission.
 7. Systems Functional Performance Test Procedures: Preliminary step-by-step System Functional Performance Test Procedures to be used during Systems Functional Performance Testing. These Preliminary Systems Functional Performance procedures provide information on the level of testing rigor, and the level of Contractor support required during performance of system's testing.
- B. Final Commissioning Plan Submittal: Based on the Final Construction Documents and the Contractor's project team, the Commissioning Agent will prepare the Final Commissioning Plan as described in this section. The Commissioning Agent will submit three hard copies and three sets of electronic files of Final Commissioning Plan. The Contractor shall review the Commissioning

Plan and provide any comments to the VA. The Commissioning Agent will incorporate review comments into the Final Commissioning Plan as directed by the VA.

- C. Systems Functional Performance Test Procedure: The Commissioning Agent will submit preliminary Systems Functional Performance Test Procedures to the Contractor, and the VA for review and comment. The Contractor shall return review comments to the VA and the Commissioning Agent. The VA will also return review comments to the Commissioning Agent. The Commissioning Agent will incorporate review comments into the Final Systems Functional Test Procedures to be used in Systems Functional Performance Testing.
- D. Pre-Functional Checklists: The Commissioning Agent will submit Pre-Functional Checklists to be completed by the Contractor.
- E. Test and Inspection Reports: The Commissioning Agent will submit test and inspection reports to the VA with copies to the Contractor and the Architect/Engineer.
- F. Corrective Action Documents: The Commissioning Agent will submit corrective action documents to the VA Project Engineer with copies to the Contractor and Architect.
- G. Preliminary Commissioning Report Submittal: The Commissioning Agent will submit three electronic copies of the preliminary commissioning report. One electronic copy, with review comments, will be returned to the Commissioning Agent for preparation of the final submittal.
- H. Final Commissioning Report Submittal: The Commissioning Agent will submit four sets of electronically formatted information of the final commissioning report to the VA. The final submittal will incorporate comments as directed by the VA.
- I. Data for Commissioning:
 - 1. The Commissioning Agent will request in writing from the Contractor specific information needed about each piece of commissioned equipment or system to fulfill requirements of the Commissioning Plan.
 - 2. The Commissioning Agent may request further documentation as is necessary for the commissioning process or to support other VA data collection requirements, including Construction Operations Building Information Exchange (COBIE), Building Information Modeling (BIM), etc.

1.13 COMMISSIONING PROCESS

- A. The Commissioning Agent will be responsible for the overall management of the commissioning process as well as coordinating scheduling of commissioning tasks with the VA and the Contractor. As directed by the VA, the Contractor shall incorporate Commissioning tasks, including, but not limited to, Systems Functional Performance Testing (including predecessors) with the Master Construction Schedule.
- B. Within 30 days of contract award, the Contractor shall designate a specific individual as the Commissioning Manager (CM) to manage and lead the commissioning effort on behalf of the Contractor. The Commissioning Manager shall be the single point of contact and communications for all commissioning related services by the Contractor.

- C. Within 30 days of contract award, the Contractor shall ensure that each subcontractor designates specific individuals as Commissioning Representatives (CR) to be responsible for commissioning related tasks. The Contractor shall ensure the designated Commissioning Representatives participate in the commissioning process as team members providing commissioning testing services, equipment operation, adjustments, and corrections if necessary. The Contractor shall ensure that all Commissioning Representatives shall have sufficient authority to direct their respective staff to provide the services required, and to speak on behalf of their organizations in all commissioning related contractual matters.

1.14 QUALITY ASSURANCE

- A. Instructor Qualifications: Factory authorized service representatives shall be experienced in training, operation, and maintenance procedures for installed systems, subsystems, and equipment.
- B. Test Equipment Calibration: The Contractor shall comply with test equipment manufacturer's calibration procedures and intervals. Recalibrate test instruments immediately whenever instruments have been repaired following damage or dropping. Affix calibration tags to test instruments. Instruments shall have been calibrated within six months prior to use.

1.15 COORDINATION

- A. Management: The Commissioning Agent will coordinate the commissioning activities with the VA and Contractor. The Commissioning Agent will submit commissioning documents and information to the VA. All commissioning team members shall work together to fulfill their contracted responsibilities and meet the objectives of the contract documents.
- B. Scheduling: The Contractor will work with the Commissioning Agent and the VA to incorporate the commissioning activities into the construction schedule. The Commissioning Agent will provide sufficient information on commissioning activities to allow the Contractor and the VA to schedule commissioning activities. All parties shall address scheduling issues and make necessary notifications in a timely manner in order to expedite the project and the commissioning process. The Contractor shall update the Master Construction Schedule as directed by the VA.
- C. Initial Schedule of Commissioning Events: The Commissioning Agent will provide the initial schedule of primary commissioning events in the Commissioning Plan and at the commissioning coordination meetings. The Commissioning Plan will provide a format for this schedule. As construction progresses, more detailed schedules will be developed by the Contractor with information from the Commissioning Agent.
- D. Commissioning Coordinating Meetings: The Commissioning Agent will conduct periodic Commissioning Coordination Meetings of the commissioning team to review status of commissioning activities, to discuss scheduling conflicts, and to discuss upcoming commissioning process activities.
- E. Pretesting Meetings: The Commissioning Agent will conduct pretest meetings of the commissioning team to review startup reports, Pre-Functional Checklist results, Systems

Functional Performance Testing procedures, testing personnel and instrumentation requirements.

- F. Systems Functional Performance Testing Coordination: The Contractor shall coordinate testing activities to accommodate required quality assurance and control services with a minimum of delay and to avoid necessity of removing and replacing construction to accommodate testing and inspecting. The Contractor shall coordinate the schedule times for tests, inspections, obtaining samples, and similar activities.

PART 2 - PRODUCTS

2.1 TEST EQUIPMENT

- A. The Contractor shall provide all standard and specialized testing equipment required to perform Systems Functional Performance Testing. Test equipment required for Systems Functional Performance Testing will be identified in the detailed System Functional Performance Test Procedure prepared by the Commissioning Agent.
- B. Data logging equipment and software required to test equipment shall be provided by the Contractor.
- C. All testing equipment shall be of sufficient quality and accuracy to test and/or measure system performance with the tolerances specified in the Specifications. If not otherwise noted, the following minimum requirements apply: Temperature sensors and digital thermometers shall have a certified calibration within the past year to an accuracy of 0.5 °C (1.0 °F) and a resolution of + or - 0.1 °C (0.2 °F). Pressure sensors shall have an accuracy of + or - 2.0% of the value range being measured (not full range of meter) and have been calibrated within the last year. All equipment shall be calibrated according to the manufacturer's recommended intervals and when dropped or damaged. Calibration tags shall be affixed or certificates readily available.

PART 3 - EXECUTION

3.1 STARTUP, INITIAL CHECKOUT, AND PRE-FUNCTIONAL CHECKLISTS

- A. The following procedures shall apply to all equipment and systems to be commissioned, according to Part 1, Systems to Be Commissioned.
1. Pre-Functional Checklists are important to ensure that the equipment and systems are hooked up and operational. These ensure that Systems Functional Performance Testing may proceed without unnecessary delays. Each system to be commissioned shall have a full Pre-Functional Checklist completed by the Contractor prior to Systems Functional Performance Testing. No sampling strategies are used.
- a. The Pre-Functional Checklist will identify the trades responsible for completing the checklist. The Contractor shall ensure the appropriate trades complete the checklists.
- b. The Commissioning Agent will review completed Pre-Functional Checklists and field-verify the accuracy of the completed checklist using sampling techniques.

2. Startup and Initial Checkout Plan: The Contractor shall develop detailed startup plans for all equipment. The primary role of the Contractor in this process is to ensure that there is written documentation that each of the manufacturer recommended procedures have been completed. Parties responsible for startup shall be identified in the Startup Plan and in the checklist forms.
 - a. The Contractor shall develop the full startup plan by combining (or adding to) the checklists with the manufacturer's detailed startup and checkout procedures from the O&M manual data and the field checkout sheets normally used by the Contractor. The plan shall include checklists and procedures with specific boxes or lines for recording and documenting the checking and inspections of each procedure and a summary statement with a signature block at the end of the plan.
 - b. The full startup plan shall at a minimum consist of the following items:
 - 1) The Pre-Functional Checklists.
 - 2) The manufacturer's standard written startup procedures copied from the installation manuals with check boxes by each procedure and a signature block added by hand at the end.
 - 3) The manufacturer's normally used field checkout sheets.
 - a) The Commissioning Agent will submit the full startup plan to the VA and Contractor for review. Final approval will be by the VA.
 - b) The Contractor shall review and evaluate the procedures and the format for documenting them, noting any procedures that need to be revised or added.
3. Sensor and Actuator Calibration
 - a. All field installed temperature, relative humidity, CO₂ and pressure sensors and gages, and all actuators (dampers and valves) on all equipment shall be calibrated using the methods described in Division 22 and Division 23 specifications.
 - b. All procedures used shall be fully documented on the Pre-Functional Checklists or other suitable forms, clearly referencing the procedures followed and written documentation of initial, intermediate and final results.
4. Execution of Equipment Startup
 - a. Four weeks prior to equipment startup, the Contractor shall schedule startup and checkout with the VA and Commissioning Agent. The performance of the startup and checkout shall be directed and executed by the Contractor.
 - b. The Commissioning Agent will observe the startup procedures for selected pieces of primary equipment.
 - c. The Contractor shall execute startup and provide the VA and Commissioning Agent with a signed and dated copy of the completed startup checklists, and contractor tests.

- d. Only individuals that have direct knowledge and witnessed that a line item task on the Startup Checklist was actually performed shall initial or check that item off. It is not acceptable for witnessing supervisors to fill out these forms.

3.2 DEFICIENCIES, NONCONFORMANCE, AND APPROVAL IN CHECKLISTS AND STARTUP

- A. The Contractor shall clearly list any outstanding items of the initial startup and Pre-Functional Checklist procedures that were not completed successfully, at the bottom of the procedures form or on an attached sheet. The procedures form and any outstanding deficiencies shall be provided to the VA and the Commissioning Agent within two days of completion.
- B. The Commissioning Agent will review the report and submit comments to the VA. The Commissioning Agent will work with the Contractor to correct and verify deficiencies or uncompleted items. The Commissioning Agent will involve the VA and others as necessary. The Contractor shall correct all areas that are noncompliant or incomplete in the checklists in a timely manner, and shall notify the VA and Commissioning Agent as soon as outstanding items have been corrected. The Contractor shall submit an updated startup report and a Statement of Correction on the original noncompliance report. When satisfactorily completed, the Commissioning Agent will recommend approval of the checklists and startup of each system to the VA.
- C. The Contractor shall be responsible for resolution of deficiencies as directed the VA.

3.3 PHASED COMMISSIONING

- A. The project may require startup and initial checkout to be executed in phases. This phasing shall be planned and scheduled in a coordination meeting of the VA, Commissioning Agent, and the Contractor. Results will be added to the master construction schedule and the commissioning schedule.

3.4 TRENDING AND ALARMS

- A. Trending is a method of testing as a standalone method or to augment manual testing. The Contractor shall trend any and all points of the system or systems at intervals specified below.
- B. Alarms are a means to notify the system operator that abnormal conditions are present in the system. Alarms shall be structured into three tiers – Critical, Priority, and Maintenance.
 - 1. Critical alarms are intended to be alarms that require the immediate attention of and action by the Operator. These alarms shall be displayed on the Operator Workstation in a popup style window that is graphically linked to the associated unit's graphical display. The popup style window shall be displayed on top of any active window within the screen, including non DDC system software.
 - 2. Priority level alarms are to be printed to a printer which is connected to the Operator's Work Station located within the engineer's office. Additionally Priority level alarms shall be able to be monitored and viewed through an active alarm application. Priority level alarms are alarms

- which shall require reaction from the operator or maintenance personnel within a normal work shift, and not immediate action.
3. Maintenance alarms are intended to be minor issues which would require examination by maintenance personnel within the following shift. These alarms shall be generated in a scheduled report automatically by the DDC system at the start of each shift. The generated maintenance report will be printed to a printer located within the engineer's office.
 - C. The Contractor shall provide a wireless internet network in the building for use during controls programming, checkout, and commissioning. This network will allow project team members to more effectively program, view, manipulate and test control devices while being in the same room as the controlled device.
 - D. The Contractor shall provide graphical trending through the DDC control system of systems being commissioned. Trending requirements are indicated below and included with the Systems Functional Performance Test Procedures. Trending shall occur before, during and after Systems Functional Performance Testing. The Contractor shall be responsible for producing graphical representations of the trended DDC points that show each system operating properly during steady state conditions as well as during the System Functional Testing. These graphical reports shall be submitted to the COTR and Commissioning Agent for review and analysis before, during dynamic operation, and after Systems Functional Performance Testing. The Contractor shall provide, but not limited to, the following trend requirements and trend submissions:
 1. Pre-testing, Testing, and Post-testing – Trend reports of trend logs and graphical trend plots are required as defined by the Commissioning Agent. The trend log points, sampling rate, graphical plot configuration, and duration will be dictated by the Commissioning Agent. At any time during the Commissioning Process the Commissioning Agent may recommend changes to aspects of trending as deemed necessary for proper system analysis. The Contractor shall implement any changes as directed by the COTR. Any pre-test trend analysis comments generated by the Commissioning Team should be addressed and resolved by the Contractor, as directed by the COTR, prior to the execution of Systems Functional Performance Testing.
 2. Dynamic plotting – The Contractor shall also provide dynamic plotting during Systems Functional Performance testing at frequent intervals for points determined by the Systems Functional Performance Test Procedure. The graphical plots will be formatted and plotted at durations listed in the Systems Functional Performance Test Procedure.
 3. Graphical plotting - The graphical plots shall be provided with a dual y-axis allowing 15 or more trend points (series) plotted simultaneously on the graph with each series in distinct color. The plots will further require title, axis naming, legend etc. all described by the Systems Functional Performance Test Procedure. If this cannot be sufficiently accomplished directly in the Direct Digital Control System, then it is the responsibility of the Contractor to plot these trend logs in Microsoft Excel.

4. The following tables indicate the points to be trended and alarmed by system. These are Master VA Tables and have not been specifically edited for this project. Refer to the Division 22 and 23 drawings and specifications for specific systems and equipment associated with this project. The Operational Trend Duration column indicates the trend duration for normal operations. The Testing Trend Duration column indicates the trend duration prior to Systems Functional Performance Testing and again after Systems Functional Performance Testing. The Type column indicates point type: AI = Analog Input, AO = Analog Output, DI = Digital Input, DO = Digital Output, Calc = Calculated Point. In the Trend Interval Column, COV = Change of Value. The Alarm Type indicates the alarm priority; C = Critical, P = Priority, and M = Maintenance. The Alarm Range column indicates when the point is considered in the alarm state. The Alarm Delay column indicates the length of time the point must remain in an alarm state before the alarm is recorded in the DDC. The intent is to allow minor, short-duration events to be corrected by the DDC system prior to recording an alarm.

| Dual-Path Air Handling Unit Trending and Alarms | | | | | | | |
|---|------|----------------|----------------------------|------------------------|------------|--------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| OA Temperature | AI | 15 Min | 24 hours | 3 days | N/A | | |
| RA Temperature | AI | 15 Min | 24 hours | 3 days | N/A | | |
| RA Humidity | AI | 15 Min | 24 hours | 3 days | P | >60% RH | 10 min |
| Mixed Air Temp | AI | None | None | None | N/A | | |
| SA Temp | AI | 15 Min | 24 hours | 3 days | C | ±5°F from SP | 10 min |
| Supply Fan Speed | AI | 15 Min | 24 hours | 3 days | N/A | | |
| Return Fan Speed | AI | 15 Min | 24 hours | 3 days | N/A | | |
| RA Pre-Filter Status | AI | None | None | None | N/A | | |
| OA Pre-Filter Status | AI | None | None | None | N/A | | |
| After Filter Status | AI | None | None | None | N/A | | |
| SA Flow | AI | 15 Min | 24 hours | 3 days | C | ±10% from SP | 10 min |
| OA Supply Temp | AI | 15 Min | 24 hours | 3 days | P | ±5°F from SP | 10 min |
| RA Supply Temp | AI | 15 Min | 24 hours | 3 days | N/A | | |
| RA CHW Valve Position | AI | 15 Min | 24 hours | 3 days | N/A | | |
| OA CHW Valve Position | AI | 15 Min | 24 hours | 3 days | N/A | | |
| OA HW Valve Position | AI | 15 Min | 24 hours | 3 days | N/A | | |
| OA Flow | AI | 15 Min | 24 hours | 3 days | P | ±10% from SP | 5 min |

| Dual-Path Air Handling Unit Trending and Alarms | | | | | | | |
|---|------|----------------|----------------------------|------------------------|------------|-------------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| RA Flow | AI | 15 Min | 24 hours | 3 days | P | ±10% from SP | 5 min |
| Initial UVC Intensity (%) | AI | None | None | None | N/A | | |
| Duct Pressure | AI | 15 Min | 24 hours | 3 days | C | ±25% from SP | 6 min |
| CO2 Level | AI | 15 Min | 24 hours | 3 days | P | ±10% from SP | 10 min |
| | | | | | | | |
| Supply Fan Status | DI | COV | 24 hours | 3 days | C | Status <> Command | 10 min |
| Return Fan Status | DI | COV | 24 hours | 3 days | C | Status <> Command | 10 Min |
| High Static Status | DI | COV | 24 hours | 3 days | P | True | 1 min |
| Fire Alarm Status | DI | COV | 24 hours | 3 days | C | True | 5 min |
| Freeze Stat Level 1 | DI | COV | 24 hours | 3 days | C | True | 10 min |
| Freeze Stat Level 2 | DI | COV | 24 hours | 3 days | C | True | 5 min |
| Freeze Stat Level 3 | DI | COV | 24 hours | 3 days | P | True | 1 min |
| Fire/Smoke Damper Status | DI | COV | 24 hours | 3 days | P | Closed | 1 min |
| Emergency AHU Shutdown | DI | COV | 24 hours | 3 days | P | True | 1 min |
| Exhaust Fan #1 Status | DI | COV | 24 hours | 3 days | C | Status <> Command | 10 min |
| Exhaust Fan #2 Status | DI | COV | 24 hours | 3 days | C | Status <> Command | 10 min |
| Exhaust Fan #3 Status | DI | COV | 24 hours | 3 days | C | Status <> Command | 10 min |
| OA Alarm | DI | COV | 24 hours | 3 days | C | True | 10 min |
| High Static Alarm | DI | COV | 24 hours | 3 days | C | True | 10 min |
| UVC Emitter Alarm | DI | COV | 24 hours | 3 days | P | True | 10 min |
| CO2 Alarm | DI | COV | 24 hours | 3 days | P | True | 10 min |
| Power Failure | DI | COV | 24 hours | 3 days | P | True | 1 min |
| | | | | | | | |
| Supply Fan Speed | AO | 15 Min | 24 hours | 3 days | N/A | | |
| Return Fan Speed | AO | 15 Min | 24 hours | 3 days | N/A | | |
| RA CHW Valve Position | AO | 15 Min | 24 hours | 3 days | N/A | | |
| OA CHW Valve Position | AO | 15 Min | 24 hours | 3 days | N/A | | |
| OA HW Valve Position | AO | 15 Min | 24 hours | 3 days | N/A | | |

| Dual-Path Air Handling Unit Trending and Alarms | | | | | | | |
|---|------|----------------|----------------------------|------------------------|------------|-------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| Supply Fan S/S | DO | COV | 24 hours | 3 days | N/A | | |
| Return Fan S/S | DO | COV | 24 hours | 3 days | N/A | | |
| Fire/Smoke Dampers | DO | COV | 24 hours | 3 days | N/A | | |
| Exhaust Fan S/S | DO | COV | 24 hours | 3 days | N/A | | |
| Exhaust Fan S/S | DO | COV | 24 hours | 3 days | N/A | | |
| Exhaust Fan S/S | DO | COV | 24 hours | 3 days | N/A | | |
| | | | | | | | |
| AHU Energy | Calc | 1 Hour | 30 day | N/A | N/A | | |
| | | | | | | | |

| Terminal Unit (VAV, CAV, etc.) Trending and Alarms | | | | | | | |
|--|------|----------------|----------------------------|------------------------|------------|---------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| Space Temperature | AI | 15 Min | 12 hours | 3 days | P | ±5°F from SP | 10 min |
| Air Flow | AI | 15 Min | 12 hours | 3 days | P | ±5°F from SP | 10 min |
| SA Temperature | AI | 15 Min | 12 hours | 3 days | P | ±5°F from SP | 10 min |
| Local Setpoint | AI | 15 Min | 12 hours | 3 days | M | ±10°F from SP | 60 min |
| Space Humidity | AI | 15 Min | 12 hours | 3 days | P | > 60% RH | 5 min |
| | | | | | | | |
| Unoccupied Override | DI | COV | 12 hours | 3 days | M | N/A | 12 Hours |
| Refrigerator Alarm | DI | COV | 12 hours | 3 days | C | N/A | 10 min |
| | | | | | | | |
| Damper Position | AO | 15 Minutes | 12 hours | 3 days | N/A | | |
| Heating coil Valve Position | AO | 15 Minutes | 12 hours | 3 days | N/A | | |

| 4-Pipe Fan Coil Trending and Alarms | | | | | | | |
|-------------------------------------|------|----------------|----------------------------|------------------------|------------|-------------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| Space Temperature | AI | 15 Minutes | 12 hours | 3 days | P | ±5°F from SP | 10 min |
| SA Temperature | AI | 15 Minutes | 12 hours | 3 days | P | ±5°F from SP | 10 min |
| Pre-Filter Status | AI | None | None | None | M | > SP | 1 hour |
| | | | | | | | |
| Water Sensor | DI | COV | 12 hours | 3 days | M | N/A | 30 Min |
| | | | | | | | |
| Cooling Coil Valve Position | AO | 15 Minutes | 12 hours | 3 days | N/A | | |
| Heating coil Valve Position | AO | 15 Minutes | 12 hours | 3 days | N/A | | |
| Fan Coil ON/OFF | DO | COV | 12 hours | 3 days | M | Status <> Command | 30 min |

| 2-Pipe Fan Coil Unit Trending and Alarms | | | | | | | |
|--|------|----------------|----------------------------|------------------------|------------|-------------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| Space Temperature | AI | 15 Minutes | 12 hours | 3 days | P | ±5°F from SP | 10 min |
| SA Temperature | AI | 15 Minutes | 12 hours | 3 days | P | ±5°F from SP | 10 min |
| Pre-Filter Status | AI | None | None | None | M | > SP | 1 hour |
| | | | | | | | |
| Water Sensor | DI | COV | 12 hours | 3 days | M | N/A | 30 Min |
| | | | | | | | |
| Cooling Coil Valve Position | AO | 15 Minutes | 12 hours | 3 days | N/A | | |
| Fan Coil ON/OFF | DO | COV | 12 hours | 3 days | M | Status <> Command | 30 min |

| Unit Heater Trending and Alarms | | | | | | | |
|---------------------------------|------|----------------|----------------------------|------------------------|------------|--------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| Space Temperature | AI | 15 Minutes | 12 hours | 3 days | P | ±5°F from SP | 10 min |

| Unit Heater Trending and Alarms | | | | | | | |
|---------------------------------|------|----------------|----------------------------|------------------------|------------|-------------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| Heating Valve Position | AO | 15 Minutes | 12 hours | 3 days | N/A | | |
| Unit Heater ON/OFF | DO | COV | 12 hours | 3 days | M | Status <> Command | 30 min |

| Steam and Condensate Pumps Trending and Alarms | | | | | | | |
|--|------|----------------|----------------------------|------------------------|------------|-------------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| Steam Flow (LB/HR) | AI | 15 Minutes | 12 hours | 3 days | N/A | | |
| Condensate Pump Run Hours | AI | 15 Minutes | 12 hours | 3 days | N/A | | |
| Water Meter (GPM) | AI | 15 Minutes | 12 hours | 3 days | N/A | | |
| Electric Meter (KW/H) | AI | 15 Minutes | 12 hours | 3 days | N/A | | |
| Irrigation Meter (GPM) | AI | 15 Minutes | 12 hours | 3 days | N/A | | |
| Chilled Water Flow (TONS) | AI | 15 Minutes | 12 hours | 3 days | N/A | | |
| Condensate Flow (GPM) | AI | 15 Minutes | 12 hours | 3 days | N/A | | |
| High Water Level Alarm | DI | COV | 12 hours | 3 days | C | True | 5 Min |
| Condensate Pump Start/Stop | DO | COV | 12 hours | 3 days | P | Status <> Command | 10 min |

| Domestic Hot Water Trending and Alarms | | | | | | | |
|--|------|----------------|----------------------------|------------------------|------------|-------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| Domestic HW Setpoint WH-1 | AI | 15 Minute | 12 Hours | 3 days | N/A | | |
| Domestic HW Setpoint WH-2 | AI | 15 Minute | 12 Hours | 3 days | N/A | | |
| Domestic HW Temperature | AI | 15 Minute | 12 Hours | 3 days | C | > 135 °F | 10 Min |

| Domestic Hot Water Trending and Alarms | | | | | | | |
|--|------|----------------|----------------------------|------------------------|------------|-------------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| Domestic HW Temperature | AI | 15 Minute | 12 Hours | 3 days | P | ±5°F from SP | 10 Min |
| | | | | | | | |
| Dom. Circ. Pump #1 Status | DI | COV | 12 Hours | 3 days | M | Status <> Command | 30 min |
| Dom. Circ. Pump #2 Status | DI | COV | 12 Hours | 3 days | M | Status <> Command | 30 min |
| | | | | | | | |
| Dom. Circ. Pump #1 Start/Stop | DO | COV | 12 Hours | 3 days | N/A | | |
| Dom. Circ. Pump #2 Start/Stop | DO | COV | 12 Hours | 3 days | N/A | | |
| Domestic HW Start/Stop | DO | COV | 12 Hours | 3 days | N/A | | |

| Hydronic Hot Water Trending and Alarms | | | | | | | |
|--|------|----------------|----------------------------|------------------------|------------|-------------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| System HWS Temperature | AI | 15 min | 12 hours | 3 days | C | ±5°F from SP | 10 Min |
| System HWR Temperature | AI | 15 min | 12 hours | 3 days | M | ±15°F from SP | 300 Min |
| HX-1 Entering Temperature | AI | 15 min | 12 hours | 3 days | P | ±5°F from SP | 10 Min |
| HX-2 Entering Temperature | AI | 15 min | 12 hours | 3 days | P | ±5°F from SP | 10 Min |
| HX-2 Leaving Temperature | AI | 15 min | 12 hours | 3 days | P | ±5°F from SP | 10 Min |
| | | | | | | | |
| System Flow (GPM) | AI | 15 min | 12 hours | 3 days | N/A | | |
| System Differential Pressure | AI | 15 min | 12 hours | 3 days | P | ±10% from SP | 8 Min |
| | | | | 3 days | | | |
| HW Pump 1 Status | DI | COV | 12 Hours | 3 days | C | Status <> Command | 30 min |
| HW Pump 2 Status | DI | COV | 12 Hours | 3 days | C | Status <> Command | 30 min |
| | | | | | | | |
| HW Pump 1 VFD Speed | AO | 15 Min | 12 Hours | 3 days | N/A | | |

| Hydronic Hot Water Trending and Alarms | | | | | | | |
|---|------|----------------|----------------------------|------------------------|------------|-------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| HW Pump 2 VFD Speed | AO | 15 Min | 12 Hours | 3 days | N/A | | |
| Steam Station #1 1/3 Control Valve Position | AO | 15 Min | 12 Hours | 3 days | N/A | | |
| Steam Station #1 2/3 Control Valve Position | AO | 15 Min | 12 Hours | 3 days | N/A | | |
| Steam Station #2 1/3 Control Valve Position | AO | 15 Min | 12 Hours | 3 days | N/A | | |
| Steam Station #2 2/3 Control Valve Position | AO | 15 Min | 12 Hours | 3 days | N/A | | |
| Steam Station Bypass Valve Position | AO | 15 Min | 12 Hours | 3 days | N/A | | |
| | | | | | | | |
| HW Pump 1 Start/Stop | DO | COV | 12 Hours | 3 days | N/A | | |
| HW Pump 2 Start/Stop | DO | COV | 12 Hours | 3 days | N/A | | |
| HWR #1 Valve | DO | COV | 12 Hours | 3 days | N/A | | |
| HWR #2 Valve | DO | COV | 12 Hours | 3 days | N/A | | |

| Chilled Water System Trending and Alarms | | | | | | | |
|--|------|----------------|----------------------------|------------------------|------------|--------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| Chiller 1 Entering Temperature | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Chiller 1 Leaving Temperature | AI | 15 Minutes | 12 Hours | 3 days | P | ±5°F from SP | 10 Min |
| Chiller 1 Flow | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Chiller 1 Percent Load | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Chiller 1 KW Consumption | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Chiller 1 Tonnage | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Chiller 2 Entering Temperature | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Chiller 2 Leaving Temperature | AI | 15 Minutes | 12 Hours | 3 days | P | ±5°F from SP | 10 Min |
| Chiller 2 Flow | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |

| Chilled Water System Trending and Alarms | | | | | | | |
|--|------|----------------|----------------------------|------------------------|------------|-------------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| Chiller 2 Percent Load | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Chiller 2 KW Consumption | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Chiller 2 Tonnage | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Primary Loop Decoupler Flow | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Primary Loop Flow | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Primary Loop Supply Temperature | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Secondary Loop Differential Pressure | AI | 15 Minutes | 12 Hours | 3 days | P | ±5% from SP | 10 Min |
| Secondary Loop Flow | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Secondary Loop Supply Temperature | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Secondary Loop Return Temperature | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Secondary Loop Tonnage | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| | | | | | | | |
| Primary Loop Pump 1 Status | DI | COV | 12 Hours | 3 days | C | Status <> Command | 30 min |
| Primary Loop Pump 2 Status | DI | COV | 12 Hours | 3 days | C | Status <> Command | 30 min |
| Secondary Loop Pump 1 Status | DI | COV | 12 Hours | 3 days | C | Status <> Command | 30 min |
| Secondary Loop Pump 2 Status | DI | COV | 12 Hours | 3 days | C | Status <> Command | 30 min |
| Chiller 1 Status | DI | COV | 12 Hours | 3 days | C | Status <> Command | 30 min |
| Chiller 1 Evaporator Iso-Valve | DI | COV | 12 Hours | 3 days | N/A | | |
| Chiller 1 Evaporator Flow Switch | DI | COV | 12 Hours | 3 days | N/A | | |
| Chiller 1 Unit Alarm | DI | COV | 12 Hours | 3 days | C | True | 10 Min |
| Chiller 2 Status | DI | COV | 12 Hours | 3 days | C | Status <> Command | 30 min |
| Chiller 2 Evaporator Iso-Valve | DI | COV | 12 Hours | 3 days | N/A | | |

| Chilled Water System Trending and Alarms | | | | | | | |
|--|------|----------------|----------------------------|------------------------|------------|-------------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| Chiller 2 Evaporator Flow Switch | DI | COV | 12 Hours | 3 days | N/A | | |
| Chiller 2 Unit Alarm | DI | COV | 12 Hours | 3 days | C | True | 10 Min |
| Refrigerant Detector | DI | COV | 12 Hours | 3 days | C | True | 10 Min |
| Refrigerant Exhaust Fan Status | DI | COV | 12 Hours | 3 days | M | Status <> Command | 30 min |
| Emergency Shutdown | DI | COV | 12 Hours | 3 days | P | True | 1 Min |
| | | | | | | | |
| Primary Loop Pump 1 VFD Speed | AO | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Primary Loop Pump 2 VFD Speed | AO | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Secondary Loop Pump 1 VFD Speed | AO | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Secondary Loop Pump 2 VFD Speed | AO | 15 Minutes | 12 Hours | 3 days | N/A | | |
| | | | | | | | |
| Primary Pump 1 Start / Stop | DO | COV | 12 Hours | 3 days | N/A | | |
| Primary Pump 2 Start / Stop | DO | COV | 12 Hours | 3 days | N/A | | |
| Secondary Pump 1 Start / Stop | DO | COV | 12 Hours | 3 days | N/A | | |
| Secondary Pump 2 Start / Stop | DO | COV | 12 Hours | 3 days | N/A | | |
| Chiller 1 Enable | DO | COV | 12 Hours | 3 days | N/A | | |
| Chiller 1 Iso-Valve Command | DO | COV | 12 Hours | 3 days | N/A | | |
| Chiller 2 Enable | DO | COV | 12 Hours | 3 days | N/A | | |
| Chiller 2 Iso-Valve Command | DO | COV | 12 Hours | 3 days | N/A | | |
| Refrigerant Exhaust Fan Start / Stop | DO | COV | 12 Hours | 3 days | N/A | | |

| Condenser Water System Trending and Alarms | | | | | | | |
|--|------|----------------|----------------------------|------------------------|------------|-------------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| Chiller 1 Condenser Entering Temp | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Chiller 1 Condenser Leaving Temp | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Chiller 2 Condenser Entering Temp | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Chiller 2 Condenser Leaving Temp | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Cooling Tower 1 Supply Temp | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Cooling Tower 1 Return Temp | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Cooling Tower 1 Basin Temp | AI | 15 Minutes | 12 Hours | 3 days | P | < 45 °F | 10 Min |
| Cooling Tower 2 Supply Temp | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Cooling Tower 2 Return Temp | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Cooling Tower 2 Basin Temp | AI | 15 Minutes | 12 Hours | 3 days | P | < 45 °F | 10 Min |
| Condenser Water Supply Temp | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Condenser Water Return Temp | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Outdoor Air Wet Bulb | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| | | | | | | | |
| Cooling Tower 1 Fan Status | DI | COV | 12 Hours | 3 days | P | Status <> Command | 1 min |
| Cooling Tower 1 Basin Heat | DI | COV | 12 Hours | 3 days | N/A | | |
| Cooling Tower 1 Heat Trace | DI | COV | 12 Hours | 3 days | N/A | | |
| Cooling Tower 2 Fan Status | DI | COV | 12 Hours | 3 days | P | Status <> Command | 1 min |
| Cooling Tower 2 Basin Heat | DI | COV | 12 Hours | 3 days | N/A | | |
| Cooling Tower 2 Heat Trace | DI | COV | 12 Hours | 3 days | N/A | | |
| Chiller 1 Isolation Valve | DI | COV | 12 Hours | 3 days | P | Status <> Command | 1 min |
| Chiller 2 Isolation Valve | DI | COV | 12 Hours | 3 days | P | Status <> Command | 1 min |
| Condenser Water Pump 1 Status | DI | COV | 12 Hours | 3 days | P | Status <> Command | 1 min |

| Condenser Water System Trending and Alarms | | | | | | | |
|--|------|----------------|----------------------------|------------------------|------------|-------------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| Condenser Water Pump 2 Status | DI | COV | 12 Hours | 3 days | P | Status <> Command | 1 min |
| Chiller 1 Condenser Bypass Valve | AO | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Chiller 2 Condenser By-Pass Valve | AO | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Cooling Tower 1 Bypass Valve | AO | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Cooling Tower 1 Fan Speed | AO | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Cooling Tower 2 Bypass Valve | AO | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Cooling Tower 2 Fan Speed | AO | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Cooling Tower 1 Fan Start / Stop | DO | COV | 12 Hours | 3 days | N/A | | |
| Cooling Tower 2 Fan Start / Stop | DO | COV | 12 Hours | 3 days | N/A | | |
| Condenser Water Pump 1 Start / Stop | DO | COV | 12 Hours | 3 days | N/A | | |
| Condenser Water Pump 2 Start / Stop | DO | COV | 12 Hours | 3 days | N/A | | |

| Steam Boiler System Trending and Alarms | | | | | | | |
|---|------|----------------|----------------------------|------------------------|------------|-------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| Boiler 1 Steam Pressure | AI | 15 Minutes | 12 Hours | 3 days | P | ±5% from SP | 10 Min |
| Boiler 1 Steam Temperature | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Boiler 1 Fire Signal | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Boiler 2 Steam Pressure | AI | 15 Minutes | 12 Hours | 3 days | P | ±5% from SP | 10 Min |
| Boiler 2 Steam Temperature | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Boiler 2 Fire Signal | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |

| Steam Boiler System Trending and Alarms | | | | | | | |
|---|------|----------------|----------------------------|------------------------|------------|-------------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| System Steam Pressure | AI | 15 Minutes | 12 Hours | 3 days | P | ±5% from SP | 10 Min |
| | | | | | | | |
| Boiler 1 Enable | DI | COV | 12 Hours | 3 days | N/A | | |
| Boiler 1 Status | DI | COV | 12 Hours | 3 days | P | Status <> Command | 10 min |
| Boiler 1 Alarm | DI | COV | 12 Hours | 3 days | C | True | 1 Min |
| Boiler 1 on Fuel Oil | DI | COV | 12 Hours | 3 days | N/A | | |
| Boiler 1 Low Water Alarm | DI | COV | 12 Hours | 3 days | C | True | 5 Min |
| Boiler 1 High Water Alarm | DI | COV | 12 Hours | 3 days | C | True | 5 Min |
| Boiler 1 Feed Pump | DI | COV | 12 Hours | 3 days | N/A | | |
| Boiler 2 Enable | DI | COV | 12 Hours | 3 days | N/A | | |
| Boiler 2 Status | DI | COV | 12 Hours | 3 days | P | Status <> Command | 10 min |
| Boiler 2 Alarm | DI | COV | 12 Hours | 3 days | C | True | 1 Min |
| Boiler 2 on Fuel Oil | DI | COV | 12 Hours | 3 days | N/A | | |
| Boiler 2 Low Water Alarm | DI | COV | 12 Hours | 3 days | C | True | 5 Min |
| Boiler 2 High Water Alarm | DI | COV | 12 Hours | 3 days | C | True | 5 Min |
| Boiler 2 Feed Pump | DI | COV | 12 Hours | 3 days | N/A | | |
| Combustion Damper Status | DI | COV | 12 Hours | 3 days | P | Status <> Command | 5 min |
| Condensate Recovery Pump Status | DI | COV | 12 Hours | 3 days | P | Status <> Command | 5 min |
| | | | | | | | |
| Boiler 1 Feed Pump Start / Stop | DO | COV | 12 Hours | 3 days | N/A | | |
| Boiler 2 Start / Stop | DO | COV | 12 Hours | 3 days | N/A | | |
| Combustion Damper Command | DO | COV | 12 Hours | 3 days | N/A | | |
| Condensate Recovery Pump Start / Stop | DO | COV | 12 Hours | 3 days | N/A | | |

| Hot Water Boiler System Trending and Alarms | | | | | | | |
|---|------|----------------|----------------------------|------------------------|------------|-------------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| Outside Air Temperature | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Boiler 1 Fire Signal | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Boiler 1 Entering Water Temperature | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Boiler 1 Leaving Water Temperature | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Boiler 2 Fire Signal | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Boiler 2 Entering Water Temperature | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Boiler 2 Leaving Water Temperature | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Hot Water Supply Temperature | AI | 15 Minutes | 12 Hours | 3 days | P | ±5 °F from SP | 10 Min |
| Hot Water Return Temperature | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| Secondary Loop Differential Pressure | AI | 15 Minutes | 12 Hours | 3 days | C | ±5% from SP | 10 Min |
| Lead Boiler | AI | 15 Minutes | 12 Hours | 3 days | N/A | | |
| | | | | | | | |
| Boiler 1 Enable | DI | COV | 12 Hours | 3 days | N/A | | |
| Boiler 1 Status | DI | COV | 12 Hours | 3 days | P | Status <> Command | 10 min |
| Boiler 1 Isolation Valve | DI | COV | 12 Hours | 3 days | N/A | | |
| Boiler 1 on Fuel Oil | DI | COV | 12 Hours | 3 days | N/A | | |
| Boiler 1 Alarm | DI | COV | 12 Hours | 3 days | C | True | 1 Min |
| Boiler 2 Enable | DI | COV | 12 Hours | 3 days | N/A | | |
| Boiler 2 Status | DI | COV | 12 Hours | 3 days | P | Status <> Command | 10 min |
| Boiler 2 Isolation Valve | DI | COV | 12 Hours | 3 days | N/A | | |
| Boiler 2 on Fuel Oil | DI | COV | 12 Hours | 3 days | N/A | | |
| Boiler 2 Alarm | DI | COV | 12 Hours | 3 days | C | True | 1 Min |
| Combustion Dampers Open | DI | COV | 12 Hours | 3 days | P | Status <> Command | 10 min |
| Primary Pump 1 Status | DI | COV | 12 Hours | 3 days | P | Status <> Command | 10 min |

| Hot Water Boiler System Trending and Alarms | | | | | | | |
|---|------|----------------|----------------------------|------------------------|------------|-------------------|-------------|
| Point | Type | Trend Interval | Operational Trend Duration | Testing Trend Duration | Alarm Type | Alarm Range | Alarm Delay |
| Primary Pump 2 Status | DI | COV | 12 Hours | 3 days | P | Status <> Command | 10 min |
| Secondary Pump 1 Status | DI | COV | 12 Hours | 3 days | P | Status <> Command | 10 min |
| Secondary Pump 2 Status | DI | COV | 12 Hours | 3 days | P | Status <> Command | 10 min |
| | | | | | | | |
| Primary Pump 1 VFD Speed | AO | COV | 12 Hours | 3 days | N/A | | |
| Primary Pump 2 VFD Speed | AO | COV | 12 Hours | 3 days | N/A | | |
| Secondary Pump 1 VFD Speed | AO | COV | 12 Hours | 3 days | N/A | | |
| Secondary Pump 2 VFD Speed | AO | COV | 12 Hours | 3 days | N/A | | |
| | | | | | | | |
| Hot Water System Enable | DO | COV | 12 Hours | 3 days | N/A | | |
| Combustion Dampers Command | DO | COV | 12 Hours | 3 days | N/A | | |
| Primary Pump 1 Start / Stop | DO | COV | 12 Hours | 3 days | N/A | | |
| Primary Pump 2 Start / Stop | DO | COV | 12 Hours | 3 days | N/A | | |
| Secondary Pump 1 Start / Stop | DO | COV | 12 Hours | 3 days | N/A | | |
| Secondary Pump 2 Start / Stop | DO | COV | 12 Hours | 3 days | N/A | | |

- E. The Contractor shall provide the following information prior to Systems Functional Performance Testing. Any documentation that is modified after submission shall be recorded and resubmitted to the COTR and Commissioning Agent.
1. Point-to-Point checkout documentation;
 2. Sensor field calibration documentation including system name, sensor/point name, measured value, DDC value, and Correction Factor.
 3. A sensor calibration table listing the referencing the location of procedures to following in the O&M manuals, and the frequency at which calibration should be performed for all sensors, separated by system, subsystem, and type. The calibration requirements shall be submitted both in the O&M manuals and separately in a standalone document containing all sensors for inclusion in the commissioning documentation. The following table is a sample that can be used as a template for submission.

| SYSTEM | | |
|---------------------------|-----------------------|-------------------------------------|
| Sensor | Calibration Frequency | O&M Calibration Procedure Reference |
| Discharge air temperature | Once a year | Volume I Section D.3.aa |
| Discharge static pressure | Every 6 months | Volume II Section A.1.c |

4. Loop tuning documentation and constants for each loop of the building systems. The documentation shall be submitted in outline or table separated by system, control type (e.g. heating valve temperature control); proportional, integral and derivative constants, interval (and bias if used) for each loop. The following table is a sample that can be used as a template for submission.

| AIR HANDLING UNIT AHU-1 | | | | |
|-------------------------|-----------------------|-------------------|---------------------|----------|
| Control Reference | Proportional Constant | Integral Constant | Derivative Constant | Interval |
| Heating Valve Output | 1000 | 20 | 10 | 2 sec. |

3.5 SYSTEMS FUNCTIONAL PERFORMANCE TESTING

- A. This paragraph applies to Systems Functional Performance Testing of systems for all referenced specification Divisions.
- B. Objectives and Scope: The objective of Systems Functional Performance Testing is to demonstrate that each system is operating according to the Contract Documents. Systems Functional Performance Testing facilitates bringing the systems from a state of substantial completion to full dynamic operation. Additionally, during the testing process, areas of noncompliant performance are identified and corrected, thereby improving the operation and functioning of the systems. In general, each system shall be operated through all modes of operation (seasonal, occupied, unoccupied, warm-up, cool-down, part- and full-load, fire alarm and emergency power) where there is a specified system response. The Contractor shall verify each sequence in the sequences of operation. Proper responses to such modes and conditions as power failure, freeze condition, low oil pressure, no flow, equipment failure, etc. shall also be tested.
- C. Development of Systems Functional Performance Test Procedures: Before Systems Functional Performance Test procedures are written, the Contractor shall submit all requested documentation and a current list of change orders affecting equipment or systems, including an updated points list, program code, control sequences and parameters. Using the testing parameters and requirements found in the Contract Documents and approved submittals and shop drawings, the Commissioning Agent will develop specific Systems Functional Test

Procedures to verify and document proper operation of each piece of equipment and system to be commissioned. The Contractor shall assist the Commissioning Agent in developing the Systems Functional Performance Test procedures as requested by the Commissioning Agent i.e. by answering questions about equipment, operation, sequences, etc. Prior to execution, the Commissioning Agent will provide a copy of the Systems Functional Performance Test procedures to the VA, the Architect/Engineer, and the Contractor, who shall review the tests for feasibility, safety, equipment and warranty protection.

- D. Purpose of Test Procedures: The purpose of each specific Systems Functional Performance Test is to verify and document compliance with the stated criteria of acceptance given on the test form. Representative test formats and examples are found in the Commissioning Plan for this project. (The Commissioning Plan will be issued as a separate document made available for review.) The test procedure forms developed by the Commissioning Agent will include, but not be limited to, the following information:
1. System and equipment or component name(s)
 2. Equipment location and ID number
 3. Unique test ID number, and reference to unique Pre-Functional Checklists and startup documentation, and ID numbers for the piece of equipment.
 4. Date
 5. Project name
 6. Participating parties
 7. A copy of the specification section describing the test requirements
 8. A copy of the specific sequence of operations or other specified parameters being verified
 9. Formulas used in any calculations
 10. Required pretest field measurements
 11. Instructions for setting up the test.
 12. Special cautions, alarm limits, etc.
 13. Specific step-by-step procedures to execute the test, in a clear, sequential and repeatable format
 14. Acceptance criteria of proper performance with a Yes / No check box to allow for clearly marking whether or not proper performance of each part of the test was achieved.
 15. A section for comments.
 16. Signatures and date block for the Commissioning Agent. A place for the Contractor to initial to signify attendance at the test.
- E. Test Methods: Systems Functional Performance Testing shall be achieved by manual testing (i.e. persons manipulate the equipment and observe performance) and/or by monitoring the performance and analyzing the results using the control system's trend log capabilities or by standalone data loggers. The Contractor and Commissioning Agent shall determine which method is most appropriate for tests that do not have a method specified.

1. Simulated Conditions: Simulating conditions (not by an overwritten value) shall be allowed, although timing the testing to experience actual conditions is encouraged wherever practical.
 2. Overwritten Values: Overwriting sensor values to simulate a condition, such as overwriting the outside air temperature reading in a control system to be something other than it really is, shall be allowed, but shall be used with caution and avoided when possible. Such testing methods often can only test a part of a system, as the interactions and responses of other systems will be erroneous or not applicable. Simulating a condition is preferable. e.g., for the above case, by heating the outside air sensor with a hair blower rather than overwriting the value or by altering the appropriate setpoint to see the desired response. Before simulating conditions or overwriting values, sensors, transducers and devices shall have been calibrated.
 3. Simulated Signals: Using a signal generator which creates a simulated signal to test and calibrate transducers and DDC constants is generally recommended over using the sensor to act as the signal generator via simulated conditions or overwritten values.
 4. Altering Setpoints: Rather than overwriting sensor values, and when simulating conditions is difficult, altering setpoints to test a sequence is acceptable. For example, to see the Air Conditioning compressor lockout initiate at an outside air temperature below 12 C (54 F), when the outside air temperature is above 12 C (54 F), temporarily change the lockout setpoint to be 2 C (4 F) above the current outside air temperature.
 5. Indirect Indicators: Relying on indirect indicators for responses or performance shall be allowed only after visually and directly verifying and documenting, over the range of the tested parameters, that the indirect readings through the control system represent actual conditions and responses. Much of this verification shall be completed during systems startup and initial checkout.
- F. Setup: Each function and test shall be performed under conditions that simulate actual conditions as closely as is practically possible. The Contractor shall provide all necessary materials, system modifications, etc. to produce the necessary flows, pressures, temperatures, etc. necessary to execute the test according to the specified conditions. At completion of the test, the Contractor shall return all affected building equipment and systems, due to these temporary modifications, to their pretest condition.
- G. Sampling: No sampling is allowed in completing Pre-Functional Checklists. Sampling is allowed for Systems Functional Performance Test Procedures execution. The Commissioning Agent will determine the sampling rate. If at any point, frequent failures are occurring and testing is becoming more troubleshooting than verification, the Commissioning Agent may stop the testing and require the Contractor to perform and document a checkout of the remaining units, prior to continuing with Systems Functional Performance Testing of the remaining units.

- H. Cost of Retesting: The cost associated with expanded sample System Functional Performance Tests shall be solely the responsibility of the Contractor. **Any required retesting by the Contractor shall not be considered a justified reason for a claim of delay or for a time extension by the Contractor.**
- I. Coordination and Scheduling: The Contractor shall provide a minimum of 7 days notice to the Commissioning Agent and the VA regarding the completion schedule for the Pre-Functional Checklists and startup of all equipment and systems. The Commissioning Agent will schedule Systems Functional Performance Tests with the Contractor and VA. The Commissioning Agent will witness and document the Systems Functional Performance Testing of systems. The Contractor shall execute the tests in accordance with the Systems Functional Performance Test Procedure.
- J. Testing Prerequisites: In general, Systems Functional Performance Testing will be conducted only after Pre-Functional Checklists have been satisfactorily completed. The control system shall be sufficiently tested and approved by the Commissioning Agent and the VA before it is used to verify performance of other components or systems. The air balancing and water balancing shall be completed before Systems Functional Performance Testing of air-related or water-related equipment or systems are scheduled. Systems Functional Performance Testing will proceed from components to subsystems to systems. When the proper performance of all interacting individual systems has been achieved, the interface or coordinated responses between systems will be checked.
- K. Problem Solving: The Commissioning Agent will recommend solutions to problems found, however the burden of responsibility to solve, correct and retest problems is with the Contractor.

3.6 DOCUMENTATION, NONCONFORMANCE AND APPROVAL OF TESTS

- A. Documentation: The Commissioning Agent will witness, and document the results of all Systems Functional Performance Tests using the specific procedural forms developed by the Commissioning Agent for that purpose. Prior to testing, the Commissioning Agent will provide these forms to the VA and the Contractor for review and approval. The Contractor shall include the filled out forms with the O&M manual data.
- B. Nonconformance: The Commissioning Agent will record the results of the Systems Functional Performance Tests on the procedure or test form. All items of nonconformance issues will be noted and reported to the VA on Commissioning Field Reports and/or the Commissioning Master Issues Log.
1. Corrections of minor items of noncompliance identified may be made during the tests. In such cases, the item of noncompliance and resolution shall be documented on the Systems Functional Test Procedure.
 2. Every effort shall be made to expedite the systems functional Performance Testing process and minimize unnecessary delays, while not compromising the integrity of the procedures.

- However, the Commissioning Agent shall not be pressured into overlooking noncompliant work or loosening acceptance criteria to satisfy scheduling or cost issues, unless there is an overriding reason to do so by direction from the VA.
3. As the Systems Functional Performance Tests progresses and an item of noncompliance is identified, the Commissioning Agent shall discuss the issue with the Contractor and the VA.
 4. When there is no dispute on an item of noncompliance, and the Contractor accepts responsibility to correct it:
 - a. The Commissioning Agent will document the item of noncompliance and the Contractor's response and/or intentions. The Systems Functional Performance Test then continues or proceeds to another test or sequence. After the day's work is complete, the Commissioning Agent will submit a Commissioning Field Report to the VA. The Commissioning Agent will also note items of noncompliance and the Contractor's response in the Master Commissioning Issues Log. The Contractor shall correct the item of noncompliance and report completion to the VA and the Commissioning Agent.
 - b. The need for retesting will be determined by the Commissioning Agent. If retesting is required, the Commissioning Agent and the Contractor shall reschedule the test and the test shall be repeated.
 5. If there is a dispute about item of noncompliance, regarding whether it is an item of noncompliance, or who is responsible:
 - a. The item of noncompliance shall be documented on the test form with the Contractor's response. The item of noncompliance with the Contractor's response shall also be reported on a Commissioning Field Report and on the Master Commissioning Issues Log.
 - b. Resolutions shall be made at the lowest management level possible. Other parties are brought into the discussions as needed. Final interpretive and acceptance authority is with the Department of Veterans Affairs.
 - c. The Commissioning Agent will document the resolution process.
 - d. Once the interpretation and resolution have been decided, the Contractor shall correct the item of noncompliance, report it to the Commissioning Agent. The requirement for retesting will be determined by the Commissioning Agent. If retesting is required, the Commissioning Agent and the Contractor shall reschedule the test. Retesting shall be repeated until satisfactory performance is achieved.
- C. Cost of Retesting: The cost to retest a System Functional Performance Test shall be solely the responsibility of the Contractor. **Any required retesting by the Contractor shall not be considered a justified reason for a claim of delay or for a time extension by the Contractor.**
- D. Failure Due to Manufacturer Defect: If 10%, or three, whichever is greater, of identical pieces (size alone does not constitute a difference) of equipment fail to perform in compliance with the Contract Documents (mechanically or substantively) due to manufacturing defect, not allowing it

to meet its submitted performance specifications, all identical units may be considered unacceptable by the VA. In such case, the Contractor shall provide the VA with the following:

1. Within one week of notification from the VA, the Contractor shall examine all other identical units making a record of the findings. The findings shall be provided to the VA within two weeks of the original notice.
 2. Within two weeks of the original notification, the Contractor shall provide a signed and dated, written explanation of the problem, cause of failures, etc. and all proposed solutions which shall include full equipment submittals. The proposed solutions shall not significantly exceed the specification requirements of the original installation.
 3. The VA shall determine whether a replacement of all identical units or a repair is acceptable.
 4. Two examples of the proposed solution shall be installed by the Contractor and the VA shall be allowed to test the installations for up to one week, upon which the VA will decide whether to accept the solution.
 5. Upon acceptance, the Contractor shall replace or repair all identical items, at their expense and extend the warranty accordingly, if the original equipment warranty had begun. The replacement/repair work shall proceed with reasonable speed beginning within one week from when parts can be obtained.
- E. Approval: The Commissioning Agent will note each satisfactorily demonstrated function on the test form. Formal approval of the Systems Functional Performance Test shall be made later after review by the Commissioning Agent and by the VA. The Commissioning Agent will evaluate each test and report to the VA using a standard form. The VA will give final approval on each test using the same form, and provide signed copies to the Commissioning Agent and the Contractor.

3.7 DEFERRED TESTING

- A. Unforeseen Deferred Systems Functional Performance Tests: If any Systems Functional Performance Test cannot be completed due to the building structure, required occupancy condition or other conditions, execution of the Systems Functional Performance Testing may be delayed upon approval of the VA. These Systems Functional Performance Tests shall be conducted in the same manner as the seasonal tests as soon as possible. Services of the Contractor to conduct these unforeseen Deferred Systems Functional Performance Tests shall be negotiated between the VA and the Contractor.
- B. Deferred Seasonal Testing: Deferred Seasonal Systems Functional Performance Tests are those that must be deferred until weather conditions are closer to the systems design parameters. The Commissioning Agent will review systems parameters and recommend which Systems Functional Performance Tests should be deferred until weather conditions more closely match systems parameters. The Contractor shall review and comment on the proposed schedule for Deferred Seasonal Testing. The VA will review and approve the schedule for Deferred Seasonal Testing. Deferred Seasonal Systems Functional Performances Tests shall be witnessed and documented

by the Commissioning Agent. Deferred Seasonal Systems Functional Performance Tests shall be executed by the Contractor in accordance with these specifications.

3.8 OPERATION AND MAINTENANCE TRAINING REQUIREMENTS

- A. The Contractor shall provide training and demonstration as required by other Division 22 and Division 23 sections. The Training and Demonstration shall include, but is not limited to, the following:
1. Review the Contract Documents.
 2. Review installed systems, subsystems, and equipment.
 3. Review instructor qualifications.
 4. Review instructional methods and procedures.
 5. Review training module outlines and contents.
 6. Review course materials (including operation and maintenance manuals).
 7. Review and discuss locations and other facilities required for instruction.
 8. Review and finalize training schedule and verify availability of educational materials, instructors, audiovisual equipment, and facilities needed to avoid delays.
 9. For instruction that must occur outside, review weather and forecasted weather conditions and procedures to follow if conditions are unfavorable.
- B. Training Module Submittals: The Contractor shall submit the following information to the VA.
1. Instruction Program: Submit two copies of outline of instructional program for demonstration and training, including a schedule of proposed dates, times, length of instruction time, and instructors' names for each training module. Include learning objective and outline for each training module. At completion of training, submit two complete training manuals for VA's use.
 2. Qualification Data: Submit qualifications for facilitator and/or instructor.
 3. Attendance Record: For each training module, submit list of participants and length of instruction time.
 4. Evaluations: For each participant and for each training module, submit results and documentation of performance-based test.
 5. Demonstration and Training Videotapes: Submit two copies within seven days of end of each training module.
 - a. Identification: On each copy, provide an applied label with the following information:
 - 1) Name of Project.
 - 2) Name and address of photographer
 - 3) Name of Contractor.
 - 4) Date videotape was recorded.
 - 5) Description of vantage point, indicating location, direction (by compass point), and elevation or story of construction.

6. Transcript: Prepared on 8-1/2-by-11-inch paper, punched and bound in heavy-duty, 3-ring, vinyl-covered binders. Mark appropriate identification on front and spine of each binder. Include a cover sheet with same label information as the corresponding videotape. Include name of Project and date of videotape on each page.

C. QUALITY ASSURANCE

1. Facilitator Qualifications: A firm or individual experienced in training or educating maintenance personnel in a training program similar in content and extent to that indicated for this Project, and whose work has resulted in training or education with a record of successful learning performance.
2. Instructor Qualifications: A factory authorized service representative, complying with requirements in Division 01 Section "Quality Requirements," experienced in operation and maintenance procedures and training.
3. Photographer Qualifications: A professional photographer who is experienced photographing construction projects.

D. COORDINATION

1. Coordinate instruction schedule with VA's operations. Adjust schedule as required to minimize disrupting VA's operations.
2. Coordinate instructors, including providing notification of dates, times, length of instruction time, and course content.
3. Coordinate content of training modules with content of approved emergency, operation, and maintenance manuals. Do not submit instruction program until operation and maintenance data has been reviewed and approved by the VA.

E. INSTRUCTION PROGRAM

1. Program Structure: Develop an instruction program that includes individual training modules for each system and equipment not part of a system, as required by individual Specification Sections, and as follows:
 - a. Fire protection systems, including fire alarm, fire pumps, and fire suppression systems.
 - b. Intrusion detection systems.
 - c. Conveying systems, including elevators, wheelchair lifts, escalators, and automated materials handling systems.
 - d. Medical equipment, including medical gas equipment and piping.
 - e. Laboratory equipment, including laboratory air and vacuum equipment and piping.
 - f. Heat generation, including boilers, feedwater equipment, pumps, steam distribution piping, condensate return systems, heating hot water heat exchangers, and heating hot water distribution piping.
 - g. Refrigeration systems, including chillers, cooling towers, condensers, pumps, and distribution piping.

- h. HVAC systems, including air handling equipment, air distribution systems, and terminal equipment and devices.
 - i. switchgear, transformers, switchboards, panelboards, uninterruptible power supplies, and motor controls.
 - j. Packaged engine generators, including synchronizing switchgear/switchboards, and transfer switches.
 - K. Lighting equipment and controls.
 - l. Communication systems, including intercommunication, surveillance, nurse call systems, public address, mass evacuation, voice and data, and entertainment television equipment.
 - m. Site utilities including lift stations, condensate pumping and return systems, and storm water pumping systems.
- F. Training Modules: Develop a learning objective and teaching outline for each module. Include a description of specific skills and knowledge that participants are expected to master. For each module, include instruction for the following:
- 1. Basis of System Design, Operational Requirements, and Criteria: Include the following:
 - a. System, subsystem, and equipment descriptions.
 - b. Performance and design criteria if Contractor is delegated design responsibility.
 - c. Operating standards.
 - d. Regulatory requirements.
 - e. Equipment function.
 - f. Operating characteristics.
 - g. Limiting conditions.
 - h. Performance curves.
 - 2. Documentation: Review the following items in detail:
 - a. Emergency manuals.
 - b. Operations manuals.
 - c. Maintenance manuals.
 - d. Project Record Documents.
 - e. Identification systems.
 - f. Warranties and bonds.
 - g. Maintenance service agreements and similar continuing commitments.
 - 3. Emergencies: Include the following, as applicable:
 - a. Instructions on meaning of warnings, trouble indications, and error messages.
 - b. Instructions on stopping.
 - c. Shutdown instructions for each type of emergency.
 - d. Operating instructions for conditions outside of normal operating limits.
 - e. Sequences for electric or electronic systems.

- f. Special operating instructions and procedures.
- 4. Operations: Include the following, as applicable:
 - a. Startup procedures.
 - b. Equipment or system break-in procedures.
 - c. Routine and normal operating instructions.
 - d. Regulation and control procedures.
 - e. Control sequences.
 - f. Safety procedures.
 - g. Instructions on stopping.
 - h. Normal shutdown instructions.
 - i. Operating procedures for emergencies.
 - j. Operating procedures for system, subsystem, or equipment failure.
 - k. Seasonal and weekend operating instructions.
 - l. Required sequences for electric or electronic systems.
 - m. Special operating instructions and procedures.
- 5. Adjustments: Include the following:
 - a. Alignments.
 - b. Checking adjustments.
 - c. Noise and vibration adjustments.
 - d. Economy and efficiency adjustments.
- 6. Troubleshooting: Include the following:
 - a. Diagnostic instructions.
 - b. Test and inspection procedures.
- 7. Maintenance: Include the following:
 - a. Inspection procedures.
 - b. Types of cleaning agents to be used and methods of cleaning.
 - c. List of cleaning agents and methods of cleaning detrimental to product.
 - d. Procedures for routine cleaning
 - e. Procedures for preventive maintenance.
 - f. Procedures for routine maintenance.
 - g. Instruction on use of special tools.
- 8. Repairs: Include the following:
 - a. Diagnosis instructions.
 - b. Repair instructions.
 - c. Disassembly; component removal, repair, and replacement; and reassembly instructions.
 - d. Instructions for identifying parts and components.
 - e. Review of spare parts needed for operation and maintenance.
- G. Training Execution:

1. Preparation: Assemble educational materials necessary for instruction, including documentation and training module. Assemble training modules into a combined training manual. Set up instructional equipment at instruction location.
 2. Instruction:
 - a. Facilitator: Engage a qualified facilitator to prepare instruction program and training modules, to coordinate instructors, and to coordinate between Contractor and Department of Veterans Affairs for number of participants, instruction times, and location.
 - b. Instructor: Engage qualified instructors to instruct VA's personnel to adjust, operate, and maintain systems, subsystems, and equipment not part of a system.
 - 1) The Contractor will furnish an instructor to describe basis of system design, operational requirements, criteria, and regulatory requirements.
 - 2) The VA will furnish an instructor to describe VA's operational philosophy.
 - 3) The VA will furnish the Contractor with names and positions of participants.
 3. Scheduling: Provide instruction at mutually agreed times. For equipment that requires seasonal operation, provide similar instruction at start of each season. Schedule training with the VA with at least seven days' advance notice.
 4. Evaluation: At conclusion of each training module, assess and document each participant's mastery of module by use of **an oral, or a written**, performance-based test.
 5. Cleanup: Collect used and leftover educational materials and remove from Project site. Remove instructional equipment. Restore systems and equipment to condition existing before initial training use.
- H. Demonstration and Training Recording:
1. General: Engage a qualified commercial photographer to record demonstration and training. Record each training module separately. Include classroom instructions and demonstrations, board diagrams, and other visual aids, but not student practice. At beginning of each training module, record each chart containing learning objective and lesson outline.
 2. Video Format: Provide high quality color DVD color on standard size DVD disks.
 3. Recording: Mount camera on tripod before starting recording, unless otherwise necessary to show area of demonstration and training. Display continuous running time.
 4. Narration: Describe scenes on videotape by audio narration by microphone while demonstration and training is recorded. Include description of items being viewed. Describe vantage point, indicating location, direction (by compass point), and elevation or story of construction.

--- E N D ---

**SECTION 02 41 00
DEMOLITION****PART 1 - GENERAL****1.1 DESCRIPTION:**

This section specifies demolition and removal of buildings, portions of buildings, utilities, other structures and debris from trash dumps shown.

1.2 RELATED WORK:

- A. Demolition and removal of walks, curbs, and on-grade slabs outside buildings to be demolished: Section 31 20 00, EARTH MOVING.
- B. Safety Requirements: GENERAL CONDITIONS Article, ACCIDENT PREVENTION.
- C. Disconnecting utility services prior to demolition: Section 01 00 00, GENERAL REQUIREMENTS.
- D. Reserved items that are to remain the property of the Government: Section 01 00 00, GENERAL REQUIREMENTS.
- E. Asbestos Removal: Section 02 82 13.13, GLOVEBAG ASBESTOS ABATEMENT and Section 02 82 13.31, ASBESTOS GASKET ABATEMENT.
- F. Environmental Protection: Section 01 57 19, TEMPORARY ENVIRONMENTAL CONTROLS.
- G. Infectious Control: Section 01 00 00, GENERAL REQUIREMENTS, Article 1.7, INFECTION PREVENTION MEASURES.

1.3 PROTECTION:

- A. Perform demolition in such manner as to eliminate hazards to persons and property; to minimize interference with use of adjacent areas, utilities and structures or interruption of use of such utilities; and to provide free passage to and from such adjacent areas of structures. Comply with requirements of GENERAL CONDITIONS Article, ACCIDENT PREVENTION.
- B. Provide safeguards, including warning signs, barricades, temporary fences, warning lights, and other similar items that are required for protection of all personnel during demolition and removal operations. Comply with requirements of Section 01 00 00, GENERAL REQUIREMENTS, Article PROTECTION OF EXISTING VEGETATION, STRUCTURES, EQUIPMENT, UTILITIES AND IMPROVEMENTS.
- C. Maintain fences, barricades, lights, and other similar items around exposed excavations until such excavations have been completely filled.
- D. Provide enclosed dust chutes with control gates from each floor to carry debris to truck beds and govern flow of material into truck. Provide overhead bridges of tight board or prefabricated metal construction at dust chutes to protect persons and property from falling debris.
- E. Prevent spread of flying particles and dust. Sprinkle rubbish and debris with water to keep dust to a minimum. Do not use water if it results in hazardous or objectionable condition such as, but not limited to; ice, flooding, or pollution. Vacuum and dust the work area daily.

- F. In addition to previously listed fire and safety rules to be observed in performance of work, include following:
1. No wall or part of wall shall be permitted to fall outwardly from structures.
 2. Maintain at least one stairway in each structure in usable condition to highest remaining floor. Keep stairway free of obstructions and debris until that level of structure has been removed.
 3. Wherever a cutting torch or other equipment that might cause a fire is used, provide and maintain fire extinguishers nearby ready for immediate use. Instruct all possible users in use of fire extinguishers.
 4. Keep hydrants clear and accessible at all times. Prohibit debris from accumulating within a radius of 4500 mm (15 feet) of fire hydrants.
- G. Before beginning any demolition work, the Contractor shall survey the site and examine the drawings and specifications to determine the extent of the work. The contractor shall take necessary precautions to avoid damages to existing items to remain in place, to be reused, or to remain the property of the Medical Center; any damaged items shall be repaired or replaced as approved by the COTR. The Contractor shall coordinate the work of this section with all other work and shall construct and maintain shoring, bracing, and supports as required. The Contractor shall ensure that structural elements are not overloaded and shall be responsible for increasing structural supports or adding new supports as may be required as a result of any cutting, removal, or demolition work performed under this contract. Do not overload structural elements. Provide new supports and reinforcement for existing construction weakened by demolition or removal works. Repairs, reinforcement, or structural replacement must have COTR's approval.
- H. The work shall comply with the requirements of Section 01 57 19, TEMPORARY ENVIRONMENTAL CONTROLS.
- I. The work shall comply with the requirements of Section 01 00 00, GENERAL REQUIREMENTS, Article 1.7 INFECTION PREVENTION MEASURES.

1.4 UTILITY SERVICES:

- A. Demolish and remove outside utility service lines shown to be removed.
- B. Remove abandoned outside utility lines that would interfere with installation of new utility lines and new construction.

PART 2 - PRODUCTS (NOT USED)

PART 3 – EXECUTION

3.1 DEMOLITION:

- A. Completely demolish and remove buildings and structures, including all appurtenances related or connected thereto, as noted below:
 1. As required for installation of new utility service lines.
 2. To full depth within an area defined by hypothetical lines located 1500 mm (5 feet) outside building lines of new structures.

- B. Debris, including brick, concrete, stone, metals and similar materials shall become property of Contractor and shall be disposed of by him daily, off the Medical Center to avoid accumulation at the demolition site. Materials that cannot be removed daily shall be stored in areas specified by the COTR. Break up concrete slabs below grade that do not require removal from present location into pieces not exceeding 600 mm (24 inches) square to permit drainage. Contractor shall dispose debris in compliance with applicable federal, state or local permits, rules and/or regulations.
- C. In removing buildings and structures of more than two stories, demolish work story by story starting at highest level and progressing down to third floor level. Demolition of first and second stories may proceed simultaneously.
- D. Remove and legally dispose of all materials, other than earth to remain as part of project work, from any trash dumps shown. Materials removed shall become property of contractor and shall be disposed of in compliance with applicable federal, state or local permits, rules and/or regulations. All materials in the indicated trash dump areas, including above surrounding grade and extending to a depth of 1500mm (5feet) below surrounding grade, shall be included as part of the lump sum compensation for the work of this section. Materials that are located beneath the surface of the surrounding ground more than 1500 mm (5 feet), or materials that are discovered to be hazardous, shall be handled as unforeseen. The removal of hazardous material shall be referred to Hazardous Materials specifications.
- E. Remove existing utilities as indicated or uncovered by work and terminate in a manner conforming to the nationally recognized code covering the specific utility and approved by the COTR. When Utility lines are encountered that are not indicated on the drawings, the COTR shall be notified prior to further work in that area.

3.2 CLEAN-UP:

On completion of work of this section and after removal of all debris, leave site in clean condition satisfactory to COTR. Clean-up shall include off the Medical Center disposal of all items and materials not required to remain property of the Government as well as all debris and rubbish resulting from demolition operations.

- - - E N D - - -

SECTION 02 82 13.13
PIPE INSULATION - GLOVEBAG ASBESTOS ABATEMENT

TABLE OF CONTENTS

| | |
|--|----|
| SECTION 00 01 15 LIST OF DRAWING SHEETS | 1 |
| 1.1 GENERAL INTENTION | 1 |
| 1.2 STATEMENT OF BID ITEM(S) | 2 |
| 1.3 construction security requirements | 3 |
| 1.4 FIRE SAFETY | 4 |
| 1.5 OPERATIONS AND STORAGE AREAS | 6 |
| 1.6 ALTERATIONS | 9 |
| 1.7 INFECTION PREVENTION MEASURES | 10 |
| 1.8 DISPOSAL AND RETENTION | 12 |
| 1.9 PROTECTION OF EXISTING VEGETATION, STRUCTURES, EQUIPMENT, UTILITIES, AND IMPROVEMENTS | 12 |
| 1.10 RESTORATION | 13 |
| 1.11 As-Built Drawings | 14 |
| 1.12 USE OF ROADWAYS | 14 |
| 1.13 TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT | 14 |

| | |
|--|----|
| 1.14 TEMPORARY USE OF EXISTING ELEVATORS | 15 |
| 1.15 TEMPORARY TOILETS | 16 |
| 1.16 AVAILABILITY AND USE OF UTILITY SERVICES..... | 16 |
| 1.17 TESTS | 17 |
| 1.18 INSTRUCTIONS | 17 |
| 1.19 GOVERNMENT-FURNISHED PROPERTY | 18 |
| 1.20 RELOCATED EQUIPMENT/ITEMS..... | 19 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 AVAILABILITY OF SPECIFICATIONS LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS FPMR PART 101-29 (FAR 52.211-1) (AUG 1998) | 1 |
| 1.3 AVAILABILITY FOR EXAMINATION OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM descriptions (FAR 52.211-4) (JUN 1988) | 1 |
| 1.4 AVAILABILITY OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS (FAR 52.211-3) (JUN 1988) | 1 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 QUALITY CONTROL | 1 |

| | |
|---|----|
| 1.3 references | 1 |
| 1.4 SUBMITTALS | 2 |
| 1.5 PROTECTION OF ENVIRONMENTAL RESOURCES | 3 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 Contractual Relationships | 2 |
| 1.3 RELATED WORK | 3 |
| 1.4 SUMMARY | 3 |
| 1.5 DEFINITIONS | 3 |
| 1.6 SYSTEMS TO BE COMMISSIONED | 4 |
| 1.7 COMMISSIONING TEAM | 5 |
| 1.8 VA'S COMMISSIONING RESPONSIBILITIES | 5 |
| 1.9 CONTRACTOR'S COMMISSIONING RESPONSIBILITIES | 6 |
| 1.10 COMMISSIONING AGENT'S RESPONSIBILITIES | 6 |
| 1.11 COMMISSIONING DOCUMENTATION | 8 |
| 1.12 SUBMITTALS | 11 |
| 1.13 COMMISSIONING PROCESS | 12 |

| | |
|---|----|
| 1.14 QUALITY ASSURANCE | 13 |
| 1.15 COORDINATION | 13 |
| part 2 - PRODUCTS | 14 |
| 2.1 TEST EQUIPMENT | 14 |
| part 3 - EXECUTION | 14 |
| 3.1 STARTUP, INITIAL CHECKOUT, AND PRE-FUNCTIONAL CHECKLISTS | 14 |
| 3.2 DEFICIENCIES, NONCONFORMANCE, AND APPROVAL IN CHECKLISTS AND STARTUP | 16 |
| 3.3 PHASED COMMISSIONING | 16 |
| 3.4 TRENDING AND ALARMS | 16 |
| 3.5 SYSTEMS FUNCTIONAL PERFORMANCE TESTING | 32 |
| 3.6 DOCUMENTATION, NONCONFORMANCE AND APPROVAL OF TESTS | 35 |
| 3.7 DEFERRED TESTING | 37 |
| 3.8 OPERATION AND MAINTENANCE TRAINING REQUIREMENTS | 38 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION: | 1 |
| 1.2 RELATED WORK: | 1 |
| 1.3 PROTECTION: | 1 |

1.4 UTILITY SERVICES:2

PART 2 - PRODUCTS (Not Used)2

PART 3 – EXECUTION2

3.1 DEMOLITION:2

3.2 CLEAN-UP:3

PART 1 - GENERAL1

1.1 SUMMARY OF THE WORK1

1.1.1 CONTRACT DOCUMENTS AND RELATED REQUIREMENTS1

1.1.2 EXTENT OF WORK1

1.1.3 RELATED WORK1

1.1.4 TASKS2

1.1.5 ABATEMENT CONTRACTOR USE OF PREMISES2

1.2 VARIATIONS IN QUANTITY.....2

1.3 STOP ASBESTOS REMOVAL2

1.4 DEFINITIONS3

1.4.1 GENERAL.....3

1.4.2 GLOSSARY3

| | |
|---|----|
| 1.4.3 REFERENCED STANDARDS ORGANIZATIONS | 8 |
| 1.5 APPLICABLE CODES AND REGULATIONS | 9 |
| 1.5.1 GENERAL APPLICABILITY OF CODES, REGULATIONS, AND STANDARDS | 9 |
| 1.5.2 Asbestos Abatement CONTRACTOR RESPONSIBILITY | 9 |
| 1.5.3 FEDERAL REQUIREMENTS | 10 |
| 1.5.4 STATE REQUIREMENTS | 10 |
| 1.5.5 LOCAL REQUIREMENTS | 10 |
| 1.5.6 STANDARDS | 10 |
| 1.5.7 EPA GUIDANCE DOCUMENTS | 11 |
| 1.5.8 NOTICES | 11 |
| 1.5.9 PERMITS/LICENSES | 11 |
| 1.5.10 POSTING AND FILING OF REGULATIONS | 11 |
| 1.5.11 VA RESPONSIBILITIES | 11 |
| 1.5.12 EMERGENCY ACTION PLAN AND ARRANGEMENTS | 11 |
| 1.5.14 PRE-Construction MEETING | 12 |
| 1.6 PROJECT COORDINATION | 12 |
| 1.6.1 PERSONNEL | 13 |

| | |
|--|----|
| 1.7 RESPIRATORY PROTECTION | 13 |
| 1.7.1 GENERAL - RESPIRATORY PROTECTION PROGRAM | 13 |
| 1.7.2 RESPIRATORY PROTECTION PROGRAM COORDINATOR | 14 |
| 1.7.3 SELECTION AND USE OF RESPIRATORS | 14 |
| 1.7.4 MINIMUM RESPIRATORY PROTECTION | 14 |
| 1.7.5 MEDICAL WRITTEN OPINION | 14 |
| 1.7.6 RESPIRATOR FIT TEST | 14 |
| 1.7.7 RESPIRATOR FIT CHECK | 14 |
| 1.7.8 MAINTENANCE AND CARE OF RESPIRATORS | 14 |
| 1.8 WORKER PROTECTION | 14 |
| 1.8.1 TRAINING OF ABATEMENT PERSONNEL | 14 |
| 1.8.2 MEDICAL EXAMINATIONS | 15 |
| 1.8.3 personal PROTECTIVE EQUIPMENT | 15 |
| 1.8.4 REGULATED AREA ENTRY PROCEDURE | 15 |
| 1.8.5 DECONTAMINATION PROCEDURE | 15 |
| 1.8.6 REGULATED AREA REQUIREMENTS | 15 |
| 1.9 DECONTAMINATION FACILITIES | 16 |

| | |
|---|----|
| 1.9.1 DESCRIPTION | 16 |
| 1.9.2 GENERAL REQUIREMENTS | 16 |
| 1.9.3 TEMPORARY FACILITIES TO THE PDF and w/EDF | 16 |
| 1.9.4 PERSONNEL DECONTAMINATION FACILITY (PDF)..... | 16 |
| 1.9.5 waste/EQUIPMENT DECONTAMINATION FACILITY (w/EDF) | 17 |
| 1.9.6 waste/EQUIPMENT DECONTAMINATION PROCEDURES..... | 18 |
| PART 2 - PRODUCTS, MATERIALS AND EQUIPMENT | 18 |
| 2.1 MATERIALS AND EQUIPMENT | 18 |
| 2.1.1 GENERAL REQUIREMENTS (all abatement projects) | 18 |
| 2.1.2 NEGATIVE PRESSURE FILTRATION SYSTEM..... | 19 |
| 2.1.3 DESIGN AND LAYOUT | 20 |
| 2.1.4 NEGATIVE AIR MACHINES (HEPA UNITS) | 20 |
| 2.1.5 PRESSURE DIFFERENTIAL | 21 |
| 2.2 CONTAINMENT BARRIERS AND COVERINGS IN THE REGULATED AREA | 21 |
| 2.2.1 GENERAL | 21 |
| 2.2.2 PREPARATION PRIOR TO SEALING THE REGULATED AREA..... | 21 |
| 2.2.3 CONTROLLING ACCESS TO THE REGULATED AREA..... | 21 |

| | | |
|--|----|----|
| 2.2.4 CRITICAL BARRIERS | 21 | |
| 2.2.5 SECONDARY BARRIERS | 22 | |
| 2.2.6 EXTENSION OF THE REGULATED AREA | 22 | |
| 2.2.7 FIRESTOPPING | 22 | |
| 2.3 MONITORING, INSPECTION AND TESTING | 22 | |
| 2.3.1 GENERAL | 22 | |
| 2.3.2 SCOPE OF SERVICES OF THE VPIH/cih CONSULTANT | 23 | |
| 2.3.3 MONITORING, INSPECTION AND TESTING BY CONTRACTOR CPIH/CIH | 23 | 23 |
| 2.4 Asbestos hazard abatement plan | 24 | |
| 2.5 SUBMITTALS | 24 | |
| 2.5.1 PRE-start MEETING SUBMITTALS | 24 | |
| 2.5.2 SUBMITTALS DURING ABATEMENT | 25 | |
| 2.5.3 SUBMITTALS AT COMPLETION OF ABATEMENT | 26 | |
| 2.6 ENCAPSULANTS | 26 | |
| 2.6.1 TYPES OF ENCAPSULANTS | 26 | |
| 2.6.2 PERFORMANCE REQUIREMENTS | 26 | |
| 2.7 CERTIFICATES OF COMPLIANCE | 27 | |

| | |
|--|----|
| 2.8 RECYCLABLE PROTECTIVE CLOTHING | 27 |
| PART 3 – EXECUTION | 27 |
| 3.1 REGULATED AREA PREPARATIONS | 27 |
| 3.1.1 SITE SECURITY | 27 |
| 3.1.2 OSHA DANGER SIGNS | 27 |
| 3.1.3.1 SHUT DOWN - LOCK OUT ELECTRICAL | 28 |
| 3.1.3.2 SHUT DOWN - LOCK OUT HVAC | 28 |
| 3.1.4 CONTAINMENT BARRIERS AND COVERINGS FOR THE REGULATED AREA | 28 |
| 3.1.4.1 GENERAL | 28 |
| 3.1.4.2 PREPARATION PRIOR TO SEALING OFF | 28 |
| 3.1.4.3 CONTROLLING ACCESS TO THE REGULATED AREA | 28 |
| 3.1.4.4 CRITICAL BARRIERS | 28 |
| 3.1.4.5 EXTENSION OF THE REGULATED AREA | 29 |
| 3.1.4.6 floor barriers | 29 |
| 3.1.5 SANITARY FACILITIES | 29 |
| 3.1.6 Pre-Cleaning | 29 |
| 3.1.6.1 PRE-CLEANING MOVABLE OBJECTS | 29 |

| | |
|---|----|
| 3.1.6.2 PRE-CLEANING FIXED OBJECTS | 29 |
| 3.1.6.3 PRE-CLEANING SURFACES IN THE REGULATED AREA | 29 |
| 3.1.7 PRE-ABATEMENT ACTIVITIES | 30 |
| 3.1.7.1 PRE-ABATEMENT MEETING | 30 |
| 3.1.7.2 PRE-ABATEMENT INSPECTIONS AND PREPARATIONS | 30 |
| 3.1.7.3 PRE-ABATEMENT CONSTRUCTION AND OPERATIONS | 30 |
| 3.2 REMOVAL OF piping ACM | 31 |
| 3.2.1 WETTING MATERIALS | 31 |
| 3.2.2 SECONDARY BARRIER AND WALKWAYS | 31 |
| 3.2.3 WET REMOVAL OF ACM | 31 |
| 3.3 GLOVEBAG REMOVAL PROCEDURES | 31 |
| 3.3.1 GENERAL | 31 |
| 3.3.2 NEGATIVE PRESSURE GLOVEBAG PROCEDURE | 32 |
| 3.4 LOCKDOWN ENCAPSULATION | 32 |
| 3.4.1 GENERAL | 32 |
| 3.4.2 SEALING EXPOSED EDGES | 32 |
| 3.5 DISPOSAL OF ACM WASTE MATERIALS | 33 |

| | |
|--|----|
| 3.5.1 GENERAL | 33 |
| 3.5.2 PROCEDURES | 33 |
| 3.6 PROJECT DECONTAMINATION | 33 |
| 3.6.1 GENERAL | 33 |
| 3.6.2 REGULATED AREA CLEARANCE | 33 |
| 3.6.3 WORK DESCRIPTION | 33 |
| 3.6.4 PRE-DECONTAMINATION CONDITIONS | 34 |
| 3.6.5 FIRST CLEANING | 34 |
| 3.6.6 PRE-CLEARANCE INSPECTION AND TESTING | 34 |
| 3.6.7 LOCKDOWN ENCAPSULATION OF ABATED SURFACES | 34 |
| 3.7 FINAL VISUAL INSPECTIONS AND AIR CLEARANCE TESTING | 34 |
| 3.7.1 GENERAL | 34 |
| 3.7.2 FINAL VISUAL INSPECTION | 34 |
| 3.7.3 FINAL AIR CLEARANCE TESTING | 34 |
| 3.7.4 FINAL AIR CLEARANCE PROCEDURES | 35 |
| 3.7.5 CLEARANCE SAMPLING USING PCM | 35 |
| 3.7.6 CLEARANCE SAMPLING USING TEM | 35 |

| | |
|--|----|
| 3.7.7 LABORATORY TESTING OF PCM SAMPLES | 35 |
| 3.7.8 LABORATORY TESTING OF TEM SAMPLES | 36 |
| 3.8 ABATEMENT CLOSEOUT AND CERTIFICATE OF COMPLIANCE | 36 |
| 3.8.1 COMPLETION OF ABATEMENT WORK | 36 |
| 3.8.2 CERTIFICATE OF COMPLETION BY CONTRACTOR | 36 |
| 3.8.3 WORK SHIFTS | 36 |
| 3.8.4 RE-INSULATION | 36 |
| ATTACHMENT #1 | 37 |
| PART 1 - GENERAL | 1 |
| 1.1 SUMMARY OF THE WORK | 1 |
| 1.1.1 CONTRACT DOCUMENTS AND RELATED REQUIREMENTS | 1 |
| 1.1.2 EXTENT OF WORK | 1 |
| 1.1.3 RELATED WORK | 1 |
| 1.1.4 TASKS | 1 |
| 1.1.5 ABATEMENT CONTRACTOR USE OF PREMISES | 1 |
| 1.2 VARIATIONS IN QUANTITY | 2 |
| 1.3 STOP ASBESTOS REMOVAL | 2 |

| | |
|---|----|
| 1.4 DEFINITIONS | 2 |
| 1.4.1 GENERAL | 2 |
| 1.4.2 GLOSSARY | 3 |
| 1.4.3 REFERENCED STANDARDS ORGANIZATIONS | 7 |
| 1.5 APPLICABLE CODES AND REGULATIONS | 9 |
| 1.5.1 GENERAL APPLICABILITY OF CODES, REGULATIONS, AND STANDARDS | 9 |
| 1.5.2 CONTRACTOR RESPONSIBILITY | 9 |
| 1.5.3 FEDERAL REQUIREMENTS | 9 |
| 1.5.4 STATE REQUIREMENTS | 10 |
| 1.5.5 LOCAL REQUIREMENTS | 10 |
| 1.5.6 STANDARDS | 10 |
| 1.5.7 EPA GUIDANCE DOCUMENTS | 10 |
| 1.5.8 NOTICES | 10 |
| 1.5.9 PERMITS/LICENSES | 10 |
| 1.5.10 POSTING AND FILING OF REGULATIONS | 11 |
| 1.5.11 VA RESPONSIBILITIES | 11 |
| 1.5.13 EMERGENCY ACTION PLAN AND ARRANGEMENTS | 11 |

| | |
|--|----|
| 1.5.14 PRE-construction MEETING | 12 |
| 1.6 PROJECT COORDINATION | 12 |
| 1.6.1 PERSONNEL | 12 |
| 1.7 RESPIRATORY PROTECTION | 13 |
| 1.7.1 GENERAL - RESPIRATORY PROTECTION PROGRAM | 13 |
| 1.7.2 RESPIRATORY PROTECTION PROGRAM COORDINATOR | 13 |
| 1.7.3 SELECTION AND USE OF RESPIRATORS | 13 |
| 1.7.4 MINIMUM RESPIRATORY PROTECTION | 13 |
| 1.7.5 MEDICAL WRITTEN OPINION | 14 |
| 1.7.6 RESPIRATOR FIT TEST | 14 |
| 1.7.7 RESPIRATOR FIT CHECK | 14 |
| 1.7.8 MAINTENANCE AND CARE OF RESPIRATORS | 14 |
| 1.8 WORKER PROTECTION | 14 |
| 1.8.1 TRAINING OF ABATEMENT PERSONNEL | 14 |
| 1.8.2 MEDICAL EXAMINATIONS | 14 |
| 1.8.3 PERSONAL PROTECTIVE EQUIPMENT | 14 |
| 1.8.4 REGULATED AREA ENTRY PROCEDURE | 14 |

| | |
|--|----|
| 1.8.5 DECONTAMINATION PROCEDURE | 15 |
| 1.8.6 REGULATED AREA REQUIREMENTS | 15 |
| PART 2 - PRODUCTS, MATERIALS AND EQUIPMENT | 15 |
| 2.1 MATERIALS AND EQUIPMENT | 15 |
| 2.1.1 GENERAL REQUIREMENTS (all abatement projects) | 15 |
| 2.2 CONTAINMENT BARRIERS AND COVERINGS IN THE REGULATED AREA | 16 |
| 2.2.1 GENERAL | 16 |
| 2.2.3 CONTROLLING ACCESS TO THE REGULATED AREA..... | 17 |
| 2.2.4 CRITICAL BARRIERS | 17 |
| 2.2.5 secondary barriers | 17 |
| 2.2.6 EXTENSION OF THE REGULATED AREA | 17 |
| 2.3 MONITORING, INSPECTION AND TESTING | 17 |
| 2.3.1 GENERAL | 17 |
| 2.3.2 SCOPE OF SERVICES OF THE VPIH/CIH CONSULTANT | 18 |
| 2.3.3 MONITORING, INSPECTION AND TESTING BY CONTRACTOR CPIH/CIH | 19 |
| 2.4 asbestos hazard abatement plan | 19 |

| | |
|--|----|
| 2.5 SUBMITTALS | 20 |
| 2.5.1 PRE-start MEETING SUBMITTALS | 20 |
| 2.5.2 SUBMITTALS DURING ABATEMENT | 21 |
| 2.5.3 SUBMITTALS AT COMPLETION OF ABATEMENT | 21 |
| PART 3 - EXECUTION | 21 |
| 3.1 REGULATED AREA PREPARATIONS | 21 |
| 3.1.1 SITE SECURITY | 21 |
| 3.1.2 OSHA DANGER SIGNS | 22 |
| 3.1.3 SHUT DOWN - LOCK OUT ELECTRICAL | 22 |
| 3.1.4 SHUT DOWN - LOCK OUT HVAC | 22 |
| 3.1.5 LOCAL EXHAUST VENTILATION | 22 |
| 3.1.6 CONTAINMENT BARRIERS AND COVERINGS FOR THE REGULATED AREA | 23 |
| 3.1.6.1 GENERAL | 23 |
| 3.1.6.2 PREPARATION PRIOR TO SEALING OFF | 23 |
| 3.1.6.3 CONTROLLING ACCESS TO THE REGULATED AREA | 23 |
| 3.1.6.4 CRITICAL BARRIERS | 23 |
| 3.1.6.5 EXTENSION OF THE REGULATED AREA | 23 |

| | | |
|---|----|----|
| 3.1.7 PERSONAL PROTECTIVE EQUIPMENT | 23 | |
| 3.1.8 SANITARY FACILITIES | 23 | |
| 3.1.9 Pre-cleaning | 24 | |
| 3.1.9.1 PRE-CLEANING MOVABLE OBJECTS | 24 | |
| 3.1.9.2 PRE-CLEANING FIXED OBJECTS | 24 | |
| 3.1.9.3 PRE-CLEANING SURFACES IN THE REGULATED AREA | 24 | |
| 3.1.10 PRE-ABATEMENT ACTIVITIES | 24 | |
| 3.1.10.1 PRE-ABATEMENT MEETING | 24 | |
| 3.1.10.2 PRE-ABATEMENT INSPECTIONS AND PREPARATIONS | 24 | |
| 3.1.10.3 PRE-ABATEMENT CONSTRUCTION AND OPERATIONS | 25 | |
| 3.2 REMOVAL OF CLASS II Gasket MATERIALS | | 25 |
| GENERAL | 25 | |
| 3.3.1 GENERAL | 26 | |
| 3.4 PROJECT DECONTAMINATION | | 27 |
| 3.4.1 GENERAL | 27 | |
| 3.4.2 REGULATED AREA CLEARANCE | 27 | |
| 3.4.3 WORK DESCRIPTION | 27 | |

| | |
|--|----|
| 3.4.4 PRE-DECONTAMINATION CONDITIONS | 27 |
| 3.4.5. CLEANING | 27 |
| 3.5VISUAL INSPECTION AND AIR CLEARANCE TESTING | 27 |
| 3.5.1 GENERAL | 27 |
| 3.5.2 VISUAL INSPECTION | 28 |
| 3.5.3 AIR CLEARANCE TESTING | 28 |
| 3.5.4 final AIR CLEARANCE PROCEDURES | 28 |
| 3.6 ABATEMENT CLOSEOUT AND CERTIFICATE OF COMPLIANCE | 28 |
| 3.6.1 COMPLETION OF ABATEMENT WORK | 28 |
| 3.6.2 CERTIFICATE OF COMPLETION BY CONTRACTOR | 28 |
| 3.6.3 WORK SHIFTS | 29 |
| ATTACHMENT #1 | 30 |
| ATTACHMENT #3 | 32 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 SUBMITTALS | 1 |

1.4 QUALITY ASSURANCE1

1.5 APPLICABLE PUBLICATIONS2

PART 2 - PRODUCTS3

2.1 DESIGN CRITERIA3

2.2 MATERIALS3

2.3 HARDWARE4

2.4 FABRICATION GENERAL4

2.5 SUPPORTS.....7

2.6 GUARDS.....7

PART 3 - EXECUTION8

3.1 INSTALLATION, GENERAL8

3.2 INSTALLATION OF SUPPORTS8

3.3 GUARDS.....9

3.4 STEEL COMPONENTS FOR MILLWORK ITEMS9

3.5 CLEAN AND ADJUSTING9

PART 1 GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 SUBMITTALS1

1.4 DELIVERY AND STORAGE1

1.5 warranty1

1.6 QUALITY ASSURANCE1

1.7 APPLICABLE PUBLICATIONS1

PART 2 - PRODUCTS2

2.1 FIRESTOP SYSTEMS2

2.2 SMOKE STOPPING IN SMOKE PARTITIONS2

PART 3 - EXECUTION3

3.1 EXAMINATION3

3.2 PREPARATION3

3.3 INSTALLATION3

3.4 CLEAN-UP AND ACCEPTANCE OF WORK3

PART 1 - GENERAL1

1.1 DESCRIPTION:1

1.2 RELATED WORK:1

1.3 QUALITY CONTROL:1

1.4 SUBMITTALS:2

1.5 PROJECT CONDITIONS:2

1.6 DELIVERY, HANDLING, AND STORAGE:2

1.7 DEFINITIONS:2

1.8 warranty:2

1.9 APPLICABLE PUBLICATIONS:3

PART 2 - PRODUCTS3

2.1 SEALANTS:3

2.2 CAULKING COMPOUND:5

2.3 COLOR:5

2.4 JOINT SEALANT BACKING:5

2.5 FILLER:6

2.6 PRIMER:6

2.7 CLEANERS-NON POURIOUS SURFACES:6

PART 3 - EXECUTION6

3.1 INSPECTION:6

| | |
|--|----|
| 3.2 PREPARATIONS: | 6 |
| 3.3 BACKING INSTALLATION: | 7 |
| 3.4 SEALANT DEPTHS AND GEOMETRY: | 8 |
| 3.5 INSTALLATION: | 8 |
| 3.6 FIELD QUALITY CONTROL: | 9 |
| 3.7 CLEANING: | 9 |
| 3.8 LOCATIONS: | 9 |
| 1.5 DELIVERY, STORAGE AND HANDLING | 4 |
| 2.1 FACTORY-ASSEMBLED PRODUCTS | 5 |
| 2.2 COMPATIBILITY OF RELATED EQUIPMENT | 5 |
| 2.3 SAFETY GUARDS | 6 |
| 2.4 LIFTING ATTACHMENTS | 6 |
| 2.13 ASBESTOS | 12 |
| 3.2 TEMPORARY PIPING AND EQUIPMENT | 14 |
| 3.3 RIGGING | 14 |
| 3.6 Plumbing systems DEMOLITION | 16 |
| 3.7 CLEANING AND PAINTING | 16 |

3.8 IDENTIFICATION SIGNS17

3.11 OPERATION AND MAINTENANCE MANUALS18

PART 1 - GENERAL1

1.1 DESCRIPTION:1

1.2 RELATED WORK:1

1.4 APPLICABLE PUBLICATIONS:1

PART 2 - PRODUCTS2

2.1 MOTORS:2

PART 3 - EXECUTION5

3.1 INSTALLATION:5

3.2 FIELD TESTS5

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 SUBMITTALS1

1.4 APPLICABLE PUBLICATIONS1

1.5 AS-BUILT DOCUMENTATION1

PART 2 – PRODUCTS2

2.1 PRESSURE GAGES FOR WATER USAGE2

PART 3 - EXECUTION2

3.1 INSTALLATION2

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 SUBMITTALS1

1.4 APPLICABLE PUBLICATIONS1

1.5 DELIVERY, STORAGE, AND HANDLING2

PART 2 - PRODUCTS2

2.1 VALVES2

2.2 BACKFLOW PREVENTERS3

PART 3 - EXECUTION4

3.1 eXAMINATION4

3.2 VALVE INSTALLATION5

3.3 ADJUSTING5

PART 1 - GENERAL1

1.1 DESCRIPTION1

2.3 INSULATION FACINGS AND JACKETS5

2.4 pipe covering protection saddles6

2.5 adhesive, Mastic, Cement6

2.6 Mechanical Fasteners6

2.7 Reinforcement and Finishes6

2.8 Firestopping Material7

2.9 flame and smoke7

3.2 INSULATION INSTALLATION8

3.3 commissioning10

3.4 PIPE INSULATION SCHEDULE10

part 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 SUMMARY1

1.4 DEFINITIONS1

| | |
|---|---|
| 1.5 COMMISSIONED SYSTEMS | 1 |
| 1.6 SUBMITTALS | 1 |
| PART 2 - PRODUCTS (Not Used) | 2 |
| PART 3 - EXECUTION | 2 |
| 3.1 PRE-FUNCTIONAL CHECKLISTS | 2 |
| 3.2 CONTRACTORS TESTS | 2 |
| 3.3 SYSTEMS FUNCTIONAL PERFORMANCE TESTING: | 2 |
| 3.4 TRAINING OF VA PERSONNEL | 3 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 SUBMITTALS | 1 |
| 1.4 APPLICABLE PUBLICATIONS | 1 |
| 1.5 QUALITY ASSURANCE | 3 |
| 1.6 SPARE PARTS | 3 |
| PART 2 - PRODUCTS | 3 |
| 2.1 ABOVE GROUND (INTERIOR) WATER PIPING | 3 |

2.2 STRAINERS 4

2.3 DIELECTRIC FITTINGS 4

2.4 STERILIZATION CHEMICALS 4

PART 3 - EXECUTION 4

3.1 INSTALLATION 4

3.2 TESTS 6

3.3 STERILIZATION 6

3.4 commissioning 6

PART 1 - GENERAL 1

1.1 DESCRIPTION 1

1.2 RELATED WORK 1

1.3 SUBMITTALS 1

1.4 APPLICABLE PUBLICATIONS 1

PART 2 - PRODUCTS 2

2.1 INLINE HOT WATER RECIRCULATING PUMP 2

PART 3 - EXECUTION 2

3.1 startup and testing 2

3.2 commissioning2

3.3 demonstration and training3

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 QUALITY ASSURANCE1

1.4 SUBMITTALS3

1.5 APPLICABLE PUBLICATIONS4

1.6 DELIVERY, STORAGE AND HANDLING5

1.7 JOB CONDITIONS – work in existing Building6

PART 2 - PRODUCTS7

2.1 FACTORY-ASSEMBLED PRODUCTS7

2.2 COMPATIBILITY OF RELATED EQUIPMENT7

2.3 DRIVE GUARDS7

2.4 LIFTING ATTACHMENTS8

2.5 ELECTRIC MOTORS8

2.6 VARIABLE SPEED MOTOR CONTROLLERS8

| | |
|--|----|
| 2.7 EQUIPMENT AND MATERIALS IDENTIFICATION | 8 |
| 2.8 FIRESTOPPING | 9 |
| 2.9 GALVANIZED REPAIR COMPOUND | 9 |
| 2.10 hvac PIPE AND EQUIPMENT SUPPORTS AND RESTRAINTS | 9 |
| 2.11 PIPE PENETRATIONS | 11 |
| 2.12 SPECIAL TOOLS AND LUBRICANTS | 12 |
| 2.13 WALL, FLOOR AND CEILING PLATES | 13 |
| 2.14 ASBESTOS | 13 |
| PART 3 - EXECUTION | 13 |
| 3.1 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING | 13 |
| 3.2 TEMPORARY PIPING AND EQUIPMENT | 15 |
| 3.3 RIGGING | 15 |
| 3.4 PIPE AND EQUIPMENT SUPPORTS | 16 |
| 3.5 MECHANICAL DEMOLITION | 17 |
| 3.6 CLEANING AND PAINTING | 17 |
| 3.7 IDENTIFICATION SIGNS | 18 |
| 3.8 MOTOR AND DRIVE ALIGNMENT | 19 |

3.9 LUBRICATION19

3.10 commissioning19

3.11 STARTUP AND TEMPORARY OPERATION20

3.12 OPERATING AND PERFORMANCE TESTS20

3.13 INSTRUCTIONS TO VA PERSONNEL20

PART 1 - GENERAL1

1.1 DESCRIPTION:1

1.2 RELATED WORK:1

1.3 SUBMITTALS:1

1.4 APPLICABLE PUBLICATIONS:1

PART 2 - PRODUCTS2

2.1 MOTORS:2

PART 3 - EXECUTION5

3.1 INSTALLATION:5

3.2 FIELD TESTS5

3.3 startup and testing5

3.4 commissioning5

3.5 Demonstration and training5

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 QUALITY ASSURANCE1

1.4 SUBMITTALS2

1.5 APPLICABLE PUBLICATIONS3

PART 2 - PRODUCTS4

2.1 GENERAL Requirements4

2.2 VIBRATION ISOLATORS4

PART 3 - EXECUTION5

3.1 INSTALLATION5

3.2 ADJUSTING5

3.3 commissioning5

3.4 SELECTION GUIDE FOR VIBRATION ISOLATORS6

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 QUALITY ASSURANCE2

1.4 SUBMITTALS3

1.5 APPLICABLE PUBLICATIONS4

PART 2 - PRODUCTS4

2.1 INSULATION REPAIR MATERIAL4

PART 3 - EXECUTION4

3.1 GENERAL4

3.2 design review report4

3.3 systems inspection report4

3.4 system readiness report4

3.5 tab reports5

3.6 TAB PROCEDURES5

3.7 VIBRATION TESTING5

3.8 SOUND TESTING6

3.9 Marking of Settings7

3.10 Phasing7

3.11 COmmissioning 7

PART 1 - GENERAL 1

1.1 DESCRIPTION 1

1.2 RELATED WORK 2

1.3 QUALITY ASSURANCE 2

1.4 SUBMITTALS 4

1.5 STORAGE AND HANDLING OF MATERIAL 4

1.6 APPLICABLE PUBLICATIONS 4

PART 2 - PRODUCTS 6

2.1 MINERAL FIBER or fiber glass 6

2.2 CELLULAR GLASS closed-cell 6

2.3 INSULATION FACINGS AND JACKETS 6

2.5 Removable insulation jackets 7

2.6 pipe covering protection saddles 7

2.7 adhesive, Mastic, Cement 8

2.8 Mechanical Fasteners 8

2.9 Reinforcement and Finishes 8

2.10 Firestopping Material 8

2.11 flame and smoke 8

PART 3 - EXECUTION 9

3.1 GENERAL REQUIREMENTS 9

3.2 INSULATION INSTALLATION 10

3.3 commissioning 12

3.4 PIPE INSULATION SCHEDULE 12

PART 1 - GENERAL 1

1.1 DESCRIPTION 1

1.2 RELATED WORK 1

1.3 SUMMARY 1

1.4 DEFINITIONS 1

1.5 COMMISSIONED SYSTEMS 1

1.6 SUBMITTALS 2

PART 2 - PRODUCTS (Not Used) 2

PART 3 - EXECUTION 2

3.1 PRE-FUNCTIONAL CHECKLISTS 2

| | |
|--|----|
| 3.2 CONTRACTORS TESTS | 2 |
| 3.3 SYSTEMS FUNCTIONAL PERFORMANCE TESTING: | 3 |
| 3.4 TRAINING OF VA PERSONNEL | 3 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 4 |
| 1.3 definitionS | 4 |
| 1.4 quality assurance | 8 |
| 1.5 performance | 9 |
| 1.6 Warranty | 11 |
| 1.7 SUBMITTALS | 11 |
| 1.8 INSTRUCTIONS | 13 |
| 1.9 project CONDITIONS (Environmental Conditions of Operation) | 13 |
| 1.10 applicable publications | 14 |
| PART 2 - PRODUCTS | 15 |
| 2.1 MATERIALS | 15 |
| 2.2 Controls System Architecture | 15 |

| | |
|---|----|
| 2.3 COMMUNICATION | 16 |
| 2.4 Engineering Control Center (ECC) | 17 |
| 2.5 PORTABLE OPERATOR'S TERMINAL (pot) | 17 |
| 2.6 BACnet protocol analyzer | 18 |
| 2.7 NETWORK AND DEVICE NAMING CONVENTION | 18 |
| 2.8 BACnet DEVICES | 19 |
| 2.9 CONTROLLERS | 19 |
| 2.10 sensors (air, water and steam) | 22 |
| 2.11 Control cables | 24 |
| 2.12 THERMOSTATS AND HUMIDISTATS | 25 |
| 2.13 FINAL CONTROL ELEMENTS AND OPERATORS | 25 |
| PART 3 - EXECUTION | 26 |
| 3.1 INSTALLATION | 26 |
| 3.2 SYSTEM VALIDATION AND DEMONSTRATION | 29 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |

| | |
|---|----|
| 1.3 QUALITY ASSURANCE | 1 |
| 1.4 SUBMITTALS | 1 |
| 1.5 APPLICABLE PUBLICATIONS | 2 |
| 1.6 Spare parts | 5 |
| PART 2 - PRODUCTS | 5 |
| 2.1 PIPE AND EQUIPMENT SUPPORTS, PIPE SLEEVES, AND WALL AND CEILING PLATES | 5 |
| 2.2 PIPE AND TUBING | 5 |
| 2.3 FITTINGS FOR STEEL PIPE | 5 |
| 2.4 FITTINGS FOR COPPER TUBING | 6 |
| 2.5 DIELECTRIC FITTINGS | 6 |
| 2.6 SCREWED JOINTS | 6 |
| 2.7 VALVES | 6 |
| 2.8 STRAINERS | 9 |
| 2.9 FLEXIBLE CONNECTORS FOR WATER SERVICE | 9 |
| 2.10 HYDRONIC SYSTEM COMPONENTS | 9 |
| 2.11 WATER FILTERS AND POT CHEMICAL FEEDERS | 9 |
| 2.12 GAGES, PRESSURE AND COMPOUND | 10 |

2.13 PRESSURE/TEMPERATURE TEST PROVISIONS10

2.14 THERMOMETERS10

2.15 FIRESTOPPING MATERIAL10

PART 3 - EXECUTION10

3.1 GENERAL10

3.2 PIPE JOINTS12

3.3 LEAK TESTING ABOVEGROUND PIPING12

3.4 FLUSHING AND CLEANING PIPING SYSTEMS12

3.5 WATER TREATMENT13

3.6 OPERATING AND PERFORMANCE TEST AND INSTRUCTION13

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 QUALITY ASSURANCE1

1.4 SUBMITTALS2

1.5 APPLICABLE PUBLICATIONS2

1.6 Definitions2

| | |
|---|---|
| 1.7 SPARE MATERIALS | 3 |
| PART 2 - PRODUCTS | 3 |
| 2.1 CENTRIFUGAL PUMPS, BRONZE FITTED | 3 |
| PART 3 – EXECUTION | 4 |
| 3.1 INSTALLATION | 4 |
| 3.2 START-UP | 4 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 QUALITY ASSURANCE | 1 |
| 1.4 SUBMITTALS | 1 |
| 1.5 APPLICABLE PUBLICATIONS | 2 |
| PART 2 - PRODUCTS | 3 |
| 2.1 PIPE AND EQUIPMENT SUPPORTS, PIPE SLEEVES, AND WALL AND CEILING PLATES | 3 |
| 2.2 PIPE AND TUBING | 3 |
| 2.3 FITTINGS FOR STEEL PIPE | 4 |
| 2.4 FITTINGS FOR COPPER TUBING | 4 |

2.5 DIELECTRIC FITTINGS 4

2.6 VALVES 5

2.7 STRAINERS 6

2.8 STEAM SYSTEM COMPONENTS 7

2.9 GAGES, PRESSURE AND COMPOUND 11

2.10 PRESSURE/TEMPERATURE TEST PROVISIONS 11

2.11 FIRESTOPPING MATERIAL 11

PART 3 - EXECUTION 11

3.1 GENERAL 11

L.Provide a 25 mm (1 inch) bypass pipe with globe valve for warm-up on all butterfly valves, gate valve

3.2 PIPE JOINTS 13

3.3 STEAM TRAP PIPING 13

3.4 LEAK TESTING 13

3.5 FLUSHING AND CLEANING PIPING SYSTEMS 13

3.6 OPERATING AND PERFORMANCE TEST AND INSTRUCTION 13

PART 1 - GENERAL 1

1.1 DESCRIPTION 1

| | |
|---|---|
| 1.2 RELATED WORK | 1 |
| 1.3 QUALITY ASSURANCE | 1 |
| 1.4 SUBMITTALS | 1 |
| 1.5 APPLICABLE PUBLICATIONS | 2 |
| PART 2 - PRODUCTS | 2 |
| 2.1 CLEANING COMPOUNDS | 2 |
| 2.2 CHEMICAL TREATMENT FOR CLOSED LOOP SYSTEMS..... | 2 |
| 2.3 EQUIPMENT AND MATERIALS IDENTIFICATION | 3 |
| PART 3 - EXECUTION | 3 |
| 3.1 INSTALLATION | 3 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 QUALITY ASSURANCE | 1 |
| 1.4 SUBMITTALS | 1 |
| 1.5 APPLICABLE PUBLICATIONS | 1 |
| 1.6 GUARANTY | 2 |

PART 2 - PRODUCTS2

2.1 UNIT HEATERS2

PART 3 - EXECUTION2

3.1 INSTALLATION2

3.2 OPERATIONAL TEST2

3.3 STARTup and testing2

3.4 COMmissioning3

3.5 demonstration and training3

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 MINIMUM REQUIREMENTS1

1.3 TEST STANDARDS1

1.4 QUALIFICATIONS (PRODUCTS AND SERVICES)2

1.5 APPLICABLE PUBLICATIONS2

1.6 MANUFACTURED PRODUCTS2

1.7 variations from contract requirements3

1.8 MATERIALS AND EQUIPMENT PROTECTION3

1.9 WORK PERFORMANCE 3

1.10 EQUIPMENT INSTALLATION AND REQUIREMENTS 4

1.11 EQUIPMENT IDENTIFICATION 4

1.12 SUBMITTALS 5

1.13 SINGULAR NUMBER 6

1.14 Acceptance Checks and Tests 6

1.15 WARRANTY 6

1.16 instruction 7

1.17 DRAWINGS AND SPECIFICATIONS 7

1.18 Record Drawings 8

1.19 Final Inspection and Punch List 8

PART 2 - PRODUCTS (Not used) 9

PART 3 - EXECUTION (Not used) 9

PART 1 - GENERAL 1

1.1 DESCRIPTION 1

1.2 RELATED WORK 1

1.3 quality ASSURANCE 1

1.4 FACTORY TESTS1

1.5 SUBMITTALS1

1.6 APPLICABLE PUBLICATIONS2

PART 2 - PRODUCTS2

2.1 conductors and CABLES2

2.2 SPLICES3

2.3 CONNECTORS and terminations3

2.4 CONTROL WIRING4

2.5 WIRE LUBRICATING COMPOUND4

PART 3 - EXECUTION4

3.1 GENERAL4

3.2 SPLICE and termination INSTALLATION5

3.3 conductor identification5

3.4 FEEDER conductor IDENTIFICATION5

3.5 existing conductors5

3.6 CONTROL WIRING INSTALLATION5

3.7 CONTROL wiring IDENTIFICATION5

3.8 Acceptance Checks and Tests5

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 quality ASSURANCE1

1.4 SUBMITTALS1

1.5 APPLICABLE PUBLICATIONS2

PART 2 - PRODUCTS2

2.1 GROUNDING AND BONDING CONDUCTORS2

PART 3 - EXECUTION2

3.1 GENERAL2

3.2 raceway3

3.3 corrosion inhibitors3

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 quality ASSURANCE1

1.4 SUBMITTALS1

1.5 APPLICABLE PUBLICATIONS2

PART 2 - PRODUCTS2

2.1 MATERIAL2

PART 3 - EXECUTION4

3.1 PENETRATIONS4

3.2 INSTALLATION, GENERAL5

3.3 CONCEALED WORK INSTALLATION6

3.4 EXPOSED WORK INSTALLATION.....6

3.5 MOTORS AND VIBRATING EQUIPMENT.....6

3.6 EXPANSION JOINTS.....6

3.7 CONDUIT SUPPORTS, INSTALLATION.....7

3.8 BOX INSTALLATION7

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 quality ASSURANCE1

1.4 SUBMITTALS1

1.5 APPLICABLE PUBLICATIONS2

PART 2 - PRODUCTS2

2.1 general requirements2

2.2 enclosures and trims3

2.3 MOLDED CASE CIRCUIT BREAKERS3

2.4 Surge PROTECTIVE DEVICES4

PART 3 - EXECUTION4

3.1 INSTALLATION4

3.2 Acceptance Checks and Tests4

3.3 Follow-Up Verification5

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 quality ASSURANCE1

1.4 SUBMITTALS1

1.5 APPLICABLE PUBLICATIONS2

PART 2 - PRODUCTS3

2.1 MOTOR CONTROLLERS3

2.2 MAGNETIC MOTOR CONTROLLERS4

2.3 low-voltage VARIABLE FREQUENCY DRIVES (VFD)4

PART 3 - EXECUTION7

3.1 INSTALLATION7

3.2 Acceptance Checks and Tests7

3.3 FOLLOW-UP VERIFICATION.....8

3.4 SPARE PARTS8

3.5 INSTRUCTION8

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 quality ASSURANCE1

1.4 SUBMITTALS1

1.5 APPLICABLE PUBLICATIONS2

PART 2 - PRODUCTS2

2.1 FUSEd SWITCHES RATED 600 AMPERES AND LESS2

2.2 UNFUSED SWITCHES RATED 600 AMPERES AND LESS.....3

PART 3 - EXECUTION3

3.1 INSTALLATION3

3.2 Acceptance Checks and Tests3

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 QUALITY ASSURANCE1

1.4 SUBMITTALS1

1.5 APPLICABLE PUBLICATIONS1

PART 2 - PRODUCTS2

2.1 PANELBOARD TVSS2

2.3 ENCLOSURES2

PART 3 - EXECUTION2

3.1 INSTALLATION2

3.2 Acceptance Checks and Tests3

3.3 Follow-Up Verification3

PART 1 - GENERAL1

1.1 DESCRIPTION OF WORK:1

1.2 DEFINITIONS:1

1.3 RELATED WORK:2

1.4 CLASSIFICATION OF EXCAVATION:2

1.5 APPLICABLE PUBLICATIONS:3

PART 2 - PRODUCTS4

2.1 MATERIALS:4

PART 3 - EXECUTION5

3.1 SITE PREPARATION:5

3.2 EXCAVATION:5

3.3 FILLING AND BACKFILLING:7

3.4 Disposal of unsuitable and excess excavated material:8

3.5 CLEAN UP:8

PART 1 - GENERAL**1.1 SUMMARY OF THE WORK****1.1.1 CONTRACT DOCUMENTS AND RELATED REQUIREMENTS**

Drawings, general provisions of the contract, including general and supplementary conditions and other Division 01 specifications, shall apply to the work of this section. The contract documents show the work to be done under the contract and related requirements and conditions impacting the project. Related requirements and conditions include applicable codes and regulations, notices and permits, existing site conditions and restrictions on use of the site, requirements for partial owner occupancy during the work, coordination with other work and the phasing of the work. In the event the Asbestos Abatement Contractor discovers a conflict in the contract documents and/or requirements or codes, the conflict must be brought to the immediate attention of the Contracting Officer for resolution. Whenever there is a conflict or overlap in the requirements, the most stringent shall apply. Any actions taken by the Contractor without obtaining guidance from the Contracting Officer shall become the sole risk and responsibility of the Asbestos Abatement Contractor. All costs incurred due to such action are also the responsibility of the Asbestos Abatement Contractor.

1.1.2 EXTENT OF WORK

- A. Below is a brief description of the estimated quantities of asbestos containing pipe insulation materials to be abated by the glovebag method while under a negative pressure enclosure. These quantities are for informational purposes only and are based on the best information available at the time of the specification preparation. The Contractor shall satisfy himself as the actual quantities to be abated. Nothing in this section may be interpreted as limiting the extent of work otherwise required by this contract and related documents.
- B. Removal, clean-up and disposal of asbestos-containing pipe insulation (including fitting insulation and asbestos contaminated elements) using glovebags inside of a regulated negative pressure enclosure with respect to the following approximate quantities:
 - Approximately 20 total hard cementitious asbestos-containing fittings on fiberglass insulated lines (6 ~6" outer diameter fittings; 2 ~10" outer diameter fittings; and 12 ~ 16" outer diameter fittings), located in the pipe basement (sub-basement), area B of building 1 (see drawing 1-DS2 for approximate locations).
 - Approximately 36 total linear feet of asbestos-containing block insulation (including hard fittings) (out diameter insulation is ~6" or less) located in mechanical room B904 of building 1 (see drawing 1-MD91 for approximate locations).
 - Approximately 220 total linear feet of asbestos-containing block insulation (including hard fittings) (outer diameter is ~6" or less) located in basement rooms A023 and A023a of building 1 (room A023a has an open ceiling, and room A023 has a hard plaster ceiling) (see drawing 1-DB3 for approximate locations).
 - Approximately 35 total hard cementitious asbestos-containing fittings on fiberglass insulated lines (outer diameter is ~6" or less) located above ceilings in rooms B315, B316, B317, and B317 AHU 1 room of building 1 (see drawing 1-DB3 for approximate locations).
 - Please note that the Prime Contractor will be responsible for obtaining a professional industrial hygienist (PIH) to perform the role of the VA professional industrial hygienist (VPIH) during asbestos abatement activities (abatement oversight, monitoring, and clearance testing). The VPIH will report to the VA project engineer.

1.1.3 RELATED WORK

- A. Section 07 84 00, FIRESTOPPING.
- B. Section 02 41 00, DEMOLITION.
- C. Division 22, PLUMBING.
- D. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING / Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION

- E. Section 23 07 11, HVAC AND BOILER PLANT INSULATION.
- F. Section 22 05 19, METERS AND GAGES FOR PLUMBING PIPING / Section 22 05 23, GENERAL-DUTY VALVES FOR PLUMBING PIPING / Section 22 11 00, FACILITY WATER DISTRIBUTION.
- G. Section 23 21 13, HYDRONIC PIPING / Section 23 22 13, STEAM AND CONDENSATE HEATING PIPING.

1.1.4 TASKS

The work tasks are summarized briefly as follows:

- A. Pre-abatement activities including pre-abatement meeting(s), inspection(s), notifications, permits, submittal approvals, work-site preparations, emergency procedures arrangements, and Asbestos Hazard Abatement Plans for glovebag asbestos abatement work.
- B. Abatement activities including removal, clean-up and disposal of ACM waste, recordkeeping, security, monitoring, and inspections.
- C. Cleaning and decontamination activities including final visual inspection, air monitoring and certification of decontamination.

1.1.5 ABATEMENT CONTRACTOR USE OF PREMISES

- A. The Contractor and Contractor's personnel shall cooperate fully with the VA representative/consultant to facilitate efficient use of buildings and areas within buildings. The Contractor shall perform the work in accordance with the VA specifications, drawings, phasing plan and in compliance with any/all applicable Federal, State and Local regulations and requirements.
- B. The Contractor shall use the existing facilities in the building strictly within the limits indicated in contract documents as well as the approved VA Design and Construction Procedures. VA Design and Construction Procedures drawings of partially occupied buildings will show the limits of regulated areas; the placement of decontamination facilities; the temporary location of bagged waste ACM; the path of transport to outside the building; and the temporary waste storage area for each building/regulated area. Any variation from the arrangements shown on drawings shall be secured in writing from the VA representative through the pre-abatement plan of action.

1.2 VARIATIONS IN QUANTITY

The quantities and locations of ACM as indicated on the drawings and the extent of work included in this section are estimated, which are limited by the physical constraints imposed by occupancy of the buildings and accessibility to ACM. Accordingly, minor variations (+/- 25%) in quantities of ACM within the regulated area are considered as having no impact on contract price and time requirements of this contract. Where additional work is required beyond the above variation, the contractor shall provide unit prices for newly discovered ACM and those prices shall be used for additional work required under the contractor.

1.3 STOP ASBESTOS REMOVAL

If the Contracting Officer; their field representative; (the facility Safety Officer/Manager or their designee, or the VA Professional Industrial Hygienist/ Certified Industrial Hygienist (VPIH/CIH) presents a verbal **Stop Asbestos Removal Order**, the Contractor/Personnel shall immediately stop all asbestos removal and maintain HEPA filtered negative pressure air flow in the containment and adequately wet any exposed ACM. If a verbal Stop Asbestos Removal Order is issued, the VA shall follow-up with a written order to the Contractor as soon as it is practicable. The Contractor shall not resume any asbestos removal activity until authorized to do so in writing by the VA Contracting Officer. A stop asbestos removal order may be issued at any time the VA Contracting Officer determines abatement conditions/activities are not within VA specification, regulatory requirements or that an imminent hazard exists to human health or the environment. Work stoppage will continue until conditions have been corrected to the satisfaction of the VA. Standby time and costs for corrective actions will be borne by the Contractor, including the VPIH/CIH time. The occurrence of any of the following events shall be reported immediately by the Contractor's competent person to the VA Contracting Office or field representative using the

most expeditious means (e.g., verbal or telephonic), followed up with written notification to the Contracting Officer as soon as practical. The Contractor shall immediately stop asbestos removal/disturbance activities and initiate fiber reduction activities:

- A. Airborne PCM analysis results equal to or greater than 0.01 f/cc outside a regulated area or >0.05 f/cc inside a regulated area;
- B. breach or break in regulated area containment barrier(s);
- C. less than -0.02" WCG pressure in the regulated area;
- D. serious injury/death at the site;
- E. fire/safety emergency at the site;
- F. respiratory protection system failure;
- G. power failure or loss of wetting agent; or
- H. any visible emissions observed outside the regulated area.

1.4 DEFINITIONS

1.4.1 GENERAL

Definitions and explanations here are neither complete nor exclusive of all terms used in the contract documents, but are general for the work to the extent they are not stated more explicitly in another element of the contract documents. Drawings must be recognized as diagrammatic in nature and not completely descriptive of the requirements indicated therein.

1.4.2 GLOSSARY

Abatement - Procedures to control fiber release from asbestos-containing materials. Includes removal, encapsulation, enclosure, demolition, and renovation activities related to asbestos containing materials (ACM).

Aerosol - Solid or liquid particulate suspended in air.

Adequately wet - Sufficiently mixed or penetrated with liquid to prevent the release of particulates. If visible emissions are observed coming from the ACM, then that material has not been adequately wetted.

Aggressive method - Removal or disturbance of building material by sanding, abrading, grinding, or other method that breaks, crumbles, or disintegrates intact ACM.

Aggressive sampling - EPA AHERA defined clearance sampling method using air moving equipment such as fans and leaf blowers to aggressively disturb and maintain in the air residual fibers after abatement.

AHERA - Asbestos Hazard Emergency Response Act. Asbestos regulations for schools issued in 1987.

Aircell - Pipe or duct insulation made of corrugated cardboard which contains asbestos.

Air monitoring - The process of measuring the fiber content of a known volume of air collected over a specified period of time. The NIOSH 7400 Method, Issue 2 is used to determine the fiber levels in air. For personal samples and clearance air testing using Phase Contrast Microscopy (PCM) analysis. NIOSH Method 7402 can be used when it is necessary to confirm fibers counted by PCM as being asbestos. The AHERA TEM analysis may be used for background, area samples and clearance samples when required by this specification, or at the discretion of the VPIH/CIH as appropriate.

Air sample filter - The filter used to collect fibers which are then counted. The filter is made of mixed cellulose ester membrane for PCM (Phase Contrast Microscopy) and polycarbonate for TEM (Transmission Electron Microscopy)

Amended water - Water to which a surfactant (wetting agent) has been added to increase the penetrating ability of the liquid.

Asbestos - Includes chrysotile, amosite, crocidolite, tremolite asbestos, anthophyllite asbestos, actinolite asbestos, and any of these minerals that have been chemically treated or altered. Asbestos also includes PACM, as defined below.

Asbestos Hazard Abatement Plan (AHAP) - Asbestos work procedures required to be submitted by the contractor before work begins.

Asbestos-containing material (ACM) - Any material containing more than one percent of asbestos.

Asbestos contaminated elements (ACE) - Building elements such as ceilings, walls, lights, or ductwork that are contaminated with asbestos.

Asbestos-contaminated soil (ACS) – Soil found in the work area or in adjacent areas such as crawlspaces or pipe tunnels which is contaminated with asbestos-containing material debris and cannot be easily separated from the material.

Asbestos-containing waste (ACW) material - Asbestos-containing material or asbestos contaminated objects requiring disposal.

Asbestos Project Monitor – Some states require that any person conducting asbestos abatement clearance inspections and clearance air sampling be licensed as an asbestos project monitor.

Asbestos waste decontamination facility - A system consisting of drum/bag washing facilities and a temporary storage area for cleaned containers of asbestos waste. Used as the exit for waste and equipment leaving the regulated area. In an emergency, it may be used to evacuate personnel.

Authorized person - Any person authorized by the VA, the Contractor, or government agency and required by work duties to be present in regulated areas.

Authorized visitor - Any person approved by the VA; the contractor; or any government agency representative having jurisdiction over the regulated area (e.g., OSHA, Federal and State EPA).

Barrier - Any surface that isolates the regulated area and inhibits fiber migration from the regulated area.

Containment Barrier - An airtight barrier consisting of walls, floors, and/or ceilings of sealed plastic sheeting which surrounds and seals the outer perimeter of the regulated area.

Critical Barrier - The barrier responsible for isolating the regulated area from adjacent spaces, typically constructed of plastic sheeting secured in place at openings such as doors, windows, or any other opening into the regulated area.

Primary Barrier – Plastic barriers placed over critical barriers and exposed directly to abatement work.

Secondary Barrier - Any additional plastic barriers used to isolate and provide protection from debris during abatement work.

Breathing zone - The hemisphere forward of the shoulders with a radius of about 150 - 225 mm (6 - 9 inches) from the worker's nose.

Bridging encapsulant - An encapsulant that forms a layer on the surface of the ACM.

Building/facility owner - The legal entity, including a lessee, which exercises control over management and recordkeeping functions relating to a building and/or facility in which asbestos activities take place.

Bulk testing - The collection and analysis of suspect asbestos containing materials.

Certified Industrial Hygienist (CIH) - A person certified in the comprehensive practice of industrial hygiene by the American Board of Industrial Hygiene.

Class I asbestos work - Activities involving the removal of Thermal System Insulation (TSI) and surfacing ACM and Presumed Asbestos Containing Material (PACM).

Class II asbestos work - Activities involving the removal of ACM which is not thermal system insulation or surfacing material. This includes, but is not limited to, the removal of asbestos-containing wallboard, floor tile and sheeting, roofing and siding shingles, and construction mastic.

Clean room/Changing room - An uncontaminated room having facilities for the storage of employee's street clothing and uncontaminated materials and equipment.

Clearance sample - The final air sample taken after all asbestos work has been done and visually inspected. Performed by the VA's professional industrial hygiene consultant/Certified Industrial Hygienist (VPIH/CIH).

Closely resemble - The major workplace conditions which have contributed to the levels of historic asbestos exposure, are no more protective than conditions of the current workplace.

Competent person - In addition to the definition in 29 CFR 1926.32(f), one who is capable of identifying existing asbestos hazards in the workplace and selecting the appropriate control strategy for asbestos exposure, who has the authority to take prompt corrective measures to eliminate them, as specified in 29 CFR 1926.32(f); in addition, for Class I and II work who is specially trained in a training course which meets the criteria of EPA's Model Accreditation Plan (40 CFR 763) for supervisor.

Contractor's Professional Industrial Hygienist (CPIH/CIH) - The asbestos abatement contractor's industrial hygienist. The industrial hygienist must meet the qualification requirements of a PIH. The Contractor's Competent Person may also be considered as the role of the CPIH.

Count - Refers to the fiber count or the average number of fibers greater than five microns in length with a length-to-width (aspect) ratio of at least 3 to 1, per cubic centimeter of air.

Crawlspace - An area which can be found either in or adjacent to the work area. This area has limited access and egress and may contain asbestos materials and/or asbestos contaminated soil.

Decontamination area/unit - An enclosed area adjacent to and connected to the regulated area and consisting of an equipment room, shower room, and clean room, which is used for the decontamination of workers, materials, and equipment that are contaminated with asbestos.

Demolition - The wrecking or taking out of any load-supporting structural member and any related razing, removing, or stripping of asbestos products.

VA Total - means a building or substantial part of the building is completely removed, torn or knocked down, bulldozed, flattened, or razed, including removal of building debris.

Disposal bag - Typically 6 mil thick sift-proof, dustproof, leak-tight container used to package and transport asbestos waste from regulated areas to the approved landfill. Each bag/container must be labeled/marked in accordance with EPA, OSHA and DOT requirements.

Disturbance - Activities that disrupt the matrix of ACM or PACM, crumble or pulverize ACM or PACM, or generate visible debris from ACM or PACM. Disturbance includes cutting away small amounts of ACM or PACM, no greater than the amount that can be contained in one standard sized glove bag or waste bag, in order to access a building component. In no event shall the amount of ACM or PACM so disturbed exceed that which can be contained in one glove bag or disposal bag and shall not exceed 60 inches in length or width.

Drum - A rigid, impermeable container made of cardboard fiber, plastic, or metal which can be sealed in order to be sift-proof, dustproof, and leak-tight.

Employee exposure - The exposure to airborne asbestos that would occur if the employee were not wearing respiratory protection equipment.

Encapsulant - A material that surrounds or embeds asbestos fibers in an adhesive matrix and prevents the release of fibers.

Encapsulation - Treating ACM with an encapsulant.

Enclosure - The construction of an air tight, impermeable, permanent barrier around ACM to control the release of asbestos fibers from the material and also eliminate access to the material.

Equipment room - A contaminated room located within the decontamination area that is supplied with impermeable bags or containers for the disposal of contaminated protective clothing and equipment.

Fiber - A particulate form of asbestos, 5 microns or longer, with a length to width (aspect) ratio of at least 3 to 1.

Fibers per cubic centimeter (f/cc) - Abbreviation for fibers per cubic centimeter, used to describe the level of asbestos fibers in air.

Filter - Media used in respirators, vacuums, or other machines to remove particulate from air.

Firestopping - Material used to close the open parts of a structure in order to prevent a fire from spreading.

Friable asbestos containing material - Any material containing more than one (1) percent or asbestos as determined using the method specified in appendix A, Subpart F, 40 CFR 763, section 1, Polarized Light Microscopy, that, when dry, can be crumbled, pulverized, or reduced to powder by hand pressure.

Glovebag - Not more than a 60 x 60 inch impervious plastic bag-like enclosure affixed around an asbestos-containing material, with glove-like appendages through which materials and tools may be handled.

High efficiency particulate air (HEPA) filter - An ASHRAE MERV 17 filter capable of trapping and retaining at least 99.97 percent of all mono-dispersed particles of 0.3 micrometers in diameter.

HEPA vacuum - Vacuum collection equipment equipped with a HEPA filter system capable of collecting and retaining asbestos fibers.

Homogeneous area - An area of surfacing, thermal system insulation or miscellaneous ACM that is uniform in color, texture and date of application.

HVAC - Heating, Ventilation and Air Conditioning

Industrial hygienist (IH) - A professional qualified by education, training, and experience to anticipate, recognize, evaluate and develop controls for occupational health hazards.

Industrial hygienist technician (IH Technician) - A person working under the direction of an IH or CIH who has special training, experience, certifications and licenses required for the industrial hygiene work assigned. Some states require that an industrial hygienist technician conducting asbestos abatement clearance inspection and clearance air sampling be licensed as an asbestos project monitor.

Intact - The ACM has not crumbled, been pulverized, or otherwise deteriorated so that the asbestos is no longer likely to be bound with its matrix.

Lockdown - Applying encapsulant, after a final visual inspection, on all abated surfaces at the conclusion of ACM removal prior to removal of critical barriers.

National Emission Standards for Hazardous Air Pollutants (NESHAP) - EPA's rule to control emissions of asbestos to the environment (40 CFR Part 61, Subpart M).

Negative initial exposure assessment - A demonstration by the employer which complies with the criteria in 29 CFR 1926.1101 (f)(2)(iii), that employee exposure during an operation is expected to be consistently below the PEL.

Negative pressure - Air pressure which is lower than the surrounding area, created by exhausting air from a sealed regulated area through HEPA equipped filtration units. OSHA requires maintaining -0.02" water column gauge inside the negative pressure enclosure.

Negative pressure respirator - A respirator in which the air pressure inside the facepiece is negative during inhalation relative to the air pressure outside the respirator facepiece.

Non-friable ACM - Material that contains more than 1 percent asbestos but cannot be crumbled, pulverized, or reduced to powder by hand pressure.

Organic vapor cartridge - The type of cartridge used on air purifying respirators to remove organic vapor hazardous air contaminants.

Outside air - The air outside buildings and structures, including, but not limited to, the air under a bridge or in an open ferry dock.

Owner/operator - Any person who owns, leases, operates, controls, or supervises the facility being demolished or renovated or any person who owns, leases, operates, controls, or supervises the demolition or renovation operation, or both.

Penetrating encapsulant - Encapsulant that is absorbed into the ACM matrix without leaving a surface layer.

Personal protective equipment (PPE) - equipment designed to protect user from injury and/or specific job hazard. Such equipment may include protective clothing, hard hats, safety glasses, and respirators.

Personal sampling/monitoring - Representative air samples obtained in the breathing zone for one or more workers within the regulated area using a filter cassette and a calibrated air sampling pump to determine asbestos exposure.

Permissible exposure limit (PEL) - The level of exposure OSHA allows for an 8 hour time weighted average. For asbestos fibers, the eight (8) hour time weighted average PEL is 0.1 fibers per cubic centimeter (0.1 f/cc) of air and the 30-minute Excursion Limit is 1.0 fibers per cubic centimeter (1 f/cc).

Pipe tunnel - An area, typically located adjacent to mechanical spaces or boiler rooms in which the pipes servicing the heating system in the building are routed to allow the pipes to access heating elements. These areas may contain asbestos pipe insulation, asbestos fittings, or asbestos-contaminated soil.

Polarized light microscopy (PLM) - Light microscopy using dispersion staining techniques and refractive indices to identify and quantify the type(s) of asbestos present in a bulk sample.

Polyethylene sheeting - Strong plastic barrier material 4 to 6 mils thick, semi-transparent, flame retardant per NFPA 241.

Positive/negative fit check - A method of verifying the seal of a facepiece respirator by temporarily occluding the filters and breathing in (inhaling) and then temporarily occluding the

exhalation valve and breathing out (exhaling) while checking for inward or outward leakage of the respirator respectively.

Presumed ACM (PACM) - Thermal system insulation, surfacing, and flooring material installed in buildings prior to 1981. If the building owner has actual knowledge, or should have known through the exercise of due diligence that other materials are ACM, they too must be treated as PACM. The designation of PACM may be rebutted pursuant to 29 CFR 1926.1101 (b).

Professional IH - An IH who meets the definition requirements of OSHA as a "Competent Person" at 29 CFR 1926.1101 (b); has completed the specialized EPA approved course on management and supervision of asbestos abatement projects; has formal training in respiratory protection and waste disposal; and has a minimum of four projects of similar complexity with this project of which at least three projects serving as the supervisory IH. The PIH may be either the VA's PIH (VPIH) or Contractor's PIH (CPIH/CIH).

Assigned Protection factor - A value assigned by OSHA/NIOSH to indicate the expected protection provided by each respirator class, when the respirator is properly selected and worn correctly. The number indicates the reduction of exposure level from outside to inside the respirator facepiece.

Qualitative fit test (QLFT) - A fit test using a challenge material that can be sensed by the wearer if leakage in the respirator occurs.

Quantitative fit test (QNFT) - A fit test using a challenge material which is quantified outside and inside the respirator thus allowing the determination of the actual fit factor.

Regulated area - An area established by the employer to demarcate where Class I, II, III asbestos work is conducted, and any adjoining area where debris and waste from such asbestos work may accumulate; and a work area within which airborne concentrations of asbestos exceed, or there is a reasonable possibility they may exceed the PEL.

Regulated ACM (RACM) - Friable ACM; Category I non-friable ACM that has become friable; Category I non-friable ACM that will be or has been subjected to sanding, grinding, cutting, or abrading or; Category II non-friable ACM that has a high probability of becoming or has become crumbled, pulverized, or reduced to powder by the forces expected to act on the material in the course of the demolition or renovation operation.

Removal - All operations where ACM, PACM and/or RACM is taken out or stripped from structures or substrates, including demolition operations.

Renovation - Altering a facility or one or more facility components in any way, including the stripping or removal of asbestos from a facility component which does not involve demolition activity.

Repair - Overhauling, rebuilding, reconstructing, or reconditioning of structures or substrates, including encapsulation or other repair of ACM or PACM attached to structures or substrates.

Shower room - The portion of the PDF where personnel shower before leaving the regulated area.

Supplied air respirator (SAR) - A respiratory protection system that supplies minimum Grade D respirable air per ANSI/Compressed Gas Association Commodity Specification for Air, G-7.1-1989.

Surfacing ACM - A material containing more than 1 percent asbestos that is sprayed, troweled on or otherwise applied to surfaces for acoustical, fireproofing and other purposes.

Surfactant - A chemical added to water to decrease water's surface tension thus making it more penetrating into ACM.

Thermal system ACM - A material containing more than 1 percent asbestos applied to pipes, fittings, boilers, breeching, tanks, ducts, or other structural components to prevent heat loss or gain.

Transmission electron microscopy (TEM) - A microscopy method that can identify and count asbestos fibers.

VA Professional Industrial Hygienist (VPIH/CIH) - The Department of Veterans Affairs Professional Industrial Hygienist must meet the qualifications of a PIH.

VA Representative - The VA official responsible for on-going project work.

Visible emissions - Any emissions, which are visually detectable without the aid of instruments, coming from ACM/PACM/RACM/ACS or ACM waste material.

Waste/Equipment decontamination facility (W/EDF) – The area in which equipment is decontaminated before removal from the regulated area.

Waste generator - Any owner or operator whose act or process produces asbestos-containing waste material.

Waste shipment record - The shipping document, required to be originated and signed by the waste generator, used to track and substantiate the disposition of asbestos-containing waste material.

Wet cleaning - The process of thoroughly eliminating, by wet methods, any asbestos contamination from surfaces or objects.

1.4.3 REFERENCED STANDARDS ORGANIZATIONS

The following acronyms or abbreviations as referenced in contract/ specification documents are defined to mean the associated names. Names and addresses may be subject to change.

- A. VA Department of Veterans Affairs
810 Vermont Avenue, NW
Washington, DC 20420
- B. AIHA American Industrial Hygiene Association
2700 Prosperity Avenue, Suite 250
Fairfax, VA 22031
703-849-8888
- C. ANSI American National Standards Institute
1430 Broadway
New York, NY 10018
212-354-3300
- D. ASTM American Society for Testing and Materials
1916 Race St.
Philadelphia, PA 19103
215-299-5400
- E. CFR Code of Federal Regulations
Government Printing Office
Washington, DC 20420
- F. CGA Compressed Gas Association
1235 Jefferson Davis Highway
Arlington, VA 22202
703-979-0900
- G. CS Commercial Standard of the National Institute of Standards and Technology(NIST)
U. S. Department of Commerce
Government Printing Office
Washington, DC 20420
- H. EPA Environmental Protection Agency
401 M St., SW
Washington, DC 20460
202-382-3949
- I. MIL-STD Military Standards/Standardization Division
Office of the Assistant Secretary of Defense
Washington, DC 20420

- J. NIST National Institute for Standards and Technology
U. S. Department of Commerce
Gaithersburg, MD 20234
301-921-1000
- K. NEC National Electrical Code (by NFPA)
- L. NEMA National Electrical Manufacturer's Association
2101 L Street, NW
Washington, DC 20037
- M. NFPA National Fire Protection Association
1 Batterymarch Park
P.O. Box 9101
Quincy, MA 02269-9101
800-344-3555
- N. NIOSH National Institutes for Occupational Safety and Health
4676 Columbia Parkway
Cincinnati, OH 45226
513-533-8236
- O. OSHA Occupational Safety and Health Administration
U.S. Department of Labor
Government Printing Office
Washington, DC 20402
- P. UL Underwriters Laboratory
333 Pfingsten Rd.
Northbrook, IL 60062
312-272-8800

1.5 APPLICABLE CODES AND REGULATIONS

1.5.1 GENERAL APPLICABILITY OF CODES, REGULATIONS, AND STANDARDS

- A. All work under this contract shall be done in strict accordance with all applicable Federal, State, and local regulations, standards and codes governing asbestos abatement, and any other trade work done in conjunction with the abatement. All applicable codes, regulations and standards are adopted into this specification and will have the same force and effect as this specification.
- B. The most recent edition of any relevant regulation, standard, document or code shall be in effect. Where conflict among the requirements or with these specifications exists, the most stringent requirement(s) shall be utilized.
- C. Copies of all standards, regulations, codes and other applicable documents, including this specification and those listed in Section 1.5 shall be available at the worksite in the clean change area of the worker decontamination system.

1.5.2 ASBESTOS ABATEMENT CONTRACTOR RESPONSIBILITY

The Asbestos Abatement Contractor (Contractor) shall assume full responsibility and liability for compliance with all applicable Federal, State and Local regulations related to any and all aspects of the asbestos abatement project. The Contractor is responsible for providing and maintaining training, accreditations, medical exams, medical records, personal protective equipment (PPE) including respiratory protection including respirator fit testing, as required by applicable Federal, State and Local regulations. The Contractor shall hold the VA and VPIH/CIH consultants harmless for any Contractor's failure to comply with any applicable work, packaging, transporting, disposal, safety, health, or environmental requirement on the part of himself, his employees, or his subcontractors. The Contractor will incur all costs of the CPIH/CIH, including all

sampling/analytical costs to assure compliance with OSHA/EPA/State requirements related to failure to comply with the regulations applicable to the work.

1.5.3 FEDERAL REQUIREMENTS

Federal requirements which govern some aspect of asbestos abatement include, but are not limited to, the following regulations.

- A. Occupational Safety and Health Administration (**OSHA**)
 - 1. Title 29 CFR 1926.1101 - Construction Standard for Asbestos
 - 2. Title 29 CFR 1910 Subpart I - Personal Protective Equipment
 - 3. Title 29 CFR 1910.134 - Respiratory Protection
 - 4. Title 29 CFR 1926 - Construction Industry Standards
 - 5. Title 29 CFR 1910.1020 - Access to Employee Exposure and Medical Records
 - 6. Title 29 CFR 1910.1200 - Hazard Communication
 - 7. Title 29 CFR 1910 Subpart K - Medical and First Aid
- B. Environmental Protection Agency (**EPA**)
 - 1. 40 CFR 61 Subpart A and M (Revised Subpart B) - National Emission Standard for Hazardous Air Pollutants - Asbestos.
 - 2. 40 CFR 763.80 - Asbestos Hazard Emergency Response Act (AHERA)
- C. Department of Transportation (**DOT**)
 - Title 49 CFR 100 - 185 – Transportation

1.5.4 STATE REQUIREMENTS

State requirements that apply to the asbestos abatement work, disposal, clearance, etc., include, but are not limited to, the following:

- A. Ohio Environmental Protection Agency (EPA)
 - 1. Ohio Administrative Code (OAC), Chapter 3745-20
- B. Ohio Department of Health
 - 1. Ohio Administrative Code (OAC), Chapter 3701-34

1.5.5 LOCAL REQUIREMENTS

If local requirements are more stringent than federal or state standards, the local standards are to be followed.

1.5.6 STANDARDS

- A. Standards which govern asbestos abatement activities include, but are not limited to, the following:
 - 1. American National Standards Institute (ANSI) Z9.2-79 - Fundamentals Governing the Design and Operation of Local Exhaust Systems and ANSI Z88.2 - Practices for Respiratory Protection.
 - 2. Underwriters Laboratories (UL) 586-90 - UL Standard for Safety of HEPA filter Units, 7th Edition.
- B. Standards which govern encapsulation work include, but are not limited to, the following:
 - 1. American Society for Testing and Materials (ASTM)
- C. Standards which govern the fire and safety concerns in abatement work include, but are not limited to, the following:
 - 1. National Fire Protection Association (NFPA) 241 - Standard for Safeguarding Construction, Alteration, and Demolition Operations.
 - 2. NFPA 701 - Standard Methods for Fire Tests for Flame Resistant Textiles and Film.
 - 3. NFPA 101 - Life Safety Code

1.5.7 EPA GUIDANCE DOCUMENTS

- A. EPA guidance documents which discuss asbestos abatement work activities are listed below. These documents are made part of this section by reference. EPA publications can be ordered from (800) 424-9065.
- B. Guidance for Controlling ACM in Buildings (Purple Book) EPA 560/5-85-024
- C. Asbestos Waste Management Guidance EPA 530-SW-85-007.
- D. A Guide to Respiratory Protection for the Asbestos Abatement Industry EPA-560-OPTS-86-001
- E. Guide to Managing Asbestos in Place (Green Book) TS 799 20T July 1990

1.5.8 NOTICES

- A. State and Local agencies: Send written notification as required by state and local regulations including the local fire department prior to beginning any work on ACM as follows:
- B. Copies of notifications shall be submitted to the VA for the facility's records in the same time frame notification are given to EPA, State, and Local authorities.

1.5.9 PERMITS/LICENSES

The contractor shall apply for and have all required permits and licenses to perform asbestos abatement work as required by Federal, State, and Local regulations.

1.5.10 POSTING AND FILING OF REGULATIONS

Maintain two (2) copies of applicable federal, state, and local regulations. Post one copy of each at the regulated area where workers will have daily access to the regulations and keep another copy in the Contractor's office.

1.5.11 VA RESPONSIBILITIES

Prior to commencement of work:

- A. Notify occupants adjacent to regulated areas of project dates and requirements for relocation, if needed. Arrangements must be made prior to starting work for relocation of desks, files, equipment, and personal possessions to avoid unauthorized access into the regulated area. **Note: Notification of adjacent personnel is required by OSHA in 29 CFR 1926.1101 (k) to prevent unnecessary or unauthorized access to the regulated area.**
- B. Submit to the Contractor results of background air sampling; including location of samples, person who collected the samples, equipment utilized, calibration data and method of analysis. During abatement, submit to the Contractor, results of bulk material analysis and air sampling data collected during the course of the abatement. This information shall not release the Contractor from any responsibility for OSHA compliance.

1.5.12 EMERGENCY ACTION PLAN AND ARRANGEMENTS

- A. An Emergency Action Plan shall be developed by prior to commencing abatement activities and shall be agreed to by the Contractor and the VA. The Plan shall meet the requirements of 29 CFR 1910.38 (a); (b).
- B. Emergency procedures shall be in written form and prominently posted in the clean room and equipment room of the decontamination unit. Everyone, prior to entering the regulated area, must read and sign these procedures to acknowledge understanding of the regulated area layout, location of emergency exits and emergency procedures.
- C. Emergency planning shall include written notification of police, fire, and emergency medical personnel of planned abatement activities; work schedule; layout of regulated area; and access to the regulated area, particularly barriers that may affect response capabilities.
- D. Emergency planning shall include consideration of fire, explosion, hazardous atmospheres, electrical hazards, slips/trips and falls, confined spaces, and heat stress illness. Written procedures for response to emergency situations shall be developed and employee training in procedures shall be provided.

- E. Employees shall be trained in regulated area/site evacuation procedures in the event of workplace emergencies.
 - 1. For non life-threatening situations - employees injured or otherwise incapacitated shall decontaminate following normal procedures with assistance from fellow workers, if necessary, before exiting the regulated area to obtain proper medical treatment.
 - 2. For life-threatening injury or illness, worker decontamination shall take least priority after measures to stabilize the injured worker, remove them from the regulated area, and secure proper medical treatment.
- F. Telephone numbers of any/all emergency response personnel shall be prominently posted in the clean room, along with the location of the nearest telephone.
- G. The Contractor shall provide verification of first aid/CPR training for personnel responsible for providing first aid/CPR. OSHA requires medical assistance within 3-4 minutes of a life-threatening injury/illness. Bloodborne Pathogen training shall also be verified for those personnel required to provide first aid/CPR.
- H. The Emergency Action Plan shall provide for a Contingency Plan in the event that an incident occurs that may require the modification of the Asbestos Hazard Abatement Plans during abatement. Such incidents include, but are not limited to, fire; accident; power failure; negative pressure failure; and supplied air system failure. The Contractor shall detail procedures to be followed in the event of an incident assuring that asbestos abatement work is stopped and wetting is continued until correction of the problem.

1.5.14 PRE-CONSTRUCTION MEETING

Prior to commencing the work, the Contractor shall meet with the VPCIH to present and review, as appropriate, the items following this paragraph. The Contractor's Competent Person(s) who will be on-site shall participate in the pre-start meeting. The pre-start meeting is to discuss and determine procedures to be used during the project. At this meeting, the Contractor shall provide:

- A. Proof of Contractor licensing.
- B. Proof the Competent Person is trained and accredited and approved for working in this State. Verification of the experience of the Competent Person shall also be presented.
- C. A list of all workers who will participate in the project, including experience and verification of training and accreditation.
- D. A list of and verification of training for all personnel who have current first-aid/CPR training. A minimum of one person per shift must have adequate training.
- E. Current medical written opinions for all personnel working on-site meeting the requirements of 29 CFR 1926.1101 (m).
- F. Current fit-tests for all personnel wearing respirators on-site meeting the requirements of 29 CFR 1926.1101 (h) and Appendix C.
- G. A copy of the Contractor's Asbestos Hazard Abatement Plan. In these procedures, the following information must be detailed, specific for this project. A copy of the Contractor's Asbestos Hazard Abatement Plan (AHAP) for Class I Glovebag Asbestos Abatement. In these procedures, the following information must be detailed, specific for this project.
 - 1. Regulated area preparation procedures;
 - 2. Notification requirements procedure of Contractor as required in 29 CFR 1926.1101 (d);
 - 3. If required, decontamination area set-up/layout and decontamination procedures for employees;
 - 4. Glovebag abatement methods/procedures and equipment to be used; and
 - 5. Personal protective equipment to be used.
- H. At this meeting the Contractor shall provide all submittals as required.
- I. Procedures for handling, packaging and disposal of asbestos waste.
- J. Emergency Action Plan and Contingency Plan Procedures.

1.6 PROJECT COORDINATION

The following are the minimum administrative and supervisory personnel necessary for coordination of the work.

1.6.1 PERSONNEL

- A. Administrative and supervisory personnel shall consist of a qualified Competent Person(s) as defined by OSHA in the Construction Standards and the Asbestos Construction Standard; Contractor Professional Industrial Hygienist and Industrial Hygiene Technicians. These employees are the Contractor's representatives responsible for compliance with these specifications and all other applicable requirements.
- B. Non-supervisory personnel shall consist of an adequate number of qualified personnel to meet the schedule requirements of the project. Personnel shall meet required qualifications. Personnel utilized on-site shall be pre-approved by the VA representative. A request for approval shall be submitted for any person to be employed during the project giving the person's name; social security number; qualifications; accreditation card with color picture; Certificate of Worker's Acknowledgment; and Affidavit of Medical Surveillance and Respiratory Protection and current Respirator Fit Test.
- C. Minimum qualifications for Contractor and assigned personnel are:
 - 1. The Contractor has conducted within the last three (3) years, three (3) projects of similar complexity and dollar value as this project; has not been cited and penalized for serious violations of federal (and state as applicable) EPA and OSHA asbestos regulations in the past three (3) years; has adequate liability/occurrence insurance for asbestos work as required by the state; is licensed in applicable states; has adequate and qualified personnel available to complete the work; has comprehensive Asbestos Hazard Abatement Plans (AHAPs) for asbestos work; and has adequate materials, equipment and supplies to perform the work.
 - 2. The Competent Person has four (4) years of abatement experience of which two (2) years were as the Competent Person on the project; meets the OSHA definition of a Competent Person; has been the Competent Person on two (2) projects of similar size and complexity as this project within the past three (3) years; has completed EPA AHERA/OSHA/State/Local training requirements/accreditation(s) and refreshers; and has all required OSHA documentation related to medical and respiratory protection.
 - 3. The Contractor Professional Industrial Hygienist/CIH (CPIH/CIH) may also be the Contractor's Competent Person provided that: he or she shall have four (4) years of monitoring experience and supervision of asbestos abatement projects; has participated as a competent person on four (4) abatement projects, three (3) of which are similar in size and complexity as this project; has developed at least one complete Asbestos Hazard Abatement Plan for asbestos abatement; has field trained abatement personnel for three (3) years; has specialized EPA AHERA/OSHA training in asbestos abatement supervision, respiratory protection, and waste disposal; has completed the Contractor/Supervisor course; and has appropriate medical/respiratory protection records/documentation.
 - 4. The Abatement Personnel shall have completed the EPA AHERA/OSHA abatement worker course; have training on the Asbestos Hazard Abatement Plans of the Contractor; has one year of asbestos abatement experience within the past three (3) years of similar size and complexity; has applicable medical and respiratory protection documentation; has certificate of training/current refresher and State accreditation/license.

All personnel should be in compliance with OSHA construction safety training as applicable and submit certification.

1.7 RESPIRATORY PROTECTION

1.7.1 GENERAL - RESPIRATORY PROTECTION PROGRAM

The Contractor shall develop and implement a written Respiratory Protection Program (RPP) which is in compliance with the January 8, 1998 OSHA requirements found at 29 CFR 1926.1101 and 29 CFR 1910 Subpart I;134. ANSI Standard Z88.2-1992 provides excellent guidance for developing a respiratory protection program. All respirators used must be NIOSH approved for asbestos abatement activities. The written RPP shall, at a minimum, contain the basic requirements found at 29 CFR 1910.134 (c)(1)(i - ix) - Respiratory Protection Program.

1.7.2 RESPIRATORY PROTECTION PROGRAM COORDINATOR

The Respiratory Protection Program Coordinator (RPPC) must be identified and shall have two (2) years experience coordinating RPP of similar size and complexity. The RPPC must submit a signed statement attesting to the fact that the program meets the above requirements.

1.7.3 SELECTION AND USE OF RESPIRATORS

The procedure for the selection and use of respirators must be submitted to the VA as part of the Contractor's qualifications. The procedure must be written clearly enough for workers to understand. A copy of the Respiratory Protection Program must be available in the clean room of the decontamination unit for reference by employees or authorized visitors.

1.7.4 MINIMUM RESPIRATORY PROTECTION

Minimum respiratory protection shall be a full face powered air purifying respirator when fiber levels are maintained consistently at or below 0.5 f/cc. A higher level of respiratory protection may be provided or required, depending on fiber levels. Respirator selection shall meet the requirements of 29 CFR 1926.1101 (h); Table 1, except as indicated in this paragraph. Abatement personnel must have a respirator for their exclusive use.

1.7.5 MEDICAL WRITTEN OPINION

No employee shall be allowed to wear a respirator unless a physician or other licensed health care professional has provided a written determination they are medically qualified to wear the class of respirator to be used on the project while wearing whole body impermeable garments and subjected to heat or cold stress.

1.7.6 RESPIRATOR FIT TEST

All personnel wearing respirators shall have a current quantitative fit test which was conducted in accordance with 29 CFR 1910.134 (f) and Appendix A. Fit tests shall be done for PAPR's which have been put into a failure mode.

1.7.7 RESPIRATOR FIT CHECK

The Competent Person shall assure that the positive/negative pressure user seal check is done each time the respirator is donned by an employee. Head coverings must cover respirator head straps. Any situation that prevents an effective facepiece to face seal as evidenced by failure of a user seal check shall preclude that person from wearing a respirator inside the regulated area until resolution of the problem.

1.7.8 MAINTENANCE AND CARE OF RESPIRATORS

The Respiratory Protection Program Coordinator shall submit evidence and documentation showing compliance with 29 CFR 1910.134 (h) maintenance and care of respirators.

1.8 WORKER PROTECTION**1.8.1 TRAINING OF ABATEMENT PERSONNEL**

Prior to beginning any abatement activity, all personnel shall be trained in accordance with OSHA 29 CFR 1926.1101 (k)(9) and any additional State/Local requirements. Training must include, at a minimum, the elements listed at 29 CFR 1926.1101 (k)(9)(viii). Training shall have been conducted by a third party, EPA/State approved trainer meeting the requirements of EPA 40 CFR 763 Appendix C (AHERA MAP). Initial training certificates and current refresher and accreditation proof must be submitted for each person working at the site.

1.8.2 MEDICAL EXAMINATIONS

Medical examinations meeting the requirements of 29 CFR 1926.1101 (m) shall be provided for all personnel working in the regulated area, regardless of exposure levels. A current physician's written opinion as required by 29 CFR 1926.1101 (m)(4) shall be provided for each person and shall include in the medical opinion the person has been evaluated for working in a heat and cold stress environment while wearing personal protective equipment (PPE) and is able to perform the work without risk of material health impairment.

1.8.3 PERSONAL PROTECTIVE EQUIPMENT

Provide whole body clothing, head coverings, foot coverings and any other personal protective equipment as determined by conducting the hazard assessment required by OSHA at 29 CFR 1910.132 (d). The Competent Person shall ensure the integrity of personal protective equipment worn for the duration of the project. Duct tape shall be used to secure all suit sleeves to wrists and to secure foot coverings at the ankle.

1.8.4 REGULATED AREA ENTRY PROCEDURE

The Competent Person shall ensure that each time workers enter the regulated area; they remove ALL street clothes in the clean room of the decontamination unit and put on new disposable coveralls, head coverings, a clean respirator, and then proceed through the shower room to the equipment room where they put on non-disposable required personal protective equipment.

1.8.5 DECONTAMINATION PROCEDURE

The Competent Person shall require all personnel to adhere to following decontamination procedures whenever they leave the regulated area.

- A. When exiting the regulated area, remove disposable coveralls, and ALL other clothes, disposable head coverings, and foot coverings or boots in the equipment room.
- B. Still wearing the respirator and completely naked, proceed to the shower. Showering is MANDATORY. Care must be taken to follow reasonable procedures in removing the respirator to avoid inhaling asbestos fibers while showering. The following procedure is required as a minimum:
 1. Thoroughly wet body including hair and face. If using a PAPR hold blower above head to keep filters dry.
 2. With respirator still in place, thoroughly decontaminate body, hair, respirator face piece, and all other parts of the respirator except the blower and battery pack on a PAPR. Pay particular attention to cleaning the seal between the face and respirator facepiece and under the respirator straps.
 3. Take a deep breath, hold it and/or exhale slowly, completely wetting hair, face, and respirator. While still holding breath, remove the respirator and hold it away from the face before starting to breathe.
- C. Carefully decontaminate the facepiece of the respirator inside and out. If using a PAPR, shut down using the following sequence: a) first cap inlets to filters; b) turn blower off to keep debris collected on the inlet side of the filter from dislodging and contaminating the outside of the unit; c) thoroughly decontaminate blower and hoses; d) carefully decontaminate battery pack with a wet rag being cautious of getting water in the battery pack thus preventing destruction. **(THIS PROCEDURE IS NOT A SUBSTITUTE FOR RESPIRATOR CLEANING!)**
- D. Shower and wash body completely with soap and water. Rinse thoroughly.
- E. Rinse shower room walls and floor to drain prior to exiting.
- F. Proceed from shower to clean room; dry off and change into street clothes or into new disposable work clothing.

1.8.6 REGULATED AREA REQUIREMENTS

The Competent Person shall meet all requirements of 29 CFR 1926.1101 (o) and assure that all requirements for Class I glovebag regulated areas at 29 CFR 1926.1101 (e) are met. All

personnel in the regulated area shall not be allowed to eat, drink, smoke, chew tobacco or gum, apply cosmetics, or in any way interfere with the fit of their respirator.

1.9 DECONTAMINATION FACILITIES

1.9.1 DESCRIPTION

Provide each regulated area with separate personnel decontamination facilities (PDF) and waste/equipment decontamination facilities (W/EDF). Ensure that the PDF are the only means of ingress and egress to the regulated area and that all equipment, bagged waste, and other material exit the regulated area only through the W/EDF.

1.9.2 GENERAL REQUIREMENTS

All personnel entering or exiting a regulated area must go through the PDF and shall follow the requirements at 29 CFR 1926.1101 (j)(1) and these specifications. All waste, equipment and contaminated materials must exit the regulated area through the W/EDF and be decontaminated in accordance with these specifications. Walls and ceilings of the PDF and W/EDF must be constructed of a minimum of 3 layers of 6 mil opaque fire retardant polyethylene sheeting and be securely attached to existing building components and/or an adequate temporary framework. A minimum of 3 layers of 6 mil poly shall also be used to cover the floor under the PDF and W/EDF units. Construct doors so that they overlap and secure to adjacent surfaces. Weight inner doorway sheets with layers of duct tape so that they close quickly after release. Put arrows on sheets so they show direction of travel and overlap. If the building adjacent area is occupied, construct a solid barrier on the occupied side(s) to protect the sheeting and reduce potential for non-authorized personnel entering the regulated area.

1.9.3 TEMPORARY FACILITIES TO THE PDF AND W/EDF


The Competent Person shall provide temporary water service connections to the PDF and W/EDF. Backflow prevention must be provided at the point of connection to the VA system. Water supply must be of adequate pressure and meet requirements of 29 CFR 1910.141(d)(3). Provide adequate temporary overhead electric power with ground fault circuit interruption (GFCI) protection. Provide a sub-panel equipped with GFCI protection for all temporary power in the clean room. Provide adequate lighting to provide a minimum of 50 foot candles in the PDF and W/EDF. Provide temporary heat, if needed, to maintain 70°F throughout the PDF and W/EDF.

1.9.4 PERSONNEL DECONTAMINATION FACILITY (PDF)

The Competent Person shall provide a PDF consisting of shower room which is contiguous to a clean room and equipment room. The PDF must be sized to accommodate the number of personnel scheduled for the project. The shower room, located in the center of the PDF, shall be fitted with as many portable showers as necessary to insure all employees can complete the entire decontamination procedure within 15 minutes. The PDF shall be constructed of opaque poly for privacy. The PDF shall be constructed to eliminate any parallel routes of egress without showering.

1. Clean Room: The clean room must be physically and visually separated from the rest of the building to protect the privacy of personnel changing clothes. The clean room shall be constructed of at least 3 layers of 6 mil opaque fire retardant poly to provide an air tight room. Provide a minimum of 2 - 900 mm (3 foot) wide 6 mil poly opaque fire retardant doorways. One doorway shall be the entry from outside the PDF and the second doorway shall be to the shower room of the PDF. The floor of the clean room shall be maintained in a clean, dry condition. Shower overflow shall not be allowed into the clean room. Provide 1 storage locker per person. A portable fire extinguisher, minimum 10 pounds capacity, Type ABC, shall be provided in accordance with OSHA and NFPA Standard 10. All persons entering the regulated area shall remove all street clothing in the clean room and dress in disposable protective clothing and respiratory protection. Any person entering the clean room does so either from the outside with street clothing on or is coming from the shower room completely naked and


- thoroughly washed. Females required to enter the regulated area shall be ensured of their privacy throughout the entry/exit process by posting guards at both entry points to the PDF so no male can enter or exit the PDF during her stay in the PDF.
2. Shower Room: The Competent Person shall assure that the shower room is a completely water tight compartment to be used for the movement of all personnel from the clean room to the equipment room and for the showering of all personnel going from the equipment room to the clean room. Each shower shall be constructed so water runs down the walls of the shower and into a drip pan. Install a freely draining smooth floor on top of the shower pan. The shower room shall be separated from the rest of the building and from the clean room and equipment room using air tight walls made from at least 3 layers of 6 mil opaque fire retardant poly. The shower shall be equipped with a shower head and controls, hot and cold water, drainage, soap dish and continuous supply of soap, and shall be maintained in a sanitary condition throughout its use. The controls shall be arranged so an individual can shower without assistance. Provide a flexible hose shower head, hose bibs and all other items shown on Shower Schematic. Waste water will be pumped to a drain after being filtered through a minimum of a 100 micron sock in the shower drain; a 20 micron filter; and a final 5 micron filter. Filters will be changed a minimum of once per day or more often as needed. Filter changes must be done in the shower to prevent loss of contaminated water. Hose down all shower surfaces after each shift and clean any debris from the shower pan. Residue is to be disposed of as asbestos waste.
 3. Equipment Room: The Competent Person shall provide an equipment room which shall be an air tight compartment for the storage of work equipment/tools, reusable personal protective equipment, except for a respirator and for use as a gross decontamination area for personnel exiting the regulated area. The equipment room shall be separated from the regulated area by a minimum 3 foot wide door made with 2 layers of 6 mil opaque fire retardant poly. The equipment room shall be separated from the regulated area, the shower room and the rest of the building by air tight walls and ceiling constructed of a minimum of 3 layers of 6 mil opaque fire retardant poly. Damp wipe all surfaces of the equipment room after each shift change. Provide an additional loose layer of 6 mil fire retardant poly per shift change and remove this layer after each shift. If needed, provide a temporary electrical sub-panel equipped with GFCI in the equipment room to accommodate any equipment required in the regulated area.
 4. The PDF shall be as follows: Clean room at the entrance followed by a shower room followed by an equipment room leading to the regulated area. Each doorway in the PDF shall be a minimum of 2 layers of 6 mil opaque fire retardant poly.

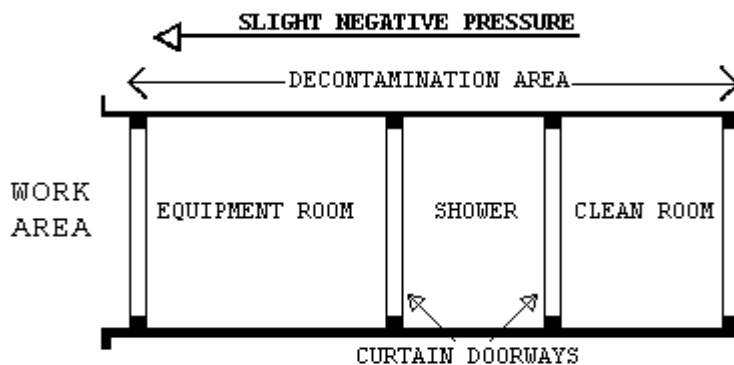

1.9.5 WASTE/EQUIPMENT DECONTAMINATION FACILITY (W/EDF)

The Competent Person shall provide a W/EDF consisting of a wash room, holding room, and clean room for removal of waste, equipment and contaminated material from the regulated area. Personnel shall not enter or exit the W/EDF except in the event of an emergency. Clean debris and residue in the W/EDF daily. All surfaces in the W/EDF shall be wiped/hosed down after each shift and all debris shall be cleaned from the shower pan. The W/EDF shall consist of the following:

1. Wash Down Station: Provide an enclosed shower unit in the regulated area just outside the Wash Room as an equipment bag and container cleaning station.
2. Wash Room: Provide a wash room for cleaning of bagged or containerized asbestos containing waste materials passed from the regulated area. Construct the wash room using 50 x 100 mm (2" x 4") wood framing and 3 layers of 6 mil fire retardant poly. Locate the wash room so that packaged materials, after being wiped clean, can be passed to the Holding Room. Doorways in the wash room shall be constructed of 2 layers of 6 mil fire retardant poly.
3. Holding Room: Provide a holding room as a drop location for bagged materials passed from the wash room. Construct the holding room using 50 x 100 mm (2" x 4") wood framing and 3 layers of 6 mil fire retardant poly. The holding room shall be located so that bagged material cannot be passed from the wash room to the clean room unless it goes through the holding room. Doorways in the holding room shall be constructed of 2 layers of 6 mil fire retardant poly.
4. Clean Room: Provide a clean room to isolate the holding room from the exterior of the regulated area. Construct the clean room using 2 x 4 wood framing and 2 layers of 6 mil fire retardant poly. The clean room shall be located so as to provide access to the holding room from the building exterior. Doorways to the clean room shall be constructed of 2 layers of 6 mil fire retardant poly. When a negative pressure differential system is used, a rigid enclosure separation between the W/EDF clean room and the adjacent areas shall be provided.
5. The W/EDF shall be as follows: Wash Room leading to a Holding Room followed by a Clean Room leading to outside the regulated area. See diagram.

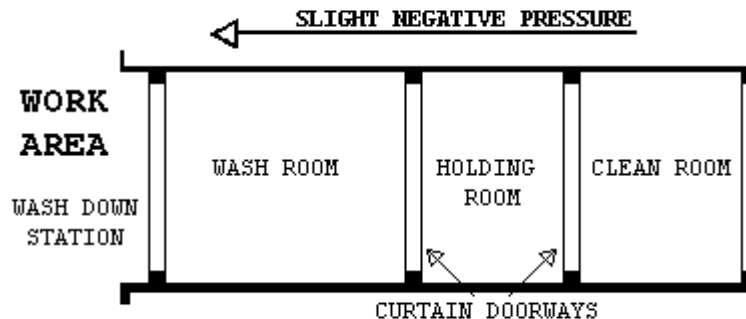

1.9.6 WASTE/EQUIPMENT DECONTAMINATION PROCEDURES

At the washdown station in the regulated area, thoroughly wet wipe/clean contaminated equipment and/or sealed polyethylene bags and pass into Wash Room after visual inspection. When passing anything into the Wash Room, close all doorways of the W/EDF, other than the doorway between the washdown station and the Wash Room. Keep all outside personnel clear of the W/EDF. Once inside the Wash Room, wet clean the equipment and/or bags. After cleaning and inspection, pass items into the Holding Room. Close all doorways except the doorway between the Holding Room and the Clean Room. Workers from the Clean Room/Exterior shall enter the Holding Room and remove the decontaminated/cleaned equipment/bags for removal and disposal. These personnel will not be required to wear PPE. At no time shall personnel from the clean side be allowed to enter the Wash Room.

PART 2 - PRODUCTS, MATERIALS AND EQUIPMENT

2.1 MATERIALS AND EQUIPMENT

2.1.1 GENERAL REQUIREMENTS (ALL ABATEMENT PROJECTS)

Prior to the start of work, the contractor shall provide and maintain a sufficient quantity of materials and equipment to assure continuous and efficient work throughout the duration of the

project. Work shall not start unless the following items have been delivered to the site and verified by the CPIH/CIH.

- A. All materials shall be delivered in their original package, container or bundle bearing the name of the manufacturer and the brand name (where applicable).
- B. Store all materials subject to damage off the ground, away from wet or damp surfaces and under cover sufficient enough to prevent damage or contamination. Flammable and combustible materials cannot be stored inside buildings. Replacement materials shall be stored outside of the regulated area until abatement is completed.
- C. The Contractor shall not block or hinder use of buildings by patients, staff, and visitors to the VA in partially occupied buildings by placing materials/equipment in any unauthorized location.
- D. The Competent Person shall inspect for damaged, deteriorating or previously used materials. Such materials shall not be used and shall be removed from the worksite and disposed of properly.
- E. Polyethylene sheeting for walls in the regulated area shall be a minimum of 4-mils. For floors and all other uses, sheeting of at least 6-mils shall be used in widths selected to minimize the frequency of joints. Fire retardant poly shall be used throughout.
- F. The method of attaching polyethylene sheeting shall be agreed upon in advance by the Contractor and the VA and selected to minimize damage to equipment and surfaces. Method of attachment may include any combination of moisture resistant duct tape furring strips, spray glue, staples, nails, screws, lumber and plywood for enclosures or other effective procedures capable of sealing polyethylene to dissimilar finished or unfinished surfaces under both wet and dry conditions.
- G. Polyethylene sheeting utilized for the PDF shall be opaque white or black in color, 6 mil fire retardant poly.
- H. Installation and plumbing hardware, showers, hoses, drain pans, sump pumps and waste water filtration system shall be provided by the Contractor.
- I. An adequate number of HEPA vacuums, scrapers, sprayers, nylon brushes, brooms, disposable mops, rags, sponges, staple guns, shovels, ladders and scaffolding of suitable height and length as well as meeting OSHA requirements, fall protection devices, water hose to reach all areas in the regulated area, airless spray equipment, and any other tools, materials or equipment required to conduct the abatement project. All electrically operated hand tools, equipment, electric cords shall be connected to GFCI protection.
- J. Special protection for objects in the regulated area shall be detailed (e.g., plywood over carpeting or hardwood floors to prevent damage from scaffolds, water and falling material).
- K. Disposal bags – 2 layers of 6 mil poly for asbestos waste shall be pre-printed with labels, markings and address as required by OSHA, EPA and DOT regulations.
- L. The VA shall be provided an advance copy of the MSDS as required for all hazardous chemicals under OSHA 29 CFR 1910.1200 - Hazard Communication in the pre-project submittal. Chlorinated compounds shall not be used with any spray adhesive, mastic remover or other product. Appropriate encapsulant(s) shall be provided.
- M. OSHA DANGER demarcation signs, as many and as required by OSHA 29 CFR 1926.1101(k)(7) shall be provided and placed by the Competent Person. All other posters and notices required by Federal and State regulations shall be posted in the Clean Room.
- N. Adequate and appropriate PPE for the project and number of personnel/shifts shall be provided. All personal protective equipment issued must be based on a written hazard assessment conducted under 29 CFR 1910.132(d).

2.1.2 NEGATIVE PRESSURE FILTRATION SYSTEM

The Contractor shall provide enough HEPA negative air machines to continuously maintain a pressure differential of -0.02" water column gauge (WCG). The Competent Person shall determine the number of units needed for the regulated area by dividing the cubic feet in the regulated area by 15 and then dividing that result by the cubic feet per minute (CFM) for each unit to determine the number of units needed to continuously maintain a pressure differential of -0.02" WCG. Provide a standby unit in the event of machine failure and/or emergency in an adjacent area.

NIOSH has done extensive studies and has determined that negative air machines typically operate at ~50% efficiency. The contractor shall consider this in their determination of number of units needed to continuously maintain a pressure differential of -0.02" WCG. The contractor shall use 8 air changes per hour or double the number of machines, based on their calculations, or submit proof their machines operate at stated capacities, at a 2" pressure drop across the filters.

2.1.3 DESIGN AND LAYOUT

- A. Before start of work submit the design and layout of the regulated area and the negative air machines. The submittal shall indicate the number of, location of and size of negative air machines. The point(s) of exhaust, air flow within the regulated area, anticipated negative pressure differential, and supporting calculations for sizing shall be provided. In addition, submit the following:
 - 1. Method of supplying power to the units and designation/location of the panels.
 - 2. Description of testing method(s) for correct air volume and pressure differential.
 - 3. If auxiliary power supply is to be provided for the negative air machines, provide a schematic diagram of the power supply and manufacturer's data on the generator and switch.

2.1.4 NEGATIVE AIR MACHINES (HEPA UNITS)

- A. Negative Air Machine Cabinet: The cabinet shall be constructed of steel or other durable material capable of withstanding potential damage from rough handling and transportation. The width of the cabinet shall be less than 30" in order to fit in standard doorways. The cabinet must be factory sealed to prevent asbestos fibers from being released during use, transport, or maintenance. Any access to and replacement of filters shall be from the inlet end. The unit must be on casters or wheels.
- B. Negative Air Machine Fan: The rating capacity of the fan must indicate the CFM under actual operating conditions. Manufacturer's typically use "free-air" (no resistance) conditions when rating fans. The fan must be a centrifugal type fan.
- C. Negative Air Machine Final Filter: The final filter shall be a HEPA filter. The filter media must be completely sealed on all edges within a structurally rigid frame. The filter shall align with a continuous flexible gasket material in the negative air machine housing to form an air tight seal. Each HEPA filter shall be certified by the manufacturer to have an efficiency of not less than 99.97%. Testing shall have been done in accordance with Military Standard MIL-STD-282 and Army Instruction Manual 136-300-175A. Each filter must bear a UL586 label to indicate ability to perform under specified conditions. Each filter shall be marked with the name of the manufacturer, serial number, air flow rating, efficiency and resistance, and the direction of test air flow.
- D. Negative Air Machine Pre-filters: The pre-filters, which protect the final HEPA filter by removing larger particles, are required to prolong the operating life of the HEPA filter. Two stages of pre-filtration are required. A first stage pre-filter shall be a low efficiency type for particles 10 micron or larger. A second stage pre-filter shall have a medium efficiency effective for particles down to 5 micron or larger. Pre-filters shall be installed either on or in the intake opening of the NAM and the second stage filter must be held in place with a special housing or clamps.
- E. Negative Air Machine Instrumentation: Each unit must be equipped with a gauge to measure the pressure drop across the filters and to indicate when filters have become loaded and need to be changed. A table indicating the cfm for various pressure readings on the gauge shall be affixed near the gauge for reference or the reading shall indicate at what point the filters shall be changed, noting cfm delivery. The unit must have an elapsed time meter to show total hours of operation.
- F. Negative Air Machine Safety and Warning Devices: An electrical/ mechanical lockout must be provided to prevent the fan from being operated without a HEPA filter. Units must be equipped with an automatic shutdown device to stop the fan in the event of a rupture in the HEPA filter or blockage in the discharge of the fan. Warning lights are required to indicate normal operation; too high a pressure drop across filters; or too low of a pressure drop across filters.
- G. Negative Air Machine Electrical: All electrical components shall be approved by the National Electrical Manufacturer's Association (NEMA) and Underwriters Laboratories (UL). Each unit must

be provided with overload protection and the motor, fan, fan housing, and cabinet must be grounded.

- H. It is essential that replacement HEPA filters be tested using an "in-line" testing method, to ensure the seal around the periphery was not damaged during replacement. Damage to the outer HEPA filter seal could allow contaminated air to bypass the HEPA filter and be discharged to an inappropriate location. Contractor will provide written documentation of test results for negative air machine units with HEPA filters changed by the contractor or documentation when changed and tested by the contractor filters.

2.1.5 PRESSURE DIFFERENTIAL

The fully operational negative air system within the regulated area shall continuously maintain a pressure differential of -0.02" water column gauge. Before any disturbance of any asbestos material, this shall be demonstrated to the VA by use of a pressure differential meter/manometer as required by OSHA 29 CFR 1926.1101(e)(5)(i). The Competent Person shall be responsible for providing, maintaining, and documenting the negative pressure and air changes as required by OSHA and this specification.

2.2 CONTAINMENT BARRIERS AND COVERINGS IN THE REGULATED AREA

2.2.1 GENERAL

Using critical barriers, seal off the perimeter to the regulated area to completely isolate the regulated area from adjacent spaces. All horizontal surfaces in the regulated area must be covered with 2 layers of 6 mil fire retardant poly to prevent contamination and to facilitate clean-up. Should adjacent areas become contaminated, immediately stop work and clean up the contamination at no additional cost to the Government. Provide firestopping and identify all fire barrier penetrations due to abatement work as specified in Section 2.2.8; FIRESTOPPING.

2.2.2 PREPARATION PRIOR TO SEALING THE REGULATED AREA

- A. Place all tools, scaffolding, materials and equipment needed for working in the regulated area prior to erecting any plastic sheeting. Remove all uncontaminated removable furniture, equipment and/or supplies from the regulated area before commencing work, or completely cover with 2 layers of 6-mil fire retardant poly sheeting and secure with duct tape. Lock out and tag out any HVAC systems in the regulated area.

2.2.3 CONTROLLING ACCESS TO THE REGULATED AREA

- A. Access to the regulated area is allowed only through the personnel decontamination facility (PDF), if required. All other means of access shall be eliminated and OSHA Danger demarcation signs posted as required by OSHA. If the regulated area is adjacent to or within view of an occupied area, provide a visual barrier of 6 mil opaque fire retardant poly sheeting to prevent building occupant observation. If the adjacent area is accessible to the public, the barrier must be solid.

2.2.4 CRITICAL BARRIERS

- A. Completely separate any openings into the regulated area from adjacent areas using fire retardant poly at least 6 mils thick and duct tape. Individually seal with 2 layers of 6 mil poly and duct tape all HVAC openings into the regulated area. Individually seal all lighting fixtures, clocks, doors, windows, convectors, speakers, or any other objects in the regulated area. Heat must be shut off any objects covered with poly.

2.2.5 SECONDARY BARRIERS

- A. A loose layer of 6 mil fire retardant poly shall be used as a drop cloth to protect the floor/horizontal surfaces from debris generated during the glovebag abatement. This layer shall be replaced as needed during the work.

2.2.6 EXTENSION OF THE REGULATED AREA

- A. If the enclosure of the regulated area is breached in any way that could allow contamination to occur, the affected area shall be included in the regulated area and constructed as per this section. If the affected area cannot be added to the regulated area, decontamination measures must be started immediately and continue until air monitoring indicates background levels are met.

2.2.7 FIRESTOPPING

- A. Through penetrations caused by cables, cable trays, pipes, sleeves must be firestopped with a fire-rated firestop system providing an air tight seal.
- B. Firestop materials that are not equal to the wall or ceiling penetrated shall be brought to the attention of the VA Representative. The Contractor shall list all areas of penetration, the type of sealant used, and whether or not the location is fire rated. Any discovery of penetrations during abatement shall be brought to the attention of the VA Representative immediately. All walls, floors and ceilings are considered fire rated unless otherwise determined by the VA Representative or Fire Marshall.
- C. Any visible openings whether or not caused by a penetration shall be reported by the Contractor to the VA Representative for a sealant system determination. Firestops shall meet ASTM E814 and UL 1479 requirements for the opening size, penetrant, and fire rating needed.

2.3 MONITORING, INSPECTION AND TESTING**2.3.1 GENERAL**

- A. Perform throughout abatement work monitoring, inspection and testing inside and around the regulated area in accordance with the OSHA requirements and these specifications. OSHA requires that the Employee exposure to asbestos must not exceed 0.1 fibers per cubic centimeter (f/cc) of air, averaged over an 8-hour work shift. The CPIH/CIH is responsible for and shall inspect and oversee the performance of the Contractor IH Technician. The IH Technician shall continuously inspect and monitor conditions inside the regulated area to ensure compliance with these specifications. In addition, the CPIH/CIH shall personally manage air sample collection, analysis, and evaluation for personnel, regulated area, and adjacent area samples to satisfy OSHA requirements. Additional inspection and testing requirements are also indicated in other parts of this specification.
- B. The VA will employ an independent industrial hygienist (VPIH/CIH) consultant and/or use its own IH to perform various services on behalf of the VA. The VPIH/CIH will perform the necessary monitoring, inspection, testing, and other support services to ensure that VA patients, employees, and visitors will not be adversely affected by the abatement work, and that the abatement work proceeds in accordance with these specifications, that the abated areas or abated buildings have been successfully decontaminated. The work of the VPIH/CIH consultant in no way relieves the Contractor from their responsibility to perform the work in accordance with contract/specification requirements, to perform continuous inspection, monitoring and testing for the safety of their employees, and to perform other such services as specified. The cost of the VPIH/CIH and their services will be borne by the VA except for any repeat of final inspection and testing that may be required due to unsatisfactory initial results. Any repeated final inspections and/or testing, if required, will be paid for by the Contractor.
- C. If fibers counted by the VPIH/CIH during abatement work, either inside or outside the regulated area, utilizing the NIOSH 7400 air monitoring method, exceed the specified respective limits, the Contractor shall stop work. The Contractor may request confirmation of the results by analysis of the samples by TEM. Request must be in writing and submitted to the VA's representative. Cost for the confirmation of results will be borne by the Contractor for both the collection and analysis

of samples and for the time delay that may/does result for this confirmation. Confirmation sampling and analysis will be the responsibility of the CPIH/CIH with review and approval of the VPIH/CIH. An agreement between the CPIH/CIH and the VPIH/CIH shall be reached on the exact details of the confirmation effort, in writing, including such things as the number of samples, location, collection, quality control on-site, analytical laboratory, interpretation of results and any follow-up actions. This written agreement shall be co-signed by the IH's and delivered to the VA's representative.

2.3.2 SCOPE OF SERVICES OF THE VPIH/CIH CONSULTANT

- A. The purpose of the work of the VPIH/CIH is to: Assure quality; resolve problems; and prevent the spread of contamination beyond the regulated area. In addition, their work includes performing the final inspection and testing to determine whether the regulated area or building has been adequately decontaminated. All air monitoring is to be done utilizing PCM/TEM. The VPIH/CIH will perform the following tasks:
 - 1. Task 1: Establish background levels before abatement begins by collecting background samples. Retain samples for possible TEM analysis.
 - 2. Task 2: Perform continuous air monitoring, inspection, and testing outside the regulated area during actual abatement work to detect any faults in the regulated area isolation and any adverse impact on the surroundings from regulated area activities.
 - 3. Task 3: Perform unannounced visits to spot check overall compliance of work with contract/specifications. These visits may include any inspection, monitoring, and testing inside and outside the regulated area and all aspects of the operation except personnel monitoring.
 - 4. Task 4: Provide support to the VA representative such as evaluation of submittals from the Contractor, resolution of unforeseen developments, etc.
 - 5. Task 5: Perform, in the presence of the VA representative, final inspection and testing of a decontaminated regulated area or building at the conclusion of the abatement and clean-up work to certify compliance with all regulations and the VA requirements/specifications.
 - 6. Task 6: Issue certificate of decontamination for each regulated area or building and project report.
- B. All data, inspection results and testing results generated by the VPIH/CIH will be available to the Contractor for information and consideration. The Contractor shall cooperate with and support the VPIH/CIH for efficient and smooth performance of their work.
- C. The monitoring and inspection results of the VPIH/CIH will be used by the VA to issue any Stop Removal orders to the Contractor during abatement work and to accept or reject a regulated area or building as decontaminated.

2.3.3 MONITORING, INSPECTION AND TESTING BY CONTRACTOR

CPIH/CIH

The Contractor's CPIH/CIH is responsible for managing all monitoring, inspections, and testing required by these specifications, as well as any and all regulatory requirements adopted by these specifications. The CPIH/CIH is responsible for the continuous monitoring of all subsystems and procedures which could affect the health and safety of the Contractor's personnel. Safety and health conditions and the provision of those conditions inside the regulated area for all persons entering the regulated area is the exclusive responsibility of the Contractor/Competent Person. The person performing the personnel and area air monitoring inside the regulated area shall be the CPIH or an IH Technician, who shall be trained and shall have specialized field experience in sampling and analysis. The CPIH or IH Technician shall also be an accredited EPA AHERA/State Contractor/Supervisor. The CPIH or IH Technician shall have participated in five abatement projects collecting personal and area samples as well as responsibility for documentation on substantially similar projects in size and scope. The analytic laboratory used by the Contractor to analyze the samples shall be AIHA accredited for asbestos PAT and approved by the VA prior to start of the project. A daily log shall be maintained by the CPIH/CIH or IH Technician, documenting all OSHA requirements for air personal monitoring for asbestos in 29 CFR 1926.1101(f), (g) and Appendix A. This log shall be made available to the VA representative and the VPIH/CIH upon request. The log will contain, at a minimum, information on personnel or area samples, other persons represented by the sample, the date of sample collection, start and stop

times for sampling, sample volume, flow rate, and fibers/cc. The CPIH/CIH shall collect and analyze samples for each representative job being done in the regulated area, i.e., removal, wetting, clean-up, and load-out. No fewer than two personal samples per shift shall be collected and one area sample per 1,000 square feet of regulated area where abatement is taking place and one sample per shift in the clean room area shall be collected. In addition to the continuous monitoring required, the CPIH/CIH will perform inspection and testing at the final stages of abatement for each regulated area as specified in the CPIH/CIH responsibilities. Additionally, the CPIH/CIH will monitor and record pressure readings within the containment daily with a minimum of two readings at the beginning and at the end of a shift, and submit the data in the daily report.

2.4 ASBESTOS HAZARD ABATEMENT PLAN

The Contractor shall have established Asbestos Hazard Abatement Plan (AHAP) in printed form and loose leaf folder consisting of simplified text, diagrams, sketches, and pictures that establish and explain clearly the ways and procedures to be followed during all phases of the work by the Contractor's personnel. The AHAP must be modified as needed to address specific requirements of the project. The AHAP shall be submitted for review and approval prior to the start of any abatement work. The minimum topics and areas to be covered by the AHAP(s) are:

- A. Minimum Personnel Qualifications
- B. Contingency Plans and Arrangements
- C. Security and Safety Procedures
- D. Respiratory Protection/Personal Protective Equipment Program and Training
- E. Medical Surveillance Program and Recordkeeping
- F. Regulated Area Requirements for Glovebag Abatement
- G. Decontamination Facilities and Entry/Exit Procedures (PDF and W/EDF)
- H. Monitoring, Inspections, and Testing
- I. Removal Procedures for Piping ACM Using the Glovebag Method
- J. Disposal of ACM waste
- K. Regulated Area Decontamination/Clean-up
- L. Regulated Area Visual and Air Clearance
- M. Project Completion/Closeout

2.5 SUBMITTALS

2.5.1 PRE-START MEETING SUBMITTALS

Submit to the VA a minimum of 14 days prior to the pre-start meeting the following for review and approval. Meeting this requirement is a prerequisite for the pre-start meeting for this project:

- A. Submit a detailed work schedule for the entire project reflecting contract documents and the phasing/schedule requirements from the CPM chart.
- B. Submit a staff organization chart showing all personnel who will be working on the project and their capacity/function. Provide their qualifications, training, accreditations, and licenses, as appropriate. Provide a copy of the "Certificate of Worker's Acknowledgment" and the "Affidavit of Medical Surveillance and Respiratory Protection" for each person.
- C. Submit Asbestos Hazard Abatement Plan developed specifically for this project, incorporating the requirements of the specifications, prepared, signed and dated by the CPIH/CIH.
- D. Submit the specifics of the materials and equipment to be used for this project with manufacturer names, model numbers, performance characteristics, pictures/diagrams, and number available for the following:
 - 1. Supplied air system, negative air machines, HEPA vacuums, air monitoring pumps, calibration devices, pressure differential monitoring device and emergency power generating system.
 - 2. Waste water filtration system, shower system, containment barriers.
 - 3. Encapsulants, surfactants, hand held sprayers, airless sprayers, glovebags, and fire extinguishers.
 - 4. Respirators, protective clothing, personal protective equipment.
 - 5. Fire safety equipment to be used in the regulated area.
- E. Submit the name, location, and phone number of the approved landfill; proof/verification the landfill is approved for ACM disposal; the landfill's requirements for ACM waste; the type of

- vehicle to be used for transportation; and name, address, and phone number of subcontractor, if used. Proof of asbestos training for transportation personnel shall be provided.
- F. Submit required notifications and arrangements made with regulatory agencies having regulatory jurisdiction and the specific contingency/emergency arrangements made with local health, fire, ambulance, hospital authorities and any other notifications/arrangements.
 - G. Submit the name, location and verification of the laboratory and/or personnel to be used for analysis of air and/or bulk samples. Personal air monitoring must be done in accordance with OSHA 29 CFR 1926.1101(f) and Appendix A. And area or clearance air monitoring in accordance with EPA AHERA protocols.
 - H. Submit qualifications verification: Submit the following evidence of qualifications. Make sure that all references are current and verifiable by providing current phone numbers and documentation.
 - 1. Asbestos Abatement Company: Project experience within the past 3 years; listing projects first most similar to this project: Project Name; Type of Abatement; Duration; Cost; Reference Name/Phone Number; Final Clearance; and Completion Date
 - 2. List of project(s) halted by owner, A/E, IH, regulatory agency in the last 3 years: Project Name; Reason; Date; Reference Name/Number; and Resolution.
 - 3. List asbestos regulatory citations (e.g., OSHA), notices of violations (e.g., Federal and state EPA), penalties, and legal actions taken against the company including and of the company's officers (including damages paid) in the last 3 years. Provide copies and all information needed for verification.
 - I. Submit information on personnel: Provide a resume; address each item completely; copies of certificates, accreditations, and licenses. Submit an affidavit signed by the CPIH/CIH stating that all personnel submitted below have medical records in accordance with OSHA 29 CFR 1926.1101(m) and 29 CFR 1910.20 and that the company has implemented a medical surveillance program and written respiratory protection program, and maintains recordkeeping in accordance with the above regulations. Submit the phone number and doctor/clinic/hospital used for medical evaluations.
 - 1. CPIH/CIH (may also be the Competent Person): Name; years of abatement experience; list of projects similar to this one; certificates, licenses, accreditations for proof of AHERA/OSHA specialized asbestos training; professional affiliations; number of workers trained in the field; medical opinion; and current respirator fit test.
 - 2. Competent Person(s)/Supervisor(s): Number; names; social security numbers; years of abatement experience as Competent Person/Supervisor; list of similar projects in size/complexity as Competent Person/Supervisor; as a worker; certificates, licenses, accreditations; proof of AHERA/OSHA specialized asbestos training; maximum number of personnel supervised on a project; medical opinion (asbestos surveillance and respirator use); and current respirator fit test.
 - 3. Workers: Numbers; names; social security numbers; years of abatement experience; certificates, licenses, accreditations; training courses in asbestos abatement and respiratory protection; medical opinion (asbestos surveillance and respirator use); and current respirator fit test.
 - J. Submit copies of State license for asbestos abatement; copy of insurance policy, including exclusions with a letter from agent stating in plain language the coverage provided and the fact that asbestos abatement activities are covered by the policy; copy of AHAP(s) incorporating the requirements of this specification; information on who provides your training, how often; who provides medical surveillance, how often; who performs and how is personal air monitoring of abatement workers conducted; a list of references of independent laboratories/IH's familiar with your air monitoring and Asbestos Hazard Abatement Plans; copies of monitoring results of the five referenced projects listed and analytical method(s) used.
 - K. Rented equipment must be decontaminated prior to returning to the rental agency.
 - L. Submit, before the start of work, the manufacturer's technical data for all types of encapsulants, all MSDS, and application instructions.

2.5.2 SUBMITTALS DURING ABATEMENT

- A. The Competent Person shall maintain and submit a daily log at the regulated area documenting the dates and times of the following: purpose, attendees and summary of meetings; all personnel

entering/exiting the regulated area; document and discuss the resolution of unusual events such as barrier breeching, equipment failures, emergencies, and any cause for stopping work; representative air monitoring and results/TWAs/ELs. Submit this information daily to the VPIH/CIH.

- B. The CPIH/CIH shall document and maintain the inspection and approval of the regulated area preparation prior to start of work and daily during work.
 - 1. Removal of any poly barriers.
 - 2. Visual inspection/testing by the CPIH/CIH or IH Technician prior to application of lockdown encapsulant.
 - 3. Packaging and removal of ACM waste from regulated area.
 - 4. Disposal of ACM waste materials; copies of Waste Shipment Records/landfill receipts to the VA's representative on a weekly basis.

2.5.3 SUBMITTALS AT COMPLETION OF ABATEMENT

The CPIH/CIH shall submit a project report consisting of the daily log book requirements and documentation of events during the abatement project including Waste Shipment Records signed by the landfill's agent. It will also include information on the containment and transportation of waste from the containment with applicable Chain of Custody forms. The report shall include a certificate of completion, signed and dated by the CPIH/CIH, in accordance with Attachment #1. All clearance and perimeter area samples must be submitted. The VA Representative will retain the abatement report after completion of the project and provide copies of the abatement report to VAMC Office of Engineer and the Safety Office.

2.6 ENCAPSULANTS

2.6.1 TYPES OF ENCAPSULANTS

- A. The following four types of encapsulants must comply with performance requirements as stated in paragraph 2.6.2:
 - 1. Removal encapsulant - used as a wetting agent to remove ACM.
 - 2. Bridging encapsulant - provides a tough, durable coating on ACM.
 - 3. Penetrating encapsulant - penetrates/encapsulates ACM at least 13 mm (1/2").
 - 4. Lockdown encapsulant - seals microscopic fibers on surfaces after ACM removal.

2.6.2 PERFORMANCE REQUIREMENTS

Encapsulants shall meet the latest requirements of EPA; shall not contain toxic or hazardous substances; or solvents; and shall comply with the following performance requirements:

- A. General Requirements for all Encapsulants:
 - 1. ASTM E84: Flame spread of 25; smoke emission of 50.
 - 2. University of Pittsburgh Protocol: Combustion Toxicity; zero mortality.
 - 3. ASTM C732: Accelerated Aging Test; Life Expectancy - 20 years.
 - 4. ASTM E96: Permeability - minimum of 0.4 perms.
- B. Bridging/Penetrating Encapsulants:
 - 1. ASTM E736: Cohesion/Adhesion Test - 24 kPa (50 lbs/ft²).
 - 2. ASTM E119: Fire Resistance - 3 hours (Classified by UL for use on fibrous/cementitious fireproofing).
 - 3. ASTM D2794: Gardner Impact Test; Impact Resistance - minimum 11.5 kg-mm (43 in/lb).
 - 4. ASTM D522: Mandrel Bend Test; Flexibility - no rupture or cracking.
- C. Lockdown Encapsulants:
 - 1. ASTM E119: Fire resistance - 3 hours (tested with fireproofing over encapsulant applied directly to steel member).
 - 2. ASTM E736: Bond Strength - 48 kPa (100 lbs/ft²) (test compatibility with cementitious and fibrous fireproofing).
 - 3. In certain situations, encapsulants may have to be applied to hot pipes/equipment. The encapsulant must be able to withstand high temperatures without cracking or off-gassing any noxious vapors during application.

2.7 CERTIFICATES OF COMPLIANCE

The Contractor shall submit to the VA representative certification from the manufacturer indicating compliance with performance requirements for encapsulants when applied according to manufacturer recommendations.

2.8 RECYCLABLE PROTECTIVE CLOTHING

If recyclable clothing is provided, all requirements of EPA, DOT and OSHA shall be met.

PART 3 – EXECUTION

3.1 REGULATED AREA PREPARATIONS

3.1.1 SITE SECURITY

- A. Regulated area access is to be restricted only to authorized, trained/accredited and protected personnel. These may include the Contractor's employees, employees of Subcontractors, VA employees and representatives, State and local inspectors, and any other designated individuals. A list of authorized personnel shall be established prior to commencing the project and be posted in the clean room of the decontamination unit.
- B. Entry into the regulated area by unauthorized individuals shall be reported immediately to the Competent Person by anyone observing the entry. The Competent Person shall immediately require any unauthorized person to leave the regulated area and then notify the VA Contracting Officer or VA Representative using the most expeditious means.
- C. A log book shall be maintained in the clean room of the decontamination unit. Anyone who enters the regulated area must record their name, affiliation, time in, and time out for each entry.
- D. Access to the regulated area shall be through a single decontamination unit. All other access (doors, windows, hallways, etc.) shall be sealed or locked to prevent entry to or exit from the regulated area. The only exceptions for this requirement are the waste/equipment load-out area which shall be sealed except during the removal of containerized asbestos waste from the regulated area, and emergency exits. Emergency exits shall not be locked from the inside; however, they shall be sealed with poly sheeting and taped until needed. In any situation where exposure to high temperatures which may result in a flame hazard, fire retardant poly sheeting must be used.
- E. The Contractor's Competent Person shall control site security during abatement operations in order to isolate work in progress and protect adjacent personnel. A 24 hour security system shall be provided at the entrance to the regulated area to assure that all entrants are logged in/out and that only authorized personnel are allowed entrance.
- F. The Contractor will have the VA's assistance in notifying adjacent personnel of the presence, location and quantity of ACM in the regulated area and enforcement of restricted access by the VA's employees.
- G. The regulated area shall be locked during non-working hours and secured by VA Representative or Competent Person. The VA Police should be informed of asbestos abatement regulated areas to provide security checks during facility rounds and emergency response.

3.1.2 OSHA DANGER SIGNS

Post OSHA DANGER signs meeting the specifications of OSHA 29 CFR 1926.1101 at any location and approaches to the regulated area where airborne concentrations of asbestos may exceed ambient background levels. Signs shall be posted at a distance sufficiently far enough away from the regulated area to permit any personnel to read the sign and take the necessary measures to avoid exposure. Additional signs will be posted following construction of the regulated area enclosure.

3.1.3.1 SHUT DOWN - LOCK OUT ELECTRICAL

Shut down and lock out/tag out electric power to the regulated area. Provide temporary power and lighting. Insure safe installation including GFCI of temporary power sources and equipment by compliance with all applicable electrical code requirements and OSHA requirements for temporary electrical systems. Electricity shall be provided by the VA.

3.1.3.2 SHUT DOWN - LOCK OUT HVAC

Shut down and lock out/tag out heating, cooling, and air conditioning system (HVAC) components that are in, supply or pass through the regulated area. Investigate the regulated area and agree on pre-abatement condition with the VA's representative. Seal all intake and exhaust vents in the regulated area with duct tape and 2 layers of 6-mil poly. Also, seal any seams in system components that pass through the regulated area. Remove all contaminated HVAC system filters and place in labeled 6-mil poly disposal bags for disposal as asbestos waste.

3.1.4 CONTAINMENT BARRIERS AND COVERINGS FOR THE REGULATED AREA**3.1.4.1 GENERAL**

Seal off any openings at the perimeter of the regulated area with critical barriers to completely isolate the regulated area and to contain all airborne asbestos contamination created by the abatement activities. Should the adjacent area past the regulated area become contaminated due to improper work activities, the Contractor shall suspend work inside the regulated area, continue wetting, and clean the adjacent areas in accordance with procedures described in these specifications. Any and all costs associated with the adjacent area cleanup shall not be borne by the VA.

3.1.4.2 PREPARATION PRIOR TO SEALING OFF

Place all materials, equipment and supplies necessary to isolate the regulated area inside the regulated area. Remove all movable material/equipment as described above and secure all unmovable material/equipment as described above. Properly secured material/ equipment shall be considered to be outside the regulated area.

3.1.4.3 CONTROLLING ACCESS TO THE REGULATED AREA

Access to the regulated area is allowed only through the personnel decontamination facility (PDF). All other means of access shall be eliminated and OSHA DANGER demarcation signs posted as required by OSHA. If the regulated area is adjacent to, or within view of an occupied area, provide a visual barrier of 6 mil opaque fire retardant poly to prevent building occupant observation. If the adjacent area is accessible to the public, the barrier must be solid and capable of withstanding the negative pressure.

3.1.4.4 CRITICAL BARRIERS

The regulated area must be completely separated from the adjacent area(s) and the outside by at least 2 layers of 6 mil fire retardant poly and duct tape/spray adhesive. Individually seal all supply and exhaust ventilation openings, lighting fixtures, clocks, doorways, windows, convectors, speakers, and other openings into the regulated area with 2 layers of 6 mil fire retardant poly, and taped securely in place with duct tape/spray adhesive. Critical barriers must remain in place until all work and clearances have been completed. Light fixtures shall not be operational during abatement. Auxiliary lighting shall be provided. If needed, provide plywood squares 6" x 6" x 3/8" (150mm x 150mm x 18mm) held in place with one 6d smooth masonry/galvanized nail driven through the center of the plywood square and duct tape on the poly so as to clamp the poly to the wall/surface. Locate plywood squares at each end, corner, and 4' (1200mm) maximum on centers.

3.1.4.5 EXTENSION OF THE REGULATED AREA

If the regulated area barrier is breached in any manner that could allow the passage of asbestos fibers or debris, the Competent Person shall immediately stop work, continue wetting, and proceed to extend the regulated area to enclose the affected area as per procedures described in this specification. If the affected area cannot be enclosed, decontamination measures and cleanup shall start immediately. All personnel shall be isolated from the affected area until decontamination/cleanup is completed as verified by visual inspection and air monitoring. Air monitoring at completion must indicate background levels.

3.1.4.6 FLOOR BARRIERS

All floors within 10 feet of glovebag work shall be covered and secured with 2 layers of 6 mil fire retardant poly and duct tape.

3.1.5 SANITARY FACILITIES

The Contractor shall provide sanitary facilities for abatement personnel and maintain them in a clean and sanitary condition throughout the abatement project.

3.1.6 PRE-CLEANING**3.1.6.1 PRE-CLEANING MOVABLE OBJECTS**

The VA will provide water for abatement purposes. The Contractor shall connect to the existing VA system. The service to the shower(s) shall be supplied with backflow prevention.

Pre-cleaning of ACM contaminated items shall be performed after the enclosure has been erected and negative pressure has been established in the work area. PPE must be donned by all workers performing pre-cleaning activities. After items have been pre-cleaned and decontaminated, they may be removed from the work area for storage until the completion of abatement in the work area.

Pre-clean all movable objects within the regulated area using a HEPA filtered vacuum and/or wet cleaning methods as appropriate. After cleaning, these objects shall be removed from the regulated area and carefully stored in an uncontaminated location.

3.1.6.2 PRE-CLEANING FIXED OBJECTS

Pre-cleaning of ACM contaminated items shall be performed after the enclosure has been erected and negative pressure has been established in the work area.

Pre-clean all fixed objects in the regulated area using HEPA filtered vacuums and/or wet cleaning techniques as appropriate. Careful attention must be paid to machinery behind grills or gratings where access may be difficult but contamination may be significant. Also, pay particular attention to wall, floor and ceiling penetration behind fixed items. After pre-cleaning, enclose fixed objects with 2 layers of 6-mil poly and seal securely in place with duct tape. Objects (e.g., permanent fixtures, shelves, electronic equipment, laboratory tables, sprinklers, alarm systems, closed circuit TV equipment and computer cables) which must remain in the regulated area and that require special ventilation or enclosure requirements should be designated here along with specified means of protection. Contact the manufacturer for special protection requirements.

3.1.6.3 PRE-CLEANING SURFACES IN THE REGULATED AREA

Pre-cleaning of ACM contaminated items shall be performed after the enclosure has been erected and negative pressure has been established in the work area.

Pre-clean all surfaces in the regulated area using HEPA filtered vacuums and/or wet cleaning methods as appropriate. Do not use any methods that would raise dust such as dry sweeping or

vacuuming with equipment not equipped with HEPA filters. Do not disturb asbestos-containing materials during this pre-cleaning phase.

3.1.7 PRE-ABATEMENT ACTIVITIES

3.1.7.1 PRE-ABATEMENT MEETING

The VA representative, upon receipt, review, and substantial approval of all pre-abatement submittals and verification by the CPIH/CIH that all materials and equipment required for the project are on the site, will arrange for a pre-abatement meeting between the Contractor, the CPIH/CIH, Competent Person(s), the VA representative(s), and the VPIH/CIH. The purpose of the meeting is to discuss any aspect of the submittals needing clarification or amplification and to discuss any aspect of the project execution and the sequence of the operation. The Contractor shall be prepared to provide any supplemental information/documentation to the VA's representative regarding any submittals, documentation, materials or equipment. Upon satisfactory resolution of any outstanding issues, the VA's representative will issue a written order to proceed to the Contractor. No abatement work of any kind described in the following provisions shall be initiated prior to the VA written order to proceed.

3.1.7.2 PRE-ABATEMENT INSPECTIONS AND PREPARATIONS

Before any work begins on the construction of the regulated area, the Contractor will:

- A. Conduct a space-by-space inspection with an authorized VA representative and prepare a written inventory of all existing damage in those spaces where asbestos abatement will occur. Still or video photography may be used to supplement the written damage inventory. Document will be signed and certified as accurate by both parties.
- B. The VA Representative, the Contractor, and the VPIH/CIH must be aware of VA A/E Quality Alert 07/09 indicating the failure to identify asbestos in the areas listed as well as common issues when preparing specifications and contract documents. This is especially critical when demolition is planned, because AHERA surveys are non-destructive, and ACM may remain undetected. A NESHAPS (destructive) ACM inspection should be conducted on all building structures that will be demolished. Ensure the following areas are inspected on the project: Lay-in ceilings concealing ACM; ACM behind walls/windows from previous renovations; inside utility chases/walls; transite piping/ductwork/sheets; behind radiators; lab fume hoods; transite lab countertops; roofing materials; below window sills; water/sewer lines; electrical conduit coverings; crawl spaces(previous abatement contamination); flooring/mastic covered by carpeting/new flooring; exterior insulated wall panels; on underground fuel tanks; and steam line trench coverings.
- C. Ensure that all furniture, machinery, equipment, curtains, drapes, blinds, and other movable objects required to be removed from the regulated area have been cleaned and removed or properly protected from contamination.
- D. If present and required, remove and dispose of carpeting from floors in the regulated area.
- E. Inspect existing firestopping in the regulated area. Correct as needed.

3.1.7.3 PRE-ABATEMENT CONSTRUCTION AND OPERATIONS

- A. Perform all preparatory work for the first regulated area in accordance with the approved work schedule and with this specification.
- B. Upon completion of all preparatory work, the CPIH/CIH will inspect the work and systems and will notify the VA's representative when the work is completed in accordance with this specification. The VA's representative may inspect the regulated area and the systems with the VPIH/CIH and may require that upon satisfactory inspection, the Contractor's employees perform all major aspects of the approved AHAP(s), especially worker protection, respiratory systems, contingency plans, decontamination procedures, and monitoring to demonstrate satisfactory operation.
- C. The CPIH/CIH shall document the pre-abatement activities described above and deliver a copy to the VA's representative.

- D. Upon satisfactory inspection of the installation of and operation of systems the VA's representative will notify the Contractor in writing to proceed with the asbestos abatement work in accordance with this specification.

3.2 REMOVAL OF PIPING ACM

3.2.1 WETTING MATERIALS

- A. Use amended water for the wetting of ACM prior to removal. The Competent Person shall assure the wetting of ACM meets the definition of "adequately wet" in the EPA NESHAP's regulation and OSHA's "wet methods" for the duration of the project. A removal encapsulant may be used instead of amended water with written approval of the VA's representative.
- B. Amended Water: Provide water to which a surfactant has been added shall be used to wet the ACM and reduce the potential for fiber release during disturbance of ACM. The mixture must be equal to or greater than the wetting provided by water amended by a surfactant consisting one ounce of 50% polyoxyethylene ester and 50% polyoxyethylene ether mixed with 5 gallons (19L) of water.
- C. Removal Encapsulant: Provide a penetrating encapsulant designed specifically for the removal of ACM. The material must, when used, result in adequate wetting of the ACM and retard fiber release during disturbance equal to or greater than the amended water described above in B.

3.2.2 SECONDARY BARRIER AND WALKWAYS

- A. Install as a drop cloth a 6 mil poly sheet at the beginning of each work shift where removal is to be done during that shift. Completely cover floors and any walls within 10 feet (3 meters) of the area where work is to be done. Secure the secondary barrier with duct tape to prevent it from moving or debris from getting behind it. Remove the secondary barrier at the end of the shift or as work in the area is completed. Keep residue on the secondary barrier wetted. When removing, fold inward to prevent spillage and place in a disposal bag.
- B. Install walkways using 6 mil black poly between the regulated area and the decontamination facilities (PDF and W/EDF) to protect the primary layers from contamination and damage. Install the walkways at the beginning of each shift and remove at the end of each shift.

3.2.3 WET REMOVAL OF ACM

- A. Using acceptable glovebag procedures, adequately and thoroughly wet the ACM to be removed prior to removal with amended water or when authorized by VA, removal encapsulant to reduce/prevent fiber release to the air. Adequate time (at a minimum two hours) must be allowed for the amended water or removal encapsulant to saturate the ACM. Abatement personnel must not disturb dry ACM. Use a fine spray of amended water or removal encapsulant. Saturate the material sufficiently to wet to the substrate without causing excessive dripping. The material must be sprayed repeatedly/continuously during the removal process in order to maintain adequately wet conditions. Removal encapsulants must be applied in accordance with the manufacturer's written instructions. Perforate or carefully separate, using wet methods, an outer covering that is painted or jacketed in order to allow penetration and wetting of the material. Where necessary, carefully remove covering while wetting to minimize fiber release. **In no event shall dry removal occur except when authorized in writing by the VPIH/CIH and VA when a greater safety hazard (e.g., electricity) is present**

3.3 GLOVEBAG REMOVAL PROCEDURES

3.3.1 GENERAL

All applicable OSHA requirements and glovebag manufacturer's recommendations shall be met during glove bagging operations. In cases where live steam lines are present, the lines must be shut down prior to any work being performed on the system. **No abatement work shall be conducted on live, pressurized steam lines.** The Contractor may choose to use a High Temperature Glovebag in which a temperature rating ranges from 300°F to 700°F on steam lines that have recently been shut down and remain at high temperature for some time. In the case

where a glovebag is not feasible, the Contractor will need to build a full negative pressure containment of sufficient size and follow all regulations as it pertains to removal.

1. Mix the surfactant with water in the garden sprayer, following the manufacturer's directions.
2. Have each employee put on a HEPA filtered respirator approved for asbestos and check the fit using the positive/negative fit check.
3. Have each employee put on a disposable full-body suit. Remember, the hood goes over the respirator straps.
4. Check closely the integrity of the glove bag to be used. Check all seams, gloves, sleeves, and glove openings. OSHA requires the bottom of the bag to be seamless.
5. Check the pipe where the work will be performed. If it is damaged (broken lagging, hanging, etc.), wrap the entire length of the pipe in poly sheeting and "candy stripe" it with duct tape.
6. Attach glovebag with required tools per manufacturer's instructions.
7. Using the smoke tube and aspirator bulb, test 10% of glovebags by placing the tube into the water porthole (two-inch opening to glove bag), and fill the bag with smoke and squeeze it. If leaks are found, they should be taped closed using duct tape and the bag should be retested with smoke.
8. Insert the wand from the water sprayer through the water porthole.
9. Insert the hose end from a HEPA vacuum into the upper portion of the glove bag.
10. Wet and remove the pipe insulation.
11. If the section of pipe is covered with an aluminum jacket, remove it first using the wire cutters to cut any bands and the tin snips to remove the aluminum. It is important to fold the sharp edges in to prevent cutting the bag when placing it in the bottom.
12. When the work is complete, spray the upper portion of the bag and clean-push all residue into the bottom of the bag with the other waste material. Be very thorough. Use adequate water.
13. Put all tools, after washing them off in the bag, in one of the sleeves of glove bag and turn it inside out, drawing it outside of the bag. Twist the sleeve tightly several times to seal it and tape it several tight turns with duct tape. Cut through the middle of the duct tape and remove the sleeve. Put the sleeve in the next glove bag or put it in a bucket of water to decontaminate the tools after cutting the sleeve open.
14. Turn on the HEPA vacuum and collapse the bag completely. Remove the vacuum nozzle, seal the hole with duct tape, twist the bag tightly several times in the middle, and tape it to keep the material in the bottom during removal of the glove bag from the pipe.
15. Slip a disposal bag over the glove bag (still attached to the pipe). Remove the tape securing the ends, and slit open the top of the glove bag and carefully fold it down into the disposal bag. Double bag and gooseneck waste materials.

3.3.2 NEGATIVE PRESSURE GLOVEBAG PROCEDURE

1. In addition to the above requirements, the HEPA vacuum shall be run continuously during the glovebag procedure until completion at which time the glovebag will be collapsed by the HEPA vacuum prior to removal from the pipe/component.
2. The HEPA vacuum shall be attached and operated as needed to prevent collapse of the glovebag during the removal process.

3.4 LOCKDOWN ENCAPSULATION

3.4.1 GENERAL

Lockdown encapsulation is an integral part of the ACM removal. At the conclusion of ACM removal and before removal of the primary barriers, all piping surfaces shall be encapsulated with a bridging encapsulant.

3.4.2 SEALING EXPOSED EDGES

Seal edges of ACM exposed by removal work with two coats of encapsulant. Prior to sealing, permit the exposed edges to dry completely to permit penetration of the encapsulant.

3.5 DISPOSAL OF ACM WASTE MATERIALS

3.5.1 GENERAL

Dispose of waste ACM and debris which is packaged in accordance with these specifications, OSHA, EPA and DOT. The landfill requirements for packaging must also be met. Transport will be in compliance with 49 CFR 100–185 regulations. Disposal shall be done at an approved landfill. Disposal of friable and non-friable ACM shall be done in accordance with applicable regulations.

3.5.2 PROCEDURES

- A. The VA must be notified at least 24 hours in advance of any waste removed from the containment
- B. Asbestos waste shall be packaged and moved through the W/EDF into a covered transport container in accordance with procedures in this specification. Waste shall be double-bagged and wetted with amended water prior to disposal. Wetted waste can be very heavy. Bags shall not be overfilled. Bags shall be securely sealed to prevent accidental opening and/or leakage. The top shall be tightly twisted and goose necked prior to tightly sealing with at least three wraps of duct tape. Ensure that unauthorized persons do not have access to the waste material once it is outside the regulated area. All transport containers must be lined with one-layer of 6-mil poly, then covered and secured at all times when not in use. OSHA signs must be on containers during loading and unloading. Material shall not be transported in open vehicles. If drums are used for packaging, the drums shall be labeled properly and shall not be re-used.
- C. Waste Load Out: Waste load out shall be done in accordance with the procedures in W/EDF Decontamination Procedures. Sealed waste bags shall be decontaminated on exterior surfaces by wet cleaning and/or HEPA vacuuming before being placed in the second waste bag and sealed, which then must also be wet wiped or HEPA vacuumed..
- D. Asbestos waste with sharp edged components, i.e., nails, screws, lath, strapping, tin sheeting, jacketing, metal mesh, etc., which might tear poly bags shall be wrapped securely in burlap or "rice" bags before packaging and, if needed, use a poly lined fiber drum as the second container, prior to disposal.

3.6 PROJECT DECONTAMINATION

3.6.1 GENERAL

- A. The entire work related to project decontamination shall be performed under the close supervision and monitoring of the CPIH/CIH.
- B. If the asbestos abatement work is in an area which was contaminated prior to the start of abatement, the decontamination will be done by cleaning the primary barrier poly prior to its removal and cleanings of the surfaces of the regulated area after the primary barrier removal.
- C. If the asbestos abatement work is in an area which was uncontaminated prior to the start of abatement, the decontamination will be done by cleaning the primary barrier poly prior to its removal, thus preventing contamination of the building when the regulated area critical barriers are removed.

3.6.2 REGULATED AREA CLEARANCE

Air testing and other requirements which must be met before release of the Contractor and re-occupancy of the regulated area space are specified in Final Testing Procedures.

3.6.3 WORK DESCRIPTION

Decontamination includes the clearance air testing in the regulated area and the decontamination and removal of the enclosures/facilities installed prior to the abatement work including primary/critical barriers, PDF and W/EDF facilities, and negative pressure systems.

3.6.4 PRE-DECONTAMINATION CONDITIONS

- A. Before decontamination starts, all ACM waste from the regulated area shall be removed, all waste collected and removed, and the secondary barrier of poly removed and disposed of along with any gross debris generated by the work.
- B. At the start of decontamination, the following shall be in place:
 - 1. Critical barriers over all openings consisting of two layers of 6 mil poly which is the sole barrier between the regulated area and the rest of the building or outside.
 - 2. Decontamination facilities, if required for personnel and equipment in operating condition.

3.6.5 FIRST CLEANING

Carry out a first cleaning of all surfaces of the regulated area including items of remaining poly sheeting, tools, scaffolding, ladders/staging by wet methods and/or HEPA vacuuming. Do not use dry dusting/sweeping/air blowing methods. Use each surface of a wetted cleaning cloth one time only and then dispose of as contaminated waste. Continue this cleaning until there is no visible residue from abated surfaces or poly or other surfaces. Remove all filters in the air handling system and dispose of as ACM waste in accordance with these specifications. The negative pressure system shall remain in operation during this time. Additional cleaning(s) may be needed as determined by the CPIH/VPIH/CIH.

3.6.6 PRE-CLEARANCE INSPECTION AND TESTING

The CPIH/CIH and VPIH/CIH will perform a thorough and detailed visual inspection at the end of the cleaning to determine whether there is any visible residue in the regulated area. If the visual inspection is acceptable, the CPIH/CIH will perform pre-clearance sampling using aggressive clearance as detailed in 40 CFR 763 Subpart E (AHERA) Appendix A (III)(B)(7)(d). If the sampling results show values below 0.01 f/cc, then the Contractor shall notify the VA's representative of the results with a brief report from the CPIH/CIH documenting the inspection and sampling results and a statement verifying that the regulated area is ready for lockdown encapsulation. The VA reserves the right to utilize their own VPIH/CIH to perform a pre-clearance inspection and testing for verification.

3.6.7 LOCKDOWN ENCAPSULATION OF ABATED SURFACES

With the express written permission of the VA's representative, perform lockdown encapsulation of all surfaces from which asbestos was abated in accordance with the procedures in this specification.

3.7 FINAL VISUAL INSPECTIONS AND AIR CLEARANCE TESTING

3.7.1 GENERAL

Notify the VA representative 24 hours in advance for the performance of the final visual inspection and testing. The final visual inspection and testing will be performed by the VPIH/CIH after the final cleaning.

3.7.2 FINAL VISUAL INSPECTION

Final visual inspection will include the entire regulated area, the PDF, all poly sheeting, seals over HVAC openings, doorways, windows, and any other openings. If any debris, residue, dust or any other suspect material is detected, the final cleaning shall be repeated at no cost to the VA. Dust/material samples may be collected and analyzed at no cost to the VA at the discretion of the VPIH/CIH to confirm visual findings. When the regulated area is visually clean the final testing can be done.

3.7.3 FINAL AIR CLEARANCE TESTING

- A. After an acceptable final visual inspection by the VPIH/CIH and VA Representative, the VPIH/CIH will perform the final clearance testing. Air samples will be collected and analyzed in accordance

with procedures for AHERA in this specification. If work is less than 260 lf/160 sf/35 cf, 5 PCM samples shall be collected for clearance and a minimum of one field blank. If work is equal to or more than 260 lf/160 sf/35 cf, AHERA TEM sampling shall be performed for clearance. TEM analysis shall be done in accordance with procedures for EPA AHERA in this specification. If the release criteria are not met, the Contractor shall repeat the final cleaning and continue decontamination procedures until clearance is achieved. All additional inspection and testing costs will be borne by the Contractor.

- B. If release criteria are met, proceed to perform the abatement closeout and to issue the certificate of completion in accordance with these specifications.

3.7.4 FINAL AIR CLEARANCE PROCEDURES

- A. Contractor's Release Criteria: Work in a regulated area is complete when the regulated area is visually clean and airborne fiber levels have been reduced to or below 0.01 f/cc as measured by the AHERA PCM protocol, or 70 AHERA structures per square millimeter (s/mm²) by AHERA TEM.
- B. Air Monitoring and Final Clearance Sampling: To determine if the elevated airborne fiber counts encountered during abatement operations have been reduced to the specified level, the VPIH/CIH will secure samples and analyze them according to the following procedures:
 - 1. Fibers Counted: "Fibers" referred to in this section shall be either all fibers regardless of composition as counted in the NIOSH 7400 PCM method or asbestos fibers counted using the AHERA TEM method.
 - 2. Aggressive Sampling: All final air testing samples shall be collected using aggressive sampling techniques except where soil is not encapsulated or enclosed. Samples will be collected on 0.8μ MCE filters for PCM analysis and 0.45μ Polycarbonate filters for TEM. A minimum of 1200 Liters of using calibrated pumps shall be collected for clearance samples. Before pumps are started, initiate aggressive air mixing sampling as detailed in 40 CFR 763 Subpart E (AHERA) Appendix A (III)(B)(7)(d). Air samples will be collected in areas subject to normal air circulation away from corners, obstructed locations, and locations near windows, doors, or vents. After air sampling pumps have been shut off, circulating fans shall be shut off. The negative pressure system shall continue to operate.

3.7.5 CLEARANCE SAMPLING USING PCM

- A. The VPIH/CIH will perform clearance samples as indicated by the specification.
- B. The NIOSH 7400 PCM method will be used for clearance sampling with a minimum collection volume of 1200 Liters of air. A minimum of 5 PCM clearance samples shall be collected. All samples must be equal to or less than 0.01 f/cc to clear the regulated area.

3.7.6 CLEARANCE SAMPLING USING TEM

- A. Clearance requires 13 samples be collected; 5 inside the regulated area; 5 outside the regulated area; and 3 field blanks.
- B. The TEM method will be used for clearance sampling with a minimum collection volume of 1200 Liters of air. A minimum of 13 clearance samples shall be collected. All samples must be equal to or less than 70 AHERA structures per square millimeter (s/mm²) AHERA TEM.

3.7.7 LABORATORY TESTING OF PCM SAMPLES

The services of an AIHA accredited laboratory will be employed by the VA to perform analysis for the PCM air samples. The accredited laboratory shall be successfully participating in the AIHA Proficiency Analytical Testing (PAT) program. Samples will be sent daily by the VPIH/CIH so that verbal/faxed reports can be received within 24 hours. A complete record, certified by the laboratory, of all air monitoring tests and results will be furnished to the VA's representative and the Contractor.

3.7.8 LABORATORY TESTING OF TEM SAMPLES

Samples shall be sent by the VPIH/CIH to a NIST accredited laboratory for analysis by TEM. The laboratory shall be successfully participating in the NIST Airborne Asbestos Analysis (TEM) program. Verbal/faxed results from the laboratory shall be available within 24 hours after receipt of the samples. A complete record, certified by the laboratory, of all TEM results shall be furnished to the VA's representative and the Contractor

3.8 ABATEMENT CLOSEOUT AND CERTIFICATE OF COMPLIANCE**3.8.1 COMPLETION OF ABATEMENT WORK**

After thorough decontamination, seal negative air machines with 2 layers of 6 mil poly and duct tape to form a tight seal at the intake/outlet ends before removal from the regulated area. Complete asbestos abatement work upon meeting the regulated area visual and air clearance criteria and fulfilling the following:

- A. Remove all equipment, materials, and debris from the project area.
- B. Package and dispose of all asbestos waste as required. Dispose of waste ACM and debris which is packaged in accordance with these specifications, OSHA, EPA and DOT. The landfill requirements for packaging must also be met. Transport will be in compliance with 49 CFR 100–185 regulations.
- C. Repair or replace all interior finishes damaged during the abatement work.
- D. The VA will be notified of any waste removed from the containment prior to 24 hours.
- E. Fulfill other project closeout requirements as specified elsewhere in this specification.

3.8.2 CERTIFICATE OF COMPLETION BY CONTRACTOR

The CPIH/CIH shall complete and sign the "Certificate of Completion" in accordance with Attachment 1 at the completion of the abatement and decontamination of the regulated area.

3.8.3 WORK SHIFTS

All work shall be done during administrative hours (8:00 AM to 4:30 PM) Monday - Friday excluding Federal Holidays. Any change in the work schedule must be approved in writing by the VA Representative.

3.8.4 RE-INSULATION

If required as part of the contract, replace all asbestos containing insulation with suitable non-asbestos material. Provide MSDS for all replacement materials. Refer to Section 23 07 11, HVAC AND BOILER PLANT INSULATION.

ATTACHMENT #1**CERTIFICATE OF COMPLETION**

DATE: _____ VA Project #: _____

PROJECT NAME: _____ Abatement Contractor: _____

VAMC/ADDRESS: _____

1. I certify that I have personally inspected, monitored and supervised the abatement work of (specify regulated area or Building):
which took place from / / to / /
2. That throughout the work all applicable requirements/regulations and the VA's specifications were met.
3. That any person who entered the regulated area was protected with the appropriate personal protective equipment and respirator and that they followed the proper entry and exit procedures and the proper operating procedures for the duration of the work.
4. That all employees of the Abatement Contractor engaged in this work were trained in respiratory protection, were experienced with abatement work, had proper medical surveillance documentation, were fit-tested for their respirator, and were not exposed at any time during the work to asbestos without the benefit of appropriate respiratory protection.
5. That I performed and supervised all inspection and testing specified and required by applicable regulations and VA specifications.
6. That the conditions inside the regulated area were always maintained in a safe and healthy condition and the maximum fiber count never exceeded 0.5 f/cc, except as described below.
7. That all glovebag work was done in accordance with OSHA requirements and the manufacturer's recommendations.

CPIH/CIH Signature/Date: _____

CPIH/CIH Print Name: _____

Abatement Contractor Signature/Date: _____

Abatement Contractor Print Name: _____

**ATTACHMENT #2
CERTIFICATE OF WORKER'S ACKNOWLEDGMENT**

PROJECT NAME: _____ DATE: _____

PROJECT ADDRESS: _____

ABATEMENT CONTRACTOR'S NAME: _____

WORKING WITH ASBESTOS CAN BE HAZARDOUS TO YOUR HEALTH. INHALING ASBESTOS HAS BEEN LINKED WITH VARIOUS TYPES OF CANCERS. IF YOU SMOKE AND INHALE ASBESTOS FIBERS, YOUR CHANCES OF DEVELOPING LUNG CANCER IS GREATER THAN THAT OF THE NON-SMOKING PUBLIC.

Your employer's contract with the owner for the above project requires that: You must be supplied with the proper personal protective equipment including an adequate respirator and be trained in its use. You must be trained in safe and healthy work practices and in the use of the equipment found at an asbestos abatement project. You must receive/have a current medical examination for working with asbestos. These things shall be provided at no cost to you. By signing this certificate you are indicating to the owner that your employer has met these obligations.

RESPIRATORY PROTECTION: I have been trained in the proper use of respirators and have been informed of the type of respirator to be used on the above indicated project. I have a copy of the written Respiratory Protection Program issued by my employer. I have been provided for my exclusive use, at no cost, with a respirator to be used on the above indicated project.

TRAINING COURSE: I have been trained by a third party, State/EPA accredited trainer in the requirements for an AHERA/OSHA Asbestos Abatement Worker training course, 32 hours minimum duration. I currently have a valid State accreditation certificate. The topics covered in the course include, as a minimum, the following:

- Physical Characteristics and Background Information on Asbestos
- Potential Health Effects Related to Exposure to Asbestos
- Employee Personal Protective Equipment
- Establishment of a Respiratory Protection Program
- State of the Art Work Practices
- Personal Hygiene
- Additional Safety Hazards
- Medical Monitoring
- Air Monitoring
- Relevant Federal, State and Local Regulatory Requirements, Procedures, and Standards
- Asbestos Waste Disposal

MEDICAL EXAMINATION: I have had a medical examination within the past 12 months which was paid for by my employer. This examination included: health history, occupational history, pulmonary function test, and may have included a chest x-ray evaluation. The physician issued a positive written opinion after the examination.

Signature: _____

Printed Name: _____

Social Security Number: _____

Witness: _____

ATTACHMENT #3**AFFIDAVIT OF MEDICAL SURVEILLANCE, RESPIRATORY PROTECTION AND TRAINING/ACCREDITATION**

VA PROJECT NAME AND NUMBER: _____

VA MEDICAL FACILITY: _____

ABATEMENT CONTRACTOR'S NAME AND ADDRESS: _____

1. I verify that the following individual
Name: _____ Social Security Number: _____
who is proposed to be employed in asbestos abatement work associated with the above project by the named Abatement Contractor, is included in a medical surveillance program in accordance with 29 CFR 1926.1101(m), and that complete records of the medical surveillance program as required by 29 CFR 1926.1101(m)(n) and 29 CFR 1910.20 are kept at the offices of the Abatement Contractor at the following address.
Address: _____
2. I verify that this individual has been trained, fit-tested and instructed in the use of all appropriate respiratory protection systems and that the person is capable of working in safe and healthy manner as expected and required in the expected work environment of this project.
3. I verify that this individual has been trained as required by 29 CFR 1926.1101(k). This individual has also obtained a valid State accreditation certificate. Documentation will be kept on-site.
4. I verify that I meet the minimum qualifications criteria of the VA specifications for a CPIH.

Signature of CPIH/CIH: _____ Date: _____

Printed Name of CPIH/CIH: _____

Signature of Contractor: _____ Date: _____

Printed Name of Contractor: _____

ATTACHMENT #4**ABATEMENT CONTRACTOR/COMPETENT PERSON(S) REVIEW AND ACCEPTANCE OF THE VA'S ASBESTOS SPECIFICATIONS**

VA Project Location: _____

VA Project #: _____

VA Project Description: _____

This form shall be signed by the Asbestos Abatement Contractor Owner and the Asbestos Abatement Contractor's Competent Person(s) prior to any start of work at the VA related to this Specification. If the Asbestos Abatement Contractor's/Competent Person(s) has not signed this form, they shall not be allowed to work on-site.

I, the undersigned, have read VA's Asbestos Specification regarding the asbestos abatement requirements. I understand the requirements of the VA's Asbestos Specification and agree to follow these requirements as well as all required rules and regulations of OSHA/EPA/DOT and State/Local requirements. I have been given ample opportunity to read the VA's Asbestos Specification and have been given an opportunity to ask any questions regarding the content and have received a response related to those questions. I do not have any further questions regarding the content, intent and requirements of the VA's Asbestos Specification.

At the conclusion of the asbestos abatement, I will certify that all asbestos abatement work was done in accordance with the VA's Asbestos Specification and all ACM was removed properly and no fibrous residue remains on any abated surfaces.

Abatement Contractor Owner's Signature _____ Date _____

Abatement Contractor Competent Person(s) _____ Date _____

- - END SECTION 02 82 13.13 - -

**SECTION 02 82 13.31
ASBESTOS GASKET ABATEMENT****TABLE OF CONTENTS**

| | |
|--|----|
| SECTION 00 01 15 LIST OF DRAWING SHEETS | 1 |
| 1.1 GENERAL INTENTION | 1 |
| 1.2 STATEMENT OF BID ITEM(S) | 2 |
| 1.3 construction security requirements | 3 |
| 1.4 FIRE SAFETY | 4 |
| 1.5 OPERATIONS AND STORAGE AREAS | 6 |
| 1.6 ALTERATIONS | 9 |
| 1.7 INFECTION PREVENTION MEASURES | 10 |
| 1.8 DISPOSAL AND RETENTION | 12 |
| 1.9 PROTECTION OF EXISTING VEGETATION, STRUCTURES, EQUIPMENT, UTILITIES, AND IMPROVEMENTS | 12 |
| 1.10 RESTORATION | 13 |
| 1.11 As-Built Drawings | 14 |
| 1.12 USE OF ROADWAYS | 14 |
| 1.13 TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT | 14 |

| | |
|--|----|
| 1.14 TEMPORARY USE OF EXISTING ELEVATORS | 15 |
| 1.15 TEMPORARY TOILETS | 16 |
| 1.16 AVAILABILITY AND USE OF UTILITY SERVICES..... | 16 |
| 1.17 TESTS | 17 |
| 1.18 INSTRUCTIONS | 17 |
| 1.19 GOVERNMENT-FURNISHED PROPERTY | 18 |
| 1.20 RELOCATED EQUIPMENT/ITEMS..... | 19 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 AVAILABILITY OF SPECIFICATIONS LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS FPMR PART 101-29 (FAR 52.211-1) (AUG 1998) | 1 |
| 1.3 AVAILABILITY FOR EXAMINATION OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM descriptions (FAR 52.211-4) (JUN 1988) | 1 |
| 1.4 AVAILABILITY OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS (FAR 52.211-3) (JUN 1988) | 1 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 QUALITY CONTROL | 1 |

1.3 references1

1.4 SUBMITTALS2

1.5 PROTECTION OF ENVIRONMENTAL RESOURCES3

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 Contractual Relationships2

1.3 RELATED WORK3

1.4 SUMMARY3

1.5 DEFINITIONS3

1.6 SYSTEMS TO BE COMMISSIONED4

1.7 COMMISSIONING TEAM5

1.8 VA'S COMMISSIONING RESPONSIBILITIES5

1.9 CONTRACTOR'S COMMISSIONING RESPONSIBILITIES6

1.10 COMMISSIONING AGENT'S RESPONSIBILITIES6

1.11 COMMISSIONING DOCUMENTATION8

1.12 SUBMITTALS11

1.13 COMMISSIONING PROCESS12

| | |
|---|----|
| 1.14 QUALITY ASSURANCE | 13 |
| 1.15 COORDINATION | 13 |
| part 2 - PRODUCTS | 14 |
| 2.1 TEST EQUIPMENT | 14 |
| part 3 - EXECUTION | 14 |
| 3.1 STARTUP, INITIAL CHECKOUT, AND PRE-FUNCTIONAL CHECKLISTS | 14 |
| 3.2 DEFICIENCIES, NONCONFORMANCE, AND APPROVAL IN CHECKLISTS AND STARTUP | 16 |
| 3.3 PHASED COMMISSIONING | 16 |
| 3.4 TRENDING AND ALARMS | 16 |
| 3.5 SYSTEMS FUNCTIONAL PERFORMANCE TESTING | 32 |
| 3.6 DOCUMENTATION, NONCONFORMANCE AND APPROVAL OF TESTS | 35 |
| 3.7 DEFERRED TESTING | 37 |
| 3.8 OPERATION AND MAINTENANCE TRAINING REQUIREMENTS | 38 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION: | 1 |
| 1.2 RELATED WORK: | 1 |
| 1.3 PROTECTION: | 1 |

1.4 UTILITY SERVICES:2

PART 2 - PRODUCTS (Not Used)2

PART 3 – EXECUTION2

3.1 DEMOLITION:2

3.2 CLEAN-UP:3

PART 1 - GENERAL1

1.1 SUMMARY OF THE WORK1

1.1.1 CONTRACT DOCUMENTS AND RELATED REQUIREMENTS1

1.1.2 EXTENT OF WORK1

1.1.3 RELATED WORK1

1.1.4 TASKS2

1.1.5 ABATEMENT CONTRACTOR USE OF PREMISES2

1.2 VARIATIONS IN QUANTITY.....2

1.3 STOP ASBESTOS REMOVAL2

1.4 DEFINITIONS3

1.4.1 GENERAL.....3

1.4.2 GLOSSARY3

| | |
|---|----|
| 1.4.3 REFERENCED STANDARDS ORGANIZATIONS | 8 |
| 1.5 APPLICABLE CODES AND REGULATIONS | 9 |
| 1.5.1 GENERAL APPLICABILITY OF CODES, REGULATIONS, AND STANDARDS | 9 |
| 1.5.2 Asbestos Abatement CONTRACTOR RESPONSIBILITY | 9 |
| 1.5.3 FEDERAL REQUIREMENTS | 10 |
| 1.5.4 STATE REQUIREMENTS | 10 |
| 1.5.5 LOCAL REQUIREMENTS | 10 |
| 1.5.6 STANDARDS | 10 |
| 1.5.7 EPA GUIDANCE DOCUMENTS | 11 |
| 1.5.8 NOTICES | 11 |
| 1.5.9 PERMITS/LICENSES | 11 |
| 1.5.10 POSTING AND FILING OF REGULATIONS | 11 |
| 1.5.11 VA RESPONSIBILITIES | 11 |
| 1.5.12 EMERGENCY ACTION PLAN AND ARRANGEMENTS | 11 |
| 1.5.14 PRE-Construction MEETING | 12 |
| 1.6 PROJECT COORDINATION | 12 |
| 1.6.1 PERSONNEL | 13 |

| | |
|--|----|
| 1.7 RESPIRATORY PROTECTION | 13 |
| 1.7.1 GENERAL - RESPIRATORY PROTECTION PROGRAM | 13 |
| 1.7.2 RESPIRATORY PROTECTION PROGRAM COORDINATOR | 14 |
| 1.7.3 SELECTION AND USE OF RESPIRATORS | 14 |
| 1.7.4 MINIMUM RESPIRATORY PROTECTION | 14 |
| 1.7.5 MEDICAL WRITTEN OPINION | 14 |
| 1.7.6 RESPIRATOR FIT TEST | 14 |
| 1.7.7 RESPIRATOR FIT CHECK | 14 |
| 1.7.8 MAINTENANCE AND CARE OF RESPIRATORS | 14 |
| 1.8 WORKER PROTECTION | 14 |
| 1.8.1 TRAINING OF ABATEMENT PERSONNEL | 14 |
| 1.8.2 MEDICAL EXAMINATIONS | 15 |
| 1.8.3 personal PROTECTIVE EQUIPMENT | 15 |
| 1.8.4 REGULATED AREA ENTRY PROCEDURE | 15 |
| 1.8.5 DECONTAMINATION PROCEDURE | 15 |
| 1.8.6 REGULATED AREA REQUIREMENTS | 15 |
| 1.9 DECONTAMINATION FACILITIES | 16 |

| | |
|---|----|
| 1.9.1 DESCRIPTION | 16 |
| 1.9.2 GENERAL REQUIREMENTS | 16 |
| 1.9.3 TEMPORARY FACILITIES TO THE PDF and w/EDF | 16 |
| 1.9.4 PERSONNEL DECONTAMINATION FACILITY (PDF)..... | 16 |
| 1.9.5 waste/EQUIPMENT DECONTAMINATION FACILITY (w/EDF) | 17 |
| 1.9.6 waste/EQUIPMENT DECONTAMINATION PROCEDURES..... | 18 |
| PART 2 - PRODUCTS, MATERIALS AND EQUIPMENT | 18 |
| 2.1 MATERIALS AND EQUIPMENT | 18 |
| 2.1.1 GENERAL REQUIREMENTS (all abatement projects) | 18 |
| 2.1.2 NEGATIVE PRESSURE FILTRATION SYSTEM..... | 19 |
| 2.1.3 DESIGN AND LAYOUT | 20 |
| 2.1.4 NEGATIVE AIR MACHINES (HEPA UNITS) | 20 |
| 2.1.5 PRESSURE DIFFERENTIAL | 21 |
| 2.2 CONTAINMENT BARRIERS AND COVERINGS IN THE REGULATED AREA | 21 |
| 2.2.1 GENERAL | 21 |
| 2.2.2 PREPARATION PRIOR TO SEALING THE REGULATED AREA..... | 21 |
| 2.2.3 CONTROLLING ACCESS TO THE REGULATED AREA..... | 21 |

| | | |
|--|----|----|
| 2.2.4 CRITICAL BARRIERS | 21 | |
| 2.2.5 SECONDARY BARRIERS | 22 | |
| 2.2.6 EXTENSION OF THE REGULATED AREA | 22 | |
| 2.2.7 FIRESTOPPING | 22 | |
| 2.3 MONITORING, INSPECTION AND TESTING | 22 | |
| 2.3.1 GENERAL | 22 | |
| 2.3.2 SCOPE OF SERVICES OF THE VPIH/cih CONSULTANT | 23 | |
| 2.3.3 MONITORING, INSPECTION AND TESTING BY CONTRACTOR CPIH/CIH | 23 | 23 |
| 2.4 Asbestos hazard abatement plan | 24 | |
| 2.5 SUBMITTALS | 24 | |
| 2.5.1 PRE-start MEETING SUBMITTALS | 24 | |
| 2.5.2 SUBMITTALS DURING ABATEMENT | 25 | |
| 2.5.3 SUBMITTALS AT COMPLETION OF ABATEMENT | 26 | |
| 2.6 ENCAPSULANTS | 26 | |
| 2.6.1 TYPES OF ENCAPSULANTS | 26 | |
| 2.6.2 PERFORMANCE REQUIREMENTS | 26 | |
| 2.7 CERTIFICATES OF COMPLIANCE | 27 | |

| | |
|--|----|
| 2.8 RECYCLABLE PROTECTIVE CLOTHING | 27 |
| PART 3 – EXECUTION | 27 |
| 3.1 REGULATED AREA PREPARATIONS | 27 |
| 3.1.1 SITE SECURITY | 27 |
| 3.1.2 OSHA DANGER SIGNS | 27 |
| 3.1.3.1 SHUT DOWN - LOCK OUT ELECTRICAL | 28 |
| 3.1.3.2 SHUT DOWN - LOCK OUT HVAC | 28 |
| 3.1.4 CONTAINMENT BARRIERS AND COVERINGS FOR THE REGULATED AREA | 28 |
| 3.1.4.1 GENERAL | 28 |
| 3.1.4.2 PREPARATION PRIOR TO SEALING OFF | 28 |
| 3.1.4.3 CONTROLLING ACCESS TO THE REGULATED AREA | 28 |
| 3.1.4.4 CRITICAL BARRIERS | 28 |
| 3.1.4.5 EXTENSION OF THE REGULATED AREA | 29 |
| 3.1.4.6 floor barriers | 29 |
| 3.1.5 SANITARY FACILITIES | 29 |
| 3.1.6 Pre-Cleaning | 29 |
| 3.1.6.1 PRE-CLEANING MOVABLE OBJECTS | 29 |

| | |
|---|----|
| 3.1.6.2 PRE-CLEANING FIXED OBJECTS | 29 |
| 3.1.6.3 PRE-CLEANING SURFACES IN THE REGULATED AREA | 29 |
| 3.1.7 PRE-ABATEMENT ACTIVITIES | 30 |
| 3.1.7.1 PRE-ABATEMENT MEETING | 30 |
| 3.1.7.2 PRE-ABATEMENT INSPECTIONS AND PREPARATIONS | 30 |
| 3.1.7.3 PRE-ABATEMENT CONSTRUCTION AND OPERATIONS | 30 |
| 3.2 REMOVAL OF piping ACM | 31 |
| 3.2.1 WETTING MATERIALS | 31 |
| 3.2.2 SECONDARY BARRIER AND WALKWAYS | 31 |
| 3.2.3 WET REMOVAL OF ACM | 31 |
| 3.3 GLOVEBAG REMOVAL PROCEDURES | 31 |
| 3.3.1 GENERAL | 31 |
| 3.3.2 NEGATIVE PRESSURE GLOVEBAG PROCEDURE | 32 |
| 3.4 LOCKDOWN ENCAPSULATION | 32 |
| 3.4.1 GENERAL | 32 |
| 3.4.2 SEALING EXPOSED EDGES | 32 |
| 3.5 DISPOSAL OF ACM WASTE MATERIALS | 33 |

| | |
|--|----|
| 3.5.1 GENERAL | 33 |
| 3.5.2 PROCEDURES | 33 |
| 3.6 PROJECT DECONTAMINATION | 33 |
| 3.6.1 GENERAL | 33 |
| 3.6.2 REGULATED AREA CLEARANCE | 33 |
| 3.6.3 WORK DESCRIPTION | 33 |
| 3.6.4 PRE-DECONTAMINATION CONDITIONS | 34 |
| 3.6.5 FIRST CLEANING | 34 |
| 3.6.6 PRE-CLEARANCE INSPECTION AND TESTING | 34 |
| 3.6.7 LOCKDOWN ENCAPSULATION OF ABATED SURFACES | 34 |
| 3.7 FINAL VISUAL INSPECTIONs AND AIR CLEARANCE TESTING | 34 |
| 3.7.1 GENERAL | 34 |
| 3.7.2 FINAL VISUAL INSPECTION | 34 |
| 3.7.3 FINAL AIR CLEARANCE TESTING | 34 |
| 3.7.4 FINAL AIR CLEARANCE PROCEDURES | 35 |
| 3.7.5 CLEARANCE SAMPLING USING PCM | 35 |
| 3.7.6 CLEARANCE SAMPLING USING TEM | 35 |

| | |
|--|----|
| 3.7.7 LABORATORY TESTING OF PCM SAMPLES | 35 |
| 3.7.8 LABORATORY TESTING OF TEM SAMPLES | 36 |
| 3.8 ABATEMENT CLOSEOUT AND CERTIFICATE OF COMPLIANCE | 36 |
| 3.8.1 COMPLETION OF ABATEMENT WORK | 36 |
| 3.8.2 CERTIFICATE OF COMPLETION BY CONTRACTOR | 36 |
| 3.8.3 WORK SHIFTS | 36 |
| 3.8.4 RE-INSULATION | 36 |
| ATTACHMENT #1 | 37 |
| PART 1 - GENERAL | 1 |
| 1.1 SUMMARY OF THE WORK | 1 |
| 1.1.1 CONTRACT DOCUMENTS AND RELATED REQUIREMENTS | 1 |
| 1.1.2 EXTENT OF WORK | 1 |
| 1.1.3 RELATED WORK | 1 |
| 1.1.4 TASKS | 1 |
| 1.1.5 ABATEMENT CONTRACTOR USE OF PREMISES | 1 |
| 1.2 VARIATIONS IN QUANTITY | 2 |
| 1.3 STOP ASBESTOS REMOVAL | 2 |

| | |
|---|----|
| 1.4 DEFINITIONS | 2 |
| 1.4.1 GENERAL | 2 |
| 1.4.2 GLOSSARY | 3 |
| 1.4.3 REFERENCED STANDARDS ORGANIZATIONS | 7 |
| 1.5 APPLICABLE CODES AND REGULATIONS | 9 |
| 1.5.1 GENERAL APPLICABILITY OF CODES, REGULATIONS, AND STANDARDS | 9 |
| 1.5.2 CONTRACTOR RESPONSIBILITY | 9 |
| 1.5.3 FEDERAL REQUIREMENTS | 9 |
| 1.5.4 STATE REQUIREMENTS | 10 |
| 1.5.5 LOCAL REQUIREMENTS | 10 |
| 1.5.6 STANDARDS | 10 |
| 1.5.7 EPA GUIDANCE DOCUMENTS | 10 |
| 1.5.8 NOTICES | 10 |
| 1.5.9 PERMITS/LICENSES | 10 |
| 1.5.10 POSTING AND FILING OF REGULATIONS | 11 |
| 1.5.11 VA RESPONSIBILITIES | 11 |
| 1.5.13 EMERGENCY ACTION PLAN AND ARRANGEMENTS | 11 |

| | |
|--|----|
| 1.5.14 PRE-construction MEETING | 12 |
| 1.6 PROJECT COORDINATION | 12 |
| 1.6.1 PERSONNEL | 12 |
| 1.7 RESPIRATORY PROTECTION | 13 |
| 1.7.1 GENERAL - RESPIRATORY PROTECTION PROGRAM | 13 |
| 1.7.2 RESPIRATORY PROTECTION PROGRAM COORDINATOR | 13 |
| 1.7.3 SELECTION AND USE OF RESPIRATORS | 13 |
| 1.7.4 MINIMUM RESPIRATORY PROTECTION | 13 |
| 1.7.5 MEDICAL WRITTEN OPINION | 14 |
| 1.7.6 RESPIRATOR FIT TEST | 14 |
| 1.7.7 RESPIRATOR FIT CHECK | 14 |
| 1.7.8 MAINTENANCE AND CARE OF RESPIRATORS | 14 |
| 1.8 WORKER PROTECTION | 14 |
| 1.8.1 TRAINING OF ABATEMENT PERSONNEL | 14 |
| 1.8.2 MEDICAL EXAMINATIONS | 14 |
| 1.8.3 PERSONAL PROTECTIVE EQUIPMENT | 14 |
| 1.8.4 REGULATED AREA ENTRY PROCEDURE | 14 |

| | |
|--|----|
| 1.8.5 DECONTAMINATION PROCEDURE | 15 |
| 1.8.6 REGULATED AREA REQUIREMENTS | 15 |
| PART 2 - PRODUCTS, MATERIALS AND EQUIPMENT | 15 |
| 2.1 MATERIALS AND EQUIPMENT | 15 |
| 2.1.1 GENERAL REQUIREMENTS (all abatement projects) | 15 |
| 2.2 CONTAINMENT BARRIERS AND COVERINGS IN THE REGULATED AREA | 16 |
| 2.2.1 GENERAL | 16 |
| 2.2.3 CONTROLLING ACCESS TO THE REGULATED AREA..... | 17 |
| 2.2.4 CRITICAL BARRIERS | 17 |
| 2.2.5 secondary barriers | 17 |
| 2.2.6 EXTENSION OF THE REGULATED AREA | 17 |
| 2.3 MONITORING, INSPECTION AND TESTING | 17 |
| 2.3.1 GENERAL | 17 |
| 2.3.2 SCOPE OF SERVICES OF THE VPIH/CIH CONSULTANT | 18 |
| 2.3.3 MONITORING, INSPECTION AND TESTING BY CONTRACTOR CPIH/CIH | 19 |
| 2.4 asbestos hazard abatement plan | 19 |

| | |
|--|----|
| 2.5 SUBMITTALS | 20 |
| 2.5.1 PRE-start MEETING SUBMITTALS | 20 |
| 2.5.2 SUBMITTALS DURING ABATEMENT | 21 |
| 2.5.3 SUBMITTALS AT COMPLETION OF ABATEMENT | 21 |
| PART 3 - EXECUTION | 21 |
| 3.1 REGULATED AREA PREPARATIONS | 21 |
| 3.1.1 SITE SECURITY | 21 |
| 3.1.2 OSHA DANGER SIGNS | 22 |
| 3.1.3 SHUT DOWN - LOCK OUT ELECTRICAL | 22 |
| 3.1.4 SHUT DOWN - LOCK OUT HVAC | 22 |
| 3.1.5 LOCAL EXHAUST VENTILATION | 22 |
| 3.1.6 CONTAINMENT BARRIERS AND COVERINGS FOR THE REGULATED AREA | 23 |
| 3.1.6.1 GENERAL | 23 |
| 3.1.6.2 PREPARATION PRIOR TO SEALING OFF | 23 |
| 3.1.6.3 CONTROLLING ACCESS TO THE REGULATED AREA | 23 |
| 3.1.6.4 CRITICAL BARRIERS | 23 |
| 3.1.6.5 EXTENSION OF THE REGULATED AREA | 23 |

| | |
|---|----|
| 3.1.7 PERSONAL PROTECTIVE EQUIPMENT | 23 |
| 3.1.8 SANITARY FACILITIES | 23 |
| 3.1.9 Pre-cleaning | 24 |
| 3.1.9.1 PRE-CLEANING MOVABLE OBJECTS | 24 |
| 3.1.9.2 PRE-CLEANING FIXED OBJECTS | 24 |
| 3.1.9.3 PRE-CLEANING SURFACES IN THE REGULATED AREA | 24 |
| 3.1.10 PRE-ABATEMENT ACTIVITIES | 24 |
| 3.1.10.1 PRE-ABATEMENT MEETING | 24 |
| 3.1.10.2 PRE-ABATEMENT INSPECTIONS AND PREPARATIONS | 24 |
| 3.1.10.3 PRE-ABATEMENT CONSTRUCTION AND OPERATIONS | 25 |
| 3.2 REMOVAL OF CLASS II Gasket MATERIALS | 25 |
| GENERAL | 25 |
| 3.3.1 GENERAL | 26 |
| 3.4 PROJECT DECONTAMINATION | 27 |
| 3.4.1 GENERAL | 27 |
| 3.4.2 REGULATED AREA CLEARANCE | 27 |
| 3.4.3 WORK DESCRIPTION | 27 |

| | |
|--|----|
| 3.4.4 PRE-DECONTAMINATION CONDITIONS | 27 |
| 3.4.5. CLEANING | 27 |
| 3.5VISUAL INSPECTION AND AIR CLEARANCE TESTING | 27 |
| 3.5.1 GENERAL | 27 |
| 3.5.2 VISUAL INSPECTION | 28 |
| 3.5.3 AIR CLEARANCE TESTING | 28 |
| 3.5.4 final AIR CLEARANCE PROCEDURES | 28 |
| 3.6 ABATEMENT CLOSEOUT AND CERTIFICATE OF COMPLIANCE | 28 |
| 3.6.1 COMPLETION OF ABATEMENT WORK | 28 |
| 3.6.2 CERTIFICATE OF COMPLETION BY CONTRACTOR | 28 |
| 3.6.3 WORK SHIFTS | 29 |
| ATTACHMENT #1 | 30 |
| ATTACHMENT #3 | 32 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 SUBMITTALS | 1 |

1.4 QUALITY ASSURANCE1

1.5 APPLICABLE PUBLICATIONS2

PART 2 - PRODUCTS3

2.1 DESIGN CRITERIA3

2.2 MATERIALS3

2.3 HARDWARE4

2.4 FABRICATION GENERAL4

2.5 SUPPORTS.....7

2.6 GUARDS.....7

PART 3 - EXECUTION8

3.1 INSTALLATION, GENERAL8

3.2 INSTALLATION OF SUPPORTS8

3.3 GUARDS.....9

3.4 STEEL COMPONENTS FOR MILLWORK ITEMS9

3.5 CLEAN AND ADJUSTING9

PART 1 GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 SUBMITTALS1

1.4 DELIVERY AND STORAGE1

1.5 warranty1

1.6 QUALITY ASSURANCE1

1.7 APPLICABLE PUBLICATIONS1

PART 2 - PRODUCTS2

2.1 FIRESTOP SYSTEMS2

2.2 SMOKE STOPPING IN SMOKE PARTITIONS2

PART 3 - EXECUTION3

3.1 EXAMINATION3

3.2 PREPARATION3

3.3 INSTALLATION3

3.4 CLEAN-UP AND ACCEPTANCE OF WORK3

PART 1 - GENERAL1

1.1 DESCRIPTION:1

1.2 RELATED WORK:1

1.3 QUALITY CONTROL:1

1.4 SUBMITTALS:2

1.5 PROJECT CONDITIONS:2

1.6 DELIVERY, HANDLING, AND STORAGE:2

1.7 DEFINITIONS:2

1.8 warranty:2

1.9 APPLICABLE PUBLICATIONS:3

PART 2 - PRODUCTS3

2.1 SEALANTS:3

2.2 CAULKING COMPOUND:5

2.3 COLOR:5

2.4 JOINT SEALANT BACKING:5

2.5 FILLER:6

2.6 PRIMER:6

2.7 CLEANERS-NON POURIOUS SURFACES:6

PART 3 - EXECUTION6

3.1 INSPECTION:6

| | |
|--|----|
| 3.2 PREPARATIONS: | 6 |
| 3.3 BACKING INSTALLATION: | 7 |
| 3.4 SEALANT DEPTHS AND GEOMETRY: | 8 |
| 3.5 INSTALLATION: | 8 |
| 3.6 FIELD QUALITY CONTROL: | 9 |
| 3.7 CLEANING: | 9 |
| 3.8 LOCATIONS: | 9 |
| 1.5 DELIVERY, STORAGE AND HANDLING | 4 |
| 2.1 FACTORY-ASSEMBLED PRODUCTS | 5 |
| 2.2 COMPATIBILITY OF RELATED EQUIPMENT | 5 |
| 2.3 SAFETY GUARDS | 6 |
| 2.4 LIFTING ATTACHMENTS | 6 |
| 2.13 ASBESTOS | 12 |
| 3.2 TEMPORARY PIPING AND EQUIPMENT | 14 |
| 3.3 RIGGING | 14 |
| 3.6 Plumbing systems DEMOLITION | 16 |
| 3.7 CLEANING AND PAINTING | 16 |

3.8 IDENTIFICATION SIGNS17

3.11 OPERATION AND MAINTENANCE MANUALS18

PART 1 - GENERAL1

1.1 DESCRIPTION:1

1.2 RELATED WORK:1

1.4 APPLICABLE PUBLICATIONS:1

PART 2 - PRODUCTS2

2.1 MOTORS:2

PART 3 - EXECUTION5

3.1 INSTALLATION:5

3.2 FIELD TESTS5

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 SUBMITTALS1

1.4 APPLICABLE PUBLICATIONS1

1.5 AS-BUILT DOCUMENTATION1

PART 2 – PRODUCTS2

2.1 PRESSURE GAGES FOR WATER USAGE2

PART 3 - EXECUTION2

3.1 INSTALLATION2

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 SUBMITTALS1

1.4 APPLICABLE PUBLICATIONS1

1.5 DELIVERY, STORAGE, AND HANDLING2

PART 2 - PRODUCTS2

2.1 VALVES2

2.2 BACKFLOW PREVENTERS3

PART 3 - EXECUTION4

3.1 eXAMINATION4

3.2 VALVE INSTALLATION5

3.3 ADJUSTING5

PART 1 - GENERAL1

1.1 DESCRIPTION1

2.3 INSULATION FACINGS AND JACKETS5

2.4 pipe covering protection saddles6

2.5 adhesive, Mastic, Cement6

2.6 Mechanical Fasteners6

2.7 Reinforcement and Finishes6

2.8 Firestopping Material7

2.9 flame and smoke7

3.2 INSULATION INSTALLATION8

3.3 commissioning10

3.4 PIPE INSULATION SCHEDULE10

part 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 SUMMARY1

1.4 DEFINITIONS1

| | |
|---|---|
| 1.5 COMMISSIONED SYSTEMS | 1 |
| 1.6 SUBMITTALS | 1 |
| PART 2 - PRODUCTS (Not Used) | 2 |
| PART 3 - EXECUTION | 2 |
| 3.1 PRE-FUNCTIONAL CHECKLISTS | 2 |
| 3.2 CONTRACTORS TESTS | 2 |
| 3.3 SYSTEMS FUNCTIONAL PERFORMANCE TESTING: | 2 |
| 3.4 TRAINING OF VA PERSONNEL | 3 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 SUBMITTALS | 1 |
| 1.4 APPLICABLE PUBLICATIONS | 1 |
| 1.5 QUALITY ASSURANCE | 3 |
| 1.6 SPARE PARTS | 3 |
| PART 2 - PRODUCTS | 3 |
| 2.1 ABOVE GROUND (INTERIOR) WATER PIPING | 3 |

2.2 STRAINERS 4

2.3 DIELECTRIC FITTINGS 4

2.4 STERILIZATION CHEMICALS 4

PART 3 - EXECUTION 4

3.1 INSTALLATION 4

3.2 TESTS 6

3.3 STERILIZATION 6

3.4 commissioning 6

PART 1 - GENERAL 1

1.1 DESCRIPTION 1

1.2 RELATED WORK 1

1.3 SUBMITTALS 1

1.4 APPLICABLE PUBLICATIONS 1

PART 2 - PRODUCTS 2

2.1 INLINE HOT WATER RECIRCULATING PUMP 2

PART 3 - EXECUTION 2

3.1 startup and testing 2

3.2 commissioning2

3.3 demonstration and training3

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 QUALITY ASSURANCE1

1.4 SUBMITTALS3

1.5 APPLICABLE PUBLICATIONS4

1.6 DELIVERY, STORAGE AND HANDLING5

1.7 JOB CONDITIONS – work in existing Building6

PART 2 - PRODUCTS7

2.1 FACTORY-ASSEMBLED PRODUCTS7

2.2 COMPATIBILITY OF RELATED EQUIPMENT7

2.3 DRIVE GUARDS7

2.4 LIFTING ATTACHMENTS8

2.5 ELECTRIC MOTORS8

2.6 VARIABLE SPEED MOTOR CONTROLLERS8

| | |
|--|----|
| 2.7 EQUIPMENT AND MATERIALS IDENTIFICATION | 8 |
| 2.8 FIRESTOPPING | 9 |
| 2.9 GALVANIZED REPAIR COMPOUND | 9 |
| 2.10 hvac PIPE AND EQUIPMENT SUPPORTS AND RESTRAINTS | 9 |
| 2.11 PIPE PENETRATIONS | 11 |
| 2.12 SPECIAL TOOLS AND LUBRICANTS | 12 |
| 2.13 WALL, FLOOR AND CEILING PLATES | 13 |
| 2.14 ASBESTOS | 13 |
| PART 3 - EXECUTION | 13 |
| 3.1 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING | 13 |
| 3.2 TEMPORARY PIPING AND EQUIPMENT | 15 |
| 3.3 RIGGING | 15 |
| 3.4 PIPE AND EQUIPMENT SUPPORTS | 16 |
| 3.5 MECHANICAL DEMOLITION | 17 |
| 3.6 CLEANING AND PAINTING | 17 |
| 3.7 IDENTIFICATION SIGNS | 18 |
| 3.8 MOTOR AND DRIVE ALIGNMENT | 19 |

3.9 LUBRICATION19

3.10 commissioning19

3.11 STARTUP AND TEMPORARY OPERATION20

3.12 OPERATING AND PERFORMANCE TESTS20

3.13 INSTRUCTIONS TO VA PERSONNEL20

PART 1 - GENERAL1

1.1 DESCRIPTION:1

1.2 RELATED WORK:1

1.3 SUBMITTALS:1

1.4 APPLICABLE PUBLICATIONS:1

PART 2 - PRODUCTS2

2.1 MOTORS:2

PART 3 - EXECUTION5

3.1 INSTALLATION:5

3.2 FIELD TESTS5

3.3 startup and testing5

3.4 commissioning5

3.5 Demonstration and training 5

PART 1 - GENERAL 1

1.1 DESCRIPTION 1

1.2 RELATED WORK 1

1.3 QUALITY ASSURANCE 1

1.4 SUBMITTALS 2

1.5 APPLICABLE PUBLICATIONS 3

PART 2 - PRODUCTS 4

2.1 GENERAL Requirements 4

2.2 VIBRATION ISOLATORS 4

PART 3 - EXECUTION 5

3.1 INSTALLATION 5

3.2 ADJUSTING 5

3.3 commissioning 5

3.4 SELECTION GUIDE FOR VIBRATION ISOLATORS 6

PART 1 - GENERAL 1

1.1 DESCRIPTION 1

1.2 RELATED WORK1

1.3 QUALITY ASSURANCE2

1.4 SUBMITTALS3

1.5 APPLICABLE PUBLICATIONS4

PART 2 - PRODUCTS4

2.1 INSULATION REPAIR MATERIAL4

PART 3 - EXECUTION4

3.1 GENERAL4

3.2 design review report4

3.3 systems inspection report4

3.4 system readiness report4

3.5 tab reports5

3.6 TAB PROCEDURES5

3.7 VIBRATION TESTING5

3.8 SOUND TESTING6

3.9 Marking of Settings7

3.10 Phasing7

3.11 COmmissioning 7

PART 1 - GENERAL 1

1.1 DESCRIPTION 1

1.2 RELATED WORK 2

1.3 QUALITY ASSURANCE 2

1.4 SUBMITTALS 4

1.5 STORAGE AND HANDLING OF MATERIAL 4

1.6 APPLICABLE PUBLICATIONS 4

PART 2 - PRODUCTS 6

2.1 MINERAL FIBER or fiber glass 6

2.2 CELLULAR GLASS closed-cell 6

2.3 INSULATION FACINGS AND JACKETS 6

2.5 Removable insulation jackets 7

2.6 pipe covering protection saddles 7

2.7 adhesive, Mastic, Cement 8

2.8 Mechanical Fasteners 8

2.9 Reinforcement and Finishes 8

2.10 Firestopping Material 8

2.11 flame and smoke 8

PART 3 - EXECUTION 9

3.1 GENERAL REQUIREMENTS 9

3.2 INSULATION INSTALLATION 10

3.3 commissioning 12

3.4 PIPE INSULATION SCHEDULE 12

PART 1 - GENERAL 1

1.1 DESCRIPTION 1

1.2 RELATED WORK 1

1.3 SUMMARY 1

1.4 DEFINITIONS 1

1.5 COMMISSIONED SYSTEMS 1

1.6 SUBMITTALS 2

PART 2 - PRODUCTS (Not Used) 2

PART 3 - EXECUTION 2

3.1 PRE-FUNCTIONAL CHECKLISTS 2

3.2 CONTRACTORS TESTS2

3.3 SYSTEMS FUNCTIONAL PERFORMANCE TESTING:3

3.4 TRAINING OF VA PERSONNEL 3

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK4

1.3 definitionS4

1.4 quality assurance8

1.5 performance9

1.6 Warranty11

1.7 SUBMITTALS11

1.8 INSTRUCTIONS13

1.9 project CONDITIONS (Environmental Conditions of Operation)13

1.10 applicable publications14

PART 2 - PRODUCTS15

2.1 MATERIALS15

2.2 Controls System Architecture15

| | |
|---|----|
| 2.3 COMMUNICATION | 16 |
| 2.4 Engineering Control Center (ECC) | 17 |
| 2.5 PORTABLE OPERATOR'S TERMINAL (pot) | 17 |
| 2.6 BACnet protocol analyzer | 18 |
| 2.7 NETWORK AND DEVICE NAMING CONVENTION | 18 |
| 2.8 BACnet DEVICES | 19 |
| 2.9 CONTROLLERS | 19 |
| 2.10 sensors (air, water and steam) | 22 |
| 2.11 Control cables | 24 |
| 2.12 THERMOSTATS AND HUMIDISTATS | 25 |
| 2.13 FINAL CONTROL ELEMENTS AND OPERATORS | 25 |
| PART 3 - EXECUTION | 26 |
| 3.1 INSTALLATION | 26 |
| 3.2 SYSTEM VALIDATION AND DEMONSTRATION | 29 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |

1.3 QUALITY ASSURANCE1

1.4 SUBMITTALS1

1.5 APPLICABLE PUBLICATIONS2

1.6 Spare parts5

PART 2 - PRODUCTS5

2.1 PIPE AND EQUIPMENT SUPPORTS, PIPE SLEEVES, AND WALL AND
CEILING PLATES5

2.2 PIPE AND TUBING5

2.3 FITTINGS FOR STEEL PIPE5

2.4 FITTINGS FOR COPPER TUBING6

2.5 DIELECTRIC FITTINGS6

2.6 SCREWED JOINTS6

2.7 VALVES6

2.8 STRAINERS9

2.9 FLEXIBLE CONNECTORS FOR WATER SERVICE9

2.10 HYDRONIC SYSTEM COMPONENTS9

2.11 WATER FILTERS AND POT CHEMICAL FEEDERS9

2.12 GAGES, PRESSURE AND COMPOUND10

2.13 PRESSURE/TEMPERATURE TEST PROVISIONS10

2.14 THERMOMETERS10

2.15 FIRESTOPPING MATERIAL10

PART 3 - EXECUTION10

3.1 GENERAL10

3.2 PIPE JOINTS12

3.3 LEAK TESTING ABOVEGROUND PIPING12

3.4 FLUSHING AND CLEANING PIPING SYSTEMS12

3.5 WATER TREATMENT13

3.6 OPERATING AND PERFORMANCE TEST AND INSTRUCTION13

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 QUALITY ASSURANCE1

1.4 SUBMITTALS2

1.5 APPLICABLE PUBLICATIONS2

1.6 Definitions2

| | |
|---|---|
| 1.7 SPARE MATERIALS | 3 |
| PART 2 - PRODUCTS | 3 |
| 2.1 CENTRIFUGAL PUMPS, BRONZE FITTED | 3 |
| PART 3 – EXECUTION | 4 |
| 3.1 INSTALLATION | 4 |
| 3.2 START-UP | 4 |
| PART 1 - GENERAL | 1 |
| 1.1 DESCRIPTION | 1 |
| 1.2 RELATED WORK | 1 |
| 1.3 QUALITY ASSURANCE | 1 |
| 1.4 SUBMITTALS | 1 |
| 1.5 APPLICABLE PUBLICATIONS | 2 |
| PART 2 - PRODUCTS | 3 |
| 2.1 PIPE AND EQUIPMENT SUPPORTS, PIPE SLEEVES, AND WALL AND CEILING PLATES | 3 |
| 2.2 PIPE AND TUBING | 3 |
| 2.3 FITTINGS FOR STEEL PIPE | 4 |
| 2.4 FITTINGS FOR COPPER TUBING | 4 |

2.5 DIELECTRIC FITTINGS 4

2.6 VALVES 5

2.7 STRAINERS 6

2.8 STEAM SYSTEM COMPONENTS 7

2.9 GAGES, PRESSURE AND COMPOUND 11

2.10 PRESSURE/TEMPERATURE TEST PROVISIONS 11

2.11 FIRESTOPPING MATERIAL 11

PART 3 - EXECUTION 11

3.1 GENERAL 11

L.Provide a 25 mm (1 inch) bypass pipe with globe valve for warm-up on all butterfly valves, gate valves

3.2 PIPE JOINTS 13

3.3 STEAM TRAP PIPING 13

3.4 LEAK TESTING 13

3.5 FLUSHING AND CLEANING PIPING SYSTEMS 13

3.6 OPERATING AND PERFORMANCE TEST AND INSTRUCTION 13

PART 1 - GENERAL 1

1.1 DESCRIPTION 1

1.2 RELATED WORK1

1.3 QUALITY ASSURANCE1

1.4 SUBMITTALS1

1.5 APPLICABLE PUBLICATIONS2

PART 2 - PRODUCTS2

2.1 CLEANING COMPOUNDS2

2.2 CHEMICAL TREATMENT FOR CLOSED LOOP SYSTEMS.....2

2.3 EQUIPMENT AND MATERIALS IDENTIFICATION3

PART 3 - EXECUTION3

3.1 INSTALLATION3

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 QUALITY ASSURANCE1

1.4 SUBMITTALS1

1.5 APPLICABLE PUBLICATIONS1

1.6 GUARANTY2

PART 2 - PRODUCTS2

2.1 UNIT HEATERS2

PART 3 - EXECUTION2

3.1 INSTALLATION2

3.2 OPERATIONAL TEST2

3.3 STARTup and testing2

3.4 COMmissioning3

3.5 demonstration and training3

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 MINIMUM REQUIREMENTS1

1.3 TEST STANDARDS1

1.4 QUALIFICATIONS (PRODUCTS AND SERVICES)2

1.5 APPLICABLE PUBLICATIONS2

1.6 MANUFACTURED PRODUCTS2

1.7 variations from contract requirements3

1.8 MATERIALS AND EQUIPMENT PROTECTION3

1.9 WORK PERFORMANCE 3

1.10 EQUIPMENT INSTALLATION AND REQUIREMENTS 4

1.11 EQUIPMENT IDENTIFICATION 4

1.12 SUBMITTALS 5

1.13 SINGULAR NUMBER 6

1.14 Acceptance Checks and Tests 6

1.15 WARRANTY 6

1.16 instruction 7

1.17 DRAWINGS AND SPECIFICATIONS 7

1.18 Record Drawings 8

1.19 Final Inspection and Punch List 8

PART 2 - PRODUCTS (Not used) 9

PART 3 - EXECUTION (Not used) 9

PART 1 - GENERAL 1

1.1 DESCRIPTION 1

1.2 RELATED WORK 1

1.3 quality ASSURANCE 1

| | |
|---|---|
| 1.4 FACTORY TESTS | 1 |
| 1.5 SUBMITTALS | 1 |
| 1.6 APPLICABLE PUBLICATIONS | 2 |
| PART 2 - PRODUCTS | 2 |
| 2.1 conductors and CABLES | 2 |
| 2.2 SPLICES | 3 |
| 2.3 CONNECTORS and terminations | 3 |
| 2.4 CONTROL WIRING | 4 |
| 2.5 WIRE LUBRICATING COMPOUND | 4 |
| PART 3 - EXECUTION | 4 |
| 3.1 GENERAL | 4 |
| 3.2 SPLICE and termination INSTALLATION | 5 |
| 3.3 conductor identification | 5 |
| 3.4 FEEDER conductor IDENTIFICATION | 5 |
| 3.5 existing conductors | 5 |
| 3.6 CONTROL WIRING INSTALLATION | 5 |
| 3.7 CONTROL wiring IDENTIFICATION | 5 |

3.8 Acceptance Checks and Tests5

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 quality ASSURANCE1

1.4 SUBMITTALS1

1.5 APPLICABLE PUBLICATIONS2

PART 2 - PRODUCTS2

2.1 GROUNDING AND BONDING CONDUCTORS2

PART 3 - EXECUTION2

3.1 GENERAL2

3.2 raceway3

3.3 corrosion inhibitors3

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 quality ASSURANCE1

1.4 SUBMITTALS1

1.5 APPLICABLE PUBLICATIONS2

PART 2 - PRODUCTS2

2.1 MATERIAL2

PART 3 - EXECUTION4

3.1 PENETRATIONS4

3.2 INSTALLATION, GENERAL5

3.3 CONCEALED WORK INSTALLATION6

3.4 EXPOSED WORK INSTALLATION.....6

3.5 MOTORS AND VIBRATING EQUIPMENT.....6

3.6 EXPANSION JOINTS.....6

3.7 CONDUIT SUPPORTS, INSTALLATION.....7

3.8 BOX INSTALLATION7

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 quality ASSURANCE1

1.4 SUBMITTALS1

1.5 APPLICABLE PUBLICATIONS2

PART 2 - PRODUCTS2

2.1 general requirements2

2.2 enclosures and trims3

2.3 MOLDED CASE CIRCUIT BREAKERS3

2.4 Surge PROTECTIVE DEVICES4

PART 3 - EXECUTION4

3.1 INSTALLATION4

3.2 Acceptance Checks and Tests4

3.3 Follow-Up Verification5

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 quality ASSURANCE1

1.4 SUBMITTALS1

1.5 APPLICABLE PUBLICATIONS2

PART 2 - PRODUCTS3

2.1 MOTOR CONTROLLERS3

2.2 MAGNETIC MOTOR CONTROLLERS4

2.3 low-voltage VARIABLE FREQUENCY DRIVES (VFD)4

PART 3 - EXECUTION7

3.1 INSTALLATION7

3.2 Acceptance Checks and Tests7

3.3 FOLLOW-UP VERIFICATION.....8

3.4 SPARE PARTS8

3.5 INSTRUCTION8

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 quality ASSURANCE1

1.4 SUBMITTALS1

1.5 APPLICABLE PUBLICATIONS2

PART 2 - PRODUCTS2

2.1 FUSEd SWITCHES RATED 600 AMPERES AND LESS2

2.2 UNFUSED SWITCHES RATED 600 AMPERES AND LESS.....3

PART 3 - EXECUTION3

3.1 INSTALLATION3

3.2 Acceptance Checks and Tests3

PART 1 - GENERAL1

1.1 DESCRIPTION1

1.2 RELATED WORK1

1.3 QUALITY ASSURANCE1

1.4 SUBMITTALS1

1.5 APPLICABLE PUBLICATIONS1

PART 2 - PRODUCTS2

2.1 PANELBOARD TVSS2

2.3 ENCLOSURES2

PART 3 - EXECUTION2

3.1 INSTALLATION2

3.2 Acceptance Checks and Tests3

3.3 Follow-Up Verification3

PART 1 - GENERAL1

1.1 DESCRIPTION OF WORK:1

1.2 DEFINITIONS:1

1.3 RELATED WORK:2

1.4 CLASSIFICATION OF EXCAVATION:2

1.5 APPLICABLE PUBLICATIONS:3

PART 2 - PRODUCTS4

2.1 MATERIALS:4

PART 3 - EXECUTION5

3.1 SITE PREPARATION:5

3.2 EXCAVATION:5

3.3 FILLING AND BACKFILLING:7

3.4 Disposal of unsuitable and excess excavated material:8

3.5 CLEAN UP:8

PART 1 - GENERAL**1.1 SUMMARY OF THE WORK****1.1.1 CONTRACT DOCUMENTS AND RELATED REQUIREMENTS**

Drawings, general provisions of the contract, including general and supplementary conditions and other Division 01 specifications, shall apply to the work of this section. The contract documents show the work to be done under the contract and related requirements and conditions impacting the project. Related requirements and conditions include applicable codes and regulations, notices and permits, existing site conditions and restrictions on use of the site, requirements for partial owner occupancy during the work, coordination with other work and the phasing of the work. In the event the Asbestos Abatement Contractor discovers a conflict in the contract documents and/or requirements or codes, the conflict must be brought to the immediate attention of the Contracting Officer for resolution. Whenever there is a conflict or overlap in the requirements, the most stringent shall apply. Any actions taken by the Contractor without obtaining guidance from the Contracting Officer shall become the sole risk and responsibility of the Asbestos Abatement Contractor. All costs incurred.

1.1.2 EXTENT OF WORK

- A. Below is a brief description of the estimated quantities of asbestos-containing materials to be abated. These quantities are for informational purposes only and are based on the best information available at the time of the specification preparation. The Contractor shall satisfy himself as the actual quantities to be abated. Nothing in this section may be interpreted as limiting the extent of work otherwise required by this contract and related documents.
- B. Removal, clean-up and disposal of asbestos-containing gasket material in an appropriate regulated area in the following approximate quantities:
 - One gasket located on a steam line at a gate valve in basement mechanical room C003 (see drawing 1-DB1 for location).
 - Please note that the Prime Contractor will be responsible for obtaining a professional industrial hygienist (PIH) to perform the role of the VA professional industrial hygienist (VPIH) during asbestos abatement activities (abatement oversight, monitoring, and clearance testing). The VPIH will report to the VA project engineer.

1.1.3 RELATED WORK

- A. Section 07 84 00, FIRESTOPPING.
- B. Section 02 41 00, DEMOLITION.

1.1.4 TASKS

The work tasks are summarized briefly as follows:

- A. Pre-abatement activities including pre-abatement meeting(s), inspection(s), notifications, permits, submittal approvals, regulated area preparations, emergency procedures arrangements, and standard operating procedures for asbestos abatement work.
- B. Abatement activities including removal, clean-up and disposal of ACM waste, recordkeeping, security, monitoring, and inspections.
- C. Cleaning and decontamination activities including final visual inspection, air monitoring and certification of decontamination.

1.1.5 ABATEMENT CONTRACTOR USE OF PREMISES

- A. The Contractor and Contractor's personnel shall cooperate fully with the VA representative/consultant to facilitate efficient use of buildings and areas within buildings. The Contractor shall perform the work in accordance with the VA specifications, drawings, phasing

plan and in compliance with any/all applicable Federal, State and Local regulations and requirements.

- B. The Contractor shall use the existing facilities in the building strictly within the limits indicated in contract documents as well as the approved VA Design and Construction Procedure. VA Design and Construction Procedure drawings of partially occupied buildings will show the limits of regulated areas; the placement of decontamination facilities; the temporary location of bagged waste ACM; the path of transport to outside the building; and the temporary waste storage area for each building/regulated area. Any variation from the arrangements shown on drawings shall be secured in writing from the VA representative through the pre-abatement plan of action.

1.2 VARIATIONS IN QUANTITY

The quantities and locations of ACM as indicated on the drawings and the extent of work included in this section are estimated which are limited by the physical constraints imposed by occupancy of the buildings and accessibility to ACM. Accordingly, minor variations (+/- 25%) in quantities of ACM within the regulated area are considered as having no impact on contract price and time requirements of this contract. Where additional work is required beyond the above variation, the contractor shall provide unit prices for newly discovered ACM and those prices shall be used for additional work required under the contract.

1.3 STOP ASBESTOS REMOVAL

If the Contracting Officer; their field representative; (the facility Safety Officer/Manager or their designee, or the VA Professional Industrial Hygienist/Certified Industrial Hygienist (VPIH/CIH) presents a verbal **Stop Asbestos Removal Order**, the Contractor/Personnel shall immediately stop all asbestos removal and maintain HEPA filtered negative pressure air flow in the containment and adequately wet any exposed ACM. If a verbal Stop Asbestos Removal Order is issued, the VA shall follow-up with a written order to the Contractor as soon as practicable. The Contractor shall not resume any asbestos removal activity until authorized to do so in writing by the VA Contracting Officer. A stop asbestos removal order may be issued at any time the VA Contracting Officer determines abatement conditions/activities are not within VA specification, regulatory requirements or that an imminent hazard exists to human health or the environment. Work stoppage will continue until conditions have been corrected to the satisfaction of the VA. Standby time and costs for corrective actions will be borne by the Contractor, including the VPIH/CIH time. The occurrence of any of the following events shall be reported immediately by the Contractor's competent person to the VA Contracting Office or field representative using the most expeditious means (e.g., verbal or telephonic), followed up with written notification to the Contracting Officer as soon as it is practical. The Contractor shall immediately stop asbestos removal/disturbance activities and initiate fiber reduction activities:

- A. Airborne PCM analysis results equal to or greater than 0.01 f/cc outside a regulated area or >0.05 f/cc inside a regulated area;
- B. breach or break in regulated area containment barrier(s);
- C. less than -0.02" WCG pressure in the regulated area;
- D. serious injury/death at the site ;
- E. fire/safety emergency at the site ;
- F. respiratory protection system failure;
- G. power failure or loss of wetting agent; or
- H. any visible emissions observed outside the regulated area.

1.4 DEFINITIONS

1.4.1 GENERAL

Definitions and explanations here are neither complete nor exclusive of all terms used in the contract documents, but are general for the work to the extent they are not stated more explicitly in another element of the contract documents. Drawings must be recognized as diagrammatic in nature and not completely descriptive of the requirements indicated therein.

1.4.2 GLOSSARY

Abatement - Procedures to control fiber release from asbestos-containing materials. Includes removal, encapsulation, enclosure, demolition and renovation activities related to asbestos containing materials (ACM).

Aerosol - Solid or liquid particulate suspended in air.

Adequately wet - Sufficiently mixed or penetrated with liquid to prevent the release of particulates. If visible emissions are observed coming from the ACM, then that material has not been adequately wetted.

Aggressive method - Removal or disturbance of building material by sanding, abrading, grinding, or other method that breaks, crumbles, or disintegrates intact ACM.

Aggressive sampling - EPA AHERA defined clearance sampling method using air moving equipment such as fans and leaf blowers to aggressively disturb and maintain in the air residual fibers after abatement.

AHERA - Asbestos Hazard Emergency Response Act. Asbestos regulations for schools issued in 1987.

Aircell - Pipe or duct insulation made of corrugated cardboard which contains asbestos.

Air monitoring - The process of measuring the fiber content of a known volume of air collected over a specified period of time. The NIOSH 7400 Method, Issue 2 is used to determine the fiber levels in air. For personal samples and clearance air testing using Phase Contrast Microscopy (PCM) analysis. NIOSH Method 7402 can be used when it is necessary to confirm fibers counted by PCM as being asbestos. The AHERA TEM analysis may be used for background, area samples and clearance samples when required by this specification, or at the discretion of the VPIH/CIH as appropriate.

Air sample filter - The filter used to collect fibers which are then counted. The filter is made of mixed cellulose ester membrane for PCM (Phase Contrast Microscopy) and polycarbonate for TEM (Transmission Electron Microscopy)

Amended water - Water to which a surfactant (wetting agent) has been added to increase the penetrating ability of the liquid.

Asbestos - Includes chrysotile, amosite, crocidolite, tremolite asbestos, anthophyllite asbestos, actinolite asbestos, and any of these minerals that have been chemically treated or altered. Asbestos also includes PACM, as defined below.

Asbestos Hazard Abatement Plan (AHAP) - Asbestos work procedures required to be submitted by the contractor before work begins.

Asbestos-containing material (ACM) - Any material containing more than one percent of asbestos.

Asbestos contaminated elements (ACE) - Building elements such as ceilings, walls, lights, or ductwork that are contaminated with asbestos.

Asbestos-contaminated soil (ACS) - Soil found in the work area or in adjacent areas such as crawlspaces or pipe tunnels which is contaminated with asbestos-containing material debris and cannot be easily separated from the material.

Asbestos-containing waste (ACW) material - Asbestos-containing material or asbestos contaminated objects requiring disposal.

Asbestos Project Monitor - Some states require that any person conducting asbestos abatement clearance inspections and clearance air sampling be licensed as an asbestos project monitor.

Asbestos waste decontamination facility - A system consisting of drum/bag washing facilities and a temporary storage area for cleaned containers of asbestos waste. Used as the exit for waste and equipment leaving the regulated area. In an emergency, it may be used to evacuate personnel.

Authorized person - Any person authorized by the VA, the Contractor, or government agency and required by work duties to be present in regulated areas.

Authorized visitor - Any person approved by the VA; the contractor; or any government agency representative having jurisdiction over the regulated area (e.g., OSHA, Federal and State EPA).

Barrier - Any surface that isolates the regulated area and inhibits fiber migration from the regulated area.

Containment Barrier - An airtight barrier consisting of walls, floors, and/or ceilings of sealed plastic sheeting which surrounds and seals the outer perimeter of the regulated area.

Critical Barrier - The barrier responsible for isolating the regulated area from adjacent spaces, typically constructed of plastic sheeting secured in place at openings such as doors, windows, or any other opening into the regulated area.

Primary Barrier – Plastic barriers placed over critical barriers and exposed directly to abatement work.

Secondary Barrier - Any additional plastic barriers used to isolate and provide protection from debris during abatement work.

Breathing zone - The hemisphere forward of the shoulders with a radius of about 150 - 225 mm (6 - 9 inches) from the worker's nose.

Bridging encapsulant - An encapsulant that forms a layer on the surface of the ACM.

Building/facility owner - The legal entity, including a lessee, which exercises control over management and recordkeeping functions relating to a building and/or facility in which asbestos activities take place.

Bulk testing - The collection and analysis of suspect asbestos containing materials.

Certified Industrial Hygienist (CIH) - A person certified in the comprehensive practice of industrial hygiene by the American Board of Industrial Hygiene.

Class I asbestos work - Activities involving the removal of Thermal System Insulation (TSI) and surfacing ACM and Presumed Asbestos Containing Material (PACM).

Class II asbestos work - Activities involving the removal of ACM which is not thermal system insulation or surfacing material. This includes, but is not limited to, the removal of asbestos-containing wallboard, floor tile and sheeting, roofing and siding shingles, and construction mastic.

Clean room/Changing room - An uncontaminated room having facilities for the storage of employee's street clothing and uncontaminated materials and equipment.

Clearance sample - The final air sample taken after all asbestos work has been done and visually inspected. Performed by the VA's professional industrial hygiene consultant/Certified Industrial Hygienist (VPIH/CIH).

Closely resemble - The major workplace conditions which have contributed to the levels of historic asbestos exposure, are no more protective than conditions of the current workplace.

Competent person - In addition to the definition in 29 CFR 1926.32(f), one who is capable of identifying existing asbestos hazards in the workplace and selecting the appropriate control strategy for asbestos exposure, who has the authority to take prompt corrective measures to eliminate them, as specified in 29 CFR 1926.32(f); in addition, for Class I and II work who is specially trained in a training course which meets the criteria of EPA's Model Accreditation Plan (40 CFR 763) for supervisor.

Contractor's Professional Industrial Hygienist (CPIH/CIH) - The asbestos abatement contractor's industrial hygienist. The industrial hygienist must meet the qualification requirements of a PIH and may be a certified industrial hygienist (CIH). The Contractor's Competent Person may also be considered as the role of the CPIH.

Count - Refers to the fiber count or the average number of fibers greater than five microns in length with a length-to-width (aspect) ratio of at least 3 to 1, per cubic centimeter of air.

Crawlspace – An area which can be found either in or adjacent to the work area. This area has limited access and egress and may contain asbestos materials and/or asbestos contaminated soil.

Decontamination area/unit - An enclosed area adjacent to and connected to the regulated area and consisting of an equipment room, shower room, and clean room, which is used for the decontamination of workers, materials, and equipment that are contaminated with asbestos.

Demolition - The wrecking or taking out of any load-supporting structural member and any related razing, removing, or stripping of asbestos products.

VA Total – means a building or substantial part of the building is completely removed, torn or knocked down, bulldozed, flattened, or razed, including removal of building debris.

Disposal bag - Typically 6 mil thick sift-proof, dustproof, leak-tight container used to package and transport asbestos waste from regulated areas to the approved landfill. Each bag/container must be labeled/marked in accordance with EPA, OSHA and DOT requirements.

Disturbance - Activities that disrupt the matrix of ACM or PACM, crumble or pulverize ACM or PACM, or generate visible debris from ACM or PACM. Disturbance includes cutting away small amounts of ACM or PACM, no greater than the amount that can be contained in one standard sized glove bag or waste bag in order to access a building component. In no event shall the amount of ACM or PACM so disturbed exceed that which can be contained in one glove bag or disposal bag which shall not exceed 60 inches in length or width.

Drum - A rigid, impermeable container made of cardboard fiber, plastic, or metal which can be sealed in order to be sift-proof, dustproof, and leak-tight.

Employee exposure - The exposure to airborne asbestos that would occur if the employee were not wearing respiratory protection equipment.

Encapsulant - A material that surrounds or embeds asbestos fibers in an adhesive matrix and prevents the release of fibers.

Encapsulation - Treating ACM with an encapsulant.

Enclosure - The construction of an air tight, impermeable, permanent barrier around ACM to control the release of asbestos fibers from the material and also eliminate access to the material.

Equipment room - A contaminated room located within the decontamination area that is supplied with impermeable bags or containers for the disposal of contaminated protective clothing and equipment.

Fiber - A particulate form of asbestos, 5 microns or longer, with a length to width (aspect) ratio of at least 3 to 1.

Fibers per cubic centimeter (f/cc) - Abbreviation for fibers per cubic centimeter, used to describe the level of asbestos fibers in air.

Filter - Media used in respirators, vacuums, or other machines to remove particulate from air.

Firestopping - Material used to close the open parts of a structure in order to prevent a fire from spreading.

Friable asbestos containing material - Any material containing more than one (1) percent or asbestos as determined using the method specified in appendix A, Subpart F, 40 CFR 763, section 1, Polarized Light Microscopy, that, when dry, can be crumbled, pulverized, or reduced to powder by hand pressure.

Glovebag - Not more than a 60 x 60 inch impervious plastic bag-like enclosure affixed around an asbestos-containing material, with glove-like appendages through which materials and tools may be handled.

High efficiency particulate air (HEPA) filter - An ASHRAE MERV 17 filter capable of trapping and retaining at least 99.97 percent of all mono-dispersed particles of 0.3 micrometers in diameter.

HEPA vacuum - Vacuum collection equipment equipped with a HEPA filter system capable of collecting and retaining asbestos fibers.

Homogeneous area - An area of surfacing, thermal system insulation or miscellaneous ACM that is uniform in color, texture and date of application.

HVAC - Heating, Ventilation and Air Conditioning

Industrial hygienist (IH) - A professional qualified by education, training, and experience to anticipate, recognize, evaluate, and develop controls for occupational health hazards.

Industrial hygienist technician (IH Technician) - A person working under the direction of an IH or CIH who has special training, experience, certifications and licenses required for the industrial hygiene work assigned. Some states require that an industrial hygienist technician conducting asbestos abatement clearance inspection and clearance air sampling be licensed as an asbestos project monitor.

Intact - The ACM has not crumbled, been pulverized, or otherwise deteriorated so that the asbestos is no longer likely to be bound with its matrix.

Lockdown - Applying encapsulant, after a final visual inspection, on all abated surfaces at the conclusion of ACM removal prior to removal of critical barriers.

National Emission Standards for Hazardous Air Pollutants (NESHAP) - EPA's rule to control emissions of asbestos to the environment (40 CFR part 61, Subpart M).

Negative initial exposure assessment - A demonstration by the employer which complies with the criteria in 29 CFR 1926.1101 (f)(2)(iii), that employee exposure during an operation is expected to be consistently below the PEL's.

Negative pressure - Air pressure which is lower than the surrounding area, created by exhausting air from a sealed regulated area through HEPA equipped filtration units. OSHA requires maintaining -0.02" water column gauge inside the negative pressure enclosure.

Negative pressure respirator - A respirator in which the air pressure inside the facepiece is negative during inhalation relative to the air pressure outside the respirator facepiece.

Non-friable ACM - Material that contains more than 1 percent asbestos but cannot be crumbled, pulverized, or reduced to powder by hand pressure.

Organic vapor cartridge - The type of cartridge used on air purifying respirators to remove organic vapor hazardous air contaminants.

Outside air - The air outside buildings and structures, including, but not limited to, the air under a bridge or in an open ferry dock.

Owner/operator - Any person who owns, leases, operates, controls, or supervises the facility being demolished or renovated or any person who owns, leases, operates, controls, or supervises the demolition or renovation operation, or both.

Penetrating encapsulant - Encapsulant that is absorbed into the ACM matrix without leaving a surface layer.

Personal protective equipment (PPE) – equipment designed to protect user from injury and/or specific job hazard. Such equipment may include protective clothing, hard hats, safety glasses, and respirators.

Personal sampling/monitoring - Representative air samples obtained in the breathing zone for one or workers within the regulated area using a filter cassette and a calibrated air sampling pump to determine asbestos exposure.

Permissible exposure limit (PEL) - The level of exposure OSHA allows for an 8 hour time weighted average. For asbestos fibers, the eight (8) hour time weighted average PEL is 0.1 fibers per cubic centimeter (0.1 f/cc) of air and the 30-minute Excursion Limit is 1.0 fibers per cubic centimeter (1 f/cc).

Pipe tunnel – An area, typically located adjacent to mechanical spaces or boiler rooms in which the pipes servicing the heating system in the building are routed to allow the pipes to access heating elements. These areas may contain asbestos pipe insulation, asbestos fittings, or asbestos-contaminated soil.

Polarized light microscopy (PLM) - Light microscopy using dispersion staining techniques and refractive indices to identify and quantify the type(s) of asbestos present in a bulk sample.

Polyethylene sheeting - Strong plastic barrier material 4 to 6 mils thick, semi-transparent, flame retardant per NFPA 241.

Positive/negative fit check - A method of verifying the seal of a facepiece respirator by temporarily occluding the filters and breathing in (inhaling) and then temporarily occluding the exhalation valve and breathing out (exhaling) while checking for inward or outward leakage of the respirator respectively.

Presumed ACM (PACM) - Thermal system insulation, surfacing, and flooring material installed in buildings prior to 1981. If the building owner has actual knowledge, or should have known through the exercise of due diligence that other materials are ACM, they too must be treated as PACM. The designation of PACM may be rebutted pursuant to 29 CFR 1926.1101 (b).

Professional IH - An IH who meets the definition requirements of OSHA as a "Competent Person" at 29 CFR 1926.1101 (b); has completed the specialized EPA approved course on management and supervision of asbestos abatement projects; has formal training in respiratory protection and waste disposal; and has a minimum of four projects of similar complexity with this project of which at least three projects serving as the supervisory IH. The PIH may be either the VA's PIH (VPIH) or Contractor's PIH (CPIH/CIH).

Assigned Protection factor - A value assigned by OSHA/NIOSH to indicate the expected protection by each respirator class, when the respirator is properly selected and worn correctly. The number indicates the reduction of exposure level from outside to inside the respirator facepiece.

Qualitative fit test (QLFT) - A fit test using a challenge material that can be sensed by the wearer if leakage in the respirator occurs.

Quantitative fit test (QNFT) - A fit test using a challenge material which is quantified outside and inside the respirator thus allowing the determination of the actual fit factor.

Regulated area - An area established by the employer to demarcate where Class I, II, III asbestos work is conducted, and any adjoining area where debris and waste from such asbestos work may accumulate; and a work area within which airborne concentrations of asbestos exceed, or there is a reasonable possibility they may exceed the PEL.

Regulated ACM (RACM) - Friable ACM; Category I non-friable ACM that has become friable; Category I non-friable ACM that will be or has been subjected to sanding, grinding, cutting, or abrading or; Category II non-friable ACM that has a high probability of becoming or has become crumbled, pulverized, or reduced to powder by the forces expected to act on the material in the course of the demolition or renovation operation.

Removal - All operations where ACM, PACM and/or RACM is taken out or stripped from structures or substrates, including demolition operations.

Renovation - Altering a facility or one or more facility components in any way, including the stripping or removal of asbestos from a facility component which does not involve demolition activity.

Repair - Overhauling, rebuilding, reconstructing, or reconditioning of structures or substrates, including encapsulation or other repair of ACM or PACM attached to structures or substrates.

Shower room - The portion of the PDF where personnel shower before leaving the regulated area.

Supplied air respirator (SAR) - A respiratory protection system that supplies minimum Grade D respirable air per ANSI/Compressed Gas Association Commodity Specification for Air, G-7.1-1989.

Surfacing ACM - A material containing more than 1 percent asbestos that is sprayed, troweled on or otherwise applied to surfaces for acoustical, fireproofing and other purposes.

Surfactant - A chemical added to water to decrease water's surface tension thus making it more penetrating into ACM.

Thermal system ACM - A material containing more than 1 percent asbestos applied to pipes, fittings, boilers, breeching, tanks, ducts, or other structural components to prevent heat loss or gain.

Transmission electron microscopy (TEM) - A microscopy method that can identify and count asbestos fibers.

VA Professional Industrial Hygienist (VPIH/CIH) - The Department of Veterans Affairs Professional Industrial Hygienist must meet the qualifications of a PIH, and may be a Certified Industrial Hygienist (CIH).

VA Representative - The VA official responsible for on-going project work.

Visible emissions - Any emissions, which are visually detectable without the aid of instruments, coming from ACM/PACM/RACM/ACS or ACM waste material.

Waste/Equipment decontamination facility (W/EDF) - The area in which equipment is decontaminated before removal from the regulated area.

Waste generator - Any owner or operator whose act or process produces asbestos-containing waste material.

Waste shipment record - The shipping document, required to be originated and signed by the waste generator, used to track and substantiate the disposition of asbestos-containing waste material.

Wet cleaning - The process of thoroughly eliminating, by wet methods, any asbestos contamination from surfaces or objects.

1.4.3 REFERENCED STANDARDS ORGANIZATIONS

The following acronyms or abbreviations as referenced in contract/ specification documents are defined to mean the associated names. Names and addresses may be subject to change.

- A. VA Department of Veterans Affairs
810 Vermont Avenue, NW
Washington, DC 20420

- B. AIHA American Industrial Hygiene Association
2700 Prosperity Avenue, Suite 250
Fairfax, VA 22031
703-849-8888
- C. ANSI American National Standards Institute
1430 Broadway
New York, NY 10018
212-354-3300
- D. ASTM American Society for Testing and Materials
1916 Race St.
Philadelphia, PA 19103
215-299-5400
- E. CFR Code of Federal Regulations
Government Printing Office
Washington, DC 20420
- F. CGA Compressed Gas Association
1235 Jefferson Davis Highway
Arlington, VA 22202
703-979-0900
- F. CS Commercial Standard of the National Institute of Standards and Technology (NIST)
U. S. Department of Commerce
Government Printing Office
Washington, DC 20420
- G. EPA Environmental Protection Agency
401 M St., SW
Washington, DC 20460
202-382-3949
- H. MIL-STD Military Standards/Standardization Division
Office of the Assistant Secretary of Defense
Washington, DC 20420
- J. NIST National Institute for Standards and Technology
U. S. Department of Commerce
Gaithersburg, MD 20234
301-921-1000
- K. NEC National Electrical Code (by NFPA)
- L. NEMA National Electrical Manufacturer's Association
2101 L Street, NW
Washington, DC 20037
- M. NFPA National Fire Protection Association
1 Batterymarch Park
P.O. Box 9101
Quincy, MA 02269-9101
800-344-3555

- N. NIOSH National Institutes for Occupational Safety and Health
4676 Columbia Parkway
Cincinnati, OH 45226
513-533-8236
- O. OSHA Occupational Safety and Health Administration
U.S. Department of Labor
Government Printing Office
Washington, DC 20402
- P. UL Underwriters Laboratory
333 Pfingsten Rd.
Northbrook, IL 60062
312-272-8800

1.5 APPLICABLE CODES AND REGULATIONS

1.5.1 GENERAL APPLICABILITY OF CODES, REGULATIONS, AND STANDARDS

- A. All work under this contract shall be done in strict accordance with all applicable Federal, State, and local regulations, standards and codes governing asbestos abatement, and any other trade work done in conjunction with the abatement. All applicable codes, regulations and standards are adopted into this specification and will have the same force and effect as this specification.
- B. The most recent edition of any relevant regulation, standard, document or code shall be in effect. Where conflict among the requirements or with these specifications exists, the most stringent requirement(s) shall be utilized.
- C. Copies of all standards, regulations, codes and other applicable documents, including this specification and those listed in Section 1.5 shall be available at the worksite in the clean change area of the worker decontamination system.

1.5.2 CONTRACTOR RESPONSIBILITY

The Asbestos Abatement Contractor (Contractor) shall assume full responsibility and liability for compliance with all applicable Federal, State and Local regulations related to any and all aspects of the asbestos abatement project. The Contractor is responsible for providing and maintaining training, accreditations, medical exams, medical records, personal protective equipment (PPE) including respiratory protection including respirator fit testing, as required by applicable Federal, State and Local regulations. The Contractor shall hold the VA and VPIH/CIH consultants harmless for any Contractor's failure to comply with any applicable work, packaging, transporting, disposal, safety, health, or environmental requirement on the part of himself, his employees, or his subcontractors. The Contractor will incur all costs of the CPIH/CIH, including all sampling/analytical costs to assure compliance with OSHA/EPA/State requirements related to failure to comply with the regulations applicable to the work.

1.5.3 FEDERAL REQUIREMENTS

Federal requirements which govern some aspect of asbestos abatement include, but are not limited to, the following regulations.

- A. Occupational Safety and Health Administration (**OSHA**)
 - 1. Title 29 CFR 1926.1101 - Construction Standard for Asbestos
 - 2. Title 29 CFR 1910 Subpart I - Personal Protective Equipment
 - 3. Title 29 CFR 1910.134 - Respiratory Protection
 - 4. Title 29 CFR 1926 - Construction Industry Standards
 - 5. Title 29 CFR 1910.1020 - Access to Employee Exposure and Medical Records
 - 6. Title 29 CFR 1910.1020 - Hazard Communication
 - 7. Title 29 CFR 1910 Subpart K - Medical and First Aid
- B. Environmental Protection Agency (EPA)

1. 40 CFR 61 Subpart A and M (Revised Subpart B) - National Emission Standard for Hazardous Air Pollutants - Asbestos.
2. 40 CFR 763.80 - Asbestos Hazard Emergency Response Act (AHERA)
- C. Department of Transportation (DOT)
Title 49 CFR 100 - 185 – Transportation

1.5.4 STATE REQUIREMENTS

State requirements that apply to the asbestos abatement work, disposal, clearance, etc., include, but are not limited to, the following:

- C. Ohio Environmental Protection Agency (EPA)
 2. Ohio Administrative Code (OAC), Chapter 3745-20
- D. Ohio Department of Health
 1. Ohio Administrative Code (OAC), Chapter 3701-34

1.5.5 LOCAL REQUIREMENTS

If local requirements are more stringent than federal or state standards, the local standards are to be followed.

1.5.6 STANDARDS

- A. Standards which govern asbestos abatement activities include, but are not limited to, the following:
 1. American National Standards Institute (ANSI) Z9.2-79 - Fundamentals Governing the Design and Operation of Local Exhaust Systems
 2. Practices for Respiratory Protection.
 2. Underwriters Laboratories (UL)586-90 - UL Standard for Safety of HEPA filter Units, 7th Edition.
- B. Standards which govern encapsulation work include, but are not limited to, the following:
 1. American Society for Testing and Materials (ASTM)
- C. Standards which govern the fire and safety concerns in abatement work include, but are not limited to, the following:
 1. National Fire Protection Association (NFPA) 241 - Standard for Safeguarding Construction, Alteration, and Demolition Operations.
 2. NFPA 701 - Standard Methods for Fire Tests for Flame Resistant Textiles and Film.
 3. NFPA 101 - Life Safety Code

1.5.7 EPA GUIDANCE DOCUMENTS

- A. EPA guidance documents which discuss asbestos abatement work activities are listed below. These documents are made part of this section by reference. EPA publications can be ordered from (800) 424-9065.
- B. Guidance for Controlling ACM in Buildings (Purple Book) EPA 560/5-85-024
- C. Asbestos Waste Management Guidance EPA 530-SW-85-007
- D. A Guide to Respiratory Protection for the Asbestos Abatement Industry EPA-560-OPTS-86-001
- E. Guide to Managing Asbestos in Place (Green Book) TS 799 20T July 1990

1.5.8 NOTICES

- A. State and Local agencies: Send written notification as required by state and local regulations including the local fire department prior to beginning any work on ACM as follows:
- B. Copies of notifications shall be submitted to the VA for the facility's records, in the same time frame as notification is given to EPA, State, and Local authorities.

1.5.9 PERMITS/LICENSES

- A. The contractor shall apply for and have all required permits and licenses to perform asbestos abatement work as required by Federal, State, and Local regulations.

1.5.10 POSTING AND FILING OF REGULATIONS

- A. Maintain two (2) copies of applicable federal, state, and local regulations. Post one copy of each at the regulated area where workers will have daily access to the regulations and keep another copy in the Contractor's office.

1.5.11 VA RESPONSIBILITIES

Prior to commencement of work:

- A. Notify occupants adjacent to regulated areas of project dates and requirements for relocation, if needed. Arrangements must be made prior to starting work for relocation of desks, files, equipment, and personal possessions to avoid unauthorized access into the regulated area. **Note: Notification of adjacent personnel is required by OSHA in 29 CFR 1926.1101 (k) to prevent unnecessary or unauthorized access to the regulated area.**
- B. Submit to the Contractor results of background air sampling; including location of samples, person who collected the samples, equipment utilized, calibration data and method of analysis. During abatement, submit to the Contractor, results of bulk material analysis and air sampling data collected during the course of the abatement. This information shall not release the Contractor from any responsibility for OSHA compliance.

1.5.13 EMERGENCY ACTION PLAN AND ARRANGEMENTS

- A. An Emergency Action Plan shall be developed by prior to commencing abatement activities and shall be agreed to by the Contractor and the VA. The Plan shall meet the requirements of 29 CFR 1910.38 (a);(b).
- B. Emergency procedures shall be in written form and prominently posted in the clean room and equipment room of the decontamination unit. Everyone, prior to entering the regulated area, must read and sign these procedures to acknowledge understanding of the regulated area layout, location of emergency exits and emergency procedures.
- C. Emergency planning shall include written notification of police, fire, and emergency medical personnel of planned abatement activities; work schedule; layout of regulated area; and access to the regulated area, particularly barriers that may affect response capabilities.
- D. Emergency planning shall include consideration of fire, explosion, hazardous atmospheres, electrical hazards, slips/trips and falls, confined spaces, and heat stress illness. Written procedures for response to emergency situations shall be developed and employee training in procedures shall be provided.
- E. Employees shall be trained in regulated area/site evacuation procedures in the event of workplace emergencies.
 - 1. For non life-threatening situations - employees injured or otherwise incapacitated shall decontaminate following normal procedures with assistance from fellow workers, if necessary, before exiting the regulated area to obtain proper medical treatment.
 - 2. For life-threatening injury or illness, worker decontamination shall take least priority after measures to stabilize the injured worker, remove them from the regulated area, and secure proper medical treatment.
- F. Telephone numbers of any/all emergency response personnel shall be prominently posted in the clean room, along with the location of the nearest telephone.
- G. The Contractor shall provide verification of first aid/CPR training for personnel responsible for providing first aid/CPR. OSHA requires medical assistance within 3-4 minutes of a life-threatening injury/illness. Bloodborne Pathogen training shall also be verified for those personnel required to provide first aid/CPR.
- H. The Emergency Action Plan shall provide for a Contingency Plan in the event that an incident occurs that may require the modification of the standard operating procedures during abatement. Such incidents include, but are not limited to, fire; accident; power failure; negative pressure failure; and supplied air system failure. The Contractor shall detail procedures to be followed in the event of an incident assuring that asbestos abatement work is stopped and wetting is continued until correction of the problem..

1.5.14 PRE-CONSTRUCTION MEETING

Prior to commencing the work, the Contractor shall meet with the VA Certified Industrial Hygienist (VPCIH) to present and review, as appropriate, the items following this paragraph. The Contractor's Competent Person(s) who will be on-site shall participate in the pre-start meeting. The pre-start meeting is to discuss and determine procedures to be used during the project. At this meeting, the Contractor shall provide:

- A. Proof of Contractor licensing.
- B. Proof the Competent Person(s) is trained and accredited and approved for working in this State. Verification of the experience of the Competent Person(s) shall also be presented.
- C. A list of all workers who will participate in the project, including experience and verification of training and accreditation.
- D. A list of and verification of training for all personnel who have current first-aid/CPR training. A minimum of one person per shift must have adequate training.
- E. Current medical written opinions for all personnel working on-site meeting the requirements of 29 CFR 1926.1101 (m).
- F. Current fit-tests for all personnel wearing respirators on-site meeting the requirements of 29 CFR 1926.1101 (h) and Appendix C.
- G. A copy of the Contractor's Asbestos Hazard Abatement Plan. In these procedures, the following information must be detailed, specific for this project.
 - 1. Regulated area preparation procedures;
 - 2. Notification requirements procedure of Contractor as required in 29 CFR 1926.1101 (d);
 - 3. Decontamination area set-up/layout and decontamination procedures for employees;
 - 4. Abatement methods/procedures and equipment to be used; and
 - 5. Personal protective equipment to be used.
- H. At this meeting the Contractor shall provide all submittals as required.
- I. Procedures for handling, packaging and disposal of asbestos waste.
- J. Emergency Action Plan and Contingency Plan Procedures.

1.6 PROJECT COORDINATION

The following are the minimum administrative and supervisory personnel necessary for coordination of the work.

1.6.1 PERSONNEL

- A. Administrative and supervisory personnel shall consist of a qualified Competent Person(s) as defined by OSHA in the Construction Standards and the Asbestos Construction Standard; Contractor Professional Industrial Hygienist and Industrial Hygiene Technicians. These employees are the Contractor's representatives responsible for compliance with these specifications and all other applicable requirements.
- B. Non-supervisory personnel shall consist of an adequate number of qualified personnel to meet the schedule requirements of the project. Personnel shall meet required qualifications. Personnel utilized on-site shall be pre-approved by the VA representative. A request for approval shall be submitted for any person to be employed during the project giving the person's name; social security number; qualifications; accreditation card with color picture; Certificate of Worker's Acknowledgment; and Affidavit of Medical Surveillance and Respiratory Protection and current Respirator Fit Test.
- C. Minimum qualifications for Contractor and assigned personnel are:
 - 1. The Contractor has conducted within the last three (3) years, three (3) projects of similar complexity and dollar value as this project; has not been cited and penalized for serious violations of federal (and state as applicable) EPA and OSHA asbestos regulations in the past three (3) years; has adequate liability/occurrence insurance for asbestos work as required by the state; is licensed in applicable states; has adequate and qualified personnel available to complete the work; has comprehensive standard operating procedures for asbestos work; has adequate materials, equipment and supplies to perform the work.

2. The Competent Person has four (4) years of abatement experience of which two (2) years were as the Competent Person on the project; meets the OSHA definition of a Competent Person; has been the Competent Person on two (2) projects of similar size and complexity as this project within the past three (3) years; has completed EPA AHERA/OSHA/State/Local training requirements/accreditation(s) and refreshers; and has all required OSHA documentation related to medical and respiratory protection.
3. The Contractor Professional Industrial Hygienist/CIH (CPIH/CIH) may also be the Contractor's Competent Person provided that: he or she shall have four (4) years of monitoring experience and supervision of asbestos abatement projects; has participated as a competent person on four (4) abatement projects, three (3) of which are similar in size and complexity as this project; has developed at least one complete Asbestos Hazard Abatement Plan for asbestos abatement; has field trained abatement personnel for three (3) years; has specialized EPA AHERA/OSHA training in asbestos abatement supervision, respiratory protection, and waste disposal; has completed the Contractor/Supervisor course; and has appropriate medical/respiratory protection records/documentation..
4. The Abatement Personnel shall have completed the EPA AHERA/OSHA abatement worker course; have training on the standard operating procedures of the Contractor; has one year of asbestos abatement experience within the past three (3) years of similar size and complexity; has applicable medical and respiratory protection documentation; has certificate of training/current refresher and State accreditation/license.
All personnel should be in compliance with OSHA construction safety training as applicable and submit certification.

1.7 RESPIRATORY PROTECTION

1.7.1 GENERAL - RESPIRATORY PROTECTION PROGRAM

The Contractor shall develop and implement a written Respiratory Protection Program (RPP) which is in compliance with the January 8, 1998 OSHA requirements found at 29 CFR 1926.1101 and 29 CFR 1910.Subpart I;134. ANSI Standard Z88.2-1992 provides excellent guidance for developing a respiratory protection program. All respirators used must be NIOSH approved for asbestos abatement activities. The written RPP shall, at a minimum, contain the basic requirements found at 29 CFR 1910.134 (c)(1)(i - ix) - Respiratory Protection Program..

1.7.2 RESPIRATORY PROTECTION PROGRAM COORDINATOR

The Respiratory Protection Program Coordinator (RPPC) must be identified and shall have two (2) years experience coordinating RPP of similar size and complexity. The RPPC must submit a signed statement attesting to the fact that the program meets the above requirements.

1.7.3 SELECTION AND USE OF RESPIRATORS

The procedure for the selection and use of respirators must be submitted to the VA as part of the Contractor's qualifications. The procedure must be written clearly enough for workers to understand. A copy of the Respiratory Protection Program must be available in the clean room of the decontamination unit for reference by employees or authorized visitors.

1.7.4 MINIMUM RESPIRATORY PROTECTION

Minimum respiratory protection shall be a half face, HEPA filtered, air purifying respirator when fiber levels are maintained consistently at or below 0.1 f/cc. A higher level of respiratory protection may be provided or required, depending on fiber levels. Respirator selection shall meet the requirements of 29 CFR 1926.1101 (h); Table 1, except as indicated in this paragraph. Abatement personnel must have a respirator for their exclusive use.

1.7.5 MEDICAL WRITTEN OPINION

No employee shall be allowed to wear a respirator unless a physician or other licensed health care professional has provided a written determination they are medically qualified to wear the class of respirator to be used on the project while wearing whole body impermeable garments and subjected to heat or cold stress.

1.7.6 RESPIRATOR FIT TEST

All personnel wearing respirators shall have a current qualitative/quantitative fit test which was conducted in accordance with 29 CFR 1910.134 (f) and Appendix A. Quantitative fit tests shall be done for PAPRs which have been put into a motor/blower failure mode.

1.7.7 RESPIRATOR FIT CHECK

The Competent Person shall assure that the positive/negative pressure user seal check is done each time the respirator is donned by an employee. Head coverings must cover respirator head straps. Any situation that prevents an effective facepiece to face seal as evidenced by failure of a user seal check shall preclude that person from wearing a respirator inside the regulated area until resolution of the problem.

1.7.8 MAINTENANCE AND CARE OF RESPIRATORS

The Respiratory Protection Program Coordinator shall submit evidence and documentation showing compliance with 29 CFR 1910.134 (h) Maintenance and care of respirators.

1.8 WORKER PROTECTION**1.8.1 TRAINING OF ABATEMENT PERSONNEL**

Prior to beginning any abatement activity, all personnel shall be trained in accordance with OSHA 29 CFR 1926.1101 (k)(9) and any additional State/Local requirements. Training must include, at a minimum, the elements listed at 29 CFR 1926.1101 (k)(9)(viii). Training shall have been conducted by a third party, EPA/State approved trainer meeting the requirements of EPA 40 CFR 763 Appendix C (AHERA MAP). Initial training certificates and current refresher and accreditation proof must be submitted for each person working at the site.

1.8.2 MEDICAL EXAMINATIONS

Medical examinations meeting the requirements of 29 CFR 1926.1101 (m) shall be provided for all personnel working in the regulated area, regardless of exposure levels. A current physician's written opinion as required by 29 CFR 1926.1101 (m)(4) shall be provided for each person and shall include in the medical opinion the person has been evaluated for working in a heat and cold stress environment while wearing personal protective equipment (PPE) and is able to perform the work without risk of material health impairment.

1.8.3 PERSONAL PROTECTIVE EQUIPMENT

Provide whole body clothing, head coverings, foot coverings and any other personal protective equipment as determined by conducting the hazard assessment required by OSHA at 29 CFR 1910.132 (d). The Competent Person shall ensure the integrity of personal protective equipment worn for the duration of the project. Duct tape shall be used to secure all suit sleeves to wrists and to secure foot coverings at the ankle. Worker protection shall meet the most stringent requirements.

1.8.4 REGULATED AREA ENTRY PROCEDURE

The Competent Person shall ensure that each time workers enter the regulated area, they remove ALL street clothes in the clean room of the decontamination unit and put on new disposable

coveralls, head coverings, a clean respirator, and then proceed through the shower room to the equipment room where they put on non-disposable required personal protective equipment.

1.8.5 DECONTAMINATION PROCEDURE

The Competent Person shall require all personnel to adhere to following decontamination procedures whenever they leave the regulated area.

- A. When exiting the regulated area, remove all disposable PPE and dispose of in a disposal bag provided in the regulated area.
- B. Carefully decontaminate and clean the respirator. Put in a clean container/bag.

1.8.6 REGULATED AREA REQUIREMENTS

The Competent Person shall meet all requirements of 29 CFR 1926.1101 (o) and assure that all requirements for Class I regulated areas at 29 CFR 1926.1101 (e) are met applicable to Class II work. All personnel in the regulated area shall not be allowed to eat, drink, smoke, chew tobacco or gum, apply cosmetics, or in any way interfere with the fit of their respirator.

1.9 DECONTAMINATION FACILITIES

1.9.1 DESCRIPTION

Requirements for Class II asbestos work operations where exposures exceed a PEL or where there is no negative exposure assessment produced before the operation, must meet the following:

- A. The employer shall establish an equipment room or area that is adjacent to the regulated area for the decontamination of employees and their equipment which is contaminated with asbestos which shall consist of an area covered by an impermeable drop cloth on the floor or horizontal working surface.
- B. The area must be of sufficient size as to accommodate cleaning of equipment and removing personal protective equipment without spreading contamination beyond the area (as determined by visible accumulations).
- C. Work clothing must be cleaned with a HEPA vacuum before it is removed.
- D. All equipment and surfaces of containers filled with ACM must be cleaned prior to removing them from the equipment room or area.
- E. The employer shall ensure that employees enter and exit the regulated area through the equipment room or area.

1.9.2 WASTE/EQUIPMENT DECONTAMINATION AREA (W/EDA)

The Competent Person shall provide a W/EDA for removal of all waste, equipment and contaminated material from the regulated area.

1.9.3 WASTE/EQUIPMENT DECONTAMINATION PROCEDURES

Contain all waste in 6 mil poly bags. Clean/decontaminate bags and pass through a double 6 mil flap doorway into another bag or fiber drum. Remove to disposal dumpster/gondola/vehicle. At no time shall unprotected personnel from the clean side be allowed to enter the regulated area.

PART 2 - PRODUCTS, MATERIALS AND EQUIPMENT

2.1 MATERIALS AND EQUIPMENT

2.1.1 GENERAL REQUIREMENTS (ALL ABATEMENT PROJECTS)

Prior to the start of work, the contractor shall provide and maintain a sufficient quantity of materials and equipment to assure continuous and efficient work throughout the duration of the project. Work shall not start unless the following items have been delivered to the site and verified by the CPIH/CIH.

- A. All materials shall be delivered in their original package, container or bundle bearing the name of the manufacturer and the brand name (where applicable).

- B. Store all materials subject to damage off the ground, away from wet or damp surfaces and under cover sufficient enough to prevent damage or contamination. Flammable and combustible materials cannot be stored inside buildings. Replacement materials shall be stored outside of the regulated area until abatement is completed.
- C. The Contractor shall not block or hinder use of buildings by patients, staff, and visitors to the VA in partially occupied buildings by placing materials/equipment in any unauthorized location.
- D. The Competent Person shall inspect for damaged, deteriorating or previously used materials. Such materials shall not be used and shall be removed from the worksite and disposed of properly.
- E. Polyethylene sheeting for walls in the regulated area shall be a minimum of 4-mils. For floors and all other uses, sheeting of at least 6-mils shall be used in widths selected to minimize the frequency of joints. Fire retardant poly shall be used throughout.
- F. The method of attaching polyethylene sheeting shall be agreed upon in advance by the Contractor and the VA and selected to minimize damage to equipment and surfaces. Method of attachment may include any combination of moisture resistant duct tape furring strips, spray glue, staples, nails, screws, lumber and plywood for enclosures or other effective procedures capable of sealing polyethylene to dissimilar finished or unfinished surfaces under both wet and dry conditions.
- G. Polyethylene sheeting utilized for the PDF shall be opaque white or black in color, 6 mil fire retardant poly.
- H. Installation and plumbing hardware, showers, hoses, drain pans, sump pumps and waste water filtration system shall be provided by the Contractor.
- I. An adequate number of HEPA vacuums, scrapers, sprayers, nylon brushes, brooms, disposable mops, rags, sponges, staple guns, shovels, ladders and scaffolding of suitable height and length as well as meeting OSHA requirements, fall protection devices, water hose to reach all areas in the regulated area, airless spray equipment, and any other tools, materials or equipment required to conduct the abatement project. All electrically operated hand tools, equipment, electric cords shall be connected to GFCI protection.
- J. Special protection for objects in the regulated area shall be detailed (e.g., plywood over carpeting or hardwood floors to prevent damage from scaffolds, water and falling material).
- K. Disposal bags – Materials shall be wrapped in 2 layers of 6 mil poly for transite waste and shall be pre-printed with labels, markings and address as required by OSHA, EPA and DOT regulations. If necessary, materials may be boxed or otherwise packaged to prevent damage to transite waste materials during transport. If boxed or otherwise packaged, appropriate labels shall be affixed to the outer layer of the final container.
- L. The VA shall be provided an advance copy of the MSDS as required for all hazardous chemicals under OSHA 29 CFR 1910.1200 - Hazard Communication in the pre-project submittal. Chlorinated compounds shall not be used with any spray adhesive, mastic remover or other product. Appropriate encapsulant(s) shall be provided.
- M. OSHA DANGER demarcation signs, as many and as required by OSHA 29 CFR 1926.1101(k)(7) shall be provided and placed by the Competent Person. All other posters and notices required by Federal and State regulations shall be posted in the Clean Room.
- N. Adequate and appropriate PPE for the project and number of personnel/shifts shall be provided. All personal protective equipment issued must be based on a written hazard assessment conducted under 29 CFR 1910.132(d).

2.2 CONTAINMENT BARRIERS AND COVERINGS IN THE REGULATED AREA

2.2.1 GENERAL

- A. Using critical barriers, Seal off the perimeter to the regulated area to completely isolate the regulated area from adjacent spaces. All surfaces in the regulated area must be covered to prevent contamination and to facilitate clean-up. Should adjacent areas become contaminated as a result of the work, shall immediately stop work and clean up the contamination at no additional cost to the VA. Provide firestopping and identify all fire barrier penetrations due to abatement work as specified in Section 3.1.4.8; FIRESTOPPING.
- B. Place all tools, scaffolding, materials and equipment needed for working in the regulated area prior to erecting any plastic sheeting. All uncontaminated removable furniture, equipment and/or

supplies shall be removed by the VA from the regulated area before commencing work. Any objects remaining in the regulated area shall be completely covered with 2 layers of 6-mil fire retardant poly sheeting and secured with duct tape. Lock out and tag out any HVAC/electrical systems in the regulated area.

2.2.3 CONTROLLING ACCESS TO THE REGULATED AREA

Access to the regulated area is allowed only through the personnel decontamination facility (PDF), if required. All other means of access shall be eliminated and OSHA DANGER demarcation signs posted as required by OSHA. If the regulated area is adjacent to or within view of an occupied area, provide a visual barrier of 6 mil opaque fire retardant poly sheeting to prevent building occupant observation. If the adjacent area is accessible to the public, the barrier must be solid.

2.2.4 CRITICAL BARRIERS

Completely separate any operations in the regulated area from adjacent areas using 2 layers of 6 mil fire retardant poly and duct tape. Individually seal with 2 layers of 6 mil poly and duct tape all HVAC openings into the regulated area. Individually seal all lighting fixtures, clocks, doors, windows, convectors, speakers, or any other objects/openings in the regulated area. Heat must be shut off any objects covered with poly.

2.2.5 SECONDARY BARRIERS

A loose layer of 6 mil poly shall be used as a drop cloth to protect the primary layers from debris generated during the abatement. This layer shall be replaced as needed during the work and at a minimum once per work day.

2.2.6 EXTENSION OF THE REGULATED AREA

If the enclosure of the regulated area is breached in any way that could allow contamination to occur, the affected area shall be included in the regulated area and constructed as per this section. Decontamination measures must be started immediately and continue until air monitoring indicates background levels are met..

2.2.7 FIRESTOPPING

- A. Through penetrations caused by cables, cable trays, pipes, sleeves, conduits, etc. must be firestopped with a fire-rated firestop system providing an air tight seal.
- B. Firestop materials that are not equal to the wall or ceiling penetrated shall be brought to the attention of the VA Representative. The contractor shall list all areas of penetration, the type of sealant used, and whether or not the location is fire rated. Any discovery of penetrations during abatement shall be brought to the attention of the VA representative immediately. All walls, floors and ceilings are considered fire rated unless otherwise determined by the VA Representative or Fire Marshall.
- C. Any visible openings whether or not caused by a penetration shall be reported by the Contractor to the VA Representative for a sealant system determination. Firestops shall meet ASTM E814 and UL 1479 requirements for the opening size, penetrant, and fire rating needed.

2.3 MONITORING, INSPECTION AND TESTING

2.3.1 GENERAL

- A. Perform throughout abatement work monitoring, inspection and testing inside and around the regulated area in accordance with the OSHA requirements and these specifications. OSHA requires that the employee exposure to asbestos must not exceed 0.1 fibers per cubic centimeter (f/cc) of air, averaged over an 8-hour work shift. The CPIH/CIH is responsible for and shall inspect and oversee the performance of the Contractor IH Technician. The IH Technician shall continuously inspect and monitor conditions inside the regulated area to ensure compliance with these specifications. In addition, the CPIH/CIH shall personally manage air sample collection,

analysis, and evaluation for personnel, regulated area, and adjacent area samples to satisfy OSHA requirements. Additional inspection and testing requirements are also indicated in other parts of this specification.

- B. The VA will employ an independent industrial hygienist (VPIH/CIH) consultant and/or use its own IH to perform various services on behalf of the VA. The VPIH/CIH will perform the necessary monitoring, inspection, testing, and other support services to ensure that VA patients, employees, and visitors will not be adversely affected by the abatement work, and that the abatement work proceeds in accordance with these specifications, that the abated areas or abated buildings have been successfully decontaminated. The work of the VPIH/CIH consultant in no way relieves the Contractor from their responsibility to perform the work in accordance with contract/specification requirements, to perform continuous inspection, monitoring and testing for the safety of their employees, and to perform other such services as specified. The cost of the VPIH/CIH and their services will be borne by the VA except for any repeat of final inspection and testing that may be required due to unsatisfactory initial results. Any repeated final inspections and/or testing, if required, will be paid for by the Contractor.
- C. If fibers counted by the VPIH/CIH during abatement work, either inside or outside the regulated area, utilizing the NIOSH 7400 air monitoring method, exceed the specified respective limits, the Contractor shall stop work. The Contractor may request confirmation of the results by analysis of the samples by TEM. Request must be in writing and submitted to the VA's representative. Cost for the confirmation of results will be borne by the Contractor for both the collection and analysis of samples and for the time delay that may/does result for this confirmation. Confirmation sampling and analysis will be the responsibility of the CPIH/CIH with review and approval of the VPIH/CIH. An agreement between the CPIH/CIH and the VPIH/CIH shall be reached on the exact details of the confirmation effort, in writing, including such things as the number of samples, location, collection, quality control on-site, analytical laboratory, interpretation of results and any follow-up actions. This written agreement shall be co-signed by the IH's and delivered to the VA's representative.

2.3.2 SCOPE OF SERVICES OF THE VPIH/CIH CONSULTANT

- A. The purpose of the work of the VPIH/CIH is to: assure quality; adherence to the specification; resolve problems; prevent the spread of contamination beyond the regulated area; and assure clearance at the end of the project. In addition, their work includes performing the final inspection and testing to determine whether the regulated area or building has been adequately decontaminated. All air monitoring is to be done utilizing PCM/TEM. The VPIH/CIH will perform the following tasks:
 - 1. Task 1: Establish background levels before abatement begins by collecting background samples. Retain samples for possible TEM analysis.
 - 2. Task 2: Perform continuous air monitoring, inspection, and testing outside the regulated area during actual abatement work to detect any faults in the regulated area isolation and any adverse impact on the surroundings from regulated area activities.
 - 3. Task 3: Perform unannounced visits to spot check overall compliance of work with contract/specifications. These visits may include any inspection, monitoring, and testing inside and outside the regulated area and all aspects of the operation except personnel monitoring.
 - 4. Task 4: Provide support to the VA representative such as evaluation of submittals from the Contractor, resolution of conflicts, interpret data, etc.
 - 5. Task 5: Perform, in the presence of the VA representative, final inspection and testing of a decontaminated regulated area at the conclusion of the abatement to certify compliance with all regulations and VA requirements/specifications.
 - 6. Task 6: Issue certificate of decontamination for each regulated area and project report.
- B. All documentation, inspection results and testing results generated by the VPIH/CIH will be available to the Contractor for information and consideration. The Contractor shall cooperate with and support the VPIH/CIH for efficient and smooth performance of their work.
- C. The monitoring and inspection results of the VPIH/CIH will be used by the VA to issue any Stop Removal orders to the Contractor during abatement work and to accept or reject a regulated area or building as decontaminated.

- D. All air sampling and analysis data will be recorded on VA Form 10-0018.

2.3.3 MONITORING, INSPECTION AND TESTING BY CONTRACTOR CPIH/CIH

The Contractor's CPIH/CIH is responsible for managing all monitoring, inspections, and testing required by these specifications, as well as any and all regulatory requirements adopted by these specifications. The CPIH/CIH is responsible for the continuous monitoring of all subsystems and procedures which could affect the health and safety of the Contractor's personnel. Safety and health conditions and the provision of those conditions inside the regulated area for all persons entering the regulated area is the exclusive responsibility of the Contractor/Competent Person. The person performing the personnel and area air monitoring inside the regulated area shall be the CPIH or an IH Technician, who shall be trained and shall have specialized field experience in sampling and analysis. The CPIH or IH Technician shall also be an accredited EPA AHERA/State Contractor/Supervisor. The CPIH or IH Technician shall have participated in five abatement projects collecting personal and area samples as well as responsibility for documentation on substantially similar projects in size and scope. The analytic laboratory used by the Contractor to analyze the samples shall be AIHA accredited for asbestos PAT and approved by the VA prior to start of the project. A daily log, shall be maintained by the CPIH/CIH or IH Technician, documenting all OSHA requirements for air personal monitoring for asbestos in 29 CFR 1926.1101(f), (g) and Appendix A. This log shall be made available to the VA representative and the VPIH/CIH upon request. The log will contain, at a minimum, information on personnel or area samples, other persons represented by the sample, the date of sample collection, start and stop times for sampling, sample volume, flow rate, and fibers/cc. The CPIH/CIH shall collect and analyze samples for each representative job being done in the regulated area, i.e., removal, wetting, clean-up, and load-out. No fewer than two personal samples per shift shall be collected and one area sample per 1,000 square feet of regulated area where abatement is taking place and one sample per shift in the clean room area shall be collected. In addition to the continuous monitoring required, the CPIH/CIH will perform inspection and testing at the final stages of abatement for each regulated area as specified in the CPIH/CIH responsibilities. Additionally, the CPIH/CIH will monitor and record pressure readings within the containment daily with a minimum of two readings at the beginning and at the end of a shift, and submit the data in the daily report.

2.4 ASBESTOS HAZARD ABATEMENT PLAN

The Contractor shall have established Asbestos Hazard Abatement Plan (AHAP) in printed form and loose leaf folder consisting of simplified text, diagrams, sketches, and pictures that establish and explain clearly the ways and procedures to be followed during all phases of the work by the contractor's personnel. The AHAP(s) must be modified as needed to address specific requirements of the project. The AHAP shall be submitted for review and approval prior to the start of any abatement work. The minimum topics and areas to be covered by the AHAP(s) are:

- A. Minimum Personnel Qualifications
- B. Contingency Plans and Arrangements
- C. Security and Safety Procedures
- D. Respiratory Protection/Personal Protective Equipment Program and Training
- E. Medical Surveillance Program and Recordkeeping
- F. Regulated Area Requirements for Class II work
- G. Decontamination Facilities and Entry/Exit Procedures (PDF and W/EDF)
- H. Monitoring, Inspections, and Testing
- I. Removal Procedures for Class II Materials
- J. Disposal of ACM Waste
- K. Regulated Area Decontamination/Clean-up
- L. Regulated Area Visual and Air Clearance
- M. Project Completion/Closeout

2.5 SUBMITTALS

2.5.1 PRE-START MEETING SUBMITTALS

Submit to the VA a minimum of 14 days prior to the pre-start meeting the following for review and approval. Meeting this requirement is a prerequisite for the pre-start meeting for this project:

- A. Submit a detailed work schedule for the entire project reflecting contract documents and the phasing/schedule requirements from the CPM chart.
- B. Submit a staff organization chart showing all personnel who will be working on the project and their capacity/function. Provide their qualifications, training, accreditations, and licenses, as appropriate. Provide a copy of the "Certificate of Worker's Acknowledgment" and the "Affidavit of Medical Surveillance and Respiratory Protection" for each person.
- C. Submit Asbestos Hazard Abatement Plan developed specifically for this project, incorporating the requirements of the specifications, prepared, signed and dated by the CPIH/CIH.
- D. Submit the specifics of the materials and equipment to be used for this project with manufacturer names, model numbers, performance characteristics, pictures/diagrams, and number available for the following:
 1. Supplied air system, negative air machines, HEPA vacuums, air monitoring pumps, calibration devices, pressure differential monitoring device and emergency power generating system.
 2. Waste water filtration system, shower system, containment barriers.
 3. Encapsulants, surfactants, hand held sprayers, airless sprayers, and fire extinguishers.
 4. Respirators, protective clothing, personal protective equipment.
 5. Fire safety equipment to be used in the regulated area.
- E. Submit the name, location, and phone number of the approved landfill; proof/verification the landfill is approved for ACM disposal; the landfill's requirements for ACM waste; the type of vehicle to be used for transportation; and name, address, and phone number of subcontractor, if used. Proof of asbestos training for transportation personnel shall be provided.
- F. Submit required notifications and arrangements made with regulatory agencies having regulatory jurisdiction and the specific contingency/emergency arrangements made with local health, fire, ambulance, hospital authorities and any other notifications/arrangements.
- G. Submit the name, location and verification of the laboratory and/or personnel to be used for analysis of air and/or bulk samples. Personal air monitoring must be done in accordance with OSHA 29 CFR 1926.1101(f) and Appendix A. Area or clearance air monitoring shall be conducted in accordance with EPA AHERA protocols.
- H. Submit qualifications verification: Submit the following evidence of qualifications. Make sure that all references are current and verifiable by providing current phone numbers and documentation.
 1. Asbestos Abatement Company: Project experience within the past 3 years; listing projects first most similar to this project: Project Name; Type of Abatement; Duration; Cost; Reference Name/Phone Number; Final Clearance; and Completion Date
 2. List of project(s) halted by owner, A/E, IH, regulatory agency in the last 3 years: Project Name; Reason; Date; Reference Name/Number; Resolution
 3. List asbestos regulatory citations (e.g., OSHA), notices of violations (e.g., Federal and state EPA), penalties, and legal actions taken against the company including and of the company's officers (including damages paid) in the last 3 years. Provide copies and all information needed for verification.
- I. Submit information on personnel: Provide a resume; address each item completely; copies of certificates, accreditations, and licenses. Submit an affidavit signed by the CPIH/CIH stating that all personnel submitted below have medical records in accordance with OSHA 29 CFR 1926.1101(m) and 29 CFR 1910.20 and that the company has implemented a medical surveillance program and written respiratory protection program, and maintains recordkeeping in accordance with the above regulations. Submit the phone number and doctor/clinic/hospital used for medical evaluations.
 1. CPIH/CIH (may also be the Competent Person): Name; years of abatement experience; list of projects similar to this one; certificates, licenses, accreditations for proof of AHERA/OSHA specialized asbestos training; professional affiliations; number of workers trained in the field; medical opinion; and current respirator fit test.

2. Competent Person(s)/Supervisor(s): Number; names; social security numbers; years of abatement experience as Competent Person/Supervisor; list of similar projects in size/complexity as Competent Person/Supervisor; as a worker; certificates, licenses, accreditations; proof of AHERA/OSHA specialized asbestos training; maximum number of personnel supervised on a project; medical opinion (asbestos surveillance and respirator use); and current respirator fit test.
3. Workers: Numbers; names; social security numbers; years of abatement experience; certificates, licenses, accreditations; training courses in asbestos abatement and respiratory protection; medical opinion (asbestos surveillance and respirator use); and current respirator fit test.
- J. Submit copies of State license for asbestos abatement; copy of insurance policy, including exclusions with a letter from agent stating in plain language the coverage provided and the fact that asbestos abatement activities are covered by the policy; copy of SOP's incorporating the requirements of this specification; information on who provides your training, how often; who provides medical surveillance, how often; who performs and how is personal air monitoring of abatement workers conducted; a list of references of independent laboratories/IH's familiar with your air monitoring and standard operating procedures; copies of monitoring results of the five referenced projects listed and analytical method(s) used.
- K. Rented equipment must be decontaminated prior to returning to the rental agency.
- L. Submit, before the start of work, the manufacturer's technical data for all types of encapsulants, all MSDS and application instructions.

2.5.2 SUBMITTALS DURING ABATEMENT

- A. The Competent Person shall maintain and submit a daily log at the regulated area documenting the dates and times of the following: purpose, attendees and summary of meetings; all personnel entering/exiting the regulated area; document and discuss the resolution of unusual events such as barrier breaching, equipment failures, emergencies, and any cause for stopping work; representative air monitoring and results/TWAs/ELs. Submit this information daily to the VPIH/CIH.
- B. The CPIH/CIH shall document and maintain the inspection and approval of the regulated area preparation prior to start of work and daily during work.
 1. Removal of any poly barriers.
 2. Visual inspection/testing by the CPIH/CIH or IH Technician prior to application of lockdown encapsulant.
 3. Packaging and removal of ACM waste from regulated area.
 4. Disposal of ACM waste materials; copies of Waste Shipment Records/landfill receipts to the VA's representative on a weekly basis.

2.5.3 SUBMITTALS AT COMPLETION OF ABATEMENT

The CPIH/CIH shall submit a project report consisting of the daily log book requirements and documentation of events during the abatement project including Waste Shipment Records signed by the landfill's agent. It will also include information on the containment and transportation of waste from the containment with applicable Chain of Custody forms. The report shall include a certificate of completion, signed and dated by the CPIH/CIH, in accordance with Attachment #1. All clearance and perimeter area samples must be submitted. The VA Representative will retain the abatement report after completion of the project and provide copies of the abatement report to VAMC Office of Engineer and the Safety Office.

PART 3 - EXECUTION

3.1 REGULATED AREA PREPARATIONS

3.1.1 SITE SECURITY

- A. Regulated area access is to be restricted only to authorized, trained/accredited and protected personnel. These may include the Contractor's employees, employees of Subcontractors, VA

employees and representatives, State and local inspectors, and any other designated individuals. A list of authorized personnel shall be established prior to commencing the project and be posted in the clean room of the decontamination unit.

- B. Entry into the regulated area by unauthorized individuals shall be reported immediately to the Competent Person by anyone observing the entry. The Competent person shall immediately notify the VA.
- C. A log book shall be maintained in the clean room of the decontamination unit. Anyone who enters the regulated area must record their name, affiliation, time in, and time out for each entry.
- D. Access to the regulated area shall be through of a critical barrier doorway. All other access (doors, windows, hallways, etc.) shall be sealed or locked to prevent entry to or exit from the regulated area. The only exceptions for this requirement are the waste/equipment load-out area which shall be sealed except during the removal of containerized asbestos waste from the regulated area, and emergency exits. Emergency exits shall not be locked from the inside; however, they shall be sealed with poly sheeting and taped until needed.
- E. The Contractor's Competent Person shall control site security during abatement operations in order to isolate work in progress and protect adjacent personnel. A 24 hour security system shall be provided at the entrance to the regulated area to assure that all entrants are logged in/out and that only authorized personnel are allowed entrance.
- F. The Contractor will have the VA's assistance in notifying adjacent personnel of the presence, location and quantity of ACM in the regulated area and enforcement of restricted access by the VA's employees.
- G. The regulated area shall be locked during non-working hours and secured by VA Representative or Competent Person. The VA Police should be informed of asbestos abatement regulated areas to provide security checks during facility rounds and emergency response.

3.1.2 OSHA DANGER SIGNS

Post OSHA DANGER signs meeting the specifications of OSHA 29 CFR 1926.1101 at any location and approaches to the regulated area where airborne concentrations of asbestos may exceed the PEL. Signs shall be posted at a distance sufficiently far enough away from the regulated area to permit any personnel to read the sign and take the necessary measures to avoid exposure. Additional signs will be posted following construction of the regulated area enclosure.

3.1.3 SHUT DOWN - LOCK OUT ELECTRICAL

Shut down and lock out/tag out electric power to the regulated area. Provide temporary power and lighting. Insure safe installation including GFCI of temporary power sources and equipment by compliance with all applicable electrical code requirements and OSHA requirements for temporary electrical systems. Electricity shall be provided by the VA.

3.1.4 SHUT DOWN - LOCK OUT HVAC

Shut down and lock out/tag out heating, cooling, and air conditioning system (**HVAC**) components that are in, supply or pass through the regulated area.

Investigate the regulated area and agree on pre-abatement condition with the VA's representative. Seal all intake and exhaust vents in the regulated area with duct tape and 2 layers of 6-mil poly. Also, seal any seams in system components that pass through the regulated area. Remove all contaminated HVAC system filters and place in labeled 6-mil poly disposal bags for disposal as asbestos waste.

3.1.5 LOCAL EXHAUST VENTILATION

The Contractor shall provide a HEPA filtered negative air machine to act as local exhaust ventilation. The unit shall be placed immediately adjacent to the work being conducted and exhausted outdoors. If outdoor exhaust is not feasible, the contractor shall obtain permission from the VPIH or VA representative to potentially exhaust indoors into an unoccupied space.

3.1.6 CONTAINMENT BARRIERS AND COVERINGS FOR THE REGULATED AREA**3.1.6.1 GENERAL**

- A. Using critical barriers, seal off the perimeter to the regulated area to completely isolate the regulated area from adjacent spaces. All surfaces in the regulated area must be covered to prevent contamination and to facilitate clean-up. Should adjacent areas become contaminated as a result of the work, shall immediately stop work and clean up the contamination at no additional cost to the VA. Provide firestopping and identify all fire barrier penetrations due to abatement work as specified in Section 3.1.4.8; FIRESTOPPING.

3.1.6.2 PREPARATION PRIOR TO SEALING OFF

Place all tools, scaffolding, materials and equipment needed for working in the regulated area prior to erecting any plastic sheeting. All uncontaminated removable furniture, equipment and/or supplies shall be removed by the VA from the regulated area before commencing work. Any objects remaining in the regulated area shall be completely covered with 2 layers of 6-mil fire retardant poly sheeting and secured with duct tape. Lock out and tag out any HVAC/electrical systems in the regulated area.

3.1.6.3 CONTROLLING ACCESS TO THE REGULATED AREA

Access to the regulated area shall be permitted only by the competent person. All other means of access shall be eliminated and OSHA DANGER demarcation signs posted as required by OSHA. If the regulated area is adjacent to, or within view of an occupied area, provide a visual barrier of 6 mil opaque fire retardant poly to prevent building occupant observation. If the adjacent area is accessible to the public, the barrier must be solid and capable of withstanding the negative pressure.

3.1.6.4 CRITICAL BARRIERS

Completely separate any operations in the regulated area from adjacent areas using 2 layers of 6 mil fire retardant poly and duct tape. Individually seal with 2 layers of 6 mil poly and duct tape all HVAC openings into the regulated area. Individually seal all lighting fixtures, clocks, doors, windows, convectors, speakers, or any other objects/openings in the regulated area. Heat must be shut off any objects covered with poly.

3.1.6.5 EXTENSION OF THE REGULATED AREA

If the enclosure of the regulated area is breached in any way that could allow contamination to occur, the affected area shall be included in the regulated area and constructed as per this section. Decontamination measures must be started immediately and continue until air monitoring indicates background levels are met

3.1.6.6 FLOOR BARRIERS

If floor removal is not being done, all floors in the regulated area shall be covered with 2 layers of 6 mil fire retardant poly and brought up the wall 12 inches.

3.1.7 PERSONAL PROTECTIVE EQUIPMENT

Refer to Sections 1.7 and 1.8.3 of this document.

3.1.8 SANITARY FACILITIES

The Contractor shall provide sanitary facilities for abatement personnel and maintain them in a clean and sanitary condition throughout the abatement project.

3.1.9 PRE-CLEANING

3.1.9.1 PRE-CLEANING MOVABLE OBJECTS

Pre-cleaning of ACM contaminated items shall be performed after the enclosure has been erected and negative pressure has been established in the work area. After items have been pre-cleaned and decontaminated, they may be removed from the work area for storage until the completion of abatement in the work area.

Pre-clean all movable objects within the regulated area using a HEPA filtered vacuum and/or wet cleaning methods as appropriate. After cleaning, these objects shall be removed from the regulated area and carefully stored in an uncontaminated location.

3.1.9.2 PRE-CLEANING FIXED OBJECTS

Pre-cleaning of ACM contaminated items shall be performed after the enclosure has been erected and negative pressure has been established in the work area

Pre-clean all fixed objects in the regulated area using HEPA filtered vacuums and/or wet cleaning techniques as appropriate. Careful attention must be paid to machinery behind grills or gratings where access may be difficult but contamination may be significant. Also, pay particular attention to wall, floor and ceiling penetration behind fixed items. After pre-cleaning, enclose fixed objects with 2 layers of 6-mil poly and seal securely in place with duct tape. Objects (e.g., permanent fixtures, shelves, electronic equipment, laboratory tables, sprinklers, alarm systems, closed circuit TV equipment and computer cables) which must remain in the regulated area and that require special ventilation or enclosure requirements should be designated here along with specified means of protection. Contact the manufacturer for special protection requirements.

3.1.9.3 PRE-CLEANING SURFACES IN THE REGULATED AREA

Pre-cleaning of ACM contaminated items shall be performed after the enclosure has been erected and negative pressure has been established in the work area

Pre-clean all surfaces in the regulated area using HEPA filtered vacuums and/or wet cleaning methods as appropriate. Do not use any methods that would raise dust such as dry sweeping or vacuuming with equipment not equipped with HEPA filters. Do not disturb asbestos-containing materials during this pre-cleaning phase.

3.1.10 PRE-ABATEMENT ACTIVITIES

3.1.10.1 PRE-ABATEMENT MEETING

The VA representative, upon receipt, review, and substantial approval of all pre-abatement submittals and verification by the CPIH that all materials and equipment required for the project are on the site, will arrange for a pre-abatement meeting between the Contractor, the CPIH, Competent Person(s), the VA representative(s), and the VPIH/CIH. The purpose of the meeting is to discuss any aspect of the submittals needing clarification or amplification and to discuss any aspect of the project execution and the sequence of the operation. The Contractor shall be prepared to provide any supplemental information/ documentation to the VA's representative regarding any submittals, documentation, materials or equipment. Upon satisfactory resolution of any outstanding issues, the VA's representative will issue a written order to proceed to the Contractor. No abatement work of any kind described in the following provisions shall be initiated prior to the VA written order to proceed.

3.1.10.2 PRE-ABATEMENT INSPECTIONS AND PREPARATIONS

Before any work begins on the construction of the regulated area, the Contractor will:

- A. Conduct a space-by-space inspection with an authorized VA representative and prepare a written inventory of all existing damage in those spaces where asbestos abatement will occur. Still or

video photography may be used to supplement the written damage inventory. Document will be signed and certified as accurate by both parties.

- B. The VA Representative, the Contractor, and the VPIH/CIH must be aware of VA A/E Quality Alert 07/09 indicating the failure to identify asbestos in the areas listed as well as common issues when preparing specifications and contract documents. This is especially critical when demolition is planned, because AHERA surveys are non-destructive, and ACM may remain undetected. A NESHAP-compliant (destructive) ACM inspection should be conducted on all building structures that will be demolished. Ensure the following areas are inspected on the project: Lay-in ceilings concealing ACM; ACM behind walls/windows from previous renovations; inside utility chases/walls; transite piping/ductwork/sheets; behind radiators; lab fume hoods; transite lab countertops; roofing materials; below window sills; water/sewer lines; electrical conduit coverings; crawl spaces(previous abatement contamination); flooring/mastic covered by carpeting/new flooring; exterior insulated wall panels; on underground fuel tanks; steam line trench coverings.
- C. Ensure that all furniture, machinery, equipment, curtains, drapes, blinds, and other movable objects required to be removed from the regulated area have been cleaned and removed or properly protected from contamination.
- D. Shut down and seal with a minimum of 2 layers of 6 mil fire retardant poly all HVAC systems and critical openings in the regulated area. The regulated area critical barriers shall be completely isolate the regulated area from any other air in the building. The VA's representative will monitor the isolation provision.
- E. Shut down and lock out in accordance with 29 CFR 1910.147 all electrical circuits which pose a potential hazard. Electrical arrangements will be tailored to the particular regulated area and the systems involved. All electrical circuits affected will be turned off at the circuit box outside the regulated area, not just the wall switch. The goal is to eliminate the potential for electrical shock which is a major threat to life in the regulated area due to water use and possible energized circuits. Electrical lines used to power equipment in the regulated area shall conform to all electrical safety standards and shall be isolated by the use of a ground fault circuit interrupter (GFCI). All GFCI shall be tested prior to use. The VA's representative will monitor the electrical shutdown.
- F. If required, remove and dispose of carpeting from floors in the regulated area.
- G. Inspect existing firestopping in the regulated area. Correct as needed.

3.1.10.3 PRE-ABATEMENT CONSTRUCTION AND OPERATIONS

- A. Perform all preparatory work for the first regulated area in accordance with the approved work schedule and with this specification.
- B. Upon completion of all preparatory work, the CPIH/CIH will inspect the work and systems and will notify the VA's representative when the work is completed in accordance with this specification. The VA's representative may inspect the regulated area and the systems with the VPIH/CIH and may require that upon satisfactory inspection, the Contractor's employees perform all major aspects of the approved AHAP(s), especially worker protection, respiratory systems, contingency plans, decontamination procedures, and monitoring to demonstrate satisfactory operation. The operational systems for respiratory protection and the negative pressure system shall be demonstrated for proper performance.
- C. The CPIH/CIH shall document the pre-abatement activities described above and deliver a copy to the VA's representative.
- D. Upon satisfactory inspection of the installation of and operation of systems the VA's representative will notify the Contractor in writing to proceed with the asbestos abatement work in accordance with this specification and all applicable regulations.

3.2 REMOVAL OF CLASS II GASKET MATERIALS

GENERAL

All applicable requirements of OSHA, EPA, and DOT shall be followed during OSHA Class II work. Keep materials intact; do not break up materials; wet while working with it; wrap as soon as

possible with 2 layers of 6 mil plastic for disposal, and maintain good housekeeping in work areas during abatement.

Coordinate with the general contractor and ensure that associated steam lines have been deactivated, lock/tagged out, and met any other applicable safety requirements before any abatement work commences.

- A. When removing gaskets containing ACM, the following work practices must be followed:
- a. If a gasket is visibly deteriorated and unlikely to be removed intact, removal shall be undertaken within a glovebag as described in paragraph B. of this section (see below).
 - b. The gasket shall be immediately placed in a disposal container.
 - c. Any scraping to remove residue must be performed wet, followed by HEPA vacuuming.
 - d. The material shall be thoroughly wetted with amended water prior to and during its removal.
 - e. The material shall be removed in an intact state unless the employer demonstrates that intact removal is not possible.
 - f. Cutting, abrading or breaking the material shall be prohibited unless the employer can demonstrate that methods less likely to result in asbestos fiber release are not feasible.
 - g. Asbestos-containing material removed, shall be immediately bagged or wrapped, or kept wetted until transferred to a closed receptacle, no later than the end of the work shift.
- B. For gaskets which are visibly deteriorated and unlikely to be removed intact, removal shall be undertaken within a glovebag in accordance with the following:
- a. Glovebags shall be made of 6 mil thick plastic and shall be seamless at the bottom.
 - b. Glovebags used on elbows and other connections must be designed for that purpose and used without modifications.
 - e. Each glovebag shall be installed so that it completely covers the circumference of pipe or other structure where the work is to be done.
 - f. Glovebags shall be smoke-tested by the CPIH or competent person for leaks and any leaks sealed prior to use.
 - g. Glovebags may be used only once and may not be moved.
 - h. Glovebags shall not be used on surfaces whose temperature exceeds 150 deg.
 - i. Prior to disposal, glovebags shall be collapsed by removing air within them using a HEPA vacuum.
 - j. Before beginning the operation, loose and friable material adjacent to the glovebag/box operation shall be wrapped and sealed in two layers of six mil plastic or otherwise rendered intact.
 - k. Where system uses attached waste bag, such bag shall be connected to collection bag using hose or other material which shall withstand pressure of ACM waste and water without losing its integrity.
 - l. Sliding valve or other device shall separate waste bag from hose to ensure no exposure when waste bag is disconnected.
 - m. At least two persons shall perform glovebag removal operations.

3.3 DISPOSAL OF CLASS II WASTE MATERIAL

3.3.1 GENERAL

The VA must be notified at least 24 hours in advance of any waste removed from the containment. Dispose of waste ACM and debris which is packaged in accordance with these specifications, OSHA, EPA and DOT. The landfill requirements for packaging must also be met. Transport will be in compliance with 49 CFR 100–185 regulations. Disposal shall be done at an approved landfill. Disposal of non-friable ACM shall be done in accordance with applicable regulations.

All transport containers must be lined with one-layer of 6-mil poly, then covered and secured at all times when not in use. OSHA signs must be on containers during loading and unloading. Material

shall not be transported in open vehicles. If drums are used for packaging, the drums shall be labeled properly and shall not be re-used.

3.4 PROJECT DECONTAMINATION

3.4.1 GENERAL

- A. The entire work related to project decontamination shall be performed under the close supervision and monitoring of the CPIH/CIH.
- B. If the asbestos abatement work is in an area which was contaminated prior to the start of abatement, the decontamination will be done by cleaning the primary barrier poly prior to its removal and cleanings of the surfaces of the regulated area after the primary barrier removal.
- C. If the asbestos abatement work is in an area which was uncontaminated prior to the start of abatement, the decontamination will be done by cleaning the primary barrier poly prior to its removal, thus preventing contamination of the building when the regulated area critical barriers are removed.

3.4.2 REGULATED AREA CLEARANCE

Air testing and other requirements which must be met before release of the Contractor and re-occupancy of the regulated area space are specified in Final Testing Procedures.

3.4.3 WORK DESCRIPTION

Decontamination includes the clearance air testing in the regulated area and the decontamination and removal of the enclosures/facilities installed prior to the abatement work including primary/critical barriers, PDF and W/EDF facilities, and negative pressure systems.

3.4.4 PRE-DECONTAMINATION CONDITIONS

- A. Before decontamination starts, all ACM waste from the regulated area shall be removed, all waste collected and removed, and the secondary barrier of poly removal and disposed of along with any gross debris generated by the work.
- B. At the start of decontamination, the following shall be in place:
 - 1. Critical barriers over all openings consisting of two layers of 6 mil poly which is the sole barrier between the regulated area and the rest of the building or outside.
 - 2. Decontamination facilities, if required for personnel and equipment in operating condition.

3.4.5. CLEANING

Carry out a first cleaning of all surfaces of the regulated area including items of remaining poly sheeting, tools, scaffolding, ladders/staging by wet methods and/or HEPA vacuuming. Do not use dry dusting/sweeping/air blowing methods. Use each surface of a wetted cleaning cloth one time only and then dispose of as contaminated waste. Continue this cleaning until there is no visible residue from abated surfaces or poly or other surfaces. Remove all filters in the air handling system and dispose of as ACM waste in accordance with these specifications. The negative pressure system shall remain in operation during this time. Additional cleaning(s) may be needed as determined by the CPIH/VPIH/CIH.

3.5 VISUAL INSPECTION AND AIR CLEARANCE TESTING

3.5.1 GENERAL

Notify the VA representative 24 hours in advance for the performance of the final visual inspection and testing. The final visual inspection and testing will be performed by the VPIH/CIH after the cleaning.

3.5.2 VISUAL INSPECTION

Final visual inspection will include the entire regulated area, all poly sheeting, seals over HVAC openings, doorways, windows, and any other openings. If any debris, residue, dust or any other suspect material is detected, the cleaning shall be repeated at no cost to the VA. Dust/ material samples may be collected and analyzed at no cost to the VA at the discretion of the VPIH/CIH to confirm visual findings. When the regulated area is visually clean the final testing can be done.

3.5.3 AIR CLEARANCE TESTING

- A. After an acceptable final visual inspection by the VPIH/CIH and VA Representative, the VPIH/CIH may, at his or her discretion, perform final clearance testing. If collected, air samples will be collected and analyzed in accordance with procedures for AHERA in this specification. If work is less than 260 lf/160 sf/35 cf, 5 PCM samples shall be collected for clearance and a minimum of one field blank. If work is equal to or more than 260 lf/160 sf/35 cf, AHERA TEM sampling shall be performed for clearance. TEM analysis shall be done in accordance with procedures for EPA AHERA in this specification. If the release criteria are not met, the Contractor shall repeat the final cleaning and continue decontamination procedures until clearance is achieved. **All Additional inspection and testing costs will be borne by the Contractor.**
- B. If release criteria are met, proceed to perform the abatement closeout and to issue the certificate of completion in accordance with these specifications.

3.5.4 FINAL AIR CLEARANCE PROCEDURES

- A. Contractor's Release Criteria: Work in a regulated area is complete when the regulated area is visually clean and airborne fiber levels (if collected by the VA) have met applicable EPA AHERA thresholds.
- B. Air Monitoring and Final Clearance Sampling: To determine if the elevated airborne fiber counts encountered during abatement operations have been reduced to the specified level, the VPIH/CIH may, at his or her discretion, secure samples and analyze them according to the following procedures:
 1. Fibers Counted: "Fibers" referred to in this section shall be either all fibers regardless of composition as counted in the NIOSH 7400 PCM method.
 2. All final air testing samples shall be collected using aggressive sampling techniques except where soil is not encapsulated or enclosed. Samples will be collected on 0.8µ MCE filters for PCM analysis and 0.45µ Polycarbonate filters for TEM. A minimum of 1200 Liters of using calibrated pumps shall be collected for clearance samples. Before pumps are started, initiate aggressive air mixing sampling as detailed in 40 CFR 763 Subpart E (AHERA) Appendix A (III)(B)(7)(d). Air samples will be collected in areas subject to normal air circulation away from corners, obstructed locations, and locations near windows, doors, or vents. After air sampling pumps have been shut off, circulating fans shall be shut off. The negative pressure system shall continue to operate.

3.6 ABATEMENT CLOSEOUT AND CERTIFICATE OF COMPLIANCE

3.6.1 COMPLETION OF ABATEMENT WORK

- A. After thorough decontamination, complete asbestos abatement work upon meeting the regulated area clearance criteria and fulfilling the following:
 1. Remove all equipment, materials, and debris from the project area.
 2. Package and dispose of all asbestos waste as required.
 3. Repair or replace all interior finishes damaged during the abatement work.
 4. Fulfill other project closeout requirements as specified elsewhere in this specification.

3.6.2 CERTIFICATE OF COMPLETION BY CONTRACTOR

The CPIH shall complete and sign the "Certificate of Completion" in accordance with Attachment 1 at the completion of the abatement and decontamination of the regulated area.

3.6.3 WORK SHIFTS

All work shall be done during administrative hours (8:00 AM to 4:30 PM) Monday - Friday excluding Federal Holidays. Any change in the work schedule must be approved in writing by the VA Representative.

Workers will be provided with adequate washing and break area facilities located away from the containment site.

ATTACHMENT #1**CERTIFICATE OF COMPLETION**

DATE: _____ VA Project #: _____

PROJECT NAME: _____ Abatement Contractor: _____

VAMC/ADDRESS: _____

1. I certify that I have personally inspected, monitored and supervised the abatement work of (specify regulated area or Building):
which took place from / / to / /
2. That throughout the work all applicable requirements/regulations and the VA's specifications were met.
3. That any person who entered the regulated area was protected with the appropriate personal protective equipment and respirator and that they followed the proper entry and exit procedures and the proper operating procedures for the duration of the work.
4. That all employees of the Abatement Contractor engaged in this work were trained in respiratory protection, were experienced with abatement work, had proper medical surveillance documentation, were fit-tested for their respirator, and were not exposed at any time during the work to asbestos without the benefit of appropriate respiratory protection.
5. That I performed and supervised all inspection and testing specified and required by applicable regulations and VA specifications.
6. That the conditions inside the regulated area were always maintained in a safe and healthy condition and the maximum fiber count never exceeded 0.5 f/cc, except as described below.
7. That all abatement work was done in accordance with OSHA requirements and the manufacturer's recommendations.

CPIH/CIH Signature/Date: _____

CPIH/CIH Print Name: _____

Abatement Contractor Signature/Date: _____

Abatement Contractor Print Name: _____

**ATTACHMENT #2
CERTIFICATE OF WORKER'S ACKNOWLEDGMENT**

PROJECT NAME: _____ DATE: _____

PROJECT ADDRESS: _____

ABATEMENT CONTRACTOR'S NAME: _____

WORKING WITH ASBESTOS CAN BE HAZARDOUS TO YOUR HEALTH. INHALING ASBESTOS HAS BEEN LINKED WITH VARIOUS TYPES OF CANCERS. IF YOU SMOKE AND INHALE ASBESTOS FIBERS, YOUR CHANCES OF DEVELOPING LUNG CANCER IS GREATER THAN THAT OF THE NON-SMOKING PUBLIC.

Your employer's contract with the owner for the above project requires that: You must be supplied with the proper personal protective equipment including an adequate respirator and be trained in its use. You must be trained in safe and healthy work practices and in the use of the equipment found at an asbestos abatement project. You must receive/have a current medical examination for working with asbestos. These things shall be provided at no cost to you. By signing this certificate you are indicating to the owner that your employer has met these obligations.

RESPIRATORY PROTECTION: I have been trained in the proper use of respirators and have been informed of the type of respirator to be used on the above indicated project. I have a copy of the written Respiratory Protection Program issued by my employer. I have been provided for my exclusive use, at no cost, with a respirator to be used on the above indicated project.

TRAINING COURSE: I have been trained by a third party, State/EPA accredited trainer in the requirements for an AHERA/OSHA Asbestos Abatement Worker training course, 32 hours minimum duration. I currently have a valid State accreditation certificate. The topics covered in the course include, as a minimum, the following:

- Physical Characteristics and Background Information on Asbestos
- Potential Health Effects Related to Exposure to Asbestos
- Employee Personal Protective Equipment
- Establishment of a Respiratory Protection Program
- State of the Art Work Practices
- Personal Hygiene
- Additional Safety Hazards
- Medical Monitoring
- Air Monitoring
- Relevant Federal, State and Local Regulatory Requirements, Procedures, and Standards
- Asbestos Waste Disposal

MEDICAL EXAMINATION: I have had a medical examination within the past 12 months which was paid for by my employer. This examination included: health history, occupational history, pulmonary function test, and may have included a chest x-ray evaluation. The physician issued a positive written opinion after the examination.

Signature: _____

Printed Name: _____

Social Security Number: _____

Witness: _____

ATTACHMENT #3**AFFIDAVIT OF MEDICAL SURVEILLANCE, RESPIRATORY PROTECTION AND TRAINING/ACCREDITATION**

VA PROJECT NAME AND NUMBER: _____

VA MEDICAL FACILITY: _____

ABATEMENT CONTRACTOR'S NAME AND ADDRESS: _____

1. I verify that the following individual
Name: _____ Social Security Number: _____
who is proposed to be employed in asbestos abatement work associated with the above project by the named Abatement Contractor, is included in a medical surveillance program in accordance with 29 CFR 1926.1101(m), and that complete records of the medical surveillance program as required by 29 CFR 1926.1101(m)(n) and 29 CFR 1910.20 are kept at the offices of the Abatement Contractor at the following address.
Address: _____
2. I verify that this individual has been trained, fit-tested and instructed in the use of all appropriate respiratory protection systems and that the person is capable of working in safe and healthy manner as expected and required in the expected work environment of this project.
3. I verify that this individual has been trained as required by 29 CFR 1926.1101(k). This individual has also obtained a valid State accreditation certificate. Documentation will be kept on-site.
4. I verify that I meet the minimum qualifications criteria of the VA specifications for a CPIH.

Signature of CPIH/CIH: _____ Date: _____

Printed Name of CPIH/CIH: _____

Signature of Contractor: _____ Date: _____

Printed Name of Contractor: _____

ATTACHMENT #4**ABATEMENT CONTRACTOR/COMPETENT PERSON(S) REVIEW AND ACCEPTANCE OF THE VA'S ASBESTOS SPECIFICATIONS**

VA Project Location: _____

VA Project #: _____

VA Project Description: _____

This form shall be signed by the Asbestos Abatement Contractor Owner and the Asbestos Abatement Contractor's Competent Person(s) prior to any start of work at the VA related to this Specification. If the Asbestos Abatement Contractor's/Competent Person(s) has not signed this form, they shall not be allowed to work on-site.

I, the undersigned, have read VA's Asbestos Specification regarding the asbestos abatement requirements. I understand the requirements of the VA's Asbestos Specification and agree to follow these requirements as well as all required rules and regulations of OSHA/EPA/DOT and State/Local requirements. I have been given ample opportunity to read the VA's Asbestos Specification and have been given an opportunity to ask any questions regarding the content and have received a response related to those questions. I do not have any further questions regarding the content, intent and requirements of the VA's Asbestos Specification.

At the conclusion of the asbestos abatement, I will certify that all asbestos abatement work was done in accordance with the VA's Asbestos Specification and all ACM was removed properly and no fibrous residue remains on any abated surfaces.

Abatement Contractor Owner's Signature _____ Date _____

Abatement Contractor Competent Person(s) _____ Date _____

- - END SECTION 02 82 13.31 - -

**SECTION 05 50 00
METAL FABRICATIONS****PART 1 - GENERAL****1.1 DESCRIPTION**

- A. This section specifies items and assemblies fabricated from structural steel shapes and other materials as shown and specified.
- B. Items specified.
 - 1. Support for Wall and Ceiling Mounted Items: (12, 14A, 14C)

1.2 RELATED WORK

- A. Mechanical pipe supports: Section 22 05 11 COMMON WORK RESULTS FOR PLUMBING and 23 05 11 COMMON WORK RESULTS FOR HVAC.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings:
 - 1. Each item specified, showing complete detail, location in the project, material and size of components, method of joining various components and assemblies, finish, and location, size and type of anchors.
 - 2. Mark items requiring field assembly for erection identification and furnish erection drawings and instructions.
 - 3. Provide templates and rough-in measurements as required.
- C. Manufacturer's Certificates:
 - 1. Anodized finish as specified.
 - 2. Live load designs as specified.
- D. Design Calculations for specified live loads including dead loads.
- E. Furnish setting drawings and instructions for installation of anchors to be preset into concrete and masonry work, and for the positioning of items having anchors to be built into concrete or masonry construction.

1.4 QUALITY ASSURANCE

- A. Each manufactured product shall meet, as a minimum, the requirements specified, and shall be a standard commercial product of a manufacturer regularly presently manufacturing items of type specified.
- B. Each product type shall be the same and be made by the same manufacturer.
- C. Assembled product to the greatest extent possible before delivery to the site.
- D. Include additional features, which are not specifically prohibited by this specification, but which are a part of the manufacturer's standard commercial product.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):
- B18.6.1-97.....Wood Screws
- B18.2.2-87(R2005).....Square and Hex Nuts
- C. American Society for Testing and Materials (ASTM):
- A36/A36M-08Structural Steel
- A47-99(R2009).....Malleable Iron Castings
- A48-03(R2008).....Gray Iron Castings
- A53-10.....Pipe, Steel, Black and Hot-Dipped, Zinc-Coated Welded and
Seamless
- A123-09.....Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products
- A167-99(R2009).....Stainless and Heat-Resisting Chromium-Nickel Steel Plate,
Sheet and Strip
- A269-10.....Seamless and Welded Austenitic Stainless Steel Tubing for
General Service
- A307-10.....Carbon Steel Bolts and Studs, 60,000 PSI Tensile Strength
- A312/A312M-09Seamless, Welded, and Heavily Cold Worked Austenitic
Stainless Steel Pipes
- A391/A391M-07Grade 80 Alloy Steel Chain
- A653/A653M-10Steel Sheet, Zinc Coated (Galvanized) or Zinc-Iron Alloy Coated
(Galvannealed) by the Hot-Dip Process
- A786/A786M-09Rolled Steel Floor Plate
- B221-08.....Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire,
Shapes, and Tubes
- B456-03(R2009).....Electrodeposited Coatings of Copper Plus Nickel Plus Chromium
and Nickel Plus Chromium
- B632-08.....Aluminum-Alloy Rolled Tread Plate
- C1107-08.....Packaged Dry, Hydraulic-Cement Grout (Nonshrink)
- D3656-07.....Insect Screening and Louver Cloth Woven from Vinyl-Coated
Glass Yarns
- F436-10.....Hardened Steel Washers
- F468-10.....Nonferrous Bolts, Hex Cap Screws, and Studs for General Use
- F593-02(R2008).....Stainless Steel Bolts, Hex Cap Screws, and Studs
- F1667-11Driven Fasteners: Nails, Spikes and Staples
- D. American Welding Society (AWS):
- D1.1-10.....Structural Welding Code Steel

- D1.2-08.....Structural Welding Code Aluminum
- D1.3-08.....Structural Welding Code Sheet Steel
- E. National Association of Architectural Metal Manufacturers (NAAMM)
 - AMP 521-01Pipe Railing Manual
 - AMP 500-06Metal Finishes Manual
 - MBG 531-09.....Metal Bar Grating Manual
 - MBG 532-09.....Heavy Duty Metal Bar Grating Manual
- F. Structural Steel Painting Council (SSPC)/Society of Protective Coatings:
 - SP 1-04No. 1, Solvent Cleaning
 - SP 2-04No. 2, Hand Tool Cleaning
 - SP 3-04No. 3, Power Tool Cleaning
- G. Federal Specifications (Fed. Spec):
 - RR-T-650ETreads, Metallic and Nonmetallic, Nonskid

PART 2 - PRODUCTS

2.1 DESIGN CRITERIA

- A. In addition to the dead loads, design fabrications to support the following live loads unless otherwise specified.

2.2 MATERIALS

- A. Structural Steel: ASTM A36.
- B. Stainless Steel: ASTM A167, Type 302 or 304.
- C. Aluminum, Extruded: ASTM B221, Alloy 6063-T5 unless otherwise specified. For structural shapes use alloy 6061-T6 and alloy 6061-T4511.
- D. Steel Pipe: ASTM A53.
 - 1. Galvanized for exterior locations.
 - 2. Type S, Grade A unless specified otherwise.
 - 3. NPS (inside diameter) as shown.
- E. Cast-Iron: ASTM A48, Class 30, commercial pattern.
- F. Malleable Iron Castings: A47.
- G. Stainless Steel Tubing: ASTM A269, type 302 or 304.
- H. Modular Channel Units:
 - 1. Factory fabricated, channel shaped, cold formed sheet steel shapes, complete with fittings bolts and nuts required for assembly.
 - 2. Form channel with in turned pyramid shaped clamping ridges on each side.
 - 3. Provide case hardened steel nuts with serrated grooves in the top edges designed to be inserted in the channel at any point and be given a quarter turn so as to engage the channel clamping ridges. Provide each nut with a spring designed to hold the nut in place.

4. Factory finish channels and parts with oven baked primer when exposed to view. Channels fabricated of ASTM A525, G90 galvanized steel may have primer omitted in concealed locations. Finish screws and nuts with zinc coating.
5. Fabricate snap-in closure plates to fit and close exposed channel openings of not more than 0.3 mm (0.0125 inch) thick stainless steel.

I. Grout: ASTM C1107, pourable type.

2.3 HARDWARE

A. Rough Hardware:

1. Furnish rough hardware with a standard plating, applied after punching, forming and assembly of parts; galvanized, cadmium plated, or zinc-coated by electro-galvanizing process. Galvanized G-90 where specified.
2. Use G90 galvanized coating on ferrous metal for exterior work unless non-ferrous metal or stainless is used.

B. Fasteners:

1. Bolts with Nuts:
 - a. ASME B18.2.2.
 - b. ASTM A307 for 415 MPa (60,000 psi) tensile strength bolts.
 - c. ASTM F468 for nonferrous bolts.
 - d. ASTM F593 for stainless steel.
2. Screws: ASME B18.6.1.
3. Washers: ASTM F436, type to suit material and anchorage.
4. Nails: ASTM F1667, Type I, style 6 or 14 for finish work.

2.4 FABRICATION GENERAL

A. Material

1. Use material as specified. Use material of commercial quality and suitable for intended purpose for material that is not named or its standard of quality not specified.
2. Use material free of defects which could affect the appearance or service ability of the finished product.

B. Size:

1. Size and thickness of members as shown.
2. When size and thickness is not specified or shown for an individual part, use size and thickness not less than that used for the same component on similar standard commercial items or in accordance with established shop methods.

C. Connections

1. Except as otherwise specified, connections may be made by welding, riveting or bolting.
2. Field riveting will not be approved.
3. Design size, number and placement of fasteners, to develop a joint strength of not less than the design value.

4. Holes, for rivets and bolts: Accurately punched or drilled and burrs removed.
 5. Size and shape welds to develop the full design strength of the parts connected by welds and to transmit imposed stresses without permanent deformation or failure when subject to service loadings.
 6. Use Rivets and bolts of material selected to prevent corrosion (electrolysis) at bimetallic contacts. Plated or coated material will not be approved.
 7. Use stainless steel connectors for removable members machine screws or bolts.
- D. Fasteners and Anchors
1. Use methods for fastening or anchoring metal fabrications to building construction as shown or specified.
 2. Where fasteners and anchors are not shown, design the type, size, location and spacing to resist the loads imposed without deformation of the members or causing failure of the anchor or fastener, and suit the sequence of installation.
 3. Use material and finish of the fasteners compatible with the kinds of materials which are fastened together and their location in the finished work.
 4. Fasteners for securing metal fabrications to new construction only, may be by use of threaded or wedge type inserts or by anchors for welding to the metal fabrication for installation before the concrete is placed or as masonry is laid.
 5. Fasteners for securing metal fabrication to existing construction or new construction may be expansion bolts, toggle bolts, power actuated drive pins, welding, self drilling and tapping screws or bolts.
- E. Workmanship
1. General:
 - a. Fabricate items to design shown.
 - b. Furnish members in longest lengths commercially available within the limits shown and specified.
 - c. Fabricate straight, true, free from warp and twist, and where applicable square and in same plane.
 - d. Provide holes, sinkages and reinforcement shown and required for fasteners and anchorage items.
 - e. Provide openings, cut-outs, and tapped holes for attachment and clearances required for work of other trades.
 - f. Prepare members for the installation and fitting of hardware.
 - g. Cut openings in gratings and floor plates for the passage of ducts, sumps, pipes, conduits and similar items. Provide reinforcement to support cut edges.
 - h. Fabricate surfaces and edges free from sharp edges, burrs and projections which may cause injury.
 2. Welding:

- a. Weld in accordance with AWS.
 - b. Welds shall show good fusion, be free from cracks and porosity and accomplish secure and rigid joints in proper alignment.
 - c. Where exposed in the finished work, continuous weld for the full length of the members joined and have depressed areas filled and protruding welds finished smooth and flush with adjacent surfaces.
 - d. Finish welded joints to match finish of adjacent surface.
3. Joining:
 - a. Miter or butt members at corners.
 - b. Where frames members are butted at corners, cut leg of frame member perpendicular to surface, as required for clearance.
4. Anchors:
 - a. Where metal fabrications are shown to be preset in concrete, weld 32 x 3 mm (1-1/4 by 1/8 inch) steel strap anchors, 150 mm (6 inches) long with 25 mm (one inch) hooked end, to back of member at 600 mm (2 feet) on center, unless otherwise shown.
 - b. Where metal fabrications are shown to be built into masonry use 32 x 3 mm (1-1/4 by 1/8 inch) steel strap anchors, 250 mm (10 inches) long with 50 mm (2 inch) hooked end, welded to back of member at 600 mm (2 feet) on center, unless otherwise shown.
5. Cutting and Fitting:
 - a. Accurately cut, machine and fit joints, corners, copes, and miters.
 - b. Fit removable members to be easily removed.
 - c. Design and construct field connections in the most practical place for appearance and ease of installation.
 - d. Fit pieces together as required.
 - e. Fabricate connections for ease of assembly and disassembly without use of special tools.
 - f. Joints firm when assembled.
 - g. Conceal joining, fitting and welding on exposed work as far as practical.
 - h. Do not show rivets and screws prominently on the exposed face.
 - i. The fit of components and the alignment of holes shall eliminate the need to modify component or to use exceptional force in the assembly of item and eliminate the need to use other than common tools.
- F. Finish:
 1. Finish exposed surfaces in accordance with NAAMM Metal Finishes Manual.
 2. Steel and Iron: NAAMM AMP 504.
 - a. Zinc coated (Galvanized): ASTM A123, G90 unless noted otherwise.
 - b. Surfaces exposed in the finished work:
 - 1) Finish smooth rough surfaces and remove projections.

- 2) Fill holes, dents and similar voids and depressions with epoxy type patching compound.
- c. Shop Prime Painting:
 - 1) Surfaces of Ferrous metal:
 - a) Items not specified to have other coatings.
 - b) Galvanized surfaces specified to have prime paint.
 - c) Remove all loose mill scale, rust, and paint, by hand or power tool cleaning as defined in SSPC-SP2 and SP3.
 - d) Clean of oil, grease, soil and other detrimental matter by use of solvents or cleaning compounds as defined in SSPC-SP1.
 - e) After cleaning and finishing apply one coat of primer.
 - 2) Non ferrous metals: Comply with MAAMM-500 series.
- G. Protection:
 1. Insulate aluminum surfaces that will come in contact with concrete, masonry, plaster, or metals other than stainless steel, zinc or white bronze by giving a coat of heavy-bodied alkali resisting bituminous paint or other approved paint in shop.
 2. Spot prime all abraded and damaged areas of zinc coating which expose the bare metal, using zinc rich paint on hot-dip zinc coat items and zinc dust primer on all other zinc coated items.

2.5 SUPPORTS

- A. General:
 1. Fabricate ASTM A36 structural steel shapes as shown.
 2. Use clip angles or make provisions for welding hangers and braces to overhead construction.
 3. Field connections may be welded or bolted.
- B. For Wall Mounted Items:
 1. For items supported by metal stud partitions.
 2. Steel strip or hat channel minimum of 1.5 mm (0.0598 inch) thick.
 3. Steel strip minimum of 150 mm (6 inches) wide, length extending one stud space beyond end of item supported.
 4. Steel hat channels where shown. Flange cut and flatted for anchorage to stud.
 5. Structural steel tube or channel for grab bar at water closets floor to structure above with clip angles or end plates formed for anchors.
 6. Use steel angles for thru wall counters. Drill angle for fasteners at ends and not over 100 mm (4 inches) on center between ends.

2.6 GUARDS

- A. Edge Guard Angles for Openings in slabs.
 1. Fabricate from steel angles of sizes and with anchorage shown.

2. Where size of angle is not shown, provide 50 x 50 x 6 mm (2 x 2 x 1/4 inch) steel angle with 32 x 5 mm (1-1/4 x 3/16 inch) strap anchors, welded to back.
3. Miter or butt angles at corners and weld.
4. Use one anchor near end and three feet on centers between end anchors.

PART 3 - EXECUTION

3.1 INSTALLATION, GENERAL

- A. Set work accurately, in alignment and where shown, plumb, level, free of rack and twist, and set parallel or perpendicular as required to line and plane of surface.
- B. Items set into concrete or masonry.
 1. Provide temporary bracing for such items until concrete or masonry is set.
 2. Place in accordance with setting drawings and instructions.
 3. Build strap anchors, into masonry as work progresses.
- C. Field weld in accordance with AWS.
 1. Design and finish as specified for shop welding.
 2. Use continuous weld unless specified otherwise.
- D. Install anchoring devices and fasteners as shown and as necessary for securing metal fabrications to building construction as specified. Power actuated drive pins may be used except for removable items and where members would be deformed or substrate damaged by their use.
- E. Spot prime all abraded and damaged areas of zinc coating as specified and all abraded and damaged areas of shop prime coat with same kind of paint used for shop priming.
- F. Isolate aluminum from dissimilar metals and from contact with concrete and masonry materials as required to prevent electrolysis and corrosion.
- G. Secure escutcheon plate with set screw.

3.2 INSTALLATION OF SUPPORTS

- A. Anchorage to structure.
 1. Secure angles or channels and clips to overhead structural steel by continuous welding unless bolting is shown.
 2. Secure supports to concrete inserts by bolting or continuous welding as shown.
 3. Secure supports to mid height of concrete beams when inserts do not exist with expansion bolts and to slabs, with expansion bolts. unless shown otherwise.
 4. Secure steel plate or hat channels to studs as detailed.
- B. Supports for Wall Mounted items:
 1. Locate center of support at anchorage point of supported item.
 2. Locate support at top and bottom of wall hung cabinets.
 3. Locate support at top of floor cabinets and shelving installed against walls.
 4. Locate supports where required for items shown.

3.3 GUARDS**A. Steel Angle Corner Guards:**

1. At existing construction fasten angle and filler piece to adjoining construction with 16 mm (5/8 inch) diameter by 75 mm (3 inch) long expansion bolts 450 mm (18 inches) on center.
2. Install Guard Angles at Edges of Openings in Slab .

3.4 STEEL COMPONENTS FOR MILLWORK ITEMS

Coordinate and deliver to Millwork fabricator for assembly where millwork items are secured to metal fabrications.

3.5 CLEAN AND ADJUSTING

- A. Adjust movable parts including hardware to operate as designed without binding or deformation of the members centered in the opening or frame and, where applicable, contact surfaces fit tight and even without forcing or warping the components.
- B. Clean after installation exposed prefinished and plated items and items fabricated from stainless steel, aluminum and copper alloys, as recommended by the metal manufacture and protected from damage until completion of the project.

--- E N D ---

**SECTION 07 84 00
FIRESTOPPING****PART 1 GENERAL****1.1 DESCRIPTION**

- A. Closures of openings in walls, floors, and roof decks against penetration of flame, heat, and smoke or gases in fire resistant rated construction.
- B. Closure of openings in walls against penetration of gases or smoke in smoke partitions.

1.2 RELATED WORK

- A. Sealants and application: Section 07 92 00, JOINT SEALANTS.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturers literature, data, and installation instructions for types of firestopping and smoke stopping used.
- C. List of FM, UL, or WH classification number of systems installed.
- D. Certified laboratory test reports for ASTM E814 tests for systems not listed by FM, UL, or WH proposed for use.

1.4 DELIVERY AND STORAGE

- A. Deliver materials in their original unopened containers with manufacturer's name and product identification.
- B. Store in a location providing protection from damage and exposure to the elements.

1.5 WARRANTY

Firestopping work subject to the terms of the Article "Warranty of Construction", FAR clause 52.246-21, except extend the warranty period to five years.

1.6 QUALITY ASSURANCE

FM, UL, or WH or other approved laboratory tested products will be acceptable.

1.7 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - E84-10.....Surface Burning Characteristics of Building Materials
 - E814-11.....Fire Tests of Through-Penetration Fire Stops
- C. Factory Mutual Engineering and Research Corporation (FM):
 - Annual Issue Approval Guide Building Materials
- D. Underwriters Laboratories, Inc. (UL):
 - Annual Issue Building Materials Directory
 - Annual Issue Fire Resistance Directory

1479-10 Fire Tests of Through-Penetration Firestops

E. Warnock Hersey (WH):

Annual Issue Certification Listings

PART 2 - PRODUCTS

2.1 FIRESTOP SYSTEMS

- A. Use either factory built (Firestop Devices) or field erected (through-Penetration Firestop Systems) to form a specific building system maintaining required integrity of the fire barrier and stop the passage of gases or smoke.
- B. Through-penetration firestop systems and firestop devices tested in accordance with ASTM E814 or UL 1479 using the "F" or "T" rating to maintain the same rating and integrity as the fire barrier being sealed. "T" ratings are not required for penetrations smaller than or equal to 100 mm (4 in) nominal pipe or 0.01 m² (16 sq. in.) in overall cross sectional area.
- C. Products requiring heat activation to seal an opening by its intumescence shall exhibit a demonstrated ability to function as designed to maintain the fire barrier.
- D. Firestop sealants used for firestopping or smoke sealing shall have following properties:
 - 1. Contain no flammable or toxic solvents.
 - 2. Have no dangerous or flammable out gassing during the drying or curing of products.
 - 3. Water-resistant after drying or curing and unaffected by high humidity, condensation or transient water exposure.
 - 4. When used in exposed areas, shall be capable of being sanded and finished with similar surface treatments as used on the surrounding wall or floor surface.
- E. Firestopping system or devices used for penetrations by glass pipe, plastic pipe or conduits, unenclosed cables, or other non-metallic materials shall have following properties:
 - 1. Classified for use with the particular type of penetrating material used.
 - 2. Penetrations containing loose electrical cables, computer data cables, and communications cables protected using firestopping systems that allow unrestricted cable changes without damage to the seal.
 - 3. Intumescent products which would expand to seal the opening and act as fire, smoke, toxic fumes, and, water sealant.
- F. Maximum flame spread of 25 and smoke development of 50 when tested in accordance with ASTM E84.
- G. FM, UL, or WH rated or tested by an approved laboratory in accordance with ASTM E814.
- H. Materials to be asbestos free.

2.2 SMOKE STOPPING IN SMOKE PARTITIONS

- A. Use silicone sealant in smoke partitions as specified in Section 07 92 00, JOINT SEALANTS.
- B. Use mineral fiber filler and bond breaker behind sealant.

- C. Sealants shall have a maximum flame spread of 25 and smoke developed of 50 when tested in accordance with E84.
- D. When used in exposed areas capable of being sanded and finished with similar surface treatments as used on the surrounding wall or floor surface.

PART 3 - EXECUTION

3.1 EXAMINATION

Submit product data and installation instructions, as required by article, submittals, after an on site examination of areas to receive firestopping.

3.2 PREPARATION

- A. Remove dirt, grease, oil, loose materials, or other substances that prevent adherence and bonding or application of the firestopping or smoke stopping materials.
- B. Remove insulation on insulated pipe for a distance of 150 mm (six inches) on either side of the fire rated assembly prior to applying the firestopping materials unless the firestopping materials are tested and approved for use on insulated pipes.

3.3 INSTALLATION

- A. Do not begin work until the specified material data and installation instructions of the proposed firestopping systems have been submitted and approved.
- B. Install firestopping systems with smoke stopping in accordance with FM, UL, WH, or other approved system details and installation instructions.
- C. Install smoke stopping seals in smoke partitions.

3.4 CLEAN-UP AND ACCEPTANCE OF WORK

- A. As work on each floor is completed, remove materials, litter, and debris.
- B. Do not move materials and equipment to the next-scheduled work area until completed work is inspected and accepted by the COTR.
- C. Clean up spills of liquid type materials.

- - - E N D - - -

**SECTION 07 92 00
JOINT SEALANTS****PART 1 - GENERAL****1.1 DESCRIPTION:**

Section covers all sealant and caulking materials and their application, wherever required for complete installation of building materials or systems.

1.2 RELATED WORK:

- A. Firestopping penetrations: Section 07 84 00, FIRESTOPPING.
- B. Mechanical Work: Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

1.3 QUALITY CONTROL:

- A. Installer Qualifications: An experienced installer who has specialized in installing joint sealants similar in material, design, and extent to those indicated for this Project and whose work has resulted in joint-sealant installations with a record of successful in-service performance.
- B. Source Limitations: Obtain each type of joint sealant through one source from a single manufacturer.
- C. Product Testing: Obtain test results from a qualified testing agency based on testing current sealant formulations within a 12-month period.
 - 1. Testing Agency Qualifications: An independent testing agency qualified according to ASTM C1021.
 - 2. Test elastomeric joint sealants for compliance with requirements specified by reference to ASTM C920, and where applicable, to other standard test methods.
 - 3. Test elastomeric joint sealants according to SWRI's Sealant Validation Program for compliance with requirements specified by reference to ASTM C920 for adhesion and cohesion under cyclic movement, adhesion-in peel, and indentation hardness.
 - 4. Test other joint sealants for compliance with requirements indicated by referencing standard specifications and test methods.
- D. Preconstruction Field-Adhesion Testing: Before installing elastomeric sealants, field test their adhesion to joint substrates in accordance with sealant manufacturer's recommendations:
 - 1. Locate test joints where indicated or, if not indicated, as directed by Contracting Officer.
 - 2. Conduct field tests for each application indicated below:
 - a. Each type of elastomeric sealant and joint substrate indicated.
 - b. Each type of non-elastomeric sealant and joint substrate indicated.
 - 3. Notify COTR seven days in advance of dates and times when test joints will be erected.
 - 4. Arrange for tests to take place with joint sealant manufacturer's technical representative present.
- E. VOC: Acrylic latex and Silicon sealants shall have less than 50g/l VOC content.

1.4 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's installation instructions for each product used.
- C. Manufacturer's Literature and Data:
 - 1. Caulking compound
 - 2. Primers
 - 3. Sealing compound, each type, including compatibility when different sealants are in contact with each other.

1.5 PROJECT CONDITIONS:

- A. Environmental Limitations:
 - 1. Do not proceed with installation of joint sealants under following conditions:
 - a. When ambient and substrate temperature conditions are outside limits permitted by joint sealant manufacturer or are below 4.4 °C (40 °F).
 - b. When joint substrates are wet.
- B. Joint-Width Conditions:
 - 1. Do not proceed with installation of joint sealants where joint widths are less than those allowed by joint sealant manufacturer for applications indicated.
- C. Joint-Substrate Conditions:
 - 1. Do not proceed with installation of joint sealants until contaminants capable of interfering with adhesion are removed from joint substrates.

1.6 DELIVERY, HANDLING, AND STORAGE:

- A. Deliver materials in manufacturers' original unopened containers, with brand names, date of manufacture, shelf life, and material designation clearly marked thereon.
- B. Carefully handle and store to prevent inclusion of foreign materials.
- C. Do not subject to sustained temperatures exceeding 32° C (90° F) or less than 5° C (40° F).

1.7 DEFINITIONS:

- A. Definitions of terms in accordance with ASTM C717 and as specified.
- B. Back-up Rod: A type of sealant backing.
- C. Bond Breakers: A type of sealant backing.
- D. Filler: A sealant backing used behind a back-up rod.

1.8 WARRANTY:

- A. Warranty exterior sealing against leaks, adhesion, and cohesive failure, and subject to terms of "Warranty of Construction", FAR clause 52.246-21, except that warranty period shall be extended to two years.
- B. General Warranty: Special warranty specified in this Article shall not deprive Government of other rights Government may have under other provisions of Contract Documents and shall be in

addition to, and run concurrent with, other warranties made by Contractor under requirements of Contract Documents.

1.9 APPLICABLE PUBLICATIONS:

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - C509-06.....Elastomeric Cellular Preformed Gasket and Sealing Material.
 - C612-10.....Mineral Fiber Block and Board Thermal Insulation.
 - C717-10.....Standard Terminology of Building Seals and Sealants.
 - C834-10.....Latex Sealants.
 - C919-08.....Use of Sealants in Acoustical Applications.
 - C920-10.....Elastomeric Joint Sealants.
 - C1021-08.....Laboratories Engaged in Testing of Building Sealants.
 - C1193-09.....Standard Guide for Use of Joint Sealants.
 - C1330-02 (R2007).....Cylindrical Sealant Backing for Use with Cold Liquid Applied Sealants.
 - D1056-07.....Specification for Flexible Cellular Materials—Sponge or Expanded Rubber.
 - E84-09.....Surface Burning Characteristics of Building Materials.
- C. Sealant, Waterproofing and Restoration Institute (SWRI).
 - The Professionals' Guide

PART 2 - PRODUCTS

2.1 SEALANTS:

- A. S-1:
 - 1. ASTM C920, polyurethane or polysulfide.
 - 2. Type M.
 - 3. Class 25.
 - 4. Grade NS.
 - 5. Shore A hardness of 20-40
- B. S-2:
 - 1. ASTM C920, polyurethane or polysulfide.
 - 2. Type M.
 - 3. Class 25.
 - 4. Grade P.
 - 5. Shore A hardness of 25-40.
- C. S-3:
 - 1. ASTM C920, polyurethane or polysulfide.

2. Type S.
 3. Class 25, joint movement range of plus or minus 50 percent.
 4. Grade NS.
 5. Shore A hardness of 15-25.
 6. Minimum elongation of 700 percent.
- D. S-4:
1. ASTM C920 polyurethane or polysulfide.
 2. Type S.
 3. Class 25.
 4. Grade NS.
 5. Shore A hardness of 25-40.
- E. S-5:
1. ASTM C920, polyurethane or polysulfide.
 2. Type S.
 3. Class 25.
 4. Grade P.
 5. Shore hardness of 15-45.
- F. S-6:
1. ASTM C920, silicone, neutral cure.
 2. Type S.
 3. Class: Joint movement range of plus 100 percent to minus 50 percent.
 4. Grade NS.
 5. Shore A hardness of 15-20.
 6. Minimum elongation of 1200 percent.
- G. S-7:
1. ASTM C920, silicone, neutral cure.
 2. Type S.
 3. Class 25.
 4. Grade NS.
 5. Shore A hardness of 25-30.
 6. Structural glazing application.
- H. S-8:
1. ASTM C920, silicone, acetoxycure.
 2. Type S.
 3. Class 25.
 4. Grade NS.
 5. Shore A hardness of 25-30.
 6. Structural glazing application.

- I. S-9:
 - 1. ASTM C920 silicone.
 - 2. Type S.
 - 3. Class 25.
 - 4. Grade NS.
 - 5. Shore A hardness of 25-30.
 - 6. Non-yellowing, mildew resistant.
- J. S-10:
 - 1. ASTM C920, coal tar extended fuel resistance polyurethane.
 - 2. Type M/S.
 - 3. Class 25.
 - 4. Grade P/NS.
 - 5. Shore A hardness of 15-20.
- K. S-11:
 - 1. ASTM C920 polyurethane.
 - 2. Type M/S.
 - 3. Class 25.
 - 4. Grade P/NS.
 - 5. Shore A hardness of 35 to 50.
- L. S-12:
 - 1. ASTM C920, polyurethane.
 - 2. Type M/S.
 - 3. Class 25, joint movement range of plus or minus 50 percent.
 - 4. Grade P/NS.
 - 5. Shore A hardness of 25 to 50.

2.2 CAULKING COMPOUND:

- A. C-1: ASTM C834, acrylic latex.
- B. C-2: One component acoustical caulking, non drying, non hardening, synthetic rubber.

2.3 COLOR:

- A. Sealants used with exposed masonry shall match color of mortar joints.
- B. Sealants used with unpainted concrete shall match color of adjacent concrete.
- C. Color of sealants for other locations shall be light gray or aluminum, unless specified otherwise.
- D. Caulking shall be light gray or white, unless specified otherwise.

2.4 JOINT SEALANT BACKING:

- A. General: Provide sealant backings of material and type that are nonstaining; are compatible with joint substrates, sealants, primers, and other joint fillers; and are approved for applications indicated by sealant manufacturer based on field experience and laboratory testing.

- B. Cylindrical Sealant Backings: ASTM C1330, of type indicated below and of size and density to control sealant depth and otherwise contribute to producing optimum sealant performance:
 - 1. Type C: Closed-cell material with a surface skin.
- C. Elastomeric Tubing Sealant Backings: Neoprene, butyl, EPDM, or silicone tubing complying with ASTM D1056, nonabsorbent to water and gas, and capable of remaining resilient at temperatures down to minus 32° C (minus 26° F). Provide products with low compression set and of size and shape to provide a secondary seal, to control sealant depth, and otherwise contribute to optimum sealant performance.
- D. Bond-Breaker Tape: Polyethylene tape or other plastic tape recommended by sealant manufacturer for preventing sealant from adhering to rigid, inflexible joint-filler materials or joint surfaces at back of joint where such adhesion would result in sealant failure. Provide self-adhesive tape where applicable.

2.5 FILLER:

- A. Mineral fiber board: ASTM C612, Class 1.
- B. Thickness same as joint width.
- C. Depth to fill void completely behind back-up rod.

2.6 PRIMER:

- A. As recommended by manufacturer of caulking or sealant material.
- B. Stain free type.

2.7 CLEANERS-NON POURIOUS SURFACES:

Chemical cleaners acceptable to manufacturer of sealants and sealant backing material, free of oily residues and other substances capable of staining or harming joint substrates and adjacent non-porous surfaces and formulated to promote adhesion of sealant and substrates.

PART 3 - EXECUTION**3.1 INSPECTION:**

- A. Inspect substrate surface for bond breaker contamination and unsound materials at adherent faces of sealant.
- B. Coordinate for repair and resolution of unsound substrate materials.
- C. Inspect for uniform joint widths and that dimensions are within tolerance established by sealant manufacturer.

3.2 PREPARATIONS:

- A. Prepare joints in accordance with manufacturer's instructions and SWRI.
- B. Clean surfaces of joint to receive caulking or sealants leaving joint dry to the touch, free from frost, moisture, grease, oil, wax, lacquer paint, or other foreign matter that would tend to destroy or impair adhesion.

1. Clean porous joint substrate surfaces by brushing, grinding, blast cleaning, mechanical abrading, or a combination of these methods to produce a clean, sound substrate capable of developing optimum bond with joint sealants.
 2. Remove loose particles remaining from above cleaning operations by vacuuming or blowing out joints with oil-free compressed air. Porous joint surfaces include the following:
 - a. Concrete.
 - b. Masonry.
 - c. Unglazed surfaces of ceramic tile.
 3. Remove laitance and form-release agents from concrete.
 4. Clean nonporous surfaces with chemical cleaners or other means that do not stain, harm substrates, or leave residues capable of interfering with adhesion of joint sealants.
 - a. Metal.
 - b. Glass.
 - c. Porcelain enamel.
 - d. Glazed surfaces of ceramic tile.
- C. Do not cut or damage joint edges.
- D. Apply masking tape to face of surfaces adjacent to joints before applying primers, caulking, or sealing compounds.
1. Do not leave gaps between ends of sealant backings.
 2. Do not stretch, twist, puncture, or tear sealant backings.
 3. Remove absorbent sealant backings that have become wet before sealant application and replace them with dry materials.
- E. Apply primer to sides of joints wherever required by compound manufacturer's printed instructions.
1. Apply primer prior to installation of back-up rod or bond breaker tape.
 2. Use brush or other approved means that will reach all parts of joints.
- F. Take all necessary steps to prevent three sided adhesion of sealants.

3.3 BACKING INSTALLATION:

- A. Install back-up material, to form joints enclosed on three sides as required for specified depth of sealant.
- B. Where deep joints occur, install filler to fill space behind the back-up rod and position the rod at proper depth.
- C. Cut fillers installed by others to proper depth for installation of back-up rod and sealants.
- D. Install back-up rod, without puncturing the material, to a uniform depth, within plus or minus 3 mm (1/8 inch) for sealant depths specified.
- E. Where space for back-up rod does not exist, install bond breaker tape strip at bottom (or back) of joint so sealant bonds only to two opposing surfaces.
- F. Take all necessary steps to prevent three sided adhesion of sealants.

3.4 SEALANT DEPTHS AND GEOMETRY:

- A. At widths up to 6 mm (1/4 inch), sealant depth equal to width.
- B. At widths over 6 mm (1/4 inch), sealant depth 1/2 of width up to 13 mm (1/2 inch) maximum depth at center of joint with sealant thickness at center of joint approximately 1/2 of depth at adhesion surface.

3.5 INSTALLATION:

- A. General:
 - 1. Apply sealants and caulking only when ambient temperature is between 5° C and 38° C (40° and 100° F).
 - 2. Do not use polysulfide base sealants where sealant may be exposed to fumes from bituminous materials, or where water vapor in continuous contact with cementitious materials may be present.
 - 3. Do not use sealant type listed by manufacture as not suitable for use in locations specified.
 - 4. Apply caulking and sealing compound in accordance with manufacturer's printed instructions.
 - 5. Avoid dropping or smearing compound on adjacent surfaces.
 - 6. Fill joints solidly with compound and finish compound smooth.
 - 7. Tool joints to concave surface unless shown or specified otherwise.
 - 8. Finish paving or floor joints flush unless joint is otherwise detailed.
 - 9. Apply compounds with nozzle size to fit joint width.
 - 10. Test sealants for compatibility with each other and substrate. Use only compatible sealant.
- B. For application of sealants, follow requirements of ASTM C1193 unless specified otherwise.
- C. Where gypsum board partitions are of sound rated, fire rated, or smoke barrier construction, follow requirements of ASTM C919 only to seal all cut-outs and intersections with the adjoining construction unless specified otherwise.
 - 1. Apply a 6 mm (1/4 inch) minimum bead of sealant each side of runners (tracks), including those used at partition intersections with dissimilar wall construction.
 - 2. Coordinate with application of gypsum board to install sealant immediately prior to application of gypsum board.
 - 3. Partition intersections: Seal edges of face layer of gypsum board abutting intersecting partitions, before taping and finishing or application of veneer plaster-joint reinforcing.
 - 4. Openings: Apply a 6 mm (1/4 inch) bead of sealant around all cut-outs to seal openings of electrical boxes, ducts, pipes and similar penetrations. To seal electrical boxes, seal sides and backs.
 - 5. Control Joints: Before control joints are installed, apply sealant in back of control joint to reduce flanking path for sound through control joint.

3.6 FIELD QUALITY CONTROL:

- A. Field-Adhesion Testing: Field-test joint-sealant adhesion to joint substrates as recommended by sealant manufacturer:
 - 1. Extent of Testing: Test completed elastomeric sealant joints as follows:
 - a. Perform 10 tests for first 300 m (1000 feet) of joint length for each type of elastomeric sealant and joint substrate.
 - b. Perform one test for each 300 m (1000 feet) of joint length thereafter or one test per each floor per elevation.
- B. Inspect joints for complete fill, for absence of voids, and for joint configuration complying with specified requirements.
- C. Inspect tested joints and report on following:
 - 1. Whether sealants in joints connected to pulled-out portion failed to adhere to joint substrates or tore cohesively. Include data on pull distance used to test each type of product and joint substrate.
 - 2. Compare these results to determine if adhesion passes sealant manufacturer's field-adhesion hand-pull test criteria.
 - 3. Whether sealants filled joint cavities and are free from voids.
 - 4. Whether sealant dimensions and configurations comply with specified requirements.

3.7 CLEANING:

- A. Fresh compound accidentally smeared on adjoining surfaces: Scrape off immediately and rub clean with a solvent as recommended by the caulking or sealant manufacturer.
- B. After filling and finishing joints, remove masking tape.
- C. Leave adjacent surfaces in a clean and unstained condition.

3.8 LOCATIONS:

- A. Exterior Building Joints, Horizontal and Vertical:
 - 1. Metal to Metal: Type S-1, S-2
 - 2. Metal to Masonry or Stone: Type S-1
 - 3. Masonry to Masonry or Stone: Type S-1
 - 4. Stone to Stone: Type S-1
 - 5. Cast Stone to Cast Stone: Type S-1
 - 6. Threshold Setting Bed: Type S-1, S-3, S-4
 - 7. Masonry Expansion and Control Joints: Type S-6
 - 8. Wood to Masonry: Type S-1
- B. Metal Reglets and Flashings:
 - 1. Flashings to Wall: Type S-6
 - 2. Metal to Metal: Type S-6
- C. Sanitary Joints:

1. Walls to Plumbing Fixtures: Type S-9
2. Counter Tops to Walls: Type S-9
3. Pipe Penetrations: Type S-9
- D. High Temperature Joints over 204 degrees C (400 degrees F):
 1. Exhaust Pipes, Flues, Breech Stacks: Type S-7 or S-8
- E. Interior Caulking:
 1. Typical Narrow Joint 6 mm, (1/4 inch) or less at Walls and Adjacent Components: Types C-1 and C-2.
 2. Perimeter of Doors, Windows, Access Panels which Adjoin Concrete or Masonry Surfaces: Types C-1 and C-2.
 3. Joints at Masonry Walls and Columns, Piers, Concrete Walls or Exterior Walls: Types C-1 and C-2.
 4. Perimeter of Lead Faced Control Windows and Plaster or Gypsum Wallboard Walls: Types C-1 and C-2.
 5. Exposed Isolation Joints at Top of Full Height Walls: Types C-1 and C-2.
 6. Exposed Acoustical Joint at Sound Rated Partitions Type C-2.
 7. Concealed Acoustic Sealant Types S-4, C-1 and C-2.

--- E N D ---

**SECTION 22 05 11
COMMON WORK RESULTS FOR PLUMBING****PART 1 - GENERAL****1.1 DESCRIPTION**

- A. The requirements of this Section shall apply to all sections of Division 22.
- B. Definitions:
 - 1. Exposed: Piping and equipment exposed to view in finished rooms.
 - 2. Option or optional: Contractor's choice of an alternate material or method.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 07 84 00, FIRESTOPPING.
- D. Section 07 92 00, JOINT SEALANTS.
- E. Section 22 07 11, PLUMBING INSULATION.

1.3 QUALITY ASSURANCE

- A. Products Criteria:
 - 1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture of the products for at least 3 years. However, digital electronics devices, software and systems such as controls, instruments, computer work station, shall be the current generation of technology and basic design that has a proven satisfactory service record of at least three years.
 - 2. Equipment Service: There shall be permanent service organizations, authorized and trained by manufacturers of the equipment supplied, located within 160 km (100 miles) of the project. These organizations shall come to the site and provide acceptable service to restore operations within four hours of receipt of notification by phone, e-mail or fax in event of an emergency, such as the shut-down of equipment; or within 24 hours in a non-emergency. Names, mail and e-mail addresses and phone numbers of service organizations providing service under these conditions for (as applicable to the project): pumps, critical instrumentation, computer workstation and programming shall be submitted for project record and inserted into the operations and maintenance manual.
 - 3. All items furnished shall be free from defects that would adversely affect the performance, maintainability and appearance of individual components and overall assembly.
 - 4. The products and execution of work specified in Division 22 shall conform to the referenced codes and standards as required by the specifications. Local codes and amendments enforced by the local code official shall be enforced, if required by local authorities such as the natural gas supplier. If the local codes are more stringent, then the local code shall apply.

- Any conflicts shall be brought to the attention of the Contracting Officers Technical Representative (COTR).
5. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be products of one manufacturer.
 6. Assembled Units: Manufacturers of equipment assemblies, which use components made by others, assume complete responsibility for the final assembled product.
 7. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
 8. Asbestos products or equipment or materials containing asbestos shall not be used.
- B. Welding: Before any welding is performed, contractor shall submit a certificate certifying that welders comply with the following requirements:
1. Qualify welding processes and operators for piping according to ASME "Boiler and Pressure Vessel Code", Section IX, "Welding and Brazing Qualifications".
 2. Comply with provisions of ASME B31 series "Code for Pressure Piping".
 3. Certify that each welder has passed American Welding Society (AWS) qualification tests for the welding processes involved, and that certification is current.
 4. All welds shall be stamped according to the provisions of the American Welding Society.
- C. Manufacturer's Recommendations: Where installation procedures or any part thereof are required to be in accordance with the recommendations of the manufacturer of the material being installed, printed copies of these recommendations shall be furnished to the COTR prior to installation. Installation of the item will not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations can be cause for rejection of the material.
- D. Execution (Installation, Construction) Quality:
1. All items shall be applied and installed in accordance with manufacturer's written instructions. Conflicts between the manufacturer's instructions and the contract drawings and specifications shall be referred to the COTR for resolution. Written hard copies or computer files of manufacturer's installation instructions shall be provided to the COTR at least two weeks prior to commencing installation of any item.
 2. Complete layout drawings shall be required by Paragraph, SUBMITTALS. Construction work shall not start on any system until the layout drawings have been approved.
- E. Guaranty: Warranty of Construction, FAR clause 52.246-21.
- F. Plumbing Systems: IPC, International Plumbing Code, latest edition.

1.4 SUBMITTALS

- A. Submittals shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.

- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 05 11, COMMON WORK RESULTS FOR PLUMBING", with applicable paragraph identification.
- C. Contractor shall make all necessary field measurements and investigations to assure that the equipment and assemblies will meet contract requirements.
- D. If equipment is submitted which differs in arrangement from that shown, provide drawings that show the rearrangement of all associated systems. Approval will be given only if all features of the equipment and associated systems, including accessibility, are equivalent to that required by the contract.
- E. Prior to submitting shop drawings for approval, contractor shall certify in writing that manufacturers of all major items of equipment have each reviewed drawings and specifications, and have jointly coordinated and properly integrated their equipment and controls to provide a complete and efficient installation.
- F. Upon request by Government, lists of previous installations for selected items of equipment shall be provided. Contact persons who will serve as references, with telephone numbers and e-mail addresses shall be submitted with the references.
- G. Manufacturer's Literature and Data: Manufacturer's literature shall be submitted under the pertinent section rather than under this section.
 - 1. Equipment and materials identification.
 - 2. Fire stopping materials.
 - 3. Hangers, inserts, supports and bracing. Provide load calculations for variable spring and constant support hangers.
 - 4. Wall, floor, and ceiling plates.
- H. Coordination Drawings: Complete consolidated and coordinated layout drawings shall be submitted for all new systems, and for existing systems that are in the same areas. The drawings shall include plan views, elevations and sections of all systems and shall be on a scale of not less than 1:32 (3/8 inch equal to one foot). Clearly identify and dimension the proposed locations of the principal items of equipment. The drawings shall clearly show the proposed location and adequate clearance for all equipment, piping, pumps, valves and other items. All valves, trap primer valves, water hammer arrestors, strainers, and equipment requiring service shall be provided with an access door sized for the complete removal of plumbing device, component, or equipment. Equipment foundations shall not be installed until equipment or piping until layout drawings have been approved. Detailed layout drawings shall be provided for all piping systems. In addition, details of the following shall be provided.
 - 1. Mechanical equipment rooms.
 - 2. Hangers, inserts, supports, and bracing.
 - 3. Pipe sleeves.
 - 4. Equipment penetrations of floors, walls, ceilings, or roofs.

- I. Maintenance Data and Operating Instructions:
 - 1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment.
 - 2. Listing of recommended replacement parts for keeping in stock supply, including sources of supply, for equipment shall be provided.
 - 3. The listing shall include belts for equipment: Belt manufacturer, model number, size and style, and distinguished whether of multiple belt sets.

1.5 DELIVERY, STORAGE AND HANDLING

- A. Protection of Equipment:
 - 1. Equipment and material placed on the job site shall remain in the custody of the Contractor until phased acceptance, whether or not the Government has reimbursed the Contractor for the equipment and material. The Contractor is solely responsible for the protection of such equipment and material against any damage.
 - 2. Damaged equipment shall be replaced with an identical unit as determined and directed by the COTR. Such replacement shall be at no additional cost to the Government.
 - 3. Interiors of new equipment and piping systems shall be protected against entry of foreign matter. Both inside and outside shall be cleaned before painting or placing equipment in operation.
 - 4. Existing equipment and piping being worked on by the Contractor shall be under the custody and responsibility of the Contractor and shall be protected as required for new work.
- B. Cleanliness of Piping and Equipment Systems:
 - 1. Care shall be exercised in the storage and handling of equipment and piping material to be incorporated in the work. Debris arising from cutting, threading and welding of piping shall be removed.
 - 2. Piping systems shall be flushed, blown or pigged as necessary to deliver clean systems.
 - 3. The interior of all tanks shall be cleaned prior to delivery and beneficial use by the Government. All piping shall be tested in accordance with the specifications and the International Plumbing Code (IPC), latest edition. All filters, strainers, fixture faucets shall be flushed of debris prior to final acceptance.
 - 4. Contractor shall be fully responsible for all costs, damage, and delay arising from failure to provide clean systems.

1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below shall form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):
 - Boiler and Pressure Vessel Code (BPVC):
 - SEC IX-2007Boiler and Pressure Vessel Code; Section IX, Welding and Brazing Qualifications.

- C. American Society for Testing and Materials (ASTM):
A36/A36M-2008Standard Specification for Carbon Structural Steel
A575-96 (R 2007)Standard Specification for Steel Bars, Carbon, Merchant Quality,
M-Grades R (2002)
E84-2005Standard Test Method for Surface Burning Characteristics of
Building Materials
E119-2008aStandard Test Methods for Fire Tests of Building Construction
and Materials
- D. Manufacturers Standardization Society (MSS) of the Valve and Fittings Industry, Inc:
SP-58-02Pipe Hangers and Supports-Materials, Design and Manufacture
SP 69-2003 (R 2004)Pipe Hangers and Supports-Selection and Application
- E. National Electrical Manufacturers Association (NEMA):
MG1-2003, Rev. 1-2007Motors and Generators
- F. International Code Council, (ICC):
IBC-06, (R 2007)International Building Code
IPC-06, (R 2007)International Plumbing Code

PART 2 - PRODUCTS

2.1 FACTORY-ASSEMBLED PRODUCTS

- A. Standardization of components shall be maximized to reduce spare part requirements.
- B. Manufacturers of equipment assemblies that include components made by others shall assume complete responsibility for final assembled unit.
1. All components of an assembled unit need not be products of same manufacturer.
 2. Constituent parts that are alike shall be products of a single manufacturer.
 3. Components shall be compatible with each other and with the total assembly for intended service.
 4. Contractor shall guarantee performance of assemblies of components, and shall repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly.
- C. Components of equipment shall bear manufacturer's name and trademark, model number, serial number and performance data on a name plate securely affixed in a conspicuous place, or cast integral with, stamped or otherwise permanently marked upon the components of the equipment.
- D. Major items of equipment, which serve the same function, shall be the same make and model

2.2 COMPATIBILITY OF RELATED EQUIPMENT

- A. Equipment and materials installed shall be compatible in all respects with other items being furnished and with existing items so that the result will be a complete and fully operational system that conforms to contract requirements.

2.3 SAFETY GUARDS

- A. Pump shafts and couplings shall be fully guarded by a sheet steel guard, covering coupling and shaft but not bearings. Material shall be minimum 16-gage sheet steel; ends shall be braked and drilled and attached to pump base with minimum of four 6 mm (1/4 inch) bolts. Reinforce guard as necessary to prevent side play forcing guard onto couplings.
- B. All Equipment shall have moving parts protected from personal injury.

2.4 LIFTING ATTACHMENTS

Equipment shall be provided with suitable lifting attachments to enable equipment to be lifted in its normal position. Lifting attachments shall withstand any handling conditions that might be encountered, without bending or distortion of shape, such as rapid lowering and braking of load.

2.5 ELECTRIC MOTORS, MOTOR CONTROL, CONTROL WIRING

- A. All material and equipment furnished and installation methods shall conform to the requirements of Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT; Section 26 29 11, MOTOR CONTROLLERS; and, Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). All electrical wiring, conduit, and devices necessary for the proper connection, protection and operation of the systems shall be provided. Premium efficient motors shall be provided. Unless otherwise specified for a particular application, electric motors shall have the following requirements.
- B. Special Requirements:
 - 1. Where motor power requirements of equipment furnished deviate from power shown on plans, provide electrical service designed under the requirements of NFPA 70 without additional time or cost to the Government.
 - 2. Assemblies of motors, starters, and controls and interlocks on factory assembled and wired devices shall be in accordance with the requirements of this specification.
 - 3. Wire and cable materials specified in the electrical division of the specifications shall be modified as follows:
 - a. Wiring material located where temperatures can exceed 71 degree C (160 degree F) shall be stranded copper with Teflon FEP insulation with jacket. This includes wiring on the boilers.
 - b. Other wiring at boilers and to control panels shall be NFPA 70 designation THWN.
 - c. Shielded conductors or wiring in separate conduits for all instrumentation and control systems shall be provided where recommended by manufacturer of equipment.
 - 4. Motor sizes shall be selected so that the motors do not operate into the service factor at maximum required loads on the driven equipment. Motors on pumps shall be sized for non-overloading at all points on the pump performance curves.
- C. Motor Efficiency and Power Factor: All motors, when specified as "high efficiency or Premium Efficiency" by the project specifications on driven equipment, shall conform to efficiency and

power factor requirements in Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT, with no consideration of annual service hours. Motor manufacturers generally define these efficiency requirements as "NEMA premium efficient" and the requirements generally exceed those of the Energy Policy Act of 1992 (EPACT). Motors not specified as "high efficiency or premium efficient" shall comply with EPACT.

- D. Single-phase Motors: Capacitor-start type for hard starting applications. Motors for centrifugal fans and pumps may be split phase or permanent split capacitor (PSC).
- E. Poly-phase Motors: NEMA Design B, Squirrel cage, induction type. Each two-speed motor shall have two separate windings. A time delay (20 seconds minimum) relay shall be provided for switching from high to low speed.
- F. Rating: Rating shall be continuous duty at 100 percent capacity in an ambient temperature of 40 degree C (104 degree F); minimum horsepower as shown on drawings; maximum horsepower in normal operation shall not exceed nameplate rating without service factor.
- G. Insulation Resistance: Not less than one-half meg-ohm between stator conductors and frame shall be measured at the time of final inspection.

2.6 EQUIPMENT AND MATERIALS IDENTIFICATION

- A. Use symbols, nomenclature and equipment numbers specified, shown on the drawings, or shown in the maintenance manuals. Identification for piping is specified in Section 23 05 11, Paragraph 3.7.
- B. Interior (Indoor) Equipment: Engraved nameplates, with letters not less than 48 mm (3/16 inch) high of brass with black-filled letters, or rigid black plastic with white letters shall be permanently fastened to the equipment. Unit components such as water heaters, tanks, filters, etc. shall be identified.
- C. Control Items: All temperature, pressure, and controllers shall be labeled and the component's function identified. Identify and label each item as they appear on the control diagrams.
- D. Valve Tags and Lists:
 - 1. Plumbing: All valves shall be provided with valve tags and listed on a valve list (Fixture stops not included).
 - 2. Valve tags: Engraved black filled numbers and letters not less than 13 mm (1/2 inch) high for number designation, and not less than 6.4 mm (1/4 inch) for service designation on 19 gage, 38 mm (1 1/2 inches) round brass disc, attached with brass "S" hook or brass chain.
 - 3. Valve lists: Valve lists shall be created using a word processing program and printed on plastic coated cards. The plastic coated valve list card(s), sized 216 mm (8 1/2 inches) by 280 mm (11 inches) shall show valve tag number, valve function and area of control for each service or system. The valve list shall be in a punched 3-ring binder notebook. A copy of the valve list shall be mounted in picture frames for mounting to a wall.

4. A detailed plan for each floor of the building indicating the location and valve number for each valve shall be provided. Each valve location shall be identified with a color coded sticker or thumb tack in ceiling.

2.7 FIRE STOPPING

- A. Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping. Refer to Section 22 07 11, PLUMBING INSULATION, for pipe insulation.

2.8 GALVANIZED REPAIR COMPOUND

- A. Mil. Spec. DOD-P-21035B, paint.

2.9 PIPE AND EQUIPMENT SUPPORTS AND RESTRAINTS

- A. In lieu of the paragraph which follows, suspended equipment support and restraints may be designed and installed in accordance with the International Building Code (IBC), latest edition. Submittals based on the International Building Code (IBC), latest edition, or the following paragraphs of this Section shall be stamped and signed by a professional engineer registered in a state where the project is located. The Support system of suspended equipment over 227 kg (500 pounds) shall be submitted for approval of the COTR in all cases. See these specifications for lateral force design requirements.
- B. For Attachment to Concrete Construction:
 1. Concrete insert: Type 18, MSS SP-58.
 2. Self-drilling expansion shields and machine bolt expansion anchors: Permitted in concrete not less than 102 mm (4 inches) thick when approved by the COTR for each job condition.
 3. Power-driven fasteners: Permitted in existing concrete or masonry not less than 102 mm (4 inches) thick when approved by the COTR for each job condition.
- C. For Attachment to Steel Construction: MSS SP-58.
 1. Welded attachment: Type 22.
 2. Beam clamps: Types 20, 21, 28 or 29. Type 23 C-clamp may be used for individual copper tubing up to 23 mm (7/8 inch) outside diameter.
- D. Hanger Rods: Hot-rolled steel, ASTM A36 or A575 for allowable load listed in MSS SP-58. For piping, provide adjustment means for controlling level or slope. Types 13 or 15 turn-buckles shall provide 38 mm (1 1/2 inches) minimum of adjustment and incorporate locknuts. All-thread rods are acceptable.
- E. Multiple (Trapeze) Hangers: Galvanized, cold formed, lipped steel channel horizontal member, not less than 41 mm by 41 mm (1 5/8 inches by 1 5/8 inches), 2.7 mm (No. 12 gage), designed to accept special spring held, hardened steel nuts. Trapeze hangers are not permitted for steam supply and condensate piping.
 1. Allowable hanger load: Manufacturers rating less 91kg (200 pounds).

2. Guide individual pipes on the horizontal member of every other trapeze hanger with 6 mm (1/4 inch) U-bolt fabricated from steel rod. Provide Type 40 insulation shield, secured by two 13 mm (1/2 inch) galvanized steel bands, or insulated calcium silicate shield for insulated piping at each hanger.
- F. Pipe Hangers and Supports: (MSS SP-58), use hangers sized to encircle insulation on insulated piping. Refer to Section 22 07 11, PLUMBING INSULATION for insulation thickness. To protect insulation, provide Type 39 saddles for roller type supports or insulated calcium silicate shields. Provide Type 40 insulation shield or insulated calcium silicate shield at all other types of supports and hangers including those for insulated piping.
1. General Types (MSS SP-58):
 - a. Standard clevis hanger: Type 1; provide locknut.
 - b. Riser clamps: Type 8.
 - c. Wall brackets: Types 31, 32 or 33.
 - d. Roller supports: Type 41, 43, 44 and 46.
 - e. Saddle support: Type 36, 37 or 38.
 - f. Turnbuckle: Types 13 or 15.
 - g. U-bolt clamp: Type 24.
 - h. Copper Tube:
 - 1) Hangers, clamps and other support material in contact with tubing shall be painted with copper colored epoxy paint, plastic coated or taped with isolation tape to prevent electrolysis.
 - 2) For vertical runs use epoxy painted or plastic coated riser clamps.
 - 3) For supporting tube to strut: Provide epoxy painted pipe straps for copper tube or plastic inserted vibration isolation clamps.
 - 4) Insulated Lines: Provide pre-insulated calcium silicate shields sized for copper tube.
 - i. Supports for plastic or glass piping: As recommended by the pipe manufacturer with black rubber tape extending one inch beyond steel support or clamp. Spring Supports (Expansion and contraction of vertical piping):
 - 1) Movement up to 20 mm (3/4 inch): Type 51 or 52 variable spring unit with integral turn buckle and load indicator.
 - 2) Movement more than 20 mm (3/4 inch): Type 54 or 55 constant support unit with integral adjusting nut, turn buckle and travel position indicator.
 - j. Spring hangers are required on all plumbing system pumps one horsepower and greater.
 2. Plumbing Piping (Other Than General Types):
 - a. Horizontal piping: Type 1, 5, 7, 9, and 10.
 - b. Chrome plated piping: Chrome plated supports.

- c. Hangers and supports in pipe chase: Prefabricated system ABS self-extinguishing material, not subject to electrolytic action, to hold piping, prevent vibration and compensate for all static and operational conditions.
 - d. Blocking, stays and bracing: Angle iron or preformed metal channel shapes, 1.3 mm (18 gage) minimum.
- G. Pre-insulated Calcium Silicate Shields:
- 1. Provide 360 degree water resistant high density 965 kPa (140 psi) compressive strength calcium silicate shields encased in galvanized metal.
 - 2. Pre-insulated calcium silicate shields to be installed at the point of support during erection.
 - 3. Shield thickness shall match the pipe insulation.
 - 4. The type of shield is selected by the temperature of the pipe, the load it must carry, and the type of support it will be used with.
 - a. Shields for supporting cold water shall have insulation that extends a minimum of one inch past the sheet metal.
 - b. The insulated calcium silicate shield shall support the maximum allowable water filled span as indicated in MSS-SP 69. To support the load, the shields shall have one or more of the following features: structural inserts 4138 kPa (600 psi) compressive strength, an extra bottom metal shield, or formed structural steel (ASTM A36) wear plates welded to the bottom sheet metal jacket.
 - 5. Shields may be used on steel clevis hanger type supports, roller supports or flat surfaces.

2.10 PIPE PENETRATIONS

- A. Pipe penetration sleeves shall be installed for all pipe other than rectangular blocked out floor openings for risers in mechanical bays.
- B. Pipe penetration sleeve materials shall comply with all fire stopping requirements for each penetration.
- C. To prevent accidental liquid spills from passing to a lower level, provide the following:
 - 1. For sleeves: Extend sleeve 25 mm (1 inch) above finished floor and provide sealant for watertight joint.
 - 2. For blocked out floor openings: Provide 40 mm (1 1/2 inch) angle set in silicone adhesive around opening.
 - 3. For drilled penetrations: Provide 40 mm (1 1/2 inch) angle ring or square set in silicone adhesive around penetration.
- D. Penetrations are not allowed through beams or ribs, but may be installed in concrete beam flanges. Any deviation from these requirements must receive prior approval of COTR.
- E. Sheet metal, plastic, or moisture resistant fiber sleeves shall be provided for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.

- F. Cast iron or zinc coated pipe sleeves shall be provided for pipe passing through exterior walls below grade. The space between the sleeve and pipe shall be made watertight with a modular or link rubber seal. The link seal shall be applied at both ends of the sleeve.
- G. Galvanized steel or an alternate black iron pipe with asphalt coating sleeves shall be for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. A galvanized steel Sleeve shall be provided for pipe passing through floor of mechanical rooms, laundry work rooms, and animal rooms above basement. Except in mechanical rooms, sleeves shall be connected with a floor plate.
- H. Brass Pipe Sleeves shall be provided for pipe passing through quarry tile, terrazzo or ceramic tile floors. The sleeve shall be connected with a floor plate.
- I. Sleeve clearance through floors, walls, partitions, and beam flanges shall be 25 mm (1 inch) greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation plus 25 mm (1 inch) in diameter. Interior openings shall be caulked tight with fire stopping material and sealant to prevent the spread of fire, smoke, and gases.
- J. Sealant and Adhesives: Shall be as specified in Section 07 92 00, JOINT SEALANTS.

2.11 TOOLS AND LUBRICANTS

- A. Furnish, and turn over to the COTR, special tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.
- B. Grease Guns with Attachments for Applicable Fittings: One for each type of grease required for each motor or other equipment.
- C. Tool Containers: metal, permanently identified for intended service and mounted, or located, where directed by the COTR.
- D. Lubricants: A minimum of 0.95 L (1 quart) of oil, and 0.45 kg (1 pound) of grease, of equipment manufacturer's recommended grade and type, in unopened containers and properly identified as to use for each different application.

2.12 WALL, FLOOR AND CEILING PLATES

- A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.
- B. Thickness: Not less than 2.4 mm (3/32 inch) for floor plates. For wall and ceiling plates, not less than 0.64 mm (0.025 inch) for up to 80 mm (3 inch) pipe, 0.89 mm (0.035 inch) for larger pipe.
- C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Wall plates shall be used where insulation ends on exposed water supply pipe drop from overhead. A watertight joint shall be provided in spaces where brass or steel pipe sleeves are specified.

2.13 ASBESTOS

Materials containing asbestos are not permitted.

PART 3 - EXECUTION**3.1 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING**

- A. Location of piping, sleeves, inserts, hangers, and equipment, access provisions shall be coordinated with the work of all trades. Piping, sleeves, inserts, hangers, and equipment shall be located clear of windows, doors, openings, light outlets, and other services and utilities. Equipment layout drawings shall be prepared to coordinate proper location and personnel access of all facilities. The drawings shall be submitted for review. Manufacturer's published recommendations shall be followed for installation methods not otherwise specified.
- B. Operating Personnel Access and Observation Provisions: All equipment and systems shall be arranged to provide clear view and easy access, without use of portable ladders, for maintenance and operation of all devices including, but not limited to: all equipment items, valves, filters, strainers, transmitters, sensors, control devices. All gages and indicators shall be clearly visible by personnel standing on the floor or on permanent platforms. Maintenance and operating space and access provisions that are shown on the drawings shall not be changed nor reduced.
- C. Structural systems necessary for pipe and equipment support shall be coordinated to permit proper installation.
- D. Location of pipe sleeves, trenches and chases shall be accurately coordinated with equipment and piping locations.
- E. Cutting Holes:
 - 1. Holes through concrete and masonry shall be cut by rotary core drill. Pneumatic hammer, impact electric, and hand or manual hammer type drill will not be allowed, except as permitted by COTR where working area space is limited.
 - 2. Holes shall be located to avoid interference with structural members such as beams or grade beams. Holes shall be laid out in advance and drilling done only after approval by COTR. If the Contractor considers it necessary to drill through structural members, this matter shall be referred to COTR for approval.
 - 3. Waterproof membrane shall not be penetrated. Pipe floor penetration block outs shall be provided outside the extents of the waterproof membrane.
- F. Interconnection of Instrumentation or Control Devices: Generally, electrical and pneumatic interconnections are not shown but must be provided.
- G. Minor Piping: Generally, small diameter pipe runs from drips and drains, water cooling, and other service are not shown but must be provided.
- H. Protection and Cleaning:

1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the COTR. Damaged or defective items in the opinion of the COTR, shall be replaced.
 2. Protect all finished parts of equipment, such as shafts and bearings where accessible, from rust prior to operation by means of protective grease coating and wrapping. Close pipe openings with caps or plugs during installation. Pipe openings, equipment, and plumbing fixtures shall be tightly covered against dirt or mechanical injury. At completion of all work thoroughly clean fixtures, exposed materials and equipment.
- I. Concrete and Grout: Concrete and shrink compensating grout 25 MPa (3000 psi) minimum, shall be used for all pad or floor mounted equipment. Gages, thermometers, valves and other devices shall be installed with due regard for ease in reading or operating and maintaining said devices. Thermometers and gages shall be located and positioned to be easily read by operator or staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.
- J. Interconnection of Controls and Instruments: Electrical interconnection is generally not shown but shall be provided. This includes interconnections of sensors, transmitters, transducers, control devices, control and instrumentation panels, instruments and computer workstations. Comply with NFPA-70.
- K. Many plumbing systems interface with the HVAC control system. See the HVAC control points list and Section 23 09 23 DIRECT DIGITAL CONTROLS FOR HVAC.
- L. Work in Existing Building:
1. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).
 2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will cause the least interfere with normal operation of the facility.
- M. Work in Animal Research Areas: Seal all pipe penetrations with silicone sealant to prevent entrance of insects.
- N. Work in bathrooms, restrooms, housekeeping closets: All pipe penetrations behind escutcheons shall be sealed with plumbers putty.
- O. Switchgear Drip Protection: Every effort shall be made to eliminate the installation of pipe above electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints.

P. Inaccessible Equipment:

1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost to the Government.
2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as electrical conduit, motors, fans, pumps, belt guards, transformers, high voltage lines, piping, and ductwork.

3.2 TEMPORARY PIPING AND EQUIPMENT

- A. Continuity of operation of existing facilities may require temporary installation or relocation of equipment and piping. Temporary equipment or pipe installation or relocation shall be provided to maintain continuity of operation of existing facilities.
- B. The Contractor shall provide all required facilities in accordance with the requirements of phased construction and maintenance of service. All piping and equipment shall be properly supported, sloped to drain, operate without excessive stress, and shall be insulated where injury can occur to personnel by contact with operating facilities. The requirements of Para. 3.1 shall apply.
- C. Temporary facilities and piping shall be completely removed and any openings in structures sealed. Necessary blind flanges and caps shall be provided to seal open piping remaining in service.

3.3 RIGGING

- A. Openings in building structures shall be planned to accommodate design scheme.
- B. Alternative methods of equipment delivery may be offered and will be considered by Government under specified restrictions of phasing and service requirements as well as structural integrity of the building.
- C. All openings in the building shall be closed when not required for rigging operations to maintain proper environment in the facility for Government operation and maintenance of service.
- D. Contractor shall provide all facilities required to deliver specified equipment and place on foundations. Attachments to structures for rigging purposes and support of equipment on structures shall be Contractor's full responsibility.
- E. Contractor shall check all clearances, weight limitations and shall provide a rigging plan designed by a Registered Professional Engineer. All modifications to structures, including reinforcement thereof, shall be at Contractor's cost, time and responsibility.
- F. Rigging plan and methods shall be referred to COTR for evaluation prior to actual work.

3.4 PIPE AND EQUIPMENT SUPPORTS

- A. Where hanger spacing does not correspond with joist or rib spacing, use structural steel channels secured directly to joist and rib structure that will correspond to the required hanger spacing, and then suspend the equipment and piping from the channels. Holes shall be drilled or burned in structural steel ONLY with the prior written approval of the COTR.

- B. The use of chain pipe supports, wire or strap hangers; wood for blocking, stays and bracing, or hangers suspended from piping above shall not be permitted. Rusty products shall be replaced.
- C. Hanger rods shall be used that are straight and vertical. Turnbuckles for vertical adjustments may be omitted where limited space prevents use. A minimum of 15 mm (1/2 inch) clearance between pipe or piping covering and adjacent work shall be provided.
- D. For horizontal and vertical plumbing pipe supports, refer to the International Plumbing Code (IPC), latest edition, and these specifications.
- E. Overhead Supports:
 - 1. The basic structural system of the building is designed to sustain the loads imposed by equipment and piping to be supported overhead.
 - 2. Provide steel structural members, in addition to those shown, of adequate capability to support the imposed loads, located in accordance with the final approved layout of equipment and piping.
 - 3. Tubing and capillary systems shall be supported in channel troughs.
- F. Floor Supports:
 - 1. Provide concrete bases, concrete anchor blocks and pedestals, and structural steel systems for support of equipment and piping. Concrete bases and structural systems shall be anchored and doweled to resist forces under operating and seismic conditions (if applicable) without excessive displacement or structural failure.
 - 2. Bases and supports shall not be located and installed until equipment mounted thereon has been approved. Bases shall be sized to match equipment mounted thereon plus 50 mm (2 inch) excess on all edges. Structural drawings shall be reviewed for additional requirements. Bases shall be neatly finished and smoothed, shall have chamfered edges at the top, and shall be suitable for painting.
 - 3. All equipment shall be shimmed, leveled, firmly anchored, and grouted with epoxy grout. Anchor bolts shall be placed in sleeves, anchored to the bases. Fill the annular space between sleeves and bolts with a grout material to permit alignment and realignment.

3.5 LUBRICATION

- A. All equipment and devices requiring lubrication shall be lubricated prior to initial operation. All devices and equipment shall be field checked for proper lubrication.
- B. All devices and equipment shall be equipped with required lubrication fittings. A minimum of one liter (one quart) of oil and 0.5 kg (one pound) of grease of manufacturer's recommended grade and type for each different application shall be provided. All materials shall be delivered to COTR in unopened containers that are properly identified as to application.
- C. A separate grease gun with attachments for applicable fittings shall be provided for each type of grease applied.
- D. All lubrication points shall be accessible without disassembling equipment, except to remove access plates.

- E. All lubrication points shall be extended to one side of the equipment.

3.6 PLUMBING SYSTEMS DEMOLITION

- A. Rigging access, other than indicated on the drawings, shall be provided after approval for structural integrity by the COTR. Such access shall be provided without additional cost or time to the Government. Where work is in an operating plant, approved protection from dust and debris shall be provided at all times for the safety of plant personnel and maintenance of plant operation and environment of the plant.
- B. Unless specified otherwise, all piping, wiring, conduit, and other devices associated with the equipment not re-used in the new work shall be completely removed from Government property. This includes all concrete equipment pads, pipe, valves, fittings, insulation, and all hangers including the top connection and any fastenings to building structural systems. All openings shall be sealed after removal of equipment, pipes, ducts, and other penetrations in roof, walls, floors, in an approved manner and in accordance with plans and specifications where specifically covered. Structural integrity of the building system shall be maintained. Reference shall also be made to the drawings and specifications of the other disciplines in the project for additional facilities to be demolished or handled.
- C. All valves including ball and check, all pressure gages and thermometers with wells shall remain Government property and shall be removed and delivered to COTR and stored as directed. The Contractor shall remove all other material and equipment, devices and demolition debris under these plans and specifications. Such material shall be removed from Government property expeditiously and shall not be allowed to accumulate.

3.7 CLEANING AND PAINTING

- A. Prior to final inspection and acceptance of the plant and facilities for beneficial use by the Government, the plant facilities, equipment and systems shall be thoroughly cleaned and painted.
- B. In addition, the following special conditions apply:
1. Cleaning shall be thorough. Solvents, cleaning materials and methods recommended by the manufacturers shall be used for the specific tasks. All rust shall be removed prior to painting and from surfaces to remain unpainted. Scratches, scuffs, and abrasions shall be repaired prior to applying prime and finish coats.
 2. The following Material And Equipment shall NOT be painted::
 - a. Motors, controllers, control switches, and safety switches.
 - b. Control and interlock devices.
 - c. Regulators.
 - d. Pressure reducing valves.
 - e. Control valves and thermostatic elements.
 - f. Lubrication devices and grease fittings.
 - g. Copper, brass, aluminum, stainless steel and bronze surfaces.
 - h. Valve stems and rotating shafts.

- i. Pressure gages and thermometers.
 - j. Glass.
 - k. Name plates.
- 3. Control and instrument panels shall be cleaned and damaged surfaces repaired. Touch-up painting shall be made with matching paint obtained from manufacturer or computer matched.
 - 4. Pumps, motors, steel and cast iron bases, and coupling guards shall be cleaned, and shall be touched-up with the same color as utilized by the pump manufacturer
 - 5. Temporary Facilities: Apply paint to surfaces that do not have existing finish coats.
 - 6. The final result shall be a smooth, even-colored, even-textured factory finish on all items. The entire piece of equipment shall be repainted, if necessary, to achieve this.

3.8 IDENTIFICATION SIGNS

- A. Laminated plastic signs, with engraved lettering not less than 5 mm (3/16 inch) high, shall be provided that designates equipment function, for all equipment, switches, motor controllers, relays, meters, control devices, including automatic control valves. Nomenclature and identification symbols shall correspond to that used in maintenance manual, and in diagrams specified elsewhere. Attach by chain, adhesive, or screws.
- B. Factory Built Equipment: Metal plate, securely attached, with name and address of manufacturer, serial number, model number, size, performance shall be placed on factory built equipment.
- C. Pipe Identification: Refer to Section 23 05 11, Paragraph 3.7.

3.9 STARTUP AND TEMPORARY OPERATION

- A. Start up of equipment shall be performed as described in the equipment specifications. Vibration within specified tolerance shall be verified prior to extended operation. Temporary use of equipment is specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT.

3.10 OPERATING AND PERFORMANCE TESTS

- A. Prior to the final inspection, all required tests shall be performed as specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TESTS and submit the test reports and records to the COTR.
- B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.
- C. When completion of certain work or system occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then make performance tests such systems respectively during first actual seasonal use of respective systems following completion of work.

3.11 OPERATION AND MAINTENANCE MANUALS

- A. Provide four bound copies. The Operations and maintenance manuals shall be delivered to COTR not less than 30 days prior to completion of a phase or final inspection.
- B. All new and temporary equipment and all elements of each assembly shall be included.
- C. Data sheet on each device listing model, size, capacity, pressure, speed, horsepower, impeller size, and other information shall be included.
- D. Manufacturer's installation, maintenance, repair, and operation instructions for each device shall be included. Assembly drawings and parts lists shall also be included. A summary of operating precautions and reasons for precautions shall be included in the Operations and Maintenance Manual.
- E. Lubrication instructions, type and quantity of lubricant shall be included.
- F. Schematic diagrams and wiring diagrams of all control systems corrected to include all field modifications shall be included.
- G. Set points of all interlock devices shall be listed.
- H. Trouble-shooting guide for the control system troubleshooting guide shall be inserted into the Operations and Maintenance Manual.
- I. The combustion control system sequence of operation corrected with submittal review comments shall be inserted into the Operations and Maintenance Manual.
- J. Emergency procedures.

3.12 INSTRUCTIONS TO VA PERSONNEL

Instructions shall be provided in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.

--- E N D ---

SECTION 22 05 12
GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT**PART 1 - GENERAL****1.1 DESCRIPTION:**

This section describes the general motor requirements for plumbing equipment.

1.2 RELATED WORK:

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements common to more than one section of Division 26.
- B. 26 29 11, MOTOR CONTROLLERS: Starters, control and protection of motors: Section

1.3 SUBMITTALS:

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Shop Drawings:
 - 1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
 - 2. Motor nameplate information shall be submitted including electrical ratings, dimensions, mounting details, materials, horsepower, power factor, current as a function of speed, current efficiency, speed as a function of load, RPM, enclosure, starting characteristics, torque characteristics, code letter, full load and locked rotor current, service factor, and lubrication method.
 - 3. Motor parameters required for the determination of the Reed Critical Frequency of vertical hollow shaft motors shall be submitted.
- C. Manuals:
 - 1. Companion copies of complete maintenance and operating manuals, including technical data sheets and application data shall be submitted simultaneously with the shop drawings.
- D. Certification: Two weeks prior to final inspection, unless otherwise noted, four copies of the following certification shall be submitted to the COTR:
 - 1. Certification shall be submitted stating that the motors have been properly applied, installed, adjusted, lubricated, and tested.

1.4 APPLICABLE PUBLICATIONS:

- A. The publications listed below (including amendments, addenda, revisions, supplements and errata) shall form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. National Electrical Manufacturers Association (NEMA):
 - MG 1-07Motors and Generators
 - MG 2-01Safety Standard and Guide for Selection, Installation and Use of Electric Motors and Generators

- C. National Fire Protection Association (NFPA):
70-08National Electrical Code (NEC)

PART 2 - PRODUCTS

2.1 MOTORS:

- A. For alternating current, fractional and integral horsepower motors, NEMA Publications MG 1 and MG 2 shall apply.
- B. Voltage ratings shall be as follows:
1. Single phase:
 - a. Motors connected to 120-volt systems: 115 volts.
 - b. Motors connected to 208-volt systems: 200 volts.
 - c. Motors connected to 240 volt or 480 volt systems: 230/460 volts, dual connection.
 2. Three phase:
 - a. Motors connected to 208-volt systems: 200 volts.
 - b. Motors, less than 74.6 kW (100 HP), connected to 240 volt or 480 volt systems: 230/460 volts, dual connection.
 - c. Motors, 74.6 kW (100 HP) or larger, connected to 240-volt systems: 230 volts.
 - d. Motors, 74.6 kW (100 HP) or larger, connected to 480-volt systems: 460 volts.
 - e. Motors connected to high voltage systems: Shall conform to NEMA Standards for connection to the nominal system voltage shown on the drawings.
- C. Number of phases shall be as follows:
1. Motors, less than 373 W (1/2 HP): Single phase.
 2. Motors, 373 W (1/2 HP) and larger: 3 phase.
 3. Exceptions:
 - a. Hermetically sealed motors.
 - b. Motors for equipment assemblies, less than 746 W (1 HP), may be single phase provided the manufacturer of the proposed assemblies cannot supply the assemblies with three phase motors.
- D. Horsepower ratings shall be adequate for operating the connected loads continuously in the prevailing ambient temperatures in areas where the motors are installed, without exceeding the NEMA standard temperature rises for the motor insulation.
- E. Motor designs, as indicated by the NEMA code letters, shall be coordinated with the connected loads to assure adequate starting and running torque.
- F. Motor Enclosures:
1. Shall be the NEMA types shown on the drawings for the motors.
 2. Where the types of motor enclosures are not shown on the drawings, they shall be the NEMA types, which are most suitable for the environmental conditions where the motors are being installed.

3. Enclosures shall be primed and finish coated at the factory with manufacturer's prime coat and standard finish.
4. All motors in hazardous locations shall be approved for the application and meet the Class and Group as required by the area classification.

G. Electrical Design Requirements

1. Motors shall be continuous duty.
2. The insulation system shall be rated minimum of class B, 130° C (266° F).
3. The maximum temperature rise by resistance at rated power shall not exceed Class B limits, 80° C (176° F).
4. The speed/torque and speed/current characteristics shall comply with NEMA Design A or B, as specified.
5. Motors shall be suitable for full voltage starting, unless otherwise noted.
6. Motors for variable frequency drive applications shall adhere to NEMA standards publication MG 1, Part 30, Application considerations for Constant Speed Motors Used on a Sinusoidal Bus with Harmonic Content and General Purpose Motors Used with Adjustable voltage or Adjustable frequency controls, or both, or Part 31, Definite Purpose Inverter Fed Polyphase Motors.

H. Mechanical Design Requirements

1. Bearings shall be rated for a minimum of 26,280 hours L-10 life at full load direct coupled, except vertical high thrust motors.
 2. Vertical motors shall be capable of withstanding a momentary up thrust of at least 30% of normal down thrust.
 3. Grease lubricated bearings shall be designed for electric motor use. Grease shall be capable of the temperatures associated with electric motors and shall be compatible with Polyurea based greases.
 4. Grease fittings, if provided, shall be Alemite type or equivalent.
 5. Oil lubricated bearings, when specified, shall have an externally visible sight glass to view oil level.
 6. Vibration shall not exceed 0.15 inch per second, unfiltered peak.
 7. Noise level shall meet the requirements of the application.
 8. Motors on 180 frames and larger shall have provisions for lifting eyes or lugs capable of a safety factor of 5.
 9. All external fasteners shall be corrosion resistant.
 10. Condensation heaters, when specified, shall keep motor windings at least 5° C (41° F) above ambient temperature.
 11. Winding thermostats, when specified shall be normally closed, connected in series.
 12. Grounding provisions shall be in the main terminal box.
- I. Additional requirements for specific motors, as indicated in other sections, shall also apply.

- J. NEMA Premium Efficiency Electric Motors, Motor Efficiencies: All permanently wired polyphase motors of 746 Watts (1 Horsepower) or more shall meet the minimum full-load efficiencies as indicated in the following table, and as specified in this specification. Motors of 746 Watts (one horsepower) or more with open, drip-proof or totally enclosed fan-cooled enclosures shall be NEMA premium efficiency type, unless otherwise indicated. Motors provided as an integral part of motor driven equipment are excluded from this requirement if a minimum seasonal or overall efficiency requirement is indicated for that equipment by the provisions of another section.

| Minimum Efficiencies Open Drip-Proof | | | | Minimum Efficiencies Totally Enclosed Fan-Cooled | | | |
|---|-------------|-------------|----------|---|-------------|-------------|-------------|
| Rating kW (HP) | 1200 RPM | 1800 RPM | 3600 RPM | Rating kW (HP) | 1200 RPM | 1800 RPM | 3600 RPM |
| 0.746 (1) | 82.5% | 85.5% | 77.0% | 0.746 (1) | 82.5% | 85.5% | 77.0% |
| 1.12 (1.5) | 86.5% | 86.5% | 84.0% | 1.12 (1.5) | 87.5% | 86.5% | 84.0% |
| 1.49 (2) | 87.5% | 86.5% | 85.5% | 1.49 (2) | 88.5% | 86.5% | 85.5% |
| 2.24 (3) | 88.5% | 89.5% | 85.5% | 2.24 (3) | 89.5% | 89.5% | 86.5% |
| 3.73 (5) | 89.5% | 89.5% | 86.5% | 3.73 (5) | 89.5% | 89.5% | 88.5% |
| 5.60 (7.5) | 90.2% | 91.0% | 88.5% | 5.60 (7.5) | 91.0% | 91.7% | 89.5% |
| 7.46 (10) | 91.7% | 91.7% | 89.5% | 7.46 (10) | 91.0% | 91.7% | 90.2% |
| 11.2 (15) | 91.7% | 93.0% | 90.2% | 11.2 (15) | 91.7% | 92.4% | 91.0% |
| 14.9 (20) | 92.4% | 93.0% | 91.0% | 14.9 (20) | 91.7% | 93.0% | 91.0% |
| 18.7 (25) | 93.0% | 93.6% | 91.7% | 18.7 (25) | 93.0% | 93.6% | 91.7% |
| 22.4 (30) | 93.6% | 94.1% | 91.7% | 22.4 (30) | 93.0% | 93.6% | 91.7% |
| 29.8 (40) | 94.1% | 94.1% | 92.4% | 29.8 (40) | 94.1% | 94.1% | 92.4% |
| 37.3 (50) | 94.1% | 94.5% | 93.0% | 37.3 (50) | 94.1% | 94.5% | 93.0% |
| 44.8 (60) | 94.5% | 95.0% | 93.6% | 44.8 (60) | 94.5% | 95.0% | 93.6% |
| 56.9 (75) | 94.5% | 95.0% | 93.6% | 56.9 (75) | 94.5% | 95.4% | 93.6% |
| 74.6 (100) | 95.0% | 95.4% | 93.6% | 74.6 (100) | 95.0% | 95.4% | 94.1% |
| 93.3 (125) | 95.0% | 95.4% | 94.1% | 93.3 (125) | 95.0% | 95.4% | 95.0% |
| 112 (150) | 95.4% | 95.8% | 94.1% | 112 (150) | 95.8% | 95.8% | 95.0% |
| 149.2 (200) | 95.4% | 95.8% | 95.0% | 149.2 (200) | 95.8% | 96.2% | 95.4% |

- K. Minimum Power Factor at Full Load and Rated Voltage: 90 percent at 1200 RPM, 1800 RPM and 3600 RPM. Power factor correction capacitors shall be installed unless the motor is controlled by a variable frequency drive. The power factor correction capacitors shall be able to withstand high voltage transients and power line variations without breakdown.

PART 3 - EXECUTION

3.1 INSTALLATION:

Install motors in accordance with manufacturer's recommendations, the NEC, NEMA, as shown on the drawings and/or as required by other sections of these specifications.

3.2 FIELD TESTS

Megger all motors after installation, before start-up. All shall test free from grounds.

- - - E N D - - -

SECTION 22 05 19**METERS AND GAGES FOR PLUMBING PIPING****PART 1 - GENERAL****1.1 DESCRIPTION**

This section describes the requirements for pressure gages.

1.2 RELATED WORK

Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Pressure Gages.
 - 2. Product certificates for each type gauge
- C. Operations and Maintenance manual shall include:
 - 1. System Description
 - 2. Major assembly block diagrams
 - 3. Troubleshooting and preventive maintenance guidelines
 - 4. Spare parts information.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute (ANSI):
American Society of Mechanical Engineers (ASME): (Copyrighted Society)
B40.1-05.....Gauges-Pressure Indicating Dial Type-Elastic
- C. American Water Works Association (AWWA):
C700-07 (R 2003).....Standard for Cold Water Meters, Displacement Type, Bronze
Main Case
C701-07.....Cold Water Meters-Turbine Type, for Customer Service AWWA/
ANSI
C702-01.....Cold water meters – Compound Type
- D. International Code Council (ICC):
IPC-06(2007 Supplement) International Plumbing Code

1.5 AS-BUILT DOCUMENTATION

- A. Four sets of manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- B. Four sets of operation and maintenance data updated to include submittal review comments shall be inserted into a three ring binder.

PART 2 – PRODUCTS**2.1 PRESSURE GAGES FOR WATER USAGE**

- A. ANSI B40.1 all metal case 114 mm (4 1/2 inches) diameter, bottom connected throughout, graduated as required for service, and identity labeled. Range shall be 0 to 1375 kPa (0 to 200 psi) gauge.
- B. The pressure element assembly shall be bourdon tube. The mechanical movement shall be lined to pressure element and connected to pointer.
- C. The dial shall be non-reflective aluminum with permanently etched scale markings graduated in kPa and psi.
- D. The pointer shall be dark colored metal.
- E. The window shall be glass.
- F. The ring shall be brass or stainless steel.
- G. The accuracy shall be grade A, plus or minus 1 percent of middle half of scale range.

PART 3 - EXECUTION**3.1 INSTALLATION**

- A. Direct mounted pressure gages shall be installed in piping tees with pressure gage located on pipe at the most readable position.
- B. Valves and snubbers shall be installed in piping for each pressure gage.
- C. Test plugs shall be installed on the inlet and outlet pipes all heat exchangers or water heaters serving more than one plumbing fixture.
- D. Pressure gages shall be installed where indicated on the drawings and at the following locations:
 - 1. Building water service entrance into building
 - 2. Inlet and outlet of each pressure reducing valve
 - 3. Suction and discharge of each re-circulating hot water return pump.

- - - E N D - - -

SECTION 22 05 23
GENERAL-DUTY VALVES FOR PLUMBING PIPING**PART 1 - GENERAL****1.1 DESCRIPTION**

- A. This section describes the requirements for general-duty valves for domestic water and sewer systems.

1.2 RELATED WORK

- A. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
1. Valves.
 2. Backflow Preventers.
 3. All items listed in Part 2 - Products.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):A536-84(R 2004) Standard Specification for Ductile Iron Castings
- C. American Society of Sanitary Engineering (ASSE)
- ASSE 1003-01 (R 2003).....Performance Requirements for Water Pressure Reducing Valves
- ASSE 1012-02.....Backflow Preventer with Intermediate Atmospheric Vent
- ASSE 1013-05.....Reduced Pressure Principle Backflow Preventers and Reduced Pressure Fire Protection Principle Backflow Preventers
- D. International Code Council (ICC)
- IPC-06 (R 2007)International Plumbing Code
- E. Manufacturers Standardization Society of the Valve and Fittings Industry, Inc. (MSS):
- SP-25-98Standard Marking System for Valves, Fittings, Flanges and Unions
- SP-67-02a (R 2004) Butterfly Valve of the Single flange Type (Lug Wafer)
- SP-70-06Cast Iron Gate Valves, Flanged and Threaded Ends.
- SP-72-99Ball Valves With Flanged or Butt Welding For General Purpose
- SP-80-03Bronze Gate, Globe, Angle and Check Valves.
- SP-110-96Ball Valve Threaded, Socket Welding, Solder Joint, Grooved and Flared Ends

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Valves shall be prepared for shipping as follows:
 - 1. Protect internal parts against rust and corrosion.
 - 2. Protect threads, flange faces, grooves, and weld ends.
 - 3. Set angle, gate, and globe valves closed to prevent rattling.
 - 4. Set ball and plug valves open to minimize exposure of functional surfaces
 - 5. Block check valves in either closed or open position.
- B. Valves shall be prepared for storage as follows:
 - 1. Maintain valve end protection.
 - 2. Store valves indoors and maintain at higher than ambient dew point temperature.
- C. A sling shall be used for large valves. The sling shall be rigged to avoid damage to exposed parts. Hand wheels or stems shall not be used as lifting or rigging points.

PART 2 - PRODUCTS**2.1 VALVES**

- A. Asbestos packing and gaskets are prohibited.
- B. Bronze valves shall be made with dezincification resistant materials. Bronze valves made with copper alloy (brass) containing more than 15 percent zinc shall not be permitted.
- C. Valves in insulated piping shall have 50 mm or DN50 (2 inch) stem extensions and extended handles of non-thermal conductive material that allows operating the valve without breaking the vapor seal or disturbing the insulation. Memory stops shall be fully adjustable after insulation is applied.
- D. Exposed Valves over 65 mm or DN65 (2-1/2 inches) installed at an elevation over 3.6 meters (12 feet) shall have a chain-wheel attachment to valve hand-wheel, stem, or other actuator.
- E. Ball valves, pressure regulating valves, gate valves, globe valves, and plug valves used to supply potable water shall meet the requirements of NSF 61.
- F. Shut-off:
 - 1. Cold, Hot and Re-circulating Hot Water:
 - a. 100 mm or DN100 (4 inches) and smaller: Ball, MSS SP-72, SP-110, Ball valves shall be full port three-piece design. Threaded stem designs are not allowed. The ball valve shall have a WSP rating of 1035 kPa (150 psig) and a CWP rating of 4140 kPa (600 psig). The body material shall be Bronze ASTM B584, Alloy C844. The ends shall be solder,
 - b. 100 mm (DN100) (4 inches) and larger:
 - 1) Class 125, Flanged Cast Iron Ball Valve. The valve shall meet MSS-SP-72, ANSI B 16.10 standards and shall be full port design with stainless steel ball, stem and FDA approved epoxy coating. Valve shall be split body type and rated for 862 kPa (125 psig) WSP and 1379 kPa (200 psig) WOG.

G. Balancing:

1. Hot Water Re-circulating, 80 mm or DN80 (3 inches) and smaller manual balancing valve shall be of bronze body, brass ball construction with glass and carbon filled TFE seat rings and designed for positive shutoff. The manual balancing valve shall have differential pressure read-out ports across the valve seat area. The read out ports shall be fitting with internal EPT inserts and check valves. The valve body shall have 8 mm or DN8 NPT (1/4" NPT) tapped drain and purge port. The valves shall have memory stops that allow the valve to close for service and then reopened to set point without disturbing the balance position. All valves shall have calibrated nameplates to assure specific valve settings.

H. Check:

1. Check valves less than 80 mm or DN80 (3 inches) and smaller) shall be class 125, bronze swing check valves with non metallic Buna-N disc. The check valve shall meet MSS SP-80 Type 4 standard. The check valve shall have a CWP rating of 1380 kPa (200 psig). The check valve shall have a Y pattern horizontal body design with bronze body material conforming to ASTM B 62, solder joints, and PTFE or TFE disc.

2.2 BACKFLOW PREVENTERS

- A. A backflow prevention assembly shall be installed at any point in the plumbing system where the potable water supply comes in contact with a potential source of contamination. The backflow prevention assembly shall be ASSE 1013 listed and certified.
- B. Reduced pressure backflow preventers shall be installed in the following applications.
 1. Deionizers.
 2. Sterilizers.
 3. Stills.
 4. Dialysis, Deionized or Reverse Osmosis Water Systems.
 5. Water make up to heating systems, cooling tower, chilled water system, generators, and similar equipment consuming water.
 6. Water service entrance from loop system.
 7. Dental Equipment
 8. Power washer
 9. Atmospheric Vacuum Breaker: ASSE 1001
 - a. Hose bibs and sinks w/threaded outlets.
 - b. Disposers.
 - c. Showers (telephone type).
 - d. Hydrotherapy units.
 - e. Autopsy, on each hot and cold water outlet at each table or sink.
 - f. All kitchen equipment, if not protected by air gap.
 - g. Ventilating hoods with wash down system.

- h. Film processor.
 - i. Detergent system
 - j. Dental equipment
 - k. Fume hoods
 - l. Glassware washers
- C. The reduced pressure principle backflow prevention assembly shall be ASSE listed 1013 with full port OS&Y gate valves and an integral relief monitor switch. The main body and access cover shall be epoxy coated duct iron conforming to ASTM A536 grade 4. The seat ring and check valve shall be Noryl (NSF listed). The stem shall be stainless steel conforming to ASTM A276. The seat disc elastomer shall be EPDM. The checks and the relief valve shall be accessible for maintenance without removing the device from the line. An epoxy coated wye type strainer with flanged connections shall be installed on the inlet.
- D. The atmospheric vacuum breaker shall be ASSE listed 1001. The main body shall be either cast bronze. All internal polymers shall be NSF listed. The seat disc elastomer shall be silicone. The device shall be accessible for maintenance without removing the device from the service line. The installation shall not be in a concealed or inaccessible location or where the venting of water from the device during normal operation is deemed objectionable.
- E. The double check detector backflow prevention assembly shall be ASSE listed 1048 and supply with full port OS&Y gate valves. The main body and access cover shall be epoxy coated ductile iron conforming to ASTM A536 grade. The seat ring and check valve shall be Noryl (NSF listed). The stem shall be stainless steel conforming to ASTM A 276. The seat disc elastomers shall be EPDM. The first and second check valve shall be accessible for maintenance without removing the device from the line.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Valve interior shall be examined for cleanliness, freedom from foreign matter, and corrosion. Special packing materials shall be removed, such as blocks, used to prevent disc movement during shipping and handling.
- B. Valves shall be operated in positions from fully open to fully closed. Guides and seats shall be examined and made accessible by such operations.
- C. Threads on valve and mating pipe shall be examined for form and cleanliness.
- D. Mating flange faces shall be examined for conditions that might cause leakage. Bolting shall be checked for proper size, length, and material. Gaskets shall be verified for proper size and that its material composition is suitable for service and free from defects and damage.
- E. Do not attempt to repair defective valves; replace with new valves.

3.2 VALVE INSTALLATION

- A. Install valves with unions or flanges at each piece of equipment arranged to allow service, maintenance, and equipment removal without system shutdown.
- B. Valves shall be located for easy access and shall be provide with separate support. Valves shall be accessible with access doors when installed inside partitions or above hard ceilings.
- C. Valves shall be installed in horizontal piping with stem at or above center of pipe
- D. Valves shall be installed in a position to allow full stem movement.
- E. Check valves shall be installed for proper direction of flow and as follows:
 - 1. Swing Check Valves: In horizontal position with hinge pin level.

3.3 ADJUSTING

- A. Valve packing shall be adjusted or replaced after piping systems have been tested and put into service but before final adjusting and balancing. Replace valves shall be replaced if persistent leaking occurs.

-- E N D --

**SECTION 22 07 11
PLUMBING INSULATION****PART 1 - GENERAL****1.1 DESCRIPTION**

- A. Field applied insulation for thermal efficiency and condensation control for
 - 1. Plumbing piping and equipment.
- B. Definitions
 - 1. ASJ: All service jacket, white finish facing or jacket.
 - 2. Air conditioned space: Space having air temperature and/or humidity controlled by mechanical equipment.
 - 3. Cold: Equipment or piping handling media at design temperature of 16 degrees C (60 degrees F) or below.
 - 4. Concealed: Piping above ceilings and in chases, and pipe spaces.
 - 5. Exposed: Piping and equipment exposed to view in finished areas including mechanical equipment rooms or exposed to outdoor weather. Shafts, chases, crawl spaces and pipe basements are not considered finished areas.
 - 6. FSK: Foil-scrim-kraft facing.
 - 7. Hot: Plumbing equipment or piping handling media above 41 degrees C (105 degrees F).
 - 8. Density: kg/m^3 - kilograms per cubic meter (Pcf - pounds per cubic foot).
 - 9. Thermal conductance: Heat flow rate through materials.
 - a. Flat surface: Watts per square meter (BTU per hour per square foot).
 - b. Pipe or Cylinder: Watts per square meter (BTU per hour per linear foot).
 - 10. Thermal Conductivity (k): Watt per meter, per degree C (BTU per inch thickness, per hour, per square foot, per degree F temperature difference).
 - 11. Vapor Retarder (Vapor Barrier): A material which retards the transmission (migration) of water vapor. Performance of the vapor retarder is rated in terms of permeance (perms). For the purpose of this specification, vapor retarders shall have a maximum published permeance of 0.1 perms and vapor barriers shall have a maximum published permeance of 0.001 perms.
 - 12. R: Pump recirculation.
 - 13. HW: Hot water.
 - 14. PVDC: Polyvinylidene chloride vapor retarder jacketing, white.

1.2 RELATED WORK

- A. Section 07 84 00, FIRESTOPPING: Mineral fiber and bond breaker behind sealant.
- B. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: General mechanical requirements and items, which are common to more than one section of Division 22.

- C. Section 22 05 19, METERS AND GAGES FOR PLUMBING PIPING and Section 22 05 23, GENERAL-DUTY VALVES FOR PLUMBING PIPING: Hot and cold water piping.
- D. Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS. Requirements for commissioning, systems readiness checklists, and training.

1.3 QUALITY ASSURANCE

- A. Refer to article QUALITY ASSURANCE, in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- B. Criteria:
 - 1. Comply with NFPA 90A, particularly paragraphs 4.3.3.1 through 4.3.3.6, 4.3.10.2.6, and 5.4.6.4, parts of which are quoted as follows:
 - 4.3.3.1** Pipe insulation and coverings, vapor retarder facings, adhesives, fasteners, tapes, unless otherwise provided for in 4.3.3.1.12 or 4.3.3.1.2, shall have, in the form in which they are used, a maximum flame spread index of 25 without evidence of continued progressive combustion and a maximum smoke developed index of 50 when tested in accordance with NFPA 255, *Standard Method of Test of Surface Burning Characteristics of Building Materials*.
 - 4.3.3.1.1** Where these products are to be applied with adhesives, they shall be tested with such adhesives applied, or the adhesives used shall have a maximum flame spread index of 25 and a maximum smoke developed index of 50 when in the final dry state. (See 4.2.4.2.)
 - 4.3.3.3** Pipe insulation and coverings shall not flame, glow, smolder, or smoke when tested in accordance with a similar test for pipe covering, ASTM C 411, Standard Test Method for Hot-Surface Performance of High-Temperature Thermal Insulation, at the temperature to which they are exposed in service.
 - 4.3.3.3.1** In no case shall the test temperature be below 121 °C (250 °F).
 - 4.3.10.2.6.3** Nonferrous fire sprinkler piping shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with UL 1887, Standard for Safety Fire Test of Plastic Sprinkler Pipe for Visible Flame and Smoke Characteristics.
 - 4.3.10.2.6.7** Smoke detectors shall not be required to meet the provisions of this section.
 - 2. Test methods: ASTM E84, UL 723, or NFPA 255.
 - 3. Specified k factors are at 24 degrees C (75 degrees F) mean temperature unless stated otherwise. Where optional thermal insulation material is used, select thickness to provide thermal conductance no greater than that for the specified material. For pipe, use insulation manufacturer's published heat flow tables. For domestic hot water supply and return, run out insulation and condensation control insulation, no thickness adjustment need be made.
 - 4. All materials shall be compatible and suitable for service temperature, and shall not contribute to corrosion or otherwise attack surface to which applied in either the wet or dry state.
- C. Every package or standard container of insulation or accessories delivered to the job site for use must have a manufacturer's stamp or label giving the name of the manufacturer and description of the material.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings:
 - 1. All information, clearly presented, shall be included to determine compliance with drawings and specifications and ASTM, federal and military specifications.
 - a. Insulation materials: Specify each type used and state surface burning characteristics.
 - b. Insulation facings and jackets: Each type used.
 - c. Insulation accessory materials: Each type used.
 - d. Manufacturer's installation and fitting fabrication instructions for flexible unicellular insulation.
 - e. Make reference to applicable specification paragraph numbers for coordination.

1.5 STORAGE AND HANDLING OF MATERIAL

Store materials in clean and dry environment, pipe covering jackets shall be clean and unmarred. Place adhesives in original containers. Maintain ambient temperatures and conditions as required by printed instructions of manufacturers of adhesives, mastics and finishing cements.

1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.
- B. Federal Specifications (Fed. Spec.):
 - L-P-535E (2)-91.....Plastic Sheet (Sheeting): Plastic Strip; Poly (Vinyl Chloride) and Poly (Vinyl Chloride - Vinyl Acetate), Rigid.
- C. Military Specifications (Mil. Spec.):
 - MIL-A-3316C (2)-90Adhesives, Fire-Resistant, Thermal Insulation
 - MIL-A-24179A (1)-87.....Adhesive, Flexible Unicellular-Plastic Thermal Insulation
 - MIL-C-19565C (1)-88Coating Compounds, Thermal Insulation, Fire-and Water-Resistant, Vapor-Barrier
 - MIL-C-20079H-87.....Cloth, Glass; Tape, Textile Glass; and Thread, Glass and Wire-Reinforced Glass
- D. American Society for Testing and Materials (ASTM):
 - A167-04Standard Specification for Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet, and Strip
 - B209-07Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate
 - C411-05.....Standard test method for Hot-Surface Performance of High-Temperature Thermal Insulation

- C449-07 Standard Specification for Mineral Fiber Hydraulic-Setting Thermal Insulating and Finishing Cement
- C533-09 Standard Specification for Calcium Silicate Block and Pipe Thermal Insulation
- C534-08 Standard Specification for Preformed Flexible Elastomeric Cellular Thermal Insulation in Sheet and Tubular Form
- C547-07 Standard Specification for Mineral Fiber pipe Insulation
- C552-07 Standard Specification for Cellular Glass Thermal Insulation
- C553-08 Standard Specification for Mineral Fiber Blanket Thermal Insulation for Commercial and Industrial Applications
- C585-09 Standard Practice for Inner and Outer Diameters of Rigid Thermal Insulation for Nominal Sizes of Pipe and Tubing (NPS System) R (1998)
- C612-10 Standard Specification for Mineral Fiber Block and Board Thermal Insulation
- C1126-10 Standard Specification for Faced or Unfaced Rigid Cellular Phenolic Thermal Insulation
- C1136-10 Standard Specification for Flexible, Low Permeance Vapor Retarders for Thermal Insulation
- D1668-97a (2006) Standard Specification for Glass Fabrics (Woven and Treated) for Roofing and Waterproofing
- E84-10 Standard Test Method for Surface Burning Characteristics of Building Materials
- E119-09C Standard Test Method for Fire Tests of Building Construction and Materials
- E136-09 b Standard Test Methods for Behavior of Materials in a Vertical Tube Furnace at 750 degrees C (1380 F)
- E. National Fire Protection Association (NFPA):
- 101-09 Life Safety Code
- 251-06 Standard methods of Tests of Fire Endurance of Building Construction Materials
- 255-06 Standard Method of tests of Surface Burning Characteristics of Building Materials
- F. Underwriters Laboratories, Inc (UL):
- 723 UL Standard for Safety Test for Surface Burning Characteristics of Building Materials with Revision of 08/03
- G. Manufacturer's Standardization Society of the Valve and Fitting Industry (MSS):

SP58-2002Pipe Hangers and Supports Materials, Design, and Manufacture

PART 2 - PRODUCTS**2.1 MINERAL FIBER OR FIBER GLASS**

- A. ASTM C547 (Pipe Fitting Insulation and Preformed Pipe Insulation), Class 1, $k = 0.037$ (0.26) at 24 degrees C (75 degrees F), for use at temperatures up to 230 degrees C (450 degrees F) with an all service vapor retarder jacket with polyvinyl chloride premolded fitting covering.

2.2 RIGID CELLULAR PHENOLIC FOAM

- A. Preformed (molded) pipe insulation, ASTM C1126, type III, grade 1, $k = 0.021$ (0.15) at 10 degrees C (50 degrees F), for use at temperatures up to 121 degrees C (250 degrees F) with vapor retarder and all service vapor retarder jacket with polyvinyl chloride premolded fitting covering.

2.3 INSULATION FACINGS AND JACKETS

- A. Vapor Retarder, higher strength with low water permeance ≤ 0.02 or less perm rating, Beach puncture 50 units for insulation facing on pipe insulation jackets. Facings and jackets shall be all service type (ASJ) or PVDC Vapor Retarder jacketing.
- B. ASJ jacket shall be white kraft bonded to 0.025 mm (1 mil) thick aluminum foil, fiberglass reinforced, with pressure sensitive adhesive closure. Comply with ASTM C1136. Beach puncture 50 units, Suitable for painting without sizing. Jackets shall have minimum 40 mm (1-1/2 inch) lap on longitudinal joints and minimum 75mm (3 inch) butt strip on end joints. Butt strip material shall be same as the jacket. Lap and butt strips shall be self-sealing type with factory-applied pressure sensitive adhesive.
- C. Vapor Retarder medium strength with low water vapor permeance of 0.02 or less perm rating), Beach puncture 25 units: Foil-Scrim-Kraft (FSK) or PVDC vapor retarder jacketing type for concealed ductwork and equipment.
- D. Glass Cloth Jackets: Presized, minimum 0.18 kg per square meter (7.8 ounces per square yard), 2000 kPa (300 psig) bursting strength with integral vapor retarder where required or specified. Weather proof if utilized for outside service.
- E. Factory composite materials may be used provided that they have been tested and certified by the manufacturer.
- F. Pipe fitting insulation covering (jackets): Fitting covering shall be premolded to match shape of fitting and shall be polyvinyl chloride (PVC) conforming to Fed Spec L-P-335, composition A, Type II Grade GU, and Type III, minimum thickness 0.7 mm (0.03 inches). Provide color matching vapor retarder pressure sensitive tape.
- G. Aluminum Jacket-Piping systems: ASTM B209, 3003 alloy, H-14 temper, 0.6 mm (0.023 inch) minimum thickness with locking longitudinal joints. Jackets for elbows, tees and other fittings shall be factory-fabricated to match shape of fitting and of 0.6 mm (0.024) inch minimum thickness aluminum. Fittings shall be of same construction as straight run jackets but need not be of the same alloy. Factory-fabricated stainless steel bands shall be installed on all circumferential joints.

Bands shall be 13 mm (0.5 inch) wide on 450 mm (18 inch) centers. System shall be weatherproof if utilized for outside service.

2.4 PIPE COVERING PROTECTION SADDLES

- A. Cold pipe support: Premolded pipe insulation 180 degrees (half-shells) on bottom half of pipe at supports. Material shall be cellular glass or high density Polyisocyanurate insulation of the same thickness as adjacent insulation. Density of Polyisocyanurate insulation shall be a minimum of 48 kg/m³ (3.0 pcf).

| Nominal Pipe Size and Accessories Material (Insert Blocks) | |
|--|---------------------------|
| Nominal Pipe Size mm (inches) | Insert Blocks mm (inches) |
| Up through 125 (5) | 150 (6) long |
| 150 (6) | 150 (6) long |
| 200 (8), 250 (10), 300 (12) | 225 (9) long |

- B. Warm or hot pipe supports: Premolded pipe insulation (180 degree half-shells) on bottom half of pipe at supports. Material shall be high density Polyisocyanurate (for temperatures up to 149 degrees C [300 degrees F]), cellular glass or calcium silicate. Insulation at supports shall have same thickness as adjacent insulation. Density of Polyisocyanurate insulation shall be a minimum of 48 kg/m³ (3.0 pcf).

2.5 ADHESIVE, MASTIC, CEMENT

- A. Mil. Spec. MIL-A-3316, Class 1: Jacket and lap adhesive and protective finish coating for insulation.
- B. Mil. Spec. MIL-A-3316, Class 2: Adhesive for laps and for adhering insulation to metal surfaces.
- C. Mil. Spec. MIL-A-24179, Type II Class 1: Adhesive for installing flexible unicellular insulation and for laps and general use.
- D. Mil. Spec. MIL-C-19565, Type I: Protective finish for outdoor use.
- E. Mil. Spec. MIL-C-19565, Type I or Type II: Vapor barrier compound for indoor use.
- F. ASTM C449: Mineral fiber hydraulic-setting thermal insulating and finishing cement.
- G. Other: Insulation manufacturers' published recommendations.

2.6 MECHANICAL FASTENERS

- A. Pins, anchors: Welded pins, or metal or nylon anchors with galvanized steel or fiber washer, or clips. Pin diameter shall be as recommended by the insulation manufacturer.
- B. Staples: Outward clinching galvanized steel
- C. Wire: 1.3 mm thick (18 gage) soft annealed galvanized or 1.9 mm (14 gage) copper clad steel or nickel copper alloy.
- D. Bands: 13 mm (1/2 inch) nominal width, brass, galvanized steel, aluminum or stainless steel.

2.7 REINFORCEMENT AND FINISHES

- A. Glass fabric, open weave: ASTM D1668, Type III (resin treated) and Type I (asphalt treated).

- B. Glass fiber fitting tape: Mil. Spec MIL-C-20079, Type II, Class 1.
- C. Hexagonal wire netting: 25 mm (one inch) mesh, 0.85 mm thick (22 gage) galvanized steel.
- D. Corner beads: 50 mm (2 inch) by 50 mm (2 inch), 0.55 mm thick (26 gage) galvanized steel; or, 25 mm (1 inch) by 25 mm (1 inch), 0.47 mm thick (28 gage) aluminum angle adhered to 50 mm (2 inch) by 50 mm (2 inch) Kraft paper.
- E. PVC fitting cover: Fed. Spec L-P-535, Composition A, 11-86 Type II, Grade GU, with Form B Mineral Fiber insert, for media temperature 4 degrees C (40 degrees F) to 121 degrees C (250 degrees F). Below 4 degrees C (40 degrees F) and above 121 degrees C (250 degrees F). Provide double layer insert. Provide color matching vapor barrier pressure sensitive tape.

2.8 FIRESTOPPING MATERIAL

Other than pipe insulation, refer to Section 07 84 00 FIRESTOPPING.

2.9 FLAME AND SMOKE

Unless shown otherwise all assembled systems shall meet flame spread 25 and smoke developed 50 rating as developed under ASTM, NFPA and UL standards and specifications. See paragraph 1.3 "Quality Assurance".

PART 3 - EXECUTION

3.1 GENERAL REQUIREMENTS

- A. Required pressure tests of piping joints and connections shall be completed and the work approved by the COTR for application of insulation. Surface shall be clean and dry with all foreign materials, such as dirt, oil, loose scale and rust removed.
- B. Except for specific exceptions, insulate all specified equipment, and piping (pipe, fittings, valves, accessories). Insulate each pipe individually. Do not use scrap pieces of insulation where a full length section will fit.
- C. Insulation materials shall be installed in a first class manner with smooth and even surfaces, with jackets and facings drawn tight and smoothly cemented down at all laps. Insulation shall be continuous through all sleeves and openings, except at fire dampers (NFPA 90A). Vapor retarders shall be continuous and uninterrupted throughout systems with operating temperature 16 degrees C (60 degrees F) and below. Lap and seal vapor barrier over ends and exposed edges of insulation. Anchors, supports and other metal projections through insulation on cold surfaces shall be insulated and vapor sealed for a minimum length of 150 mm (6 inches).
- D. Install vapor stops at all insulation terminations on either side of valves, pumps and equipment and particularly in straight lengths of pipe insulation.
- E. Construct insulation on parts of equipment such as cold water pumps and heat exchangers that must be opened periodically for maintenance or repair, so insulation can be removed and replaced without damage. Install insulation with bolted 1 mm thick (20 gage) galvanized steel or aluminum covers as complete units, or in sections, with all necessary supports, and split to coincide with flange/split of the equipment.

- F. Insulation on hot piping and equipment shall be terminated square at items not to be insulated, access openings and nameplates. Cover all exposed raw insulation with white sealer or jacket material.
- G. Protect all insulations outside of buildings with aluminum jacket using lock joint or other approved system for a continuous weather tight system. Access doors and other items requiring maintenance or access shall be removable and sealable.
- H. Plumbing work not to be insulated:
 - 1. Piping and valves of fire protection system.
 - 2. Chromium plated brass piping.
- I. Apply insulation materials subject to the manufacturer's recommended temperature limits. Apply adhesives, mastic and coatings at the manufacturer's recommended minimum coverage.
- J. Elbows, flanges and other fittings shall be insulated with the same material as is used on the pipe straights.

Use of polyurethane spray-foam to fill a PVC elbow jacket is prohibited on cold applications.
- K. Firestop Pipe insulation:
 - 1. Provide firestopping insulation at fire and smoke barriers through penetrations. Fire stopping insulation shall be UL listed as defines in Section 07 84 00, FIRESTOPPING.
 - 2. Pipe penetrations requiring fire stop insulation including, but not limited to the following:
 - a. Pipe risers through floors
 - b. Pipe chase walls and floors
 - c. Smoke partitions
 - d. Fire partitions
- L. Provide vapor barrier jackets over insulation as follows:
 - 1. All interior piping conveying fluids exposed to outdoor air (i.e. in attics, ventilated (not air conditioned) spaces, etc.) below ambient air temperature in high humidity areas.
- M. Provide metal jackets over insulation as follows:
 - a. All plumbing piping exposed to outdoor weather.
 - b. Piping exposed in building, within 1800 mm (6 feet) of the floor, that connects to sterilizers, kitchen and laundry equipment. Jackets may be applied with pop rivets. Provide aluminum angle ring escutcheons at wall, ceiling or floor penetrations.
 - c. A 50 mm (2 inch) overlap is required at longitudinal and circumferential joints.

3.2 INSULATION INSTALLATION

- A. Molded Mineral Fiber Pipe and Tubing Covering:
 - 1. Fit insulation to pipe, aligning longitudinal joints. Seal longitudinal joint laps and circumferential butt strips by rubbing hard with a nylon sealing tool to assure a positive seal. Staples may be used to assist in securing insulation. Seal all vapor retarder penetrations on cold piping with a generous application of vapor barrier mastic. Provide inserts and install with metal insulation shields at outside pipe supports. Install freeze protection insulation over heating cable.

2. Contractor's options for fitting, flange and valve insulation:
 - a. Insulating and finishing cement for sizes less than 100 mm (4 inches) operating at surface temperature of 16 degrees C (61 degrees F) or more.
 - b. Factory premolded, one piece PVC covers with mineral fiber, (Form B), inserts. Provide two insert layers for pipe temperatures below 4 degrees C (40 degrees F), or above 121 degrees C (250 degrees F). Secure first layer of insulation with twine. Seal seam edges with vapor barrier mastic and secure with fitting tape.
 - c. Factory molded, ASTM C547 or field mitered sections, joined with adhesive or wired in place. For hot piping finish with a smoothing coat of finishing cement. For cold fittings, 16 degrees C (60 degrees F) or less, vapor seal with a layer of glass fitting tape imbedded between two 2 mm (1/16 inch) coats of vapor barrier mastic.
 - d. Fitting tape shall extend over the adjacent pipe insulation and overlap on itself at least 50 mm (2 inches).
 3. Nominal thickness in millimeters and inches specified in the schedule at the end of this section.
- B. Rigid Cellular Phenolic Foam:
1. Rigid closed cell phenolic insulation may be provided for piping, ductwork and equipment for temperatures up to 121 degrees C (250 degrees F).
 2. Note the NFPA 90A burning characteristics requirements of 25/50 in paragraph 1.3.B
 3. Provide secure attachment facilities such as welding pins.
 4. Apply insulation with joints tightly drawn together
 5. Apply adhesives, coverings, neatly finished at fittings, and valves.
 6. Final installation shall be smooth, tight, neatly finished at all edges.
 7. Minimum thickness in millimeters (inches) specified in the schedule at the end of this section.
- D. Cellular Glass Insulation:
1. Pipe and tubing, covering nominal thickness in millimeters and inches as specified in the schedule at the end of this section.
 2. Underground Piping factory jacketed with a 3 mm laminate jacketing consisting of 3000 mm x 3000 mm (10 ft x 10 ft) asphalt impregnated glass fabric, bituminous mastic and outside protective plastic film.
 - a. 75 mm (3 inches) thick for hot water piping.
 - b. Underground piping: Apply insulation with joints tightly butted. Seal longitudinal self-sealing lap. Use field fabricated or factory made fittings. Seal butt joints and fitting with jacketing as recommended by the insulation manufacturer. Use 100 mm (4 inch) wide strips to seal butt joints.
 - c. Underground insulation shall be inspected and approved by the COTR as follows:
 - 1) Insulation in place before coating.
 - 2) After coating.

- d. Sand bed and backfill: Minimum 75 mm (3 inches) all around Insulated pipe or tank, applied after coating has dried.
- E. Polyisocyanurate Closed-Cell Rigid Insulation:
1. Polyisocyanurate closed-cell rigid insulation (PIR) may be provided for exterior piping for temperature up to 149 degree C (300 degree F).
 2. Install insulation, vapor retarder and jacketing per manufacturer's recommendations. Particular attention should be paid to recommendations for joint staggering, adhesive application, external hanger design, expansion/contraction joint design and spacing and vapor retarder integrity.
 3. Install insulation with all joints tightly butted (except expansion joints in hot applications).
 4. If insulation thickness exceeds 63 mm (2.5 inches), install as a double layer system with longitudinal (lap) and butt joint staggering as recommended by manufacturer.
 5. Elbows, flanges and other fittings shall be insulated with the same material as is used on the pipe straights. The elbow/fitting insulation shall be field-fabricated, mitered or factory prefabricated to the necessary size and shape to fit on the elbow/fitting. Use of polyurethane spray-foam to fill PVC elbow jacket is prohibited on cold applications.
 6. All PVC and metal jacketing shall be installed so as to naturally shed water. Joints shall point down and shall be sealed with either adhesive or caulking (except for periodic slip joints).
 7. Underground piping: Follow instructions for above ground piping but the vapor retarder jacketing shall be 6 mil thick PVDC or minimum 30 mil thick rubberized bituminous membrane. Sand bed and backfill shall be a minimum of 150 mm (6 inches) all around insulated pipe.
 8. Note the NFPA 90A burning characteristic requirements of 25/50 in paragraph 1.3B. Refer to paragraph 3.1 for items not to be insulated.
 9. Minimum thickness in millimeter (inches) specified in the schedule at the end of this section.

3.3 COMMISSIONING

- A. Provide commissioning documentation in accordance with the requirements of section 22 08 00 – COMMISSIONING OF PLUMBING SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to section 22 08 00 – COMMISSIONING OF PLUMBING SYSTEMS and related sections for contractor responsibilities for system commissioning.

3.4 PIPE INSULATION SCHEDULE

Provide insulation for piping systems as scheduled below:

| Insulation Thickness Millimeters (Inches) | | | | | |
|---|---------------------|--|------------|---------|-------------|
| | | Nominal Pipe Size Millimeters (Inches) | | | |
| Operating Temperature | Insulation Material | Less than | 25 – 32 (1 | 38 – 75 | 100 (4) and |

| Range/Service | | 25 (1) | — 1¼ | (1½ - 3) | Above |
|---|---|----------|----------|----------|----------|
| 38-60 degrees C (100-140 degrees F) (Domestic Hot Water Supply and Return) | Mineral Fiber (Above ground piping only) | 38 (1.5) | 38 (1.5) | 50 (2.0) | 50 (2.0) |
| 38-60 degrees C (100-140 degrees F) (Domestic Hot Water Supply and Return) | Rigid Cellular Phenolic Foam (Above ground piping only) | 38 (1.5) | 38 (1.5) | 50 (2.0) | 50 (2.0) |
| 38-60 degrees C (100-140 degrees F) (Domestic Hot Water Supply and Return) | Polyisocyanurate Closed-Cell Rigid (Exterior Locations only) | 38 (1.5) | 38 (1.5) | 80 (3.0) | ---- |

--- E N D ---

SECTION 22 08 00**COMMISSIONING OF PLUMBING SYSTEMS****PART 1 - GENERAL****1.1 DESCRIPTION**

- A. The requirements of this Section apply to all sections of Division 22.
- B. This project will have selected building systems commissioned. The complete list of equipment and systems to be commissioned are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. The commissioning process, which the Contractor is responsible to execute, is defined in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. A Commissioning Agent (CxA) appointed by the Department of Veterans Affairs will manage the commissioning process.

1.2 RELATED WORK

- A. Section 01 00 00 GENERAL REQUIREMENTS.
- B. Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.
- C. Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

1.3 SUMMARY

- A. This Section includes requirements for commissioning plumbing systems, subsystems and equipment. This Section supplements the general requirements specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.
- B. The commissioning activities have been developed to support the VA requirements to meet guidelines for Federal Leadership in Environmental, Energy, and Economic Performance.
- C. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for more specifics regarding processes and procedures as well as roles and responsibilities for all Commissioning Team members.

1.4 DEFINITIONS

- A. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for definitions.

1.5 COMMISSIONED SYSTEMS

- A. Commissioning of a system or systems specified in this Division is part of the construction process. Documentation and testing of these systems, is required in cooperation with the VA and the Commissioning Agent.
- B. The following Plumbing systems will be commissioned:
 - 1. Domestic Hot Water Systems (hot water recirculating pumps and motors, controls).

1.6 SUBMITTALS

- A. The commissioning process requires review of selected Submittals. The Commissioning Agent will review these submittals to verify compliance with Basis of Design and Owner's Project Requirements. Refer to Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, and SAMPLES for further details.

- B. The commissioning process requires review of installed equipment against approved submittals. Specific submittal requirements related to the commissioning process are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

PART 2 - PRODUCTS (NOT USED)**PART 3 - EXECUTION****3.1 PRE-FUNCTIONAL CHECKLISTS**

- A. The Contractor shall complete Pre-Functional Checklists to verify systems, subsystems, and equipment installation is complete and systems are ready for Systems Functional Performance Testing. The Commissioning Agent will prepare Pre-Functional Checklists to be used to document equipment installation. The Contractor shall complete the checklists. Completed checklists shall be submitted to the VA and to the Commissioning Agent for review. The Commissioning Agent may spot check a sample of completed checklists. If the Commissioning Agent determines that the information provided on the checklist is not accurate, the Commissioning Agent will return the marked-up checklist to the Contractor for correction and resubmission. If the Commissioning Agent determines that a significant number of completed checklists for similar equipment are not accurate, the Commissioning Agent will select a broader sample of checklists for review. If the Commissioning Agent determines that a significant number of the broader sample of checklists is also inaccurate, all the checklists for the type of equipment will be returned to the Contractor for correction and resubmission. Refer to SECTION 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for submittal requirements for Pre-Functional Checklists, Equipment Startup Reports, and other commissioning documents.

3.2 CONTRACTORS TESTS

- A. Contractor tests as required by other sections of Division 22 shall be scheduled and documented in accordance with Section 01 00 00 GENERAL REQUIREMENTS. The Commissioning Agent will witness selected Contractor tests. Contractor tests shall be completed prior to scheduling Systems Functional Performance Testing.

3.3 SYSTEMS FUNCTIONAL PERFORMANCE TESTING:

- A. The Commissioning Process includes Systems Functional Performance Testing that is intended to test systems functional performance under steady state conditions, to test system reaction to changes in operating conditions, and system performance under emergency conditions. The Commissioning Agent will prepare detailed Systems Functional Performance Test procedures for review and approval by the COTR. The Contractor shall review and comment on the tests prior to approval. The Contractor shall provide the required labor, materials, and test equipment identified in the test procedure to perform the tests. The Commissioning Agent will witness and document the testing. The Contractor shall sign the test reports to verify tests were performed. See Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS, for additional details.

3.4 TRAINING OF VA PERSONNEL

- A. Training of the VA operation and maintenance personnel is required in cooperation with the COTR and Commissioning Agent. Provide competent, factory authorized personnel to provide instruction to operation and maintenance personnel concerning the location, operation, and troubleshooting of the installed systems. The instruction shall be scheduled in coordination with the COTR after submission and approval of formal training plans. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS and Division 22 Sections for additional Contractor training requirements.

----- END -----

SECTION 22 11 00
FACILITY WATER DISTRIBUTION**PART 1 - GENERAL****1.1 DESCRIPTION**

- A. Domestic water systems, including piping, equipment and all necessary accessories as designated in this section.

1.2 RELATED WORK

- A. Section 07 84 00, FIRESTOPPING: Penetrations in rated enclosures
- B. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- C. Section 22 07 11, PLUMBING INSULATION.
- D. SECTION 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS: Requirements for commissioning, systems readiness checklist, and training.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. All items listed in Part 2 - Products.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute (ANSI):
 - American Society of Mechanical Engineers (ASME): (Copyrighted Society)
 - A13.1-2007 Scheme for Identification of Piping Systems
 - B16.3-2006 Malleable Iron Threaded Fittings Classes 150 and 300
 - B16.9-2007 Gray Iron Threaded Fittings Classes 125 and 250
 - B16.9-2007 Factory-Made Wrought Butt Welding Fittings ANSI/ASME
 - B16.11-2009 Forged Fittings, Socket-Welding and Threaded ANSI/ASME
 - B16.12-2009 Cast Iron Threaded Drainage Fittings ANSI/ASME
 - B16.15-2006 Cast Bronze Threaded Fittings Classes 125 and 250 ANSI/ASME
 - B16.18-01 (R2005) Cast Copper Alloy Solder-Joint Pressure Fittings ANSI/ASME
 - B16.22-01 (R2005) Wrought Copper and Copper Alloy Solder Joint Pressure Fittings
ANSI/ASME Element ANSI/ASME
 - NSF/ANSI 61 Drinking Water System Components - Health Effects
- C. American Society for Testing and Materials (ASTM):
 - A47/A47M-99(2009) Ferritic Malleable Iron Castings Revision 1989
 - A53/A53M-07 Pipe, Steel, Black And Hot-Dipped, Zinc-coated Welded and
Seamless

| | |
|---|---|
| A183-03(2009) | Carbon Steel Track Bolts and Nuts |
| A269-10 | Standard Specification for Seamless and Welded Austenitic Stainless Steel Tubing for General Service |
| A312/A312M-09 | Seamless, Welded, and Heavily Cold Worked Austenitic Stainless Steel Pipes |
| A403/A403M-10a | Standard Specification for Wrought Austenitic Stainless Steel Piping Fittings |
| A536-84(2009) | Ductile Iron Castings |
| A733-03(2009) | Welded and Seamless Carbon Steel and Austenitic Stainless Steel Pipe Nipples |
| B32-08 | Solder Metal |
| B61-08 | Steam or Bronze Castings |
| B62-09 | Composition Bronze or Ounce Metal Castings |
| B75-02 | Seamless Copper Tube |
| B88-09 | Seamless Copper Water Tube |
| B300-10 | AWWA Standard for Hypochlorites |
| B301-10 | AWWA Standard for Liquid Chlorine |
| B584-09a | Copper Alloy Sand Castings for General Applications Revision A |
| B687-99(2005) e1 | Brass, Copper, and Chromium-Plated Pipe Nipples |
| D1785-06 | Standard Specification for Poly (Vinyl Chloride) (PVC) Plastic Pipe, Schedules 40, 80, and 120 |
| D2000-08 | Rubber Products in Automotive Applications |
| D4101-09 | Propylene Plastic Injection and Extrusion Materials |
| D2447-03 | Polyethylene (PE) Plastic Pipe, Schedule 40 and 80, Based on Outside Diameter |
| D2564-04(2009) e1 | Solvent Cements for Poly (Vinyl Chloride) (PVC) Plastic Pipe and Fittings |
| D4101-09 | Propylene Plastic Injection and Extrusion Materials |
| E1120-08 | Standard Specification For Liquid Chlorine |
| E1229-08 | Standard Specification For Calcium Hypochlorite |
| D. American Water Works Association (AWWA): | |
| C110-08 | Ductile Iron and Gray Iron Fittings - 75 mm thru 1200 mm (3 inch thru 48 inches) for Water and other liquids AWWA/ANSI |
| C151/A21.51-09 | Ductile-Iron Pipe, Centrifugally Cast in Metal Molds or Sand- Lined Molds, for Water or Other Liquids AWWA/ ANSI |
| C153/A21.53-06 | AWWA Standard for Ductile-Iron Compact Fittings for Water Service AWWA/ANSI |

- C203-08.....Coal-Tar Protective Coatings and Linings for Steel Water
Pipelines - Enamel and Tape - Hot Applied AWWA/ANSI
- C213-07.....Fusion Bonded Epoxy Coating For The Interior & Exterior Of
Steel Water Pipelines
- C651-05.....Disinfecting Water Mains
- E. American Welding Society (AWS):
A5.8/A5.8M:2004.....Filler Metals for Brazing
- F. International Plumbing Code
International Plumbing Code – 2009
- G. American Society of Sanitary Engineers (ASSE):
ANSI/ASSE (Plumbing)
1001-2008Pipe Applied Atmospheric Type Vacuum Breakers
ANSI/ASSE 1010-2004Water Hammer Arresters
ANSI/ASSE 1018-2001Performance for trap seal primer valves – potable water supplied.
ANSI/ASSE (Plumbing)
1020-2004Pressure Vacuum Breaker Assembly
- H. Plumbing and Drainage Institute (PDI):
PDI WH-201 2007.....Water Hammer Arrestor

1.5 QUALITY ASSURANCE

- A. Submit prior to welding of steel piping a certificate of Welder's certification. The certificate shall be current and more than one year old.
- B. For mechanical pressed sealed fittings, only tools of fitting manufacture shall be used.
- C. Mechanical pressed fittings shall be installed by factory trained workers.
- D. All grooved joint couplings, fittings, valves, and specialties shall be the products of a single manufacturer. Grooving tools shall be by the same manufacturer as the groove components.
- E. All castings used for coupling housings, fittings, valve bodies, etc., shall be date stamped for quality assurance and traceability.

1.6 SPARE PARTS

- A. For mechanical pressed sealed fittings provide tools required for each pipe size used at the facility.

PART 2 - PRODUCTS

2.1 ABOVE GROUND (INTERIOR) WATER PIPING

- A. Pipe: Copper tube, ASTM B88, Type K or L, drawn. For pipe 150 mm (6 inches) and larger, stainless, steel ASTM A312, schedule 10 may be used.
- B. Fittings for Copper Tube:

1. Wrought copper or bronze castings conforming to ANSI B16.18 and B16.22. Unions shall be bronze, MSS SP72 & SP 110, Solder or braze joints. Use 95/5 tin and antimony for all soldered joints.
 2. Grooved fittings, 50 to 150 mm (2 to 6 inch) wrought copper ASTM B75 C12200, 125 to 150 mm (5 to 6 inch) bronze casting ASTM B584, CDA 844. Mechanical grooved couplings, ductile iron, ASTM A536 (Grade 65-45-12), or malleable iron, ASTM A47 (Grade 32510) housing, with EPDM gasket, steel track head bolts, ASTM A183, coated with copper colored alkyd enamel.
 3. Mechanical press sealed fittings, 65 mm (2 1/2") in size and smaller. Fittings shall be double pressed type NSF/ANSI 61 approved and utilize EPDM (Ethylene Propylene Diene Monomer) non toxic synthetic rubber sealing elements.
- C. Fittings for Stainless Steel:
1. Stainless steel butt-welded fittings, Type 316, Schedule 10, conforming to ANSI B16.9.
 2. Grooved fittings, stainless steel, Type 316, Schedule 10, conforming to ASTM A403. Segmentally fabricated fittings are not allowed. Mechanical grooved couplings, ductile iron, ASTM A536 (Grade 65-45-12), or Malleable iron, ASTM A47 (Grade 32510) housing, with EPDM gasket, steel track head bolts, ASTM A183, coated with copper colored alkyd enamel.
- D. Adapters: Provide adapters for joining screwed pipe to copper tubing.
- E. Solder: ASTM B32 Composition Sb5 HA or HB. Provide non-corrosive flux.
- F. Brazing alloy: AWS A5.8, Classification BCuP.

2.2 STRAINERS

- A. Provide on high pressure side of pressure reducing valves, on suction side of pumps, on inlet side of indicating and control instruments and equipment subject to sediment damage and where shown on drawings. Strainer element shall be removable without disconnection of piping.
- B. Water: Basket or "Y" type with easily removable cover and brass strainer basket.
- C. Body: Smaller than 80 mm (3 inches), brass or bronze; 80 mm (3 inches) and larger, cast iron or semi-steel.

2.3 DIELECTRIC FITTINGS

- A. Provide dielectric couplings or unions between ferrous and non-ferrous pipe.

2.4 STERILIZATION CHEMICALS

- A. Hypochlorites ANSI/AWWA B300-10
- B. Liquid Chlorine ANSI/AWWA B301-10

PART 3 - EXECUTION

3.1 INSTALLATION

- A. General: Comply with the International Plumbing Code and the following:

1. Install branch piping for water from the piping system and connect to all fixtures, valves, cocks, outlets, casework, cabinets and equipment, including those furnished by the Government or specified in other sections.
2. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe, except for plastic and glass, shall be reamed to full size after cutting.
3. All pipe runs shall be laid out to avoid interference with other work.
4. Install union and shut-off valve on pressure piping at connections to equipment.
5. Pipe Hangers, Supports and Accessories:
 - a. All piping shall be supported per the International Plumbing Code, Chapter No. 3.
 - b. Shop Painting and Plating: Hangers, supports, rods, inserts and accessories used for pipe supports shall be shop coated with red lead or zinc chromate primer paint. Electroplated copper hanger rods, hangers and accessories may be used with copper tubing.
 - c. Floor, Wall and Ceiling Plates, Supports, Hangers:
 - 1) Solid or split unplated cast iron.
 - 2) All plates shall be provided with set screws.
 - 3) Pipe Hangers: Height adjustable clevis type.
 - 4) Adjustable Floor Rests and Base Flanges: Steel.
 - 5) Concrete Inserts: "Universal" or continuous slotted type.
 - 6) Hanger Rods: Mild, low carbon steel, fully threaded or Threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
 - 7) Riser Clamps: Malleable iron or steel.
 - 8) Rollers: Cast iron.
 - 9) Self-drilling type expansion shields shall be "Phillips" type, with case hardened steel expander plugs.
 - 10) Hangers and supports utilized with insulated pipe and tubing shall have 180 degree (min.) metal protection shield Centered on and welded to the hanger and support. The shield shall be 4 inches in length and be 16 gauge steel. The shield shall be sized for the insulation.
 - 11) Miscellaneous Materials: As specified, required, directed or as noted on the drawings for proper installation of hangers, supports and accessories. If the vertical distance exceeds 6 m (20 feet) for cast iron pipe additional support shall be provided in the center of that span. Provide all necessary auxiliary steel to provide that support.
 - 12) With the installation of each flexible expansion joint, provide piping restraints for the upstream and downstream section of the piping at the flexible expansion joint. Provide calculations supporting the restraint length design and type of selected restraints.

6. Install chrome plated cast brass escutcheon with set screw at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
7. Penetrations:
 - a. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING. Completely fill and seal clearances between raceways and openings with the fire stopping materials.
 - b. Waterproofing: At floor penetrations, completely seal clearances around the pipe and make watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS.
- B. Piping shall conform to the following:
 1. Domestic Water:
 - a. Grade all lines to facilitate drainage. Provide drain valves at bottom of risers and all low points in system. Design domestic hot water circulating lines with no traps.
 - b. Connect branch lines at bottom of main serving fixtures below and pitch down so that main may be drained through fixture. Connect branch lines to top of main serving only fixtures located on floor above.

3.2 TESTS

- A. General: Test system either in its entirety or in sections.
- B. Potable Water System: Test after installation of piping and domestic water heaters, but before piping is concealed, before covering is applied, and before plumbing fixtures are connected. Fill systems with water and maintain hydrostatic pressure of 690 kPa (100 psi) gage for two hours. No decrease in pressure is allowed. Provide a pressure gage with a shutoff and bleeder valve at the highest point of the piping being tested.
- C. Reagent Grade Water Systems: Fill system with water and maintain hydrostatic pressure of 690 kPa (100 psi) gage during inspection and prove tight.
- D. All Other Piping Tests: Test new installed piping under 1 1/2 times actual operating conditions and prove tight.

3.3 STERILIZATION

- A. After tests have been successfully completed, thoroughly flush and sterilize the interior domestic water distribution system in accordance with AWWA C651.
- B. Use liquid chlorine or hypochlorites for sterilization.

3.4 COMMISSIONING

- A. Provide commissioning documentation accordance with the requirements of Section 22 08 00 – COMMISSIONING OF PLUMBING SYSTEMS for all inspection, startup, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.

- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 22 08 00 – COMMISSIONING OF PLUMBING SYSTEMS and related sections for contractor responsibilities for system commissioning.

- - - E N D - - -

**SECTION 22 11 23
DOMESTIC WATER PUMPS****PART 1 - GENERAL****1.1 DESCRIPTION**

- A. Hot water recirculation pump.

1.2 RELATED WORK

- A. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- B. SECTION 22 08 00 – COMMISSIONING OF PLUMBING SYSTEMS.
Requirements for commissioning, systems readiness checklist, and training.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Pump:
 - a. Manufacturer and model.
 - b. Operating speed.
 - c. Capacity.
 - d. Characteristic performance curves.
 - 2. Motor:
 - a. Manufacturer, frame and type.
 - b. Speed.
 - c. Current Characteristics.
 - d. Efficiency.
- C. Complete operating and maintenance manuals including wiring diagrams, technical data sheets and information for ordering replaceable parts:
 - 1. Include complete list indicating all components of the systems.
 - 2. Include complete diagrams of the internal wiring for each item of equipment.
 - 3. Diagrams shall have their terminals identified to facilitate installation, operation and maintenance.
- D. Completed System Readiness Checklist provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 22 08 00 COMMISSIONING OF PLUMBING SYSTEMS.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

- B. National Electrical Manufacturers Association (NEMA):
 - ICS6-93 (R2006) Industrial Control and Systems Enclosures
 - 250-08 Enclosures for Electrical Equipment (1000 Volts Maximum)
- C. American Society of Mechanical Engineers (ASME):
 - Boiler and Pressure Vessel Code: 2010
 - Section VIII Pressure Vessels, Division I and II
- D. Underwriters' Laboratories, Inc. (UL):
 - 508-99 (R2008) Standards for Industrial Control Equipment

PART 2 - PRODUCTS

2.1 INLINE HOT WATER RECIRCULATING PUMP

- A. Centrifugal in-line horizontal oil lubricated pump designed for quiet operation and 862 kPa (125 psi).
- B. Bronze body construction capable of pumping 75.7 LPM (20 GPM) @ 10.7 Meters of head (35 Feet of head) when drive by 0.4 HP single phase, 120 VAC motor. Pump shall be non-overloading at any point on the pump curve.
- C. Pump shall be constant running. In addition, the pump shall be provided with "on-off" switch for shut down. In the inlet and outlet piping of the pump shutoff valves shall be installed to permit service to the pump without draining the system. A check valve shall be installed in the pump discharge piping immediately downstream of the pump.

PART 3 - EXECUTION

3.1 STARTUP AND TESTING

- A. Make tests as recommended by product manufacturer and listed standards and under actual or simulated operating conditions and prove full compliance with design and specified requirements. Tests of the various items of equipment shall be performed simultaneously with the system of which each item is an integral part.
- B. System Test: After installation is completed provide an operational test of the completed system including flow rates, pressure compliance, alarms and all control functions.
- C. When any defects are detected, correct defects and repeat test.
- D. The Commissioning Agent will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the COTR and Commissioning Agent. Provide a minimum of 7 days prior to notice.

3.2 COMMISSIONING

- A. Provide Commissioning Documentation accordance with the requirements of Section 22 08 00 – COMMISSIONING OF PLUMBING SYSTEMS for all inspection, startup, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.

- B. Components provided under this Section of the specification will be tested as part of a larger system. Refer to Section 22 08 00 – COMMISSIONING OF PLUMBING SYSTEMS and related sections for contractor responsibilities for system commissioning.

3.3 DEMONSTRATION AND TRAINING

- A. Provide services of manufacturer's technical representative for four hours to instruct VA Personnel in operation and maintenance of units.
- B. Submit training plans and instructor qualifications in accordance with the requirements of Section 22 08 00 COMMISSIONING OF PLUMBING SYSTEMS.

- - - E N D - - -

**SECTION 23 05 11
COMMON WORK RESULTS FOR HVAC****PART 1 - GENERAL****1.1 DESCRIPTION**

- A. The requirements of this Section apply to all sections of Division 23.
- B. Definitions:
 - 1. Exposed: Piping, ductwork, and equipment exposed to view in finished rooms.
 - 2. Option or optional: Contractor's choice of an alternate material or method.
 - 3. COTR: Contracting Officer's Technical Representative.

1.2 RELATED WORK

- C. Section 01 00 00, GENERAL REQUIREMENTS
- D. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES
- E. Section 02 82 13.13, PIPE INSULATION – GLOVEBAG ASBESTOS ABATEMENT
- F. Section 02 82 13.31 ASBESTOS GASKET ABATEMENT.
- G. Section 31 20 00, EARTHWORK: Excavation and Backfill
- F. Section 05 50 00, METAL FABRICATIONS
- G. Section 07 84 00, FIRESTOPPING
- H. Section 07 92 00, JOINT SEALANTS
- I. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT
- J. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT
- K. Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC
- L. Section 23 07 11, HVAC AND BOILER PLANT INSULATION
- M. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC
- N. Section 23 21 13, HYDRONIC PIPING
- O. Section 23 21 23, HYDRONIC PUMPS
- P. Section 23 22 13, STEAM AND CONDENSATE HEATING PIPING
- Q. Section 23 25 00, HVAC WATER TREATMENT
- R. Section 23 82 00, CONVECTION HEATING AND COOLING UNITS
- S. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS: Requirements for commissioning, systems readiness checklists, and training
- T. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS
- U. Section 26 29 11, MOTOR CONTROLLERS.

1.3 QUALITY ASSURANCE

- A. Mechanical, electrical and associated systems shall be safe, reliable, efficient, durable, easily and safely operable and maintainable, easily and safely accessible, and in compliance with applicable codes as specified. The systems shall be comprised of high quality institutional-class and

industrial-class products of manufacturers that are experienced specialists in the required product lines. All construction firms and personnel shall be experienced and qualified specialists in industrial and institutional HVAC.

- B. Flow Rate Tolerance for HVAC Equipment: Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.
- C. Equipment Vibration Tolerance:
 - 1. Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT. Equipment shall be factory-balanced to this tolerance and re-balanced on site, as necessary.
 - 2. After HVAC air balance work is completed and permanent drive sheaves are in place, perform field mechanical balancing and adjustments required to meet the specified vibration tolerance.
- D. Products Criteria:
 - 1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture of the products for at least 3 years (or longer as specified elsewhere). The design, model and size of each item shall have been in satisfactory and efficient operation on at least three installations for approximately three years. However, digital electronics devices, software and systems such as controls, instruments, computer work station, shall be the current generation of technology and basic design that has a proven satisfactory service record of at least three years. See other specification sections for any exceptions and/or additional requirements.
 - 2. All items furnished shall be free from defects that would adversely affect the performance, maintainability and appearance of individual components and overall assembly.
 - 3. Conform to codes and standards as required by the specifications. Conform to local codes, if required by local authorities such as the natural gas supplier, if the local codes are more stringent than those specified. Refer any conflicts to the Contracting Officer's Technical Representative (COTR).
 - 4. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be products of one manufacturer.
 - 5. Assembled Units: Manufacturers of equipment assemblies, which use components made by others, assume complete responsibility for the final assembled product.
 - 6. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
 - 7. Asbestos products or equipment or materials containing asbestos shall not be used.
- E. Equipment Service Organizations:
 - 1. HVAC: Products and systems shall be supported by service organizations that maintain a complete inventory of repair parts and are located within 50 miles to the site.

- F. HVAC Mechanical Systems Welding: Before any welding is performed, contractor shall submit a certificate certifying that welders comply with the following requirements:
1. Qualify welding processes and operators for piping according to ASME "Boiler and Pressure Vessel Code", Section IX, "Welding and Brazing Qualifications".
 2. Comply with provisions of ASME B31 series "Code for Pressure Piping".
 3. Certify that each welder has passed American Welding Society (AWS) qualification tests for the welding processes involved, and that certification is current.
- G. Execution (Installation, Construction) Quality:
1. Apply and install all items in accordance with manufacturer's written instructions. Refer conflicts between the manufacturer's instructions and the contract drawings and specifications to the COTR for resolution. Provide written hard copies or computer files of manufacturer's installation instructions to the COTR at least two weeks prior to commencing installation of any item. Installation of the item will not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations is a cause for rejection of the material.
 2. All items that require access, such as for operating, cleaning, servicing, maintenance, and calibration, shall be easily and safely accessible by persons standing at floor level, or standing on permanent platforms, without the use of portable ladders. Examples of these items include, but are not limited to: all types of valves, filters and strainers, transmitters, control devices. Prior to commencing installation work, refer conflicts between this requirement and contract drawings to the COTR for resolution.
 3. Provide complete layout drawings required by Paragraph, SUBMITTALS. Do not commence construction work on any system until the layout drawings have been approved.
- H. Upon request by Government, provide lists of previous installations for selected items of equipment. Include contact persons who will serve as references, with telephone numbers and e-mail addresses.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, and with requirements in the individual specification sections.
- B. Contractor shall make all necessary field measurements and investigations to assure that the equipment and assemblies will meet contract requirements.
- C. If equipment is submitted which differs in arrangement from that shown, provide drawings that show the rearrangement of all associated systems. Approval will be given only if all features of the equipment and associated systems, including accessibility, are equivalent to that required by the contract.
- D. Prior to submitting shop drawings for approval, contractor shall certify in writing that manufacturers of all major items of equipment have each reviewed drawings and specifications, and have jointly coordinated and properly integrated their equipment and controls to provide a complete and efficient installation.

- E. Submittals and shop drawings for interdependent items, containing applicable descriptive information, shall be furnished together and complete in a group. Coordinate and properly integrate materials and equipment in each group to provide a completely compatible and efficient installation. Final review and approval will be made only by groups.
- F. Samples: Samples will not be required, except where materials offered differ from specification requirements. Samples shall be accompanied by full description of characteristics different from specification. The Government, at the Government's expense, will perform evaluation and testing if necessary. The Contractor may submit samples of additional material at the Contractor's option; however, if additional samples of materials are submitted later, pursuant to Government request, adjustment in contract price and time will be made as provided in the GENERAL CONDITIONS.
- G. Mock-ups: Mock-ups are required for critical items and typical component installations replicated numerous times throughout the project as directed by the COTR. The COTR and Medical Center Representatives shall review and approve the mock-up prior to installation of additional applicable components.
- H. Manufacturer's Literature and Data: Submit under the pertinent section rather than under this section.
 - 1. Submit electric motor data with the driven equipment.
 - a. Variable speed drive data for motors shall be submitted under the appropriate Division 26 specification section. Coordinate requirements with E.C.
 - 2. Equipment and materials identification.
 - 3. Fire-stopping materials.
 - 4. Hangers, inserts, supports and bracing. Provide load calculations for variable spring and constant support hangers.
 - 5. Wall, floor, and ceiling plates.
- I. HVAC Maintenance Data and Operating Instructions:
 - 1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment.
 - 2. Provide a listing of recommended replacement parts for keeping in stock supply, including sources of supply, for equipment.
- J. Provide copies of approved HVAC equipment submittals to the Testing, Adjusting and Balancing Subcontractor.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Conditioning, Heating and Refrigeration Institute (AHRI):
430-2009 Central Station Air-Handling Units
- C. American National Standard Institute (ANSI):
B31.1-2007 Power Piping

- D. Rubber Manufacturers Association (ANSI/RMA):
 - IP-20-2007.....Specifications for Drives Using Classical V-Belts and Sheaves
 - IP-21-2009.....Specifications for Drives Using Double-V (Hexagonal) Belts
 - IP-22-2007.....Specifications for Drives Using Narrow V-Belts and Sheaves
- E. Air Movement and Control Association (AMCA):
 - 410-96Recommended Safety Practices for Air Moving Devices
- F. American Society of Mechanical Engineers (ASME):
 - Boiler and Pressure Vessel Code (BPVC):
 - Section I-2007Power Boilers
 - Section IX-2007.....Welding and Brazing Qualifications
 - Code for Pressure Piping:
 - B31.1-2007.....Power Piping
- G. American Society for Testing and Materials (ASTM):
 - A36/A36M-08Standard Specification for Carbon Structural Steel
 - A575-96(2007)Standard Specification for Steel Bars, Carbon, Merchant Quality, M-Grades
 - E84-10.....Standard Test Method for Surface Burning Characteristics of Building Materials
 - E119-09c.....Standard Test Methods for Fire Tests of Building Construction and Materials
- H. Manufacturers Standardization Society (MSS) of the Valve and Fittings Industry, Inc:
 - SP-58-2009Pipe Hangers and Supports-Materials, Design and Manufacture, Selection, Application, and Installation
 - SP 69-2003Pipe Hangers and Supports-Selection and Application
 - SP 127-2001Bracing for Piping Systems, Seismic – Wind – Dynamic, Design, Selection, Application
- I. National Electrical Manufacturers Association (NEMA):
 - MG-1-2009Motors and Generators
- J. National Fire Protection Association (NFPA):
 - 31-06Standard for Installation of Oil-Burning Equipment
 - 54-09National Fuel Gas Code
 - 70-08National Electrical Code
 - 85-07Boiler and Combustion Systems Hazards Code
 - 90A-09.....Standard for the Installation of Air Conditioning and Ventilating Systems
 - 101-09Life Safety Code

1.6 DELIVERY, STORAGE AND HANDLING

- A. Protection of Equipment:

1. Equipment and material placed on the job site shall remain in the custody of the Contractor until phased acceptance, whether or not the Government has reimbursed the Contractor for the equipment and material. The Contractor is solely responsible for the protection of such equipment and material against any damage.
 2. Place damaged equipment in first class, new operating condition; or, replace same as determined and directed by the COTR. Such repair or replacement shall be at no additional cost to the Government.
 3. Protect interiors of new equipment and piping systems against entry of foreign matter. Clean both inside and outside before painting or placing equipment in operation.
 4. Existing equipment and piping being worked on by the Contractor shall be under the custody and responsibility of the Contractor and shall be protected as required for new work.
- B. Cleanliness of Piping and Equipment Systems:
1. Exercise care in storage and handling of equipment and piping material to be incorporated in the work. Remove debris arising from cutting, threading and welding of piping.
 2. Piping systems shall be flushed, blown or pigged as necessary to deliver clean systems.
 3. Clean interior of all tanks prior to delivery for beneficial use by the Government.
 4. Contractor shall be fully responsible for all costs, damage, and delay arising from failure to provide clean systems.

1.7 JOB CONDITIONS – WORK IN EXISTING BUILDING

- A. Building Operation: Government employees will be continuously operating and managing all facilities, including temporary facilities, that serve the medical center.
- B. Maintenance of Service: Schedule all work to permit continuous service as required by the medical center.
- C. Steam and Condensate Service Interruptions: Limited steam and condensate service interruptions, as required for interconnections of new and existing systems, will be permitted by the COTR during periods when the demands are not critical to the operation of the medical center. These non-critical periods are limited to between 8 pm and 5 am in the appropriate off-season (if applicable). Provide at least one week advance notice to the COTR.
- D. Phasing of Work: Comply with all requirements shown on drawings or specified.
- E. Building Working Environment: Maintain the architectural and structural integrity of the building and the working environment at all times. Maintain the interior of building at 18 degrees C (65 degrees F) minimum. Limit the opening of doors, windows or other access openings to brief periods as necessary for rigging purposes. No storm water or ground water leakage permitted. Provide daily clean-up of construction and demolition debris on all floor surfaces and on all equipment being operated by VA.
- F. Acceptance of Work for Government Operation: As new facilities are made available for operation and these facilities are of beneficial use to the Government, inspections will be made and tests will be performed. Based on the inspections, a list of contract deficiencies will be issued to the

Contractor. After correction of deficiencies as necessary for beneficial use, the Contracting Officer will process necessary acceptance and the equipment will then be under the control and operation of Government personnel.

- G. Temporary Facilities: Refer to Article, TEMPORARY PIPING AND EQUIPMENT in this section.

PART 2 - PRODUCTS

2.1 FACTORY-ASSEMBLED PRODUCTS

- A. Provide maximum standardization of components to reduce spare part requirements.
- B. Manufacturers of equipment assemblies that include components made by others shall assume complete responsibility for final assembled unit.
 - 1. All components of an assembled unit need not be products of same manufacturer.
 - 2. Constituent parts that are alike shall be products of a single manufacturer.
 - 3. Components shall be compatible with each other and with the total assembly for intended service.
 - 4. Contractor shall guarantee performance of assemblies of components, and shall repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly.
- C. Components of equipment shall bear manufacturer's name and trademark, model number, serial number and performance data on a name plate securely affixed in a conspicuous place, or cast integral with, stamped or otherwise permanently marked upon the components of the equipment.
- D. Major items of equipment, which serve the same function, must be the same make and model. Exceptions will be permitted if performance requirements cannot be met.

2.2 COMPATIBILITY OF RELATED EQUIPMENT

Equipment and materials installed shall be compatible in all respects with other items being furnished and with existing items so that the result will be a complete and fully operational plant that conforms to contract requirements.

2.3 DRIVE GUARDS

- A. For machinery and equipment, provide guards as shown in AMCA 410 for belts, chains, couplings, pulleys, sheaves, shafts, gears and other moving parts regardless of height above the floor to prevent damage to equipment and injury to personnel. Drive guards may be excluded where motors and drives are inside factory fabricated air handling unit casings.
- B. Pump shafts and couplings shall be fully guarded by a sheet steel guard, covering coupling and shaft but not bearings. Material shall be minimum 16-gage sheet steel; ends shall be braked and drilled and attached to pump base with minimum of four 6 mm (1/4-inch) bolts. Reinforce guard as necessary to prevent side play forcing guard onto couplings.
- C. Materials: Sheet steel, cast iron, expanded metal or wire mesh rigidly secured so as to be removable without disassembling pipe, duct, or electrical connections to equipment.
- D. Access for Speed Measurement: 25 mm (One inch) diameter hole at each shaft center.

2.4 LIFTING ATTACHMENTS

Provide equipment with suitable lifting attachments to enable equipment to be lifted in its normal position. Lifting attachments shall withstand any handling conditions that might be encountered, without bending or distortion of shape, such as rapid lowering and braking of load.

2.5 ELECTRIC MOTORS

- A. All material and equipment furnished and installation methods shall conform to the requirements of Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT; Section 26 29 11, MOTOR CONTROLLERS; and, Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). Provide all electrical wiring, conduit, and devices necessary for the proper connection, protection and operation of the systems. Provide special energy efficient premium efficiency type motors as scheduled.

2.6 VARIABLE SPEED MOTOR CONTROLLERS

- A. Refer to Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS and Section 26 29 11, MOTOR CONTROLLERS for specifications.
- B. The motor shall be provided by the manufacturer of the driven equipment, such as pumps and fans. Variable speed motor controllers are specified in Section 26 29 11 MOTOR CONTROLLERS, and shall be provided by the Division 26 Contractor. The combination of controller and motor shall be compatible, and shall be rated for 100 percent output performance. HVAC Contractor shall coordinate motor and controller requirements with the Division 26 Contractor. Multiple units of the same class of equipment, i.e. air handlers, fans, pumps, shall be product of a single manufacturer.
- C. Motors shall be premium efficiency type and be approved by the motor controller manufacturer. The controller-motor combination shall be guaranteed to provide full motor nameplate horsepower in variable frequency operation. Both driving and driven motor/fan sheaves shall be fixed pitch.
- D. Controller shall not add any current or voltage transients to the input AC power distribution system, DDC controls, sensitive medical equipment, etc., nor shall be affected from other devices on the AC power system.

2.7 EQUIPMENT AND MATERIALS IDENTIFICATION

- A. Use symbols, nomenclature and equipment numbers specified, shown on the drawings and shown in the maintenance manuals. Identification for piping is specified in Paragraph 3.7 below.
- B. Interior (Indoor) Equipment: Engraved nameplates, with letters not less than 48 mm (3/16-inch) high of brass with black-filled letters, or rigid black plastic with white letters, permanently fastened to the equipment. Identify unit components such as coils, filters, fans, etc.
- C. Exterior (Outdoor) Equipment: Brass nameplates, with engraved black filled letters, not less than 48 mm (3/16-inch) high riveted or bolted to the equipment.

- D. Control Items: Label all temperature and humidity sensors, controllers and control dampers. Identify and label each item as they appear on the control diagrams.
- E. Valve Tags and Lists:
 - 1. HVAC: Provide for all valves other than for equipment in Section 23 82 00, CONVECTION HEATING AND COOLING UNITS.
 - 2. Valve tags: Engraved black filled numbers and letters not less than 13 mm (1/2-inch) high for number designation, and not less than 6.4 mm (1/4-inch) for service designation on 19 gage 38 mm (1-1/2 inches) round brass disc, attached with brass "S" hook or brass chain.
 - 3. Valve lists: Typed or printed plastic coated card(s), sized 216 mm (8-1/2 inches) by 280 mm (11 inches) showing tag number, valve function and area of control, for each service or system. Punch sheets for a 3-ring notebook.
 - 4. Provide detailed plan for each floor of the building indicating the location and valve number for each valve. Identify location of each valve with a color coded thumb tack in ceiling.

2.8 FIRESTOPPING

Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping and ductwork. Refer to Section 23 07 11, HVAC AND BOILER PLANT INSULATION, for firestop pipe and duct insulation.

2.9 GALVANIZED REPAIR COMPOUND

Mil. Spec. DOD-P-21035B, paint form.

2.10 HVAC PIPE AND EQUIPMENT SUPPORTS AND RESTRAINTS

- A. Vibration Isolators: Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- B. Supports for Roof Mounted Items:
 - 1. Equipment: Equipment rails shall be galvanized steel, minimum 1.3 mm (18 gauge), with integral baseplate, continuous welded corner seams, factory installed 50 mm by 100 mm (2 by 4) treated wood nailer, 1.3 mm (18 gauge) galvanized steel counter flashing cap with screws, built-in cant strip, (except for gypsum or tectum deck), minimum height 280 mm (11 inches). For surface insulated roof deck, provide raised cant strip to start at the upper surface of the insulation.
 - 2. Pipe/duct pedestals: Provide a galvanized Unistrut channel welded to U-shaped mounting brackets which are secured to side of rail with galvanized lag bolts.
- C. Pipe Supports: Comply with MSS SP-58. Type Numbers specified refer to this standard. For selection and application comply with MSS SP-69. Refer to Section 05 50 00, METAL FABRICATIONS, for miscellaneous metal support materials and prime coat painting requirements.
- D. Attachment to Concrete Building Construction:
 - 1. Concrete insert: MSS SP-58, Type 18.

2. Self-drilling expansion shields and machine bolt expansion anchors: Permitted in concrete not less than 102 mm (four inches) thick when approved by the COTR for each job condition.
 3. Power-driven fasteners: Not permitted.
- E. Attachment to Steel Building Construction:
1. Welded attachment: MSS SP-58, Type 22.
 2. Beam clamps: MSS SP-58, Types 20, 21, 28 or 29. Type 23 C-clamp may be used for individual copper tubing up to 23mm (7/8-inch) outside diameter.
- F. Attachment to Metal Pan or Deck: As required for existing materials.
- G. Attachment to existing structure: Support from existing floor/roof frame.
- H. Attachment to Wood Construction: Wood screws or lag bolts.
- I. Hanger Rods: Hot-rolled steel, ASTM A36 or A575 for allowable load listed in MSS SP-58. For piping, provide adjustment means for controlling level or slope. Types 13 or 15 turn-buckles shall provide 38 mm (1-1/2 inches) minimum of adjustment and incorporate locknuts. All-thread rods are acceptable.
- J. Hangers Supporting Multiple Pipes (Trapeze Hangers): Galvanized, cold formed, lipped steel channel horizontal member, not less than 41 mm by 41 mm (1-5/8 inches by 1-5/8 inches), 2.7 mm (No. 12 gage), designed to accept special spring held, hardened steel nuts. Not permitted for steam supply and condensate piping.
1. Allowable hanger load: Manufacturers rating less 91kg (200 pounds).
 2. Guide individual pipes on the horizontal member of every other trapeze hanger with 6 mm (1/4-inch) U-bolt fabricated from steel rod. Provide Type 40 insulation shield, secured by two 13mm (1/2-inch) galvanized steel bands, or preinsulated calcium silicate shield for insulated piping at each hanger.
- K. Supports for Piping Systems:
1. Select hangers sized to encircle insulation on insulated piping. Refer to Section 23 07 11, HVAC AND BOILER PLANT INSULATION for insulation thickness. To protect insulation, provide Type 39 saddles for roller type supports or preinsulated calcium silicate shields. Provide Type 40 insulation shield or preinsulated calcium silicate shield at all other types of supports and hangers including those for preinsulated piping.
 2. Piping Systems except High and Medium Pressure Steam (MSS SP-58):
 - a. Standard clevis hanger: Type 1; provide locknut.
 - b. Riser clamps: Type 8.
 - c. Wall brackets: Types 31, 32 or 33.
 - d. Roller supports: Type 41, 43, 44 and 46.
 - e. Saddle support: Type 36, 37 or 38.
 - f. Turnbuckle: Types 13 or 15. Preinsulate.
 - g. U-bolt clamp: Type 24.
 - h. Copper Tube:

- 1) Hangers, clamps and other support material in contact with tubing shall be painted with copper colored epoxy paint, plastic coated or taped with non adhesive isolation tape to prevent electrolysis.
 - 2) For vertical runs use epoxy painted or plastic coated riser clamps.
 - 3) For supporting tube to strut: Provide epoxy painted pipe straps for copper tube or plastic inserted vibration isolation clamps.
 - 4) Insulated Lines: Provide pre-insulated calcium silicate shields sized for copper tube.
3. High and Medium Pressure Steam (MSS SP-58):
- a. Provide eye rod or Type 17 eye nut near the upper attachment.
 - b. Piping 50 mm (2 inches) and larger: Type 43 roller hanger. For roller hangers requiring seismic bracing provide a Type 1 clevis hanger with Type 41 roller attached by flat side bars.
 - c. Piping with Vertical Expansion and Contraction:
 - 1) Movement up to 20 mm (3/4-inch): Type 51 or 52 variable spring unit with integral turn buckle and load indicator.
 - 2) Movement more than 20 mm (3/4-inch): Type 54 or 55 constant support unit with integral adjusting nut, turn buckle and travel position indicator.
4. Converter Hangers: May be Type 1 sized for the shell diameter. Insulation where required shall cover the hangers.
- L. Pre-insulated Calcium Silicate Shields:
1. Provide 360 degree water resistant high density 965 kPa (140 psi) compressive strength calcium silicate shields encased in galvanized metal.
 2. Pre-insulated calcium silicate shields to be installed at the point of support during erection.
 3. Shield thickness shall match the pipe insulation.
 4. The type of shield is selected by the temperature of the pipe, the load it must carry, and the type of support it will be used with.
 - a. Shields for supporting chilled or cold water shall have insulation that extends a minimum of 1 inch past the sheet metal. Provide for an adequate vapor barrier in chilled lines.
 - b. The pre-insulated calcium silicate shield shall support the maximum allowable water filled span as indicated in MSS-SP 69. To support the load, the shields may have one or more of the following features: structural inserts 4138 kPa (600 psi) compressive strength, an extra bottom metal shield, or formed structural steel (ASTM A36) wear plates welded to the bottom sheet metal jacket.
6. Shields may be used on steel clevis hanger type supports, roller supports or flat surfaces.

2.11 PIPE PENETRATIONS

- A. Install sleeves during construction for other than blocked out floor openings for risers in mechanical bays.
- B. To prevent accidental liquid spills from passing to a lower level, provide the following:

1. For sleeves: Extend sleeve 25 mm (one inch) above finished floor and provide sealant for watertight joint.
 2. For blocked out floor openings: Provide 40 mm (1-1/2 inch) angle set in silicone adhesive around opening.
 3. For drilled penetrations: Provide 40 mm (1-1/2 inch) angle ring or square set in silicone adhesive around penetration.
- C. Penetrations are not allowed through beams or ribs, but may be installed in concrete beam flanges. Any deviation from these requirements must receive prior approval of COTR.
- D. Sheet Metal, Plastic, or Moisture-resistant Fiber Sleeves: Provide for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.
- E. Cast Iron or Zinc Coated Pipe Sleeves: Provide for pipe passing through exterior walls below grade. Make space between sleeve and pipe watertight with a modular or link rubber seal. Seal shall be applied at both ends of sleeve.
- F. Galvanized Steel or an alternate Black Iron Pipe with asphalt coating Sleeves: Provide for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. Provide sleeve for pipe passing through floor of mechanical rooms. Except in mechanical rooms, connect sleeve with floor plate.
- G. Brass Pipe Sleeves: Provide for pipe passing through quarry tile, terrazzo or ceramic tile floors. Connect sleeve with floor plate.
- H. Sleeves are not required for wall hydrants for fire department connections or in drywall construction.
- I. Sleeve Clearance: Sleeve through floors, walls, partitions, and beam flanges shall be one inch greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation. Interior openings shall be caulked tight with fire stopping material and sealant to prevent the spread of fire, smoke, and gases.
- J. Sealant and Adhesives: Shall be as specified in Section 07 92 00, JOINT SEALANTS.

2.12 SPECIAL TOOLS AND LUBRICANTS

- A. Furnish, and turn over to the COTR, tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.
- B. Grease Guns with Attachments for Applicable Fittings: One for each type of grease required for each motor or other equipment.
- C. Tool Containers: Hardwood or metal, permanently identified for intended service and mounted, or located, where directed by the COTR.
- D. Lubricants: A minimum of 0.95 L (one quart) of oil, and 0.45 kg (one pound) of grease, of equipment manufacturer's recommended grade and type, in unopened containers and properly identified as to use for each different application.

2.13 WALL, FLOOR AND CEILING PLATES

- A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.
- B. Thickness: Not less than 2.4 mm (3/32-inch) for floor plates. For wall and ceiling plates, not less than 0.64 mm (0.025-inch) for up to 80 mm (3-inch pipe), 0.89 mm (0.035-inch) for larger pipe.
- C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Provide a watertight joint in spaces where brass or steel pipe sleeves are specified.

2.14 ASBESTOS

Materials containing asbestos are not permitted.

PART 3 - EXECUTION**3.1 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING**

- A. Coordinate location of piping, sleeves, inserts, hangers, ductwork and equipment. Locate piping, sleeves, inserts, hangers, ductwork and equipment clear of windows, doors, openings, light outlets, and other services and utilities. Prepare equipment layout drawings to coordinate proper location and personnel access of all facilities. Submit the drawings for review as required by Part 1. Follow manufacturer's published recommendations for installation methods not otherwise specified.
- B. Operating Personnel Access and Observation Provisions: Select and arrange all equipment and systems to provide clear view and easy access, without use of portable ladders, for maintenance and operation of all devices including, but not limited to: all equipment items, valves, filters, strainers, transmitters, sensors, control devices. All gages and indicators shall be clearly visible by personnel standing on the floor or on permanent platforms. Do not reduce or change maintenance and operating space and access provisions that are shown on the drawings.
- C. Equipment and Piping Support: Coordinate structural systems necessary for pipe and equipment support with pipe and equipment locations to permit proper installation.
- D. Location of pipe sleeves, trenches and chases shall be accurately coordinated with equipment and piping locations.
- E. Cutting Holes:
 - 1. Cut holes through concrete and masonry by rotary core drill. Pneumatic hammer, impact electric, and hand or manual hammer type drill will not be allowed, except as permitted by COTR where working area space is limited.
 - 2. Locate holes to avoid interference with structural members such as beams or grade beams. Holes shall be laid out in advance and drilling done only after approval by COTR. If the Contractor considers it necessary to drill through structural members, this matter shall be referred to COTR for approval.
 - 3. Do not penetrate membrane waterproofing.

- F. Interconnection of Instrumentation or Control Devices: Generally, electrical and pneumatic interconnections are not shown but must be provided.
- G. Minor Piping: Generally, small diameter pipe runs from drips and drains, water cooling, and other service are not shown but must be provided.
- H. Electrical and Pneumatic Interconnection of Controls and Instruments: This generally not shown but must be provided. This includes interconnections of sensors, transmitters, transducers, control devices, control and instrumentation panels, instruments and computer workstations. Comply with NFPA-70.
- I. Protection and Cleaning:
 - 1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the COTR. Damaged or defective items in the opinion of the COTR, shall be replaced.
 - 2. Protect all finished parts of equipment, such as shafts and bearings where accessible, from rust prior to operation by means of protective grease coating and wrapping. Close pipe openings with caps or plugs during installation. Tightly cover and protect fixtures and equipment against dirt, water chemical, or mechanical injury. At completion of all work thoroughly clean fixtures, exposed materials and equipment.
- J. Concrete and Grout: Use concrete and shrink compensating grout 25 MPa (3000 psi) minimum.
- K. Install gages, thermometers, valves and other devices with due regard for ease in reading or operating and maintaining said devices. Locate and position thermometers and gages to be easily read by operator or staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.
- L. Work in Existing Building:
 - 1. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).
 - 2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will least interfere with normal operation of the facility.
 - 3. Cut required openings through existing masonry and reinforced concrete using diamond core drills. Use of pneumatic hammer type drills, impact type electric drills, and hand or manual hammer type drills, will be permitted only with approval of the COTR. Locate openings that will least effect structural slabs, columns, ribs or beams. Refer to the COTR for determination of proper design for openings through structural sections and opening layouts approval, prior to cutting or drilling into structure. After COTR's approval, carefully cut opening through construction no larger than absolutely necessary for the required installation.

- M. Switchgear/Electrical Equipment Drip Protection: Every effort shall be made to eliminate the installation of pipe above electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints. Installation of piping, ductwork, leak protection apparatus or other installations foreign to the electrical installation shall not be located in the space equal to the width and depth of the equipment and extending from the floor to a height of 1.8 m (6 ft.) above the equipment or to structural ceiling, whichever is lower (NFPA 70).
- N. Inaccessible Equipment:
1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost to the Government.
 2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as motors, fans, pumps, belt guards, transformers, high voltage lines, piping, and ductwork.

3.2 TEMPORARY PIPING AND EQUIPMENT

- A. Continuity of operation of existing facilities will generally require temporary installation or relocation of equipment and piping.
- B. The Contractor shall provide all required facilities in accordance with the requirements of phased construction and maintenance of service. All piping and equipment shall be properly supported, sloped to drain, operate without excessive stress, and shall be insulated where injury can occur to personnel by contact with operating facilities. The requirements of Paragraph 3.1 apply.
- C. Temporary facilities and piping shall be completely removed and any openings in structures sealed. Provide necessary blind flanges and caps to seal open piping remaining in service.

3.3 RIGGING

- A. Design is based on application of available equipment. Openings in building structures are planned to accommodate design scheme.
- B. Alternative methods of equipment delivery may be offered by Contractor and will be considered by Government under specified restrictions of phasing and maintenance of service as well as structural integrity of the building.
- C. Close all openings in the building when not required for rigging operations to maintain proper environment in the facility for Government operation and maintenance of service.
- D. Contractor shall provide all facilities required to deliver specified equipment and place on foundations. Attachments to structures for rigging purposes and support of equipment on structures shall be Contractor's full responsibility. Upon request, the Government will check structure adequacy and advise Contractor of recommended restrictions.
- E. Contractor shall check all clearances, weight limitations and shall offer a rigging plan designed by a Registered Professional Engineer. All modifications to structures, including reinforcement thereof, shall be at Contractor's cost, time and responsibility.
- F. Rigging plan and methods shall be referred to COTR for evaluation prior to actual work.

- G. Restore building to original condition upon completion of rigging work.

3.4 PIPE AND EQUIPMENT SUPPORTS

- A. Where hanger spacing does not correspond with joist or rib spacing, use structural steel channels secured directly to joist and rib structure that will correspond to the required hanger spacing, and then suspend the equipment and piping from the channels. Drill or burn holes in structural steel only with the prior approval of the COTR.
- B. Use of chain, wire or strap hangers; wood for blocking, stays and bracing; or, hangers suspended from piping above will not be permitted. Replace or thoroughly clean rusty products and paint with zinc primer.
- C. Use hanger rods that are straight and vertical. Turnbuckles for vertical adjustments may be omitted where limited space prevents use. Provide a minimum of 15 mm (1/2-inch) clearance between pipe or piping covering and adjacent work.
- D. HVAC Horizontal Pipe Support Spacing: Refer to MSS SP-69. Provide additional supports at valves, strainers, in-line pumps and other heavy components. Provide a support within one foot of each elbow.
- E. HVAC Vertical Pipe Supports:
1. Up to 150 mm (6-inch pipe), 9 m (30 feet) long, bolt riser clamps to the pipe below couplings, or welded to the pipe and rest supports securely on the building structure.
 2. Vertical pipe larger than the foregoing, support on base elbows or tees, or substantial pipe legs extending to the building structure.
- F. Overhead Supports:
1. The basic structural system of the building is designed to sustain the loads imposed by equipment and piping to be supported overhead.
 2. Provide steel structural members, in addition to those shown, of adequate capability to support the imposed loads, located in accordance with the final approved layout of equipment and piping.
 3. Tubing and capillary systems shall be supported in channel troughs.
- G. Floor Supports:
1. Provide concrete bases, concrete anchor blocks and pedestals, and structural steel systems for support of equipment and piping. Anchor and dowel concrete bases and structural systems to resist forces under operating and seismic conditions (if applicable) without excessive displacement or structural failure.
 2. Do not locate or install bases and supports until equipment mounted thereon has been approved. Size bases to match equipment mounted thereon plus 50 mm (2 inch) excess on all edges. Refer to structural drawings. Bases shall be neatly finished and smoothed, shall have chamfered edges at the top, and shall be suitable for painting.

3. All equipment shall be shimmed, leveled, firmly anchored, and grouted with epoxy grout. Anchor bolts shall be placed in sleeves, anchored to the bases. Fill the annular space between sleeves and bolts with a granular material to permit alignment and realignment.

3.5 MECHANICAL DEMOLITION

- A. Rigging access, other than indicated on the drawings, shall be provided by the Contractor after approval for structural integrity by the COTR. Such access shall be provided without additional cost or time to the Government. Where work is in an operating plant, provide approved protection from dust and debris at all times for the safety of plant personnel and maintenance of plant operation and environment of the plant.
- B. In an operating facility, maintain the operation, cleanliness and safety. Government personnel will be carrying on their normal duties of operating, cleaning and maintaining equipment and plant operation. Confine the work to the immediate area concerned; maintain cleanliness and wet down demolished materials to eliminate dust. Do not permit debris to accumulate in the area to the detriment of plant operation. Perform all flame cutting to maintain the fire safety integrity of this plant. Adequate fire extinguishing facilities shall be available at all times. Perform all work in accordance with recognized fire protection standards. Inspection will be made by personnel of the VA Medical Center, and Contractor shall follow all directives of the COTR with regard to rigging, safety, fire safety, and maintenance of operations.
- C. Completely remove all piping, wiring, conduit, and other devices associated with the equipment not to be re-used in the new work. This includes all pipe, valves, fittings, insulation, and all hangers including the top connection and any fastenings to building structural systems. Seal all openings, after removal of equipment, pipes, ducts, and other penetrations in roof, walls, floors, in an approved manner and in accordance with plans and specifications where specifically covered. Structural integrity of the building system shall be maintained. Reference shall also be made to the drawings and specifications of the other disciplines in the project for additional facilities to be demolished or handled.
- D. All valves including gate, globe, ball, butterfly and check, all pressure gages and thermometers with wells shall remain Government property and shall be removed and delivered to COTR and stored as directed. The Contractor shall remove all other material and equipment, devices and demolition debris under these plans and specifications. Such material shall be removed from Government property expeditiously and shall not be allowed to accumulate.
- E. Asbestos Insulation Removal: Conform to Section 02 82 13.13, PIPE INSULATION – GLOVEBAG ASBESTOS ABATEMENT.

3.6 CLEANING AND PAINTING

- A. Prior to final inspection and acceptance of the plant and facilities for beneficial use by the Government, the plant facilities, equipment and systems shall be thoroughly cleaned and painted.
- B. In addition, the following special conditions apply:

3. Cleaning shall be thorough. Use solvents, cleaning materials and methods recommended by the manufacturers for the specific tasks. Remove all rust prior to painting and from surfaces to remain unpainted. Repair scratches, scuffs, and abrasions prior to applying prime and finish coats.
4. Material And Equipment Not To Be Painted Includes:
 - a. Motors, controllers, control switches, and safety switches.
 - b. Control and interlock devices.
 - c. Regulators.
 - d. Pressure reducing valves.
 - e. Control valves and thermostatic elements.
 - f. Lubrication devices and grease fittings.
 - g. Copper, brass, aluminum, stainless steel and bronze surfaces.
 - h. Valve stems and rotating shafts.
 - i. Pressure gauges and thermometers.
 - j. Glass.
 - k. Name plates.
3. Control and instrument panels shall be cleaned, damaged surfaces repaired, and shall be touched-up with matching paint obtained from panel manufacturer.
4. Pumps, motors, steel and cast iron bases, and coupling guards shall be cleaned, and shall be touched-up with the same color as utilized by the pump manufacturer
5. Temporary Facilities: Apply paint to surfaces that do not have existing finish coats.
6. Paint shall withstand the following temperatures without peeling or discoloration:
 - a. Condensate -- 38 degrees C (100 degrees F) on insulation jacket surface and 120 degrees C (250 degrees F) on metal pipe surface.
 - b. Steam -- 52 degrees C (125 degrees F) on insulation jacket surface and 190 degrees C (375 degrees F) on metal pipe surface.
7. Final result shall be smooth, even-colored, even-textured factory finish on all items.
Completely repaint the entire piece of equipment if necessary to achieve this.

3.7 IDENTIFICATION SIGNS

- A. Provide laminated plastic signs, with engraved lettering not less than 5 mm (3/16-inch) high, designating functions, for all equipment, switches, motor controllers, relays, meters, control devices, including automatic control valves. Nomenclature and identification symbols shall correspond to that used in maintenance manual, and in diagrams specified elsewhere. Attach by chain, adhesive, or screws.
- B. Factory Built Equipment: Metal plate, securely attached, with name and address of manufacturer, serial number, model number, size, performance.
- C. Pipe Identification: Pipe marking shall be applied to all pipes after insulation and painting has been completed, and shall be as follows:

1. Plastic semi-rigid snap-on type, manufacturer's standard pre-printed color coded pipe markers extending fully around the pipe and insulation or pressure-sensitive vinyl markers.
 2. On piping and insulation 6" and greater diameter, full band as specified above or strip-type markers fastened to the pipe or insulation with laminated or bonded application or by color-coded plastic tape not less than 1.50" wide, full circle at both ends of the marker
 3. Arrows for direction of flow provided integral with the pipe marker or separate at each marker.
- D. For pipe labeling, coordinate names, abbreviations and other designations used in mechanical identification work, with corresponding designations shown, specified or scheduled on drawings.
- Pipe markings shall be placed:
1. At each piece of equipment.
 2. At 10 ft. centers in mechanical rooms and concealed spaces, but at least once per room.
 3. At 25 ft. centers in other exposed locations.
 4. On mains at each branch take-off.
 5. On duct access panels.

3.8 MOTOR AND DRIVE ALIGNMENT

- A. Direct-connect Drive: Securely mount motor in accurate alignment so that shafts are free from both angular and parallel misalignment when both motor and driven machine are operating at normal temperatures.

3.9 LUBRICATION

- A. Lubricate all devices requiring lubrication prior to initial operation. Field-check all devices for proper lubrication.
- B. Equip all devices with required lubrication fittings or devices. Provide a minimum of one liter (one quart) of oil and 0.5 kg (one pound) of grease of manufacturer's recommended grade and type for each different application; also provide 12 grease sticks for lubricated plug valves. Deliver all materials to COTR in unopened containers that are properly identified as to application.
- C. Provide a separate grease gun with attachments for applicable fittings for each type of grease applied.
- D. All lubrication points shall be accessible without disassembling equipment, except to remove access plates.

3.10 COMMISSIONING

- A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00 – COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specifications will be tested as part of a larger system. Refer to Section 23 08 00 – COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

3.11 STARTUP AND TEMPORARY OPERATION

Start up equipment as described in equipment specifications. Verify that vibration is within specified tolerance prior to extended operation. Temporary use of equipment is specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT.

3.12 OPERATING AND PERFORMANCE TESTS

- A. Prior to the final inspection, perform required tests as specified in Section 01 00 00, GENERAL REQUIREMENTS and submit the test reports and records to the COTR.
- B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.
- C. When completion of certain work or system occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then make performance tests for heating systems and for cooling systems respectively during first actual seasonal use of respective systems following completion of work.

3.13 INSTRUCTIONS TO VA PERSONNEL

Provide in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.

--- E N D ---

SECTION 23 05 12
GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT

PART 1 - GENERAL**1.1 DESCRIPTION:**

This section specifies the furnishing, installation and connection of motors for HVAC equipment.

1.2 RELATED WORK:

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements common to more than one Section of Division 26.
- B. Section 26 29 11, MOTOR CONTROLLERS: Starters, control and protection for motors.
- C. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- D. Section 23 21 23, HYDRONIC PUMPS.
- E. Section 23 82 00, CONVECTION HEATING AND COOLING UNITS.
- F. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS: Requirements for commissioning, systems readiness checklists, and training.

1.3 SUBMITTALS:

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Shop Drawings:
 - 1. Provide documentation to demonstrate compliance with drawings and specifications.
 - 2. Include electrical ratings, efficiency, bearing data, power factor, frame size, dimensions, mounting details, materials, horsepower, voltage, phase, speed (RPM), enclosure, starting characteristics, torque characteristics, code letter, full load and locked rotor current, service factor, and lubrication method.
- C. Manuals:
 - 1. Submit simultaneously with the shop drawings, companion copies of complete installation, maintenance and operating manuals, including technical data sheets and application data.
- D. Certification: Two weeks prior to final inspection, unless otherwise noted, submit four copies of the following certification to the COTR:
 - 1. Certification that the motors have been applied, installed, adjusted, lubricated, and tested according to manufacturer published recommendations.
- E. Completed System Readiness Checklists provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 23 08 00 COMMISSIONING OF HVAC SYSTEMS.

1.4 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Electrical Manufacturers Association (NEMA):
MG 1-2006 Rev. 1 2009Motors and Generators

MG 2–2001 Rev. 1 2007 Safety Standard for Construction and Guide for Selection,
Installation and Use of Electric Motors and Generators

- C. National Fire Protection Association (NFPA):
70-2008 National Electrical Code (NEC)
- D. Institute of Electrical and Electronics Engineers (IEEE):
112-04 Standard Test Procedure for Polyphase Induction Motors and
Generators
- E. American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE):
90.1-2007 Energy Standard for Buildings Except Low-Rise Residential
Buildings

PART 2 - PRODUCTS

2.1 MOTORS:

- A. For alternating current, fractional and integral horsepower motors, NEMA Publications MG 1 and MG 2 shall apply.
- B. All material and equipment furnished and installation methods shall conform to the requirements of Section 26 29 11, MOTOR CONTROLLERS; and Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). Provide all electrical wiring, conduit, and devices necessary for the proper connection, protection and operation of the systems. Provide premium efficiency type motors as scheduled. Unless otherwise specified for a particular application, use electric motors with the following requirements.
- C. Single-phase Motors: Motors for centrifugal fans and pumps may be split phase or permanent split capacitor (PSC) type. Provide capacitor-start type for hard starting applications.
 - 1. Contractor's Option - Electrically Commutated motor (EC Type): Motor shall be brushless DC type specifically designed for applications with heavy duty ball bearings and electronic commutation. The motor shall be speed controllable down to 20% of full speed and 85% efficient at all speeds.
- D. Poly-phase Motors: NEMA Design B, Squirrel cage, induction type.
 - 1. Two Speed Motors: Each two-speed motor shall have two separate windings. Provide a time-delay (20 seconds minimum) relay for switching from high to low speed.
- E. Voltage ratings shall be as follows:
 - 1. Single phase:
 - a. Motors connected to 120-volt systems: 115 volts.
 - b. Motors connected to 208-volt systems: 200 volts.
 - c. Motors connected to 240 volt or 480 volt systems: 230/460 volts, dual connection.
 - 2. Three phase:
 - a. Motors connected to 208-volt systems: 200 volts.

- b. Motors, less than 74.6 kW (100 HP), connected to 240 volt or 480 volt systems: 208-230/460 volts, dual connection.
- F. Number of phases shall be as follows:
 - 1. Motors, less than 373 W (1/2 HP): Single phase.
 - 2. Motors, 373 W (1/2 HP) and larger: 3 phase.
 - 3. Exceptions:
 - a. Hermetically sealed motors.
 - b. Motors for equipment assemblies, less than 746 W (one HP), may be single phase provided the manufacturer of the proposed assemblies cannot supply the assemblies with three phase motors.
- G. Motors shall be designed for operating the connected loads continuously in a 40°C (104°F) environment, where the motors are installed, without exceeding the NEMA standard temperature rises for the motor insulation. If the motors exceed 40°C (104°F), the motors shall be rated for the actual ambient temperatures.
- H. Motor designs, as indicated by the NEMA code letters, shall be coordinated with the connected loads to assure adequate starting and running torque.
- I. Motor Enclosures:
 - 1. Shall be the NEMA types as specified and/or shown on the drawings.
 - 2. Where the types of motor enclosures are not shown on the drawings, they shall be the NEMA types, which are most suitable for the environmental conditions where the motors are being installed. Enclosure requirements for certain conditions are as follows:
 - a. Motors located outdoors, indoors in wet or high humidity locations, or in unfiltered airstreams shall be totally enclosed type.
 - b. Where motors are located in an NEC 511 classified area, provide TEFC explosion proof motor enclosures.
 - c. Where motors are located in a corrosive environment, provide TEFC enclosures with corrosion resistant finish.
 - 3. Enclosures shall be primed and finish coated at the factory with manufacturer's prime coat and standard finish.
- J. Special Requirements:
 - 1. Where motor power requirements of equipment furnished deviate from power shown on plans, provide electrical service designed under the requirements of NFPA 70 without additional time or cost to the Government.
 - 2. Assemblies of motors, starters, controls and interlocks on factory assembled and wired devices shall be in accordance with the requirements of this specification.
 - 3. Wire and cable materials specified in the electrical division of the specifications shall be modified as follows:

- a. Wiring material located where temperatures can exceed 71 degrees C (160 degrees F) shall be stranded copper with Teflon FEP insulation with jacket. This includes wiring on the boilers.
- b. Other wiring at boilers and to control panels shall be NFPA 70 designation THWN.
- c. Provide shielded conductors or wiring in separate conduits for all instrumentation and control systems where recommended by manufacturer of equipment.
- 4. Select motor sizes so that the motors do not operate into the service factor at maximum required loads on the driven equipment. Motors on pumps shall be sized for non-overloading at all points on the pump performance curves.
- 5. Motors utilized with variable frequency drives shall be rated "inverter-duty" per NEMA Standard, MG1, Part 31.4.4.2. Provide motor shaft grounding apparatus that will protect bearings from damage from stray currents.
- K. Additional requirements for specific motors, as indicated in the other sections listed in Article 1.2, shall also apply.
- L. Energy-Efficient Motors (Motor Efficiencies): All permanently wired polyphase motors of 746 Watts (1 HP) or more shall meet the minimum full-load efficiencies as indicated in the following table. Motors of 746 Watts (1 HP) or more with open-, drip-proof or totally enclosed fan-cooled enclosures shall be NEMA premium efficiency type, unless otherwise indicated. Motors provided as an integral part of motor driven equipment are excluded from this requirement if a minimum seasonal or overall efficiency requirement is indicated for that equipment by the provisions of another section. Motors not specified as "premium efficiency" shall comply with the Energy Policy Act of 2005 (EPACT).

| Minimum Premium Efficiencies Open Drip-Proof | | | | Minimum Premium Efficiencies Totally Enclosed Fan-Cooled | | | |
|---|-------------|-------------|----------|---|-------------|-------------|-------------|
| Rating kW (HP) | 1200 RPM | 1800 RPM | 3600 RPM | Rating kW (HP) | 1200 RPM | 1800 RPM | 3600 RPM |
| 0.746 (1) | 82.5% | 85.5% | 77.0% | 0.746 (1) | 82.5% | 85.5% | 77.0% |
| 1.12 (1.5) | 86.5% | 86.5% | 84.0% | 1.12 (1.5) | 87.5% | 86.5% | 84.0% |
| 1.49 (2) | 87.5% | 86.5% | 85.5% | 1.49 (2) | 88.5% | 86.5% | 85.5% |
| 2.24 (3) | 88.5% | 89.5% | 85.5% | 2.24 (3) | 89.5% | 89.5% | 86.5% |
| 3.73 (5) | 89.5% | 89.5% | 86.5% | 3.73 (5) | 89.5% | 89.5% | 88.5% |
| 5.60 (7.5) | 90.2% | 91.0% | 88.5% | 5.60 (7.5) | 91.0% | 91.7% | 89.5% |
| 7.46 (10) | 91.7% | 91.7% | 89.5% | 7.46 (10) | 91.0% | 91.7% | 90.2% |

- M. Minimum Power Factor at Full Load and Rated Voltage: 90 percent at 1200 RPM, 1800 RPM and 3600 RPM.

PART 3 - EXECUTION**3.1 INSTALLATION:**

Install motors in accordance with manufacturer's recommendations, the NEC, NEMA, as shown on the drawings and/or as required by other sections of these specifications.

3.2 FIELD TESTS

- A. Perform an electric insulation resistance Test using a megohmmeter on all motors after installation, before start-up. All shall test free from grounds.
- B. Perform Load test in accordance with ANSI/IEEE 112, Test Method B, to determine freedom from electrical or mechanical defects and compliance with performance data.
- C. Insulation Resistance: Not less than one-half meg-ohm between stator conductors and frame, to be determined at the time of final inspection.

3.3 STARTUP AND TESTING

- A. The Commissioning Agent will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with COTR and Commissioning Agent. Provide a minimum of 7 days prior notice.

3.4 COMMISSIONING

- A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00 – COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 23 08 00 – COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

3.5 DEMONSTRATION AND TRAINING

- A. Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.
- B. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00 – COMMISSIONING OF HVAC SYSTEMS.

--- E N D ---

SECTION 23 05 41
NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT

PART 1 - GENERAL**1.1 DESCRIPTION**

Noise criteria, vibration tolerance and vibration isolation for HVAC and plumbing work.

1.2 RELATED WORK

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC: General mechanical requirements and items, which are common to more than one section of Division 23.
- B. Section 23 22 13, STEAM AND CONDENSATE HEATING PIPING: Requirements for flexible pipe connectors to reciprocating and rotating mechanical equipment.
- C. Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC: requirements for sound and vibration tests.
- D. Section 23 21 23, HYDRONIC PUMPS: vibration isolation requirements for pumps.
- E. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS: Requirements for commissioning, systems readiness checklists, and training.

1.3 QUALITY ASSURANCE

- A. Refer to article, QUALITY ASSURANCE in specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Noise Criteria:
 - 1. Noise levels in all 8 octave bands due to equipment and systems shall not exceed following NC levels:

| TYPE OF ROOM | NC LEVEL |
|--------------------------------------|-----------------|
| Audio Speech Pathology | 25 |
| Audio Suites | 25 |
| Auditoriums, Theaters | 35-40 |
| Bathrooms and Toilet Rooms | 40 |
| Chapels | 35 |
| Conference Rooms | 35 |
| Corridors (Nurse Stations) | 40 |
| Corridors(Public) | 40 |
| Dining Rooms, Food Services/ Serving | 40 |
| Examination Rooms | 35 |
| Gymnasiums | 50 |
| Kitchens | 50 |
| Laboratories (With Fume Hoods) | 45 to 55 |
| Lobbies, Waiting Areas | 40 |

| | |
|---|-------|
| Locker Rooms | 45 |
| Offices, Large Open | 40 |
| Offices, Small Private | 35 |
| Operating Rooms | 40 |
| Patient Rooms | 35 |
| Phono/Cardiology | 25 |
| Recreation Rooms | 40-45 |
| Shops | 50 |
| SPD (Decontamination and Clean Preparation) | 45 |
| Treatment Rooms | 35 |
| Warehouse | 50 |
| X-Ray and General Work Rooms | 40 |

2. For equipment which has no sound power ratings scheduled on the plans, the contractor shall select equipment such that the fore-going noise criteria, local ordinance noise levels, and OSHA requirements are not exceeded. Selection procedure shall be in accordance with 2009 ASHRAE Fundamentals Handbook, Chapter 8, Sound and Vibration.
 3. An allowance, not to exceed 5db, may be added to the measured value to compensate for the variation of the room attenuating effect between room test condition prior to occupancy and design condition after occupancy which may include the addition of sound absorbing material, such as, furniture. This allowance may not be taken after occupancy. The room attenuating effect is defined as the difference between sound power level emitted to room and sound pressure level in room.
 4. In absence of specified measurement requirements, measure equipment noise levels three feet from equipment and at an elevation of maximum noise generation.
- C. Allowable Vibration Tolerances for Rotating, Non-reciprocating Equipment: Not to exceed a self-excited vibration maximum velocity of 5 mm per second (0.20 inch per second) RMS, filter in, when measured with a vibration meter on bearing caps of machine in vertical, horizontal and axial directions or measured at equipment mounting feet if bearings are concealed. Measurements for internally isolated fans and motors may be made at the mounting feet.

1.4 SUBMITTALS

- A. Submit in accordance with specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 1. Vibration isolators:
 - a. Floor mountings
 - b. Hangers

2. Bases.

- C. Isolator manufacturer shall furnish with submittal load calculations for selection of isolators, including supplemental bases, based on lowest operating speed of equipment supported.
- D. The supplier of isolation equipment shall study the application, the equipment to be isolated and the structure. The supplier shall assume responsibility to determine optimum deflection characteristic accounting for dynamic and static forces.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc. (ASHRAE):
 - 2009 Fundamentals Handbook, Chapter 8, Sound and Vibration
 - 2011 HVAC Applications, Chapter 48, Noise and Vibration Control
- C. American Society for Testing and Materials (ASTM):
 - A123/A123M-09 Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products
 - A307-07b Standard Specification for Carbon Steel Bolts and Studs, 60,000 PSI Tensile Strength
 - D2240-05(2010) Standard Test Method for Rubber Property - Durometer Hardness
- D. Manufacturers Standardization (MSS):
 - SP-58-2009 Pipe Hangers and Supports-Materials, Design and Manufacture
- E. Occupational Safety and Health Administration (OSHA):
 - 29 CFR 1910.95 Occupational Noise Exposure
- F. American Society of Civil Engineers (ASCE):
 - ASCE 7-10 Minimum Design Loads for Buildings and Other Structures.
- G. American National Standards Institute / Sheet Metal and Air Conditioning Contractor's National Association (ANSI/SMACNA):
 - 001-2008 Seismic Restraint Manual: Guidelines for Mechanical Systems, 3rd Edition.
- H. International Code Council (ICC):
 - 2009 IBC International Building Code.
- I. Department of Veterans Affairs (VA):
 - H-18-8 2010 Seismic Design Requirements.

PART 2 - PRODUCTS**2.1 GENERAL REQUIREMENTS**

- A. Type of isolator, base, and minimum static deflection shall be as required for each specific equipment application as recommended by isolator or equipment manufacturer but subject to minimum requirements indicated herein and indicated on the drawings.
- B. Elastomeric Isolators shall comply with ASTM D2240 and be oil resistant neoprene with a maximum stiffness of 60 durometer and have a straight-line deflection curve.
- C. Exposure to weather: Isolator housings to be either hot dipped galvanized or powder coated to ASTM B117 salt spray testing standards. Springs to be powder coated or electro galvanized. All hardware to be electro galvanized. In addition provide limit stops to resist wind velocity. Velocity pressure established by wind shall be calculated in accordance with section 1609 of the International Building Code. A minimum wind velocity of 75 mph shall be employed.
- D. Uniform Loading: Select and locate isolators to produce uniform loading and deflection even when equipment weight is not evenly distributed.
- E. Color code isolators by type and size for easy identification of capacity.

2.2 VIBRATION ISOLATORS

- A. Hangers: Shall be combination neoprene and springs unless otherwise noted and shall allow for expansion of pipe.
 - 1. Combination Neoprene and Spring (Type H): Vibration hanger shall contain a spring and double deflection neoprene element in series. Spring shall have a diameter not less than 0.8 of compressed operating spring height. Spring shall have a minimum additional travel of 50 percent between design height and solid height. Spring shall permit a 15 degree angular misalignment without rubbing on hanger box.
 - 2. Spring Position Hanger (Type HP): Similar to combination neoprene and spring hanger except hanger shall hold piping at a fixed elevation during installation and include a secondary adjustment feature to transfer load to spring while maintaining same position.
 - 3. Neoprene (Type HN): Vibration hanger shall contain a double deflection type neoprene isolation element. Hanger rod shall be separated from contact with hanger bracket by a neoprene grommet.
 - 4. Spring (Type HS): Vibration hanger shall contain a coiled steel spring in series with a neoprene grommet. Spring shall have a diameter not less than 0.8 of compressed operating spring height. Spring shall have a minimum additional travel of 50 percent between design height and solid height. Spring shall permit a 15 degree angular misalignment without rubbing on hanger box.
 - 5. Hanger supports for piping 50 mm (2 inches) and larger shall have a pointer and scale deflection indicator.

PART 3 - EXECUTION**3.1 INSTALLATION**

- A. Vibration Isolation:
 - 1. No metal-to-metal contact will be permitted between fixed and floating parts.
 - 2. Connections to Equipment: Allow for deflections equal to or greater than equipment deflections. Electrical, drain, piping connections, and other items made to rotating or reciprocating equipment (pumps, compressors, etc.) which rests on vibration isolators, shall be isolated from building structure for first three hangers or supports with a deflection equal to that used on the corresponding equipment.
 - 3. Provide heat shields where elastomers are subject to temperatures over 38 degrees C (100 degrees F).
 - 4. Extend bases for pipe elbow supports at discharge and suction connections at pumps. Pipe elbow supports shall not short circuit pump vibration to structure.
 - 5. Non-rotating equipment such as heat exchangers and convertors shall be mounted on isolation units having the same static deflection as the isolation hangers or support of the pipe connected to the equipment.
- B. Inspection and Adjustments: Check for vibration and noise transmission through connections, piping, ductwork, foundations, and walls. Adjust, repair, or replace isolators as required to reduce vibration and noise transmissions to specified levels.

3.2 ADJUSTING

- A. Adjust vibration isolators after piping systems are filled and equipment is at operating weight.
- B. Adjust limit stops on restrained spring isolators to mount equipment at normal operating height. After equipment installation is complete, adjust limit stops so they are out of contact during normal operation.
- C. Attach thrust limits at centerline of thrust and adjust to a maximum of 1/4inch (6-mm) movement during start and stop.
- D. Adjust active height of spring isolators.

3.3 COMMISSIONING

- A. Provide commissioning documentation in accordance with the requirements of section 23 08 00 – COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to section 23 08 00 – COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

3.4 SELECTION GUIDE FOR VIBRATION ISOLATORS

- A. Select and size vibration isolators in accordance with Table 47, Chapter 48 of 2011 ASHRAE HVAC Applications Handbook on Noise and Vibration Control.

- - - E N D - -

SECTION 23 05 93
TESTING, ADJUSTING, AND BALANCING FOR HVAC**PART 1 - GENERAL****1.1 DESCRIPTION**

- A. Testing, adjusting, and balancing (TAB) of heating, ventilating and air conditioning (HVAC) systems. TAB includes the following:
 - 1. Planning systematic TAB procedures.
 - 2. Design Review Report.
 - 3. Systems Inspection report.
 - 4. Systems Readiness Report.
 - 5. Balancing water distribution systems; adjustment of total system to provide design performance; and testing performance of equipment and automatic controls.
 - 6. Vibration and sound measurements.
 - 7. Recording and reporting results.
- B. Definitions:
 - 1. Basic TAB used in this Section: Chapter 38, "Testing, Adjusting and Balancing" of 2011 ASHRAE Handbook, "HVAC Applications".
 - 2. TAB: Testing, Adjusting and Balancing; the process of checking and adjusting HVAC systems to meet design objectives.
 - 3. AABC: Associated Air Balance Council.
 - 4. Hydronic Systems: Includes heating hot water systems.
 - 5. Flow rate tolerance: The allowable percentage variation, minus to plus, of actual flow rate from values (design) in the contract documents.

1.2 RELATED WORK

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC: General Mechanical Requirements.
- B. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT: Noise and Vibration Requirements.
- C. Section 23 07 11, HVAC AND BOILER PLANT INSULATION: Piping and Equipment Insulation.
- D. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Controls and Instrumentation Settings.
- E. Section 23 82 00, CONVECTION HEATING AND COOLING UNITS
- F. Section 23 21 23, HYDRONIC PUMPS
- G. Section 23 21 13, HYDRONIC PIPING
- H. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS: Requirements for commissioning, systems readiness checklists, and training
- I. Section 23 05 12 GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT

1.3 QUALITY ASSURANCE

- A. Refer to Articles, Quality Assurance and Submittals, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.
- B. Qualifications:
 - 1. TAB Agency: The TAB agency shall be a subcontractor of the General Contractor and shall report to and be paid by the General Contractor. No individual entity shall be permitted to serve as both the HVAC Contractor and the TAB agency. In addition, the TAB agency shall not have any affiliation with the HVAC Contractor or any of its sub-contractors.
 - 2. The TAB agency shall be a certified member of AABC to perform TAB service for HVAC, water balancing and vibrations and sound testing of equipment. The certification shall be maintained for the entire duration of duties specified herein. If, for any reason, the agency loses subject certification during this period, the General Contractor shall immediately notify the COTR and submit another TAB firm for approval. Any agency that has been the subject of disciplinary action by the AABC within the five years preceding Contract Award shall not be eligible to perform any work related to the TAB. All work performed in this Section and in other related Sections by the TAB agency shall be considered invalid if the TAB agency loses its certification prior to Contract completion, and the successor agency's review shows unsatisfactory work performed by the predecessor agency.
 - 3. TAB Specialist: The TAB specialist shall be a member of AABC. The certification shall be maintained for the entire duration of duties specified herein. If, for any reason, the Specialist loses subject certification during this period, the General Contractor shall immediately notify the COTR and submit another TAB Specialist for approval. Any individual that has been the subject of disciplinary action by the AABC within the five years preceding Contract Award shall not be eligible to perform any duties related to the HVAC systems, including TAB. All work specified in this Section and in other related Sections performed by the TAB specialist shall be considered invalid if the TAB Specialist loses its certification prior to Contract completion and must be performed by an approved successor.
 - 4. TAB Specialist shall be identified by the General Contractor within 60 days after the notice to proceed. The TAB specialist will be coordinating, scheduling and reporting all TAB work and related activities and will provide necessary information as required by the COTR. The responsibilities shall specifically include:
 - a. Shall directly supervise all TAB work.
 - b. Shall sign the TAB reports that bear the seal of the TAB standard. The reports shall be accompanied by report forms and schematic drawings required by the TAB standard, AABC.
 - c. Shall follow all TAB work through its satisfactory completion.
 - d. Shall provide final markings of settings of all HVAC adjustment devices.

5. All TAB technicians performing actual TAB work shall be experienced and must have done satisfactory work on a minimum of 3 projects comparable in size and complexity to this project. Qualifications must be certified by the TAB agency in writing. The lead technician shall be certified by AABC.
- C. Test Equipment Criteria: The instrumentation shall meet the accuracy/calibration requirements established by AABC National Standards for Testing, Adjusting and Balancing of Environmental Systems and instrument manufacturer. Provide calibration history of the instruments to be used for test and balance purpose.
- D. TAB Criteria:
 1. One or more of the applicable AABC or SMACNA publications, supplemented by 2011 ASHRAE Handbook "HVAC Applications" Chapter 38, and requirements stated herein shall be the basis for planning, procedures, and reports.
 2. Flow rate tolerance: Following tolerances are allowed. For tolerances not mentioned herein follow 2011 ASHRAE Handbook "HVAC Applications", Chapter 38, as a guideline.
 - a. Heating hot water pumps and hot water coils: Minus 5 percent to plus 5 percent.
 3. Systems shall be adjusted for energy efficient operation as described in PART 3.
 4. Typical TAB procedures and results shall be demonstrated to the COTR for one hydronic system (pumps and coils) as follows:
 - a. When field TAB work begins.
 - b. During each partial final inspection and the final inspection for the project if requested by VA.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Submit names and qualifications of TAB agency and TAB specialists within 60 days after the notice to proceed. Submit information on three recently completed projects and a list of proposed test equipment.
- C. Submit Following for Review and Approval:
 1. Design Review Report after the system layout on water side is completed by the Contractor.
 2. Systems inspection report on equipment and installation for conformance with design.
 3. Systems Readiness Report.
 4. Intermediate and Final TAB reports covering flow balance and adjustments, performance tests, vibration tests and sound tests.
 5. Include in final reports uncorrected installation deficiencies noted during TAB and applicable explanatory comments on test results that differ from design requirements.
- D. Prior to request for Final or Partial Final inspection, submit completed Test and Balance report for the area.

1.5 APPLICABLE PUBLICATIONS

- A. The following publications form a part of this specification to the extent indicated by the reference thereto. In text the publications are referenced to by the acronym of the organization.
- B. American Society of Heating, Refrigerating and Air Conditioning Engineers, Inc. (ASHRAE):
2011HVAC Applications ASHRAE Handbook, Chapter 38, Testing, Adjusting, and Balancing and Chapter 48, Noise and Vibration Control
- C. Associated Air Balance Council (AABC):
2002AABC National Standards for Total System Balance
- D. Sheet Metal and Air Conditioning Contractors National Association (SMACNA):
3rd Edition 2002HVAC SYSTEMS Testing, Adjusting and Balancing

PART 2 - PRODUCTS**2.1 INSULATION REPAIR MATERIAL**

See Section 23 07 11, HVAC AND BOILER PLANT INSULATION Provide for repair of insulation removed or damaged for TAB work.

PART 3 - EXECUTION**3.1 GENERAL**

- A. Refer to TAB Criteria in Article, Quality Assurance.
- B. Obtain applicable contract documents and copies of approved submittals for HVAC equipment and automatic control systems.

3.2 DESIGN REVIEW REPORT

The TAB Specialist shall review the Contract Plans and specifications and advise the COTR of any design deficiencies that would prevent the HVAC systems from effectively operating in accordance with the sequence of operation specified or prevent the effective and accurate TAB of the system. The TAB Specialist shall provide a report individually listing each deficiency and the corresponding proposed corrective action necessary for proper system operation.

3.3 SYSTEMS INSPECTION REPORT

- A. Inspect equipment and installation for conformance with design.
- B. The inspection and report is to be done after hydronic distribution equipment is on site and piping installation has begun, but well in advance of performance testing and balancing work. The purpose of the inspection is to identify and report deviations from design and ensure that systems will be ready for TAB at the appropriate time.
- C. Reports: Follow check list format developed by AABC or SMACNA, supplemented by narrative comments. Check for conformance with submittals.

3.4 SYSTEM READINESS REPORT

- A. The TAB Contractor shall measure existing water flow rates associated with existing systems utilized to serve renovated areas as indicated on drawings. Submit report of findings to COTR.

- B. Inspect each System to ensure that it is complete including installation and operation of controls. Submit report to COTR in standard format and forms prepared and or approved by the Commissioning Agent.
- C. Verify that all items such as piping, ports, terminals, connectors, etc., that is required for TAB are installed. Provide a report to the COTR.

3.5 TAB REPORTS

- A. Submit an intermediate report for systems and equipment tested and balanced to establish satisfactory test results.
- B. The TAB contractor shall provide raw data immediately in writing to the COTR if there is a problem in achieving intended results before submitting a formal report.
- C. If over 20 percent of readings in the intermediate report fall outside the acceptable range, the TAB report shall be considered invalid and all contract TAB work shall be repeated and re-submitted for approval at no additional cost to the Government.
- D. Do not proceed with the remaining systems until intermediate report is approved by the COTR.

3.6 TAB PROCEDURES

- A. TAB shall be performed in accordance with the requirement of the Standard under which TAB agency is certified by AABC.
- B. General: During TAB all related system components shall be in full operation. Pump rotation, motor loads and equipment vibration shall be checked and corrected as necessary before proceeding with TAB. Set controls and/or block off parts of distribution systems to simulate design operation of variable volume water systems for test and balance work.
- C. Coordinate TAB procedures with existing systems and any phased construction completion requirements for the project. Provide TAB reports for pre construction water flow rate and for each phase of the project prior to partial final inspections of each phase of the project. Return existing areas outside the work area to pre constructed conditions.
- D. Allow sufficient time in construction schedule for TAB and submission of all reports for an organized and timely correction of deficiencies.
- E. Water Balance and Equipment Test: Include circulating pumps and convertors:
 - 1. Adjust flow rates for equipment. Set to values on equipment submittals, if different from values on contract drawings.
 - 2. Record final measurements for hydronic equipment on performance data sheets. Include entering and leaving water temperatures for convertors.

3.7 VIBRATION TESTING

- A. Furnish instruments and perform vibration measurements as specified in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT. Field vibration balancing is specified in Section 23 05 11, COMMON WORK RESULTS FOR HVAC. Provide

measurements for all rotating HVAC equipment of 373 watts (1/2 horsepower) and larger, including pumps and motors.

- B. Record initial measurements for each unit of equipment on test forms and submit a report to the COTR. Where vibration readings exceed the allowable tolerance Contractor shall be directed to correct the problem. The TAB agency shall verify that the corrections are done and submit a final report to the COTR.

3.8 SOUND TESTING

- A. Perform and record required sound measurements in accordance with Paragraph, QUALITY ASSURANCE in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
1. Take readings in rooms, approximately ten (10) percent of all rooms. The COTR may designate the specific rooms to be tested.
- B. Take measurements with a calibrated sound level meter and octave band analyzer of the accuracy required by AABC.
- C. Sound reference levels, formulas and coefficients shall be according to 2011 ASHRAE Handbook, "HVAC Applications", Chapter 48, Noise and Vibration Control.
- D. Determine compliance with specifications as follows:
1. When sound pressure levels are specified, including the NC Criteria in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT:
 - a. Reduce the background noise as much as possible by shutting off unrelated audible equipment.
 - b. Measure octave band sound pressure levels with specified equipment "off."
 - c. Measure octave band sound pressure levels with specified equipment "on."
 - d. Use the DIFFERENCE in corresponding readings to determine the sound pressure due to equipment.

| | | | | | | | |
|-------------|----|---|---|---|---|--------|------------|
| DIFFERENCE: | 0 | 1 | 2 | 3 | 4 | 5 to 9 | 10 or More |
| FACTOR: | 10 | 7 | 4 | 3 | 2 | 1 | 0 |

Sound pressure level due to equipment equals sound pressure level with equipment "on" minus FACTOR.

- e. Plot octave bands of sound pressure level due to equipment for typical rooms on a graph which also shows noise criteria (NC) curves.
2. When sound power levels are specified:
 - a. Perform steps 1.a. thru 1.d., as above.
 - b. For indoor equipment: Determine room attenuating effect, i.e., difference between sound power level and sound pressure level. Determined sound power level will be the sum of sound pressure level due to equipment plus the room attenuating effect.

- c. For outdoor equipment: Use directivity factor and distance from noise source to determine distance factor, i.e., difference between sound power level and sound pressure level. Measured sound power level will be the sum of sound pressure level due to equipment plus the distance factor. Use 10 meters (30 feet) for sound level location.
- 3. Where sound pressure levels are specified in terms of dB(A), measure sound levels using the "A" scale of meter. Single value readings will be used instead of octave band analysis.
- E. Where measured sound levels exceed specified level, the installing contractor or equipment manufacturer shall take remedial action approved by the COTR and the necessary sound tests shall be repeated.
- F. Test readings for sound testing could go higher than 15 percent if determination is made by the COTR based on the recorded sound data.

3.9 MARKING OF SETTINGS

Following approval of TAB final Report, the setting of all HVAC adjustment devices (valves) shall be permanently marked by the TAB Specialist so that adjustment can be restored if disturbed at any time. Style and colors used for markings shall be coordinated with the COTR.

3.10 PHASING

- A. Phased Projects: Testing and Balancing Work to follow project with areas shall be completed per the project phasing. Upon completion of the project all areas shall have been tested and balanced per the contract documents.
- B. Existing Areas: Systems that serve areas outside of the project scope shall not be adversely affected. Measure existing parameters where shown to document system capacity.

3.11 COMMISSIONING

- A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00 – COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 23 08 00 – COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

- - E N D - - -

**SECTION 23 07 11
HVAC AND BOILER PLANT INSULATION****PART 1 - GENERAL****1.1 DESCRIPTION**

- A. Field applied insulation for thermal efficiency and condensation control for
 - 1. HVAC piping and equipment.
 - 2. Re-insulation of HVAC piping and equipment after asbestos abatement.
- B. Definitions
 - 1. ASJ: All service jacket, white finish facing or jacket.
 - 2. Air conditioned space: Space having air temperature and/or humidity controlled by mechanical equipment.
 - 3. Cold: Equipment or piping handling media at design temperature of 16 degrees C (60 degrees F) or below.
 - 4. Concealed: Piping above ceilings and in chases and pipe spaces.
 - 5. Exposed: Piping and equipment exposed to view in finished areas including mechanical and electrical equipment rooms or exposed to outdoor weather. Attics and crawl spaces where air handling units are located are considered to be mechanical rooms. Shafts, chases unfinished attics, crawl spaces and pipe basements are not considered finished areas.
 - 6. FSK: Foil-scrim-kraft facing.
 - 7. Hot: HVAC equipment or piping handling media above 41 degrees C (105 degrees F).
 - 8. Density: kg/m^3 - kilograms per cubic meter (Pcf - pounds per cubic foot).
 - 9. Runouts: Branch pipe connections up to 25-mm (one-inch) nominal size to fan coil units or reheat coils for terminal units.
 - 10. Thermal conductance: Heat flow rate through materials.
 - a. Flat surface: Watt per square meter (BTU per hour per square foot).
 - b. Pipe or Cylinder: Watt per square meter (BTU per hour per linear foot).
 - 11. Thermal Conductivity (k): Watt per meter, per degree C (BTU per inch thickness, per hour, per square foot, per degree F temperature difference).
 - 12. Vapor Retarder (Vapor Barrier): A material which retards the transmission (migration) of water vapor. Performance of the vapor retarder is rated in terms of permeance (perms). For the purpose of this specification, vapor retarders shall have a maximum published permeance of 0.1 perms and vapor barriers shall have a maximum published permeance of 0.001 perms.
 - 13. HPS: High pressure steam (415 kPa [60 psig] and above).
 - 14. HPR: High pressure steam condensate return.
 - 15. MPS: Medium pressure steam (110 kPa [16 psig] thru 414 kPa [59 psig]).
 - 16. MPR: Medium pressure steam condensate return.

- 17. LPS: Low pressure steam (103 kPa [15 psig] and below).
- 18. LPR: Low pressure steam condensate gravity return.
- 19. PC: Pumped condensate.
- 20. HWS: Heating hot water supply.
- 21. HWR: Heating hot water return.
- 22. PVDC: Polyvinylidene chloride vapor retarder jacketing, white.

1.2 RELATED WORK

- A. Section 02 82 13.13, PIPE INSULATION – GLOVEBAG ASBESTOS ABATEMENT: Insulation containing asbestos material.
- B. Section 07 84 00, FIRESTOPPING: Mineral fiber and bond breaker behind sealant.
- C. Section 23 05 11, COMMON WORK RESULTS FOR HVAC: General mechanical requirements and items, which are common to more than one section of Division 23.
- D. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT
- E. Section 23 21 23, HYDRONIC PUMPS
- F. Section 23 21 13, HYDRONIC PIPING and Section 23 22 13, STEAM AND CONDENSATE HEATING PIPING: Piping and equipment.
- G. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS. Requirements for commissioning, systems readiness checklists, and training.

1.3 QUALITY ASSURANCE

- A. Refer to article QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Criteria:

- 1. Comply with NFPA 90A, particularly paragraphs 4.3.3.1 through 4.3.3.6, 4.3.10.2.6, and 5.4.6.4, parts of which are quoted as follows:

4.3.3.1 Pipe insulation and coverings, duct coverings, duct linings, vapor retarder facings, adhesives, fasteners, tapes, and supplementary materials added to air ducts, plenums, panels, and duct silencers used in duct systems, unless otherwise provided for in 4.3.3.1.1 or 4.3.3.1.2, shall have, in the form in which they are used, a maximum flame spread index of 25 without evidence of continued progressive combustion and a maximum smoke developed index of 50 when tested in accordance with NFPA 255, *Standard Method of Test of Surface Burning Characteristics of Building Materials*.

4.3.3.1.1 Where these products are to be applied with adhesives, they shall be tested with such adhesives applied, or the adhesives used shall have a maximum flame spread index of 25 and a maximum smoke developed index of 50 when in the final dry state.
(See 4.2.4.2)

4.3.3.1.2 The flame spread and smoke developed index requirements of 4.3.3.1.1 shall not apply to air duct weatherproof coverings where they are located entirely outside of a building, do not penetrate a wall or roof, and do not create an exposure hazard.

4.3.3.2 Closure systems for use with rigid and flexible air ducts tested in accordance with UL 181, Standard for Safety Factory-Made Air Ducts and Air Connectors, shall have been tested, listed, and used in accordance with the conditions of their listings, in accordance with one of the following:

(1) UL 181A, Standard for Safety Closure Systems for Use with Rigid Air Ducts and Air Connectors

(2) UL 181B, Standard for Safety Closure Systems for Use with Flexible Air Ducts and Air Connectors

4.3.3.3 Air duct, panel, and plenum coverings and linings, and pipe insulation and coverings shall not flame, glow, smolder, or smoke when tested in accordance with a similar test for pipe covering, ASTM C 411, Standard Test Method for Hot-Surface Performance of High-Temperature Thermal Insulation, at the temperature to which they are exposed in service.

4.3.3.3.1 In no case shall the test temperature be below 121 °C (250°F).

4.3.3.4 Air duct coverings shall not extend through walls or floors that are required to be fire stopped or required to have a fire resistance rating, unless such coverings meet the requirements of 5.4.6.4.

4.3.3.5* Air duct linings shall be interrupted at fire dampers to prevent interference with the operation of devices.

4.3.3.6 Air duct coverings shall not be installed so as to conceal or prevent the use of any service opening.

4.3.10.2.6 Materials exposed to the airflow shall be noncombustible or limited combustible and have a maximum smoke developed index of 50 or comply with the following.

4.3.10.2.6.1 Electrical wires and cables and optical fiber cables shall be listed as noncombustible or limited combustible and have a maximum smoke developed index of 50 or shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with NFPA 262, Standard Method of Test for Flame Travel and Smoke of Wires and Cables for Use in Air-Handling Spaces.

4.3.10.2.6.4 Optical-fiber and communication raceways shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with UL 2024, Standard for Safety Optical-Fiber Cable Raceway.

4.3.10.2.6.6 Supplementary materials for air distribution systems shall be permitted when complying with the provisions of 4.3.3.

5.4.6.4 Where air ducts pass through walls, floors, or partitions that are required to have a fire resistance rating and where fire dampers are not required, the opening in the construction around the air duct shall be as follows:

(1) Not exceeding a 25.4 mm (1 in.) average clearance on all sides

(2) Filled solid with an approved material capable of preventing the passage of flame and hot gases sufficient to ignite cotton waste when subjected to the time-temperature fire conditions required for fire barrier penetration as specified in NFPA 251, *Standard Methods of Tests of Fire Endurance of Building Construction and Materials*

2. Test methods: ASTM E84, UL 723, or NFPA 255.

3. Specified k factors are at 24 degrees C (75 degrees F) mean temperature unless stated otherwise. Where optional thermal insulation material is used, select thickness to provide thermal conductance no greater than that for the specified material. For pipe, use insulation manufacturer's published heat flow tables. For run out insulation and condensation control insulation, no thickness adjustment need be made.

4. All materials shall be compatible and suitable for service temperature, and shall not contribute to corrosion or otherwise attack surface to which applied in either the wet or dry state.
- C. Every package or standard container of insulation or accessories delivered to the job site for use must have a manufacturer's stamp or label giving the name of the manufacturer and description of the material.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings:
 1. All information, clearly presented, shall be included to determine compliance with drawings and specifications and ASTM, federal and military specifications.
 - a. Insulation materials: Specify each type used and state surface burning characteristics.
 - b. Insulation facings and jackets: Each type used. Make it clear that white finish will be furnished for exposed ductwork, casings and equipment.
 - c. Insulation accessory materials: Each type used.
 - d. Manufacturer's installation and fitting fabrication instructions for flexible unicellular insulation.
 - e. Make reference to applicable specification paragraph numbers for coordination.

1.5 STORAGE AND HANDLING OF MATERIAL

Store materials in clean and dry environment, pipe covering jackets shall be clean and unmarred. Place adhesives in original containers. Maintain ambient temperatures and conditions as required by printed instructions of manufacturers of adhesives, mastics and finishing cements.

1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.
- B. Federal Specifications (Fed. Spec.):

L-P-535E (2)- 99.....Plastic Sheet (Sheeting): Plastic Strip; Poly (Vinyl Chloride) and Poly (Vinyl Chloride - Vinyl Acetate), Rigid.
- C. Military Specifications (Mil. Spec.):

MIL-A-3316C (2)-90Adhesives, Fire-Resistant, Thermal Insulation

MIL-A-24179A (1)-87.....Adhesive, Flexible Unicellular-Plastic Thermal Insulation

MIL-C-19565C (1)-88Coating Compounds, Thermal Insulation, Fire-and Water-Resistant, Vapor-Barrier

MIL-C-20079H-87.....Cloth, Glass; Tape, Textile Glass; and Thread, Glass and Wire-Reinforced Glass

D. American Society for Testing and Materials (ASTM):

- A167-99(2004) Standard Specification for Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet, and Strip
- B209-07 Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate
- C411-05 Standard test method for Hot-Surface Performance of High-Temperature Thermal Insulation
- C449-07 Standard Specification for Mineral Fiber Hydraulic-Setting Thermal Insulating and Finishing Cement
- C533-09 Standard Specification for Calcium Silicate Block and Pipe Thermal Insulation
- C534-08 Standard Specification for Preformed Flexible Elastomeric Cellular Thermal Insulation in Sheet and Tubular Form
- C547-07 Standard Specification for Mineral Fiber pipe Insulation
- C552-07 Standard Specification for Cellular Glass Thermal Insulation
- C553-08 Standard Specification for Mineral Fiber Blanket Thermal Insulation for Commercial and Industrial Applications
- C585-09 Standard Practice for Inner and Outer Diameters of Rigid Thermal Insulation for Nominal Sizes of Pipe and Tubing (NPS System) R (1998)
- C612-10 Standard Specification for Mineral Fiber Block and Board Thermal Insulation
- C1126-04 Standard Specification for Faced or Unfaced Rigid Cellular Phenolic Thermal Insulation
- C1136-10 Standard Specification for Flexible, Low Permeance Vapor Retarders for Thermal Insulation
- D1668-97a (2006) Standard Specification for Glass Fabrics (Woven and Treated) for Roofing and Waterproofing
- E84-10 Standard Test Method for Surface Burning Characteristics of Building Materials
- E119-09c Standard Test Method for Fire Tests of Building Construction and Materials
- E136-09b Standard Test Methods for Behavior of Materials in a Vertical Tube Furnace at 750 degrees C (1380 F)

E. National Fire Protection Association (NFPA):

- 90A-09 Standard for the Installation of Air Conditioning and Ventilating Systems

- 96-08Standards for Ventilation Control and Fire Protection of
Commercial Cooking Operations
- 101-09Life Safety Code
- 251-06Standard methods of Tests of Fire Endurance of Building
Construction Materials
- 255-06Standard Method of tests of Surface Burning Characteristics of
Building Materials
- F. Underwriters Laboratories, Inc (UL):
 - 723UL Standard for Safety Test for Surface Burning Characteristics
of Building Materials with Revision of 09/08
- G. Manufacturer's Standardization Society of the Valve and Fitting Industry (MSS):
 - SP58-2009Pipe Hangers and Supports Materials, Design, and Manufacture

PART 2 - PRODUCTS

2.1 MINERAL FIBER OR FIBER GLASS

- A. ASTM C612 (Board, Block), Class 1 or 2, density 48 kg/m³ (3 pcf), k = 0.037 (0.26) at 24 degrees C (75 degrees F), external insulation for temperatures up to 204 degrees C (400 degrees F) with foil scrim (FSK) facing.
- B. ASTM C547 (Pipe Fitting Insulation and Preformed Pipe Insulation), Class 1, k = 0.037 (0.26) at 24 degrees C (75 degrees F), for use at temperatures up to 230 degrees C (450 degrees F) with an all service vapor retarder jacket with polyvinyl chloride premolded fitting covering.

2.2 CELLULAR GLASS CLOSED-CELL

- A. Comply with Standard ASTM C177, C518, density 120 kg/m³ (7.5 pcf) nominal, k = 0.033 (0.29) at 240 degrees C (75 degrees F).
- B. Pipe insulation for use at temperatures up to 200 degrees C (400 degrees F) with all service vapor retarder jacket.

2.3 INSULATION FACINGS AND JACKETS

- A. Vapor Retarder, higher strength with low water permeance ≤ 0.02 or less perm rating, Beach puncture 50 units for insulation facing on exposed equipment, and for pipe insulation jackets. Facings and jackets shall be all service type (ASJ) or PVDC Vapor Retarder jacketing.
- B. ASJ jacket shall be white kraft bonded to 0.025 mm (1 mil) thick aluminum foil, fiberglass reinforced, with pressure sensitive adhesive closure. Comply with ASTM C1136. Beach puncture 50 units, Suitable for painting without sizing. Jackets shall have minimum 40 mm (1-1/2 inch) lap on longitudinal joints and minimum 75 mm (3 inch) butt strip on end joints. Butt strip material shall be same as the jacket. Lap and butt strips shall be self-sealing type with factory-applied pressure sensitive adhesive.

- C. Vapor Retarder medium strength with low water vapor permeance of 0.02 or less perm rating, Beach puncture 25 units: Foil-Scrim-Kraft (FSK) or PVDC vapor retarder jacketing type for concealed equipment.
- D. Glass Cloth Jackets: Presized, minimum 0.18 kg per square meter (7.8 ounces per square yard), 2000 kPa (300 psig) bursting strength with integral vapor retarder where required or specified. Weather proof if utilized for outside service.
- E. Factory composite materials may be used provided that they have been tested and certified by the manufacturer.
- F. Pipe fitting insulation covering (jackets): Fitting covering shall be premolded to match shape of fitting and shall be polyvinyl chloride (PVC) conforming to Fed Spec L-P-535, composition A, Type II Grade GU, and Type III, minimum thickness 0.7 mm (0.03 inches). Provide color matching vapor retarder pressure sensitive tape.
- G. Aluminum Jacket-Piping systems: ASTM B209, 3003 alloy, H-14 temper, 0.6 mm (0.023 inch) minimum thickness with locking longitudinal joints. Jackets for elbows, tees and other fittings shall be factory-fabricated to match shape of fitting and of 0.6 mm (0.024) inch minimum thickness aluminum. Fittings shall be of same construction as straight run jackets but need not be of the same alloy. Factory-fabricated stainless steel bands shall be installed on all circumferential joints. Bands shall be 13 mm (0.5 inch) wide on 450 mm (18 inch) centers. System shall be weatherproof if utilized for outside service.

2.5 REMOVABLE INSULATION JACKETS

- A. Removable insulation jackets shall be provided for all valves, control valves, condensate tanks, expansion tanks, flash tanks, pressure reducing valves, traps, and other steam, condensate, or heating hot water equipment that is not insulated due to maintenance accessibility concerns.
- B. Insulation and Jacket:
 - 1. Jacket Material: Silicon impregnated fiberglass composite.
 - 2. Core blanket shall meet ASTM C 1086-88.
 - 3. Construction: One piece jacket body with three-ply braided pure Teflon or Kevlar thread and insulation sewn as part of jacket. Belt fastened.
 - 4. For large equipment, no piece shall weigh over 40 lbs. All large tanks shall come in at least two interlocking pieces. The blanket shall be custom designed for the piece of equipment being used.

2.6 PIPE COVERING PROTECTION SADDLES

- A. Warm or hot pipe supports: Premolded pipe insulation (180 degree half-shells) on bottom half of pipe at supports. Material shall be cellular glass or calcium silicate. Insulation at supports shall have same thickness as adjacent insulation.

2.7 ADHESIVE, MASTIC, CEMENT

- A. Mil. Spec. MIL-A-3316, Class 1: Jacket and lap adhesive and protective finish coating for insulation.
- B. Mil. Spec. MIL-A-3316, Class 2: Adhesive for laps and for adhering insulation to metal surfaces.
- C. Mil. Spec. MIL-A-24179, Type II Class 1: Adhesive for installing flexible unicellular insulation and for laps and general use.
- D. Mil. Spec. MIL-C-19565, Type I: Protective finish for outdoor use.
- E. Mil. Spec. MIL-C-19565, Type I or Type II: Vapor barrier compound for indoor use.
- F. ASTM C449: Mineral fiber hydraulic-setting thermal insulating and finishing cement.
- G. Other: Insulation manufacturers' published recommendations.

2.8 MECHANICAL FASTENERS

- A. Pins, anchors: Welded pins, or metal or nylon anchors with galvanized steel-coated or fiber washer, or clips. Pin diameter shall be as recommended by the insulation manufacturer.
- B. Staples: Outward clinching monel or galvanized steel.
- C. Wire: 1.3 mm thick (18 gage) soft annealed galvanized or 1.9 mm (14 gage) copper clad steel or nickel copper alloy.
- D. Bands: 13 mm (0.5 inch) nominal width, brass, galvanized steel, aluminum or stainless steel.

2.9 REINFORCEMENT AND FINISHES

- A. Glass fabric, open weave: ASTM D1668, Type III (resin treated) and Type I (asphalt treated).
- B. Glass fiber fitting tape: Mil. Spec MIL-C-20079, Type II, Class 1.
- C. Tape for Flexible Elastomeric Cellular Insulation: As recommended by the insulation manufacturer.
- D. Hexagonal wire netting: 25 mm (one inch) mesh, 0.85 mm thick (22 gage) galvanized steel.
- E. Corner beads: 50 mm (2 inch) by 50 mm (2 inch), 0.55 mm thick (26 gage) galvanized steel; or, 25 mm (1 inch) by 25 mm (1 inch), 0.47 mm thick (28 gage) aluminum angle adhered to 50 mm (2 inch) by 50 mm (2 inch) Kraft paper.
- F. PVC fitting cover: Fed. Spec L-P-535, Composition A, 11-86 Type II, Grade GU, with Form B Mineral Fiber insert, for media temperature 4 degrees C (40 degrees F) to 121 degrees C (250 degrees F). Below 4 degrees C (40 degrees F) and above 121 degrees C (250 degrees F), provide double layer insert. Provide color matching vapor barrier pressure sensitive tape.

2.10 FIRESTOPPING MATERIAL

Other than pipe and duct insulation, refer to Section 07 84 00 FIRESTOPPING.

2.11 FLAME AND SMOKE

Unless shown otherwise all assembled systems shall meet flame spread 25 and smoke developed 50 rating as developed under ASTM, NFPA and UL standards and specifications. See paragraph 1.3 " QUALITY ASSURANCE ".

PART 3 - EXECUTION**3.1 GENERAL REQUIREMENTS**

- A. Required pressure tests piping joints and connections shall be completed and the work approved by the COTR prior to application of insulation. Surface shall be clean and dry with all foreign materials, such as dirt, oil, loose scale and rust removed.
- B. Except for specific exceptions, insulate entire specified equipment, piping (pipe, fittings, valves, accessories). Insulate each pipe individually. Do not use scrap pieces of insulation where a full length section will fit.
- C. Where removal of insulation of piping and equipment is required to comply with Section 02 82 13.13, PIPE INSULATION – GLOVEBAG ASBESTOS ABATEMENT, such areas shall be reinsulated to comply with this specification, where piping is to remain.
- D. Insulation materials shall be installed in a first class manner with smooth and even surfaces, with jackets and facings drawn tight and smoothly cemented down at all laps. Insulation shall be continuous through all sleeves and openings. Vapor retarders shall be continuous and uninterrupted throughout systems with operating temperature 16 degrees C (60 degrees F) and below. Lap and seal vapor retarder over ends and exposed edges of insulation. Anchors, supports and other metal projections through insulation on cold surfaces shall be insulated and vapor sealed for a minimum length of 150 mm (6 inches).
- E. Install vapor stops at all insulation terminations on either side of valves, pumps and equipment and particularly in straight lengths of pipe insulation.
- F. Construct insulation on parts of equipment such as convertors and heat exchangers that must be opened periodically for maintenance or repair, so insulation can be removed and replaced without damage. Install insulation with bolted 1 mm thick (20 gage) galvanized steel or aluminum covers as complete units, or in sections, with all necessary supports, and split to coincide with flange/split of the equipment.
- G. Insulation on hot piping and equipment shall be terminated square at items not to be insulated, access openings and nameplates. Cover all exposed raw insulation with white sealer or jacket material.
- H. Protect all insulations outside of buildings with aluminum jacket using lock joint or other approved system for a continuous weather tight system. Access doors and other items requiring maintenance or access shall be removable and sealable.
- I. Insulate PRVs, flow meters, and steam traps.
- J. HVAC work not to be insulated:
 - 1. Equipment: Expansion tanks, heating hot water pumps.
 - 2. In hot piping: Unions, flexible connectors, control valves, vacuum breakers, thermostatic vent valves, exposed piping through floor for convectors and radiators. Insulate piping to within approximately 75 mm (3 inches) of uninsulated items.

- K. Apply insulation materials subject to the manufacturer's recommended temperature limits. Apply adhesives, mastic and coatings at the manufacturer's recommended minimum coverage.
- L. Elbows, flanges and other fittings shall be insulated with the same material as is used on the pipe straights. The elbow/ fitting insulation shall be field-fabricated, mitered or factory prefabricated to the necessary size and shape to fit on the elbow/ fitting. Use of polyurethane spray-foam to fill a PVC elbow jacket is prohibited on cold applications.
- M. Firestop Pipe insulation:
 - 1. Provide firestopping insulation at fire and smoke barriers through penetrations. Fire stopping insulation shall be UL listed as defined in Section 07 84 00, FIRESTOPPING.
 - 2. Pipe penetrations requiring fire stop insulation including, but not limited to the following:
 - a. Pipe risers through floors
 - b. Pipe chase walls and floors
 - c. Smoke partitions
 - d. Fire partitions
- N. Provide vapor barrier jackets over insulation as follows:
 - 1. All piping and ductwork exposed to outdoor weather.
- O. Provide metal jackets over insulation as follows:
 - 1. All piping exposed to outdoor weather.
 - 2. Piping exposed in building, within 1800 mm (6 feet) of the floor, that connects to sterilizers, kitchen and laundry equipment. Jackets may be applied with pop rivets. Provide aluminum angle ring escutcheons at wall, ceiling or floor penetrations.
 - 3. A 50 mm (2 inch) overlap is required at longitudinal and circumferential joints.

3.2 INSULATION INSTALLATION

- A. Mineral Fiber Board:
 - 1. Faced board: Apply board on pins spaced not more than 300 mm (12 inches) on center each way, and not less than 75 mm (3 inches) from each edge of board. In addition to pins, apply insulation bonding adhesive to entire underside of horizontal metal surfaces. Butt insulation edges tightly and seal all joints with laps and butt strips. After applying speed clips cut pins off flush and apply vapor seal patches over clips.
 - 2. Plain board:
 - a. Insulation shall be scored, beveled or mitered to provide tight joints and be secured to equipment with bands spaced 225 mm (9 inches) on center for irregular surfaces or with pins and clips on flat surfaces. Use corner beads to protect edges of insulation.
 - b. For hot equipment: Stretch 25 mm (1 inch) mesh wire, with edges wire laced together, over insulation and finish with insulating and finishing cement applied in one coat, 6 mm (1/4 inch) thick, trowel led to a smooth finish.
 - 3. Hot equipment: 40 mm (1-1/2 inch) thick insulation faced with ASJ.
 - a. Convertors, air separators, steam condensate receivers.

- b. Steam humidifier housing.
- B. Molded Mineral Fiber Pipe and Tubing Covering:
 - 1. Fit insulation to pipe or duct, aligning longitudinal joints. Seal longitudinal joint laps and circumferential butt strips by rubbing hard with a nylon sealing tool to assure a positive seal. Staples may be used to assist in securing insulation. Seal all vapor retarder penetrations on cold piping with a generous application of vapor barrier mastic. Provide inserts and install with metal insulation shields at outside pipe supports.
 - 2. Contractor's options for fitting, flange and valve insulation:
 - a. Insulating and finishing cement for sizes less than 100 mm (4 inches) operating at surface temperature of 16 degrees C (61 degrees F) or more.
 - b. Factory premolded, one piece PVC covers with mineral fiber, (Form B), inserts. Provide two insert layers for pipe temperatures below 4 degrees C (40 degrees F), or above 121 degrees C (250 degrees F). Secure first layer of insulation with twine. Seal seam edges with vapor barrier mastic and secure with fitting tape.
 - c. Factory molded, ASTM C547 or field mitered sections, joined with adhesive or wired in place. For hot piping finish with a smoothing coat of finishing cement.
 - d. Fitting tape shall extend over the adjacent pipe insulation and overlap on itself at least 50 mm (2 inches).
 - 3. Nominal thickness in millimeters and inches specified in the schedule at the end of this section.
- C. Cellular Glass Insulation:
 - 1. Pipe and tubing, covering nominal thickness in millimeters and inches as specified in the schedule at the end of this section.
 - 2. Underground Steam & Condensate Piping: Type II, factory jacketed with a 3 mm laminate jacketing consisting of 3000 mm x 3000 mm (10 ft x 10 ft) asphalt impregnated glass fabric, bituminous mastic and outside protective plastic film.
 - a. 75 mm (3 inches) thick for steam & condensate piping.
 - b. Underground piping: Apply insulation with joints tightly butted. Seal longitudinal self-sealing lap. Use field fabricated or factory made fittings. Seal butt joints and fitting with jacketing as recommended by the insulation manufacturer. Use 100 mm (4 inch) wide strips to seal butt joints.
 - c. Provide anchors and wall penetrations as recommended by the insulation manufacturer.
 - d. Underground insulation shall be inspected and approved by the COTR as follows:
 - 1) Insulation in place before coating.
 - 2) After coating.
 - e. Sand bed and backfill: Minimum 75 mm (3 inches) all around insulated pipes, applied after coating has dried.
- D. Removable insulation jackets:

1. To minimize heat loss from fittings, the blanket shall extend beyond mating flanges into existing insulation for a minimum of 2". Where the blanket cannot fit over existing oversized insulation, the blanket shall butt up to existing insulation with a friction fit closing seam. All sections of pipes shall be insulated and open gaps are not acceptable. Blanket diameters that are 2" or larger than existing insulation shall be end capped to eliminate open air void.

3.3 COMMISSIONING

- A. Provide commissioning documentation in accordance with the requirements of section 23 08 00 – COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to section 23 08 00 – COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

3.4 PIPE INSULATION SCHEDULE

Provide insulation for piping systems as scheduled below:

| Insulation Thickness Millimeters (Inches) | | | | | |
|--|---|--|------------------|------------------|-------------------|
| Operating Temperature Range/Service | Insulation Material | Nominal Pipe Size Millimeters (Inches) | | | |
| | | Less than 25 (1) | 25 – 32 (1 – 1¼) | 38 – 75 (1½ - 3) | 100 (4) and Above |
| 122-177 degrees C (251-350 degrees F) (HPS, MPS) | Mineral Fiber (Above ground piping only) | 75 (3) | 100 (4) | 113 (4.5) | 113 (4.5) |
| 100-121 degrees C (212-250 degrees F) (HPR, MPR, LPS, vent piping from PRV Safety Valves, Condensate receivers and flash tanks) | Mineral Fiber (Above ground piping only) | 62 (2.5) | 62 (2.5) | 75 (3.0) | 75 (3.0) |
| 38-94 degrees C (100-200 degrees F) (LPR, HWS, HWR) | Mineral Fiber (Above ground piping only) | 38 (1.5) | 38 (1.5) | 50 (2.0) | 50 (2.0) |
| 93-260 degrees C (200-500 degrees F) (HPS, PR) | Cellular Glass Closed-Cell | 50 (2.0) | 50 (2.0) | 75 (3.0) | 75 (3.0) |
| | | | | | |

--- E N D ---

SECTION 23 08 00**COMMISSIONING OF HVAC SYSTEMS****PART 1 - GENERAL****1.1 DESCRIPTION**

- A. The requirements of this Section apply to all sections of Division 23.
- B. This project will have selected building systems commissioned. The complete list of equipment and systems to be commissioned are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. The commissioning process, which the Contractor is responsible to execute, is defined in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. A Commissioning Agent (CxA) appointed by the Department of Veterans Affairs will manage the commissioning process.

1.2 RELATED WORK

- A. Section 01 00 00 GENERAL REQUIREMENTS.
- B. Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.
- C. Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

1.3 SUMMARY

- A. This Section includes requirements for commissioning the HVAC systems, subsystems and equipment. This Section supplements the general requirements specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.
- B. The commissioning activities have been developed to support the VA requirements to meet guidelines for Federal Leadership in Environmental, Energy, and Economic Performance.
- C. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for more specifics regarding processes and procedures as well as roles and responsibilities for all Commissioning Team members.

1.4 DEFINITIONS

- A. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for definitions.

1.5 COMMISSIONED SYSTEMS

- A. Commissioning of a system or systems specified in this Division is part of the construction process. Documentation and testing of these systems, is required in cooperation with the VA and the Commissioning Agent.
- B. The following HVAC systems will be commissioned:
 - 1. Heating Hot Water Systems (Converters and control valves, controls, instrumentation and gages, heating water pumps and motors, Variable Speed Drives, air terminal unit 3-way control valve operation, pump minimum flow bypass control valve operation).
 - 2. Condensate Return Systems (automatic pump traps).

3. Steam System (Controls, gages and instrumentation, pressure reducing valves, steam meters, steam humidifiers, steam reheat coil controls, safety relief valves).
4. Direct Digital Control System (BACnet or similar Local Area Network (LAN), Operator Work Station hardware and software, building controller hardware and software, all sequences of operation, system accuracy and response time).
5. HVAC Water Treatment Systems (Closed circuits – including shot feeders and final water analysis, open circuits – including water analysis, chemical/biocide tanks, injection piping, chemical/biocide pumps and motors, controls, water meter, and automatic blowdown).

1.6 SUBMITTALS

- A. The commissioning process requires review of selected Submittals. The Commissioning Agent will review these submittals to verify compliance with Basis of Design and Owner's Project Requirements. Refer to Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, and SAMPLES for further details.
- B. The commissioning process requires review of installed equipment against approved submittals. Specific submittal requirements related to the commissioning process are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION

3.1 PRE-FUNCTIONAL CHECKLISTS

- A. The Contractor shall complete Pre-Functional Checklists to verify systems, subsystems, and equipment installation is complete and systems are ready for Systems Functional Performance Testing. The Commissioning Agent will prepare Pre-Functional Checklists to be used to document equipment installation. The Contractor shall complete the checklists. Completed checklists shall be submitted to the VA and to the Commissioning Agent for review. The Commissioning Agent may spot check a sample of completed checklists. If the Commissioning Agent determines that the information provided on the checklist is not accurate, the Commissioning Agent will return the marked-up checklist to the Contractor for correction and resubmission. If the Commissioning Agent determines that a significant number of completed checklists for similar equipment are not accurate, the Commissioning Agent will select a broader sample of checklists for review. If the Commissioning Agent determines that a significant number of the broader sample of checklists is also inaccurate, all the checklists for the type of equipment will be returned to the Contractor for correction and resubmission. Refer to SECTION 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for submittal requirements for Pre-Functional Checklists, Equipment Startup Reports, and other commissioning documents.

3.2 CONTRACTORS TESTS

- A. Contractor tests as required by other sections of Division 23 shall be scheduled and documented in accordance with Section 01 00 00 GENERAL REQUIREMENTS. The Commissioning Agent

will witness selected Contractor tests. Contractor tests shall be completed prior to scheduling Systems Functional Performance Testing.

3.3 SYSTEMS FUNCTIONAL PERFORMANCE TESTING:

- A. The Commissioning Process includes Systems Functional Performance Testing that is intended to test systems functional performance under steady state conditions, to test system reaction to changes in operating conditions, and system performance under emergency conditions. The Commissioning Agent will prepare detailed Systems Functional Performance Test procedures for review and approval by the COTR. The Contractor shall review and comment on the tests prior to approval. The Contractor shall provide the required labor, materials, and test equipment identified in the test procedure to perform the tests. The Commissioning Agent will witness and document the testing. The Contractor shall sign the test reports to verify tests were performed. See Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS, for additional details.

3.4 TRAINING OF VA PERSONNEL

- A. Training of the VA's operation and maintenance personnel is required in cooperation with the COTR. Provide competent, factory authorized personnel to provide instruction to operation and maintenance personnel concerning the location, operation, and troubleshooting of the installed systems. The instruction shall be scheduled in coordination with the COTR after submission and approval of formal training plans. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS and Division 23 Sections for additional Contractor training requirements.

----- END -----

SECTION 23 09 23
DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC**PART 1 - GENERAL****1.1 DESCRIPTION**

- A. A complete new stand-alone direct digital control system shall be provided under this project to serve the new equipment and renovated areas of this project. The system shall be a BACNet capable Direct Digital Control System utilizing electric actuation, and shall be tied into the existing Hospital Johnson Controls Metasys Building Automation System, including all graphics, trends, alarms, etc.
- B. The contractor administered by this section of the technical specifications must be in the business of installing direct digital controls for over three (3) years and must have installed and completed at least ten (10) direct digital temperature control jobs of similar design using the same model of equipment as specified. The contractor administered by this section of the technical specifications must be a Licensed Factory Representative and Installer of the manufacturer's specified for the local area, and shall have a local engineering and service office within 50 miles of the job site.
- C. The basic control system shall include all sensors, controllers, instruments, valves, actuators, devices, installation and service for a complete and functional control system. All control devices (valves, actuators, etc.) are included under the controls work unless specifically specified elsewhere in the Specifications. Control system shall be designed to allow easy field adjustment of all setpoints and parameters.
- D. Cooperate with the HVAC Contractor and other Subcontractors in identifying active or inactive pneumatic tubing, control wiring, equipment, etc., and assist in the actual removal. Remove all pneumatic tubing, control wiring and control devices not required to accommodate the renovated areas and new control system.
- E. Provide (a) direct-digital control system(s) as indicated on the project documents, point list, interoperability tables, drawings and as described in these specifications. Include a complete and working direct-digital control system. Include all engineering, programming, controls and installation materials, installation labor, commissioning and start-up, training, final project documentation and warranty.
 - 1. The direct-digital control system(s) shall consist of high-speed, peer-to-peer network of DDC controllers, utilizing the existing control system server and Engineering Control Center. The existing CPU/Monitor, printer, and other peripherals shall be used to form a single operator workstation. New system including interface to existing systems and equipment shall operate and function as one complete system including one database of control point objects and global control logic capabilities. Facility operators shall have complete operations and control capability over all systems, new and existing, including: monitoring, trending, graphing,

- scheduling, alarm management, global point sharing, global strategy deployment, graphical operations interface and custom reporting as specified. Modify the existing ECC, if necessary, to accommodate the additional control points.
2. The contractor administered by this section of the technical specifications shall supply as required, all necessary hardware equipment and software packages to interface between any existing and new system Network Area Controllers (NAC) as part of this contract. Number of area controllers required is dependent on the type and quantity of devices, hardware and software points provided. Network area controllers are same as remote controller units (RCU).
 3. The direct-digital control system(s) shall be native BACnet. All controllers, devices and components shall be listed by BACnet Testing Laboratories. All new controller, devices and components shall be accessible using a Web browser interface and shall communicate exclusively using the ASHRAE Standard 135 BACnet communications protocol without the use of gateways, unless otherwise allowed by this Section of the technical specifications, specifically shown on the design drawings and specifically requested otherwise by the VA.
 - a. If used, gateways shall support the ASHRAE Standard 135 BACnet communications protocol.
 - b. If used, gateways shall provide all object properties and read/write services shown on VA-approved interoperability schedules.
 4. The work administered by this Section of the technical specifications shall include all labor, materials, special tools, equipment, enclosures, power supplies, software, software licenses, Project specific software configurations and database entries, interfaces, wiring, tubing, installation, labeling, engineering, calibration, documentation, submittals, testing, verification, training services, permits and licenses, transportation, shipping, handling, administration, supervision, management, insurance, Warranty, specified services and items required for complete and fully functional Controls Systems.
 5. The control systems shall be designed such that each mechanical system shall operate under stand-alone mode. The contractor administered by this Section of the technical specifications shall provide controllers for each mechanical system. In the event of a network communication failure, or the loss of any other controller, the control system shall continue to operate independently. Failure of the ECC shall have no effect on the field controllers, including those involved with global strategies.
- F. Some products are furnished but not installed by the contractor administered by this Section of the technical specifications. The contractor administered by this Section of the technical specifications shall formally coordinate in writing and receive from other contractors formal acknowledgements in writing prior to submission the installation of the products. These products include, but are not limited to the following:
1. Control valves.

2. Flow switches.
 3. Flow meters.
 4. Sensor wells and sockets in piping.
- G. Some products are installed but not furnished by the contractor administered by this Section of the technical specifications. The contractor administered by this Section of the technical specifications shall formally coordinate in writing and receive from other contractors formal acknowledgements in writing prior to submission the procurement of the products. These products include, but are not limited to the following:
1. Factory-furnished accessory thermostats and sensors furnished with unitary equipment.
- H. Some products are not provided by, but are nevertheless integrated with the work executed by, the contractor administered by this Section of the technical specifications. The contractor administered by this Section of the technical specifications shall formally coordinate in writing and receive from other contractors formal acknowledgements in writing prior to submission the particulars of the products. These products include, but are not limited to the following:
1. Fire alarm systems. If zoned fire alarm is required by the project-specific requirements, this interface shall require multiple relays, which are provided and installed by the fire alarm system contractor, to be monitored.
 2. Advanced utility metering systems. These systems may take information from the control system or its component meters and sensors. There is no command or control action from the advanced utility monitoring system on the control system however.
 3. Plate & Frame converter package controls. These controls shall be native BACnet, for integration into existing front-end.
 4. Variable frequency drives. These controls, shall be native BACnet.
 5. The following systems have limited control (as individually noted below) from the ECC:
 - a. Domestic water heating systems: Hot water recirculation pump status alarms.
- I. Responsibility Table:

| Work/Item/System | Furnish | Install | Low Voltage Wiring | Line Power |
|--|----------|----------|--------------------|------------|
| Control system low voltage and communication wiring | 23 09 23 | 23 09 23 | 23 09 23 | N/A |
| LAN conduits, jack and cabling | 27 | 27 | 27 | N/A |
| Manual valves | 23 | 23 | N/A | N/A |
| Automatic valves | 23 09 23 | 23 | 23 09 23 | 23 09 23 |
| Pipe insertion devices and taps, flow and pressure stations. | 23 | 23 | N/A | N/A |
| Thermowells | 23 09 23 | 23 | N/A | N/A |
| Current Switches | 23 09 23 | 23 09 23 | 23 09 23 | N/A |
| Control Relays | 23 09 23 | 23 09 23 | 23 09 23 | N/A |

| Work/Item/System | Furnish | Install | Low Voltage Wiring | Line Power |
|---|----------|----------|--------------------|------------|
| Interface with plate & frame converter controls | 23 09 23 | 23 09 23 | 23 09 23 | 26 |
| All control system nodes, equipment, housings, enclosures and panels. | 23 09 23 | 23 09 23 | 23 09 23 | 26 |
| VFDs | 26 | 26 | 23 09 23 | 26 |
| Unit Heater controls (not furnished with equipment) | 23 09 23 | 23 09 23 | 23 09 23 | 26 |
| Starters, HOA switches | 23 | 23 | N/A | 26 |

- J. Unitary standalone systems including Unit Heaters and similar units for control of room environment conditions may be equipped with integral controls furnished and installed by the equipment manufacturer or field mounted. Refer to equipment specifications and as indicated in project documents. Application of standalone unitary controls is limited to at least those systems wherein remote monitoring, alarm and start-up are not necessary. Examples of such systems include:
1. Vestibule heater
 2. Exterior stair heater
 3. Mechanical or electrical room heating and ventilation.
- K. The direct-digital control system shall start and stop equipment, move (position) valve actuators, and vary speed of equipment to execute the mission of the control system. Use electricity as the motive force for all valve actuators.

1.2 RELATED WORK

- A. Section 22 11 23, Domestic Water Pumps.
- B. Section 23 21 13, Hydronic Piping.
- C. Section 23 22 13, Steam and Condensate Heating Piping.
- D. Section 26 05 11, Requirements for Electrical Installations.
- E. Section 26 05 21, Low-Voltage Electrical Power Conductors and Cables (600 Volts and Below).
- F. Section 26 05 26, Grounding and Bonding for Electrical Systems.
- G. Section 26 05 33, Raceway and Boxes for Electrical Systems.
- H. Section 26 29 11, Motor Controllers.

1.3 DEFINITIONS

- A. Algorithm: A logical procedure for solving a recurrent mathematical problem; A prescribed set of well-defined rules or processes for the solution of a problem in a finite number of steps.
- B. ARCNET: ANSI/ATA 878.1 - Attached Resource Computer Network. ARCNET is a deterministic LAN technology; meaning it's possible to determine the maximum delay before a device is able to transmit a message.

- C. Analog: A continuously varying signal value (e.g., temperature, current, velocity etc.
- D. BACnet: A Data Communication Protocol for Building Automation and Control Networks, ANSI/ASHRAE Standard 135. This communications protocol allows diverse building automation devices to communicate data over and services over a network.
- E. BACnet/IP: Annex J of Standard 135. It defines and allows for using a reserved UDP socket to transmit BACnet messages over IP networks. A BACnet/IP network is a collection of one or more IP sub-networks that share the same BACnet network number.
- F. BACnet Internetwork: Two or more BACnet networks connected with routers. The two networks may use different LAN technologies.
- G. BACnet Network: One or more BACnet segments that have the same network address and are interconnected by bridges at the physical and data link layers.
- H. BACnet Segment: One or more physical segments of BACnet devices on a BACnet network, connected at the physical layer by repeaters.
- I. BACnet Broadcast Management Device (BBMD): A communications device which broadcasts BACnet messages to all BACnet/IP devices and other BBMDs connected to the same BACnet/IP network.
- J. BACnet Interoperability Building Blocks (BIBBs): BACnet Interoperability Building Blocks (BIBBs) are collections of one or more BACnet services. These are prescribed in terms of an "A" and a "B" device. Both of these devices are nodes on a BACnet internetwork.
- K. BACnet Testing Laboratories (BTL). The organization responsible for testing products for compliance with the BACnet standard, operated under the direction of BACnet International.
- L. Baud: It is a signal change in a communication link. One signal change can represent one or more bits of information depending on type of transmission scheme. Simple peripheral communication is normally one bit per Baud. (e.g., Baud rate = 78,000 Baud/sec is 78,000 bits/sec, if one signal change = 1 bit).
- M. Binary: A two-state system where a high signal level represents an "ON" condition and an "OFF" condition is represented by a low signal level.
- N. BMP or bmp: Suffix, computerized image file, used after the period in a DOS-based computer file to show that the file is an image stored as a series of pixels.
- O. Bus Topology: A network topology that physically interconnects workstations and network devices in parallel on a network segment.
- P. Control Unit (CU): Generic term for any controlling unit, stand-alone, microprocessor based, digital controller residing on secondary LAN or Primary LAN, used for local controls or global controls
- Q. Deadband: A temperature range over which no heating or cooling is supplied, i.e., 22-25 degrees C (72-78 degrees F), as opposed to a single point change over or overlap).
- R. Device: a control system component that contains a BACnet Device Object and uses BACnet to communicate with other devices.

- S. Device Object: Every BACnet device requires one Device Object, whose properties represent the network visible properties of that device. Every Device Object requires a unique Object Identifier number on the BACnet internetwork. This number is often referred to as the device instance.
- T. Device Profile: A specific group of services describing BACnet capabilities of a device, as defined in ASHRAE Standard 135-2008, Annex L. Standard device profiles include BACnet Operator Workstations (B-OWS), BACnet Building Controllers (B-BC), BACnet Advanced Application Controllers (B-AAC), BACnet Application Specific Controllers (B-ASC), BACnet Smart Actuator (B-SA), and BACnet Smart Sensor (B-SS). Each device used in new construction is required to have a PICS statement listing which service and BIBBs are supported by the device.
- U. Diagnostic Program: A software test program, which is used to detect and report system or peripheral malfunctions and failures. Generally, this system is performed at the initial startup of the system.
- V. Direct Digital Control (DDC): Microprocessor based control including Analog/Digital conversion and program logic. A control loop or subsystem in which digital and analog information is received and processed by a microprocessor, and digital control signals are generated based on control algorithms and transmitted to field devices in order to achieve a set of predefined conditions.
- W. Distributed Control System: A system in which the processing of system data is decentralized and control decisions can and are made at the subsystem level. System operational programs and information are provided to the remote subsystems and status is reported back to the Engineering Control Center. Upon the loss of communication with the Engineering Control center, the subsystems shall be capable of operating in a stand-alone mode using the last best available data.
- X. Download: The electronic transfer of programs and data files from a central computer or operation workstation with secondary memory devices to remote computers in a network (distributed) system.
- Y. DXF: An AutoCAD 2-D graphics file format. Many CAD systems import and export the DXF format for graphics interchange.
- Z. Electrical Control: A control circuit that operates on line or low voltage and uses a mechanical means, such as a temperature sensitive bimetal or bellows, to perform control functions, such as actuating a switch or positioning a potentiometer.
- AA. Electronic Control: A control circuit that operates on low voltage and uses a solid-state components to amplify input signals and perform control functions, such as operating a relay or providing an output signal to position an actuator.
- BB. Engineering Control Center (ECC): The centralized control point for the intelligent control network. The ECC comprises of personal computer and connected devices to form a single workstation.
- CC. Ethernet: A trademark for a system for exchanging messages between computers on a local area network using coaxial, fiber optic, or twisted-pair cables.

- DD. Firmware: Firmware is software programmed into read only memory (ROM) chips. Software may not be changed without physically altering the chip.
- EE. Gateway: Communication hardware connecting two or more different protocols. It translates one protocol into equivalent concepts for the other protocol. In BACnet applications, a gateway has BACnet on one side and non-BACnet (usually proprietary) protocols on the other side.
- FF. GIF: Abbreviation of Graphic interchange format.
- GG. Graphic Program (GP): Program used to produce images of air handler systems, fans, chillers, pumps, and building spaces. These images can be animated and/or color-coded to indicate operation of the equipment.
- HH. Graphic Sequence of Operation: It is a graphical representation of the sequence of operation, showing all inputs and output logical blocks.
- II. I/O Unit: The section of a digital control system through which information is received and transmitted. I/O refers to analog input (AI), digital input (DI), analog output (AO) and digital output (DO). Analog signals are continuous and represent temperature, pressure, flow rate etc, whereas digital signals convert electronic signals to digital pulses (values), represent motor status, filter status, on-off equipment etc.
- JJ. I/P: a method for conveying and routing packets of information over LAN paths. User Datagram Protocol (UDP) conveys information to "sockets" without confirmation of receipt. Transmission Control Protocol (TCP) establishes "sessions", which have end-to-end confirmation and guaranteed sequence of delivery.
- KK. JPEG: A standardized image compression mechanism stands for Joint Photographic Experts Group, the original name of the committee that wrote the standard.
- LL. Local Area Network (LAN): A communication bus that interconnects operator workstation and digital controllers for peer-to-peer communications, sharing resources and exchanging information.
- MM. Network Repeater: A device that receives data packet from one network and rebroadcasts to another network. No routing information is added to the protocol.
- NN. MS/TP: Master-slave/token-passing (ISO/IEC 8802, Part 3). It is not an acceptable LAN option for VA health-care facilities. It uses twisted-pair wiring for relatively low speed and low cost communication.
- OO. Native BACnet Device: A device that uses BACnet as its primary method of communication with other BACnet devices without intermediary gateways. A system that uses native BACnet devices at all levels is a native BACnet system.
- PP. Network Number: A site-specific number assigned to each network segment to identify for routing. This network number must be unique throughout the BACnet internetwork.
- QQ. Object: The concept of organizing BACnet information into standard components with various associated properties. Examples include analog input objects and binary output objects.

- RR. Object Identifier: An object property used to identify the object, including object type and instance. Object Identifiers must be unique within a device.
- SS. Object Properties: Attributes of an object. Examples include present value and high limit properties of an analog input object. Properties are defined in ASHRAE 135; some are optional and some are required. Objects are controlled by reading from and writing to object properties.
- TT. Operating system (OS): Software, which controls the execution of computer application programs.
- UU. PCX: File type for an image file. When photographs are scanned onto a personal computer they can be saved as PCX files and viewed or changed by a special application program as Photo Shop.
- VV. Peripheral: Different components that make the control system function as one unit. Peripherals include monitor, printer, and I/O unit.
- WW. Peer-to-Peer: A networking architecture that treats all network stations as equal partners-any device can initiate and respond to communication with other devices.
- XX. PICS: Protocol Implementation Conformance Statement, describing the BACnet capabilities of a device. All BACnet devices have published PICS.
- YY. PID: Proportional, integral, and derivative control, used to control modulating equipment to maintain a setpoint.
- ZZ. Repeater: A network component that connects two or more physical segments at the physical layer.
- AAA. Router: a component that joins together two or more networks using different LAN technologies. Examples include joining a BACnet Ethernet LAN to a BACnet MS/TP LAN.
- BBB. Sensors: devices measuring state points or flows, which are then transmitted back to the DDC system.
- CCC. Thermostats : devices measuring temperatures, which are used in control of standalone or unitary systems and equipment not attached to the DDC system.

1.4 QUALITY ASSURANCE

A. Criteria:

1. Single Source Responsibility of subcontractor: The Contractor shall obtain hardware and software supplied under this Section and delegates the responsibility to a single source controls installation subcontractor. The controls subcontractor shall be responsible for the complete design, installation, and commissioning of the system. The controls subcontractor shall be in the business of design, installation and service of such building automation control systems similar in size and complexity.
2. Equipment and Materials: Equipment and materials shall be cataloged products of manufacturers regularly engaged in production and installation of HVAC control systems. Products shall be manufacturer's latest standard design and have been tested and proven in actual use.

3. The controls subcontractor shall provide a list of no less than ten similar projects which have building control systems as specified in this Section. These projects must be on-line and functional such that the Department of Veterans Affairs (VA) representative would observe the control systems in full operation.
 4. The controls subcontractor shall have in-place facility within 50 miles with technical staff, spare parts inventory for the next five (5) years, and necessary test and diagnostic equipment to support the control systems.
 5. The controls subcontractor shall have minimum of three years experience in design and installation of building automation systems similar in performance to those specified in this Section. Provide evidence of experience by submitting resumes of the project manager, the local branch manager, project engineer, the application engineering staff, and the electronic technicians who would be involved with the supervision, the engineering, and the installation of the control systems. Training and experience of these personnel shall not be less than three years. Failure to disclose this information will be a ground for disqualification of the supplier.
 6. Provide a competent and experienced Project Manager employed by the Controls Contractor. The Project Manager shall be supported as necessary by other Contractor employees in order to provide professional engineering, technical and management service for the work. The Project Manager shall attend scheduled Project Meetings as required and shall be empowered to make technical, scheduling and related decisions on behalf of the Controls Contractor.
- B. Codes and Standards:
1. All work shall conform to the applicable Codes and Standards.
 2. Electronic equipment shall conform to the requirements of FCC Regulation, Part 15, Governing Radio Frequency Electromagnetic Interference, and be so labeled.

1.5 PERFORMANCE

- A. The system shall conform to the following:
1. Graphic Display: The system shall display up to four (4) graphics on a single screen with a minimum of twenty (20) dynamic points per graphic. All current data shall be displayed within ten (10) seconds of the request.
 2. Graphic Refresh: The system shall update all dynamic points with current data within eight (8) seconds. Data refresh shall be automatic, without operator intervention.
 3. Object Command: The maximum time between the command of a binary object by the operator and the reaction by the device shall be two(2) seconds. Analog objects shall start to adjust within two (2) seconds.
 4. Object Scan: All changes of state and change of analog values shall be transmitted over the high-speed network such that any data used or displayed at a controller or work-station will be current, within the prior six (6) seconds.

5. Alarm Response Time: The maximum time from when an object goes into alarm to when it is annunciated at the workstation shall not exceed (10) seconds.
6. Program Execution Frequency: Custom and standard applications shall be capable of running as often as once every (5) seconds. The Contractor shall be responsible for selecting execution times consistent with the mechanical process under control.
7. Multiple Alarm Annunciations: All workstations on the network shall receive alarms within five (5) seconds of each other.
8. Performance: Programmable Controllers shall be able to execute DDC PID control loops at a selectable frequency from at least once every one (1) second. The controller shall scan and update the process value and output generated by this calculation at this same frequency.
9. Reporting Accuracy: Listed below are minimum acceptable reporting end-to-end accuracies for all values reported by the specified system:

| Measured Variable | Reported Accuracy |
|-------------------------|---|
| Space temperature | $\pm 0.5^{\circ}\text{C}$ ($\pm 1^{\circ}\text{F}$) |
| Ducted air temperature | $\pm 0.5^{\circ}\text{C}$ [$\pm 1^{\circ}\text{F}$] |
| Outdoor air temperature | $\pm 1.0^{\circ}\text{C}$ [$\pm 2^{\circ}\text{F}$] |
| Dew Point | $\pm 1.5^{\circ}\text{C}$ [$\pm 3^{\circ}\text{F}$] |
| Water temperature | $\pm 0.5^{\circ}\text{C}$ [$\pm 1^{\circ}\text{F}$] |
| Relative humidity | $\pm 2\%$ RH |
| Water flow | $\pm 1\%$ of reading |
| Water pressure | $\pm 2\%$ of full scale *Note 1 |
| Electrical Power | $\pm 0.5\%$ of reading |

Note 1: for both absolute and differential pressure

10. Control stability and accuracy: Control sequences shall maintain measured variable at setpoint within the following tolerances:

| Controlled Variable | Control Accuracy | Range of Medium |
|---------------------|---|--|
| Space Temperature | $\pm 1.0^{\circ}\text{C}$ ($\pm 2.0^{\circ}\text{F}$) | |
| Duct Temperature | $\pm 1.5^{\circ}\text{C}$ ($\pm 3^{\circ}\text{F}$) | |
| Humidity | $\pm 5\%$ RH | |
| Fluid Pressure | ± 10 kPa (± 1.5 psi) | 0–1 MPa (1–150 psi) |
| Fluid Pressure | ± 250 Pa (± 1.0 in. w.g.) | 0–12.5 kPa (0–50 in. w.g.) differential |

11. Extent of direct digital control: control design shall allow for at least the points indicated on the points lists on the drawings.

1.6 WARRANTY

- A. Labor and materials for control systems shall be warranted for a period as specified under Warranty in FAR clause 52.246-21.
- B. Control system failures during the warranty period shall be adjusted, repaired, or replaced at no cost or reduction in service to the owner. The system includes all computer equipment, transmission equipment, and all sensors and control devices.
- C. The on-line support service shall allow the Controls supplier to connect via (through password-limited access) VPN through the internet monitor and control the facility's building automation system. This remote connection to the facility shall be within two (2) hours of the time that the problem is reported. This coverage shall be extended to include normal business hours, after business hours, weekend and holidays. If the problem cannot be resolved with on-line support services, the Controls supplier shall dispatch the qualified personnel to the job site to resolve the problem within 24 hours after the problem is reported.
- D. Controls and Instrumentation subcontractor shall be responsible for temporary operations and maintenance of the control systems during the construction period until final commissioning, training of facility operators and acceptance of the project by VA.

1.7 SUBMITTALS

- A. Submit shop drawings in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's literature and data for all components including the following:
 - 1. A wiring diagram for each type of input device and output device including DDC controllers, modems, repeaters, etc. Diagram shall show how the device is wired and powered, showing typical connections at the digital controllers and each power supply, as well as the device itself. Show for all field connected devices, including but not limited to, control relays, motor starters, electric or electronic actuators, and temperature pressure, flow and humidity sensors and transmitters.
 - 2. A diagram of each terminal strip, including digital controller terminal strips, terminal strip location, termination numbers and the associated point names.
 - 3. Control valves schedule, including the size and pressure drop.
 - 4. Catalog cut sheets of all equipment used. This includes, but is not limited to software (by manufacturer and by third parties), DDC controllers, panels, peripherals, airflow measuring stations and associated components, and auxiliary control devices such as sensors, actuators, and control valves. When manufacturer's cut sheets apply to a product series rather than a specific product, the data specifically applicable to the project shall be highlighted. Each submitted piece of literature and drawings shall clearly reference the specification and/or drawings that it supposed to represent.
 - 5. Sequence of operations for each HVAC system and the associated control diagrams. Equipment and control labels shall correspond to those shown on the drawings.

6. Color prints of proposed graphics with a list of points for display.
 7. Furnish a BACnet Protocol Implementation Conformance Statement (PICS) for each BACnet-compliant device.
 8. Schematic wiring diagrams for all control, communication and power wiring. Provide a schematic drawing of the central system installation. Label all cables and ports with computer manufacturers' model numbers and functions. Show all interface wiring to the control system.
 9. An instrumentation list for each controlled system. Each element of the controlled system shall be listed in table format. The table shall show element name, type of device, manufacturer, model number, and product data sheet number.
 10. Riser diagrams of wiring between central control unit and all control panels.
 11. Scaled plan drawings showing routing of LAN and locations of control panels, controllers, routers, gateways, ECC, and larger controlled devices.
 12. Construction details for all installed conduit, cabling, raceway, cabinets, and similar. Construction details of all penetrations and their protection.
 13. Quantities of submitted items may be reviewed but are the responsibility of the contractor administered by this Section of the technical specifications.
- C. Product Certificates: Compliance with Article, QUALITY ASSURANCE.
- D. Licenses: Provide licenses for all software residing on and used by the Controls Systems and transfer these licenses to the VA prior to completion.
- E. As Built Control Drawings:
1. Furnish three (3) copies of as-built drawings for each control system. The documents shall be submitted for approval prior to final completion.
 2. Furnish one (1) stick set of applicable control system prints for each mechanical system for wall mounting. The documents shall be submitted for approval prior to final completion.
 3. Furnish one (1) CD-ROM in CAD DWG and/or .DXF format for the drawings noted in subparagraphs above.
- F. Operation and Maintenance (O/M) Manuals:
1. Submit in accordance with Article, INSTRUCTIONS, in Specification Section 01 00 00, GENERAL REQUIREMENTS.
 2. Include the following documentation:
 - a. General description and specifications for all components, including logging on/off, alarm handling, producing trend reports, overriding computer control, and changing set points and other variables.
 - b. Detailed illustrations of all the control systems specified for ease of maintenance and repair/replacement procedures, and complete calibration procedures.
 - c. One copy of the final version of all software provided including operating systems, programming language, operator workstation software, and graphics software.
 - d. Complete troubleshooting procedures and guidelines for all systems.

- e. Complete operating instructions for all systems.
 - f. Recommended preventive maintenance procedures for all system components including a schedule of tasks for inspection, cleaning and calibration. Provide a list of recommended spare parts needed to minimize downtime.
 - g. Training Manuals: Submit the course outline and training material to the COTR for approval three (3) weeks prior to the training of VA facility personnel. These persons will be responsible for maintaining and the operation of the control systems, including programming. The COTR reserves the right to modify any or all of the course outline and training material.
 - h. Licenses, guaranty, and other pertaining documents for all equipment and systems.
- G. Submit Performance Report to COTR prior to final inspection.

1.8 INSTRUCTIONS

- A. Instructions to VA operations personnel: Perform in accordance with Article, INSTRUCTIONS, in Specification Section 01 00 00, GENERAL REQUIREMENTS, and as noted below. Contractor shall also video tape instruction sessions noted below.
- 1. First Phase: Formal instructions to the VA facilities personnel for a total of 8 hours, given in multiple training sessions (each no longer than four hours in length), conducted sometime between the completed installation and prior to the performance test period of the control system, at a time mutually agreeable to the Contractor and the VA.
 - 2. Second Phase: This phase of training shall comprise of on the job training during start-up, checkout period, and performance test period. VA facilities personnel will work with the Contractor's installation and test personnel on a daily basis during start-up and checkout period. During the performance test period, controls subcontractor shall provide 8 hours of instructions, given in multiple training sessions (each no longer than four hours in length), to the VA facilities personnel.
 - 3. The O/M Manuals shall contain approved submittals as outlined in Article 1.7, SUBMITTALS. The Controls subcontractor shall review the manual contents with VA facilities personnel during second phase of training.
 - 4. Training shall be given by direct employees of the controls system subcontractor.

1.9 PROJECT CONDITIONS (ENVIRONMENTAL CONDITIONS OF OPERATION)

- A. The peripheral devices and system support equipment shall be designed to operate in ambient condition of 20 to 35°C (65 to 90°F) at a relative humidity of 20 to 80% non-condensing.
- B. The CUs used outdoors shall be mounted in NEMA 4 waterproof enclosures, and shall be rated for operation at -40 to 65°C (-40 to 150°F).
- C. All electronic equipment shall operate properly with power fluctuations of plus 10 percent to minus 15 percent of nominal supply voltage.

- D. Sensors and controlling devices shall be designed to operate in the environment, which they are sensing or controlling.

1.10 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE):
Standard 135-10.....BACNET Building Automation and Control Networks
- C. American Society of Mechanical Engineers (ASME):
B16.18-01.....Cast Copper Alloy Solder Joint Pressure Fittings.
B16.22-01.....Wrought Copper and Copper Alloy Solder Joint Pressure Fittings.
- D. American Society of Testing Materials (ASTM):
B32-08.....Standard Specification for Solder Metal
B88-09.....Standard Specifications for Seamless Copper Water Tube
B88M-09.....Standard Specification for Seamless Copper Water Tube
(Metric)
B280-08.....Standard Specification for Seamless Copper Tube for Air-
Conditioning and Refrigeration Field Service
D2737-03.....Standard Specification for Polyethylene (PE) Plastic Tubing
- E. Federal Communication Commission (FCC):
Rules and Regulations Title 47 Chapter 1-2001 Part 15: Radio Frequency Devices.
- F. Institute of Electrical and Electronic Engineers (IEEE):
802.3-11Information Technology-Telecommunications and Information
Exchange between Systems-Local and Metropolitan Area
Networks- Specific Requirements-Part 3: Carrier Sense Multiple
Access with Collision Detection (CSMA/CD) Access method and
Physical Layer Specifications
- G. National Fire Protection Association (NFPA):
70-11National Electric Code
90A-09.....Standard for Installation of Air-Conditioning and Ventilation
Systems
- H. Underwriter Laboratories Inc (UL):
94-10Tests for Flammability of Plastic Materials for Parts and Devices
and Appliances
294-10Access Control System Units
486A/486B-10Wire Connectors
555S-11Standard for Smoke Dampers
916-10Energy Management Equipment
1076-10Proprietary Burglar Alarm Units and Systems

PART 2 - PRODUCTS**2.1 MATERIALS**

- A. Use new products that the manufacturer is currently manufacturing and that have been installed in a minimum of 25 installations. Spare parts shall be available for at least five years after completion of this contract.

2.2 CONTROLS SYSTEM ARCHITECTURE

- A. General
 - 1. The Controls Systems shall consist of multiple Nodes and associated equipment connected by industry standard digital and communication network arrangements.
 - 2. The building controllers and principal communications network equipment shall be standard products of recognized major manufacturers available through normal PC and computer vendor channels – not "Clones" assembled by a third-party subcontractor.
 - 3. The networks shall, at minimum, comprise, as necessary, the following:
 - a. A fixed ECC and a portable operator's terminal.
 - b. Network computer processing, data storage and BACnet-compliant communication equipment including Servers and digital data processors.
 - c. BACnet-compliant routers, bridges, switches, hubs, modems, gateways, interfaces and similar communication equipment.
 - d. Active processing BACnet-compliant building controllers connected to other BACnet-compliant controllers together with their power supplies and associated equipment.
 - e. Addressable elements, sensors, transducers and end devices.
 - f. Third-party equipment interfaces and gateways as described and required by the Contract Documents.
 - g. Other components required for a complete and working Control Systems as specified.
- B. The Specifications for the individual elements and component subsystems shall be minimum requirements and shall be augmented as necessary by the Contractor to achieve both compliance with all applicable codes, standards and to meet all requirements of the Contract Documents.
- C. Network Architecture
 - 1. The Controls communication network shall utilize BACnet communications protocol operating over a standard Ethernet LAN and operate at a minimum speed of 100 Mb/sec.
 - 2. The networks shall utilize only copper and optical fiber communication media as appropriate and shall comply with applicable codes, ordinances and regulations. They may also utilize digital wireless technologies as appropriate to the application and if required by the VA.
 - 3. All necessary telephone lines, ISDN lines and internet Service Provider services and connections will be provided by the VA.
- D. Third Party Interfaces:

1. The contractor administered by this Section of the technical specifications shall include necessary hardware, equipment, software and programming to allow data communications between the controls systems and building systems supplied by other trades.
2. Other manufacturers and contractors supplying other associated systems and equipment shall provide their necessary hardware, software and start-up at their cost and shall cooperate fully with the contractor administered by this Section of the technical specifications in a timely manner and at their cost to ensure complete functional integration.

E. Servers:

1. Provide data storage server(s) to archive historical data including trends, alarm and event histories and transaction logs.
2. Equip these server(s) with the same software tool set that is located in the BACnet building controllers for system configuration and custom logic definition and color graphic configuration.
3. Access to all information on the data storage server(s) shall be through the same browser functionality used to access individual nodes. When logged onto a server the operator will be able to also interact with any other controller on the control system as required for the functional operation of the controls systems. The contractor administered by this Section of the technical specifications shall provide all necessary digital processor programmable data storage server(s).
4. These server(s) shall be utilized for controls systems application configuration, for archiving, reporting and trending of data, for operator transaction archiving and reporting, for network information management, for alarm annunciation, for operator interface tasks, for controls application management and similar. These server(s) shall utilize IT industry standard data base platforms which utilize a database declarative language designed for managing data in relational database management systems (RDBMS) such as SQL.

2.3 COMMUNICATION

- A. Control products, communication media, connectors, repeaters, hubs, and routers shall comprise a BACnet internetwork. Controller and operator interface communication shall conform to ANSI/ASHRAE Standard 135-2008, BACnet.
 1. The Data link / physical layer protocol (for communication) acceptable to the VA throughout its facilities is Ethernet (ISO 8802-3) and BACnet/IP.
- B. Each controller shall have a communication port for connection to an operator interface.
- C. Internetwork operator interface and value passing shall be transparent to internetwork architecture.
 1. An operator interface connected to a controller shall allow the operator to interface with each internetwork controller as if directly connected. Controller information such as data, status, reports, system software, and custom programs shall be viewable and editable from each internetwork controller.

2. Inputs, outputs, and control variables used to integrate control strategies across multiple controllers shall be readable by each controller on the internetwork. Program and test all cross-controller links required to execute specified control system operation. An authorized operator shall be able to edit cross-controller links by typing a standard object address.
- D. System shall be expandable to at least twice the required input and output objects with additional controllers, associated devices, and wiring. Expansion shall not require operator interface hardware additions or software revisions.
- E. ECCs and Controllers with real-time clocks shall use the BACnet Time Synchronization service. The system shall automatically synchronize system clocks daily from an operator-designated device via the internetwork. The system shall automatically adjust for daylight savings and standard time as applicable.

2.4 ENGINEERING CONTROL CENTER (ECC)

- A. The existing ECC and operator's workstation shall be used.
- B. The ECC resides on a high-speed network with controllers. The ECC and each standard browser connected to server shall be able to access all system information.
- C. ECC and controllers shall communicate using BACnet protocol. ECC and control network backbone shall communicate using ISO 8802-3 (Ethernet) Data Link/Physical layer protocol and BACnet/IP addressing as specified in ASHRAE/ANSI 135-2008, BACnet Annex J.

2.5 PORTABLE OPERATOR'S TERMINAL (POT)

- A. Provide a portable operator's terminal (POT) that shall be capable of accessing all system data. POT may be connected to any point on the system network or may be connected directly to any controller for programming, setup, and troubleshooting. POT shall communicate using BACnet protocol. POT may be connected to any point on the system network or it may be connected directly to controllers using the BACnet PTP (Point-To-Point) Data Link/ Physical layer protocol. The terminal shall use the Read (Initiate) and Write (Execute) BACnet Services. POT shall be an IBM-compatible notebook-style PC including all software and hardware required.
- B. Hardware: POT shall conform to the BACnet Advanced Workstation (B-AWS) Profile and shall be BTL-Listed as a B-AWS device.
 1. POT shall be commercial standard with supporting 32- or 64-bit hardware (as limited by the direct-digital control system software) and software enterprise server. Internet Explorer v6.0 SP1 or higher, Windows Script Hosting version 5.6 or higher, Windows Message Queuing, Windows Internet Information Services (IIS) v5.0 or higher, minimum 2.8 GHz processor, minimum 500 GB 7200 rpm SATA hard drive with 16 MB cache, minimum 2GB DDR3 SDRAM (minimum 1333 Mhz) memory, 512 MB video card, minimum 16 inch (diagonal) screen, 10-100-1000 Base-TX Ethernet NIC with an RJ45 connector or a 100Base-FX Ethernet NIC with an SC/ST connector, 56,600 bps modem, an ASCII RS-232 interface, and a 16 speed high density DVD-RW+/- optical drive.
- C. Software: POT shall include software equal to the software on the ECC.

2.6 BACNET PROTOCOL ANALYZER

- A. For ease of troubleshooting and maintenance, provide a BACnet protocol analyzer. Provide its associated fittings, cables and appurtenances, for connection to the communications network.
- The BACnet protocol analyzer shall be able to, at a minimum: capture and store to a file all data traffic on all network levels; measure bandwidth usage; filter out (ignore) selected traffic.

2.7 NETWORK AND DEVICE NAMING CONVENTION

A. Network Numbers

1. BACnet network numbers shall be based on a "facility code, network" concept. The "facility code" is the VAMC's or VA campus' assigned numeric value assigned to a specific facility or building. The "network" typically corresponds to a "floor" or other logical configuration within the building. BACnet allows 65535 network numbers per BACnet internet work.
2. The network numbers are thus formed as follows: "Net #" = "FFFNN" where:
 - a. FFF = Facility code (see below)
 - b. NN = 00-99 This allows up to 100 networks per facility or building

B. Device Instances

1. BACnet allows 4194305 unique device instances per BACnet internet work. Using Agency's unique device instances are formed as follows: "Dev #" = "FFFNDD" where
 - a. FFF and N are as above and
 - b. DD = 00-99, this allows up to 100 devices per network.
2. Note Special cases, where the network architecture of limiting device numbering to DD causes excessive subnet works. The device number can be expanded to DDD and the network number N can become a single digit. In NO case shall the network number N and the device number D exceed 4 digits.
3. Facility code assignments:
4. 000-400 Building/facility number
5. Note that some facilities have a facility code with an alphabetic suffix to denote wings, related structures, etc. The suffix will be ignored. Network numbers for facility codes above 400 will be assigned in the range 000-399.

C. Device Names

1. Name the control devices based on facility name, location within a facility, the system or systems that the device monitors and/or controls, or the area served. The intent of the device naming is to be easily recognized. Names can be up to 254 characters in length, without embedded spaces. Provide the shortest descriptive, but unambiguous, name. For example, in building #123 prefix the number with a "B" followed by the building number, if there is only one chilled water pump "CHWP-1", a valid name would be "B123.CHWP. 1.STARTSTOP". If there are two pumps designated "CHWP-1", one in a basement mechanical room (Room 0001) and one in a penthouse mechanical room (Room PH01), the names could be "B123.R0001.CHWP.1. STARTSTOP" or "B123.RPH01.CHWP.1.STARTSTOP". In the case

of unitary controllers, for example a VAV box controller, a name might be "B123.R101.VAV". These names should be used for the value of the "Object_Name" property of the BACnet Device objects of the controllers involved so that the BACnet name and the EMCS name are the same.

2.8 BACNET DEVICES

- A. All BACnet Devices – controllers, gateways, routers, actuators and sensors shall conform to BACnet Device Profiles and shall be BACnet Testing Laboratories (BTL) -Listed as conforming to those Device Profiles. Protocol Implementation Conformance Statements (PICSs), describing the BACnet capabilities of the Devices shall be published and available of the Devices through links in the BTL website.
1. BACnet Building Controllers, historically referred to as NACs, shall conform to the BACnet B-BC Device Profile, and shall be BTL-Listed as conforming to the B-BC Device Profile. The Device's PICS shall be submitted.
 2. BACnet Advanced Application Controllers shall conform to the BACnet B-AAC Device Profile, and shall be BTL-Listed as conforming to the B-AAC Device Profile. The Device's PICS shall be submitted.
 3. BACnet Application Specific Controllers shall conform to the BACnet B-ASC Device Profile, and shall be BTL-Listed as conforming to the B-ASC Device Profile. The Device's PICS shall be submitted.
 4. BACnet Smart Actuators shall conform to the BACnet B-SA Device Profile, and shall be BTL-Listed as conforming to the B-SA Device Profile. The Device's PICS shall be submitted.
 5. BACnet Smart Sensors shall conform to the BACnet B-SS Device Profile, and shall be BTL-Listed as conforming to the B-SS Device Profile. The Device's PICS shall be submitted.
 6. BACnet routers and gateways shall conform to the BACnet B-OTH Device Profile, and shall be BTL-Listed as conforming to the B-OTH Device Profile. The Device's PICS shall be submitted.

2.9 CONTROLLERS

- A. General. Provide an adequate number of BTL-Listed B-BC building controllers and an adequate number of BTL-Listed B-AAC advanced application controllers to achieve the performance specified in the Part 1 Article on "System Performance." Each of these controllers shall meet the following requirements.
1. The controller shall have sufficient memory to support its operating system, database, and programming requirements.
 2. The building controller shall share data with the ECC and the other networked building controllers. The advanced application controller shall share data with its building controller and the other networked advanced application controllers.

3. The operating system of the controller shall manage the input and output communication signals to allow distributed controllers to share real and virtual object information and allow for central monitoring and alarms.
 4. Controllers that perform scheduling shall have a real-time clock.
 5. The controller shall continually check the status of its processor and memory circuits. If an abnormal operation is detected, the controller shall:
 - a. assume a predetermined failure mode, and
 - b. generate an alarm notification.
 6. The controller shall communicate with other BACnet devices on the internetwork using the BACnet Read (Execute and Initiate) and Write (Execute and Initiate) Property services.
 7. Communication.
 - a. Each controller shall reside on a BACnet network using the ISO 8802-3 (Ethernet) Data Link/Physical layer protocol for its communications. Each building controller also shall perform BACnet routing if connected to a network of custom application and application specific controllers.
 - b. The controller shall provide a service communication port using BACnet Data Link/Physical layer protocol for connection to a portable operator's terminal.
 8. Keypad. A local keypad and display shall be provided for each controller. The keypad shall be provided for interrogating and editing data. Provide a system security password to prevent unauthorized use of the keypad and display.
 9. Serviceability. Provide diagnostic LEDs for power, communication, and processor. All wiring connections shall be made to field-removable, modular terminal strips or to a termination card connected by a ribbon cable.
 10. Memory. The controller shall maintain all BIOS and programming information in the event of a power loss for at least 72 hours.
 11. The controller shall be able to operate at 90% to 110% of nominal voltage rating and shall perform an orderly shutdown below 80% nominal voltage. Controller operation shall be protected against electrical noise of 5 to 120 Hz and from keyed radios up to 5 W at 1 m (3 ft).
 12. All Field controllers (ACUs, UCUs, etc.) shall have built in displays or a hand held display supplied with the Field Controller. The hand held or built in display shall display all points and allow calibration of sensors and control devices.
- B. Provide BTL-Listed B-ASC application specific controllers for each piece of equipment for which they are constructed. Application specific controllers shall communicate with other BACnet devices on the internetwork using the BACnet Read (Execute) Property service.
1. Each B-ASC shall be capable of stand-alone operation and shall continue to provide control functions without being connected to the network.
 2. Each B-ASC will contain sufficient I/O capacity to control the target system.
 3. Communication.

- a. Each controller shall reside on a BACnet network using the ISO 8802-3 (Ethernet) Data Link/Physical layer protocol for its communications. Each building controller also shall perform BACnet routing if connected to a network of custom application and application specific controllers.
 - b. Each controller shall have a BACnet Data Link/Physical layer compatible connection for a laptop computer or a portable operator's tool. This connection shall be extended to a space temperature sensor port where shown.
 4. Serviceability. Provide diagnostic LEDs for power, communication, and processor. All wiring connections shall be made to field-removable, modular terminal strips or to a termination card connected by a ribbon cable.
 5. Memory. The application specific controller shall use nonvolatile memory and maintain all BIOS and programming information in the event of a power loss.
 6. Immunity to power and noise. Controllers shall be able to operate at 90% to 110% of nominal voltage rating and shall perform an orderly shutdown below 80%. Operation shall be protected against electrical noise of 5-120 Hz and from keyed radios up to 5 W at 1 m (3 ft).
 7. Transformer. Power supply for the ASC must be rated at a minimum of 125% of ASC power consumption and shall be of the fused or current limiting type.
- C. Direct Digital Controller Software
1. The software programs specified in this section shall be commercially available, concurrent, multi-tasking operating system and support the use of software application that operates under DOS or Microsoft Windows.
 2. All points shall be identified by up to 30-character point name and 16-character point descriptor. The same names shall be used at the ECC.
 3. All control functions shall execute within the stand-alone control units via DDC algorithms. The VA shall be able to customize control strategies and sequences of operations defining the appropriate control loop algorithms and choosing the optimum loop parameters.
 4. All controllers shall be capable of being programmed to utilize stored default values for assured fail-safe operation of critical processes. Default values shall be invoked upon sensor failure or, if the primary value is normally provided by the central or another CU, or by loss of bus communication. Individual application software packages shall be structured to assume a fail-safe condition upon loss of input sensors. Loss of an input sensor shall result in output of a sensor-failed message at the ECC. Each ACU and RCU shall have capability for local readouts of all functions. The UCUs shall be read remotely.
 5. All DDC control loops shall be able to utilize any of the following control modes:
 - a. Two position (on-off, slow-fast) control.
 - b. Proportional control.
 - c. Proportional plus integral (PI) control.

- d. Proportional plus integral plus derivative (PID) control. All PID programs shall automatically invoke integral wind up prevention routines whenever the controlled unit is off, under manual control of an automation system or time initiated program.
 - e. Automatic tuning of control loops.
6. System Security: Operator access shall be secured using individual password and operator's name. Passwords shall restrict the operator to the level of object, applications, and system functions assigned to him. A minimum of six (6) levels of security for operator access shall be provided.
7. Application Software: The controllers shall provide the following programs as a minimum for the purpose of optimizing energy consumption while maintaining comfortable environment for occupants. All application software shall reside and run in the system digital controllers. Editing of the application shall occur at the ECC or via a portable operator's terminal, when it is necessary, to access directly the programmable unit.
- a. Alarm Reporting: The operator shall be able to determine the action to be taken in the event of an alarm. Alarms shall be routed to the ECC based on time and events. An alarm shall be able to start programs, login the event, print and display the messages. The system shall allow the operator to prioritize the alarms to minimize nuisance reporting and to speed operator's response to critical alarms. A minimum of six (6) priority levels of alarms shall be provided for each point.
 - b. Remote Communications: The system shall have the ability to dial out in the event of an alarm to the ECC and alpha-numeric pagers. The alarm message shall include the name of the calling location, the device that generated the alarm, and the alarm message itself. The operator shall be able to remotely access and operate the system using dial up communications. Remote access shall allow the operator to function the same as local access.
 - c. Maintenance Management (PM): The program shall monitor equipment status and generate maintenance messages based upon the operators defined equipment run time, starts, and/or calendar date limits. A preventative maintenance alarm shall be printed indicating maintenance requirements based on pre-defined run time. Each preventive message shall include point description, limit criteria and preventative maintenance instruction assigned to that limit. A minimum of 480-character PM shall be provided for each component of units such as hot water converter systems.

2.10 SENSORS (AIR, WATER AND STEAM)

- A. Sensors' measurements shall be read back to the DDC system, and shall be visible by the ECC.
 - B. Temperature and Humidity Sensors shall be electronic, vibration and corrosion resistant for wall, immersion, and/or duct mounting. Provide all remote sensors as required for the systems.
1. Temperature Sensors: thermistor type for terminal units and Resistance Temperature Device (RTD) with an integral transmitter type for all other sensors.

- a. Duct sensors shall be rigid or averaging type as shown on drawings. Averaging sensor shall be a minimum of 1 linear ft of sensing element for each sq ft of cooling coil face area.
 - b. Immersion sensors shall be provided with a separable well made of stainless steel, bronze or monel material. Pressure rating of well is to be consistent with the system pressure in which it is to be installed.
 - c. Space sensors shall be equipped with in-space User set-point adjustment, override switch, numerical temperature display on sensor cover, and communication port. Match room thermostats. Provide a tooled-access cover.
 - 1) Public space sensor: setpoint adjustment shall be only through the ECC or through the DDC system's diagnostic device/laptop. Do not provide in-space User set-point adjustment. Provide an opaque keyed-entry cover if needed to restrict in-space User set-point adjustment.
 - d. Outdoor air temperature sensors shall have watertight inlet fittings and be shielded from direct sunlight.
 - e. Room security sensors shall have stainless steel cover plate with insulated back and security screws.
 - f. Wire: Twisted, shielded-pair cable.
 - g. Output Signal: 4-20 ma.
2. Humidity Sensors: Bulk polymer sensing element type.
- a. Duct and room sensors shall have a sensing range of 20 to 80 percent with accuracy of ± 2 to ± 5 percent RH, including hysteresis, linearity, and repeatability.
 - b. Outdoor humidity sensors shall be furnished with element guard and mounting plate and have a sensing range of 0 to 100 percent RH.
 - c. 4-20 ma continuous output signal.
- C. Steam Flow Sensor/Transmitter:
- 1. Meter shall be a spring-loaded, variable area type, with differential pressure output. The output shall be linear with respect to changes in flow rate and shall not exceed 200"wg at maximum flow. The flowmeter shall be of wafer design, manufactured from 316 stainless steel and suitable for installation between 150, 300 or 600 ANSI flanges. The meter shall be capable of measuring flows over a turndown of 100:1 and provide readings accurate to $\pm 1\%$ of reading. Piping requirements, from a 90-degree bend, shall not exceed 6 diameters upstream and 3 diameters downstream of meter size, straight pipe. The meter shall be mounted horizontally or vertically (with flow vertically downward). The flowmeter shall be of the In-Line-Variable-Area (ILVA) type.
 - a. Sensor on all steam lines shall be protected by pigtail siphons installed between the sensor and the line, and shall have an isolation valve installed between the sensor and pressure source.

- D. Flow switches:
1. Shall be either paddle or differential pressure type.
 - a. Paddle-type switches (liquid service only) shall be UL Listed, SPDT snap-acting, adjustable sensitivity with NEMA 4 enclosure.
 - b. Differential pressure type switches (air or water service) shall be UL listed, SPDT snap acting, NEMA 4 enclosure, with scale range and differential suitable for specified application.
- E. Current Switches: Current operated switches shall be self powered, solid state with adjustable trip current as well as status, power, and relay command status LED indication. The switches shall be selected to match the current of the application and output requirements of the DDC systems.

2.11 CONTROL CABLES

- A. General:
1. Ground cable shields, drain conductors, and equipment to eliminate shock hazard and to minimize ground loops, common-mode returns, noise pickup, cross talk, and other impairments. Comply with Section 26 05 26.
 2. Cable conductors to provide protection against induction in circuits. Crosstalk attenuation within the System shall be in excess of -80 dB throughout the frequency ranges specified.
 3. Minimize the radiation of RF noise generated by the System equipment so as not to interfere with any audio, video, data, computer main distribution frame (MDF), telephone customer service unit (CSU), and electronic private branch exchange (EPBX) equipment the System may service.
 4. The as-installed drawings shall identify each cable as labeled, used cable, and bad cable pairs.
 5. Label system's cables on each end. Test and certify cables in writing to the VA before conducting proof-of-performance testing. Minimum cable test requirements are for impedance compliance, inductance, capacitance, signal level compliance, opens, shorts, cross talk, noise, and distortion, and split pairs on all cables in the frequency ranges used. Make available all cable installation and test records at demonstration to the VA. All changes (used pair, failed pair, etc.) shall be posted in these records as the change occurs.
 6. Power wiring shall not be run in conduit with communications trunk wiring or signal or control wiring operating at 100 volts or less.
- B. Analogue control cabling shall be not less than No. 18 AWG solid, with thermoplastic insulated conductors.
- C. Copper digital communication cable between the ECC and the B-BC and B-AAC controllers shall be 100BASE-TX Ethernet, Category 5e or 6, not less than minimum 24 American Wire Gauge (AWG) solid, Shielded Twisted Pair (STP) or Unshielded Twisted Pair (UTP), with thermoplastic insulated conductors, enclosed in a thermoplastic outer jacket.

1. Other types of media commonly used within IEEE Std 802.3 LANs (e.g., 10Base-T and 10Base-2) shall be used only in cases to interconnect with existing media.
- D. Optical digital communication fiber, if used, shall be Multimode or Singlemode fiber, 62.5/125 micron for multimode or 10/125 micron for singlemode micron with SC or ST connectors as specified in TIA-568-C.1. Terminations, patch panels, and other hardware shall be compatible with the specified fiber. Fiber-optic cable shall be suitable for use with the 100Base-FX or the 100Base-SX standard (as applicable) as defined in IEEE Std 802.3.

2.12 THERMOSTATS AND HUMIDISTATS

- A. Room thermostats controlling unitary standalone heating and cooling devices not connected to the DDC system shall have three modes of operation (heating - null or dead band - cooling). Wall mounted thermostats shall have manufacturer's recommended finish, setpoint range and temperature display and external adjustment:
 1. Electronic Thermostats: Solid-state, microprocessor based, programmable to daily, weekend, and holiday schedules.
 - a. Public Space Thermostat: Public space thermostat shall have a thermistor sensor and shall not have a visible means of set point adjustment. Adjustment shall be via the digital controller to which it is connected.
 - b. Battery replacement without program loss.
- B. Strap-on thermostats shall be enclosed in a dirt-and-moisture proof housing with fixed temperature switching point and single pole, double throw switch.

2.13 FINAL CONTROL ELEMENTS AND OPERATORS

- A. Fail Safe Operation: Control valves shall provide "fail safe" operation in either the normally open or normally closed position as required for freeze, moisture, and smoke or fire protection.
- B. Spring Ranges: Range as required for system sequencing and to provide tight shut-off.
- C. Control Valves:
 1. Valves shall be rated for a minimum of 150 percent of system operating pressure at the valve location but not less than 900 kPa (125 psig).
 2. Valves 50 mm (2 inches) and smaller shall be bronze body with threaded or flare connections.
 3. Valves 60 mm (2 1/2 inches) and larger shall be bronze or iron body with flanged connections.
 4. Brass or bronze seats except for valves controlling media above 100 degrees C (210 degrees F), which shall have stainless steel seats.
 5. Flow characteristics:
 - a. Three way modulating valves shall be globe pattern. Position versus flow relation shall be linear relation for steam or equal percentage for water flow control.
 - b. Two-way modulating valves shall be globe pattern. Position versus flow relation shall be linear for steam and equal percentage for water flow control.
 - c. Two-way 2-position valves shall be ball, gate or butterfly type.
 6. Maximum pressure drop:

- a. Two position steam control: 20 percent of inlet gauge pressure.
 - b. Modulating Steam Control: 80 percent of inlet gauge pressure for 15 psi or less; 50 percent of inlet gauge pressures for greater than 15 psi. (acoustic velocity limitation).
 - c. Modulating water flow control, greater of 3 meters (10 feet) of water or the pressure drop through the apparatus.
7. Two position water valves shall be line size.
- D. Valve Operators and Relays:
1. Electric operator shall provide full modulating control of valves. Metal parts shall be aluminum, mill finish galvanized steel, or zinc plated steel or stainless steel. Provide actuator heads which allow for electrical conduit attachment. The motors shall have sufficient closure torque to allow for complete closure of valve under pressure. Provide multiple motors as required to achieve sufficient close-off torque.
 - a. Minimum valve close-off pressure shall be equal to the system pump's dead-head pressure, minimum 50 psig for valves smaller than 4 inches.
 2. See drawings for required control operation.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. General:
1. Examine project plans for control devices and equipment locations; and report any discrepancies, conflicts, or omissions to COTR for resolution before proceeding with installation.
 2. Install equipment, piping, wiring /conduit parallel to or at right angles to building lines.
 3. Install all equipment and piping in readily accessible locations. Do not run tubing and conduit concealed under insulation or inside ducts.
 4. Mount control devices, tubing and conduit located on ducts and apparatus with external insulation on standoff support to avoid interference with insulation.
 5. Provide sufficient slack and flexible connections to allow for vibration of piping and equipment.
 6. Run tubing and wire connecting devices on or in control cabinets parallel with the sides of the cabinet neatly racked to permit tracing.
 7. Install equipment level and plum.
- B. Electrical Wiring Installation:
1. All wiring cabling shall be installed in conduits. Install conduits and wiring in accordance with Specification Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS. Conduits carrying control wiring and cabling shall be dedicated to the control wiring and cabling: these conduits shall not carry power wiring. Provide plastic end sleeves at all conduit terminations to protect wiring from burrs.
 2. Install analog signal and communication cables in conduit. Install digital communication cables in conduit.

3. Install conduit and wiring between operator workstation(s), digital controllers, electrical panels, indicating devices, instrumentation, miscellaneous alarm points, thermostats, and relays as shown on the drawings or as required under this section.
 4. Install all electrical work required for a fully functional system and not shown on electrical plans or required by electrical specifications. Where low voltage (less than 50 volt) power is required, provide suitable Class B transformers.
 5. Install all system components in accordance with local Building Code and National Electric Code.
 - a. Splices: Splices in shielded and coaxial cables shall consist of terminations and the use of shielded cable couplers. Terminations shall be in accessible locations. Cables shall be harnessed with cable ties.
 - b. Equipment: Fit all equipment contained in cabinets or panels with service loops, each loop being at least 300 mm (12 inches) long. Equipment for fiber optics system shall be rack mounted, as applicable, in ventilated, self-supporting, code gauge steel enclosure. Cables shall be supported for minimum sag.
 - c. Cable Runs: Keep cable runs as short as possible. Allow extra length for connecting to the terminal board. Do not bend flexible coaxial cables in a radius less than ten times the cable outside diameter.
 - d. Use vinyl tape, sleeves, or grommets to protect cables from vibration at points where they pass around sharp corners, through walls, panel cabinets, etc.
 6. Conceal cables, except in mechanical rooms and areas where other conduits and piping are exposed.
 7. Permanently label or code each point of all field terminal strips to show the instrument or item served. Color-coded cable with cable diagrams may be used to accomplish cable identification.
 8. Grounding: ground electrical systems per manufacturer's written requirements for proper and safe operation.
- C. Install Sensors and Controls:
1. Temperature Sensors:
 - a. Install all sensors and instrumentation according to manufacturer's written instructions. Temperature sensor locations shall be readily accessible, permitting quick replacement and servicing of them without special skills and tools.
 - b. Calibrate sensors to accuracy specified, if not factory calibrated.
 - c. Use of sensors shall be limited to its duty, e.g., duct sensor shall not be used in lieu of room sensor.
 - d. Install room sensors permanently supported on wall frame. They shall be mounted at 46" above the finished floor to comply with ADA requirements..

- e. Mount sensors rigidly and adequately for the environment within which the sensor operates. Separate extended-bulb sensors from contact with metal casings and coils using insulated standoffs.
 - f. Sensors used in mixing plenum, and hot and cold decks shall be of the averaging of type. Averaging sensors shall be installed in a serpentine manner horizontally across duct. Each bend shall be supported with a capillary clip.
 - g. All pipe mounted temperature sensors shall be installed in wells.
 - h. All wires attached to sensors shall be air sealed in their conduits or in the wall to stop air transmitted from other areas affecting sensor reading.
 - i. Permanently mark terminal blocks for identification. Protect all circuits to avoid interruption of service due to short-circuiting or other conditions. Line-protect all wiring that comes from external sources to the site from lightning and static electricity.
2. Pressure Sensors:
- a. Install duct static pressure sensor tips facing directly downstream of airflow.
 - b. Install high-pressure side of the differential switch between the pump discharge and the check valve.
 - c. Install snubbers and isolation valves on steam pressure sensing devices.
3. Actuators:
- a. Mount and link valve actuators according to manufacturer's written instructions.
 - b. Check operation of valve/actuator combination to confirm that actuator modulates valve smoothly throughout stroke to both open and closed position.
 - c. Check operation of valve/actuator combination to confirm that actuator modulates valve smoothly in both open and closed position.
4. Flow Switches:
- a. Install flow switch according to manufacturer's written instructions.
 - b. Mount flow switch a minimum of 5 pipe diameters up stream and 5 pipe diameters downstream or 600 mm (2 feet) whichever is greater, from fittings and other obstructions.
 - c. Assure correct flow direction and alignment.
 - d. Mount in horizontal piping-flow switch on top of the pipe.
- D. Installation of network:
1. Ethernet:
- a. The network shall employ Ethernet LAN architecture, as defined by IEEE 802.3. The Network Interface shall be fully Internet Protocol (IP) compliant allowing connection to currently installed IEEE 802.3, Compliant Ethernet Networks.
 - b. The network shall directly support connectivity to a variety of cabling types.
2. Third party interfaces: Contractor shall integrate real-time data from building systems by other trades and databases originating from other manufacturers as specified and required to make the system work as one system.

- E. Installation of digital controllers and programming:
1. Provide a separate digital control panel for each major piece of equipment, such as air handling unit, chiller, pumping unit etc. Points used for control loop reset such as outdoor air, outdoor humidity, or space temperature could be located on any of the remote control units.
 2. Provide sufficient internal memory for the specified control sequences and trend logging. There shall be a minimum of 25 percent of available memory free for future use.
 3. System point names shall be modular in design, permitting easy operator interface without the use of a written point index.
 4. Provide software programming for the applications intended for the systems specified, and adhere to the strategy algorithms provided.
 5. Provide graphics for each piece of equipment and floor plan in the building. This includes each heating hot water plate & frame converter skid package, pumping unit, steam or water meter, etc. These graphics shall show all points dynamically as specified in the point list.

3.2 SYSTEM VALIDATION AND DEMONSTRATION

- A. As part of final system acceptance, a system demonstration is required (see below). Prior to start of this demonstration, the Contractor is to perform a complete validation of all aspects of the controls and instrumentation system.
- B. Validation
1. Prepare and submit for approval a validation test plan including test procedures for the performance verification tests. Test Plan shall address all specified sequences of operation. Explain in detail actions and expected results used to demonstrate compliance with the requirements of this specification. Explain the method for simulating the necessary conditions of operation used to demonstrate performance of the system. Test plan shall include a test check list to be used by the Installer's agent to check and initial that each test has been successfully completed. Deliver test plan documentation for the performance verification tests to the COTR 30 days prior to start of performance verification tests. Provide draft copy of operation and maintenance manual with performance verification test.
 2. After approval of the validation test plan, installer shall carry out all tests and procedures therein. Installer shall completely check out, calibrate, and test all connected hardware and software to insure that system performs in accordance with approved specifications and sequences of operation submitted. Installer shall complete and submit Test Check List.
- C. Demonstration
1. System operation and calibration shall be demonstrated by the installer in the presence of the COTR or other VA representative on random samples of equipment as dictated by the Architect or VA's representative. Should random sampling indicate improper commissioning, the COTR reserves the right to subsequently witness complete calibration of the system at no addition cost to the VA.

2. Demonstrate to the COTR or other VA representative that all required safeties and life safety functions are fully functional and complete.
3. Make accessible, personnel to provide necessary adjustments and corrections to systems as directed by balancing agency.
4. The following witnessed demonstrations of field control equipment shall be included:
 - a. Observe HVAC systems in shut down condition. Check valves for normal position.
 - b. Test application software for its ability to communicate with digital controllers, operator workstation, and uploading and downloading of control programs.
 - c. Demonstrate the software ability to edit the control program off-line.
 - d. Demonstrate reporting of alarm conditions for each alarm and ensure that these alarms are received at the assigned location.
 - e. Demonstrate ability of software program to function for the intended applications-trend reports, change in status etc.
 - f. Demonstrate via graphed trends to show the sequence of operation is executed in correct manner, and that the HVAC systems operate properly through the complete sequence of operation, e.g., seasonal change, occupied/unoccupied mode, and warm-up condition.
 - g. Demonstrate hardware interlocks and safeties functions, and that the control systems perform the correct sequence of operation after power loss and resumption of power loss.
 - h. Prepare and deliver to the COTR graphed trends of all control loops to demonstrate that each control loop is stable and the set points are maintained.
 - i. Demonstrate that each control loop responds to set point adjustment and stabilizes within one (1) minute. Control loop trend data shall be instantaneous and the time between data points shall not be greater than one (1) minute.

----- END -----

**SECTION 23 21 13
HYDRONIC PIPING****PART 1 - GENERAL****1.1 DESCRIPTION**

- A. Water piping to connect HVAC equipment, including the following:
 - 1. Heating hot water and drain piping.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- C. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION:
General mechanical requirements and items, which are common to more than one section of Division 23.
- D. Section 23 21 23, HYDRONIC PUMPS: Pumps.
- E. Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION: Piping insulation.
- F. Section 23 25 00, HVAC WATER TREATMENT: Water treatment for open and closed systems.
- G. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Temperature and pressure sensors and valve operators.

1.3 QUALITY ASSURANCE

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION, which includes welding qualifications.
- B. Submit prior to welding of steel piping a certificate of Welder's certification. The certificate shall be current and not more than one year old.
- C. All grooved joint couplings, fittings, valves, and specialties shall be the products of a single manufacturer. Grooving tools shall be the same manufacturer as the grooved components.
 - 1. All castings used for coupling housings, fittings, valve bodies, etc., shall be date stamped for quality assurance and traceability.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Pipe and equipment supports.
 - 2. Pipe and tubing, with specification, class or type, and schedule.
 - 3. Pipe fittings, including miscellaneous adapters and special fittings.
 - 4. Flanges, gaskets and bolting.
 - 5. Grooved joint couplings and fittings.
 - 6. Valves of all types.
 - 7. Strainers.

8. Flexible connectors for water service.
 9. Pipe alignment guides.
 10. Expansion joints.
 11. All specified hydronic system components.
 12. Gages.
 13. Thermometers and test wells.
- C. Submit the welder's qualifications in the form of a current (less than one year old) and formal certificate.
- D. As-Built Piping Diagrams: Provide drawing as follows for heating hot water system and other piping systems and equipment.
1. One wall-mounted stick file with complete set of prints. Mount stick file in the sub-basement service room or control room along with control diagram stick file.
 2. One complete set of reproducible drawings.
 3. One complete set of drawings in electronic Autocad and pdf format.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. American National Standards Institute, Inc.
- B. American Society of Mechanical Engineers/American National Standards Institute, Inc. (ASME/ANSI):
- B1.20.1-83(R2006)..... Pipe Threads, General Purpose (Inch)
 - B16.4-06..... Gray Iron Threaded Fittings B16.18-01 Cast Copper Alloy Solder joint Pressure fittings
 - B16.23-02..... Cast Copper Alloy Solder joint Drainage fittings
 - B40.100-05..... Pressure Gauges and Gauge Attachments
- C. American National Standards Institute, Inc./Fluid Controls Institute (ANSI/FCI):
- 70-2-2006..... Control Valve Seat Leakage
- D. American Society of Mechanical Engineers (ASME):
- B16.1-98..... Cast Iron Pipe Flanges and Flanged Fittings
 - B16.3-2006..... Malleable Iron Threaded Fittings: Class 150 and 300
 - B16.4-2006..... Gray Iron Threaded Fittings: (Class 125 and 250)
 - B16.5-2003..... Pipe Flanges and Flanged Fittings: NPS ½ through NPS 24 Metric/Inch Standard
 - B16.9-07..... Factory Made Wrought Butt Welding Fittings
 - B16.11-05..... Forged Fittings, Socket Welding and Threaded
 - B16.18-01..... Cast Copper Alloy Solder Joint Pressure Fittings
 - B16.22-01..... Wrought Copper and Bronze Solder Joint Pressure Fittings.
 - B16.24-06..... Cast Copper Alloy Pipe Flanges and Flanged Fittings

- B16.39-06.....Malleable Iron Threaded Pipe Unions
- B16.42-06.....Ductile Iron Pipe Flanges and Flanged Fittings
- B31.1-08.....Power Piping
- E. American Society for Testing and Materials (ASTM):
- A47/A47M-99 (2004)Ferritic Malleable Iron Castings
- A53/A53M-07Standard Specification for Pipe, Steel, Black and Hot-Dipped,
Zinc-Coated, Welded and Seamless
- A106/A106M-08Standard Specification for Seamless Carbon Steel Pipe for
High-Temperature Service
- A126-04.....Standard Specification for Gray Iron Castings for Valves,
Flanges, and Pipe Fittings
- A183-03.....Standard Specification for Carbon Steel Track Bolts and Nuts
- A216/A216M-08Standard Specification for Steel Castings, Carbon, Suitable for
Fusion Welding, for High Temperature Service
- A234/A234M-07Piping Fittings of Wrought Carbon Steel and Alloy Steel for
Moderate and High Temperature Service
- A307-07.....Standard Specification for Carbon Steel Bolts and Studs, 60,000
PSI Tensile Strength
- A536-84 (2004)Standard Specification for Ductile Iron Castings
- A615/A615M-08Deformed and Plain Carbon Steel Bars for Concrete
Reinforcement
- A653/A 653M-08Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy Coated
(Galvannealed) By the Hot-Dip Process
- B32-08.....Standard Specification for Solder Metal
- B62-02.....Standard Specification for Composition Bronze or Ounce Metal
Castings
- B88-03.....Standard Specification for Seamless Copper Water Tube
- B209-07.....Aluminum and Aluminum Alloy Sheet and Plate
- C177-04Standard Test Method for Steady State Heat Flux Measurements
and Thermal Transmission Properties by Means of the Guarded
Hot Plate Apparatus
- C478-09Precast Reinforced Concrete Manhole Sections
- C533-07Calcium Silicate Block and Pipe Thermal Insulation
- C552-07Cellular Glass Thermal Insulation
- D3350-08Polyethylene Plastics Pipe and Fittings Materials
- C591-08Unfaced Preformed Rigid Cellular Polyisocyanurate Thermal
Insulation

- D1784-08 Rigid Poly (Vinyl Chloride) (PVC) Compounds and Chlorinated Poly (Vinyl Chloride) (CPVC) Compound
- D1785-06 Poly (Vinyl Chloride) (PVC) Plastic Pipe, Schedules 40, 80 and 120
- D2241-05 Poly (Vinyl Chloride) (PVC) Pressure Rated Pipe (SDR Series)
- F439-06 Standard Specification for Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 80
- F441/F441M-02 Standard Specification for Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe, Schedules 40 and 80
- F477-08 Elastomeric Seals Gaskets) for Joining Plastic Pipe
- F. American Water Works Association (AWWA):
- C110-08 Ductile Iron and Grey Iron Fittings for Water
- C203-02 Coal Tar Protective Coatings and Linings for Steel Water Pipe Lines Enamel and Tape Hot Applied
- G. American Welding Society (AWS):
- B2.1-02 Standard Welding Procedure Specification
- H. Copper Development Association, Inc. (CDA):
- CDA A4015-06 Copper Tube Handbook
- I. Expansion Joint Manufacturer's Association, Inc. (EJMA):
- EMJA-2003 Expansion Joint Manufacturer's Association Standards, Ninth Edition
- J. Manufacturers Standardization Society (MSS) of the Valve and Fitting Industry, Inc.:
- SP-67-02a Butterfly Valves
- SP-70-06 Gray Iron Gate Valves, Flanged and Threaded Ends
- SP-71-05 Gray Iron Swing Check Valves, Flanged and Threaded Ends
- SP-80-08 Bronze Gate, Globe, Angle and Check Valves
- SP-85-02 Cast Iron Globe and Angle Valves, Flanged and Threaded Ends
- SP-110-96 Ball Valves Threaded, Socket-Welding, Solder Joint, Grooved and Flared Ends
- SP-125-00 Gray Iron and Ductile Iron In-line, Spring Loaded, Center-Guided Check Valves
- K. National Sanitation Foundation/American National Standards Institute, Inc. (NSF/ANSI):
- 14-06 Plastic Piping System Components and Related Materials
- 50-2009a Equipment for Swimming Pools, Spas, Hot Tubs and other Recreational Water Facilities – Evaluation criteria for materials, components, products, equipment and systems for use at recreational water facilities
- 61-2008 Drinking Water System Components – Health Effects

- L. Tubular Exchanger Manufacturers Association: TEMA 9th Edition, 2007

1.6 SPARE PARTS

- A. For mechanical pressed sealed fittings provide tools required for each pipe size used at the facility.

PART 2 - PRODUCTS

2.1 PIPE AND EQUIPMENT SUPPORTS, PIPE SLEEVES, AND WALL AND CEILING PLATES

- A. Provide in accordance with Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

2.2 PIPE AND TUBING

- A. Heating Hot Water Piping:
1. Steel: ASTM A53 Grade B, seamless or ERW, Schedule 40.
 2. Copper water tube option: ASTM B88, Type K or L, hard drawn.
- B. Pipe supports, including insulation shields, for above ground piping: Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

2.3 FITTINGS FOR STEEL PIPE

- A. 50 mm (2 inches) and Smaller: Screwed or welded joints.
1. Butt welding: ASME B16.9 with same wall thickness as connecting piping.
 2. Forged steel, socket welding or threaded: ASME B16.11.
 3. Screwed: 150 pound malleable iron, ASME B16.3. 125 pound cast iron, ASME B16.4, may be used in lieu of malleable iron. Bushing reduction of a single pipe size, or use of close nipples, is not acceptable.
 4. Unions: ASME B16.39.
 5. Water hose connection adapter: Brass, pipe thread to 20 mm (3/4 inch) garden hose thread, with hose cap nut.
- B. 65 mm (2-1/2 inches) and Larger: Welded or flanged joints. Contractor's option: Grooved mechanical couplings and fittings are optional.
1. Butt welding fittings: ASME B16.9 with same wall thickness as connecting piping. Elbows shall be long radius type, unless otherwise noted.
 2. Welding flanges and bolting: ASME B16.5:
 - a. Water service: Weld neck or slip-on, plain face, with 6 mm (1/8 inch) thick full face neoprene gasket suitable for 104 degrees C (220 degrees F).
 - 1) Contractor's option: Convuluted, cold formed 150 pound steel flanges, with teflon gaskets, may be used for water service.
 - b. Flange bolting: Carbon steel machine bolts or studs and nuts, ASTM A307, Grade B.
- C. Welded Branch and Tap Connections: Forged steel weldolets, or branchlets and threadolets may be used for branch connections up to one pipe size smaller than the main. Forged steel half-couplings, ASME B16.11 may be used for drain, vent and gage connections.

- D. Grooved Mechanical Pipe Couplings and Fittings (Contractor's Option): Grooved Mechanical Pipe Couplings and Fittings may be used, with cut or roll grooved pipe, in water service up to 110 degrees C (230 degrees F) in lieu of welded, screwed or flanged connections. All joints must be rigid type.
1. Grooved mechanical couplings: Malleable iron, ASTM A47 or ductile iron, ASTM A536, fabricated in two or more parts, securely held together by two or more track-head, square, or oval-neck bolts, ASTM A449 and A183.
 2. Gaskets: Rubber product recommended by the coupling manufacturer for the intended service.
 3. Grooved end fittings: Malleable iron, ASTM A47; ductile iron, ASTM A536; or steel, ASTM A53 or A106, designed to accept grooved mechanical couplings. Tap-in type branch connections are acceptable.

2.4 FITTINGS FOR COPPER TUBING

- A. Joints:
1. Solder Joints: Joints shall be made up in accordance with recommended practices of the materials applied. Apply 95/5 tin and antimony on all copper piping.
 2. Mechanically formed tee connection in water and drain piping: Form mechanically extracted collars in a continuous operation by drilling pilot hole and drawing out tube surface to form collar, having a height of not less than three times the thickness of tube wall. Adjustable collaring device shall insure proper tolerance and complete uniformity of the joint. Notch and dimple joining branch tube in a single process to provide free flow where the branch tube penetrates the fitting.
- B. Bronze Flanges and Flanged Fittings: ASME B16.24.
- C. Fittings: ANSI/ASME B16.18 cast copper or ANSI/ASME B16.22 solder wrought copper.

2.5 DIELECTRIC FITTINGS

- A. Provide where copper tubing and ferrous metal pipe are joined.
- B. 50 mm (2 inches) and Smaller: Threaded dielectric union, ASME B16.39.
- C. 65 mm (2 1/2 inches) and Larger: Flange union with dielectric gasket and bolt sleeves, ASME B16.42.
- D. Temperature Rating, 99 degrees C (210 degrees F).
- E. Contractor's option: On pipe sizes 2" and smaller, screwed end brass ball valves may be used in lieu of dielectric unions.

2.6 SCREWED JOINTS

- A. Pipe Thread: ANSI B1.20.
- B. Lubricant or Sealant: Oil and graphite or other compound approved for the intended service.

2.7 VALVES

- A. Asbestos packing is not acceptable.

- B. All valves of the same type shall be products of a single manufacturer.
- C. Provide chain operators for valves 150 mm (6 inches) and larger when the centerline is located 2400 mm (8 feet) or more above the floor or operating platform.
- D. Shut-Off Valves
 - 1. Ball Valves (Pipe sizes 2" and smaller):
 - a. MSS SP-72, SP-110, Type II, Class 125, Style 1, three piece construction, full ported, full flow, with stainless steel ball and stem and solder end connections, 2750 kPa (400 psi) WOG, MSS-SP-67.
 - 2. Butterfly Valves (Pipe Sizes 2-1/2" and larger): Provide stem extension to allow 50 mm (2 inches) of pipe insulation without interfering with valve operation. MSS-SP 67, flange lug type or grooved end rated 1205 kPa (175 psig) working pressure at 93 degrees C (200 degrees F). Valves shall be ANSI Leakage Class VI and rated for bubble tight shut-off to full valve pressure rating. Valve shall be rated for dead end service and bi-directional flow capability to full rated pressure. Not permitted for direct buried pipe applications.
 - a. Body: Cast iron, ASTM A126, Class B. Malleable iron, ASTM A47 electro-plated, or ductile iron, ASTM A536, Grade 65-45-12 electro-plated.
 - b. Trim: Bronze, aluminum bronze, or 300 series stainless steel disc, bronze bearings, 316 stainless steel shaft and manufacturer's recommended resilient seat. Resilient seat shall be molded-in liner. A phosphate coated steel shaft or stem is acceptable, if the stem is completely isolated from the product.
 - c. Actuators: Field interchangeable. Valves for balancing service shall have adjustable memory stop to limit open position.
 - 1) Valves 150 mm (6 inches) and smaller: Lever actuator with minimum of seven locking positions, except where chain wheel is required.
 - 2) Valves 200 mm (8 inches) and larger: Enclosed worm gear with handwheel, and where required, chain-wheel operator.
 - 3. Gate Valves (steam service only – refer to specification section 23 22 13 STEAM AND CONDENSATE HEATING PIPING):
- E. Globe and Angle Valves
 - 1. Globe Valves
 - a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Globe valves shall be union bonnet with metal plug type disc.
 - b. 65 mm (2 1/2 inches) and larger: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for globe valves.
 - 2. Angle Valves:
 - a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Angle valves shall be union bonnet with metal plug type disc.

- b. 65 mm (2 1/2 inches) and larger: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for angle valves.
- F. Check Valves
 - 1. Swing Check Valves:
 - a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.), 45 degree swing disc.
 - b. 65 mm (2 1/2 inches) and larger: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-71 for check valves.
 - 2. Non-Slam or Silent Check Valve: Spring loaded double disc swing check or internally guided flat disc lift type check for bubble tight shut-off. Provide where check valves are shown in hot water piping. Check valves incorporating a balancing feature may be used.
 - a. Body: MSS-SP 125 cast iron, ASTM A126, Class B, or steel, ASTM A216, Class WCB, or ductile iron, ASTM 536, flanged, grooved, or wafer type.
 - b. Seat, disc and spring: 18-8 stainless steel, or bronze, ASTM B62. Seats may be elastomer material.
- G. Water Flow Balancing Valves: For flow regulation and shut-off. Valves shall be line size rather than reduced to control valve size.
 - 1. Ball or Globe style valve.
 - 2. A dual purpose flow balancing valve and adjustable flow meter, with bronze or cast iron body, calibrated position pointer, valved pressure taps or quick disconnects with integral check valves and preformed polyurethane insulating enclosure.
 - 3. Provide a readout kit including flow meter, readout probes, hoses, flow charts or calculator, and carrying case.
- H. Automatic Balancing Control Valves: Factory calibrated to maintain constant flow (plus or minus five percent) over system pressure fluctuations of at least 10 times the minimum required for control. Provide standard pressure taps and four sets of capacity charts. Valves shall be line size and be one of the following designs:
 - 1. Gray iron (ASTM A126) or brass body rated 1205 kPa (175 psig) at 93 degrees C (200 degrees F), with stainless steel piston and spring.
 - 2. Brass or ferrous body designed for 2067 kPa (300 psig) service at 121 degrees C (250 degrees F), with corrosion resistant, tamper proof, self-cleaning piston/spring assembly that is easily removable for inspection or replacement.
 - 3. Combination assemblies containing ball type shut-off valves, unions, flow regulators, strainers with blowdown valves and pressure temperature ports shall be acceptable.
 - 4. Provide a readout kit including flow meter, probes, hoses, flow charts and carrying case.
- I. Manual Radiator/Convactor Valves: Brass, packless, with position indicator.

2.8 STRAINERS

- A. Basket or Y Type.
 - 1. Screens: Bronze, monel metal or 18-8 stainless steel, free area not less than 2-1/2 times pipe area, with perforations as follows: 1.1 mm (0.045 inch) diameter perforations for 100 mm (4 inches) and larger: 3.2 mm (0.125 inch) diameter perforations.
- B. Suction Diffusers: Specified in Section 23 21 23, HYDRONIC PUMPS.

2.9 FLEXIBLE CONNECTORS FOR WATER SERVICE

- A. Flanged Spool Connector:
 - 1. Single arch or multiple arch type. Tube and cover shall be constructed of chlorobutyl elastomer with full faced integral flanges to provide a tight seal without gaskets. Connectors shall be internally reinforced with high strength synthetic fibers impregnated with rubber or synthetic compounds as recommended by connector manufacturer, and steel reinforcing rings.
 - 2. Working pressures and temperatures shall be as follows:
 - a. Connector sizes 50 mm to 100 mm (2 inches to 4 inches), 1137 kPa (165psig) at 121 degrees C (250 degrees F).
 - b. Connector sizes 125 mm to 300 mm (5 inches to 12 inches), 965 kPa (140 psig) at 121 degrees C (250 degrees F).
 - 3. Provide ductile iron retaining rings and control units.
- B. Mechanical Pipe Couplings:

See other fittings specified under Part 2, PRODUCTS.

2.10 HYDRONIC SYSTEM COMPONENTS

- A. Tangential Air Separator: ASME Pressure Vessel Code construction for 861 kPa (125 psig) working pressure, flanged tangential inlet and outlet connection, bottom blowdown connection. Provide Form No. U-1. If scheduled on the drawings.
- B. Diaphragm/Bladder Type Pre-Pressurized Expansion Tank: ASME Pressure Vessel Code construction for 861 kPa (125 psig) working pressure, welded steel shell, rust-proof coated, with a flexible elastomeric diaphragm/bladder suitable for a maximum operating temperature of 116 degrees C (240 degrees F). Provide Form No. U-1. Tank shall be equipped with system connection, drain connection, standard air fill valve and be factory pre-charged to a minimum of 83 kPa (12 psig).
- C. Automatic/manual Air Vent Valves (where shown on drawings and where required by Section 3.1): Cast iron or semi-steel body, 1034 kPa (150 psig) working pressure, stainless steel float, valve, valve seat and mechanism, minimum 15 mm (1/2 inch) water connection and 6 mm (1/4 inch) air outlet. Air outlet shall be piped to the nearest floor drain.

2.11 WATER FILTERS AND POT CHEMICAL FEEDERS

See section 23 25 00, HVAC WATER TREATMENT, Article 2.2, CHEMICAL

TREATMENT FOR CLOSED LOOP SYSTEMS.

2.12 GAGES, PRESSURE AND COMPOUND

- A. ASME B40.100, Accuracy Grade 1A, (pressure, vacuum, or compound for air, oil or water), initial mid-scale accuracy 1 percent of scale (Qualify grade), metal or phenolic case, 115 mm (4-1/2 inches) in diameter, 6 mm (1/4 inch) NPT bottom connection, white dial with black graduations and pointer, clear glass or acrylic plastic window, suitable for board mounting. Provide red "set hand" to indicate normal working pressure.
- B. Provide brass lever handle union cock. Provide brass/bronze pressure snubber for gages in water service.
- C. Range of Gages: Provide range equal to at least 130 percent of normal operating range.

2.13 PRESSURE/TEMPERATURE TEST PROVISIONS

- A. Pete's Plug: 6 mm (1/4 inch) MPT by 75 mm (3 inches) long, brass body and cap, with retained safety cap, norel self-closing valve cores, permanently installed in piping where shown.
- B. Provide one each of the following test items to the COTR:
 - 1. 6 mm (1/4 inch) FPT by 3 mm (1/8 inch) diameter stainless steel pressure gage adapter probe for extra long test plug. PETE'S 500 XL is an example.
 - 2. 90 mm (3-1/2 inch) diameter, one percent accuracy, compound gage, 100 kPa (30 inches) Hg to 700 kPa (100 psig) range.
 - 3. 0 - 104 degrees C (220 degrees F) pocket thermometer one-half degree accuracy, 25 mm (one inch) dial, 125 mm (5 inch) long stainless steel stem, plastic case.

2.14 THERMOMETERS

- A. Organic liquid filled type, red or blue column, clear plastic window, with 150 mm (6 inch) brass stem, straight, fixed or adjustable angle as required for each in reading.
- B. Case: Chrome plated brass or aluminum with enamel finish.
- C. Scale: Not less than 225 mm (9 inches), range as described below, two degree graduations.
- D. Separable Socket (Well): Brass, extension neck type to clear pipe insulation.
- E. Scale ranges:
 - 1. Heating Hot Water: -1 – 116 degrees C (30-240 degrees F).

2.15 FIRESTOPPING MATERIAL

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

PART 3 - EXECUTION**3.1 GENERAL**

- A. The drawings show the general arrangement of pipe and equipment but do not show all required fittings and offsets that may be necessary to connect pipes to equipment, fan-coils, coils, radiators, etc., and to coordinate with other trades. Provide all necessary fittings, offsets and pipe runs based on field measurements and at no additional cost to the government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories to be

connected on ceiling grid. Pipe location on the drawings shall be altered by contractor where necessary to avoid interferences and clearance difficulties.

- B. Store materials to avoid excessive exposure to weather or foreign materials. Keep inside of piping relatively clean during installation and protect open ends when work is not in progress.
- C. Support piping securely. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC. Install cooling coils and other heat exchangers at height sufficient to provide for installation of condensate drain trap as detailed on the drawings and to allow gravity flow of condensate drain piping.
- D. Install piping generally parallel to walls and column center lines, unless shown otherwise on the drawings. Space piping, including insulation, to provide 25 mm (one inch) minimum clearance between adjacent piping or other surface. Unless shown otherwise, slope drain piping down in the direction of flow not less than 25 mm (one inch) in 12 m (40 feet). Provide eccentric reducers to keep bottom of sloped piping flat.
- E. Locate and orient valves to permit proper operation and access for maintenance of packing, seat and disc. Generally locate valve stems in overhead piping in horizontal position. Provide a union adjacent to one end of all threaded end valves. Control valves usually require reducers to connect to pipe sizes shown on the drawing. Install butterfly valves with the valve open as recommended by the manufacturer to prevent binding of the disc in the seat.
- F. Offset equipment connections to allow valving off for maintenance and repair with minimal removal of piping. Provide flexibility in equipment connections and branch line take-offs with 3-elbow swing joints where appropriate.
- G. Tee water piping runouts or branches into the side of mains or other branches. Avoid bull-head tees, which are two return lines entering opposite ends of a tee and exiting out the common side.
- H. Provide manual or automatic air vent at all piping system high points and drain valves at all low points. Install piping to floor drains from all automatic air vents.
- I. Connect piping to equipment as shown on the drawings. Install components furnished by others such as:
 - 1. Flow elements (orifice unions), control valve bodies, flow switches, pressure taps with valve, and wells for sensors.
- J. Thermometer Wells: In pipes 65 mm (2-1/2 inches) and smaller increase the pipe size to provide free area equal to the upstream pipe area.
- K. Firestopping: Fill openings around uninsulated piping penetrating floors or fire walls, with firestop material. For firestopping insulated piping refer to Section 23 07 11, HVAC, AND BOILER PLANT INSULATION.
- L. Where copper piping is connected to steel piping, provide dielectric connections.

3.2 PIPE JOINTS

- A. Welded: Beveling, spacing and other details shall conform to ASME B31.1 and AWS B2.1. See Welder's qualification requirements under "Quality Assurance" in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Screwed: Threads shall conform to ASME B1.20; joint compound shall be applied to male threads only and joints made up so no more than three threads show. Coat exposed threads on steel pipe with joint compound, or red lead paint for corrosion protection.
- C. Mechanical Joint: Pipe grooving shall be in accordance with joint manufacturer's specifications. Lubricate gasket exterior including lips, pipe ends and housing interiors to prevent pinching the gasket during installation. Lubricant shall be as recommended by coupling manufacturer.
- D. 125 Pound Cast Iron Flange (Plain Face): Mating flange shall have raised face, if any, removed to avoid overstressing the cast iron flange.
- E. Solvent Welded Joints: As recommended by the manufacturer.

3.3 LEAK TESTING ABOVEGROUND PIPING

- A. Inspect all joints and connections for leaks and workmanship and make corrections as necessary, to the satisfaction of the COTR. Tests may be either of those below, or a combination, as approved by the COTR.
- B. An operating test at design pressure, and for hot systems, design maximum temperature.
- C. A hydrostatic test at 1.5 times design pressure for the new piping systems. Valve off existing piping systems as necessary. For water systems the design maximum pressure would usually be the static head, or expansion tank maximum pressure, plus pump head. Factory tested equipment (convertors, exchangers, coils, etc.) need not be field tested. Isolate equipment where necessary to avoid excessive pressure on mechanical seals and safety devices.

3.4 FLUSHING AND CLEANING PIPING SYSTEMS

- A. Water Piping: Clean systems as recommended by the suppliers of existing chemicals.
 - 1. Initial flushing: Remove loose dirt, mill scale, metal chips, weld beads, rust, and like deleterious substances without damage to any system component. Provide temporary piping or hose to bypass coils, control valves, exchangers and other factory cleaned equipment unless acceptable means of protection are provided and subsequent inspection of hide-out areas takes place. Isolate or protect clean system components, including pumps and pressure vessels, and remove any component which may be damaged. Open all valves, drains, vents and strainers at all system levels. Remove plugs, caps, spool pieces, and components to facilitate early debris discharge from system. Sectionalize system to obtain debris carrying velocity of 1.8 m/S (6 feet per second), if possible. Connect dead-end supply and return headers as necessary. Flush bottoms of risers. Install temporary strainers where necessary to protect down-stream equipment. Supply and remove flushing water and

- drainage by various type hose, temporary and permanent piping and Contractor's booster pumps. Flush until clean as approved by the COTR.
2. Cleaning: Using products recommended by existing chemical supplier, circulate systems at normal temperature to remove adherent organic soil, hydrocarbons, flux, pipe mill varnish, pipe joint compounds, iron oxide, and like deleterious substances not removed by flushing, without chemical or mechanical damage to any system component. Removal of tightly adherent mill scale is not required. Keep isolated equipment which is "clean" and where dead-end debris accumulation cannot occur. Sectionalize system if possible, to circulate at velocities not less than 1.8 m/S (6 feet per second). Circulate each section for not less than four hours. Blow-down all strainers, or remove and clean as frequently as necessary. Drain and prepare for final flushing.
 3. Final Flushing: Return systems to conditions required by initial flushing after all cleaning solution has been displaced by clean make-up. Flush all dead ends and isolated clean equipment. Gently operate all valves to dislodge any debris in valve body by throttling velocity. Flush for not less than one hour.

3.5 WATER TREATMENT

- A. Install water treatment equipment and provide water treatment system piping.
- B. Close and fill system as soon as possible after final flushing to minimize corrosion.
- C. Charge systems with chemicals specified in Section 23 25 00, HVAC WATER TREATMENT.
- D. Utilize this activity, by arrangement with the COTR, for instructing VA operating personnel.

3.6 OPERATING AND PERFORMANCE TEST AND INSTRUCTION

- A. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Adjust red set hand on pressure gages to normal working pressure.

--- E N D ---

**SECTION 23 21 23
HYDRONIC PUMPS****PART 1 - GENERAL****1.1 DESCRIPTION**

- A. Hydronic pumps for Heating, Ventilating and Air Conditioning.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- C. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- D. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.
- E. Section 23 21 13, HYDRONIC PIPING.
- F. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT.
- G. Section 26 29 11, MOTOR CONTROLLERS.

1.3 QUALITY ASSURANCE

- A. Refer to Paragraph, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Design Criteria:
 - 1. Pumps design and manufacturer shall conform to Hydraulic Institute Standards.
 - 2. Pump sizes, capacities, pressures, operating characteristics and efficiency shall be as scheduled.
 - 3. Head-capacity curves shall slope up to maximum head at shut-off. Curves shall be relatively flat for closed systems. Select pumps near the midrange of the curve, so the design capacity falls to the left of the best efficiency point, to allow a cushion for the usual drift to the right in operation, without approaching the pump curve end point and possible cavitation and unstable operation. Select pumps for open systems so that required net positive suction head (NPSHR) does not exceed the net positive head available (NPSHA).
 - 4. Pump Driver: Furnish with pump. Size shall be non-overloading at any point on the head-capacity curve, including in a parallel or series pumping installation with one pump in operation.
 - 5. Provide all pumps with motors, impellers, drive assemblies, bearings, coupling guard and other accessories specified. Statically and dynamically balance all rotating parts.
 - 6. Furnish each pump and motor with a nameplate giving the manufacturers name, serial number of pump, capacity in GPM and head in feet at design condition, horsepower, voltage, frequency, speed and full load current and motor efficiency.
 - 7. Test all pumps before shipment. The manufacturer shall certify all pump ratings.

8. After completion of balancing, provide replacement of impellers or trim impellers to provide specified flow at actual pumping head, as installed.
- C. Allowable Vibration Tolerance for Pump Units: Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 1. Pumps and accessories.
 2. Motors and drives.
 3. Variable speed motor controllers shall be submitted under the appropriate Division 26 specification section. Coordinate requirements with E.C.
- C. Manufacturer's installation, maintenance and operating instructions, in accordance with Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- D. Characteristic Curves: Head-capacity, efficiency-capacity, brake horsepower-capacity, and NPSHR-capacity for each pump and for combined pumps in parallel or series service. Identify pump and show fluid pumped, specific gravity, pump speed and curves plotted from zero flow to maximum for the impeller being furnished and at least the maximum diameter impeller that can be used with the casing.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only:
- B. American Iron and Steel Institute (AISI):
AISI 1045.....Cold Drawn Carbon Steel Bar, Type 1045
AISI 416.....Type 416 Stainless Steel
- C. American National Standards Institute (ANSI):
ANSI B15.1-00(R2008)..... Safety Standard for Mechanical Power Transmission Apparatus
ANSI B16.1-05Cast Iron Pipe Flanges and Flanged Fittings, Class 25, 125, 250
and 800
- D. American Society for Testing and Materials (ASTM):
A48-03 (2008)Standard Specification for Gray Iron Castings
B62-2009Standard Specification for Composition Bronze or Ounce Metal
Castings
- E. Maintenance and Operating Manuals in accordance with Section 01 00 00, General Requirements.

1.6 DEFINITIONS

- A. Capacity: Liters per second (L/s) (Gallons per minute (GPM) of the fluid pumped.

- B. Head: Total dynamic head in kPa (feet) of the fluid pumped.
- C. Flat head-capacity curve: Where the shutoff head is less than 1.16 times the head at the best efficiency point.

1.7 SPARE MATERIALS

- A. Furnish one spare seal and casing gasket for each pump to the COTR.

PART 2 - PRODUCTS

2.1 CENTRIFUGAL PUMPS, BRONZE FITTED

- A. General:
 - 1. Provide pumps that will operate continuously without overheating bearings or motors at every condition of operation on the pump curve, or produce noise audible outside the room or space in which installed.
 - 2. Provide pumps of size, type and capacity as indicated, complete with electric motor and drive assembly, unless otherwise indicated. Design pump casings for the indicated working pressure and factory test at 1½ times the designed pressure.
 - 3. Provide pumps of the same type, the product of a single manufacturer, with pump parts of the same size and type interchangeable.
 - 4. General Construction Requirements
 - a. Balance: Rotating parts, statically and dynamically.
 - b. Construction: To permit servicing without breaking piping or motor connections.
 - c. Pump Motors: Provide high efficiency motors, rated for inverter duty for variable speed service. Refer to Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT. Motors shall be Open Drip Proof and operate at 1750 rpm unless noted otherwise.
 - d. Heating pumps shall be suitable for handling water to 225°F.
 - e. Provide coupling guards that meet ANSI B15.1, Section 8 and OSHA requirements.
 - f. Pump Connections: Flanged.
 - g. Pump shall be factory tested.
 - h. Performance: As scheduled on the Contract Drawings.
 - 5. Variable Speed Pumps:
 - a. The pumps shall be the type shown on the drawings and specified herein flex coupled to an open drip-proof motor.
 - b. Variable Speed Motor Controllers: Refer to Section 26 29 11, MOTOR CONTROLLERS and to Section 23 05 11, COMMON WORK RESULTS FOR HVAC paragraph, Variable Speed Motor Controllers. Division 23 Contractor shall closely coordinate pump and associated motor requirements with variable speed motor controller furnished by Division 26 Contractor.
 - c. Pump operation and speed control shall be as shown on the drawings.

B. In-Line Type:

1. Casing and Bearing Housing: Close-grained cast iron, ASTM A48.
2. Casing Wear Rings: Bronze.
3. Suction and Discharge: Plain face flange, 850 kPa (125 psig), ANSI B16.1.
4. Casing Vent: Manual brass cock at high point.
5. Casing Drain and Gage Taps: 15 mm (1/2-inch) plugged connections minimum size.
6. Impeller: Bronze, ASTM B62, enclosed type, keyed to shaft.
7. Shaft: Steel, AISI Type 1045 or stainless steel.
8. Shaft Seal: Manufacturer's standard mechanical type to suit pressure and temperature and fluid pumped.
9. Shaft Sleeve: Bronze or stainless steel.
10. Motor: Furnish with pump. Refer to Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT.
11. Provide line sized shut-off valve and suction strainer (with blow down valve), and maintain manufacturer recommended straight pipe length on pump suction. Contractor option: Provide suction diffuser as follows:
 - a. Body: Cast iron with steel inlet vanes and combination diffuser-strainer-orifice cylinder with 5 mm (3/16-inch) diameter openings for pump protection. Provide taps for strainer blowdown and gage connections.
 - b. Provide adjustable foot support for suction piping.
 - c. Strainer free area: Not less than five times the suction piping.
 - d. Provide disposable start-up strainer.

PART 3 – EXECUTION**3.1 INSTALLATION**

- A. Follow manufacturer's written instructions for pump mounting and start-up. Access/Service space around pumps shall not be less than minimum space recommended by pumps manufacturer.
- B. Support piping adjacent to pump such that no weight is carried on pump casing. First 3 hangers for each pipe shall be spring and neoprene type.
- C. Permanently support in-line pumps by the connecting piping only, not from the casing or the motor eye bolt.
- D. Coordinate location of thermometer and pressure gauges as per Section 23 21 13, HYDRONIC PIPING.

3.2 START-UP

- A. Verify that the piping system has been flushed, cleaned and filled.
- B. Lubricate pumps before start-up.
- C. Prime the pump, vent all air from the casing and verify that the rotation is correct. To avoid damage to mechanical seals, never start or run the pump in dry condition.

- D. Verify that correct size heaters-motor over-load devices are installed for each pump controller unit.
- E. Field modifications to the bearings and or impeller (including trimming) are not permitted. If the pump does not meet the specified vibration tolerance, send the pump back to the manufacturer for a replacement pump. All modifications to the pump shall be performed at the factory.
- F. Ensure the disposable strainer is free of debris prior to testing and balancing of the hydronic system.
- G. After several days of operation, replace the disposable start-up strainer with a regular strainer in the suction diffuser.

--- E N D ---

SECTION 23 22 13
STEAM AND CONDENSATE HEATING PIPING**PART 1 - GENERAL****1.1 DESCRIPTION**

- A. Steam, condensate and vent piping inside buildings.

1.2 RELATED WORK

- A. Excavation and backfill: Section 31 20 00, EARTHWORK.
- B. General mechanical requirements and items, which are common to more than one section of Division 23: Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- C. Piping insulation: Section 23 07 11, HVAC AND BOILER PLANT INSULATION.
- D. Unit Heaters: Section 23 82 00, CONVECTION HEATING AND COOLING UNITS.
- E. Temperature and pressure sensors and valve operators: Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

1.3 QUALITY ASSURANCE

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC, which includes welding qualifications.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Pipe and equipment supports.
 - 2. Pipe and tubing, with specification, class or type, and schedule.
 - 3. Pipe fittings, including miscellaneous adapters and special fittings.
 - 4. Flanges, gaskets and bolting.
 - 5. Valves of all types.
 - 6. Strainers.
 - 7. All specified steam system components.
 - 8. Gages.
 - 9. Thermometers and test wells.
- C. Manufacturer's certified data report, Form No. U-1, for ASME pressure vessels:
 - 1. Heat Exchangers (Steam-to-Hot Water).
 - 2. Flash tanks.
- D. As-Built Piping Diagrams: Provide drawing as follows for steam and steam condensate piping and other central plant equipment.
 - 1. One wall-mounted stick file for prints. Mount stick file in the sub-basement service room or adjacent control room along with control diagram stick file.
 - 2. One set of reproducible drawings.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers/American National Standards Institute (ASME/ANSI):
 B1.20.1-83(R2006).....Pipe Threads, General Purpose (Inch)
 B16.4-2006.....Gray Iron Threaded Fittings
- C. American Society of Mechanical Engineers (ASME):
 B16.1-2005.....Gray Iron Pipe Flanges and Flanged Fittings
 B16.3-2006.....Malleable Iron Threaded Fittings
 B16.9-2007.....Factory-Made Wrought Buttwelding Fittings
 B16.11-2005.....Forged Fittings, Socket-Welding and Threaded
 B16.14-91.....Ferrous Pipe Plugs, Bushings, and Locknuts with Pipe Threads
 B16.22-2001.....Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings
 B16.23-2002.....Cast Copper Alloy Solder Joint Drainage Fittings
 B16.24-2006.....Cast Copper Alloy Pipe Flanges and Flanged Fittings, Class 150,
 300, 400, 600, 900, 1500 and 2500
 B16.39-98.....Malleable Iron Threaded Pipe Unions, Classes 150, 250, and 300
 B31.1-2007.....Power Piping
 B31.9-2008.....Building Services Piping
 B40.100-2005.....Pressure Gauges and Gauge Attachments
 Boiler and Pressure Vessel Code: SEC VIII D1-2001, Pressure Vessels, Division 1
- D. American Society for Testing and Materials (ASTM):
 A47-99.....Ferritic Malleable Iron Castings
 A53-2007.....Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and
 Seamless
 A106-2008.....Seamless Carbon Steel Pipe for High-Temperature Service
 A126-2004.....Standard Specification for Gray Iron Castings for Valves,
 Flanges, and Pipe Fittings
 A181-2006.....Carbon Steel Forgings, for General-Purpose Piping
 A183-2003.....Carbon Steel Track Bolts and Nuts
 A216-2008.....Standard Specification for Steel Castings, Carbon, Suitable for
 Fusion Welding, for High Temperature Service
 A285-01.....Pressure Vessel Plates, Carbon Steel, Low-and-Intermediate-
 Tensile Strength
 A307-2007.....Carbon Steel Bolts and Studs, 60,000 PSI Tensile Strength
 A516-2006.....Pressure Vessel Plates, Carbon Steel, for Moderate-and- Lower
 Temperature Service
 A536-84(2004)e1.....Standard Specification for Ductile Iron Castings

- B32-2008..... Solder Metal
- B61-2008..... Steam or Valve Bronze Castings
- B62-2009..... Composition Bronze or Ounce Metal Castings
- B88-2003..... Seamless Copper Water Tube
- F439-06..... Socket-Type Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe
Fittings, Schedule 80
- F441-02(2008) Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe, Schedules
40 and 80
- E. American Welding Society (AWS):
- A5.8-2004..... Filler Metals for Brazing and Braze Welding
- B2.1-00..... Welding Procedure and Performance Qualifications
- F. Manufacturers Standardization Society (MSS) of the Valve and Fitting Industry, Inc.:
- SP-67-95 Butterfly Valves
- SP-70-98 Cast Iron Gate Valves, Flanged and Threaded Ends
- SP-71-97 Gray Iron Swing Check Valves, Flanged and Threaded Ends
- SP-72-99 Ball Valves with Flanged or Butt-Welding Ends for General
Service
- SP-78-98 Cast Iron Plug Valves, Flanged and Threaded Ends
- SP-80-97 Bronze Gate, Globe, Angle and Check Valves
- SP-85-94 Cast Iron Globe and Angle Valves, Flanged and Threaded Ends
- G. Military Specifications (Mil. Spec.):
- MIL-S-901D-1989..... Shock Tests, H.I. (High Impact) Shipboard Machinery,
Equipment, and Systems
- H. National Board of Boiler and Pressure Vessel Inspectors (NB): Relieving Capacities of Safety
Valves and Relief Valves
- I. Tubular Exchanger Manufacturers Association: TEMA 18th Edition, 2000

PART 2 - PRODUCTS

2.1 PIPE AND EQUIPMENT SUPPORTS, PIPE SLEEVES, AND WALL AND CEILING PLATES

- A. Provide in accordance with Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

2.2 PIPE AND TUBING

- A. Steam Piping: Steel, ASTM A53, Grade B, seamless or ERW; A106 Grade B, Seamless;
Schedule 40, except underground piping between Building 1 and Building 15 shall be Schedule
80.
- B. Steam Condensate and Pumped Condensate Piping:
1. Copper water tube ASTM B88, Type K, hard drawn.
 2. All steam condensate piping upstream of steam traps: Steel, ASTM A53, Grade B, Seamless
or ERW, or A106 Grade B Seamless, Schedule 80.

- C. Vent Piping: Steel, ASTM A53, Grade B, seamless or ERW; A106 Grade B, Seamless; Schedule 40, galvanized.

2.3 FITTINGS FOR STEEL PIPE

- A. 50 mm (2 inches) and Smaller: Welded.
1. Butt welding: ASME B16.9 with same wall thickness as connecting piping.
 2. Forged steel, socket welding: ASME B16.11.
 3. Unions: ASME B16.39.
 4. Steam line drip station and strainer quick-couple blowdown hose connection: Straight through, plug and socket, screw or cam locking type for 15 mm (1/2 inch) ID hose. No integral shut-off is required.
- B. 65 mm (2-1/2 inches) and Larger: Welded or flanged joints.
1. Butt welding fittings: ASME B16.9 with same wall thickness as connecting piping. Elbows shall be long radius type, unless otherwise noted.
 2. Welding flanges and bolting: ASME B16.5:
 - a. Steam service: Weld neck or slip-on, raised face, with non-asbestos gasket. Non-asbestos gasket shall either be stainless steel spiral wound strip with flexible graphite filler or compressed inorganic fiber with nitrile binder rated for saturated and superheated steam service 750 degrees F and 1500 psi.
 - b. Flange bolting: Carbon steel machine bolts or studs and nuts, ASTM A307, Grade B.
- C. Welded Branch and Tap Connections: Forged steel weldolets, or branchlets and threadolets may be used for branch connections up to one pipe size smaller than the main. Forged steel half-couplings, ASME B16.11 may be used for drain, vent and gage connections.

2.4 FITTINGS FOR COPPER TUBING

- A. Solder Joint:
1. Joints shall be made up in accordance with recommended practices of the materials applied. Apply 95/5 tin and antimony on all copper piping.
- B. Bronze Flanges and Flanged Fittings: ASME B16.24.
- C. Fittings: ANSI/ASME B16.18 cast copper or ANSI/ASME B16.22 solder wrought copper.

2.5 DIELECTRIC FITTINGS

- A. Provide where copper tubing and ferrous metal pipe are joined.
- B. 50 mm (2 inches) and Smaller: Threaded dielectric union, ASME B16.39.
- C. 65 mm (2 1/2 inches) and Larger: Flange union with dielectric gasket and bolt sleeves, ASME B16.42.
- D. Temperature Rating, 121 degrees C (250 degrees F) for steam condensate and as required for steam service.
- E. Contractor's option: On pipe sizes 2" and smaller, screwed end brass gate valves may be used in lieu of dielectric unions.

2.6 VALVES

- A. Asbestos packing is not acceptable.
- B. All valves of the same type shall be products of a single manufacturer.
- C. Provide chain operators for valves 150 mm (6 inches) and larger when the centerline is located 2100 mm (7 feet) or more above the floor or operating platform, and in other locations as noted on the drawings.
- D. Provide butterfly valves for all steam supply piping 2.5" and larger, and gate valves for all steam valves smaller than 2.5".
- E. Provide gate valves for all steam condensate piping, regardless of size.
- F. Provide globe valves in all bypass lines used for warm-up or temporary emergency operation.
- G. Shut-Off Valves
 - 1. Gate Valves:
 - a. 50 mm (2 inches) and smaller: Heavy Duty, forged steel (A105) body, 13 CR disc and stem, HF seat, Class 800, rated 1,975 psi @ 100 deg.F.
 - b. 65 mm (2 1/2 inches) and larger: Flanged, outside screw and yoke.
 - 1) High pressure steam 413 kPa (60 psig) and above nominal MPS system): Cast steel body, ASTM A216 grade WCB, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel solid disc and seats. Provide 25 mm (1 inch) bypass with globe valve on all steam main shutoff valves.
 - 2) All other services: MSS-SP 70, iron body, bronze mounted, 861 kPa (125 psig) wedge disc.
 - 2. Butterfly Valves: Provide stem extension to allow 50 mm (2 inches) of pipe insulation without interfering with valve operation. MSS-SP 68, flange lug type or grooved end rated 1448 kPa (210 psig) working pressure at 177 degrees C (350 degrees F). Valves shall be ANSI Leakage Class VI and rated for bubble tight shut-off to full valve pressure rating. Valve shall be rated for dead end service and bi-directional flow capability to full rated pressure. Not permitted for direct buried pipe applications. All butterfly valves for steam service shall be provided with a 25 mm (1 inch) bypass pipe with globe valve for warm-up.
 - a. Body: ASTM A216 Grade WCB Carbon Steel.
 - b. Trim: ASTM A351 Grade CF8M stainless steel disc, PTFE-coated 304 Stainless steel permanently lubricated bearings, stainless steel stem and 15% glass reinforced PTFE seat.
 - c. Actuators: Field interchangeable. Enclosed worm gear with handwheel, and where required, chain-wheel operator.
- H. Globe and Angle Valves:
 - 1. Globe Valves:
 - a. 50 mm (2 inches) and smaller: Heavy Duty, forged steel (A105) body, 13 CR disc and stem, HF seat, Class 800, rated 1,975 psi @ 100 deg.F.

- b. 65 mm (2 1/2 inches) and larger:
 - 1) Globe valves for high pressure steam 413 kPa (60 psig) and above nominal MPS system: Cast steel body, ASTM A216 grade WCB, flanged, OS&Y, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel disc and renewable seat rings.
 - 2) All other services: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for globe valves.
- 2. Angle Valves
 - a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Angle valves shall be union bonnet with metal plug type disc.
 - b. 65 mm (2 1/2 inches) and larger:
 - 1) Angle valves for high pressure steam 413 kPa (60 psig) and above nominal MPS system): Cast steel body, ASTM A216 grade WCB, flanged, OS&Y, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel disc and renewable seat rings.
 - 2) All other services: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for angle valves.
- I. Swing Check Valves
 - 1. 50 mm (2 inches) and smaller: ASME B16.34, heavy duty, forged steel (A105) body, 13 CR trim, HF seat, Class 800, rated 1,975 psi @ 100 deg.F.
 - 2. 65 mm (2-1/2 inches) and Larger:
 - a. Check valves for high pressure steam 413 kPa (60 psig) and above nominal MPS system: Cast steel body, ASTM A216 grade WCB, flanged, OS&Y, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel disc and renewable seat rings.
 - b. All other services: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-71 for check valves.

2.7 STRAINERS

- A. Basket or Y Type. Tee type is acceptable for gravity flow and pumped steam condensate service.
- B. High Pressure Steam: Rated 1034 kPa (150 psig) saturated steam.
 - 1. 50 mm (2 inches) and smaller: Iron, ASTM A116 Grade B, or bronze, ASTM B-62 body with screwed connections (250 psig).
 - 2. 65 mm (2-1/2 inches) and larger: Flanged cast steel or 1723 kPa (250 psig) cast iron.
- C. All Other Services: Rated 861 kPa (125 psig) saturated steam.
 - 1. 50 mm (2 inches) and smaller: Cast iron or bronze.
 - 2. 65 mm (2-1/2 inches) and larger: Flanged, iron body.
- D. Screens: Bronze, monel metal or 18-8 stainless steel, free area not less than 2-1/2 times pipe area, with perforations as follows:

1. 75 mm (3 inches) and smaller: 20 mesh for steam and 1.1 mm (0.045 inch) diameter perforations for liquids.
2. 100 mm (4 inches) and larger: 1.1 mm (0.045) inch diameter perforations for steam and 3.2 mm (0.125 inch) diameter perforations for liquids.

2.8 STEAM SYSTEM COMPONENTS

- A. Heat Exchanger (Steam to Hot Water): Shell and tube type, U-bend removable tube bundle, steam in shell, water in tubes, equipped with support cradles.
 1. Maximum tube velocity: 2.3 m/s (7.5 feet per second).
 2. Tube fouling factor: TEMA Standards, but not less than $0.00018 \text{ m}^2\text{K/W}$ ($0.001 \text{ ft}^2\text{hrF/Btu}$).
 3. Materials:
 - a. Shell: Steel.
 - b. Tube sheet and tube supports: Steel or brass.
 - c. Tubes: 20 mm (3/4 inch) OD copper.
 - d. Head or bonnet: Cast iron or steel.
 4. Construction: In accordance with ASME Pressure Vessel Code for 861 kPa (125 psig) working pressure for shell and tubes. Provide manufacturer's certified data report, Form No. U-1.
- B. Optional Heat Transfer Package: In lieu of field erected individual components, the Contractor may provide a factory or shop assembled package of heat exchangers, pumps, and other components supported on a welded steel frame.
- C. Heat Exchanger (Steam to Hot Water): Plate and frame package type. The package shall include the following components pre-piped and hydrotested prior to shipment:
 1. Plate & Frame Heat Exchanger - Heat exchanger shall be of a bolted design with 316 stainless steel plates and EPDM clip on gaskets. The unit shall be ASME stamped for 150psig. Heat exchanger shall be supplied with sufficient heating surface to guarantee zero flash steam in the condensate at full load conditions with secondary outlet temperature not exceeding 190 F. Heat exchanger shall be designed for ease of maintenance without disturbing the steam, condensate or waterside piping. The heat exchanger shall have the capacity for expansion by the addition of plates without removal of the heat exchanger from its installed position.
 2. Temperature Control System - The outlet fluid temperature shall be controlled utilizing a modulating control valve on the condensate outlet of the heat exchanger. The valve shall be a two port, ANSI 150 carbon steel globe valve with equal percentage trim. It shall be fitted with an electric, fail closed actuator. Actuator shall operate from a 4-20 mA control signal provided by RTD on outlet. The steam supply shall also be supplied with an automated ball valve to allow full shutoff of steam to the skid. The steam supply shall be complete with inlet drip trap. The skid shall be supplied a single control valve.

3. Temperature Sensors – Package shall include RTD type temperature sensors on the secondary water inlet and outlet as well as the condensate outlet. The RTD's shall operate in conjunction with the package's integral control panel, to regulate outlet temperature and to actuate the upstream steam valve in the event the secondary inlet and outlet temperatures become equalized, or condensate temperature rises to the point of producing flash steam in the condensate. Sensors shall be factory mounted and wired to the control system.
 4. System Controls – Package shall include a UL Listed, NEMA12, control panel with a single point power connection and all components pre-wired. Temperature shall be controlled by a Programmable Automation Controller and interfaced through a 7" touch screen display. The control logic shall be designed for both operating and high limit temperature control. The controller shall have password protected user levels for limiting access, real time and historical trending /alarm management for up to 30 days. The controller shall be capable of BACNet communication interface including the ability to accept a temperature setpoint input from the building automation system. Enclosure shall be NEMA 12 with thru the door disconnects.
 5. Piping – All piping 2" NPS or less shall be schedule 80 ASTM A106 Grade B or A53. Piping greater than 2" NPS shall be schedule 40 ASTM A106 Grade B or A53. NPT fittings shall be Class 300 malleable iron. Inlet steam piping shall include integral steam separator and associated steam trap station by skid manufacturer. Outlet piping shall include integral steam trap station downstream of condensate control valve by skid manufacturer. Frame shall be heavy duty channel and angle iron construction of ASTM A36 structural steel. All welding shall be performed by ASME Section IX certified welders. Both the steam and waterside piping shall be hydrostatically factory tested to 1.5 times the design pressure. All carbon steel piping and framework shall be prepped to SSPC-SP10 and painted with high temperature enamel.
 6. Performance – The skid shall be completely packaged and tested prior to shipment. All components shall be fully installed. Component sub-assemblies may be removed for protection during shipping if needed. The complete package shall be supplied by a single manufacturer with at least 5 years experience providing packaged heat exchange solutions. System commissioning shall be provided by factory trained service technician.
 7. Warranty – The system shall be warranted from the manufacturer for a period of 12 months from date of start up, not to exceed 18 months from date of shipment.
- D. Steam Pressure Reducing Valves in PRV Stations:
1. Type: Single-seated, diaphragm operated, spring-loaded, external or internal steam pilot-controlled, normally closed, adjustable set pressure. Pilot shall sense controlled pressure downstream of main valve.
 2. Service: Provide controlled reduced pressure to steam piping systems.

3. Pressure control shall be smooth and continuous. Maximum flow capability of each valve shall not exceed capacity of downstream safety valve(s).
4. Main valve and pilot valve shall have replaceable valve plug and seat of stainless steel, monel, or similar durable material.
 - a. Pressure rating for high pressure steam: Not less than 1034 kPa (150 psig) saturated steam.
 - b. Connections: Flanged for valves 65 mm (2-1/2 inches) and larger; flanged or threaded ends for smaller valves.
5. Select pressure reducing valves to develop less than 85 dbA at 1500 mm (5 feet) elevation above adjacent floor, and 1500 mm (5 feet) distance in any direction. Inlet and outlet piping for steam pressure reducing valves shall be Schedule 80 minimum for required distance to achieve required levels or sound attenuators shall be applied.
- E. Safety Valves and Accessories: Comply with ASME Boiler and Pressure Vessel Code, Section VIII. Capacities shall be certified by National Board of Boiler and Pressure Vessel Inspectors, maximum accumulation 10 percent. Provide lifting lever. Provide drip pan elbow where shown.
- F. Flash Tanks: Horizontal type, constructed of copper bearing steel, ASTM A516 or ASTM A285, for a steam working pressure of 861 kPa (125 psig) to comply with ASME Code for Unfired Pressure Vessels and stamped with "U" symbol. Perforated pipe inside tank shall be ASTM A53 Grade B, Seamless or ERW, or A106 Grade B Seamless, Schedule 80. Corrosion allowance of 1.6 mm (1/16 inch) may be provided in lieu of the copper bearing requirement. Provide data Form No. U-1.
- G. Steam Trap: Each type of trap shall be the product of a single manufacturer. Provide trap sets at all low points and at 61 m (200 feet) intervals on the horizontal main lines.
 1. Floats and linkages shall provide sufficient force to open trap valve over full operating pressure range available to the system. Unless otherwise indicated on the drawings, traps shall be sized to handle 2.0 times the specified heat transfer load with minimum pressure drop as follows:
 - a. For equipment with modulating control valve: 1.7 kPa (1/4 psig), based on a condensate leg of 300 mm (12 inches) at the trap inlet and gravity flow to the receiver.
 - b. For main line drip trap sets and other trap sets at steam pressure: Up to 70 percent of design differential pressure. Condensate may be lifted to the return line.
 2. Standard trap bodies: Bronze, cast iron, or semi-steel, constructed to permit ease of removal and servicing working parts without disturbing connecting piping. Universal trap assemblies on drips shall have stainless steel body. For systems without relief valve traps shall be rated for the pressure upstream of the PRV supplying the system.
 3. Balanced pressure thermostatic elements: Phosphor bronze, stainless steel or monel metal.
 4. Valves and seats: Suitable hardened corrosion resistant alloy.
 5. Mechanism: Brass, stainless steel or corrosion resistant alloy. Universal trap assemblies shall have stainless steel mechanism.

6. Floats: Stainless steel.
 7. Inverted bucket traps: Provide bi-metallic thermostatic element for rapid release of non-condensables.
 8. Universal trap stations shall be all stainless steel, two-bolt design, and shall be capable of accepting traps of any universal trap manufacturer. Assembly shall include integral inlet & outlet isolation valves, inlet strainer with blowdown valve, and test port valve downstream of trap. Universal thermodynamic type traps associated with universal trap stations shall be all stainless steel, two-bolt design.
- H. Thermostatic Air Vent (Steam): Brass or iron body, balanced pressure bellows, stainless steel (renewable) valve and seat, rated 861 kPa (125 psig) working pressure, 20 mm (3/4 inch) screwed connections. Air vents shall be balanced pressure type that responds to steam pressure-temperature curve and vents air at any pressure.
- I. Steam Humidifiers:
1. Steam separator type that discharges steam into the air stream through a steam jacketed distribution manifold or dispersion tube. Humidifiers shall be complete with Y-type steam supply strainer; modulating, normally closed steam control valve; normally closed condensate temperature switch; and manufacturer's standard steam trap(s).
 2. Steam separator: Stainless steel.
 3. Distribution manifold: Stainless steel, composed of dispersion pipe and surrounding steam jacket, manifold shall span the width of duct, and shall be multiple manifold type under any of the following conditions:
 - a. Duct section height exceeds 900 mm (36 inches).
 - b. Duct air velocity exceeds 5.1 m/s (1000 feet per minute).
 - b. If within 900 mm (3 feet) upstream of fan, damper or pre-filter.
 - d. If within 3000 mm (10 feet) upstream of after-filter.
- J. Steam Flow Meter/Recorder: Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- K. Automatic pump traps shall be skid-mounted. Body construction shall be cast iron, rated for the duty imposed, minimum 200 psi at 600°F, with a swing type inlet check valve and ball type outlet check valve. The internal trap mechanism shall contain dual stainless steel floats connected with a two stage trap, while the internal pump mechanism shall be a stainless steel single tension spring snap-action device. The pump, trap and check valve mechanisms shall be incorporated within the same body envelope with no external seals or glands, no separate trap required external to the pump trap, and shall be capable of operating with 8 inches of installation head from the base of the unit. Pump trap shall include pre-piped reservoir by pump trap manufacturer, sized for the pump duty cycle. The APT manufacturer shall study each application and select the pump and accessories accordingly.

2.9 GAGES, PRESSURE AND COMPOUND

- A. ASME B40.1, Accuracy Grade 1A, (pressure, vacuum, or compound), initial mid-scale accuracy 1 percent of scale (Qualify grade), metal or phenolic case, 115 mm (4-1/2 inches) in diameter, 6 mm (1/4 inch) NPT bottom connection, white dial with black graduations and pointer, clear glass or acrylic plastic window, suitable for board mounting. Provide red "set hand" to indicate normal working pressure.
- B. Provide brass, lever handle union cock. Provide brass/bronze pressure snubber for gages in water service. Provide brass pigtail syphon for steam gages.
- C. Range of Gages: For services not listed provide range equal to at least 130 percent of normal operating range:

| | |
|--|---------------------------|
| Low pressure steam and steam condensate to 103 kPa(15 psig) | 0 to 207 kPa (30 psig). |
| Medium pressure steam and steam condensate nominal 413 kPa (60 psig) | 0 to 689 kPa (100 psig). |
| High pressure steam and steam condensate nominal 620 kPa to 861 kPa (90 to 125 psig) | 0 to 1378 kPa (200 psig). |
| Pumped condensate, steam condensate, gravity or vacuum (30" HG to 30 psig) | 0 to 415 kPa (60 psig) |

2.10 PRESSURE/TEMPERATURE TEST PROVISIONS

- A. Provide one each of the following test items to the COTR:
- 6 mm (1/4 inch) FPT by 3 mm (1/8 inch) diameter stainless steel pressure gage adapter probe for extra long test plug. PETE'S 500 XL is an example.
 - 90 mm (3-1/2 inch) diameter, one percent accuracy, compound gage, 762 mm (30 inches) Hg to 689 kPa (100 psig) range.
 - 0 - 104 degrees C (32-220 degrees F) pocket thermometer one-half degree accuracy, 25 mm (one inch) dial, 125 mm (5 inch) long stainless steel stem, plastic case.

2.11 FIRESTOPPING MATERIAL

- A. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

PART 3 - EXECUTION**3.1 GENERAL**

- A. The drawings show the general arrangement of pipe and equipment but do not show all required fittings and offsets that may be necessary to connect pipes to equipment, fan-coils, coils, radiators, etc., and to coordinate with other trades. Provide all necessary fittings, offsets and pipe runs based on field measurements and at no additional cost to the government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories to be

connected on ceiling grid. Pipe location on the drawings shall be altered by contractor where necessary to avoid interferences and clearance difficulties.

- B. Store materials to avoid excessive exposure to weather or foreign materials. Keep inside of piping relatively clean during installation and protect open ends when work is not in progress.
- C. Support piping securely. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC. Install convertors, steam coils, humidifiers, and other heat exchangers at height sufficient to provide gravity flow of condensate to the flash tank and condensate pump.
- D. Install piping generally parallel to walls and column center lines, unless shown otherwise on the drawings. Space piping, including insulation, to provide 25 mm (one inch) minimum clearance between adjacent piping or other surface. Unless shown otherwise, slope steam, condensate and drain piping down in the direction of flow not less than 25 mm (one inch) in 12 m (40 feet). Provide eccentric reducers to keep bottom of sloped piping flat.
- E. Locate and orient valves to permit proper operation and access for maintenance of packing, seat and disc. Generally locate valve stems in overhead piping in horizontal position. Provide a union adjacent to one end of all threaded end valves. Control valves usually require reducers to connect to pipe sizes shown on the drawing. Install butterfly valves with the valve open as recommended by the manufacturer to prevent binding of the disc in the seat.
- F. Offset equipment connections to allow valving off for maintenance and repair with minimal removal of piping. Provide flexibility in equipment connections and branch line take-offs with 3-elbow swing joints where appropriate.
- G. Tee water piping runouts or branches into the side of mains or other branches. Avoid bull-head tees, which are two return lines entering opposite ends of a tee and exiting out the common side.
- H. Connect piping to equipment as shown on the drawings. Install components furnished by others such as:
 - 1. Flow elements (orifice unions), control valve bodies, flow switches, pressure taps with valve, and wells for sensors.
- I. Firestopping: Fill openings around uninsulated piping penetrating floors or fire walls, with firestop material. For firestopping insulated piping refer to Section 23 07 11, HVAC AND BOILER PLANT INSULATION.
- J. Where copper piping is connected to steel piping, provide dielectric connections.
- K. Pipe vents to the exterior. Where a combined vent is provided, the cross sectional area of the combined vent shall be equal to sum of individual vent areas. Slope vent piping one inch in 40 feet (0.25 percent) in direction of flow. Provide a drip trap elbow on relief valve outlets if the vent rises to prevent backpressure. Terminate vent minimum 0.3 M (12 inches) above the roof or through the wall minimum 2.5 M (8 feet) above grade with down turned elbow.

- L. Provide a 25 mm (1 inch) bypass pipe with globe valve for warm-up on all butterfly valves, gate valves 4" and larger, and any other valves as noted on drawings. If bypass is not factory installed, it shall be field installed by Contractor.

3.2 PIPE JOINTS

- A. Welded: Beveling, spacing and other details shall conform to ASME B31.1 and AWS B2.1. See Welder's qualification requirements under "Quality Assurance" in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Screwed: Threads shall conform to ASME B1.20; joint compound shall be applied to male threads only and joints made up so no more than three threads show. Coat exposed threads on steel pipe with joint compound, or red lead paint for corrosion protection.
- C. 125 Pound Cast Iron Flange (Plain Face): Mating flange shall have raised face, if any, removed to avoid overstressing the cast iron flange.

3.3 STEAM TRAP PIPING

- A. Install to permit gravity flow to the trap. Provide gravity flow (avoid lifting condensate) from the trap where modulating control valves are used. Support traps weighing over 11 kg (25 pounds) independently of connecting piping.

3.4 LEAK TESTING

- A. Inspect all joints and connections for leaks and workmanship and make corrections as necessary, to the satisfaction of the COTR in accordance with the specified requirements. Testing shall be performed in accordance with the specification requirements.
- B. An operating test at design pressure, and for hot systems, design maximum temperature.
- C. A hydrostatic test at 1.5 times design pressure for the new piping systems. Valve off existing piping systems as necessary. Factory tested equipment (convertors, exchangers, coils, etc.) need not be field tested. Avoid excessive pressure on mechanical seals and safety devices.

3.5 FLUSHING AND CLEANING PIPING SYSTEMS

- A. Steam, Condensate and Vent Piping: No flushing or chemical cleaning required. Accomplish cleaning by pulling all strainer screens and cleaning all scale/dirt legs during start-up operation.

3.6 OPERATING AND PERFORMANCE TEST AND INSTRUCTION

- A. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Adjust red set hand on pressure gages to normal working pressure.

--- E N D ---

**SECTION 23 25 00
HVAC WATER TREATMENT****PART 1 - GENERAL****1.1 DESCRIPTION**

- A. This section specifies cleaning and treatment of circulating HVAC water systems, including the following.
 - 1. Cleaning compounds.
 - 2. Chemical treatment for closed loop heat transfer systems.

1.2 RELATED WORK

- A. Test requirements and instructions on use of equipment/system: Section 01 00 00, GENERAL REQUIREMENTS.
- B. General mechanical requirements and items, which are common to more than one section of Division 23: Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- C. Piping and valves: Section 23 21 13, HYDRONIC PIPING and Section 23 22 13, STEAM AND CONDENSATE HEATING PIPING.

1.3 QUALITY ASSURANCE

- A. Refer to paragraph, QUALITY ASSURANCE in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Technical Services: Provide the services of an experienced water treatment chemical engineer or technical representative to direct flushing, cleaning, pre-treatment, training, debugging, and acceptance testing operations; direct and perform chemical limit control during construction period and monitor systems for a period of 12 months after acceptance, including not less than 6 service calls and written status reports. Emergency calls are not included.
- C. Chemicals: Chemicals shall be non-toxic approved by local authorities and meeting applicable EPA requirements.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data including:
 - 1. Cleaning compounds and recommended procedures for their use.
 - 2. Chemical treatment for closed systems, including installation and operating instructions.
- C. Water analysis verification.
- D. Materials Safety Data Sheet for all proposed chemical compounds, based on U.S. Department of Labor Form No. L5B-005-4.
- E. Maintenance and operating instructions in accordance with Section 01 00 00, GENERAL REQUIREMENTS.

1.5 APPLICABLE PUBLICATIONS

- A. The publication listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Fire Protection Association (NFPA):
70-2008 National Electric Code (NEC)
- C. American Society for Testing and Materials (ASTM):
F441/F441M-02 (2008)..... Standard Specification for Chlorinated Poly (Vinyl Chloride)
(CPVC) Plastic Pipe, Schedules 40 and 80

PART 2 - PRODUCTS**2.1 CLEANING COMPOUNDS**

- A. Alkaline phosphate or non-phosphate detergent/surfactant/specific to remove organic soil, hydrocarbons, flux, pipe mill varnish, pipe compounds, iron oxide, and like deleterious substances, with or without inhibitor, suitable for system wetted metals without deleterious effects.
- B. All chemicals shall be acceptable for discharge to sanitary sewer.
- C. Refer to Section 23 21 13, HYDRONIC PIPING and Section 23 22 13, STEAM AND CONDENSATE HEATING PIPING, PART 3, for flushing and cleaning procedures.

2.2 CHEMICAL TREATMENT FOR CLOSED LOOP SYSTEMS

- A. Inhibitor: Provide sodium nitrite/borate, molybdate-based inhibitor or other approved compound suitable for make-up quality and make-up rate and which will cause or enhance bacteria/corrosion problems or mechanical seal failure due to excessive total dissolved solids. Shot feed manually. Maintain inhibitor residual as determined by water treatment laboratory, taking into consideration residual and temperature effect on pump mechanical seals.
- B. pH Control: Inhibitor formulation shall include adequate buffer to maintain pH range of 8.0 to 10.5.
- C. Performance: Protect various wetted, coupled, materials of construction including ferrous, and red and yellow metals. Maintain system essentially free of scale, corrosion, and fouling. Corrosion rate of following metals shall not exceed specified mills per year penetration; ferrous, 0-2; brass, 0-1; copper, 0-1. Inhibitor shall be stable at equipment skin surface temperatures and bulk water temperatures of not less than 121 degrees C (250 degrees F) and 52 degrees C (125 degrees Fahrenheit) respectively. Heat exchanger fouling and capacity reduction shall not exceed that allowed by fouling factor 0.0005.
- D. Pot Feeder (New – Building 15 basement mechanical room system): By-pass type, complete with necessary shut off valves, drain and air release valves, and system connections, for introducing chemicals into system, cast iron or steel tank with funnel or large opening on top for easy chemical addition. Feeders shall be 18.9 L (five gallon) minimum capacity at 860 kPa (125 psig) minimum working pressure.
- E. Pot Feeder (Existing to remain – Building 1 basement mechanical room and 10th floor penthouse systems): Utilize for the introduction of additional chemicals into the system as required to

increase concentration of treatment chemicals to specified, appropriate, and chemical manufacturer-required levels in the entire system (existing and new portions) after completion of hot water piping work.

- F. Side stream Water Filter for Closed Loop Systems: Stainless steel housing, and polypropylene filter media with polypropylene or stainless steel core. Filter media shall be compatible with water treatment chemicals used in the system. Replaceable filter cartridges for sediment removal service with minimum 20 micrometer particulate at 98 percent efficiency for approximately five (5) percent of system design flow rate. Filter cartridge shall have a maximum pressure drop of 13.8 kPa (2 psig) at design flow rate when clean, and maximum pressure drop of 172 kPa (25 psig) when dirty. An automatic flow control valve shall be provided in the piping to the filter. Inlet and outlet pressure gauges shall be provided to monitor filter condition. For existing filters to remain (Building 1 basement mechanical room and 10th floor penthouse systems), replace existing filter media with new upon completion of new piping work.

2.3 EQUIPMENT AND MATERIALS IDENTIFICATION

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Delivery and Storage: Deliver all chemicals in manufacturer's sealed shipping containers. Store in designated space and protect from deleterious exposure and hazardous spills.
- B. Install equipment furnished by the chemical treatment supplier and charge systems according to the manufacturer's instructions and as directed by the Technical Representative.
- C. Refer to Section 23 21 13 HYDRONIC PIPING for chemical treatment piping, installed as follows:
 - 1. Provide a by-pass line around water meters and bleed off piping assembly. Provide ball valves to allow for bypassing, isolation, and servicing of components.
 - 2. Provide installation supervision, start-up and operating instruction by manufacturer's technical representative.
- D. Prior to connection of new piping to existing piping systems, clean new portion of piping system as specified in Part 3 of Section 23 21 13. Before adding cleaning chemical to the closed system, all air handling coils and fan coil units shall be isolated by closing the inlet and outlet valves and opening the bypass valves. This is done to prevent dirt and solids from lodging the coils.
- E. Do not valve in or operate system pumps until after system has been cleaned.
- F. After chemical cleaning is satisfactorily completed, open the inlet and outlet valves to each coil and close the by-pass valves. Also, clean all strainers.
- G. Perform tests and report results in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
- H. After cleaning is complete, and water PH is acceptable to manufacturer of water treatment chemical, add manufacturer-recommended amount of chemicals to systems through existing/new

chemical pot feeder. Add volume of treatment chemicals to system such that concentration is increased to manufacturer-required levels for the entire system – existing and new.

- I. Instruct VA personnel in system maintenance and operation in accordance with Section 01 00 00, GENERAL REQUIREMENTS.

--- E N D ---

SECTION 23 82 00
CONVECTION HEATING AND COOLING UNITS**PART 1 - GENERAL****1.1 DESCRIPTION**

Unit heaters.

1.2 RELATED WORK

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC: General mechanical requirements and items, which are common to more than one section of Division 23.
- B. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT: Noise requirements.
- C. Section 23 22 13, STEAM AND CONDENSATE HEATING PIPING: unit heater piping.
- D. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Valve operators.
- E. Section 23 08 00 – COMMISSIONING OF HVAC SYSTEMS: Requirements for commissioning, systems readiness checklists, and training.
- F. Section 01 09 00 – GENERAL COMMISSIONING REQUIREMENTS

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Unit heaters.
- C. Certificates:
 - 1. Compliance with paragraph, QUALITY ASSURANCE.
 - 2. Compliance with specified standards.
- D. Operation and Maintenance Manuals: Submit in accordance with paragraph, INSTRUCTIONS, in Section 01 00 00, GENERAL REQUIREMENTS.
- E. Completed System Readiness Checklists provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 23 08 00 COMMISSIONING OF HVAC SYSTEMS.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute / Air Conditioning, Heating and Refrigeration Institute (ANSI/AHRI):
 - 440-08Performance Rating of Room Fan Coils

- C. National Fire Protection Association (NFPA):
 - 90A-09.....Standard for the Installation of Air Conditioning and Ventilating Systems
 - 70-11National Electrical Code
- D. Underwriters Laboratories, Inc. (UL):
 - 181-08Standard for Factory-Made Air Ducts and Air Connectors
 - 1995-05Heating and Cooling Equipment

1.6 GUARANTY

In accordance with FAR clause 52.246-21

PART 2 - PRODUCTS

2.1 UNIT HEATERS

- A. General: Horizontal discharge type for steam heating medium, as indicated.
- B. Casing: Steel sheet, phosphatized to resist rust and finished in baked enamel. Provide hanger supports.
- C. Fan: Propeller type, direct driven by manufacturer's standard electric motor. Provide resilient mounting. Provide fan guard for horizontal discharge units.
- D. Discharge Air Control:
 - 1. Horizontal discharge: Horizontal, adjustable louvers.
- E. Steam Coil: Aluminum fins bonded to seamless copper tubing by mechanical expansion of the tubing, designed for 517 kPa (75 psig) steam working pressure.
- F. Controls: As shown on drawings.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Work shall be installed as shown and according to the manufacturer's diagrams and recommendations.
- B. Handle and install units in accordance with manufacturer's written instructions.
- C. Support units rigidly so they remain stationary at all times. Cross-bracing or other means of stiffening shall be provided as necessary. Method of support shall be such that distortion and malfunction of units cannot occur.

3.2 OPERATIONAL TEST

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

3.3 STARTUP AND TESTING

- A. The Commissioning Agent will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the COTR and Commissioning Agent. Provide a minimum of 7 days prior notice.

3.4 COMMISSIONING

- A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00 – COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 23 08 00 – COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

3.5 DEMONSTRATION AND TRAINING

- A. Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.
- B. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00 – COMMISSIONING OF HVAC SYSTEMS.

--- E N D ---

**SECTION 26 05 11
REQUIREMENTS FOR ELECTRICAL INSTALLATIONS****PART 1 - GENERAL****1.1 DESCRIPTION**

- A. This section applies to all sections of Division 26.
- B. Furnish and install electrical systems, materials, equipment, and accessories in accordance with the specifications and drawings. Capacities and ratings of motors, transformers, conductors and cable, switchboards, panelboards, motor control centers, automatic transfer switches, and other items and arrangements for the specified items are shown on the drawings.
- C. Conductor ampacities specified or shown on the drawings are based on copper conductors, with the conduit and raceways sized per NEC. Aluminum conductors are prohibited.

1.2 MINIMUM REQUIREMENTS

- A. The International Building Code (IBC), National Electrical Code (NEC), Underwriters Laboratories, Inc. (UL), and National Fire Protection Association (NFPA) codes and standards are the minimum requirements for materials and installation.
- B. The drawings and specifications shall govern in those instances where requirements are greater than those stated in the above codes and standards.

1.3 TEST STANDARDS

- A. All materials and equipment shall be listed, labeled, or certified by a Nationally Recognized Testing Laboratory (NRTL) to meet Underwriters Laboratories, Inc. (UL), standards where test standards have been established. Materials and equipment which are not covered by UL standards will be accepted, providing that materials and equipment are listed, labeled, certified or otherwise determined to meet the safety requirements of a NRTL. Materials and equipment which no NRTL accepts, certifies, lists, labels, or determines to be safe, will be considered if inspected or tested in accordance with national industrial standards, such as ANSI, NEMA, and NETA. Evidence of compliance shall include certified test reports and definitive shop drawings.
- B. Definitions:
 - 1. Listed: Materials and equipment included in a list published by an organization that is acceptable to the Authority Having Jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production or listed materials and equipment or periodic evaluation of services, and whose listing states that the materials and equipment either meets appropriate designated standards or has been tested and found suitable for a specified purpose.
 - 2. Labeled: Materials and equipment to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the Authority Having Jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled

materials and equipment, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

3. Certified: Materials and equipment which:
 - a. Have been tested and found by a NRTL to meet nationally recognized standards or to be safe for use in a specified manner.
 - b. Are periodically inspected by a NRTL.
 - c. Bear a label, tag, or other record of certification.
4. Nationally Recognized Testing Laboratory: Testing laboratory which is recognized and approved by the Secretary of Labor in accordance with OSHA regulations.

1.4 QUALIFICATIONS (PRODUCTS AND SERVICES)

- A. Manufacturer's Qualifications: The manufacturer shall regularly and currently produce, as one of the manufacturer's principal products, the materials and equipment specified for this project, and shall have manufactured the materials and equipment for at least three years.
- B. Product Qualification:
 1. Manufacturer's materials and equipment shall have been in satisfactory operation, on three installations of similar size and type as this project, for at least three years.
 2. The Government reserves the right to require the Contractor to submit a list of installations where the materials and equipment have been in operation before approval.

1.5 APPLICABLE PUBLICATIONS

- A. Applicable publications listed in all Sections of Division 26 are the latest issue, unless otherwise noted.
- B. Products specified in all sections of Division 26 shall comply with the applicable publications listed in each section.

1.6 MANUFACTURED PRODUCTS

- A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, and for which replacement parts shall be available.
- B. When more than one unit of the same class or type of materials and equipment is required, such units shall be the product of a single manufacturer.
- C. Equipment Assemblies and Components:
 1. Components of an assembled unit need not be products of the same manufacturer.
 2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
 3. Components shall be compatible with each other and with the total assembly for the intended service.
 4. Constituent parts which are similar shall be the product of a single manufacturer.
- D. Factory wiring and terminals shall be identified on the equipment being furnished and on all wiring diagrams.

1.7 VARIATIONS FROM CONTRACT REQUIREMENTS

- A. Where the Government or the Contractor requests variations from the contract requirements, the connecting work and related components shall include, but not be limited to additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.

1.8 MATERIALS AND EQUIPMENT PROTECTION

- A. Materials and equipment shall be protected during shipment and storage against physical damage, vermin, dirt, corrosive substances, fumes, moisture, cold and rain.
 - 1. Store materials and equipment indoors in clean dry space with uniform temperature to prevent condensation.
 - 2. During installation, equipment shall be protected against entry of foreign matter, and be vacuum-cleaned both inside and outside before testing and operating. Compressed air shall not be used to clean equipment. Remove loose packing and flammable materials from inside equipment.
 - 3. Damaged equipment shall be repaired or replaced, as determined by the COTR.
 - 4. Painted surfaces shall be protected with factory installed removable heavy kraft paper, sheet vinyl or equal.
 - 5. Damaged paint on equipment shall be refinished with the same quality of paint and workmanship as used by the manufacturer so repaired areas are not obvious.

1.9 WORK PERFORMANCE

- A. All electrical work shall comply with the requirements of NFPA 70 (NEC), NFPA 70B, NFPA 70E, OSHA Part 1910 subpart J – General Environmental Controls, OSHA Part 1910 subpart K – Medical and First Aid, and OSHA Part 1910 subpart S – Electrical, in addition to other references required by contract.
- B. Job site safety and worker safety is the responsibility of the Contractor.
- C. Electrical work shall be accomplished with all affected circuits or equipment de-energized. When an electrical outage cannot be accomplished in this manner for the required work, the following requirements are mandatory:
 - 1. Electricians must use full protective equipment (i.e., certified and tested insulating material to cover exposed energized electrical components, certified and tested insulated tools, etc.) while working on energized systems in accordance with NFPA 70E.
 - 2. Before initiating any work, a job specific work plan must be developed by the Contractor with a peer review conducted and documented by the COTR and Medical Center staff. The work plan must include procedures to be used on and near the live electrical equipment, barriers to be installed, safety equipment to be used, and exit pathways.
 - 3. Work on energized circuits or equipment cannot begin until prior written approval is obtained from the COTR.

- D. For work that affects existing electrical systems, arrange, phase and perform work to assure minimal interference with normal functioning of the facility. Refer to Article OPERATIONS AND STORAGE AREAS under Section 01 00 00, GENERAL REQUIREMENTS.
- E. New work shall be installed and connected to existing work neatly, safely and professionally. Disturbed or damaged work shall be replaced or repaired to its prior conditions, as required by Section 01 00 00, GENERAL REQUIREMENTS.
- F. Coordinate location of equipment and conduit with other trades to minimize interference.

1.10 EQUIPMENT INSTALLATION AND REQUIREMENTS

- A. Equipment location shall be as close as practical to locations shown on the drawings.
- B. Working clearances shall not be less than specified in the NEC.
- C. Inaccessible Equipment:
 - 1. Where the Government determines that the Contractor has installed equipment not readily accessible for operation and maintenance, the equipment shall be removed and reinstalled as directed at no additional cost to the Government.
 - 2. "Readily accessible" is defined as being capable of being reached quickly for operation, maintenance, or inspections without the use of ladders, or without climbing or crawling under or over obstacles such as, but not limited to, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.

1.11 EQUIPMENT IDENTIFICATION

- A. In addition to the requirements of the NEC, install an identification sign which clearly indicates information required for use and maintenance of items such as switchboards and switchgear, panelboards, cabinets, motor controllers, fused and non-fused safety switches, automatic transfer switches, separately enclosed circuit breakers, individual breakers and controllers in switchboards, switchgear and motor control assemblies, control devices and other significant equipment.
- B. Identification signs for Normal Power System equipment shall be laminated black phenolic resin with a white core with engraved lettering. Identification signs for Essential Electrical System (EES) equipment, as defined in the NEC, shall be laminated red phenolic resin with a white core with engraved lettering. Lettering shall be a minimum of 12 mm (1/2 inch) high. Identification signs shall indicate equipment designation, rated bus amperage, voltage, number of phases, number of wires, and type of EES power branch as applicable. Secure nameplates with screws.
- C. Install adhesive arc flash warning labels on all equipment as required by NFPA 70E. Label shall indicate the arc hazard boundary (inches), working distance (inches), arc flash incident energy at the working distance (calories/cm²), required PPE category and description including the glove rating, voltage rating of the equipment, limited approach distance (inches), restricted approach distance (inches), prohibited approach distance (inches), equipment/bus name, date prepared, and manufacturer name and address.

1.12 SUBMITTALS

- A. Submit to the COTR in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. The Government's approval shall be obtained for all materials and equipment before delivery to the job site. Delivery, storage or installation of materials and equipment which has not had prior approval will not be permitted.
- C. All submittals shall include six copies of adequate descriptive literature, catalog cuts, shop drawings, test reports, certifications, samples, and other data necessary for the Government to ascertain that the proposed materials and equipment comply with drawing and specification requirements. Catalog cuts submitted for approval shall be legible and clearly identify specific materials and equipment being submitted.
- D. Submittals for individual systems and equipment assemblies which consist of more than one item or component shall be made for the system or assembly as a whole. Partial submittals will not be considered for approval.
 - 1. Mark the submittals, "SUBMITTED UNDER SECTION _____".
 - 2. Submittals shall be marked to show specification reference including the section and paragraph numbers.
 - 3. Submit each section separately.
- E. The submittals shall include the following:
 - 1. Information that confirms compliance with contract requirements. Include the manufacturer's name, model or catalog numbers, catalog information, technical data sheets, shop drawings, manuals, pictures, nameplate data, and test reports as required.
 - 2. Elementary and interconnection wiring diagrams for communication and signal systems, control systems, and equipment assemblies. All terminal points and wiring shall be identified on wiring diagrams.
 - 3. Parts list which shall include information for replacement parts and ordering instructions, as recommended by the equipment manufacturer.
- F. Maintenance and Operation Manuals:
 - 1. Submit as required for systems and equipment specified in the technical sections. Furnish in hardcover binders or an approved equivalent.
 - 2. Inscribe the following identification on the cover: the words "MAINTENANCE AND OPERATION MANUAL," the name and location of the system, material, equipment, building, name of Contractor, and contract name and number. Include in the manual the names, addresses, and telephone numbers of each subcontractor installing the system or equipment and the local representatives for the material or equipment.
 - 3. Provide a table of contents and assemble the manual to conform to the table of contents, with tab sheets placed before instructions covering the subject. The instructions shall be legible and easily read, with large sheets of drawings folded in.

4. The manuals shall include:
 - a. Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of the equipment.
 - b. A control sequence describing start-up, operation, and shutdown.
 - c. Description of the function of each principal item of equipment.
 - d. Installation instructions.
 - e. Safety precautions for operation and maintenance.
 - f. Diagrams and illustrations.
 - g. Periodic maintenance and testing procedures and frequencies, including replacement parts numbers.
 - h. Performance data.
 - i. Pictorial "exploded" parts list with part numbers. Emphasis shall be placed on the use of special tools and instruments. The list shall indicate sources of supply, recommended spare and replacement parts, and name of servicing organization.
 - j. List of factory approved or qualified permanent servicing organizations for equipment repair and periodic testing and maintenance, including addresses and factory certification qualifications.
- G. Approvals will be based on complete submission of shop drawings, manuals, test reports, certifications, and samples as applicable.

1.13 SINGULAR NUMBER

- A. Where any device or part of equipment is referred to in these specifications in the singular number (e.g., "the switch"), this reference shall be deemed to apply to as many such devices as are required to complete the installation as shown on the drawings.

1.14 ACCEPTANCE CHECKS AND TESTS

- A. The Contractor shall furnish the instruments, materials, and labor for tests.
- B. Where systems are comprised of components specified in more than one section of Division 26, the Contractor shall coordinate the installation, testing, and adjustment of all components between various manufacturer's representatives and technicians so that a complete, functional, and operational system is delivered to the Government.
- C. When test results indicate any defects, the Contractor shall repair or replace the defective materials or equipment, and repeat the tests. Repair, replacement, and retesting shall be accomplished at no additional cost to the Government.

1.15 WARRANTY

- A. All work performed and all equipment and material furnished under this Division shall be free from defects and shall remain so for a period of one year from the date of acceptance of the entire installation by the Contracting Officer for the Government.

1.16 INSTRUCTION

- A. Instruction to designated Government personnel shall be provided for the particular equipment or system as required in each associated technical specification section.
- B. Furnish the services of competent instructors to give full instruction in the adjustment, operation, and maintenance of the specified equipment and system, including pertinent safety requirements. Instructors shall be thoroughly familiar with all aspects of the installation, and shall be trained in operating theory as well as practical operation and maintenance procedures.
- C. A training schedule shall be developed and submitted by the Contractor and approved by the COTR at least 30 days prior to the planned training.

1.17 DRAWINGS AND SPECIFICATIONS

- A. The drawings indicate the general arrangement of the work and are to be followed insofar as possible. The word "provide", as used, shall mean "furnish and install". If significant deviations from the layout are necessitated by field conditions, detailed layouts of the proposed departures shall be submitted to the COTR for approval before proceeding with the work.
- B. Make all necessary field measurements to ensure correct fitting. Coordinate work with all other trades in such a manner as to cause a minimum of conflict or delay.
- C. The drawings and specifications shall be carefully studied during the course of bidding and construction. Any errors, omissions or discrepancies encountered shall be referred immediately to the COTR for interpretation or correction, so that misunderstandings at a later date may be avoided. The contract drawings are not intended to show every vertical or horizontal offset which may be necessary to complete the systems. Having bus duct, wireways and fittings fabricated and delivered in advance of making actual measurements shall not be sufficient cause to avoid making offsets and minor changes as may be necessary to install bus duct, wireways, fittings and equipment.
- D. The COTR shall reserve the right to make minor adjustment in locations of system runs and components where he considers such adjustments desirable in the interest of protecting and concealing work or presenting a better appearance where exposed. Any such changes shall be anticipated and requested sufficiently in advance as to not cause extra work, or unduly delay the work. Coordinate work in advance with all other trades and report immediately any difficulties which can be anticipated.
- E. Equipment, ductwork and piping shall not be installed in the dedicated electrical space above or in the working space required around electrical switchgear, motor control centers or panelboards as identified by NEC 110.26 Spaces About Electrical Equipment – 600 Volts Nominal or Less. For equipment rated over 600 volts nominal – 110.32 Work Space About Equipment – 110.33 Entrance and Access to Work Space – 110.34 Work Space and Guarding. The Electrical Contractor shall caution other trades to comply with this stipulation.

- F. Where any system runs and components are so placed as to cause or contribute to a conflict, it shall be readjusted at the expense of the contractor causing such conflict. The COTR's decision shall be final in regard to the arrangement of bus duct, conduit, etc., where conflict arises.
- G. Provide offsets in system runs, additional fittings, necessary conduit, pull boxes, conductors, switches and devices required to complete the installation, or for the proper operation of the system. Each Contractor shall exercise due and particular caution to determine that all parts of the work are made quickly and easily accessible.
- H. Should overlap of work among the trades become evident, this shall be called to the attention of the COTR. In such event, none of the trades or their suppliers shall assume that he is relieved of the work which is specified under his branch until instructions in writing are received from the COTR.

1.18 RECORD DRAWINGS

- A. The Electrical Contractor shall maintain a separate set of prints of the contract documents and shall show all changes or variations, in a manner to be clearly discernible, which are made during construction. Upon completion of the work, these drawings shall be turned over to the Architect. This shall apply particularly to underground and concealed work, and to other systems where the installation varies to a degree which would justify recording the change.

1.19 FINAL INSPECTION AND PUNCH LIST

- A. As the time of work completion approaches, the Contractor shall survey and inspect his work and develop his own punch list to confirm that it is complete and finished. He shall then notify the COTR and request that a final inspection be made. It shall not be considered the COTR's obligation to perform a final inspection until the Contractor has inspected the work and so states at the time of the request for the final inspection.
- B. Requests to the COTR for final inspection may be accompanied by a limited list of known deficiencies in completion, with appropriate explanation and schedule for completing these; this is in the interest of expediting acceptance for beneficial occupancy.
- C. The Architect and/or Engineer will inspect the work and prepare a punch list of items requiring correction, completion or verification. Corrective action shall be taken by the Contractor to the satisfaction of Architect and Engineer within 30 days of receipt of the Architect/Engineer's punch list.

1.20 REMOVALS

- A. Remove ALL existing work which will be superfluous when the new system is installed and made operational. Not all items that need to be removed are necessarily shown on the drawings. Void unused conduit behind walls or below floors as necessary or as directed. No wire or conduit shall be removed which will impair the functioning of the remaining work unless first replaced with a rerouted section of wire or conduit to ensure continuity. Remove inactive wiring back to the last active junction box, panelboard or piece of equipment.

- B. Upon completion, no unused conduit or stub shall extend thru floors, walls or ceilings in finished areas. Abandoned conduit where remaining in place shall have any unused wiring removed. All accessible unused conduit shall be removed.
- C. When it is necessary to reroute a section of an active circuit, the rerouted section shall be installed before removing the existing in order to minimize system down time. Rerouted sections shall be installed as required for new work.

PART 2 - PRODUCTS (NOT USED)**PART 3 - EXECUTION (NOT USED)**

---END---

SECTION 26 05 19
LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES**PART 1 - GENERAL****1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of the electrical conductors and cables for use in electrical systems rated 600 V and below, indicated as cable(s), conductor(s), wire, or wiring in this section.

1.2 RELATED WORK

- A. Section 07 84 00, FIRESTOPPING: Sealing around penetrations to maintain the integrity of fire-resistant rated construction.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits for conductors and cables.

1.3 QUALITY ASSURANCE

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 FACTORY TESTS

- A. Conductors and cables shall be thoroughly tested at the factory per NEMA to ensure that there are no electrical defects. Factory tests shall be certified.

1.5 SUBMITTALS

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
 - 1. Shop Drawings:
 - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
 - b. Submit the following data for approval:
 - 1) Electrical ratings and insulation type for each conductor and cable.
 - 2) Splicing materials and pulling lubricant.
 - 2. Certifications: Two weeks prior to final inspection, submit the following.
 - a. Certification by the manufacturer that the conductors and cables conform to the requirements of the drawings and specifications.
 - b. Certification by the Contractor that the conductors and cables have been properly installed, adjusted, and tested.

1.6 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are reference in the text by designation only.
- B. American Society of Testing Material (ASTM):
 - D2301-10.....Standard Specification for Vinyl Chloride Plastic Pressure-Sensitive Electrical Insulating Tape
 - D2304-10.....Test Method for Thermal Endurance of Rigid Electrical Insulating Materials
 - D3005-10.....Low-Temperature Resistant Vinyl Chloride Plastic Pressure-Sensitive Electrical Insulating Tape
- C. National Electrical Manufacturers Association (NEMA):
 - WC 70-09.....Power Cables Rated 2000 Volts or Less for the Distribution of Electrical Energy
- D. National Fire Protection Association (NFPA):
 - 70-11National Electrical Code (NEC)
- E. Underwriters Laboratories, Inc. (UL):
 - 44-10Thermoset-Insulated Wires and Cables
 - 83-08Thermoplastic-Insulated Wires and Cables
 - 467-07Grounding and Bonding Equipment
 - 486A-486B-03Wire Connectors
 - 486C-04.....Splicing Wire Connectors
 - 486D-05.....Sealed Wire Connector Systems
 - 486E-09.....Equipment Wiring Terminals for Use with Aluminum and/or Copper Conductors
 - 493-07Thermoplastic-Insulated Underground Feeder and Branch Circuit Cables
 - 514B-04.....Conduit, Tubing, and Cable Fittings

PART 2 - PRODUCTS**2.1 CONDUCTORS AND CABLES**

- A. Conductors and cables shall be in accordance with NEMA, UL, as specified herein, and as shown on the drawings.
- B. All conductors shall be copper.
- C. Single Conductor and Cable:
 - 1. No. 12 AWG: Minimum size, except where smaller sizes are specified herein or shown on the drawings.
 - 2. No. 12 AWG and larger: Stranded.

D. Color Code:

1. No. 10 AWG and smaller: Solid color insulation or solid color coating.
2. No. 8 AWG and larger: Color-coded using one of the following methods:
 - a. Solid color insulation or solid color coating.
 - b. Stripes, bands, or hash marks of color specified.
 - c. Color using 19 mm (0.75 inches) wide tape.
4. For modifications and additions to existing wiring systems, color coding shall conform to the existing wiring system.
5. Conductors shall be color-coded as follows:

| 208/120 V | Phase | 480/277 V |
|--|---------|-----------|
| Black | A | Brown |
| Red | B | Orange |
| Blue | C | Yellow |
| White | Neutral | Gray * |
| * or white with colored (other than green) tracer. | | |

2.2 SPLICES

- A. Splices shall be in accordance with NEC and UL.
- B. Above Ground Splices for No. 10 AWG and Smaller:
 1. Solderless, screw-on, reusable pressure cable type, with integral insulation, approved for copper and aluminum conductors.
 2. The integral insulator shall have a skirt to completely cover the stripped conductors.
 3. The number, size, and combination of conductors used with the connector, as listed on the manufacturer's packaging, shall be strictly followed.
- C. Above Ground Splices for No. 8 AWG to No. 4/0 AWG:
 1. Compression, hex screw, or bolt clamp-type of high conductivity and corrosion-resistant material, listed for use with copper and aluminum conductors.
 2. Insulate with materials approved for the particular use, location, voltage, and temperature. Insulation level shall be not less than the insulation level of the conductors being joined.
 3. Splice and insulation shall be product of the same manufacturer.
 4. All bolts, nuts, and washers used with splices shall be zinc-plated steel.
- D. Plastic electrical insulating tape: Per ASTM D2304, flame-retardant, cold and weather resistant.

2.3 CONNECTORS AND TERMINATIONS

- A. Mechanical type of high conductivity and corrosion-resistant material, listed for use with copper and aluminum conductors.
- B. Long barrel compression type of high conductivity and corrosion-resistant material, with minimum of two compression indents per wire, listed for use with copper and aluminum conductors.

- C. All bolts, nuts, and washers used to connect connections and terminations to bus bars or other termination points shall be zinc-plated steel.

2.4 CONTROL WIRING

- A. Unless otherwise specified elsewhere in these specifications, control wiring shall be as specified herein, except that the minimum size shall be not less than No. 14 AWG.
- B. Control wiring shall be sized such that the voltage drop under in-rush conditions does not adversely affect operation of the controls.

2.5 WIRE LUBRICATING COMPOUND

- A. Lubricating compound shall be suitable for the wire insulation and conduit, and shall not harden or become adhesive.
- B. Shall not be used on conductors for isolated power systems.

PART 3 - EXECUTION

3.1 GENERAL

- A. Install conductors in accordance with the NEC, as specified, and as shown on the drawings.
- B. Install all conductors in raceway systems.
- C. Splice conductors only in outlet boxes, junction boxes, pullboxes, manholes, or handholes.
- D. Conductors of different systems (e.g., 120 V and 277 V) shall not be installed in the same raceway.
- E. Install cable supports for all vertical feeders in accordance with the NEC. Provide split wedge type which firmly clamps each individual cable and tightens due to cable weight.
- F. In panelboards, cabinets, wireways, switches, enclosures, and equipment assemblies, neatly form, train, and tie the conductors with non-metallic ties.
- G. For connections to motors, transformers, and vibrating equipment, stranded conductors shall be used only from the last fixed point of connection to the motors, transformers, or vibrating equipment.
- H. Use expanding foam or non-hardening duct-seal to seal conduits entering a building, after installation of conductors.
- I. Conductor and Cable Pulling:
 - 1. Provide installation equipment that will prevent the cutting or abrasion of insulation during pulling. Use lubricants approved for the cable.
 - 2. Use nonmetallic pull ropes.
 - 3. Attach pull ropes by means of either woven basket grips or pulling eyes attached directly to the conductors.
 - 4. All conductors in a single conduit shall be pulled simultaneously.
 - 5. Do not exceed manufacturer's recommended maximum pulling tensions and sidewall pressure values.
- J. No more than three branch circuits shall be installed in any one conduit.

- K. When stripping stranded conductors, use a tool that does not damage the conductor or remove conductor strands.

3.2 SPLICE AND TERMINATION INSTALLATION

- A. Splices and terminations shall be mechanically and electrically secure, and tightened to manufacturer's published torque values using a torque screwdriver or wrench.
- B. Where the Government determines that unsatisfactory splices or terminations have been installed, replace the splices or terminations at no additional cost to the Government.

3.3 CONDUCTOR IDENTIFICATION

- A. When using colored tape to identify phase, neutral, and ground conductors larger than No. 8 AWG, apply tape in half-overlapping turns for a minimum of 75 mm (3 inches) from terminal points, and in junction boxes, pullboxes, and manholes. Apply the last two laps of tape with no tension to prevent possible unwinding. Where cable markings are covered by tape, apply tags to cable, stating size and insulation type.

3.4 FEEDER CONDUCTOR IDENTIFICATION

- A. In each interior pullbox and each underground manhole and handhole, install brass tags on all feeder conductors to clearly designate their circuit identification and voltage. The tags shall be the embossed type, 40 mm (1-1/2 inches) in diameter and 40 mils thick. Attach tags with plastic ties.

3.5 EXISTING CONDUCTORS

- A. Unless specifically indicated on the plans, existing conductors shall not be reused.

3.6 CONTROL WIRING INSTALLATION

- A. Unless otherwise specified in other sections, install control wiring and connect to equipment to perform the required functions as specified or as shown on the drawings.
- B. Install a separate power supply circuit for each system, except where otherwise shown on the drawings.

3.7 CONTROL WIRING IDENTIFICATION

- A. Install a permanent wire marker on each wire at each termination.
- B. Identifying numbers and letters on the wire markers shall correspond to those on the wiring diagrams used for installing the systems.
- C. Wire markers shall retain their markings after cleaning.

3.8 ACCEPTANCE CHECKS AND TESTS

- A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:
 - 1. Visual Inspection and Tests: Inspect physical condition.
 - 2. Electrical tests:
 - a. After installation but before connection to utilization devices, such as fixtures, motors, or appliances, test conductors phase-to-phase and phase-to-ground resistance with an insulation resistance tester. Existing conductors to be reused shall also be tested.

- b. Applied voltage shall be 500 V DC for 300 V rated cable, and 1000 V DC for 600 V rated cable. Apply test for one minute or until reading is constant for 15 seconds, whichever is longer. Minimum insulation resistance values shall not be less than 25 megohms for 300 V rated cable and 100 megohms for 600 V rated cable.
- c. Perform phase rotation test on all three-phase circuits.

---END---

SECTION 26 05 26
GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of grounding and bonding equipment, indicated as grounding equipment in this section.
- B. "Grounding electrode system" refers to grounding electrode conductors and all electrodes required or allowed by NEC, as well as made, supplementary, and lightning protection system grounding electrodes.
- C. The terms "connect" and "bond" are used interchangeably in this section and have the same meaning.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Low-voltage conductors.
- C. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit and boxes.
- D. Section 26 24 16, PANELBOARDS: Low-voltage panelboards.

1.3 QUALITY ASSURANCE

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
 - 1. Shop Drawings:
 - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
 - b. Submit plans showing the location of system grounding electrodes and connections, and the routing of aboveground and underground grounding electrode conductors.
 - 2. Test Reports:
 - a. Two weeks prior to the final inspection, submit ground resistance field test reports to the COTR.
 - 3. Certifications:
 - a. Certification by the Contractor that the grounding equipment has been properly installed and tested.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American Society for Testing and Materials (ASTM):
- B1-07 Standard Specification for Hard-Drawn Copper Wire
 - B3-07 Standard Specification for Soft or Annealed Copper Wire
 - B8-11 Standard Specification for Concentric-Lay-Stranded Copper
Conductors, Hard, Medium-Hard, or Soft
- C. Institute of Electrical and Electronics Engineers, Inc. (IEEE):
- 81-83 IEEE Guide for Measuring Earth Resistivity, Ground Impedance,
and Earth Surface Potentials of a Ground System Part 1: Normal
Measurements
- D. National Fire Protection Association (NFPA):
- 70-11 National Electrical Code (NEC)
 - 70E-12 National Electrical Safety Code
 - 99-12 Health Care Facilities
- E. Underwriters Laboratories, Inc. (UL):
- 44-10 Thermoset-Insulated Wires and Cables
 - 83-08 Thermoplastic-Insulated Wires and Cables
 - 467-07 Grounding and Bonding Equipment

PART 2 - PRODUCTS**2.1 GROUNDING AND BONDING CONDUCTORS**

- A. Equipment grounding conductors shall be insulated stranded copper, except that sizes No. 10 AWG and smaller shall be solid copper. Insulation color shall be continuous green for all equipment grounding conductors, except that wire sizes No. 4 AWG and larger shall be identified per NEC.
- B. Bonding conductors shall be bare stranded copper, except that sizes No. 10 AWG and smaller shall be bare solid copper. Bonding conductors shall be stranded for final connection to motors, transformers, and vibrating equipment.
- C. Conductor sizes shall not be less than shown on the drawings, or not less than required by the NEC, whichever is greater.
- D. Insulation: THHN-THWN and XHHW-2. XHHW-2 shall be used for isolated power systems.

PART 3 - EXECUTION**3.1 GENERAL**

- A. Install grounding equipment in accordance with the NEC, as shown on the drawings, and as specified herein.

- B. Equipment Grounding: Metallic piping, building structural steel, electrical enclosures, raceways, junction boxes, outlet boxes, cabinets, machine frames, and other conductive items in close proximity with electrical circuits, shall be bonded and grounded.

3.2 RACEWAY

- A. Conduit Systems:
 - 1. Ground all metallic conduit systems. All metallic conduit systems shall contain an equipment grounding conductor.
 - 2. Metallic conduit that only contains a grounding conductor, and is provided for its mechanical protection, shall be bonded to that conductor at the entrance and exit from the conduit.
 - 3. Metallic conduits which terminate without mechanical connection to an electrical equipment housing by means of locknut and bushings or adapters, shall be provided with grounding bushings. Connect bushings with an equipment grounding conductor to the equipment ground bus.
- B. Feeders and Branch Circuits: Install equipment grounding conductors with all feeders, and power and lighting branch circuits.
- C. Boxes, Cabinets, Enclosures, and Panelboards:
 - 1. Bond the equipment grounding conductor to each pullbox, junction box, outlet box, device box, cabinets, and other enclosures through which the conductor passes (except for special grounding systems for intensive care units and other critical units shown).
 - 2. Provide lugs in each box and enclosure for equipment grounding conductor termination.
- D. Fixed electrical appliances and equipment shall be provided with a ground lug for termination of the equipment grounding conductor.

3.3 CORROSION INHIBITORS

- A. When making grounding and bonding connections, apply a corrosion inhibitor to all contact surfaces. Use corrosion inhibitor appropriate for protecting a connection between the metals used.

---END---

SECTION 26 05 33
RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS**PART 1 - GENERAL****1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of conduit, fittings, and boxes, to form complete, coordinated, grounded raceway systems. Raceways are required for all wiring unless shown or specified otherwise.
- B. Definitions: The term conduit, as used in this specification, shall mean any or all of the raceway types specified.

1.2 RELATED WORK

- A. Section 07 84 00, FIRESTOPPING: Sealing around penetrations to maintain the integrity of fire rated construction.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:

- A. Manufacturer's Literature and Data: Showing each cable type and rating. The specific item proposed and its area of application shall be identified on the catalog cuts.
- B. Shop Drawings:
 - 1. Size and location of main feeders.
 - 2. Size and location of panels and pull-boxes.
 - 3. Layout of required conduit penetrations through structural elements.
- C. Certifications:
 - 1. Two weeks prior to the final inspection, submit four copies of the following certifications to the COTR:
 - a. Certification by the manufacturer that the material conforms to the requirements of the drawings and specifications.
 - b. Certification by the contractor that the material has been properly installed.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American National Standards Institute (ANSI):
 - C80.1-05.....Electrical Rigid Steel Conduit
 - C80.3-05.....Steel Electrical Metal Tubing
 - C80.6-05.....Electrical Intermediate Metal Conduit
- C. National Fire Protection Association (NFPA):
 - 70-11National Electrical Code (NEC)
- D. Underwriters Laboratories, Inc. (UL):
 - 1-05Flexible Metal Conduit
 - 5-04Surface Metal Raceway and Fittings
 - 6-07Electrical Rigid Metal Conduit - Steel
 - 50-95Enclosures for Electrical Equipment
 - 360-093Liquid-Tight Flexible Steel Conduit
 - 467-07Grounding and Bonding Equipment
 - 514A-04.....Metallic Outlet Boxes
 - 514B-04.....Conduit, Tubing, and Cable Fittings
 - 514C-96.....Nonmetallic Outlet Boxes, Flush-Device Boxes and Covers
 - 651-05Schedule 40 and 80 Rigid PVC Conduit and Fittings
 - 651A-00.....Type EB and A Rigid PVC Conduit and HDPE Conduit
 - 797-07Electrical Metallic Tubing
 - 1242-06Electrical Intermediate Metal Conduit - Steel
- E. National Electrical Manufacturers Association (NEMA):
 - TC-2-03Electrical Polyvinyl Chloride (PVC) Tubing and Conduit
 - TC-3-04PVC Fittings for Use with Rigid PVC Conduit and Tubing
 - FB1-07.....Fittings, Cast Metal Boxes and Conduit Bodies for Conduit,
Electrical Metallic Tubing and Cable

PART 2 - PRODUCTS**2.1 MATERIAL**

- A. Conduit Size: In accordance with the NEC, but not less than 0.75 in [13 mm] unless otherwise shown.
- B. Conduit:
 - 1. Rigid steel: Shall conform to UL 6 and ANSI C80.1.
 - 2. Rigid intermediate steel conduit (IMC): Shall conform to UL 1242 and ANSI C80.6.

3. Electrical metallic tubing (EMT): Shall conform to UL 797 and ANSI C80.3. Maximum size not to exceed 4 in [105 mm] and shall be permitted only with cable rated 600 V or less.
 4. Flexible galvanized steel conduit: Shall conform to UL 1.
 5. Liquid-tight flexible metal conduit: Shall conform to UL 360.
- C. Conduit Fittings:
1. Rigid steel and IMC conduit fittings:
 - a. Fittings shall meet the requirements of UL 514B and NEMA FB1.
 - b. Standard threaded couplings, locknuts, bushings, conduit bodies, and elbows: Only steel or malleable iron materials are acceptable. Integral retractable type IMC couplings are also acceptable.
 - c. Locknuts: Bonding type with sharp edges for digging into the metal wall of an enclosure.
 - d. Bushings: Metallic insulating type, consisting of an insulating insert, molded or locked into the metallic body of the fitting. Bushings made entirely of metal or nonmetallic material are not permitted.
 - e. Erickson (union-type) and set screw type couplings: Approved for use in concrete are permitted for use to complete a conduit run where conduit is installed in concrete. Use set screws of case-hardened steel with hex head and cup point to firmly seat in conduit wall for positive ground. Tightening of set screws with pliers is prohibited.
 - f. Sealing fittings: Threaded cast iron type. Use continuous drain-type sealing fittings to prevent passage of water vapor. In concealed work, install fittings in flush steel boxes with blank cover plates having the same finishes as that of other electrical plates in the room.
 2. Electrical metallic tubing fittings:
 - a. Fittings and conduit bodies shall meet the requirements of UL 514B, ANSI C80.3, and NEMA FB1.
 - b. Only steel or malleable iron materials are acceptable.
 - c. Compression couplings and connectors: Concrete-tight and rain-tight, with connectors having insulated throats for conduit 2" and smaller.
 - d. Setscrew couplings and connectors: Use setscrews of case-hardened steel with hex head and cup point, to firmly seat in wall of conduit for positive grounding for conduit over 2".
 - e. Indent-type connectors or couplings are prohibited.
 - f. Die-cast or pressure-cast zinc-alloy fittings or fittings made of "pot metal" are prohibited.
 3. Flexible steel conduit fittings:
 - a. Conform to UL 514B. Only steel or malleable iron materials are acceptable.
 - b. Clamp-type, with insulated throat.
 4. Liquid-tight flexible metal conduit fittings:
 - a. Fittings shall meet the requirements of UL 514B and NEMA FB1.
 - b. Only steel or malleable iron materials are acceptable.

- c. Fittings must incorporate a threaded grounding cone, a steel or plastic compression ring, and a gland for tightening. Connectors shall have insulated throats.
- 5. Expansion and deflection couplings:
 - a. Conform to UL 467 and UL 514B.
 - b. Accommodate a 0.75 in [19 mm] deflection, expansion, or contraction in any direction, and allow 30 degree angular deflections.
 - c. Include internal flexible metal braid, sized to guarantee conduit ground continuity and a low-impedance path for fault currents, in accordance with UL 467 and the NEC tables for equipment grounding conductors.
 - d. Jacket: Flexible, corrosion-resistant, watertight, moisture and heat-resistant molded rubber material with stainless steel jacket clamps.
- D. Conduit Supports:
 - 1. Parts and hardware: Zinc-coat or provide equivalent corrosion protection.
 - 2. Individual Conduit Hangers: Designed for the purpose, having a pre-assembled closure bolt and nut, and provisions for receiving a hanger rod.
 - 3. Multiple conduit (trapeze) hangers: Not less than 1.5 x 1.5 in [38 mm x 38 mm], 12-gauge steel, cold-formed, lipped channels; with not less than 0.375 in [9 mm] diameter steel hanger rods.
 - 4. Solid Masonry and Concrete Anchors: Self-drilling expansion shields, or machine bolt expansion.
- E. Outlet, Junction, and Pull Boxes:
 - 1. UL-50 and UL-514A.
 - 2. Cast metal where required by the NEC or shown, and equipped with rustproof boxes.
 - 3. Sheet metal boxes: Galvanized steel, except where otherwise shown.

PART 3 - EXECUTION

3.1 PENETRATIONS

- A. Cutting or Holes:
 - 1. Cut holes in advance where they should be placed in the structural elements, such as ribs or beams. Obtain the approval of the COTR prior to drilling through structural elements.
 - 2. Cut holes through concrete and masonry in new and existing structures with a diamond core drill or concrete saw. Pneumatic hammers, impact electric, hand, or manual hammer-type drills are not allowed, except where permitted by the COTR as required by limited working space.
- B. Firestop: Where conduits, wireways, and other electrical raceways pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING.

3.2 INSTALLATION, GENERAL

- A. In accordance with UL, NEC, as shown, and as specified herein.
- B. Essential (Emergency) raceway systems shall be entirely independent of other raceway systems, except where shown on drawings.
- C. Install conduit as follows:
 - 1. In complete mechanically and electrically continuous runs before pulling in cables or wires.
 - 2. Unless otherwise indicated on the drawings or specified herein, installation of all conduits shall be concealed within finished walls, floors, and ceilings.
 - 3. Flattened, dented, or deformed conduit is not permitted. Remove and replace the damaged conduits with new undamaged material.
 - 4. Assure conduit installation does not encroach into the ceiling height head room, walkways, or doorways.
 - 5. Cut square, ream, remove burrs, and draw up tight.
 - 6. Independently support conduit at 8 ft [2.4 M] on centers. Do not use other supports, i.e., suspended ceilings, suspended ceiling supporting members, lighting fixtures, conduits, mechanical piping, or mechanical ducts.
 - 7. Support within 12 in [300 mm] of changes of direction, and within 12 in [300 mm] of each enclosure to which connected.
 - 8. Close ends of empty conduit with plugs or caps at the rough-in stage until wires are pulled in, to prevent entry of debris.
 - 9. Conduit installations under fume and vent hoods are prohibited.
 - 10. Secure conduits to cabinets, junction boxes, pull-boxes, and outlet boxes with bonding type locknuts. For rigid and IMC conduit installations, provide a locknut on the inside of the enclosure, made up wrench tight. Do not make conduit connections to junction box covers.
 - 11. Conduit bodies shall only be used for changes in direction, and shall not contain splices.
- D. Conduit Bends:
 - 1. Make bends with standard conduit bending machines.
 - 2. Conduit hickey may be used for slight offsets and for straightening stubbed out conduits.
 - 3. Bending of conduits with a pipe tee or vise is prohibited.
- E. Layout and Homeruns:
 - 1. Install conduit with wiring, including homeruns, as shown on drawings.
 - 2. Deviations: Make only where necessary to avoid interferences and only after drawings showing the proposed deviations have been submitted approved by the COTR.
- F. Conduit shall be run concealed in all finished areas of new construction and elsewhere unless specifically indicated or upon specific permission by the COTR. All conduit shall parallel building lines.
- G. Conduit shall be run overhead and shall not be run below concrete slabs unless specifically indicated on the drawings and in the legend on the drawings.

- H. Contractor shall record carefully on a set of "as built" prints the exact location of all feeder conduits.
- I. Unless noted otherwise on the drawings, a maximum of 8 conductors shall be installed in a branch circuit conduit. This maximum is a count of all phase and neutral conductors only - ground conductors are not counted when determining maximum fill for this purpose.

3.3 CONCEALED WORK INSTALLATION

- A. Above Furred or Suspended Ceilings and in Walls:
 - 1. Conduit for conductors 600 V and below: Rigid steel, IMC, or EMT. Mixing different types of conduits indiscriminately in the same system is prohibited.
 - 2. Align and run conduit parallel or perpendicular to the building lines.
 - 3. Connect recessed lighting fixtures to conduit runs with maximum 6 ft [1.8 M] of flexible metal conduit extending from a junction box to the fixture.
 - 4. Tightening setscrews with pliers is prohibited.

3.4 EXPOSED WORK INSTALLATION

- A. Unless otherwise indicated on the drawings, exposed conduit is only permitted in mechanical and electrical rooms.
- B. Conduit for Conductors 600 V and Below: Rigid steel, IMC, or EMT. Mixing different types of conduits indiscriminately in the system is prohibited.
- C. Align and run conduit parallel or perpendicular to the building lines.
- D. Install horizontal runs close to the ceiling or beams and secure with conduit straps.
- E. Support horizontal or vertical runs at not over 8 ft [2.4 M] intervals.
- F. Surface metal raceways: Use only where shown.

3.5 MOTORS AND VIBRATING EQUIPMENT

- A. Use flexible metal conduit for connections to motors and other electrical equipment subject to movement, vibration, misalignment, cramped quarters, or noise transmission.
- B. Use liquid-tight flexible metal conduit for installation in exterior locations, moisture or humidity laden atmosphere, corrosive atmosphere, water or spray wash-down operations, inside airstream of HVAC units, and locations subject to seepage or dripping of oil, grease, or water. Provide a green equipment grounding conductor with flexible metal conduit.

3.6 EXPANSION JOINTS

- A. Conduits 3 in [75 mm] and larger that are secured to the building structure on opposite sides of a building expansion joint require expansion and deflection couplings. Install the couplings in accordance with the manufacturer's recommendations.
- B. Provide conduits smaller than 3 in [75 mm] with junction boxes on both sides of the expansion joint. Connect conduits to junction boxes with sufficient slack of flexible conduit to produce 5 in [125 mm] vertical drop midway between the ends. Flexible conduit shall have a bonding jumper

installed. In lieu of this flexible conduit, expansion and deflection couplings as specified above for conduits 15 in [375 mm] and larger are acceptable.

- C. Install expansion and deflection couplings where shown.

3.7 CONDUIT SUPPORTS, INSTALLATION

- A. Safe working load shall not exceed one-quarter of proof test load of fastening devices.
- B. Use pipe straps or individual conduit hangers for supporting individual conduits.
- C. Support multiple conduit runs with trapeze hangers. Use trapeze hangers that are designed to support a load equal to or greater than the sum of the weights of the conduits, wires, hanger itself, and 200 lbs [90 kg]. Attach each conduit with U-bolts or other approved fasteners.
- D. Support conduit independently of junction boxes, pull-boxes, fixtures, suspended ceiling T-bars, angle supports, and similar items.
- E. Fasteners and Supports in Solid Masonry and Concrete:
 - 1. New Construction: Use steel or malleable iron concrete inserts set in place prior to placing the concrete.
 - 2. Existing Construction:
 - a. Steel expansion anchors not less than 0.25 in [6 mm] bolt size and not less than 1.125 in [28 mm] embedment.
 - b. Power set fasteners not less than 0.25 in [6 mm] diameter with depth of penetration not less than 3 in [75 mm].
 - c. Use vibration and shock-resistant anchors and fasteners for attaching to concrete ceilings.
- E. Hollow Masonry: Toggle bolts.
- F. Bolts supported only by plaster or gypsum wallboard are not acceptable.
- G. Metal Structures: Use machine screw fasteners or other devices specifically designed and approved for the application.
- H. Attachment by wood plugs, rawl plug, plastic, lead or soft metal anchors, or wood blocking and bolts supported only by plaster is prohibited.
- I. Chain, wire, or perforated strap shall not be used to support or fasten conduit.
- J. Spring steel type supports or fasteners are prohibited for all uses except horizontal and vertical supports/fasteners within walls.

3.8 BOX INSTALLATION

- A. Boxes for Concealed Conduits:
 - 1. Flush-mounted.
 - 2. Provide raised covers for boxes to suit the wall or ceiling, construction, and finish.
- B. In addition to boxes shown, install additional boxes where needed to prevent damage to cables and wires during pulling-in operations.
- C. Remove only knockouts as required and plug unused openings. Use threaded plugs for cast metal boxes and snap-in metal covers for sheet metal boxes.

- D. Outlet boxes mounted back-to-back in the same wall are prohibited. A minimum 24 in [600 mm] center-to-center lateral spacing shall be maintained between boxes.
- E. Stencil or install phenolic nameplates on covers of the boxes identified on riser diagrams; for example "SIG-FA JB No. 1."
- F. On all branch circuit junction box covers, identify the circuits with black marker.

- - - E N D - - -

**SECTION 26 24 16
PANELBOARDS****PART 1 - GENERAL****1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of panelboards.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Low-voltage conductors.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits.

1.3 QUALITY ASSURANCE

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
1. Shop Drawings:
 - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
 - b. Include electrical ratings, dimensions, mounting details, materials, required clearances, terminations, weight, circuit breakers, wiring and connection diagrams, accessories, and nameplate data.
 2. Manuals:
 - a. Submit, simultaneously with the shop drawings, complete maintenance and operating manuals including technical data sheets, wiring diagrams, and information for ordering circuit breakers and replacement parts.
 - 1) Include schematic diagrams, with all terminals identified, matching terminal identification in the panelboards.
 - 2) Include information for testing, repair, troubleshooting, assembly, and disassembly.
 - b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
 3. Certifications: Two weeks prior to final inspection, submit the following.
 - a. Certification by the manufacturer that the panelboards conform to the requirements of the drawings and specifications.

- b. Certification by the Contractor that the panelboards have been properly installed, adjusted, and tested.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. International Code Council (ICC):
IBC-12 International Building Code
- C. National Electrical Manufacturers Association (NEMA):
PB 1-11 Panelboards
250-08 Enclosures for Electrical Equipment (1,000V Maximum)
- D. National Fire Protection Association (NFPA):
70-11 National Electrical Code (NEC)
70E-12 Standard for Electrical Safety in the Workplace
- E. Underwriters Laboratories, Inc. (UL):
50-95 Enclosures for Electrical Equipment
67-09 Panelboards
489-09 Molded Case Circuit Breakers and Circuit Breaker Enclosures

PART 2 - PRODUCTS

2.1 GENERAL REQUIREMENTS

- A. Panelboards shall be in accordance with NEC, NEMA, UL, as specified, and as shown on the drawings.
- B. Panelboards shall have main breaker or main lugs, bus size, voltage, phases, number of circuit breaker mounting spaces, top or bottom feed, flush or surface mounting, branch circuit breakers, and accessories as shown on the drawings.
- C. Panelboards shall be completely factory-assembled with molded case circuit breakers and integral accessories as shown on the drawings or specified herein.
- D. Non-reduced size copper bus bars, rigidly supported on molded insulators, and fabricated for bolt-on type circuit breakers.
- E. Bus bar connections to the branch circuit breakers shall be the "distributed phase" or "phase sequence" type.
- F. Mechanical lugs furnished with panelboards shall be cast, stamped, or machined metal alloys listed for use with the conductors to which they will be connected.
- G. Neutral bus shall be 100% rated, mounted on insulated supports.
- H. Grounding bus bar shall be equipped with screws or lugs for the connection of equipment grounding conductors.

- I. Bus bars shall be braced for the available short-circuit current as shown on the drawings, but not be less than 10,000 A symmetrical for 120/208 V and 120/240 V panelboards, and 14,000 A symmetrical for 277/480 V panelboards.
- J. In two-section panelboards, the main bus in each section shall be full size. The first section shall be furnished with subfeed lugs on the line side of main lugs only, or through-feed lugs for main breaker type panelboards, and have field-installed cable connections to the second section as shown on the drawings. Panelboard sections with tapped bus or crossover bus are not acceptable.
- K. Series-rated panelboards are not permitted.

2.2 ENCLOSURES AND TRIMS

- A. Enclosures:
 - 1. Provide galvanized steel enclosures, with NEMA rating as shown on the drawings or as required for the environmental conditions in which installed.
 - 2. Enclosures shall not have ventilating openings.
 - 3. Enclosures may be of one-piece formed steel or of formed sheet steel with end and side panels welded, riveted, or bolted as required.
 - 4. Provide manufacturer's standard option for prepunched knockouts on top and bottom endwalls.
 - 5. Include removable inner dead front cover, independent of the panelboard cover.
- B. Trims:
 - 1. Standard screw-on door trim.
 - 2. Trims shall be flush or surface type as shown on the drawings.

2.3 MOLDED CASE CIRCUIT BREAKERS

- A. Circuit breakers shall be per UL, NEC, as shown on the drawings, and as specified.
- B. Circuit breakers shall be bolt-on type.
- C. Circuit breakers shall have minimum interrupting rating as required to withstand the available fault current, but not less than:
 - 1. 120/208 V Panelboard: 10,000 A symmetrical.
 - 2. 120/240 V Panelboard: 10,000 A symmetrical.
 - 3. 277/480 V Panelboard: 14,000 A symmetrical.
- D. Circuit breakers shall have automatic, trip free, non-adjustable, inverse time, and instantaneous magnetic trips for less than 400 A frame.
- E. Circuit breaker features shall be as follows:
 - 1. A rugged, integral housing of molded insulating material.
 - 2. Silver alloy contacts.
 - 3. Arc quenchers and phase barriers for each pole.
 - 4. Quick-make, quick-break, operating mechanisms.

5. A trip element for each pole, thermal magnetic type with long time delay and instantaneous characteristics, a common trip bar for all poles and a single operator.
6. Electrically and mechanically trip free.
7. An operating handle which indicates closed, tripped, and open positions.
8. An overload on one pole of a multi-pole breaker shall automatically cause all the poles of the breaker to open.
9. For circuit breakers being added to existing panelboards, coordinate the breaker type with existing panelboards. Modify the panel directory accordingly.

2.4 SURGE PROTECTIVE DEVICES

- A. Where shown on the drawings, furnish panelboards with external surge protective devices. Refer to Section 26 43 13, SURGE PROTECTIVE DEVICES.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation shall be in accordance with the manufacturer's instructions, the NEC, as shown on the drawings, and as specified.
- B. Locate panelboards so that the present and future conduits can be conveniently connected.
- C. Install a printed schedule of circuits in each panelboard after approval by the COTR. Schedules shall reflect final load descriptions, room numbers, and room names connected to each circuit breaker. Schedules shall be printed on the panelboard directory cards and be installed in the appropriate panelboards
- D. Mount panelboards such that the maximum height of the top circuit breaker above the finished floor shall not exceed 1980 mm (78 inches).
- E. Provide blank cover for each unused circuit breaker mounting space.

3.2 ACCEPTANCE CHECKS AND TESTS

- A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:
 1. Visual Inspection and Tests:
 - a. Compare equipment nameplate data with specifications and approved shop drawings.
 - b. Inspect physical, electrical, and mechanical condition.
 - c. Verify appropriate anchorage and required area clearances.
 - d. Verify that circuit breaker sizes and types correspond to approved shop drawings.
 - e. To verify tightness of accessible bolted electrical connections, use the calibrated torque-wrench method or perform thermographic survey after energization.
 - f. Vacuum-clean enclosure interior. Clean enclosure exterior.

3.3 FOLLOW-UP VERIFICATION

- A. Upon completion of acceptance checks, settings, and tests, the Contractor shall demonstrate that the panelboards are in good operating condition and properly performing the intended function.

---END---

**SECTION 26 29 11
MOTOR CONTROLLERS****PART 1 - GENERAL****1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of motor controllers, including all low-voltage motor controllers and manual motor controllers, indicated as motor controllers in this section, and low-voltage variable speed motor controllers.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- B. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Low-voltage conductors.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits.

1.3 QUALITY ASSURANCE

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
 - 1. Shop Drawings:
 - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
 - b. Include electrical ratings, dimensions, weights, mounting details, materials, overcurrent protection devices, overload relays, sizes of enclosures, wiring diagrams, starting characteristics, interlocking, and accessories.
 - 2. Manuals:
 - a. Submit, simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals, including technical data sheets, wiring diagrams, and information for ordering replacement parts.
 - 1) Wiring diagrams shall have their terminals identified to facilitate installation, maintenance, and operation.
 - 2) Wiring diagrams shall indicate internal wiring for each item of equipment and interconnections between the items of equipment.
 - 3) Elementary schematic diagrams shall be provided for clarity of operation.
 - 4) Include the catalog numbers for the correct sizes of overload relays for the motor controllers.

- b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
- 3. Certifications: Two weeks prior to final inspection, submit the following.
 - a. Certification by the manufacturer that the motor controllers conform to the requirements of the drawings and specifications.
 - b. Certification by the Contractor that the motor controllers have been properly installed, adjusted, and tested.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.
- B. Institute of Electrical and Electronic Engineers (IEEE):
 - 519-92 Recommended Practices and Requirements for Harmonic Control in Electrical Power Systems
 - C37.90.1-02..... Standard Surge Withstand Capability (SWC) Tests for Relays and Relay Systems Associated with Electric Power Apparatus
- C. International Code Council (ICC):
 - IBC-12 International Building Code
- D. National Electrical Manufacturers Association (NEMA):
 - ICS 1-08 Industrial Control and Systems: General Requirements
 - ICS 1.1-09 Safety Guidelines for the Application, Installation and Maintenance of Solid State Control
 - ICS 2-05 Industrial Control and Systems Controllers, Contactors, and Overload Relays Rated 600 Volts
 - ICS 4-05 Industrial Control and Systems: Terminal Blocks
 - ICS 6-06 Industrial Control and Systems: Enclosures
 - ICS 7-06 Industrial Control and Systems: Adjustable-Speed Drives
 - ICS 7.1-06 Safety Standards for Construction and Guide for Selection, Installation, and Operation of Adjustable-Speed Drive Systems
 - MG 1 Part 31 Inverter Fed Polyphase Motor Standards
- E. National Fire Protection Association (NFPA):
 - 70-11 National Electrical Code (NEC)
- F. Underwriters Laboratories Inc. (UL):
 - 508A-07 Industrial Control Panels
 - 508C-07 Power Conversion Equipment
 - UL 1449-06..... Surge Protective Devices

PART 2 - PRODUCTS**2.1 MOTOR CONTROLLERS**

- A. Motor controllers shall comply with IEEE, NEMA, NFPA, UL, and as shown on the drawings.
- B. Motor controllers shall be separately enclosed, unless part of another assembly.
- C. Motor controllers shall be combination type, with magnetic controller per Paragraph 2.2 below and with disconnecting means, with external operating handle with lock-open padlocking positions and ON-OFF position indicator.
- D. Enclosures:
 - 1. Enclosures shall be NEMA-type rated 1, 3R, or 12 as indicated on the drawings or as required per the installed environment.
 - 2. Enclosure doors shall be interlocked to prevent opening unless the disconnecting means is open. A "defeater" mechanism shall allow for inspection by qualified personnel with the disconnect means closed. Provide padlocking provisions.
 - 3. All metal surfaces shall be thoroughly cleaned, phosphatized, and factory primed prior to applying light gray baked enamel finish.
- E. Motor control circuits:
 - 1. Shall operate at not more than 120 Volts.
 - 2. Shall be grounded, except where the equipment manufacturer recommends that the control circuits be isolated.
 - 3. For each motor operating over 120 Volts, incorporate a separate, heavy duty, control transformer within each motor controller enclosure.
 - 4. Incorporate primary and secondary overcurrent protection for the control power transformers.
- F. Overload relays:
 - 1. Thermal type. Devices shall be NEMA type.
 - 2. One for each pole.
 - 3. External overload relay reset pushbutton on the door of each motor controller enclosure.
 - 4. Overload relays shall be matched to nameplate full-load current of actual protected motor and with appropriate adjustment for duty cycle.
 - 5. Thermal overload relays shall be tamperproof, not affected by vibration, manual reset, sensitive to single-phasing, and shall have selectable trip classes of 10, 20 and 30.
- G. Hand-Off-Automatic (H-O-A) switch is required unless specifically stated on the drawings as not required for a particular controller. H-O-A switch shall be operable without opening enclosure door. H-O-A switch is not required for manual motor controllers.
- H. Incorporate into each control circuit a 120 Volt, electronic time-delay relay (ON delay), minimum adjustable range from 0.3 to 10 minutes, with transient protection. Time-delay relay is not required where H-O-A switch is not required.
- I. Unless noted otherwise, equip each motor controller with not less than two normally open (N.O.) and two normally closed (N.C.) auxiliary contacts.

- J. Provide green (RUN) and red (STOP) pilot lights.
- K. Motor controllers incorporated within equipment assemblies shall also be designed for the specific requirements of the assemblies.
- L. Additional requirements for specific motor controllers, as indicated in other specification sections, shall also apply.

2.2 MAGNETIC MOTOR CONTROLLERS

- A. Shall be in accordance with applicable requirements of 2.1 above.
- B. Controllers shall be general-purpose, Class A magnetic controllers for induction motors rated in horsepower. Minimum NEMA size 0.
- C. Where combination motor controllers are used, combine controller with protective or disconnect device in a common enclosure.
- D. Provide phase loss protection for each controller, with contacts to de-energize the controller upon loss of any phase.
- E. Unless otherwise indicated, provide full voltage non-reversing across-the-line mechanisms for motors less than 75 HP, closed by coil action and opened by gravity. Equip controllers with 120 VAC coils and individual control transformer unless otherwise noted.

2.3 LOW-VOLTAGE VARIABLE FREQUENCY DRIVES (VFD)

- A. VFD shall be in accordance with applicable portions of 2.1 above.
- B. VFD shall be electronic, with adjustable frequency and voltage, three phase output, capable of driving standard NEMA B three-phase induction motors at full rated speed. The control technique shall be pulse width modulation (PWM), where the VFD utilizes a full wave bridge design incorporating diode rectifier circuitry. Silicon controlled rectifiers or other control techniques are not acceptable.
- C. VFD shall be suitable for variable torque loads, and shall be capable of providing sufficient torque to allow the motor to break away from rest upon first application of power.
- D. VFD shall be capable of operating within voltage parameters of plus 10 to minus 15 percent of line voltage, and be suitably rated for the full load amps of the maximum watts (HP) within its class.
- E. Minimum efficiency shall be 95 percent at 100 percent speed and 85 percent at 50 percent speed.
- F. The displacement power factor of the VFD shall not be less than 95 percent under any speed or load condition.
- G. VFD current and voltage harmonic distortion shall not exceed the values allowed by IEEE 519.
- H. Operating and Design Conditions:
 - 1. Elevation: 1000 feet Above Mean Sea Level (AMSL)
 - 2. Temperatures: Maximum +90°F Minimum -10°F
 - 3. Relative Humidity: 95%
 - 4. VFD Location: Mechanical Spaces (non-air conditioned)
- I. VFD shall have the following features:
 - 1. Isolated power for control circuits.

2. Manually resettable overload protection for each phase.
3. Adjustable current limiting circuitry to provide soft motor starting. Maximum starting current shall not exceed 200 percent of motor full load current.
4. Independent acceleration and deceleration time adjustment, manually adjustable from 2 to 2000 seconds. Set timers to the equipment manufacturer's recommended time in the above range.
5. Control input circuitry that will accept 4 to 20 mA current or 0-10 VDC voltage control signals from an external source.
6. Automatic frequency adjustment from 1 Hz to 300 Hz.
7. Circuitry to initiate an orderly shutdown when any of the conditions listed below occur. The VFD shall not be damaged by any of these electrical disturbances and shall automatically restart when the conditions are corrected. The VFD shall be able to restart into a rotating motor operating in either the forward or reverse direction and matching that frequency.
 - a. Incorrect phase sequence.
 - b. Single phasing.
 - c. Overvoltage in excess of 10 percent.
 - d. Undervoltage in excess of 15 percent.
 - e. Running overcurrent above 110 percent (VFD shall not automatically reset for this condition.)
 - f. Instantaneous overcurrent above 150 percent (VFD shall not automatically reset for this condition).
 - g. Short duration power outages of 12 cycles or less (i.e., distribution line switching, generator testing, and automatic transfer switch operations.)
8. Automatic Reset/Restart: Attempt three restarts after VFD fault or on return of power after an interruption and before shutting down for manual reset or fault correction, with adjustable delay time between restart attempts.
9. Power-Interruption Protection: To prevent motor from re-energizing after a power interruption until motor has stopped, unless "Bidirectional Autospeed Search" feature is available and engaged.
10. Bidirectional Autospeed Search: Capable of starting VFD into rotating loads spinning in either direction and returning motor to set speed in proper direction, without causing damage to VFD, motor, or load.
- J. VFD shall include an input circuit breaker which will disconnect all input power, interlocked with the door so that the door cannot be opened with the circuit breaker in the closed position.
- K. VFD shall include a 5% line reactor and a RFI/EMI filter.
- L. Surge Suppression: Provide three-phase protection against damage from supply voltage surges in accordance with UL 1449.

- M. VFD shall include front-accessible operator station, with sealed keypad and digital display, which allows complete programming, operating, monitoring, and diagnostic capabilities.
1. Typical control functions shall include but not be limited to:
 - a. HAND-OFF-AUTOMATIC-RESET, with manual speed control in HAND mode.
 - b. NORMAL-BYPASS.
 - c. NORMAL-TEST, which allows testing and adjusting of the VFD while in bypass mode.
 2. Typical monitoring functions shall include but not be limited to:
 - a. Output frequency (Hz).
 - b. Motor speed and status (run, stop, fault).
 - c. Output voltage and current.
 3. Typical fault and alarm functions shall include but not be limited to:
 - a. Loss of input signal, under- and over-voltage, inverter overcurrent, motor overload, critical frequency rejection with selectable and adjustable deadbands, instantaneous line-to-line and line-to-ground overcurrent, loss-of-phase, reverse-phase, and short circuit.
 - b. System protection indicators indicating that the system has shutdown and will not automatically restart.
- N. VFD shall include two N.O. and two N.C. dry contacts rated 120 Volts, 10 amperes, 60 Hz.
- O. Hardware, software, network interfaces, gateways, and programming to control and monitor the VFD by control systems specified in other specification sections, including but not limited to Divisions 22 and 23.
- P. Network communications ports: As required for connectivity to control systems specified in other specification sections, including but not limited to Divisions 22 and 23.
- Q. Embedded BAS Protocols for Network Communications: Shall communicate exclusively using the ASHRAE Standard 135 BACnet communications protocol without the use of gateways, unless otherwise allowed by Section 23 09 23 of the technical specifications, specifically shown on the design drawings and specifically requested otherwise by the VA.
- a. If used, gateways shall support the ASHRAE Standard 135 BACnet communications protocol.
 - b. If used, gateways shall provide all object properties and read/write services shown on VA-approved interoperability schedules.
- R. Bypass controller: Provide contactor-style bypass, arranged to bypass the inverter.
1. Inverter Output Contactor and Bypass Contactor: Load-break IEC or NEMA-rated contactor.
 2. Motor overload relays.
 3. HAND-OFF-AUTOMATIC bypass control.
- S. Bypass operation: Transfers motor between inverter output and bypass circuit, manually, automatically, or both. VFD shall be capable of stable operation (starting, stopping, and running), and control by fire alarm and detection systems, with motor completely disconnected from the

inverter output. Transfer between inverter and bypass contactor and retransfer shall only be allowed with the motor at zero speed.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install motor controllers in accordance with the NEC, as shown on the drawings, and as recommended by the manufacturer.
- B. Install manual motor controllers in flush enclosures in finished areas.
- C. Set field-adjustable switches, auxiliary relays, time-delay relays, timers, and electronic overload relay pickup and trip ranges.
- D. Program variable speed motor controllers per the manufacturer's instructions and in coordination with other trades so that a complete and functional system is delivered.
- E. Adjust trip settings of circuit breakers and motor circuit protectors with adjustable instantaneous trip elements. Initially adjust at six times the motor nameplate full-load ampere ratings and attempt to start motors several times, allowing for motor cooldown between starts. If tripping occurs on motor inrush, adjust settings in increments until motors start without tripping. Do not exceed eight times the motor full-load amperes (or 11 times for NEMA Premium Efficiency motors if required). Where these maximum settings do not allow starting of a motor, notify COTR before increasing settings.

3.2 ACCEPTANCE CHECKS AND TESTS

- A. Perform manufacturer's required field tests in accordance with the manufacturer's recommendations. In addition, include the following:
 - 1. Visual Inspection and Tests:
 - a. Compare equipment nameplate data with specifications and approved shop drawings.
 - b. Inspect physical, electrical, and mechanical condition.
 - c. Verify appropriate anchorage, required area clearances, and correct alignment.
 - d. Verify that circuit breaker, motor circuit protector, and fuse sizes and types correspond to approved shop drawings.
 - e. Verify overload relay ratings are correct.
 - f. Vacuum-clean enclosure interior. Clean enclosure exterior.
 - g. Verify tightness of accessible bolted electrical connections by calibrated torque-wrench method in accordance with manufacturer's published data.
 - h. Test all control and safety features of the motor controllers.
 - i. For low-voltage variable speed motor controllers, final programming and connections shall be by a factory-trained technician. Set all programmable functions of the variable speed motor controllers to meet the requirements and conditions of use.

3.3 FOLLOW-UP VERIFICATION

- A. Upon completion of acceptance checks, settings, and tests, the Contractor shall show by demonstration in service that the motor controllers are in good operating condition and properly performing the intended functions.

3.4 SPARE PARTS

- A. Two weeks prior to the final inspection, provide one complete set of spare fuses for each motor controller.

3.5 INSTRUCTION

- A. Furnish the services of a factory-trained technician for two 4-hour training periods for instructing personnel in the maintenance and operation of the motor controllers, on the dates requested by the COTR.

---END---

SECTION 26 29 21
ENCLOSED SWITCHES AND CIRCUIT BREAKERS**PART 1 - GENERAL****1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of fused and unfused disconnect switches (indicated as switches in this section), and separately-enclosed circuit breakers for use in electrical systems rated 600 V and below.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Low-voltage conductors.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground faults.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits.
- E. Section 26 24 16, PANELBOARDS: Molded-case circuit breakers.

1.3 QUALITY ASSURANCE

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
 - 1. Shop Drawings:
 - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
 - b. Submit the following data for approval:
 - 1) Electrical ratings, dimensions, mounting details, materials, required clearances, terminations, weight, fuses, circuit breakers, wiring and connection diagrams, accessories, and device nameplate data.
 - 2. Manuals:
 - a. Submit complete maintenance and operating manuals including technical data sheets, wiring diagrams, and information for ordering fuses, circuit breakers, and replacement parts.
 - 1) Include schematic diagrams, with all terminals identified, matching terminal identification in the enclosed switches and circuit breakers.
 - 2) Include information for testing, repair, troubleshooting, assembly, and disassembly.

- b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
- 3. Certifications: Two weeks prior to final inspection, submit the following.
 - a. Certification by the manufacturer that the enclosed switches and circuit breakers conform to the requirements of the drawings and specifications.
 - b. Certification by the Contractor that the enclosed switches and circuit breakers have been properly installed, adjusted, and tested.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. International Code Council (ICC):
 - IBC-12 International Building Code
- C. National Electrical Manufacturers Association (NEMA):
 - FU I-07 Low Voltage Cartridge Fuses
 - KS I-06 Enclosed and Miscellaneous Distribution Equipment Switches
(600 Volts Maximum)
- D. National Fire Protection Association (NFPA):
 - 70-11 National Electrical Code (NEC)
- E. Underwriters Laboratories, Inc. (UL):
 - 98-07 Enclosed and Dead-Front Switches
 - 248-00 Low Voltage Fuses
 - 489-09 Molded Case Circuit Breakers and Circuit Breaker Enclosures

PART 2 - PRODUCTS

2.1 FUSED SWITCHES RATED 600 AMPERES AND LESS

- A. Switches shall be in accordance with NEMA, NEC, UL, as specified, and as shown on the drawings.
- B. Shall be NEMA classified General Duty (GD) for 240 V switches, and NEMA classified Heavy Duty (HD) for 480 V switches.
- C. Shall be horsepower (HP) rated.
- D. Shall have the following features:
 - 1. Switch mechanism shall be the quick-make, quick-break type.
 - 2. Copper blades, visible in the open position.
 - 3. An arc chute for each pole.
 - 4. External operating handle shall indicate open and closed positions, and have lock-open padlocking provisions.

5. Mechanical interlock shall permit opening of the door only when the switch is in the open position, defeatable to permit inspection.
6. Fuse holders for the sizes and types of fuses specified.
7. Solid neutral for each switch being installed in a circuit which includes a neutral conductor.
8. Ground lugs for each ground conductor.
9. Enclosures:
 - a. Shall be the NEMA types shown on the drawings.
 - b. Where the types of switch enclosures are not shown, they shall be the NEMA types most suitable for the ambient environmental conditions.
 - c. Shall be finished with manufacturer's standard gray baked enamel paint over pretreated steel.

2.2 UNFUSED SWITCHES RATED 600 AMPERES AND LESS

- A. Shall be the same as fused switches, but without provisions for fuses.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation shall be in accordance with the manufacturer's instructions, the NEC, as shown on the drawings, and as specified.

3.2 ACCEPTANCE CHECKS AND TESTS

- A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:
 1. Visual Inspection and Tests:
 - a. Compare equipment nameplate data with specifications and approved shop drawings.
 - b. Inspect physical, electrical, and mechanical condition.
 - c. Verify tightness of accessible bolted electrical connections by calibrated torque-wrench method.
 - d. Vacuum-clean enclosure interior. Clean enclosure exterior.

---END---

SECTION 26 43 13
SURGE PROTECTIVE DEVICES**PART 1 - GENERAL****1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of Type 2 Surge Protective Devices, as defined in NFPA 70, and indicated as transient voltage surge suppression or TVSS in this section.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- B. Section 26 24 16, PANELBOARDS: For factory-installed or external TVSS.

1.3 QUALITY ASSURANCE

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
 - 1. Shop Drawings:
 - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
 - b. Include electrical ratings and device nameplate data.
 - 2. Manuals:
 - a. Submit, simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals including technical data sheets, wiring diagrams, and information for ordering replacement parts.
 - b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
 - 3. Certifications: Two weeks prior to final inspection, submit the following.
 - a. Certification by the manufacturer that the TVSS conforms to the requirements of the drawings and specifications.
 - b. Certification by the Contractor that the TVSS has been properly installed.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplement and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. Institute of Engineering and Electronic Engineers (IEEE):

- IEEE C62.41.2-02 Recommended Practice on Characterization of Surges in Low-Voltage (1000 V and Less) AC Power Circuits
- IEEE C62.45-03 Recommended Practice on Surge Testing for Equipment Connected to Low-Voltage (1000 V and Less) AC Power Circuits

- C. National Fire Protection Association (NFPA):
- 70-11 National Electrical Code (NEC)
- D. Underwriters Laboratories, Inc. (UL):
- UL 1283-05..... Electromagnetic Interference Filters
- UL 1449-06..... Surge Protective Devices

PART 2 - PRODUCTS

2.1 PANELBOARD TVSS

- A. General Requirements:
1. Comply with UL 1449 and IEEE C62.41.2.
 2. Modular design with field-replaceable modules.
 3. Fuses, rated at 200 kA interrupting capacity.
 4. Bolted compression lugs for internal wiring.
 5. Integral disconnect switch.
 6. Redundant suppression circuits.
 7. LED indicator lights for power and protection status.
 8. Audible alarm, with silencing switch, to indicate when protection has failed.
 9. Form-C contacts rated at 5 A and 250-V ac, one normally open and one normally closed, for remote monitoring of protection status. Contacts shall reverse on failure of any surge diversion module or on opening of any current-limiting device.
 10. Four-digit transient-event counter.
- B. Surge Current per Phase: Minimum 120kA per phase.

2.3 ENCLOSURES

- A. Enclosures: NEMA 1.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Field-installed TVSS: Contractor shall install TVSS with conductors or buses between TVSS and points of attachment as short and straight as possible. Do not exceed manufacturer's recommended lead length. Do not bond neutral and ground.
1. Provide a circuit breaker as a dedicated disconnecting means for TVSS as shown on drawings.
- B. Do not perform insulation resistance tests on switchgear, switchboards, panelboards, or feeders with the TVSS connected. Disconnect TVSS before conducting insulation resistance tests, and reconnect TVSS immediately after insulation resistance tests are complete.

3.2 ACCEPTANCE CHECKS AND TESTS

- A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:
 - 1. Visual Inspection and Tests:
 - a. Compare equipment nameplate data with specifications and approved shop drawings.
 - b. Inspect physical, electrical, and mechanical condition.
 - c. Verify that disconnecting means and feeder size and maximum length to TVSS corresponds to approved shop drawings.
 - d. Verifying tightness of accessible bolted electrical connections by calibrated torque-wrench method.
 - e. Vacuum-clean enclosure interior. Clean enclosure exterior.
 - f. Verify the correct operation of all sensing devices, alarms, and indicating devices.

3.3 FOLLOW-UP VERIFICATION

- A. After completion of acceptance checks and tests, the Contractor shall show by demonstration in service that TVSS are in good operating condition and properly performing the intended function.

---END---

**SECTION 31 20 00
EARTHWORK****PART 1 - GENERAL****1.1 DESCRIPTION OF WORK:**

- A. This section specifies the requirements for furnishing all equipment, materials, labor, tools, and techniques for earthwork including, but not limited to, the following:
 - 1. Site preparation.
 - 2. Excavation.
 - 3. Underpinning.
 - 4. Filling and backfilling.
 - 5. Grading.
 - 6. Soil Disposal.
 - 7. Clean Up.

1.2 DEFINITIONS:

- A. Unsuitable Materials:
 - 1. Fills: Topsoil; frozen materials; construction materials and materials subject to decomposition; clods of clay and stones larger than 75 mm (3 inches); organic material, including silts, which are unstable; and inorganic materials, including silts, too wet to be stable and any material with a liquid limit and plasticity index exceeding 40 and 15 respectively. Unsatisfactory soils also include satisfactory soils not maintained within 2 percent of optimum moisture content at time of compaction.
 - 2. Existing Subgrade (Except Footing Subgrade): Same materials as 1.2.A.1, that are not capable of direct support of slabs, pavement, and similar items with possible exception of improvement by compaction, proofrolling, or similar methods.
- B. Building Earthwork: Earthwork operations required in area enclosed by a line located 1500 mm (5 feet) outside of principal building perimeter. It also includes earthwork required for auxiliary structures and buildings.
- C. Trench Earthwork: Trenchwork required for utility lines.
- D. Site Earthwork: Earthwork operations required in area outside of a line located 1500 mm (5 feet) outside of principal building perimeter and within new construction area with exceptions noted above.
- E. Degree of compaction: Degree of compaction is expressed as a percentage of maximum density obtained by laboratory test procedure. This percentage of maximum density is obtained through use of data provided from results of field test procedures presented in ASTM D1556, ASTM D2167, and ASTM D6938.
- F. Fill: Satisfactory soil materials used to raise existing grades. In the Construction Documents, the term "fill" means fill or backfill as appropriate.

- G. Backfill: Soil materials or controlled low strength material used to fill an excavation.
- H. Unauthorized excavation: Removal of materials beyond indicated sub-grade elevations or indicated lines and dimensions without written authorization by the COTR. No payment will be made for unauthorized excavation or remedial work required to correct unauthorized excavation.
- I. Authorized additional excavation: Removal of additional material authorized by the COTR based on the determination by the Government's soils testing agency that unsuitable bearing materials are encountered at required sub-grade elevations. Removal of unsuitable material and its replacement as directed will be paid on basis of Conditions of the Contract relative to changes in work.
- J. Subgrade: The undisturbed earth or the compacted soil layer immediately below granular sub-base, drainage fill, or topsoil materials.
- K. Structure: Buildings, foundations, slabs, tanks, curbs, mechanical and electrical appurtenances, or other man-made stationary features constructed above or below the ground surface.
- L. Borrow: Satisfactory soil imported from off-site for use as fill or backfill.
- M. Drainage course: Layer supporting slab-on-grade used to minimize capillary flow of pore water.
- N. Bedding course: Layer placed over the excavated sub-grade in a trench before laying pipe. Bedding course shall extend up to the springline of the pipe.
- O. Sub-base Course: Layer placed between the sub-grade and base course for asphalt paving or layer placed between the sub-grade and a concrete pavement or walk.
- P. Utilities include on-site underground pipes, conduits, ducts, and cables as well as underground services within buildings.
- Q. Debris: Debris includes all materials located within the designated work area not covered in the other definitions and shall include but not be limited to items like vehicles, equipment, appliances, building materials or remains thereof, tires, any solid or liquid chemicals or products stored or found in containers or spilled on the ground.
- R. Contaminated soils: Soil that contains contaminants as defined and determined by the COTR or the Government's testing agency.

1.3 RELATED WORK:

- A. Safety requirements: GENERAL CONDITIONS.
- B. Protection of existing utilities, fire protection services, existing equipment, roads, and pavements: Section 01 00 00, GENERAL REQUIREMENTS.
- C. Site preparation: Section 02 41 00, DEMOLITION.

1.4 CLASSIFICATION OF EXCAVATION:

- A. Unclassified Excavation: Removal and disposal of pavements and other man-made obstructions visible on surface; utilities, and other items including underground structures indicated to be demolished and removed; together with any type of materials regardless of character of material and obstructions encountered.

1.5 APPLICABLE PUBLICATIONS:

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
- B. American Association of State Highway and Transportation Officials (AASHTO):
- T99-10 Standard Method of Test for Moisture-Density Relations of Soils
Using a 2.5 kg (5.5 lb) Rammer and a 305 mm (12 inch) Drop
- T180-10 Standard Method of Test for Moisture-Density Relations of Soils
using a 4.54 kg (10 lb) Rammer and a 457 mm (18 inch) Drop
- C. American Society for Testing and Materials (ASTM):
- C33-03 Concrete Aggregate
[javascript:onClick=AllVersionsPick\('/D448.htm'\);](#) D448-08
Standard Classification for Sizes of Aggregate for Road
and Bridge Construction
- D698-07e1 Standard Test Method for Laboratory Compaction Characteristics
of Soil Using Standard Effort (12,400 ft. lbf/ft³ (600 kN m/m³))
- D1140-00 Amount of Material in Soils Finer than the No. 200 (75-
micrometer) Sieve
- D1556-07 Standard Test Method for Density and Unit Weight of Soil in
Place by the Sand Cone Method
- D1557-09 Standard Test Methods for Laboratory Compaction
Characteristics of Soil Using Modified Effort (56,000 ft-lbf/ft³
(2700 kN m/m³))
- D2167-08 Standard Test Method for Density and Unit Weight of Soil in
Place by the Rubber Balloon Method
- D2487-11 Standard Classification of Soils for Engineering Purposes
(Unified Soil Classification System)
- D2940-09 Standard Specifications for Graded Aggregate Material for Bases
or Subbases for Highways or Airports
- D6938-10 Standard Test Method for In-Place Density and Water Content of
Soil and Soil-Aggregate by Nuclear Methods (Shallow Depth)
- D. Society of Automotive Engineers (SAE):
- J732-07 Specification Definitions - Loaders
- J1179-08 Hydraulic Excavator and Backhoe Digging Forces

PART 2 - PRODUCTS**2.1 MATERIALS:**

- A. General: Provide borrow soil material when sufficient satisfactory soil materials are not available from excavations.
- B. Fills: Material in compliance with ASTM D2487 Soil Classification Groups GW, GP, GM, SW, SP, SM, SC, and ML, or any combination of these groups; free of rock or gravel larger than 75 mm (3 inches) in any dimension, debris, waste, frozen materials, vegetation, and other deleterious matter. Material approved from on site or off site sources having a minimum dry density of 1760 kg/m³ (110 pcf), a maximum Plasticity Index of 15, and a maximum Liquid Limit of 40.
- C. Engineered Fill: Naturally or artificially graded mixture of compliance with ASTM D2487 Soil Classification Groups GW, GP, GM, SW, SP, SM, SC, and ML, or any combination of these groups, or as approved by the Engineer or material with at least 90 percent passing a 37.5-mm (1 1/2-inch) sieve and not more than 12 percent passing a 75-μm (No. 200) sieve, per ASTM D2940;.
- D. Bedding: Naturally or artificially graded mixture of natural or crushed gravel, crushed stone, and natural or crushed sand; ASTM D2940; except with 100 percent passing a 25 mm (1 inch) sieve and not more than 8 percent passing a 75-μm (No. 200) sieve.
- E. Drainage Fill: Washed, narrowly graded mixture of crushed stone, or crushed or uncrushed gravel; ASTM D448; coarse-aggregate grading Size 57; with 100 percent passing a 37.5 mm (1 1/2-inch) sieve and 0 to 5 percent passing a 2.36 mm (No. 8) sieve.
- F. Granular Fill:
 - 1. Under concrete slab, - granular fill shall consist of clean, poorly graded crushed rock, crushed gravel, or uncrushed gravel placed beneath a building slab with or without a vapor barrier to cut off the capillary flow of pore water to the area immediately below. Fine aggregate grading shall conform to ASTM C 33 with a maximum of 3 percent by weight passing ASTM D 1140;.
- G. Buried Warning and Identification Tape: Metallic core or metallic-faced, acid- and alkali-resistant polyethylene plastic warning tape manufactured specifically for warning and identification of buried utility lines. Provide tape on rolls, 3 inch minimum width, color coded as specific below for the intended utility with warning and identification imprinted in bold black letters continuously over the entire tape length. Warning and identification to read, "CAUTION, BURIED STEAM LINE BELOW" or similar wording. Color and printing shall be permanent, Unaffected by moisture or soil. Warning tape color codes:
 - White: Steam Systems
- H. Warning Tape for Metallic Piping: Acid and alkali-resistant polyethylene plastic tape conforming to the width, color, and printing requirements specified above. Minimum thickness of tape shall be 0.076 mm (0.003 inch). Tape shall have a minimum strength of 10.3 MPa (1500 psi) lengthwise, and 8.6 MPa (1250 psi) crosswise, with a maximum 350 percent elongation.

PART 3 - EXECUTION**3.1 SITE PREPARATION:**

- A. Clearing: Clear within limits of earthwork operations as shown. Work includes removal of foundations, incidental structures, paving, concrete slabs, debris, trash, and other obstructions. Remove materials from Medical Center Property.
- B. Concrete Slabs and Paving: Score deeply or saw cut to insure a neat, straight cut, sections of existing concrete slabs and paving to be removed where excavation or trenching occurs. Extend pavement section to be removed a minimum of 300 mm (12 inches) on each side of widest part of trench excavation and insure final score lines are approximately parallel unless otherwise indicated. Remove material from Medical Center Property.
- C. Disposal: All materials removed from the property shall be disposed of at a legally approved site, for the specific materials, and all removals shall be in accordance with all applicable Federal, State and local regulations. No burning of materials is permitted onsite.

3.2 EXCAVATION:

- A. Shoring, Sheet piling and Bracing: Shore, brace, or slope, its angle of repose or to an angle considered acceptable by the COTR, banks of excavations to protect workmen, banks, adjacent paving, structures, and utilities.
 - 1. Design of the temporary support of excavation system is the responsibility of the Contractor. The Contractor shall submit a Shoring and Sheet piling plan for approval 15 days prior to starting work. Submit drawings and calculations, certified by a registered professional engineer, describing the methods for shoring and sheet piling of excavations. Shoring, including sheet piling, shall be furnished and installed as necessary to protect workmen, banks, adjacent paving, structures, and utilities. Shoring, bracing, and sheet piling shall be removed as excavations are backfilled, in a manner to prevent caving.
 - 2. Construction of the support of excavation system shall not interfere with the permanent structure and may begin only after a review by the COTR.
 - 3. Extend shoring and bracing to a minimum of 1500 mm (5 feet) below the bottom of excavation. Shore excavations that are carried below elevations of adjacent existing foundations.
 - 4. Do not remove shoring until permanent work in excavation has been inspected and approved by COTR.
- B. Excavation Drainage: Operate pumping equipment, and/or provide other materials, means and equipment as required to keep excavation free of water and subgrade dry, firm, and undisturbed until approval of permanent work has been received from COTR. Approval by the COTR is also required before placement of the permanent work on all subgrades. Groundwater flowing toward or into excavations shall be controlled to prevent sloughing of excavation slopes and walls, boils, uplift and heave in the excavation and to eliminate interference with orderly progress of

construction. French drains, sumps, ditches or trenches will not be permitted within 0.9 m (3 feet) of the foundation of any structure, except with specific written approval, and after specific contractual provisions for restoration of the foundation area have been made. Control measures shall be taken by the time the excavation reaches the water level in order to maintain the integrity of the in situ material. While the excavation is open, the water level shall be maintained continuously, below the working level.

- C. Subgrade Protection: Protect subgrades from softening, undermining, washout, or damage by rain or water accumulation. Reroute surface water runoff from excavated areas and not allow water to accumulate in excavations. Do not use excavated trenches as temporary drainage ditches. When subgrade for foundations has been disturbed by water, remove disturbed material to firm undisturbed material after water is brought under control. Replace disturbed subgrade in trenches with concrete or material approved by the COTR.

D. Trench Earthwork:

1. Utility trenches (except sanitary and storm sewer):
 - a. Excavate to a width as necessary for sheeting and bracing and proper performance of the work.
 - b. Grade bottom of trenches with bell holes scooped out to provide a uniform bearing.
 - c. Support piping on suitable undisturbed earth unless a mechanical support is shown. Unstable material removed from the bottom of the trench or excavation shall be replaced with select granular material placed in layers not exceeding 150 mm (6 inches) loose thickness.
 - d. Length of open trench in advance of piping laying shall not be greater than is authorized by COTR.
 - e. Provide buried utility lines with utility identification tape. Bury tape 300 mm (12 inches) below finished grade; under pavements and slabs, bury tape 150 mm (6 inches) below top of subgrade
 - f. Initial backfill material shall be placed and compacted with approved tampers to a height of at least one foot above the utility pipe or conduit. The backfill shall be brought up evenly on both sides of the pipe for the full length of the pipe. Care shall be taken to ensure thorough compaction of the fill under the haunches of the pipe. Except as specified otherwise in the individual piping section, provide bedding for buried piping in accordance with AWWA C600, Type 4, except as specified herein. Backfill to top of pipe shall be compacted to 95 percent of ASTM D 698 maximum density. Provide materials as follows:
 - 1) Class I: Angular, 6 to 40 mm (0.25 to 1.5 inches), graded stone, including a number of fill materials that have regional significance such as coral, slag, cinders, crushed stone, and crushed shells.

- 2) Class II: Coarse sands and gravels with maximum particle size of 40 mm (1.5 inches), including various graded sands and gravels containing small percentages of fines, generally granular and noncohesive, either wet or dry. Soil Types GW, GP, SW, and SP are included in this class as specified in ASTM D2487.
 - 3) Clean, coarse-grained sand classified by ASTM D2487 for bedding and backfill
 - 4) Clean, coarsely graded natural gravel, crushed stone or a combination thereof having a classification in accordance with ASTM D2487 for bedding and backfill.
- E. Site Earthwork: Earth excavation includes excavating pavements and obstructions visible on surface; underground structures, utilities, and other items indicated to be removed; together with soil, boulders, and other materials not classified as rock or unauthorized excavation. Excavation shall be accomplished as required by drawings and specifications. Excavate to indicated elevations and dimensions within a tolerance of plus or minus 25 mm (1 inch). Extend excavations a sufficient distance from structures for placing and removing concrete formwork, for installing services and other construction, complying with OSHA requirements, and for inspections. Remove subgrade materials that are determined by COTR as unsuitable, and replace with acceptable material.

3.3 FILLING AND BACKFILLING:

- A. General: Do not fill or backfill until all debris, water, unsatisfactory soil materials, obstructions, and deleterious materials have been removed from excavation. For fill and backfill, use excavated materials and borrow meeting the criteria specified herein, as applicable. Borrow shall be supplied at no additional cost to the Government. Do not use unsuitable excavated materials. Do not backfill until foundation walls have been completed above grade and adequately braced, waterproofing or dampproofing applied, foundation drainage, and pipes coming in contact with backfill have been installed and work inspected and approved by COTR.
- B. Placing: Place materials in horizontal layers not exceeding 200 mm (8 inches) in loose depth for material compacted by heavy compaction equipment, and not more than 100 mm (4 inches) in loose depth for material compacted by hand-operated tampers and then compacted. Place backfill and fill materials evenly on all sides of structures to required elevations, and uniformly along the full length of each structure. Place no material on surfaces that are muddy, frozen, or contain frost.
- C. Compaction: Compact with approved tamping rollers, sheepfoot rollers, pneumatic tired rollers, steel wheeled rollers, vibrator compactors, or other approved equipment (hand or mechanized) well suited to soil being compacted. Do not operate mechanized vibratory compaction equipment within 3000 mm (10 feet) of new or existing building walls without prior approval of COTR. Moisten or aerate material as necessary to provide moisture content that will readily facilitate obtaining specified compaction with equipment used. Backfill adjacent to any and all types of structures shall be placed and compacted to at least 90 percent laboratory maximum density for cohesive materials or 95 percent laboratory maximum density for cohesionless materials to prevent

wedging action or eccentric loading upon or against the structure. Compact soil to not less than the following percentages of maximum dry density, according to ASTM D698 or ASTM D1557 as specified below:

1. Fills, Embankments, and Backfill
 - a. Under Sidewalks, scarify and recompact top 150 mm (6 inches) below subgrade and compact each layer of backfill or fill material 95 percent.
2. Natural Ground (Cut or Existing)
 - a. Under sidewalks, top 150 mm (6 inches), 95 percent.

3.4 DISPOSAL OF UNSUITABLE AND EXCESS EXCAVATED MATERIAL:

- A. Disposal: Remove surplus satisfactory soil and waste material, including unsatisfactory soil, trash, and debris, and legally dispose of it off Medical Center property.
- B. Place excess excavated materials suitable for fill and/or backfill on site where directed.
- C. Remove from site and dispose of any excess excavated materials after all fill and backfill operations have been completed.

3.5 CLEAN UP:

Upon completion of earthwork operations, clean areas within contract limits, remove tools, and equipment. Provide site clear, clean, free of debris, and suitable for subsequent construction operations. Remove all debris, rubbish, and excess material from Medical Center Property.

----- E N D -----