



NOTES

1. REFER TO SPECIFICATION SECTION 010000 FOR REQUIREMENTS REGARDING PRE-CONSTRUCTION INVESTIGATION PRIOR TO COMMENCEMENT OF WORK.

KEYED NOTES

- 1 CORRECT GYPSUM BOARD DEFICIENCIES TO ACHIEVE 20 MINUTE SMOKE RESISTIBLE WALLS RATING OF THE EXISTING WALL IN ROOM 250A TO MEET NFPA701-19.3.6.2.4, IN ADDITION, CORRECT AND FIRESTOP ALL PENETRATIONS TO MEET THESE CODE REQUIREMENTS. REFER TO PHOTO C4/1 AE601.
- 2 CORRECT GYPSUM BOARD DEFICIENCIES TO ACHIEVE 20 MINUTE SMOKE RESISTIBLE WALLS RATING OF THE EXISTING WALL IN ROOM 2505 TO MEET NFPA701-19.3.6.2.4, IN ADDITION, CORRECT AND FIRESTOP ALL PENETRATIONS TO MEET THESE CODE REQUIREMENTS. REFER TO PHOTO C4/1 AE601.

LEGEND

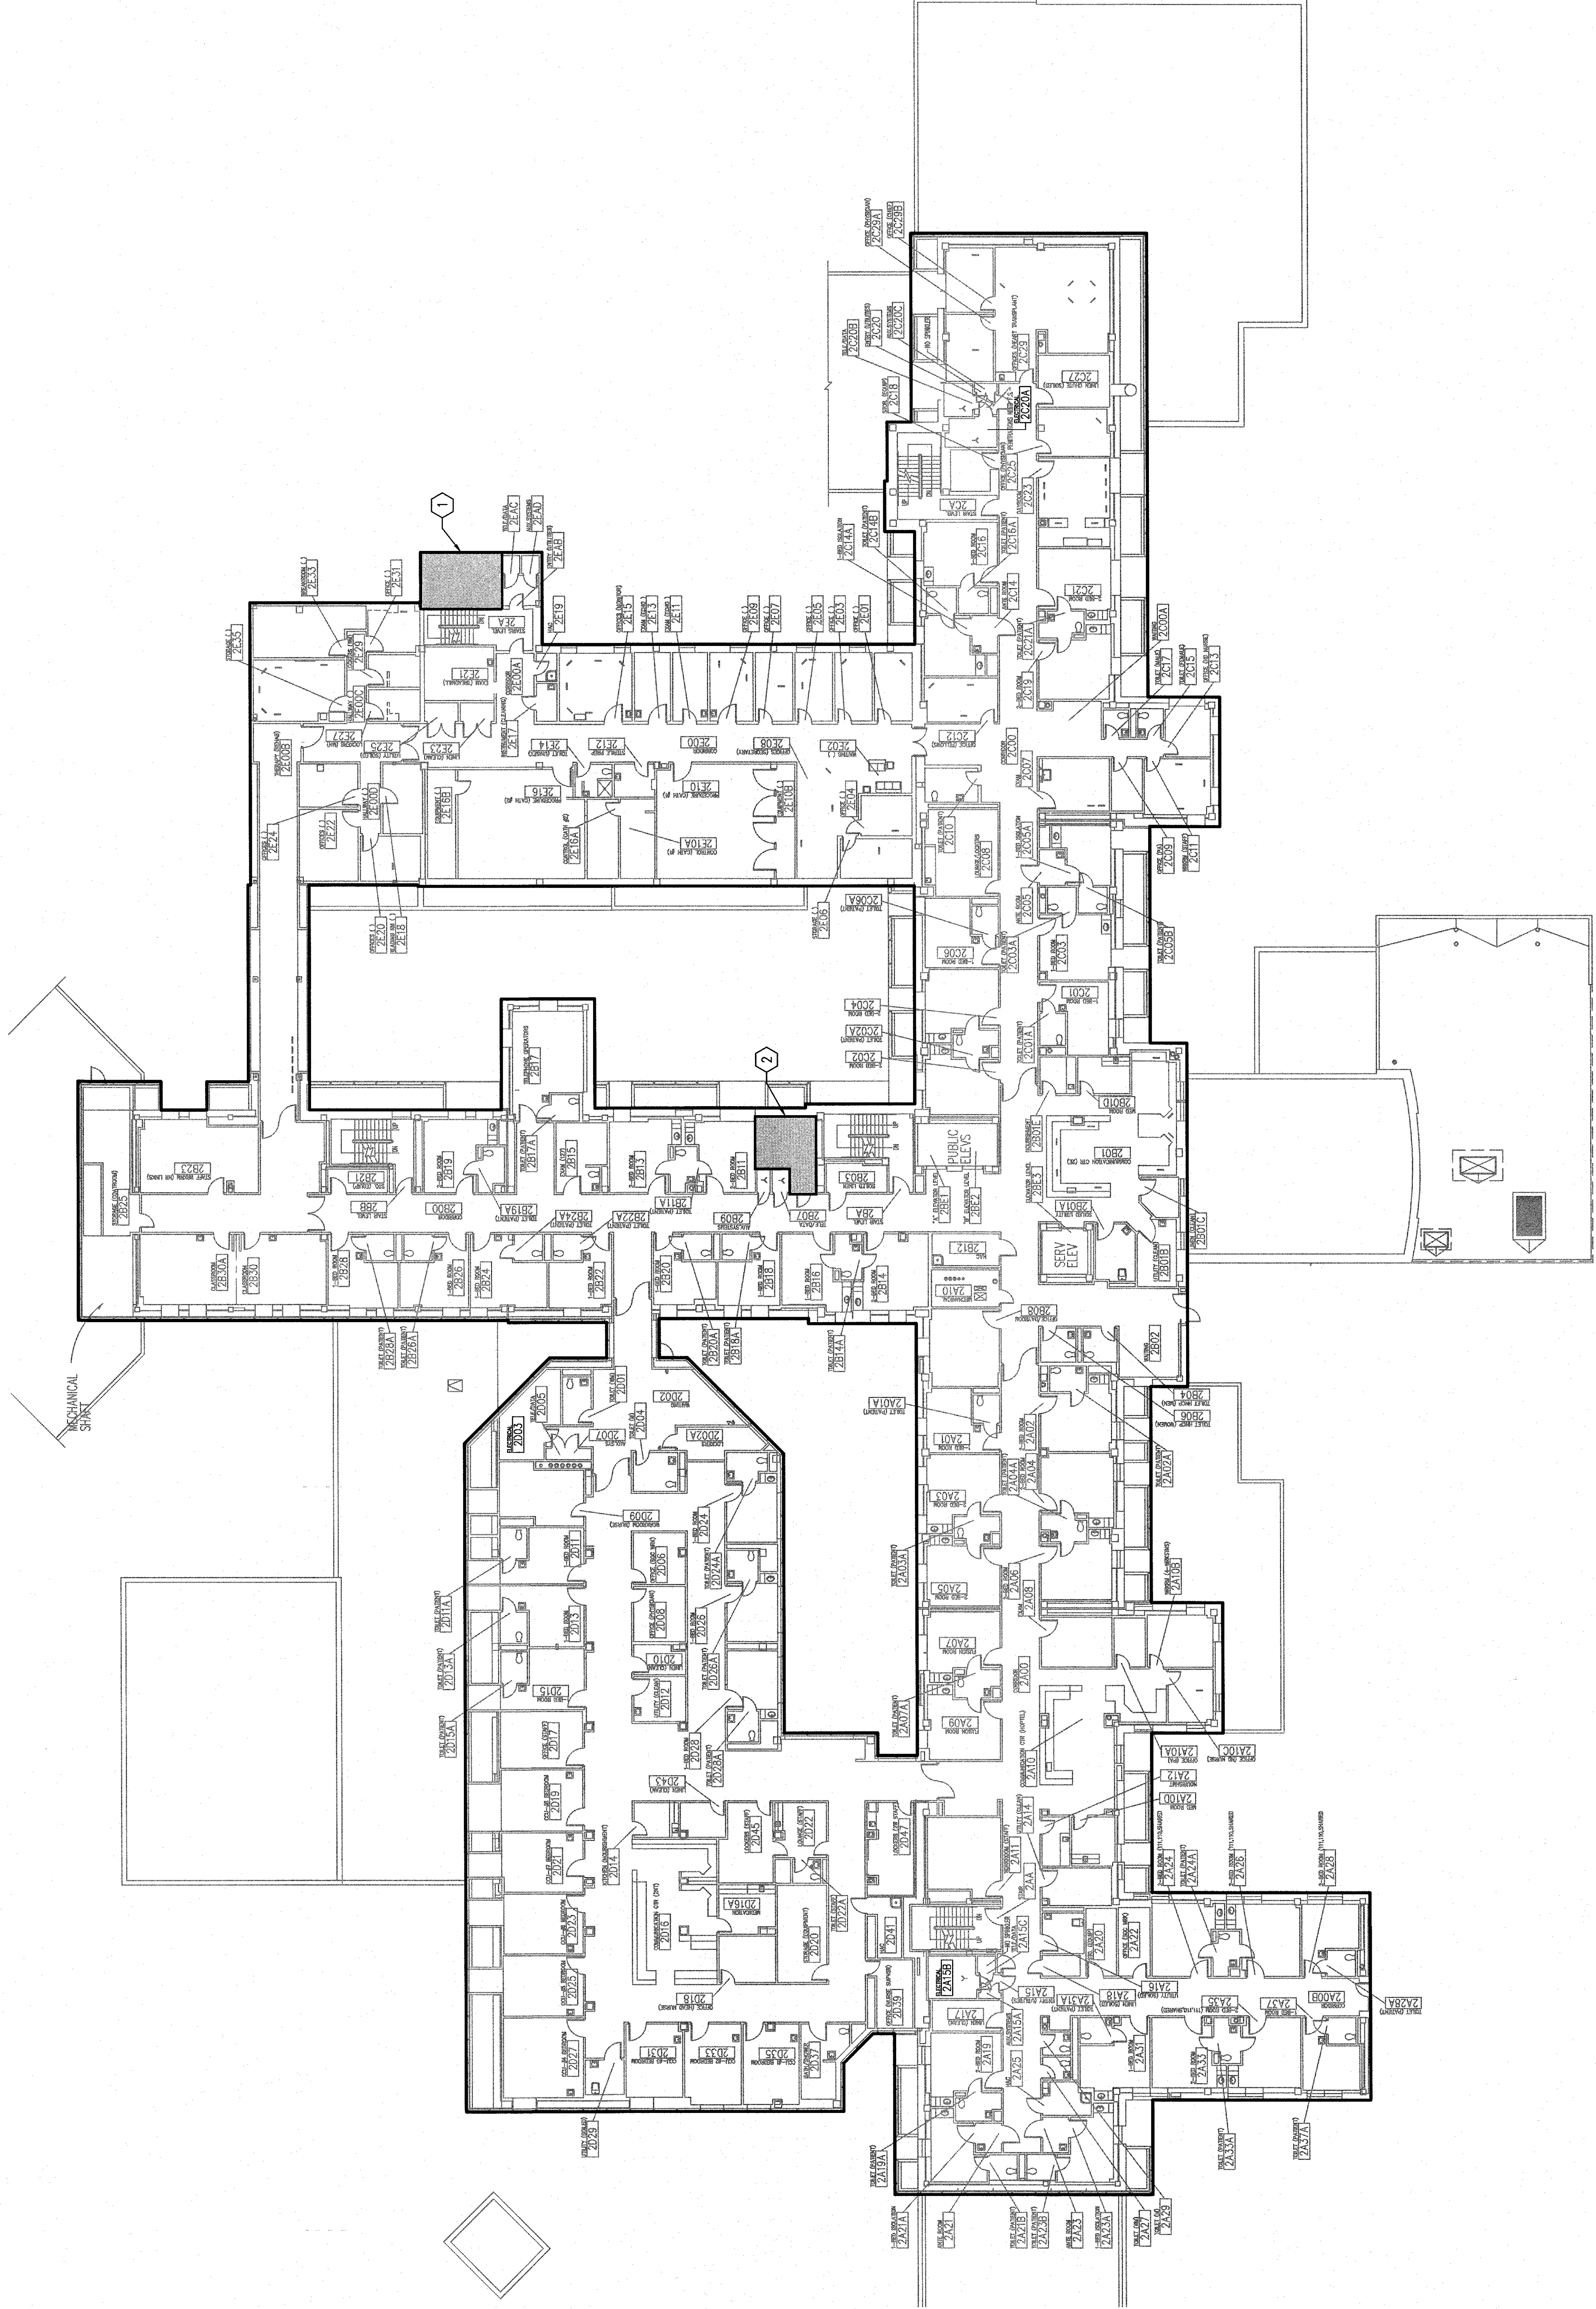

F1 **FLOOR PLAN** $1/16" = 1'-0"$

KEY PLAN - NOT TO SCALE

**FULLY SPRINKLERED
BID DOCUMENTS
FOR CONSTRUCTION**

ARCHITECT/ENGINEERS:

PARADIGM
ENGINEERS AND CONSTRUCTORS

Drawing Title:
FIRE BARRIER PLAN - SECOND FLOOR
BUILDING 1

Project Title:	FIRE SAFETY UPGRADES
----------------	----------------------

Project Number:
259-13-C-0245

Building Number: 1

Drawing Number:

Location: **GEORGE E WAHLEN VAMC**
500 FOOTHILL DR. SALT LAKE CITY, UT

Date:	12-13-2013	Checked:	KLP	Drawn:	JDM
-------	------------	----------	-----	--------	-----

Date:	12-13-2013	Checked:	KLP	Drawn:	JDM
-------	------------	----------	-----	--------	-----

Date:	12-13-2013	Checked:	KLP	Drawn:	JDM
-------	------------	----------	-----	--------	-----

Approved: Project Director

Office of

Department of
Veterans Affairs