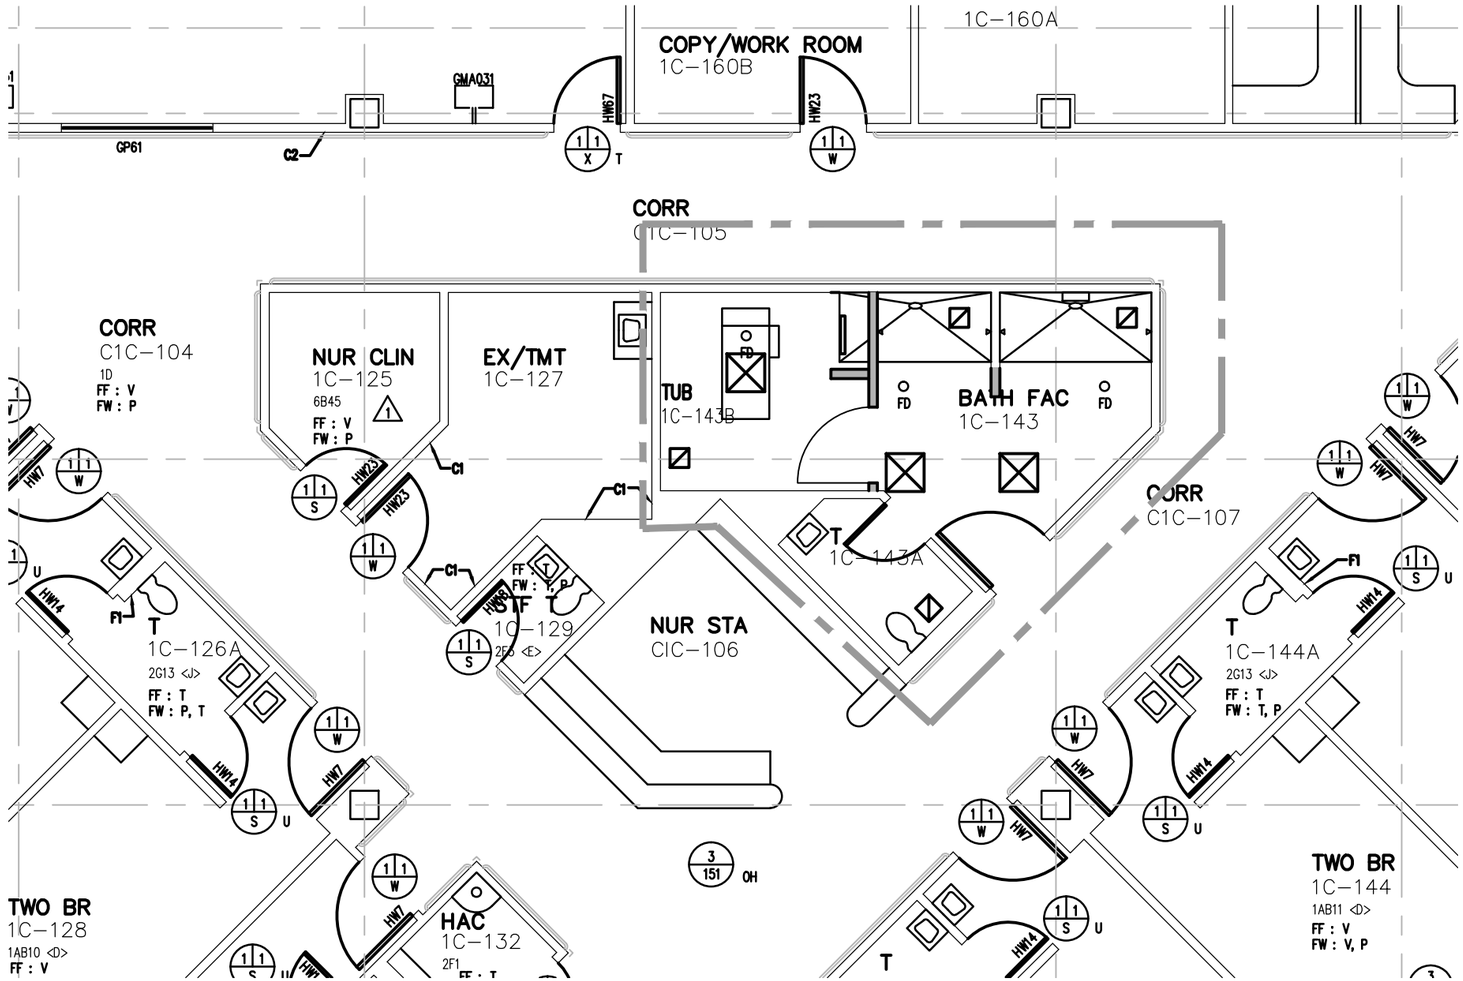

1 HVAC PLAN – NEW

SCALE:1/8:=1'-0"

LEGEND

- HVAC SUPPLY
- HVAC EXHAUST/RETURN
- LINER DIFFUSER

GENERAL NOTES

1 PROVIDE AND INSTALL NEW VAV IN THE INTERSTICIAL SPACE. VAV TO BE 600 CFM. CONNECT TO HOT AND COLD DECK. PROVIDE LOCAL CONTROL ONLY.

2 SPACE TO BE 100% EXHAUST. CONNECT TO EXISTING SYSTEM.

WORK SHOWN IS IN 1C, 1D WORK IDENTICAL SEE REFERENCE DRAWINGS FOR PLAN LAYOUT.

Revisions	Date

CONSULTANTS:

ARCHITECT/ENGINEERS:

Drawing Title: - HVAC PLAN - NEW -

Approved Project Director:

Project Title: -- -- -

Location: --

Date: - | Checked | Drawn

Project Number: --

Building Number: --

Drawing Number: M-101

Dwg. of --

Office of Construction and Facilities Management

VA FORM 08-6231RM 08-6231