


SMOKE COMPARTMENT	AREA (GSF)	LOAD FACTOR	OCCUPANT LOAD	INCHES OF EXIT WIDTH REQUIRED			INCHES OF EXIT WIDTH PROVIDED										
				INCH/ PERSON	STAIRS	INCH/ PERSON	DOORS	STAIRS	HORIZ.	DOORS							
SECOND FLOOR																	
2A2C1E2	1-2 INSTITUTE (OP NONSLP)	12,712	100	128	0.3	39	0.2	26	96	.	80						
2A2E1E2	1-2 INSTITUTE (OP NONSLP)	15,118	100	152	0.3	46	0.2	31	88	.	80						
2B1	1-2 INSTITUTE (OP NONSLP)	8,323	100	84	0.3	26	0.2	17	48	.	40						
2C1C2D	1-2 INSTITUTE (OP NONSLP)	9,002	100	91	0.3	28	0.2	19	96	.	80						
2C2E1E3	1-2 INSTITUTE (OP NONSLP)	6,781	100	68	0.3	21	0.2	14	48	.	40						
2E1E3	1-2 INSTITUTE (OP NONSLP)	4,467	100	45	0.3	14	0.2	9	.	.	.						
2MHN	1-2 INSTITUTE (OP NONSLP)	6,267	100	63	0.3	19	0.2	13	36	.	40						
2MHS	1-2 INSTITUTE (OP NONSLP)	6,520	100	66	0.3	20	0.2	14	36	.	32						
2R1	1-2 INSTITUTE (OP NONSLP)	7,002	100	71	0.3	22	0.2	15	72	.	80						
2Z	1-2 INSTITUTE (OP NONSLP)	9,280	100	93	0.3	28	0.2	19	38	.	40						
TOTAL:										85,472	861						

SMOKE COMPARTMENT NOTES:
1. SEE FLOOR PLANS FOR ADDITIONAL INFORMATION AND LOCATIONS OF FIRE EXTINGUISHERS AND FIRE DEPARTMENT VALVE CABINETS.




CONSULTING ENGINEERS:

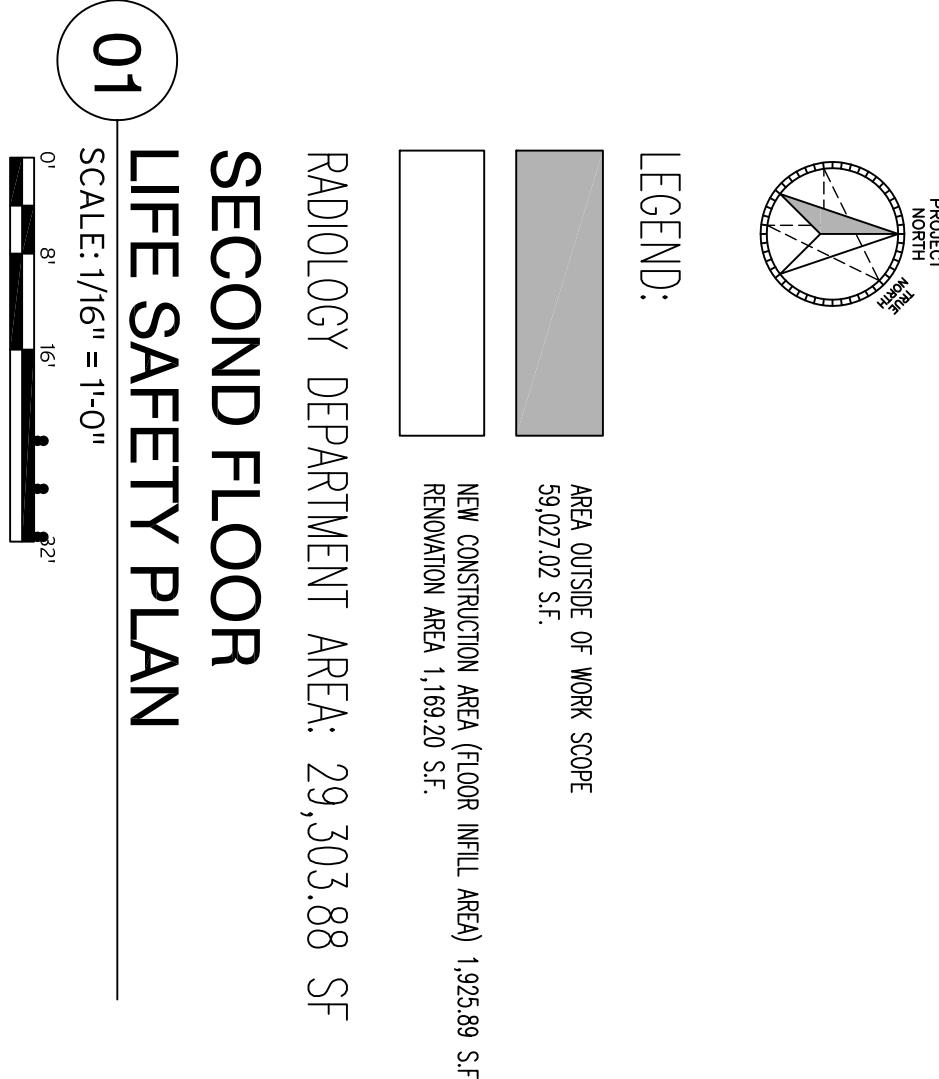

SSOE Inc.

3804 7th Avenue South
Birmingham, AL 35222
Phone: (205) 251-4500
Fax: (205) 324-4181

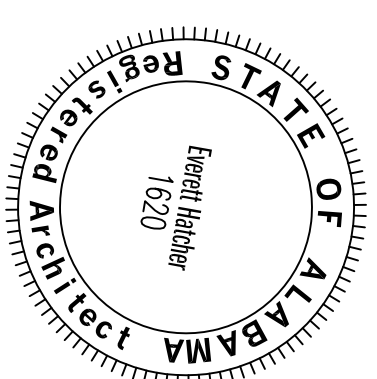


ARCHITECT:



CMH Architects, Inc.
1205 Parkview Drive
Birmingham, AL 35244
Phone: (205) 966-5686
Fax: (205) 966-5687
www.cmharchitects.com
Copyright © 2014 CMH Architects, Inc.

PROJECT MANAGEMENT:

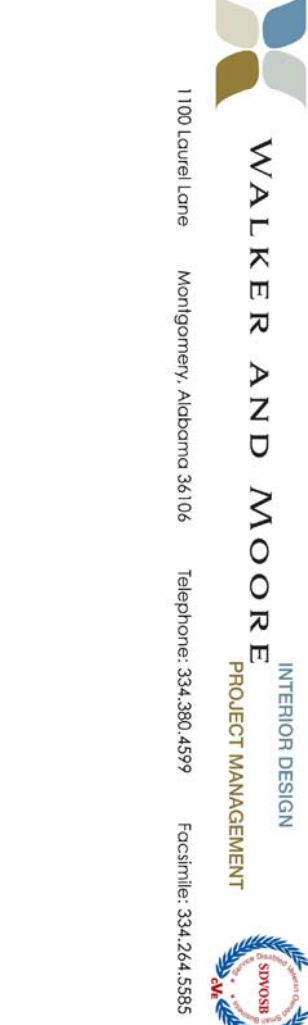

WALKER AND MOORE, INC.
11801 Central Expressway
Montgomery, Alabama 36105
Telephone: 334.346.6099
Fax: 334.346.6085
www.walkerandmoore.com

SECOND FLOOR LIFE SAFETY PLAN

Approved Project Director
James Zellander

Project Title: A/E AMBULATORY SURGERY IMPROVEMENTS
Location: VAMC - Birmingham, Alabama
Date: 5/23/2014
Checked: bea
Drawn: bea
Drawing Number: A002
DWG 06 of 124

Office of Construction and Facilities Management
Department of Veterans Affairs

CONSTRUCTION DOCUMENTS - 100% FINALS FULLY SPRINKLERED