SHEET NOTES

A.

SHEET KEYNOTES

1. UNLESS SPARE BREAKERS ARE AVAILABLE, PROVIDE (2) 35A, 1P BREAKERS IN EXISTING CRITICAL PANEL CHD-C2-2 TO MATCH EXISTING, FOR NEW IPU PANELS, IPU19 AND IPU20.

2. UNLESS A SPARE BREAKER IS AVAILABLE, PROVIDE A NEW 20A 1P BREAKER IN EXISTING CRITICAL PANEL CLP-C2-1 (LC22) TO MATCH EXISTING. PROVIDE 2#12, #12G, 3/4"C. FOR DDC CONTROL POWER AND VALVE POWER.

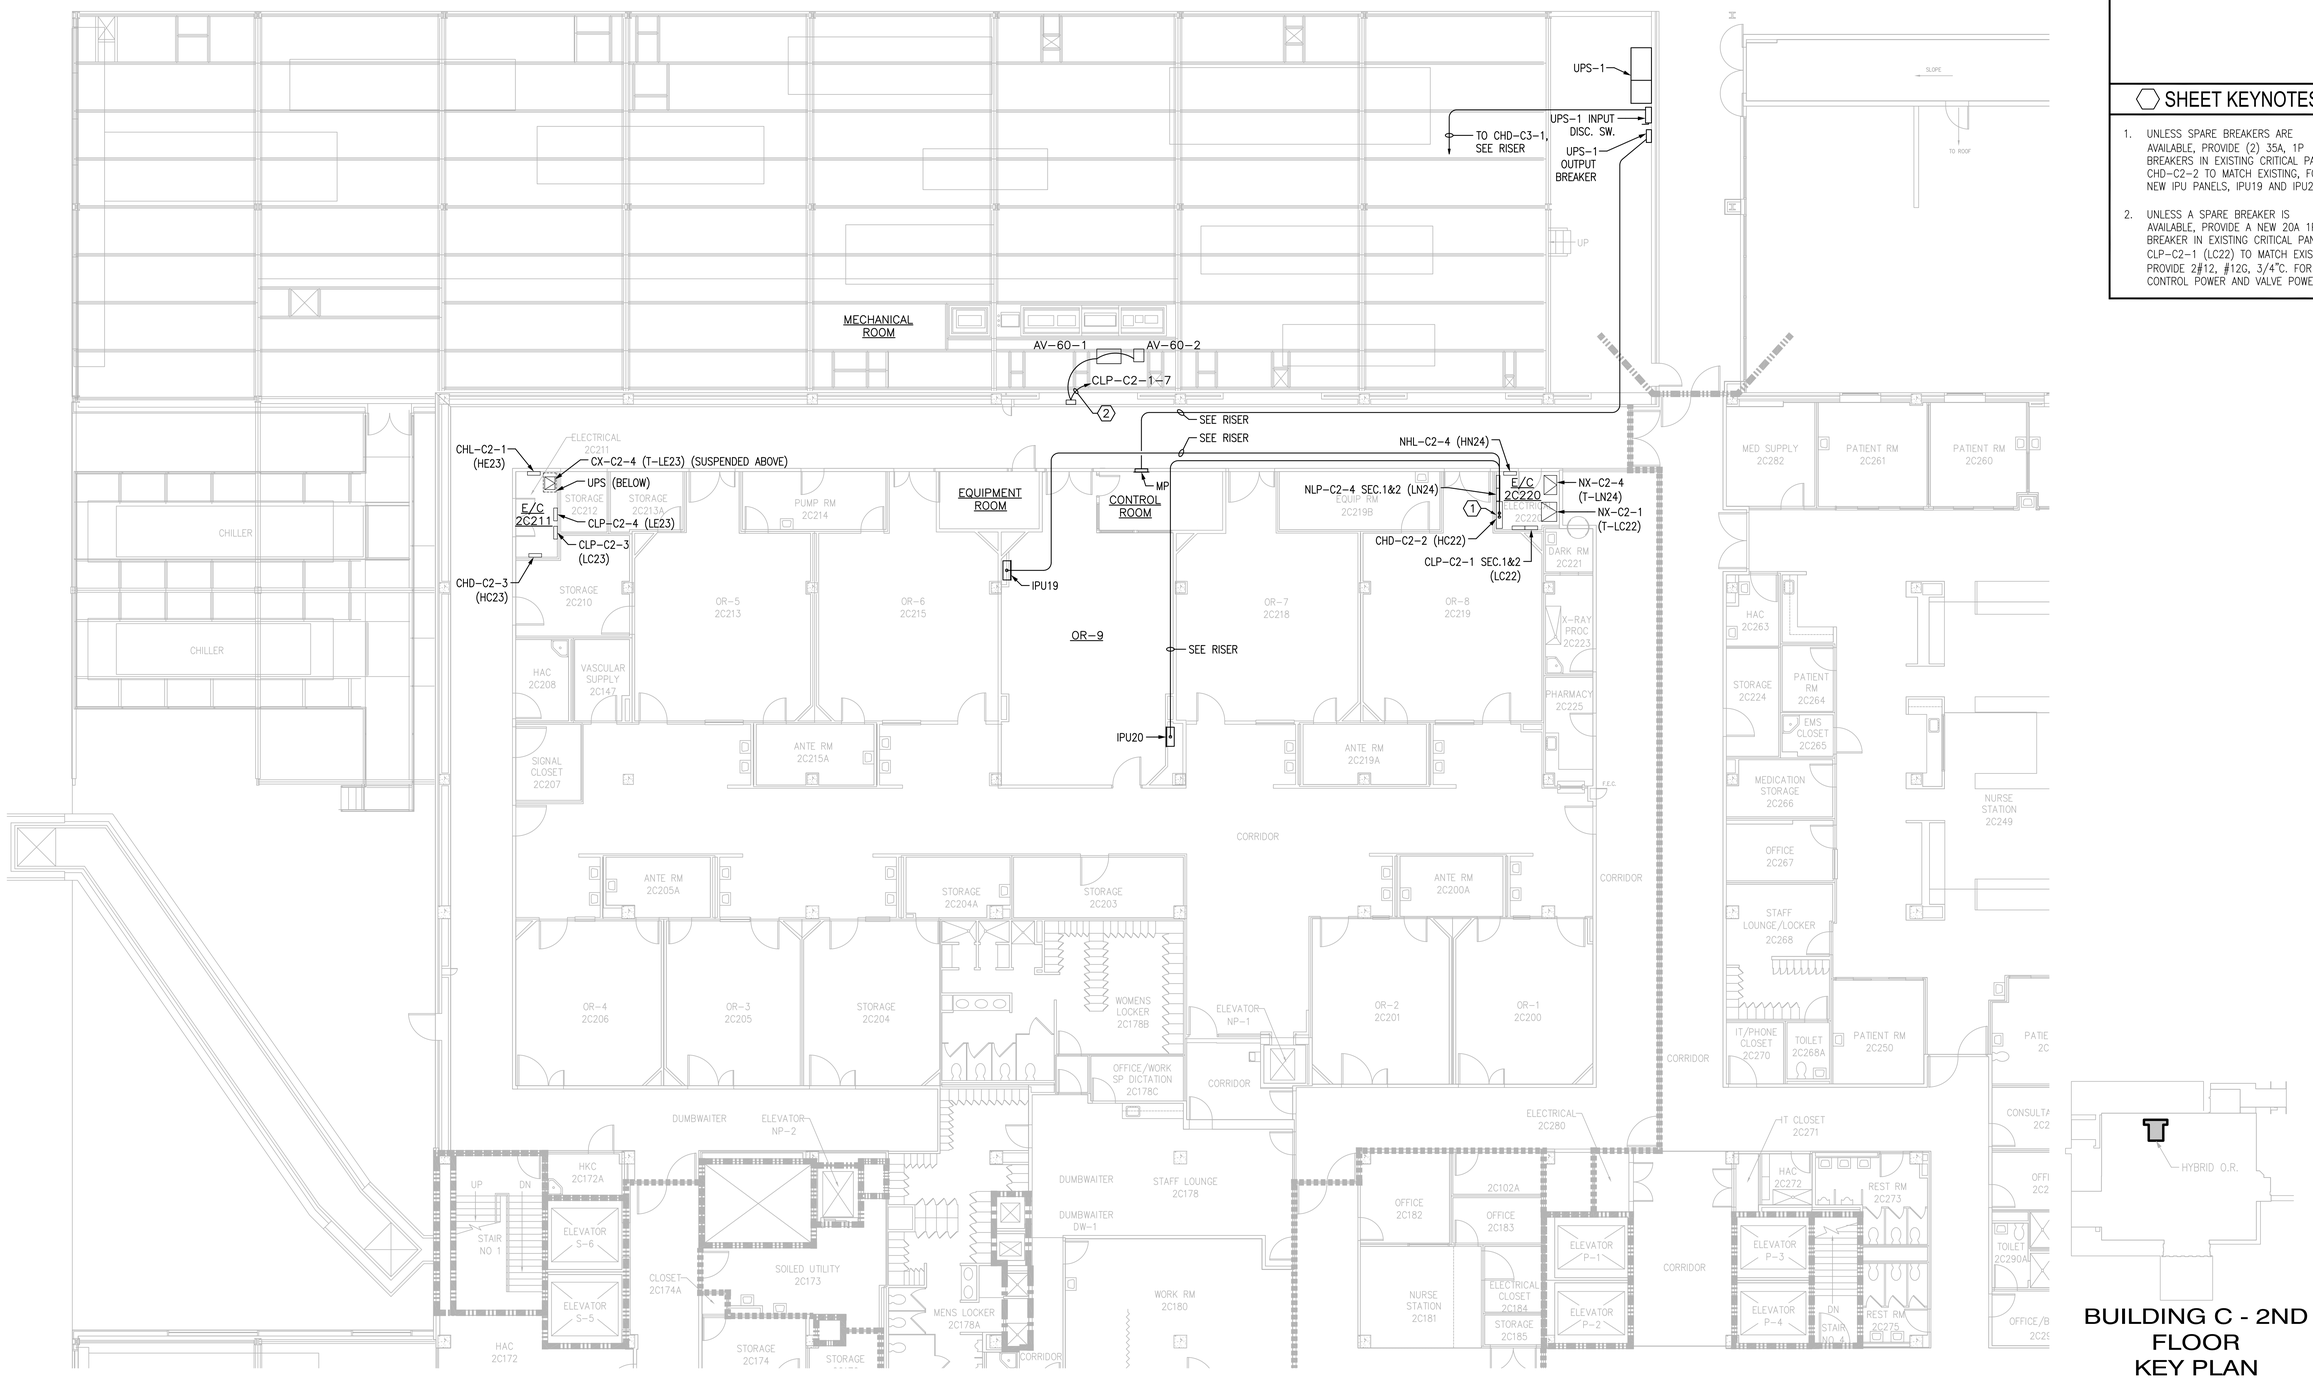

1 ELECTRICAL POWER PLAN - PARTIAL SECOND FLOOR

SCALE: 1/8" = 1' - 0"

BUILDING C - 2ND FLOOR KEY PLAN

FINAL SUBMITTAL
APPROVED FOR CONSTRUCTION

Revisions:	Date

CONSULTANTS:

ENGINEER-OF-RECORD: RANDALL A. HENSLEY — GA. P.E. NO. 18607

ARCHITECT/ENGINEERS:

AKEA INC.
3603 NW 98th Street, Suite B
Gainesville, FL 32606
Phone: (352) 474-6124
Fax: (352) 474-6324
COA: FL #26693
AKEA Project No. 072-14

Drawing Title: ELECTRICAL POWER PLAN - PARTIAL SECOND FLOOR

Approved: Project Director

Project Title: NEW SURGICAL 9TH OR SUITE

Location: Atlanta, Georgia

Date: APRIL 30, 2014 | Checked: RAH | Drawn: CJF

Project Number: 508-14-105

Building Number:

Drawing Number: E203
30 of 36

Office of Construction and Facilities Management

Department of Veterans Affairs

VA FORM 08-6231