


GENERAL NOTES

- ALL EXISTING FAN COIL UNITS SHALL REMAIN BALANCED AS THE PREVIOUS PROJECT UNLESS NOTED OTHERWISE.
- NEW HYDRONIC PIPING LOCATED IN POOL MECHANICAL ROOM. REST OF HYDRONIC PIPING IS EXISTING TO REMAIN.
- CONTRACTOR TO RELOCATE EXISTING THERMOSTATS TO NEW LOCATIONS AS SHOWN.

KEY

NOTE

- EXISTING FAN COIL UNIT.
- 2 1/2" CHWS/R AND 2 1/2" HWS/R FROM MAIN MECHANICAL ROOM. SEE 1-MP101 FOR CONTINUATION.
- 1" HWS/R DOWN UNDER SLAB TO RADIANT FLOOR MANIFOLD.
- FLOOR ACCESS PANEL FOR RADIANT FLOOR MANIFOLD.
- EXISTING UNIT HEATER SERVING PASSAGE WAY.
- EXISTING HYDRONIC BASEBOARD.
- BB-4, 8'-0", 6480 BTU/H TOTAL CAPACITY.
- POOL WATER HEATING SYSTEM.
- HATCHED AREA DENOTES IN SLAB RADIANT FLOOR ON POOL DECK. MAXIMUM INTENSITY = 17 BTU/HR * SQ. FT.
- VA PROVIDED, CONTRACTOR INSTALLED.
- CONNECT FINAL PIPING ROUNDOUTS TO PROVIDED STUB OUTS.

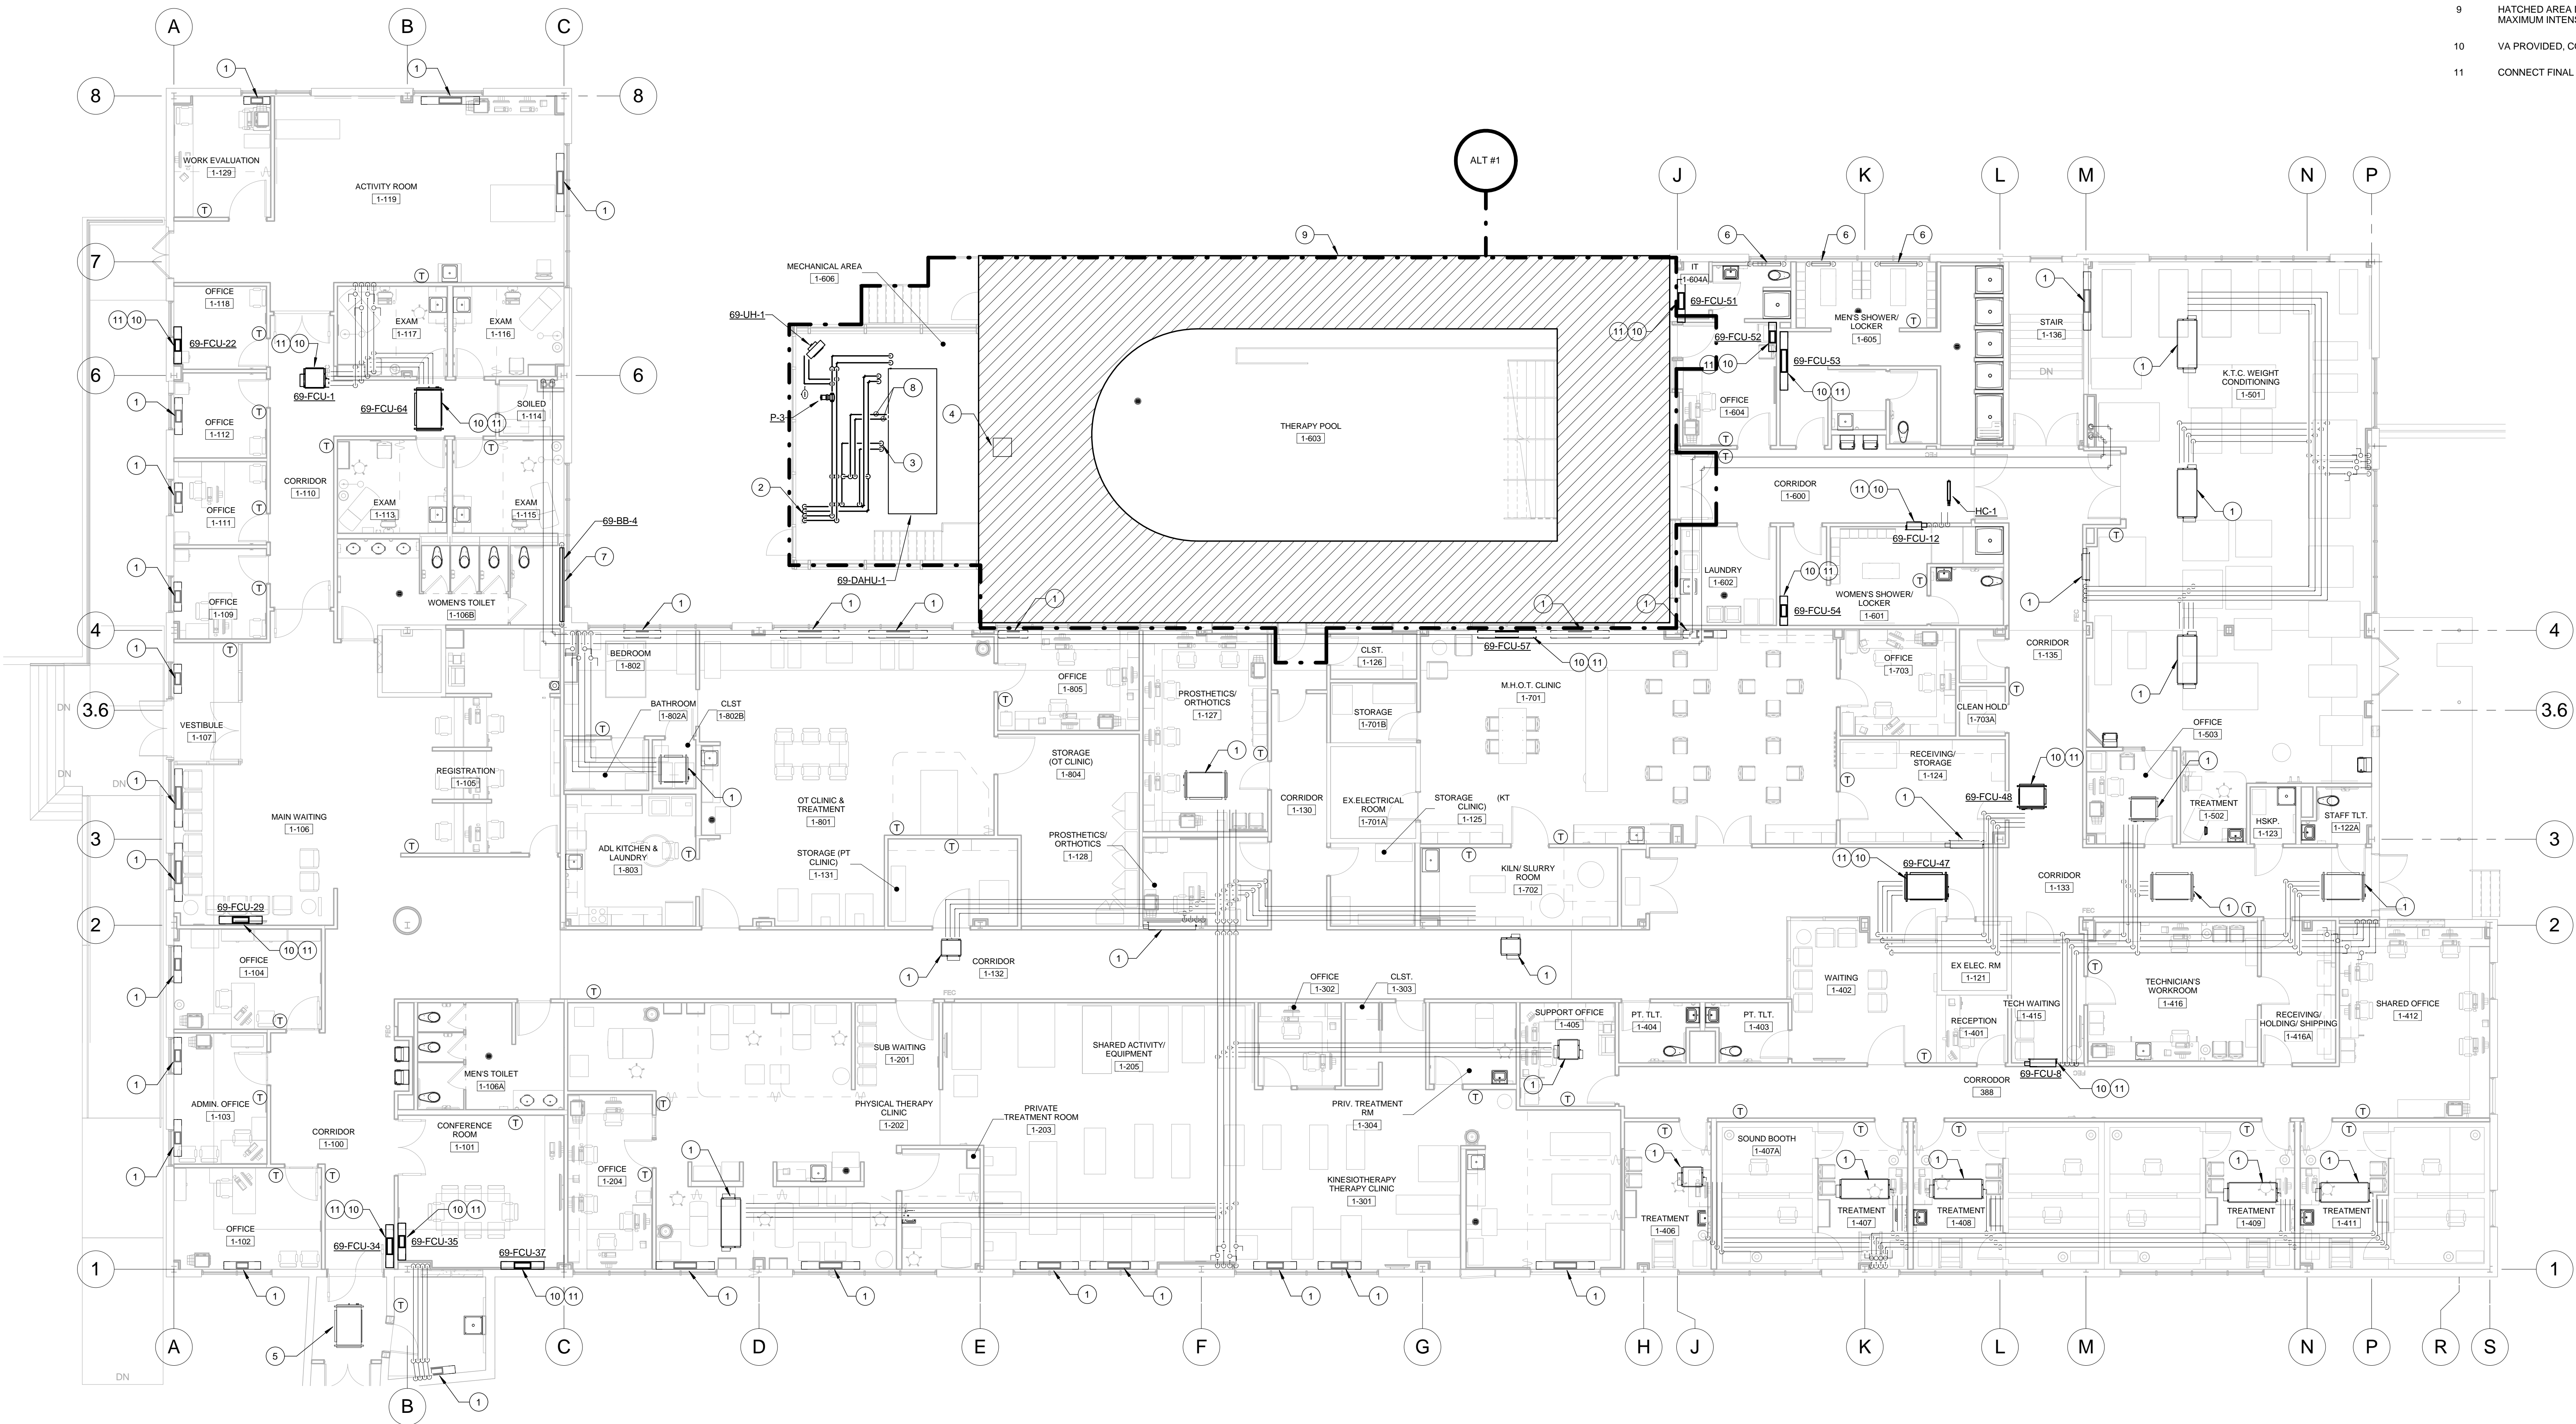

1 1st FLOOR HYDRONIC PLAN
1/8" = 1'-0"

FULLY SPRINKLERED
ISSUED FOR BID

CONSULTANTS:

Project Manager
BRAY MOONEY CONSULTING

410 E. 21 STREET
CHESTER, PA 19013
Tel: (610) 872-3716

Architect
ARRAY HEALTHCARE FACILITIES SOLUTIONS

2520 RENAISSANCE BLVD.,
SUITE 110
KING OF PRUSSIA, PA 19406
Tel: (610) 270-0599

Structural Engineer
WZG, STRUCTURAL CONSULTING ENGINEERS

P.O. BOX 24
40 LITTLE ROAD
ZIEGLERVILLE, PA 19482
Tel: (610) 267-5194

MEP/FP Engineer
APOGEE CONSULTING GROUP

7330 CHAPEL HILL ROAD,
SUITE 202
RALEIGH, NC 27606
Tel: (919) 859-7420

Civil Engineer
GUIDON DESIGN

2453 N DELAWARE STREET
INDIANAPOLIS, IN 46205
Tel: (317) 600-6388

Fire Protection Consultant
HARRINGTON GROUP

7508 E. INDEPENDENCE
BLVD., SUITE 116
CHARLOTTE, NC 28277
Tel: (704) 531-5077

Cost Estimator
BRAY MOONEY CONSULTING

410 E. 21 STREET
CHESTER, PA 19013
Tel: (610) 872-3716

Aquatic Consultant
ATLANTIC AQUATIC ENGINEERING

1823 DEEP RUN ROAD
PIPERSVILLE, PA 18947
Tel: (215) 786-0409

Associate Architects
W. COOK ARCHITECTS

1251 ROMANSVILLE ROAD
COATESVILLE, PA 19320
Tel: (610) 383-4460

PROJECT MANAGER:

Bray Mooney Consulting

Project Number
3627

Scale
1/8" = 1'-0"

Drawing Title

1ST FLOOR HYDRONIC PLAN

Approved: Project Director

Project Title

RENOVATE BUILDING 69

Location

1400 Black Horse Hill, Coatesville, PA

Date

1/22/2014

Checked

DJR

Drawn

ORD

VA Project Number
542-CSI-203

Building Number
69

Drawing Number
MP111

Dwg. 46 of 86

Office of
Facilities
Management

