



① CORRECT GYPSUM BOARD WALL DEFICIENCIES TO ACHIEVE A SMOKE BARRIER RATING OF THE EXISTING WALL IN ROOM 2EAA TO MEET NFPA101-18.3.6.2.3 "TO FORM A BARRIER TO LIMIT THE TRANSFER OF SMOKE." IN ADDITION, CORRECT AND FIRESTOP ALL PENETRATIONS TO MEET THESE CODE REQUIREMENTS. THE VA ARCHITECTURAL DESIGN MANUAL SECTION 4.24.5 ALLOWS "FOR SMOKE BARRIERS, EXTEND ONE LAYER OF GYPSUM BOARD FROM FLOOR TO UNDERSIDE OF STRUCTURE ABOVE ON PARTITIONS, AND FIRESTOP JUNCTURE OF GYPSUM BOARD AND ADJOINING MATERIAL TO PREVENT THE PASSAGE OF SMOKE." REFER TO PHOTO C1/1.AE601.

② CORRECT GYPSUM BOARD WALL DEFICIENCIES TO ACHIEVE A SMOKE BARRIER RATING OF THE EXISTING WALL IN ROOM 2B05 TO MEET NFPA101-18.3.6.2.3 "TO FORM A BARRIER TO LIMIT THE TRANSFER OF SMOKE." IN ADDITION, CORRECT AND FIRESTOP ALL PENETRATIONS TO MEET THESE CODE REQUIREMENTS. THE VA ARCHITECTURAL DESIGN MANUAL SECTION 4.24.5 ALLOWS "FOR SMOKE BARRIERS, EXTEND ONE LAYER OF GYPSUM BOARD FROM FLOOR TO UNDERSIDE OF STRUCTURE ABOVE ON PARTITIONS, AND FIRESTOP JUNCTURE OF GYPSUM BOARD AND ADJOINING MATERIAL TO PREVENT THE PASSAGE OF SMOKE." REFER TO PHOTO C4/1.AE601.

AREA APPLIED TO THIS PORTION OF PROJECT

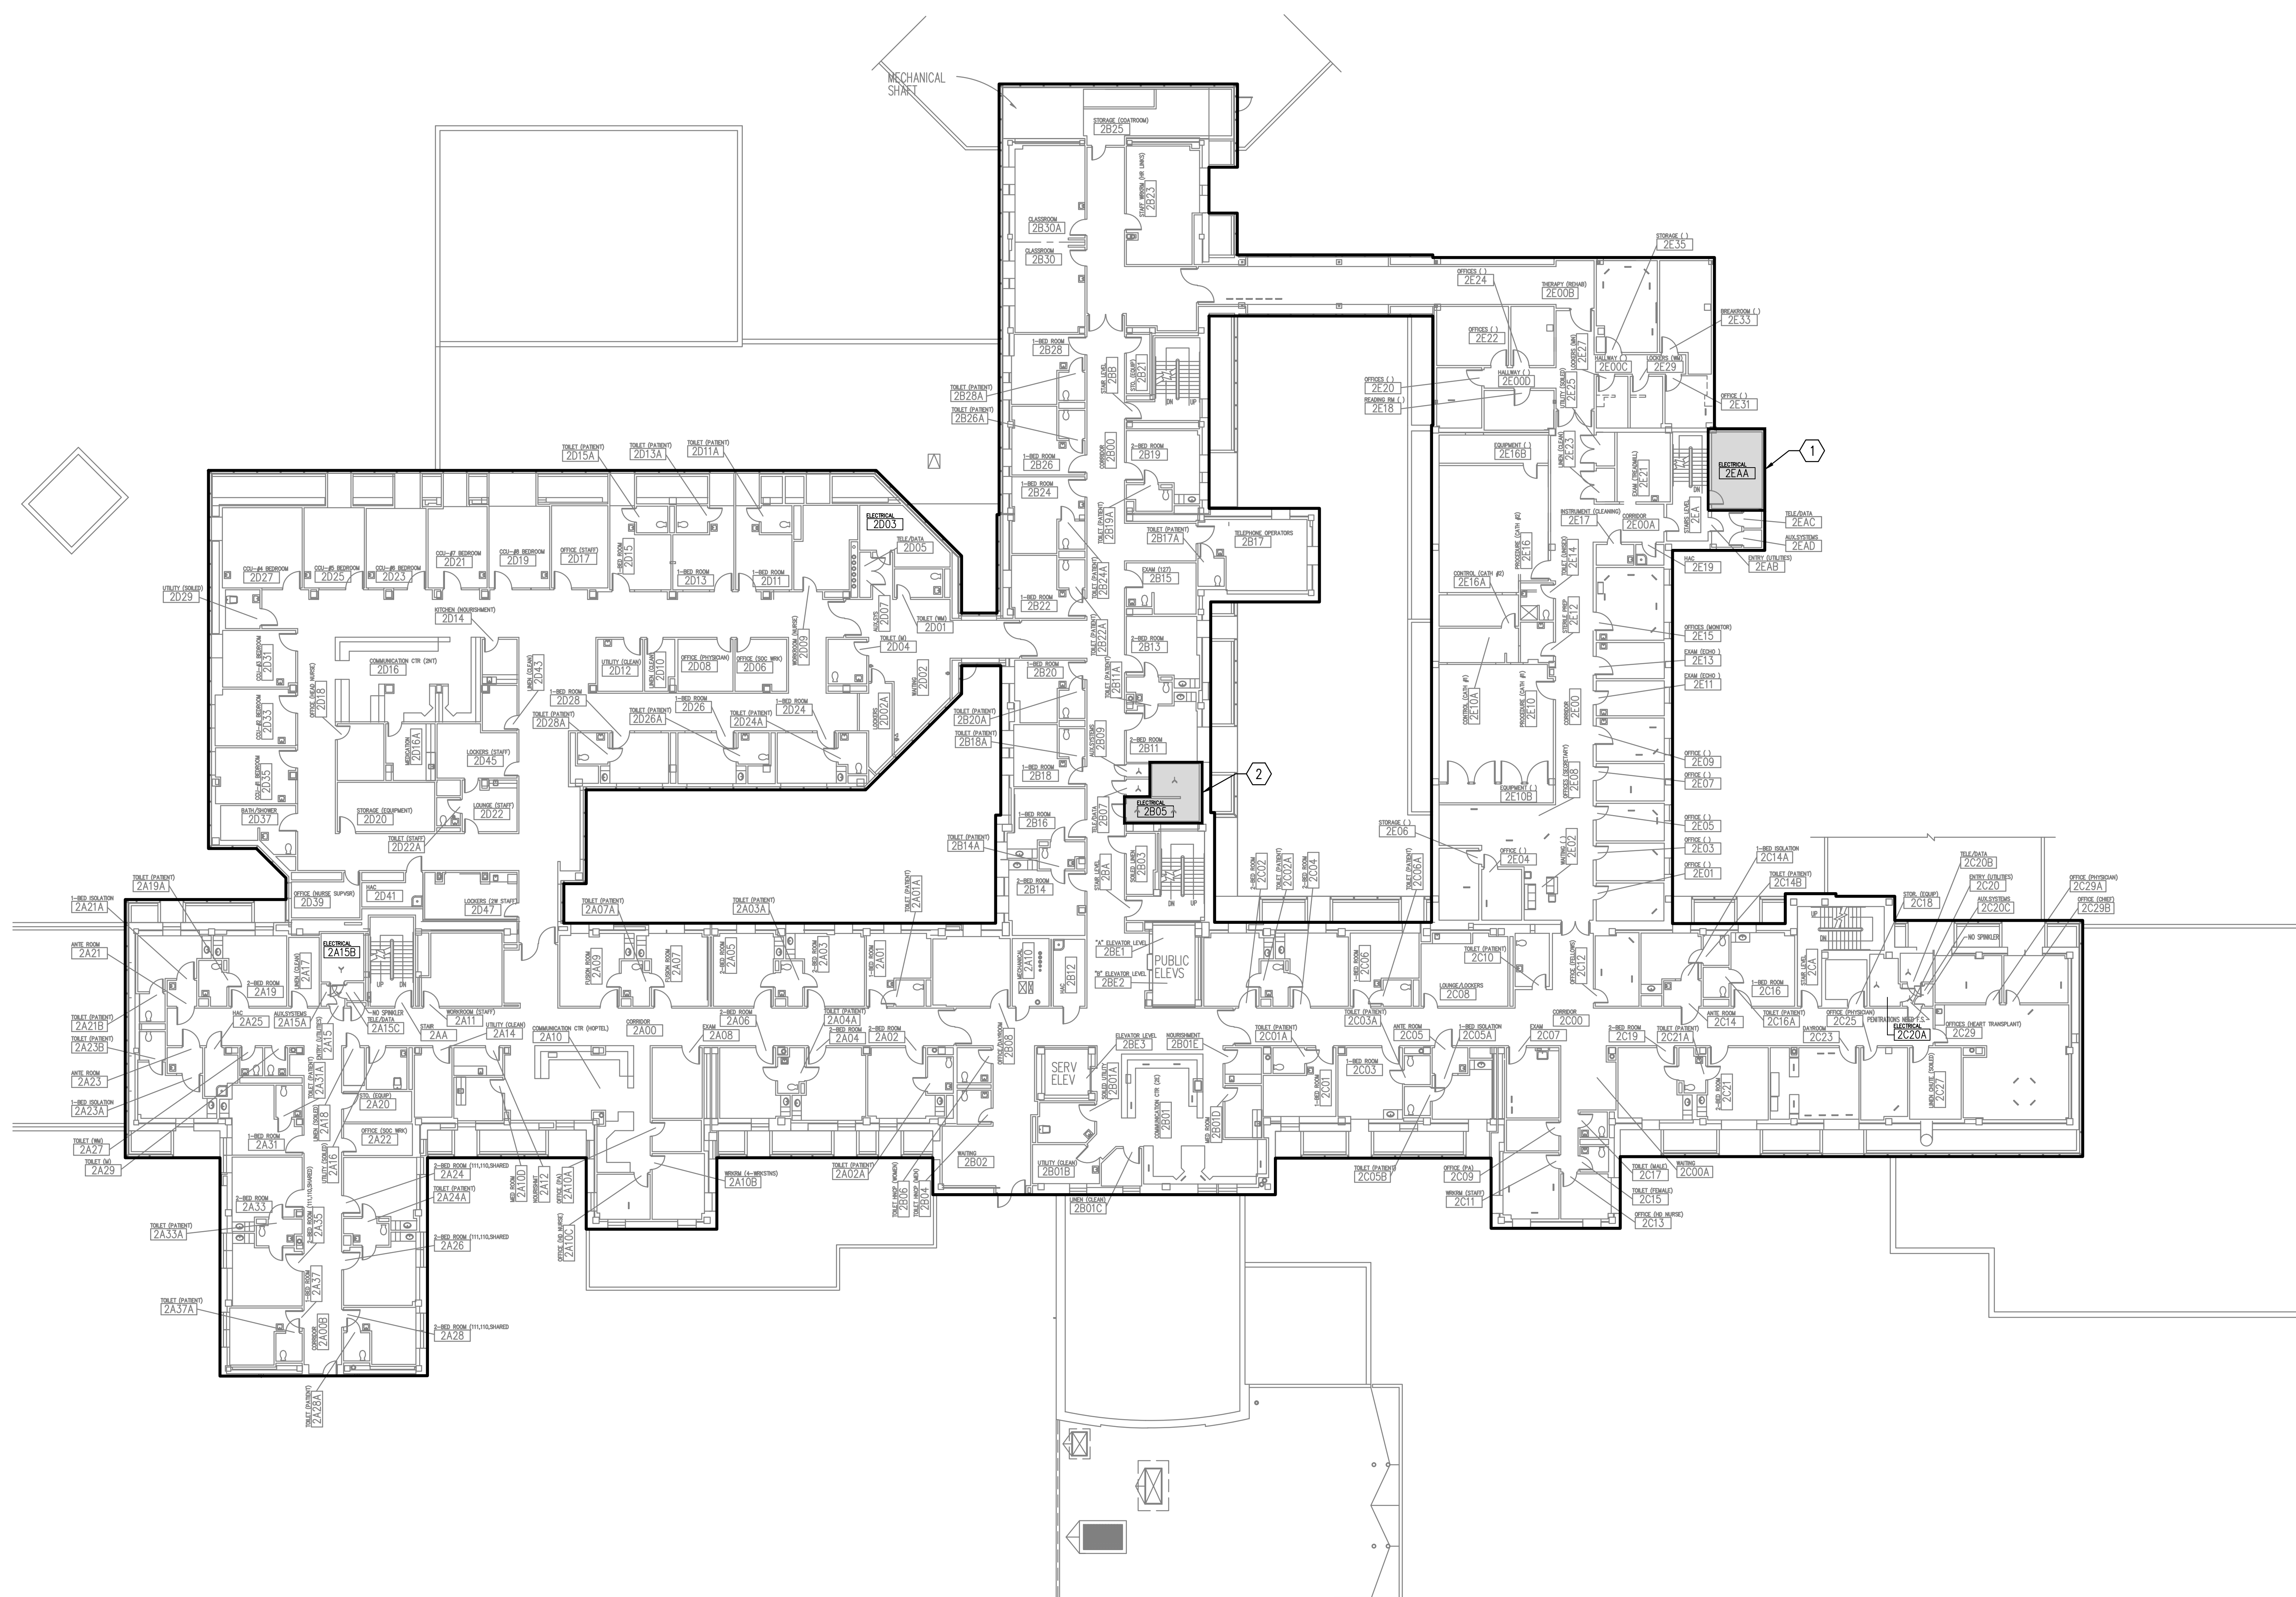

F1 FLOOR PLAN
1/16" = 1'-0"

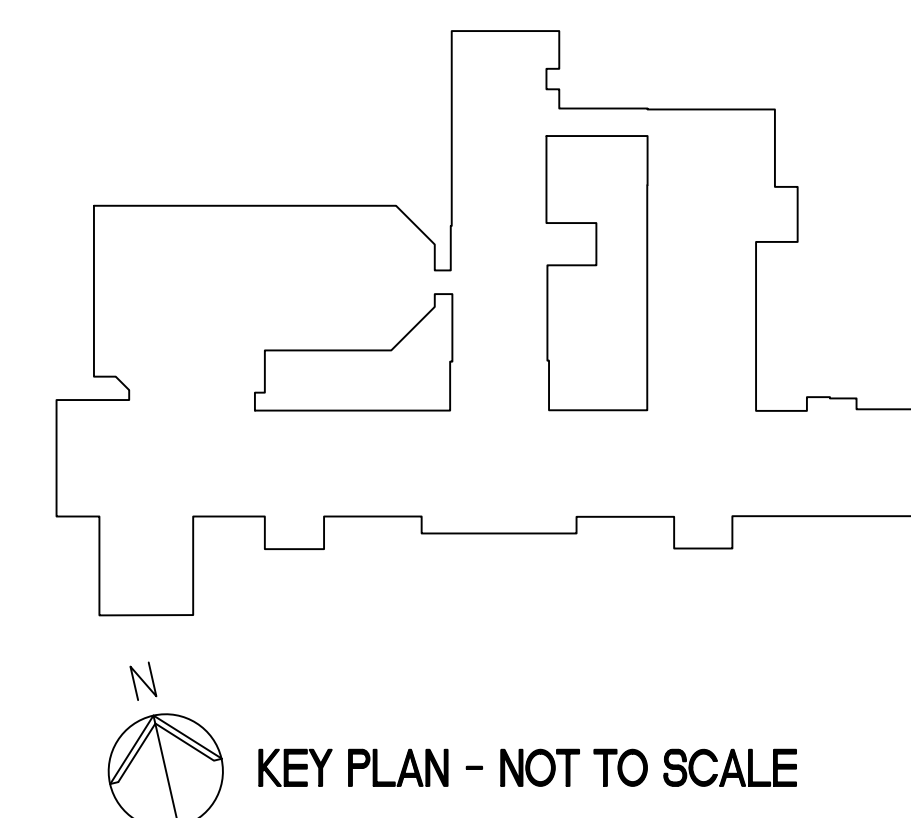

FULLY SPRINKLERED
BID DOCUMENTS
FOR CONSTRUCTION

			ARCHITECT/ENGINEERS:	Project Title: FIRE BARRIER PLAN - SECOND FLOOR BUILDING 1	Project Number: 660-14-104	Office of Construction and Facilities Management
			 200 Enway Circle #201, Louisville KY 40299 -- PH: 502.339.8511 -- www.paradigmusa.com	Approved: Project Director	Building Number: 1	 Department of Veterans Affairs
AMENDMENT #3	5/20/14			Location: GEORGE E WAHLEN VAMC 800 Foothill Dr. SALT LAKE CITY, UT	Drawing Number: 1.AE102	
AMENDMENT #1	5/01/14			Date: 12-13-2013	Checked: KLP	
Revisions:	Date				Drawn: JDM	