

A

W

C

U

I

II

0

three inches = one foot
one and one half inches = one foot
one inch = one foot
three quarters inch = one foot
one half inch = one foot
three eighths inch = one foot
one quarter inch = one foot
one eighth inch = one foot


LIGHT FIXTURE SCHEDULE (WORKING)

No.	FIXTURE	MANUFACTURER	CATALOG #	DESCRIPTION	LAMPS	VOLT.	INPUT WATTS	NOTES
A1		XXXXX	XXXXXXXXX	2x1 2 LAMP FIXTURE	F28T8	277	104	
A2		XXXXXX	XXXXXXXXXX	2x2 2 LAMP FIXTURE	2-54W TSHO	277	xxx	
A3		XXXXXX	XXXXXXXXXX	2x2 2 LAMP FIXTURE	3-54W TSHO	277	xxx	
A4		XXXXXX	XXXXXXXXXX	2x4 2 LAMP FIXTURE (LENSED TROUFLER)	3-54W TSHO	277	104	
I4		XXXXXX	XXXXXXXXXX	1 LAMP INDUSTRIAL 4 FT. STRIP	1-35W MH	277	104	
I2		XXXXXX	XXXXXXXXXX	2 LAMP INDUSTRIAL 4 FT. STRIP WITH REFLECTORS	2-F32T8	277		
C2		PATHWAY	6HF-132T-E4-6HF1SCL	RECESSED DOWNLIGHT	1-32W CFL	277	35	
C2.D		PATHWAY	6HF-132T-D4-6HF1SCL	RECESSED DOWNLIGHT DIMMABLE	1-32W CFL	277	35	
JJ		PATHWAY	6MHT6-3E-W-AHTF61SCL	METAL HALIDE DOWNLIGHT	1-32W MH	277	35	
EX		EXISTING	EXISTING	EXISTING	EXIST	277	EXIST	
RE		EXISTING	EXISTING	RELOCATED	EXIST	277	EXIST	
X1		MCPHILBEN	ESVL (RED LETTERING)	EDGE LIT, LED EXIT WITH RED LETTERING	LAMPS INCL.	277	4	

LIGHTING FIXTURE NOTES


- EQUAL LIGHTING FIXTURE MANUFACTURERS WILL BE CONSIDERED
- CONTRACTOR SHALL PROVIDE PROJECTED DELIVERY DATES FOR ALL SUPPLIED FIXTURES WITH SUBMITTAL. FAILURE WILL RESULT IN REJECTION WITH NO REVIEW.
- ALL NEW FLUORESCENT LAMPS SHALL BE THE SAME COLOR TEMPERATURE, 3500K, OR MATCH EXISTING LAMP TEMPERATURE UNLESS OTHERWISE NOTED.
- SUPPORT ALL RECESSED FIXTURES FROM BUILDING STRUCTURE WITH MINIMUM #12 CEILING HANGER WIRE, FROM EACH CORNER OF FIXTURE.
- FOR EXACT LIGHTING LOCATIONS, SEE ARCHITECTURAL REFLECTED CEILING PLANS.
- PROVIDE MOUNTING TYPES, FACES, AND DIRECTIONAL ARROWS AS INDICATED ON THE FLOOR PLANS FOR ALL EXIT SIGNS.
- PROVIDE EMERGENCY POWER BATTERY PACK APPROPRIATE FOR THE LAMPS AND POWER SUPPLY FOR FIXTURE.
- PROVIDE DIMMING POWER SUPPLY AS REQUIRED FOR DIMMED FIXTURES. COORDINATE WITH POWER SUPPLY MANUFACTURER FOR RECOMMENDED DIMMER CONTROLLER.
- DIMMING CONTROLLER SHALL BE OF SIMILAR APPEARANCE AS ON OTHER LIGHTING CONTROLLERS.
- PROVIDE FIXTURES AND ACCESSORY EQUIPMENT THAT WILL OPERATE THE FIXTURE ASSEMBLY ON THE VOLTAGE OF THE CONNECTED CIRCUIT.
- XX = TO BE DETERMINED BY ARCHITECT.
- CONTRACTOR SHALL COORDINATE ALL COLOR AND FINISHES WITH ARCHITECT PRIOR TO SUBMITTAL REVIEW.

HEADWALL DETAIL

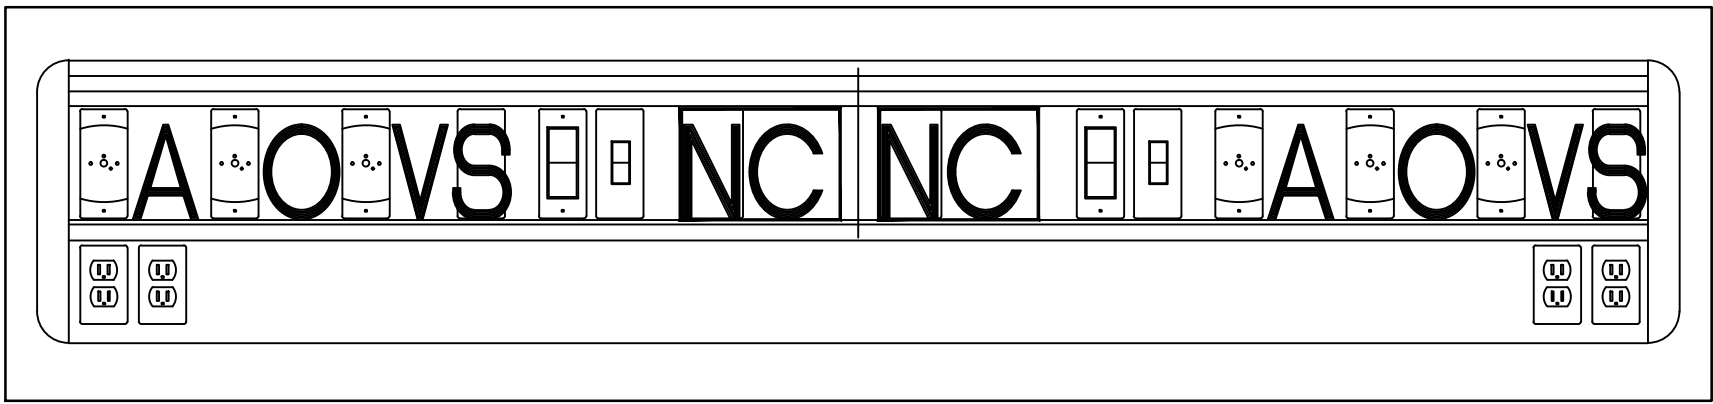

FEATURES
MOUNTING: GRID
VOLTAGE: 120 V
FINISH: ANTI-MICROBIAL WHITE

A= 23-5/8"
B= 22-1/2"
C= 5-7/8"

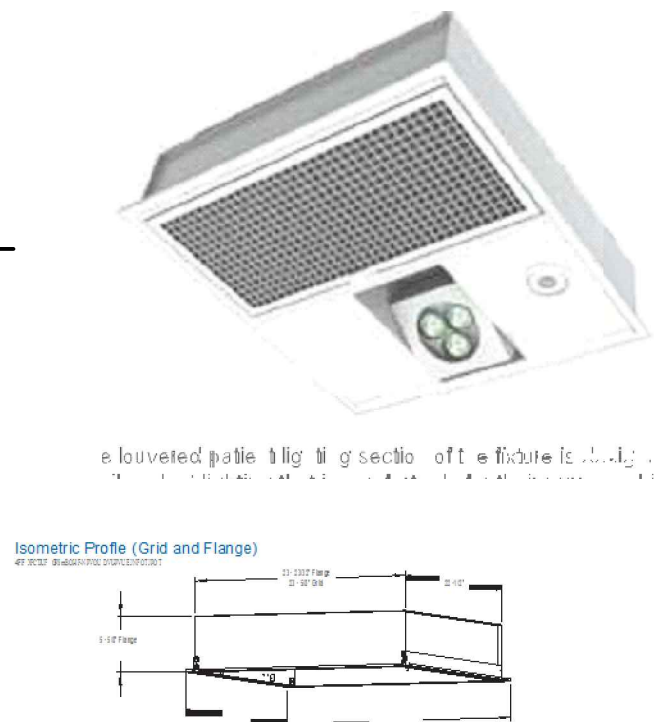

GENERAL DESCRIPTION

HOUSING: 18" Ga STEEL HOUSING, 24 Ga STEEL REFLECTORS, POLYSTYRENE PARABOLIC LOUVER WITH ACRYLIC OVERLAY, SPECULAR SILVER GRID SHIELDS AMBIENT LAMPING, TEMPERED GLASS LENS (EXAM HEAD), POLYESTER NON-YELLOWING POWDER COAT FINISH; ANTI-MICROBIAL POWDER COAT FINISH IS AVAILABLE.

MOUNTING: GRID

SWITCHING: WITH MOTORIZED EXAM HEAD, CLASS 2 LOW VOLTAGE CONTROLLER (STANDARD) FOR PATIENT LIGHTING CONTROL FROM NURSE CALL SYSTEM OR PILLOW SWITCH.


ELECTRICAL: 120 VOLT

PATIENT RM. CEILING LIGHT

FIXTURE TYPE "E"

FEATURES
MOUNTING: SUSPENDED
SHIELDING: WIRE GUARD
BATTERY: NICKEL CADMIUM (90 MINS. TO LAMP)
DUAL INPUT VOLTAGE (120/277 v)

A= 4 1/2"
B= 9 7/16"
C= 1 3/4"

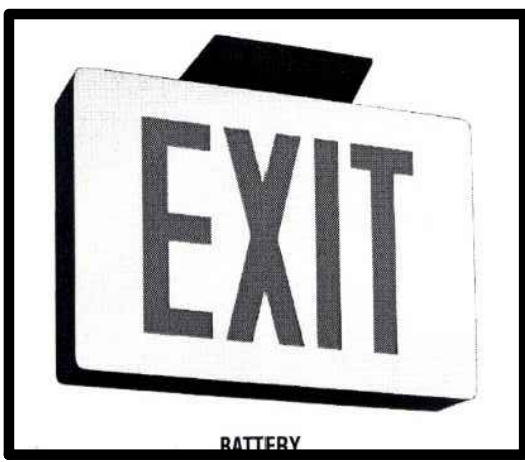

GENERAL DESCRIPTION

HOUSING: ULTRA SLIM AND COMPACT HOUSING, DIE-CAST ALUMINUM SIGNAGE, SUPERIOR ILLUMINATION, HINGE FACEPLATE AND SPRING LATCHES FOR EASY LAMP COMPARTMENT ACCESS.
LAMP IS CONSTRUCTED USING NEW LED TECHNOLOGY. PROVIDES PERFECTLY UNIFORM ILLUMINATION TO MEET 3/4" LETTER STROKE REQUIRED BY CODE.


MOUNTING: CEILING MOUNT

ELECTRICAL: 120/277 VOLT

EXIT LIGHT

FIXTURE TYPE "E" AND "E1"

LOW VOLTAGE, SINGLE CIRCUIT MOTION SENSOR DETAIL

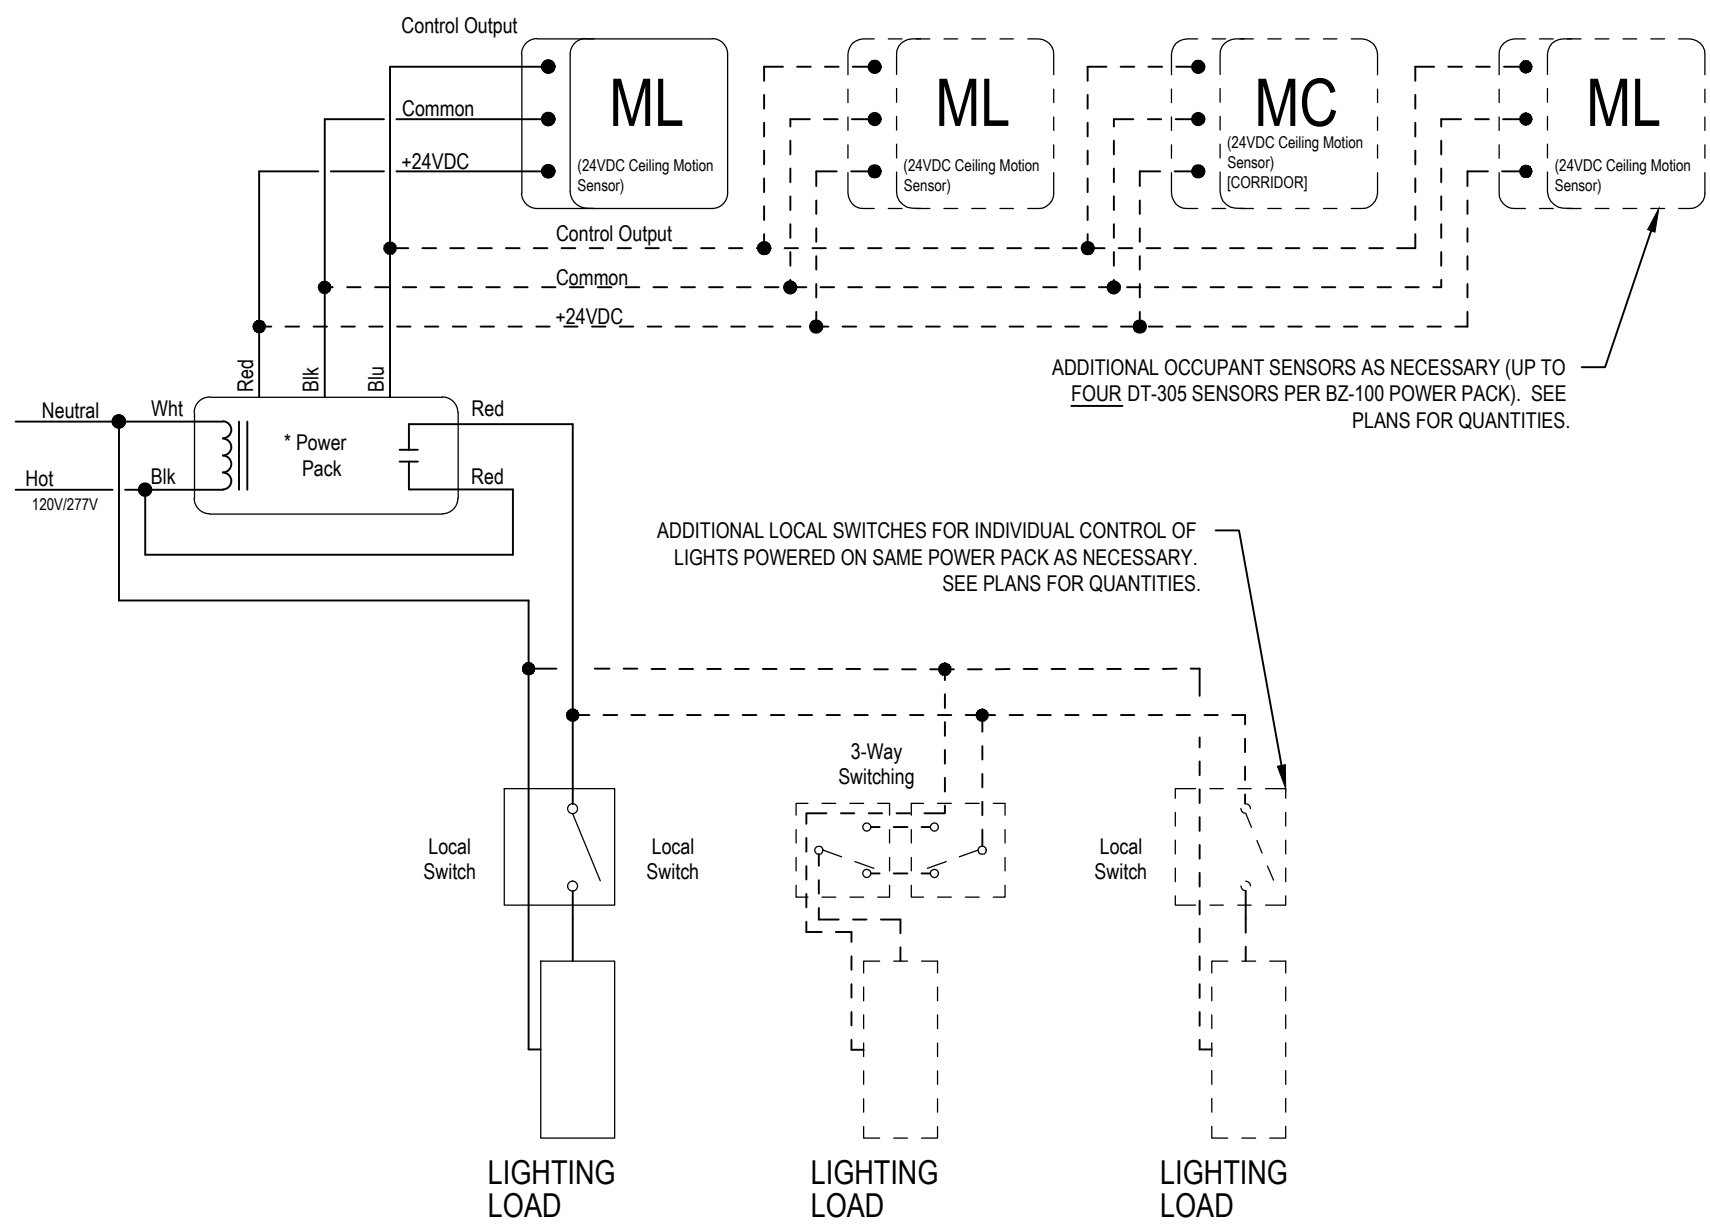

SCALE: NONE
CONTRACTOR SHALL PROVIDE THE APPROPRIATE POWER PACKS TO ACHIEVE DESIGN INTENT
MC = CORRIDOR MOTION SENSOR
ML = AREA MOTION SENSOR

FOR BIDDING PURPOSES ONLY
FINAL SUBMISSION
FULLY SPRINKLERED

CONSULTANTS:		ARCHITECT/ENGINEERS:		Drawing Title	Project Title	Project Number
				ELECTRICAL NEW WORK LIGHTING SCHEDULE AND DETAILS	BALTIMORE VA MEDICAL CENTER MANAGED CARE / ED IMPROVEMENTS AND ENROLLMENT CENTER	512-511
				Scale	Location	Building Number
				NOT TO SCALE	BALTIMORE, MARYLAND	1
				Approved Project Director	Date	Drawing Number
					8/17/2012	EL104
					Checked SN	Dwg. 135 of 175
					Drawn ER	

