


A  
1  
2  
3  
4  
5  
6  
7  
8  
9  
10  
11  
12  
13  
14  
15  
16

three inches = one foot  
one and one half inches = one foot  
one inch = one foot  
three quarters inch = one foot  
one half inch = one foot  
three eighths inch = one foot  
one quarter inch = one foot  
one eighth inch = one foot

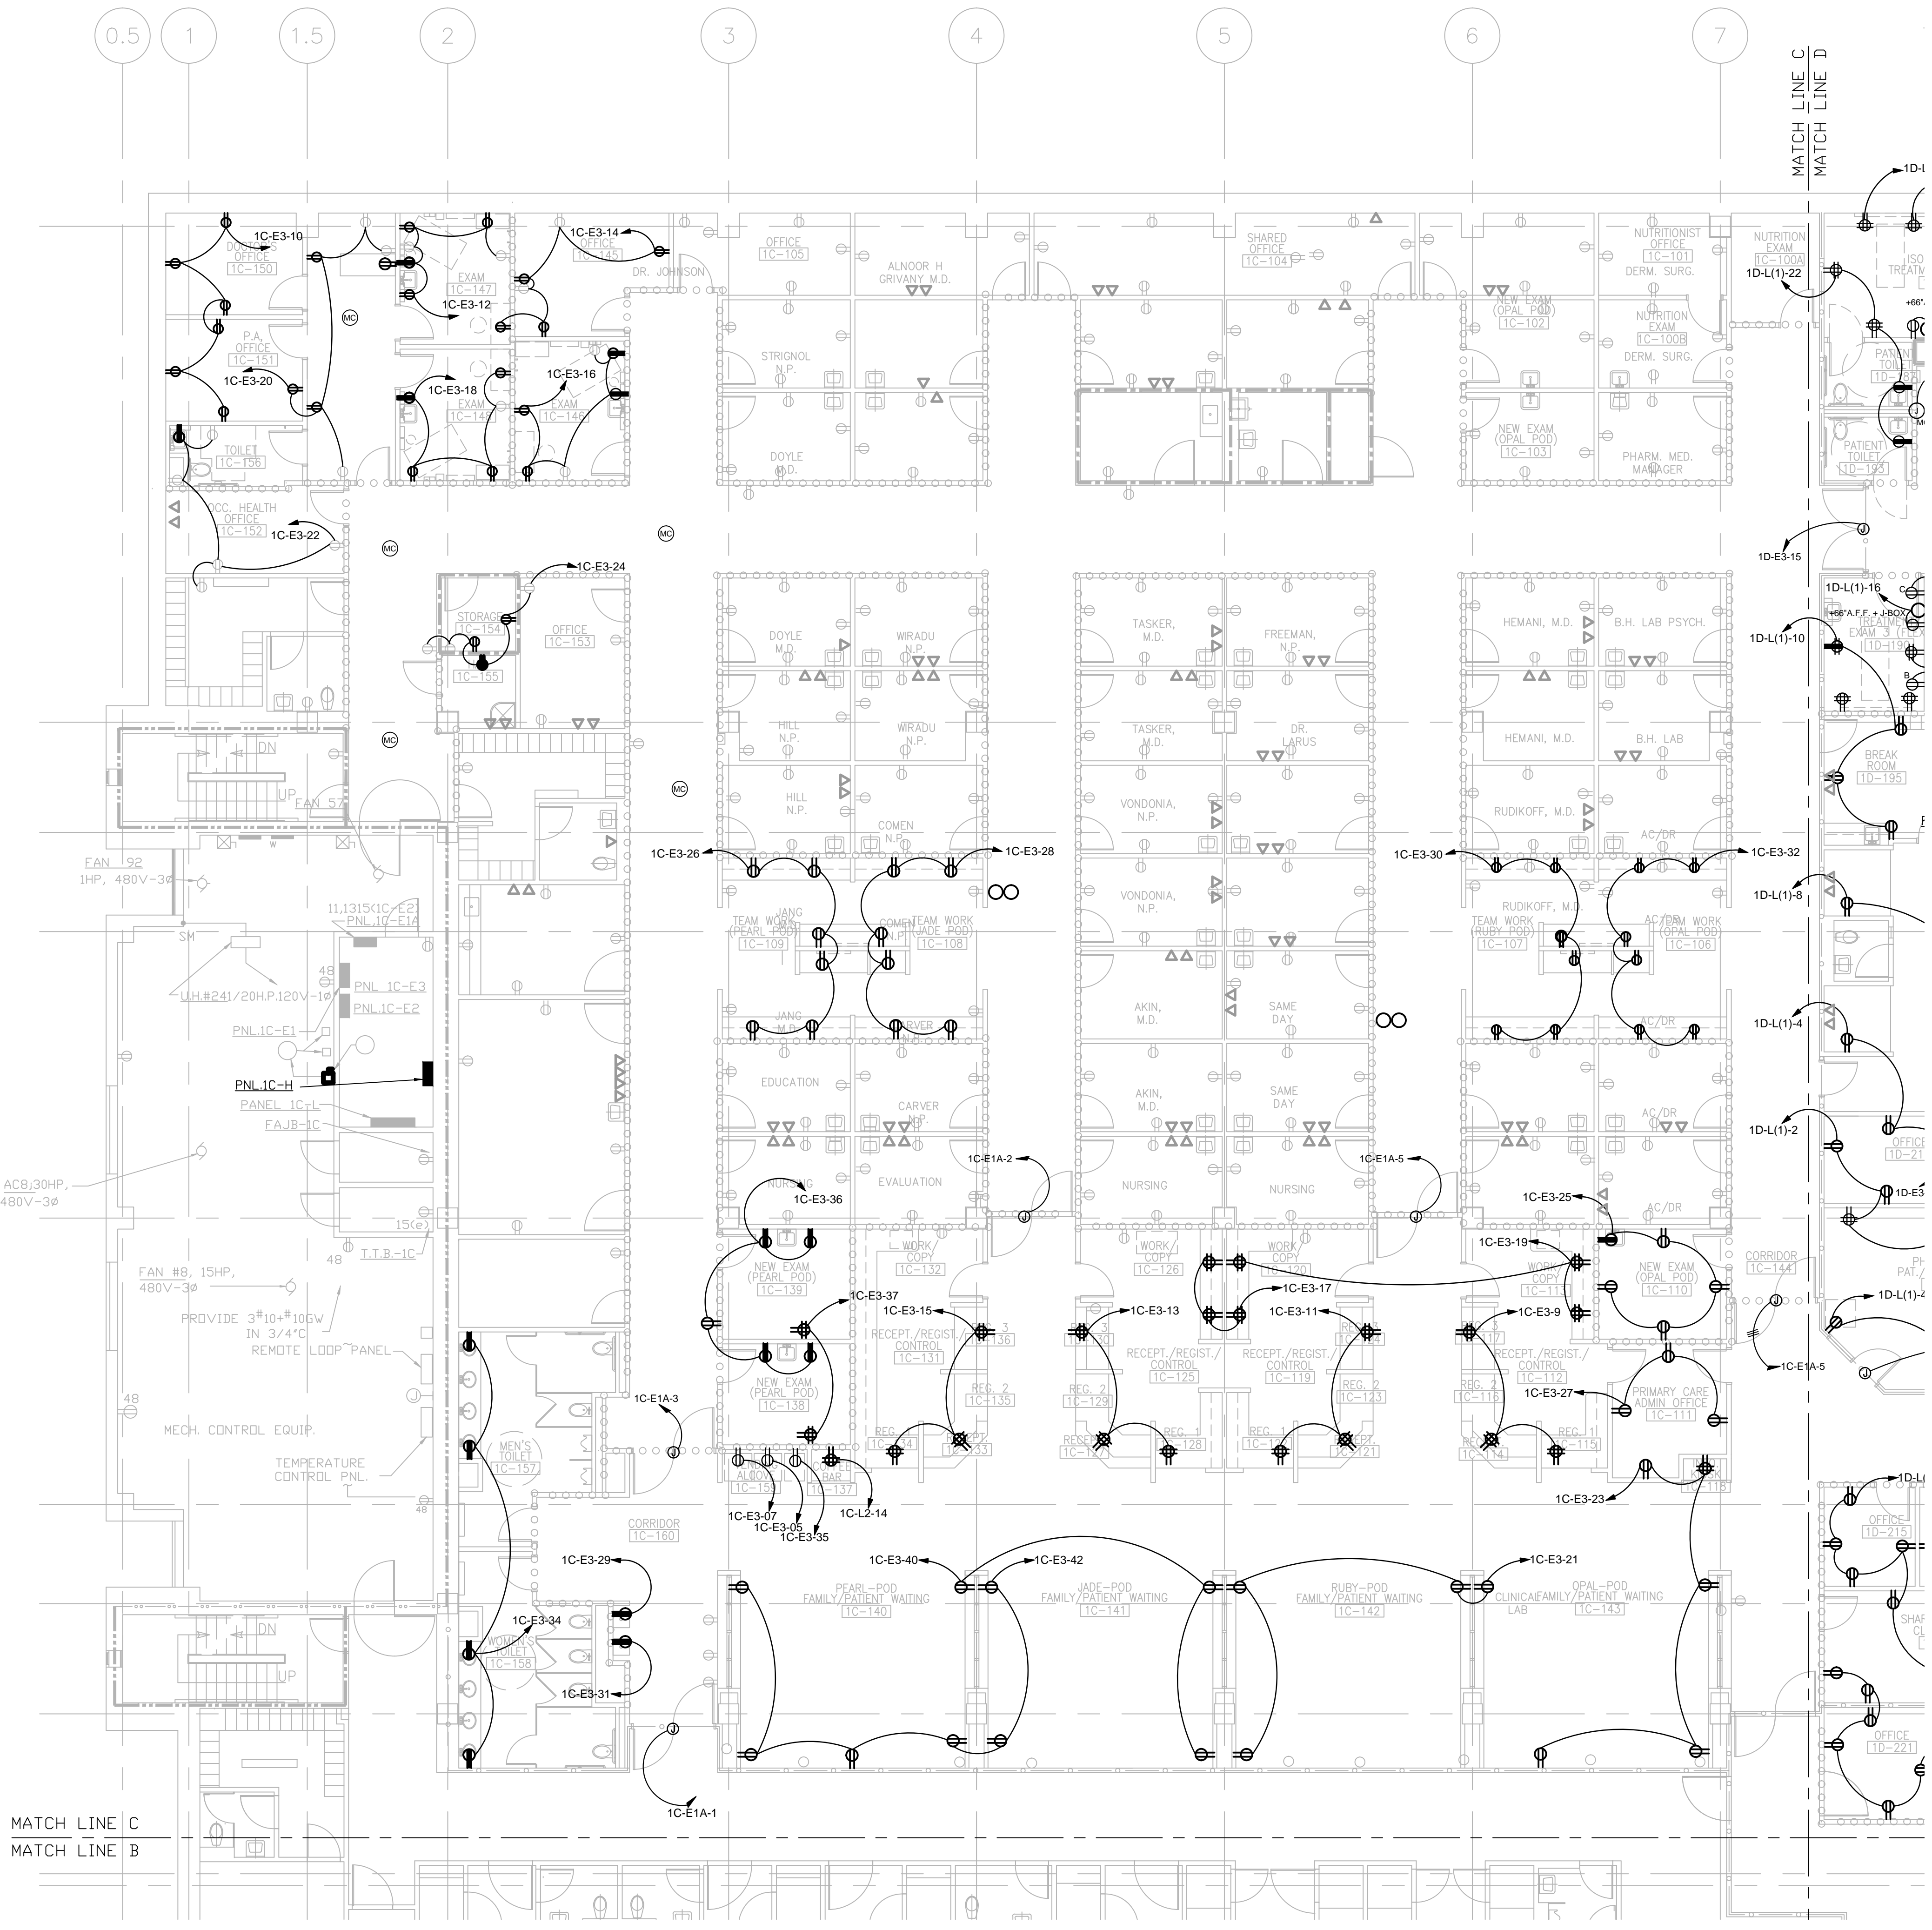


**ELECTRICAL DEMOLITION NOTES:**


1. CONTRACTOR SHALL REMOVE ALL EXISTING WORK THAT WILL NOT BE REUSED DURING NEW CONSTRUCTION, LEAVING THE BUILDING FREE AND CLEAN OF OLD SYSTEMS.
2. THE CONTRACTOR SHALL COORDINATE ALL WORK WITH OTHER TRADES.
3. CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINING FIRE RATING, AND WATERPROOFING INTEGRITY IN ALL CASES.
4. ALL REMOVED ITEMS SHALL BECOME THE PROPERTY OF THE CONTRACTOR FOR DISPOSAL UNLESS OTHERWISE DIRECTED. CONTRACTOR SHALL COORDINATE FOR ITEMS THAT SHALL BE RETURNED TO OWNER. OTHER ITEMS THAT ARE NOT REQUIRED TO BE TURNED IN SHALL BECOME THE PROPERTY OF THE CONTRACTOR FOR DISPOSAL.
5. DEMOLITION SHALL BE WELL COORDINATED TO MINIMIZE DOWN TIME OF SYSTEMS THAT WILL REMAIN IN OPERATION.
6. PROVIDE CAP OFF CONNECTIONS FOR ALL REMOVED OR CUT OFF WORK THAT WILL NOT BE RECONNECTED DURING THE NEW WORK PHASE AND WILL BE REQUIRED TO REMAIN IN OPERATION.
7. REMOVE ALL EXPOSED, ELECTRICAL SERVICES THAT ARE NOT GOING TO BE REUSED IN NEW WORK BACK TO SOURCE.
8. WHEN DEMOLITION WORK IS AFFECTING EXISTING UTILITIES SERVING BASE BUILDING, CONTRACTOR SHALL RELOCATE, REROUTE, OFFSET IN CEILING SPACE, OR UNDER FLOOR SLAB, (SAW CUT SLAB WHEN REQUIRED) AND RELOCATE ALL SERVICES IN ACCORDANCE WITH ALL APPLICABLE CODES, REGULATIONS AND GOOD PRACTICE OF TRADES. COORDINATE WITH BUILDING OWNER REPRESENTATIVE, AND MAKE PROVISIONS FOR TEMPORARY SERVICES AS REQUIRED. CONTRACTOR SHALL COORDINATE AND GIVE ADEQUATE NOTICE TO BUILDING OWNER OR ITS REPRESENTATIVE PRIOR TO WORK IN ANY BASE BUILDING UTILITIES.
9. ALL ELECTRICAL DEVICES IN WALLS TO BE DEMOLISHED SHALL BE REMOVED UNLESS OTHERWISE NOTED. MAINTAIN CIRCUIT CONTINUITY FOR DEVICES THAT REMAIN.
10. SUPPORT ALL CEILING MOUNTED DEVICES INDEPENDENT OF CEILING GRIDS & TILES, WHICH WILL BE REMOVED & REINSTALLED WHEN NEW WALLS ARE CONSTRUCTED.
11. REMOVE ALL EXISTING ELECTRICAL EQUIPMENT IN THIS AREA UNLESS OTHERWISE NOTED TO REMAIN, INCLUDING LIGHTING FIXTURES, SWITCHES, RECEPTACLES, EXPOSED CONDUIT, SURFACE AND FLUSH DEVICES BOXES, DEVICE PLATES, ETC. REMOVE ALL WIRING FROM EXISTING CONDUITS, CUT BACK CAP AND ABANDON ALL CONCEALED CONDUITS AS REQUIRED.
12. MAINTAIN AND RESTORE, IF INTERRUPTED, ALL CONDUITS AND FEEDERS PASSING THROUGH RENOVATED AREAS AND SERVICING UNDISTURBED AREAS.
13. EXISTING CONDUIT FOUND TO BE REUSABLE MAY BE USED. ALL OTHER MATERIAL SHALL BE REMOVED FROM THE JOB SITE UNLESS OTHERWISE DIRECTED BY THE RESIDENT ENGINEER.
14. EXISTING ELECTRICAL WORK TO REMAIN IN THIS AREA, RESTORE ALL CIRCUITS INTERRUPTED BY NEW WORK.
15. REMOVE EXISTING TELEPHONE SERVICE, AND BRANCH CIRCUITS. COORDINATE DEMOLITION WITH TELEPHONE COMPANY.
16. PARTIAL BRANCH CIRCUIT WIRING DENOTING EXISTING CONTROL OR SWITCHING ON THE DRAWING IS SHOWN FOR REFERENCE/CLARIFICATION ONLY, AND IS NOT TO BE CONSTRUED TO IMPLY COMPLETE CIRCUIT WIRING. THE LOCATION OF THE INTERCONNECTION OF CONTROL DEVICE, AND EQUIPMENT CONTROLLED IS DIAGRAMMATIC ONLY.

**DEMOLITION/NEW WORK LEGEND:**

- (E) DENOTES EXISTING TO REMAIN.
- (R) DENOTES EXISTING TO BE REMOVED.
- (RE) DENOTES EXISTING TO BE RELOCATED.
- (ER) DENOTES NEW LOCATION OF EXISTING RELOCATED. (\*)
- (N) DENOTES NEW TO MATCH EXISTING.
- (\*) EXTEND BRANCH CIRCUIT WIRING AS REQUIRED.

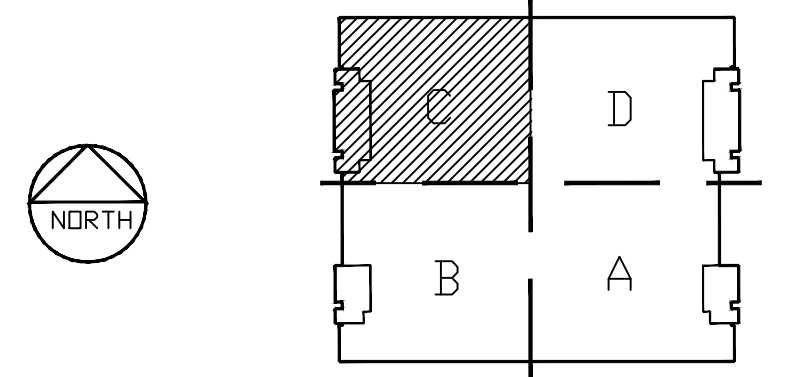

**FOR BIDDING PURPOSES ONLY  
FINAL SUBMISSION  
FULLY SPRINKLERED**
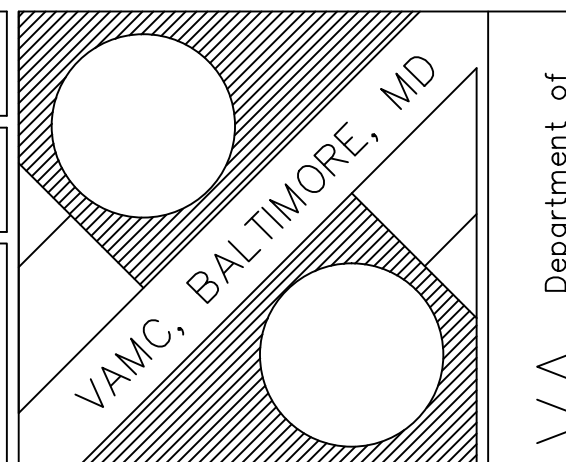
<b>CONSULTANTS:</b>		<b>ARCHITECT/ENGINEERS:</b>		<b>Drawing Title</b> ELECTRICAL NEW WORK AREA C-POWER	<b>Project Title</b> BALTIMORE VA MEDICAL CENTER MANAGED CARE / ED IMPROVEMENTS AND ENROLLMENT CENTER	<b>Project Number</b> 512-511		
				<b>Scale</b> 1/8"=1'-0"	<b>Location</b> BALTIMORE, MARYLAND	<b>Building Number</b> 1		
				<b>Approved Project Director</b>	<b>Date</b> 8/17/2012	<b>Drawing Number</b> EP102		
					<b>Checked</b> SN	<b>Drawn</b> LG		
<b>Revisions:</b>						<b>Dwg.</b> 138 of 175		
PRELIMINARY								
08/22/11								
Date								