



1 POWER NOTES

- OVERHEAD POWER CONDUIT ROUTING AND JUNCTIONPULLBOXES ARE INDICATED TO SHOW DESIGN INTENT. FIELD VERIFY EXISTING CONDITIONS PRIOR TO ROUTING CONDUIT THROUGH THE ELECTRICAL ROOMS.
- EXISTING UNDERGROUND FIRE SPRINKLER, DOMESTIC WATER, AND IRRIGATION LINES. COORDINATE FINAL LOCATION WITH COTR PRIOR TO ANY EXCAVATION.
- OVERHEAD DATA TELEPHONE CONDUIT ROUTING AND JUNCTIONPULLBOXES ARE INDICATED TO SHOW DESIGN INTENT. FIELD VERIFY EXISTING CONDITIONS PRIOR TO ROUTING CONDUIT THROUGH CORRIDOR AND ROOMS. COORDINATE PROPOSED ROUTING WITH OWNERS FACILITIES GROUP. EXTEND CONDUIT AND CABLEING TO FINAL EQUIPMENT LOCATION. REPLACE ANY EXISTING CONDUIT AND CABLEING WITH NEW CONDUIT AND CABLEING. MATCH EXISTING PENETRATIONS. PROVIDE ALL REQUIRED WALL PATCHING TO MATCH EXISTING.
- UNDERGROUND ELECTRICAL DUCTBANK (RE: 1E5001). COORDINATE EXCAVATION AND DUCTBANK LOCATION WITH COTR PRIOR TO ANY EXCAVATION. COORDINATE WITH THE TOP OF DUCTBANK SHALL BE A MINIMUM OF 14" BELOW BOTTOM OF NEW UTILITY TUNNEL.
- CEILING MOUNTED JUNCTION BOX. PROVIDE BARRIERED SEPARATION WITHIN BOX OR PROVIDE SEPARATE ENCLOSURES BETWEEN CRITICAL WIRING AND EQUIPMENT/NORMAL WIRING. FIELD VERIFY EXISTING CONDITIONS PRIOR TO ROUTING CONDUIT THROUGH CEILING. COORDINATE WITH THE TOP OF DUCTBANK SHALL BE A MINIMUM OF 14" BELOW BOTTOM OF NEW UTILITY TUNNEL.
- WALL MOUNTED NEMA-4 EXTERIOR WIREWAY. ROUTE WIREWAY ALONG THE EXTERIOR OF BUILDING. PROVIDE BARRIERED SEPARATION WITHIN WIREWAY OR PROVIDE SEPARATE ENCLOSURE SEPARATING CRITICAL WIRING FROM EQUIPMENT/NORMAL WIRING. COORDINATE WITH THE TOP OF DUCTBANK SHALL BE A MINIMUM OF 14" BELOW BOTTOM OF NEW UTILITY TUNNEL. PROVIDE WEATHER PROOF PARALLEL INSULATED TAPERED TERMINAL PLUGS WITHIN THE WIREWAY AT THE WALL PENETRATION TO MINIMIZE WIREWAY DEPTH. PROVIDE BOX-LEDED ACCESS OPENINGS TO THE WIREWAY. PROVIDE BARRIERED SEPARATION WITHIN WIREWAY OR PROVIDE SEPARATE ENCLOSURE SEPARATING CRITICAL WIRING FROM EQUIPMENT/NORMAL WIRING. COORDINATE WITH THE TOP OF DUCTBANK SHALL BE A MINIMUM OF 14" BELOW BOTTOM OF NEW UTILITY TUNNEL. PROVIDE WEATHER PROOF PARALLEL INSULATED TAPERED TERMINAL PLUGS WITHIN THE WIREWAY AT THE WALL PENETRATION TO MINIMIZE WIREWAY DEPTH. PROVIDE BOX-LEDED ACCESS OPENINGS TO THE WIREWAY. PROVIDE BARRIERED SEPARATION WITHIN WIREWAY OR PROVIDE SEPARATE ENCLOSURE SEPARATING CRITICAL WIRING FROM EQUIPMENT/NORMAL WIRING. COORDINATE WITH THE TOP OF DUCTBANK SHALL BE A MINIMUM OF 14" BELOW BOTTOM OF NEW UTILITY TUNNEL.
- RGS CONDUIT ROUTED ABOVE CEILING TILE. COORDINATE CONDUIT ROUTING WITHIN CEILING POWER CONDUITS PRIOR TO ROUGH-IN. COORDINATE WORK WITH VA TO MINIMIZE DISRUPTION TO THE AREA. REPLACE ANY CEILING TILES DAMAGED IN THE INSTALLATION PROCESS. SEAL ALL PENETRATIONS. PROVIDE ALL REQUIRED WALL PATCHING TO MATCH EXISTING.
- WALL MOUNTED NEMA-4 EXTERIOR WIREWAY. PROVIDE BARRIERED SEPARATION WITHIN WIREWAY OR PROVIDE SEPARATE ENCLOSURE SEPARATING CRITICAL WIRING FROM EQUIPMENT/NORMAL WIRING. COORDINATE WITH THE TOP OF DUCTBANK SHALL BE A MINIMUM OF 14" BELOW BOTTOM OF NEW UTILITY TUNNEL. PROVIDE WEATHER PROOF PARALLEL INSULATED TAPERED TERMINAL PLUGS WITHIN THE WIREWAY AT THE WALL PENETRATION TO MINIMIZE WIREWAY DEPTH. PROVIDE BOX-LEDED ACCESS OPENINGS TO THE WIREWAY. PROVIDE BARRIERED SEPARATION WITHIN WIREWAY OR PROVIDE SEPARATE ENCLOSURE SEPARATING CRITICAL WIRING FROM EQUIPMENT/NORMAL WIRING. COORDINATE WITH THE TOP OF DUCTBANK SHALL BE A MINIMUM OF 14" BELOW BOTTOM OF NEW UTILITY TUNNEL.
- EXISTING EXTERIOR WALL LOUVER AND ASSOCIATED EXHAUST FAN. POWER AND CONTROLS TO BE KEPT INTACT & FUNCTIONING. RELOCATE EXISTING SIEMENS CONTROL PANEL TO AD IN THE INSTALLATION OF NEW CONDUIT WIREWAY.
- EXISTING ELECTRICAL EQUIPMENT AND CONDUIT. COORDINATE EXACT LOCATIONS OF EXISTING UNDERGROUND UTILITIES WITH THE WAC COTR PRIOR TO ANY SOIL EXCAVATION AND ROUGH-IN.
- INTERIOR UNFINISHED WIREWAYS. PROVIDE EXISTING EXHAUST FANS/SHROUD. ROUTE CRITICAL SYSTEM WIREWAY ABOVE FAN AND NORMAL EQUIPMENT WIREWAY BELOW FAN. PROVIDE CONDUIT STUB WALL PENETRATIONS FOR NEW FEEDER CABLE THROUGH EXISTING CEILING. PROVIDE BARRIERED SEPARATION WITHIN WIREWAY OR PROVIDE SEPARATE ENCLOSURE SEPARATING CRITICAL WIRING FROM EQUIPMENT/NORMAL WIRING. COORDINATE WITH THE TOP OF DUCTBANK SHALL BE A MINIMUM OF 14" BELOW BOTTOM OF NEW UTILITY TUNNEL.
- CONDUIT DUCTBANK ROUTED UNDER NEW MECHANICAL ROOM FLOOR SLAB (RE: 2E5020). FAN OUT CONDUITS TO RISER LOCATIONS AS SHOWN ON DRAWINGS PLANS. REFER TO STRUCTURAL PLANS FOR RISER LOCATIONS. PROVIDE ALL REQUIRED WALL PATCHING TO MATCH EXISTING.
- OVERHEAD PUBLIC ADDRESS CONDUIT ROUTING AND JUNCTIONPULLBOXES ARE INDICATED TO SHOW DESIGN INTENT. FIELD VERIFY EXISTING CONDITIONS PRIOR TO ROUTING CONDUIT THROUGH CORRIDOR AND ROOMS. COORDINATE PROPOSED ROUTING WITH OWNERS FACILITIES GROUP. EXTEND CONDUIT AND CABLEING TO FINAL EQUIPMENT LOCATION. REPLACE ANY CEILING TILES DAMAGED IN THE INSTALLATION PROCESS. SEAL ALL WALL/CEILING PENETRATIONS. PROVIDE ALL REQUIRED WALL PATCHING TO MATCH EXISTING.
- COORDINATE OPTICAL FIBER CABLE IN G-30 EXISTING CABINET USING ST CONNECTORS. COORDINATE PROPOSED LOCATION WITH VETERANS ADMINISTRATION, VA.
- PUNCH-DOWN 100 PAIR COPPER IN EXISTING TELECOM ROOM G-29. COORDINATE WITH EXISTING 110-BLOCK TERMINATIONS AND VETERANS ADMINISTRATION, VA EQUIPMENT.

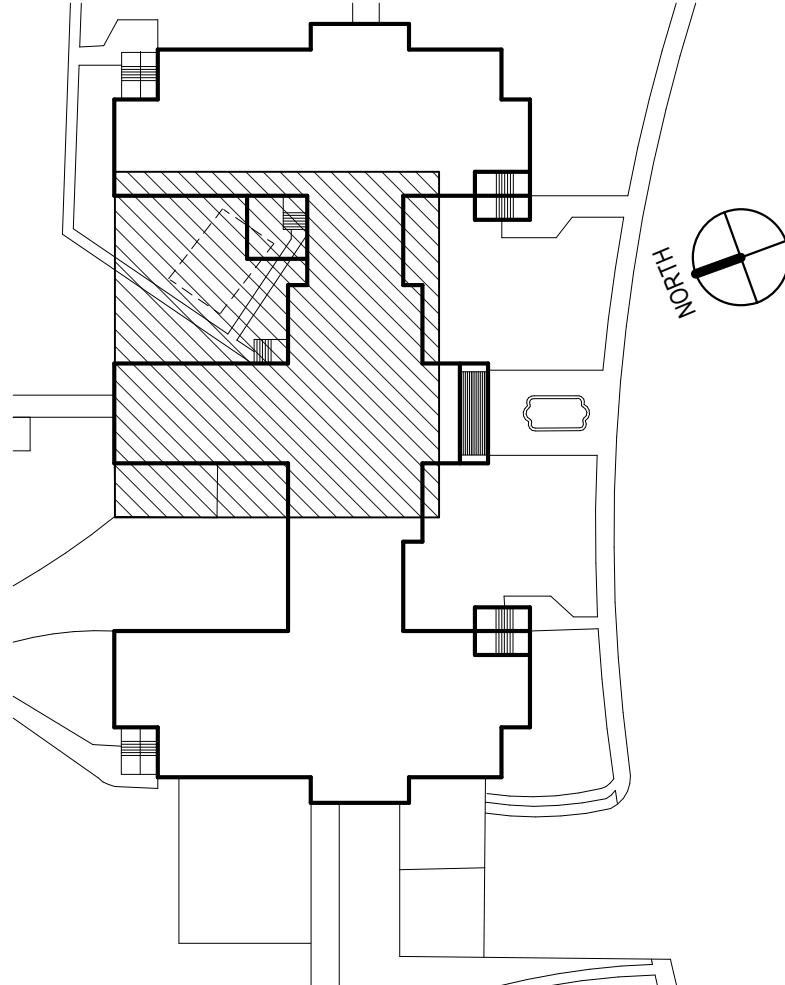


KEY PLAN - BUILDING 1(ELECTRICAL)

FULLY SPRINKLERED

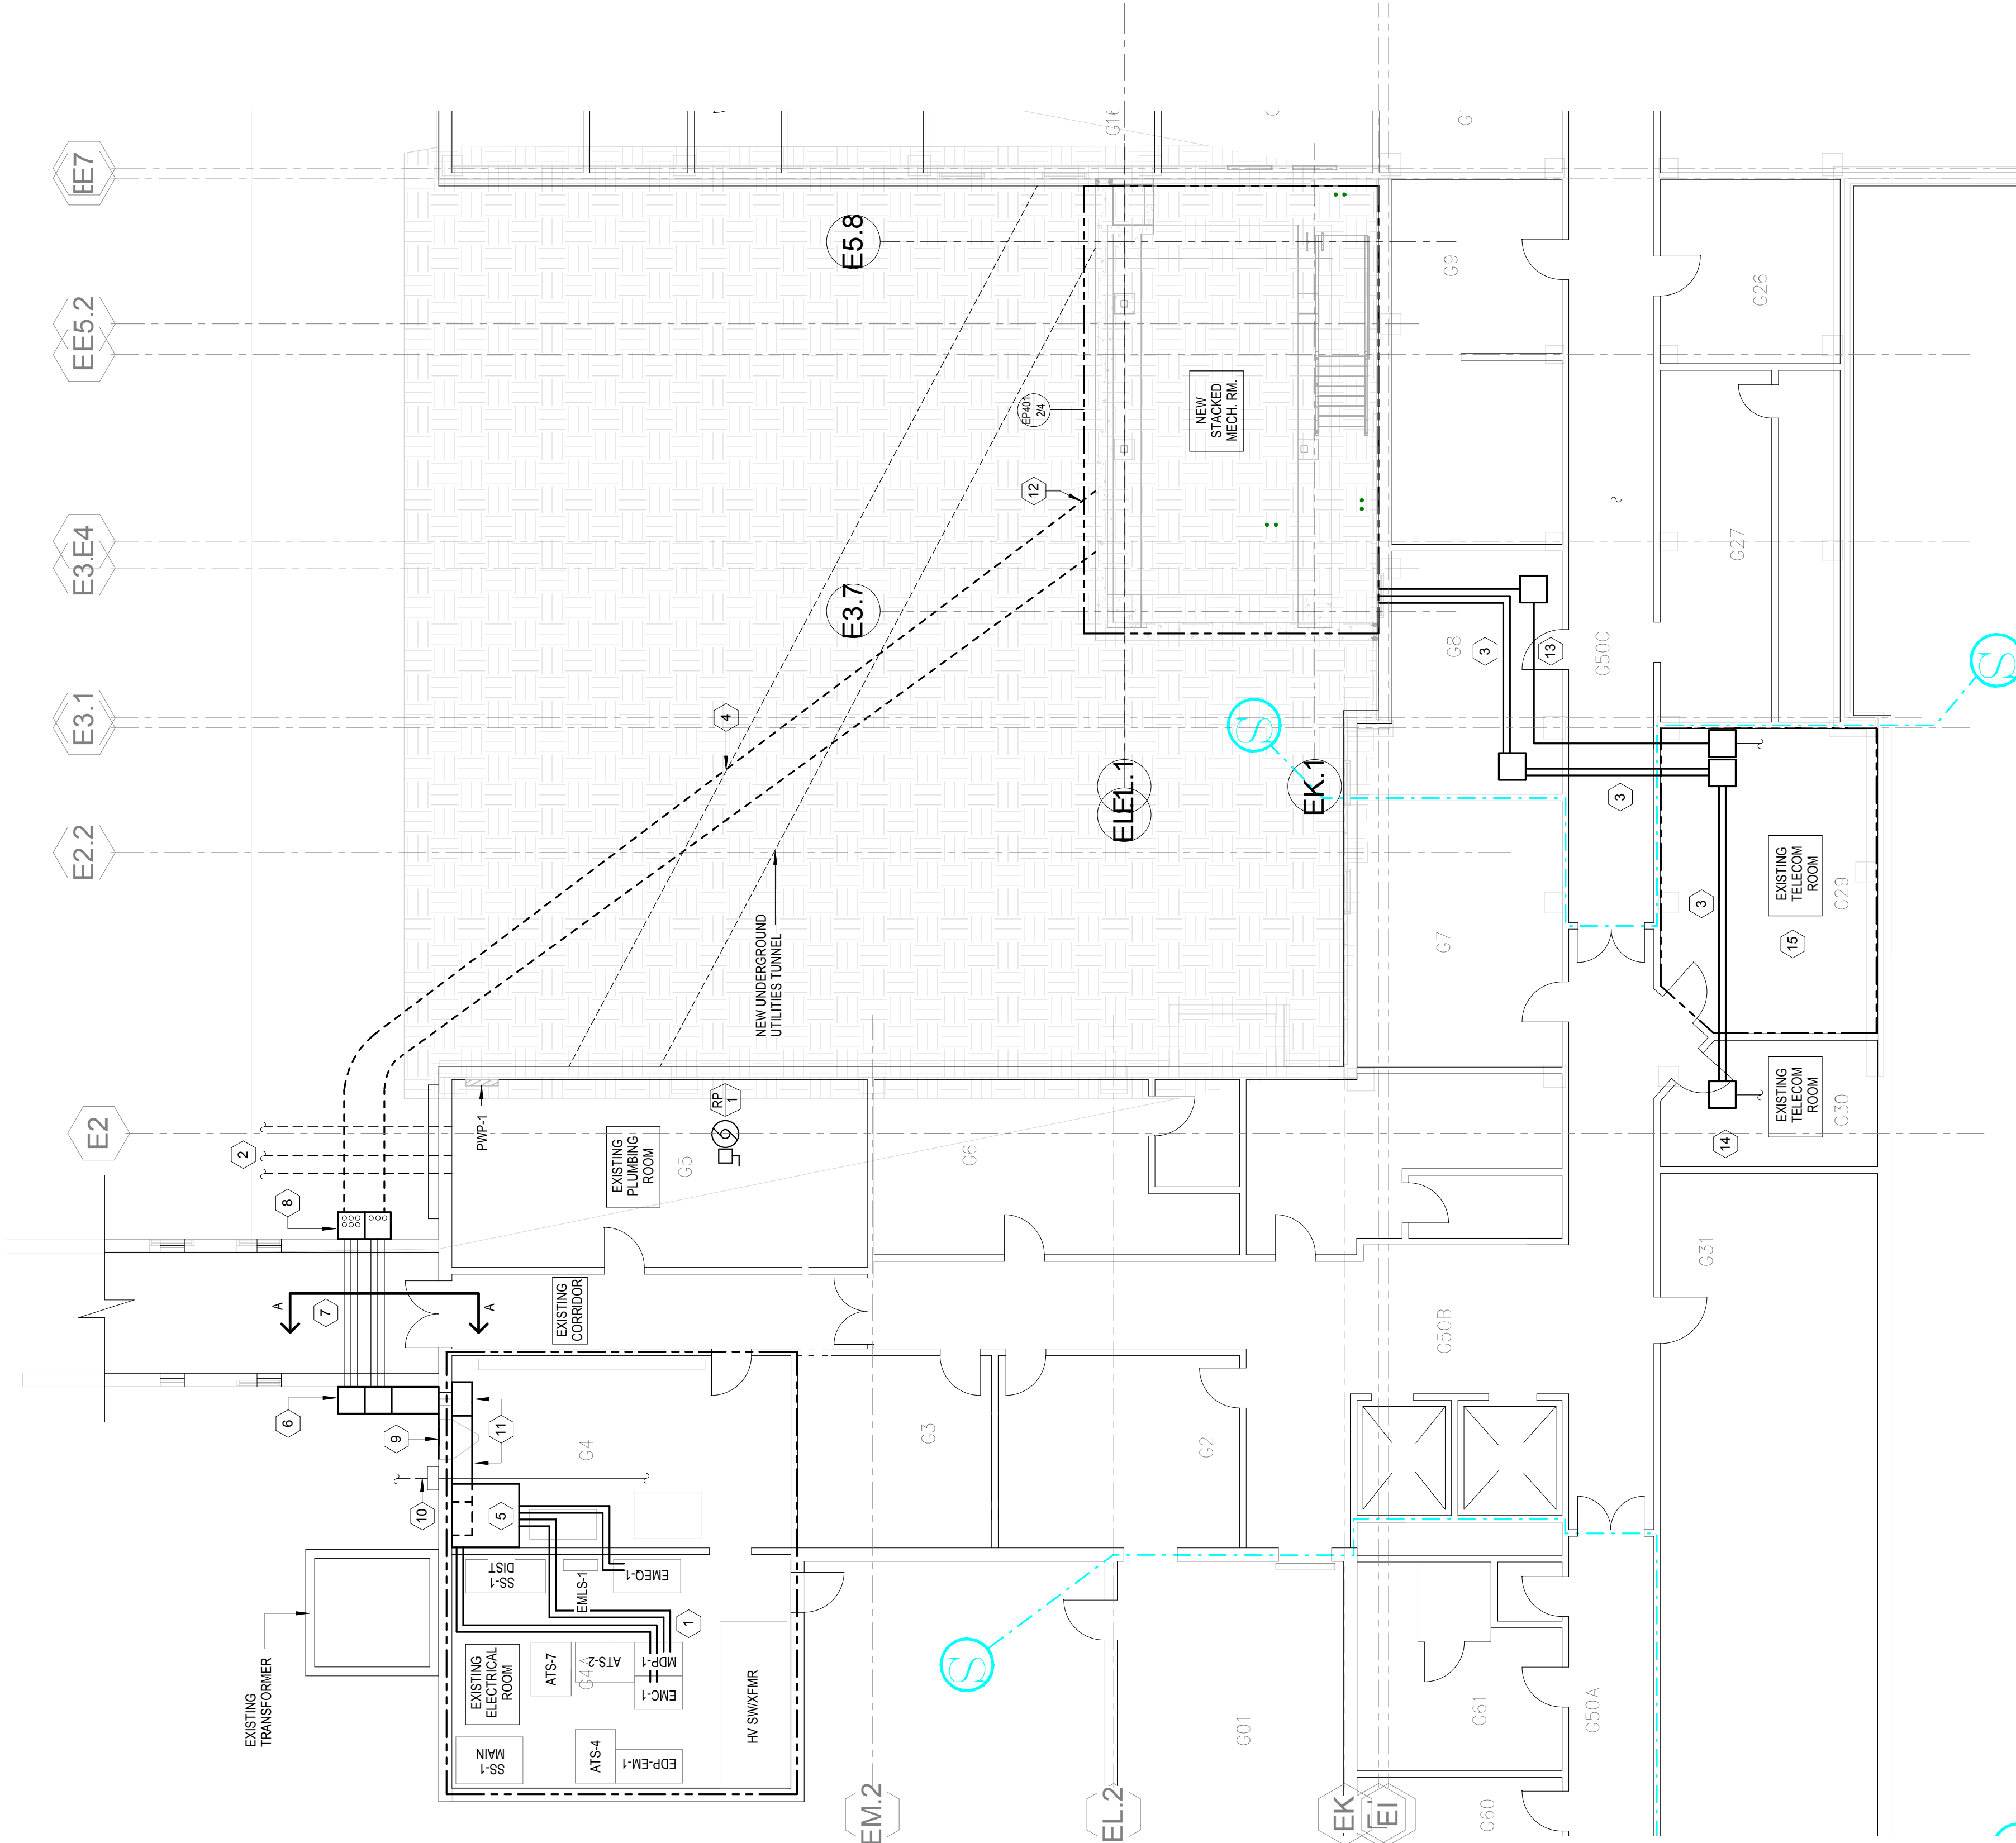

2 GROUND FLOOR- PARTIAL POWER PLAN  
1/8" = 1'-0"

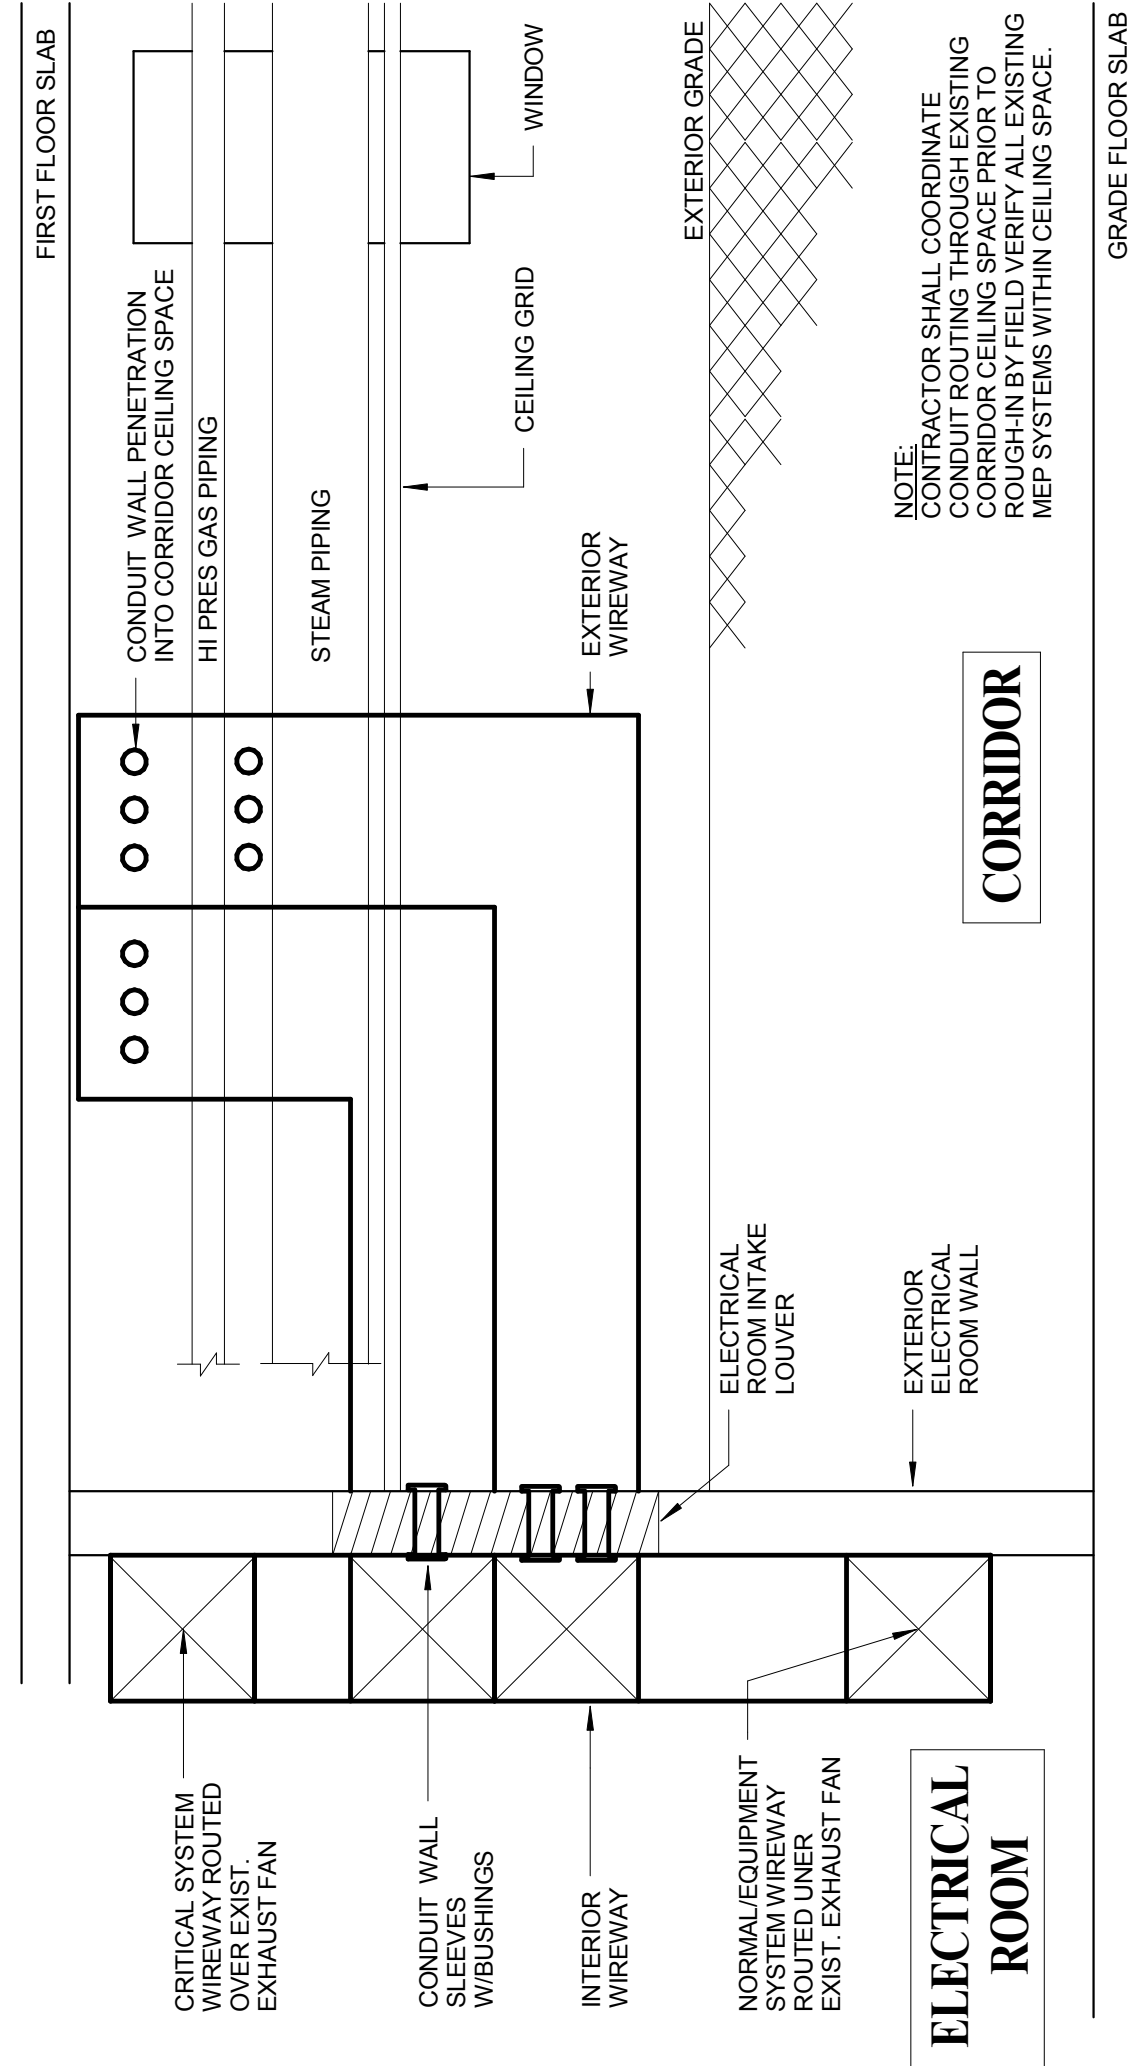

3 SECTION - AA

Revisions	Date
ALTERNATE No. 4	07/07/14
ALTERNATE No. 3	07/07/14
CONSTRUCTION DOCUMENT - 100% SUBMISSION	07/07/13
CONSTRUCTION DOCUMENT - 90% SUBMISSION	04/05/13
FIRE LIFE SAFETY REVIEW	03/15/13
DESIGN DEVELOPMENT - 60% SUBMISSION (RD)	11/09/12
DESIGN DEVELOPMENT - 60% SUBMISSION (RD)	10/05/12
SCHEMATIC DESIGN - 30% SUBMISSION	08/09/11

VA WESTERN NEW YORK HEALTHCARE SYSTEM  
222 RICHMOND AVE  
BATAVIA, NEW YORK 14020


**CANNON** DESIGN  
2170 White Plains Road, Great Neck, New York 11042  
1-718-777-5500  
Boston • New York • Baltimore • Washington DC • Buffalo  
Chicago • Dallas • Denver • Detroit • Houston • Los Angeles • Miami  
Minneapolis • New Orleans • Philadelphia • San Francisco • Seattle  
Tampa • Toronto • Vancouver • Wichita

CARDIOLOGY MANAGER	DATE	ENGINEERING MANAGER	DATE
INFECTION CONTROL	DATE	CARELINE MANAGER	DATE
SAFETY OFFICER	DATE	CHIEF OF STAFF	DATE

GROUND FLOOR - PARTIAL POWER PLAN	DATE
MEDICAL CENTER DIRECTOR	DATE
ASSOCIATE MEDICAL CENTER DIRECTOR	DATE

WARD C RENOVATIONS	Building Number	Drawn
	1	DJJ
		TGF

Date	09/09/11
Station No.	538A
353	E111

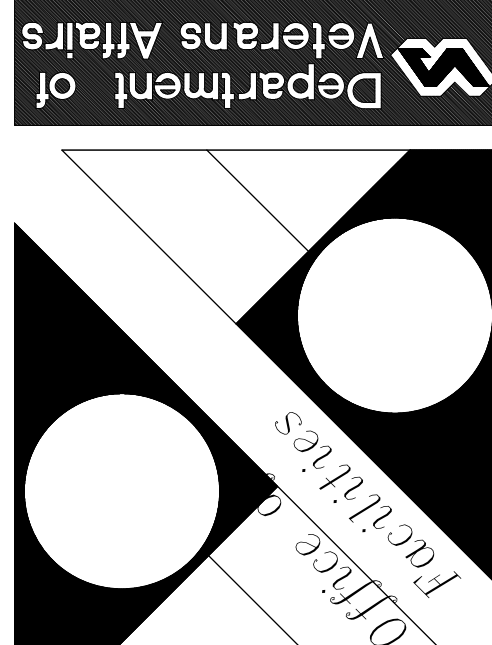

three-eighths inch = one foot  
three-quarters inch = one foot  
one-half inch = one foot  
one and one-half inch = one foot  
three inches = one foot

Revisions	Date
ALTERNATE No. 4	07/07/14
ALTERNATE No. 3	07/07/14
CONSTRUCTION DOCUMENT - 100% SUBMISSION	07/09/13
CONSTRUCTION DOCUMENT - 50% SUBMISSION	04/05/13
FIRE LIFE SAFETY REVIEW	03/15/13
DESIGN DEVELOPMENT - 60% SUBMISSION (RD)	11/09/12
DESIGN DEVELOPMENT - 60% SUBMISSION (RD)	10/05/12
SCHEMATIC DESIGN - 30% SUBMISSION	09/09/11

VA WESTERN NEW YORK HEALTHCARE SYSTEM  
222 RICHMOND AVE  
BATAVIA, NEW YORK 14020

Architect

stamp

CANNON

2170 White Plains Road, Garden City, New York 11042  
1-718-775-5500  
1-718-775-5500

Boston • New York • Washington DC • Buffalo  
Chicago • Dallas • San Francisco • Los Angeles • San Diego  
Atlanta • Miami • Phoenix • Seattle • Denver

	CARDIOLOGY MANAGER	DATE	ENGINEERING MANAGER	DATE
	INFECTION CONTROL	DATE	CARELINE MANAGER	DATE
	SAFETY OFFICER	DATE	CHIEF OF STAFF	DATE


Project Title	WARD C RENOVATIONS
Building Number	1
Location	V.A.M.C. BATAVIA, NEW YORK

09/09/11


Station No. 538A

E112

353

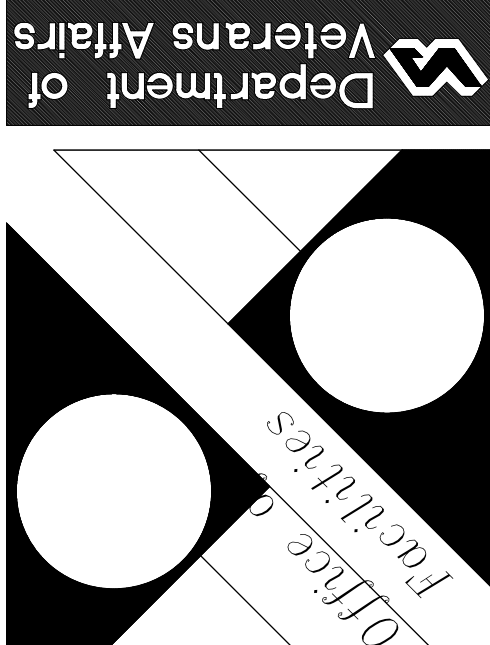

FULLY SPRINKLERED

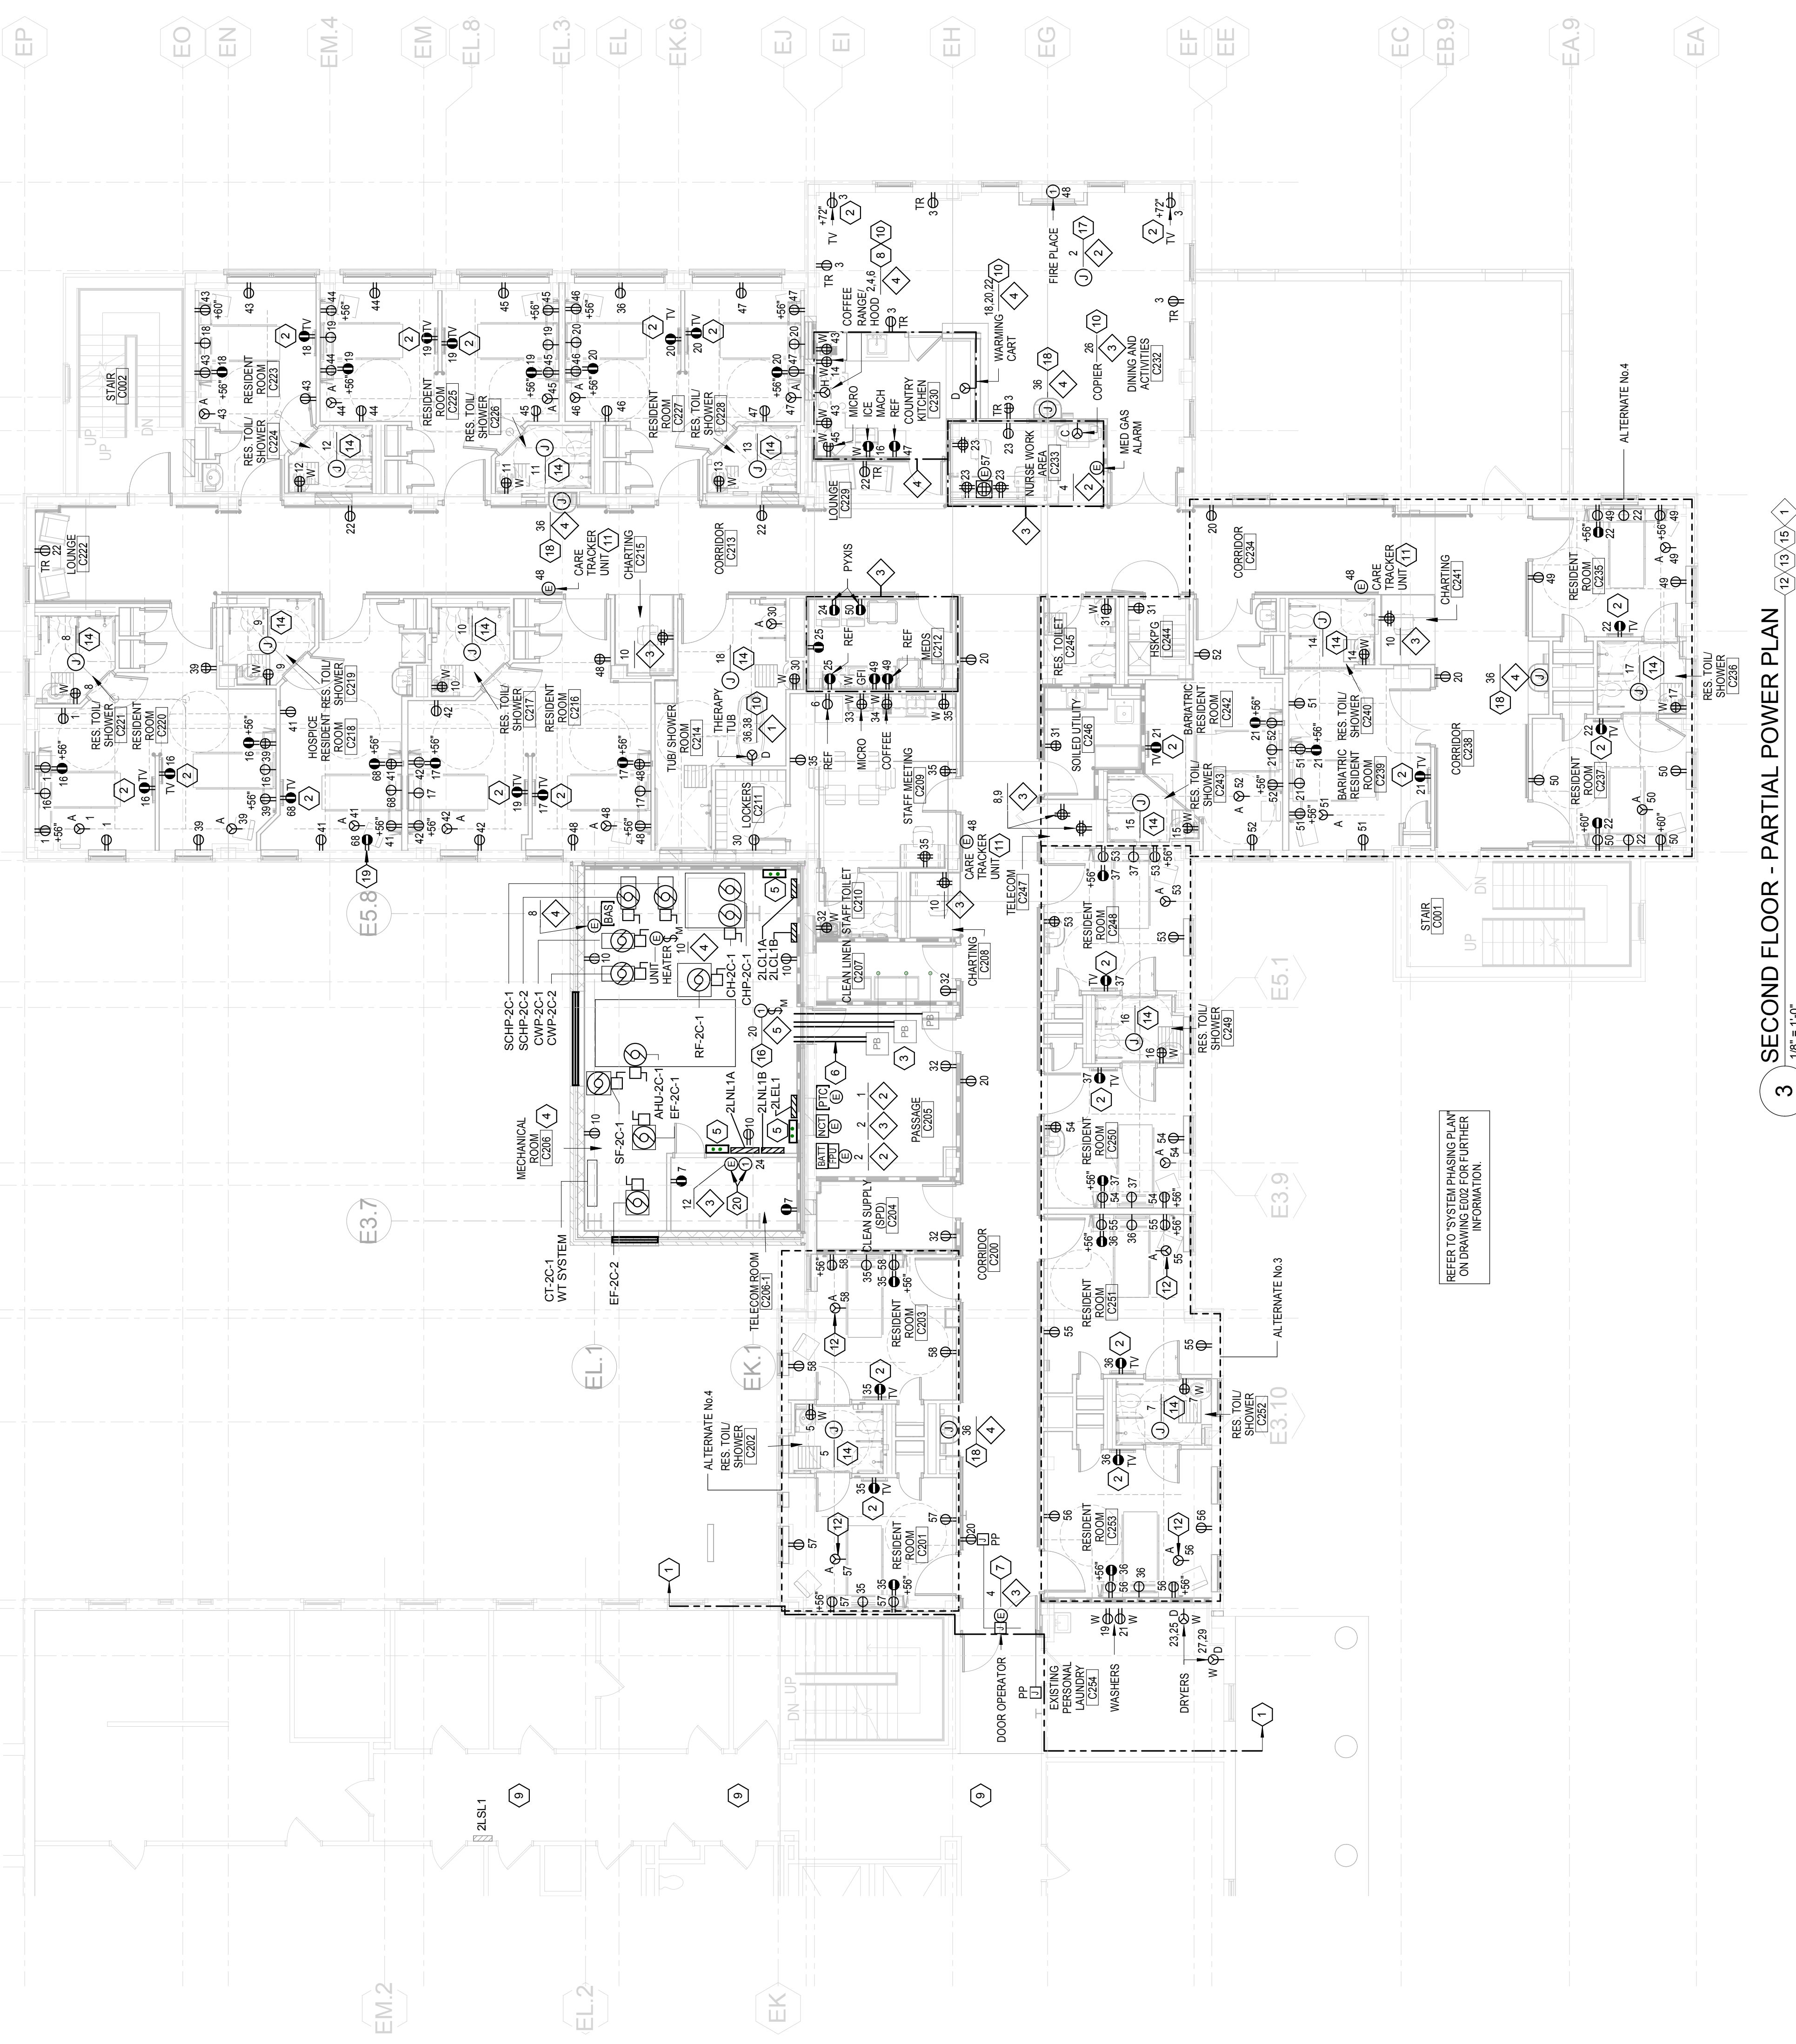

POWER NOTES

- AREA BOUNDARY OF WARD C WORK SCOPE.
- OUTLET FOR WALL MOUNTED TELEVISION, 6'-0" AFF. COORDINATE FINAL MOUNTING HEIGHT WITH ARCHITECTURAL DRAWINGS, DETAILS AND ELEVATIONS. FOR POWER AND CAVITY WARDEN HAVING DETAIL REFER TO DETAIL 1000.
- EXISTING CEILING MOUNTED PULL/JUNCTION BOXES SERVING PANELBOARDS ON THIRD FLOOR ABOVE. ASSOCIATED PANELBOARDS SHALL BE KEPT FUNCTIONAL THROUGHOUT THE WARD C RENOVATION PROJECT. REFER TO PHASING NOTES ON DRAWING E002.
- PROVIDE EXPANSION AND CONTRACTION JOINTS AT THE EXPANSION JOINTS IN THE NEW MECHANICAL ROOM AND EXISTING BUILDING WALL INTERFACE FOR ALL RACEWAYS SERVED BY EQUIPMENT LOCATED ON OR WITHIN THE EXISTING BUILDING AND SUPPORTED FROM THE NEW ROOM CEILING OR WALL.
- PANELBOARD FEEDER RISER JUNCTION/PULLBOX. INSTALLATION SHALL BE COORDINATED WITH STRUCTURAL STEEL DRAWINGS TO VERIFY DISTANCE OF BOX STANDOFF FROM EXISTING WALL. PROVIDE PROTECTIVE COVERING TO PROTECT EXISTING WALL FROM ANY DEVICES/EQUIPMENT LOCATED WITHIN DEDICATED EQUIPMENT WORKING SPACE.
- NEW FEEDER TO SERVE EXISTING PANELBOARDS LOCATED ON THIRD FLOOR. EXTEND TO EXISTING SECOND FLOOR PULL/JUNCTION BOXES. COORDINATE PROPOSED ROUTING WITH CONTRACTOR TO MINIMIZE TIME OF OUTAGE TO PANELS AND OCCUPANTS ON THIRD FLOOR. PROVIDE PROTECTIVE COVERING TO PROTECT EXISTING WALL FROM ANY DEVICES/EQUIPMENT LOCATED WITHIN DEDICATED EQUIPMENT WORKING SPACE. AFTER RECONNECTION, ESTABLISHED MECHANICAL AND PLUMBING CONTRACTORS. REMOVE EXISTING FEEDER ROUTED THROUGH WARD C, THE CENTRAL CORRIDOR AND DOWN TO THE MAIN ELECTRICAL ROOM IN 15 SEVENET.
- PROVIDE ALL NECESSARY POWER, LOW VOLTAGE & CONTROL CONNECTIONS TO NEW POWERED DOORS. INCLUDE CONDUIT ROUGH-IN WITH PULL STRINGS FOR THE INSTALLATION OF DOORS. PROVIDE PROTECTIVE COVERING TO PROTECT EXISTING WALL FROM ANY DEVICES/EQUIPMENT LOCATED WITHIN DEDICATED EQUIPMENT WORKING SPACE. AFTER RECONNECTION, ESTABLISHED MECHANICAL AND PLUMBING CONTRACTORS. REMOVE EXISTING FEEDER ROUTED THROUGH WARD C, THE CENTRAL CORRIDOR AND DOWN TO THE MAIN ELECTRICAL ROOM IN 15 SEVENET.
- REPLACE ALL EXISTING CEILING TILES DAMAGED BY THE INSTALLATION OF NEW LIFE SAFETY BRANCH CIRCUITS SERVING WARD C. ALL CEILING PENETRATIONS THROUGH RATED WALLS SHALL BE REPAIRS TO MEET THE SAME RATING AS THE WALL PENETRATIONS THROUGH RATED WALLS. PROVIDE ALL REQUIRED WALL FINISHING TO MATCH EXISTING.
- COORDINATE FINAL OUTLET NEMA TYPE & BRANCH CIRCUIT SIZE WITH APPROVED EQUIPMENT SELECTION PRIOR TO ROUGH-IN.
- INSTALL EXISTING CARETRACKER UNIT THAT WAS REMOVED FROM PRIOR REMODELED AREA. PROVIDE PROTECTIVE COVERING TO PROTECT EXISTING WALL FROM ANY DEVICES/EQUIPMENT LOCATED WITHIN DEDICATED EQUIPMENT WORKING SPACE. AFTER RECONNECTION, ESTABLISHED MECHANICAL AND PLUMBING CONTRACTORS. REMOVE EXISTING FEEDER ROUTED THROUGH WARD C, THE CENTRAL CORRIDOR AND DOWN TO THE MAIN ELECTRICAL ROOM IN 15 SEVENET.
- RECEPAC AT CEILING OF RESIDENT ROOM FOR PATIENT LIFT. COORDINATE FINAL LOCATION WITH MANUFACTURER'S REQUIREMENTS. PROVIDE PROTECTIVE COVERING TO PROTECT EXISTING WALL FROM ANY DEVICES/EQUIPMENT LOCATED WITHIN DEDICATED EQUIPMENT WORKING SPACE. AFTER RECONNECTION, ESTABLISHED MECHANICAL AND PLUMBING CONTRACTORS. REMOVE EXISTING FEEDER ROUTED THROUGH WARD C, THE CENTRAL CORRIDOR AND DOWN TO THE MAIN ELECTRICAL ROOM IN 15 SEVENET.
- SEAL ALL WALL AND FLOOR PENETRATIONS (MATCH RATING OF WALL/FLOOR PENETRATING). TOILET ROOM RADIANT PANEL HEATERS. PROVIDE FINAL CONNECTION TO MECHANICAL EQUIPMENT. REFER TO MECHANICAL PLANS FOR FINAL LOCATION.
- COORDINATE FINAL LOCATIONS OF DEVICES ON RESIDENT ROOM HEAD WALL WITH ARCHITECTURAL PLANS AND ELEVATIONS PRIOR TO ROUGH-IN.
- CLEAN STEAM GENERATOR (GSE-1) POWER CONNECTION. COORDINATE FINAL LOCATION WITH MECHANICAL DRAWINGS.
- POWER CONNECTION FOR SINK SENSORS/TRANSFORMER. COORDINATE FINAL LOCATION WITH FIRE ALARMS CONTRACTOR PRIOR TO ROUGH-IN.
- POWER CONNECTION FOR SINK SENSORS/TRANSFORMER. PROVIDE RECESSED JUNCTION BOX MOUNTED UNDER SINK WITH CONDUIT ROUTED TO CEILING SPACE. COORDINATE FINAL LOCATION WITH FIRE ALARMS CONTRACTOR PRIOR TO ROUGH-IN.
- RECEPAC LOCATED 7'-0" AFF FOR WALL MOUNTED FAN. COORDINATE FINAL LOCATION WITH WA PRIOR TO ROUGH-IN.
- POWER FOR DATA RACKS MOUNTED AT 4'-0" AFF. PROVIDE 240-4P BRANCH CIRCUITS WITH THIST LOCK RECEPTACLES TO MATCH THE TELECOM EQUIPMENT. COORDINATE FINAL NEMA RECEPTACLE TYPE WITH MANUFACTURER'S SUBMITTED EQUIPMENT SHOP DRAWINGS PRIOR TO ROUGH-IN.
- UNLESS OTHERWISE NOTED, ALL CRITICAL BRANCH CIRCUITS THIS AREA SHALL BE CIRCUITED TO PANELBOARD 2E1.1.
- UNLESS OTHERWISE NOTED, ALL EQUIPMENT BRANCH CIRCUITS THIS AREA SHALL BE CIRCUITED TO PANELBOARD 2E1.1.
- NORMAL BRANCH CIRCUIT SHALL BE CIRCUITED TO PANELBOARD 2UN1A.

BRANCH CIRCUIT NOTES

- UNLESS OTHERWISE NOTED, ALL NORMAL BRANCH CIRCUITS THIS AREA SHALL BE CIRCUITED TO PANELBOARD 2UN1B.
- UNLESS OTHERWISE NOTED, ALL LIFE SAFETY BRANCH CIRCUITS THIS AREA SHALL BE CIRCUITED TO PANELBOARD 2E1.1. PROVIDE PROTECTIVE COVERING TO PROTECT EXISTING WALL FROM ANY DEVICES/EQUIPMENT LOCATED WITHIN DEDICATED EQUIPMENT WORKING SPACE. AFTER RECONNECTION, ESTABLISHED MECHANICAL AND PLUMBING CONTRACTORS. REMOVE EXISTING FEEDER ROUTED THROUGH WARD C, THE CENTRAL CORRIDOR AND DOWN TO THE MAIN ELECTRICAL ROOM IN 15 SEVENET.
- UNLESS OTHERWISE NOTED, ALL CRITICAL BRANCH CIRCUITS THIS AREA SHALL BE CIRCUITED TO PANELBOARD 2E1.1.
- UNLESS OTHERWISE NOTED, ALL EQUIPMENT BRANCH CIRCUITS THIS AREA SHALL BE CIRCUITED TO PANELBOARD 2E1.1.
- NORMAL BRANCH CIRCUIT SHALL BE CIRCUITED TO PANELBOARD 2UN1A.



Revision	Date
ALTERNATE No. 4	07/07/14
ALTERNATE No. 3	07/07/14
CONSTRUCTION DOCUMENT - 100% SUBMISSION	07/07/13
CONSTRUCTION DOCUMENT - 90% SUBMISSION	04/05/13
FIRE LIFE SAFETY REVIEW	03/15/13
DESIGN DEVELOPMENT - 60% SUBMISSION (RD)	11/09/12
DESIGN DEVELOPMENT - 60% SUBMISSION (RD)	10/05/12
SCHEMATIC DESIGN - 30% SUBMISSION	08/09/11

VA WESTERN NEW YORK HEALTHCARE SYSTEM  
222 RICHMOND AVE  
BATAVIA, NEW YORK 14020


**CANNON**DESIGN  
2170 White Plains Road, Great Neck, New York 11042  
1-718-775-5500 F: 718-775-5505  
Boston • New York • Baltimore • Washington DC • Buffalo  
Chicago • Dallas • Denver • Detroit • Houston  
Los Angeles • Miami • Minneapolis • New Orleans  
Philadelphia • San Francisco • Seattle • Tampa • Washington DC

Architect  
CANNON PROJECT # 3256.00


CARDIOLOGY MANAGER	DATE	ENGINEERING MANAGER	DATE
INFECTION CONTROL	DATE	CARLINE MANAGER	DATE
SAFETY OFFICER	DATE	CHIEF OF STAFF	DATE

Project Title			
WARD C RENOVATIONS			
Building Number	Drawn	Checked	Drawn
1	TGF	DJJ	DJJ
Location	Location	Location	Location
V.A.M.C. BATAVIA, NEW YORK	V.A.M.C. BATAVIA, NEW YORK	V.A.M.C. BATAVIA, NEW YORK	V.A.M.C. BATAVIA, NEW YORK


Date  
09/09/11

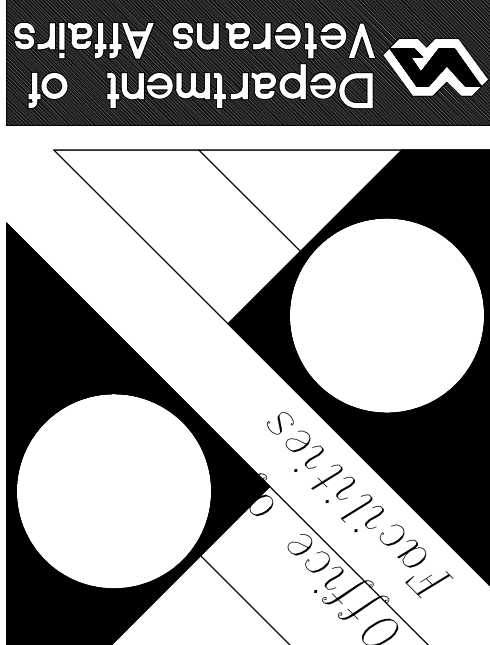


4 SECOND FLOOR - FIRE ALARM PLAN  
1/8" = 1'-0"

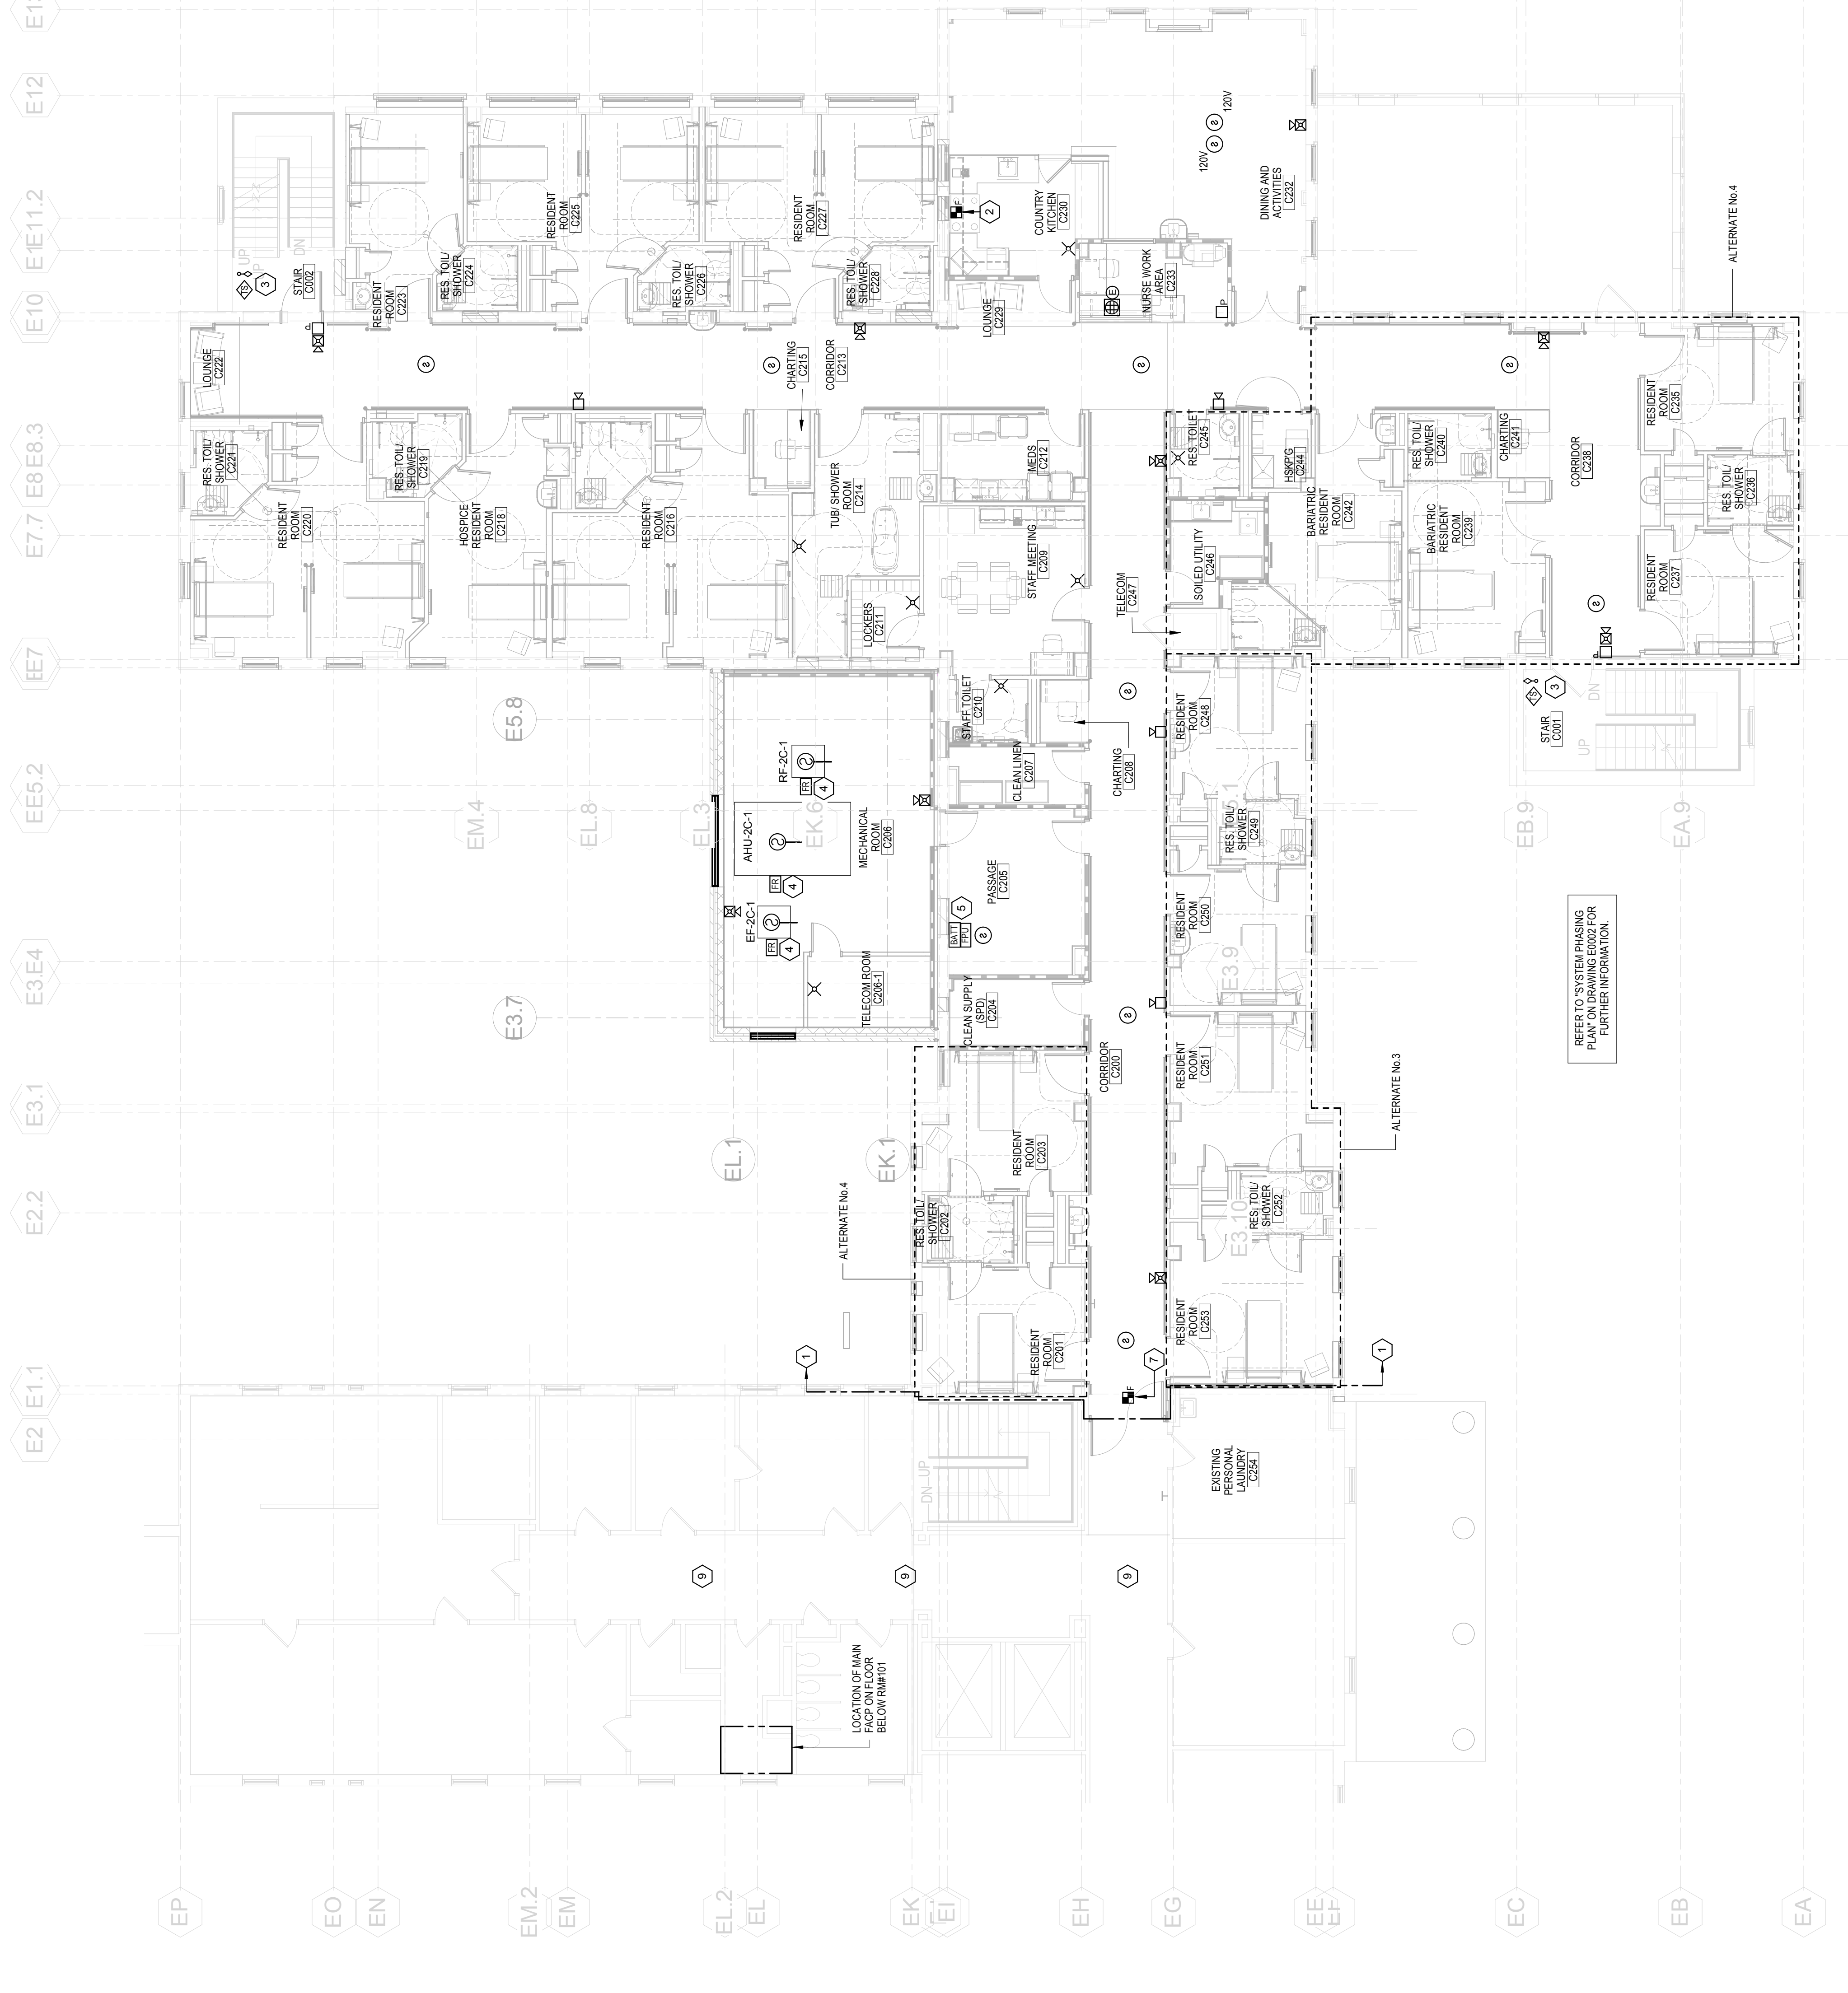


6 ENLARGED PLAN - THIRD FLOOR MECHANICAL ROOM C306  
1/8" = 1'-0"

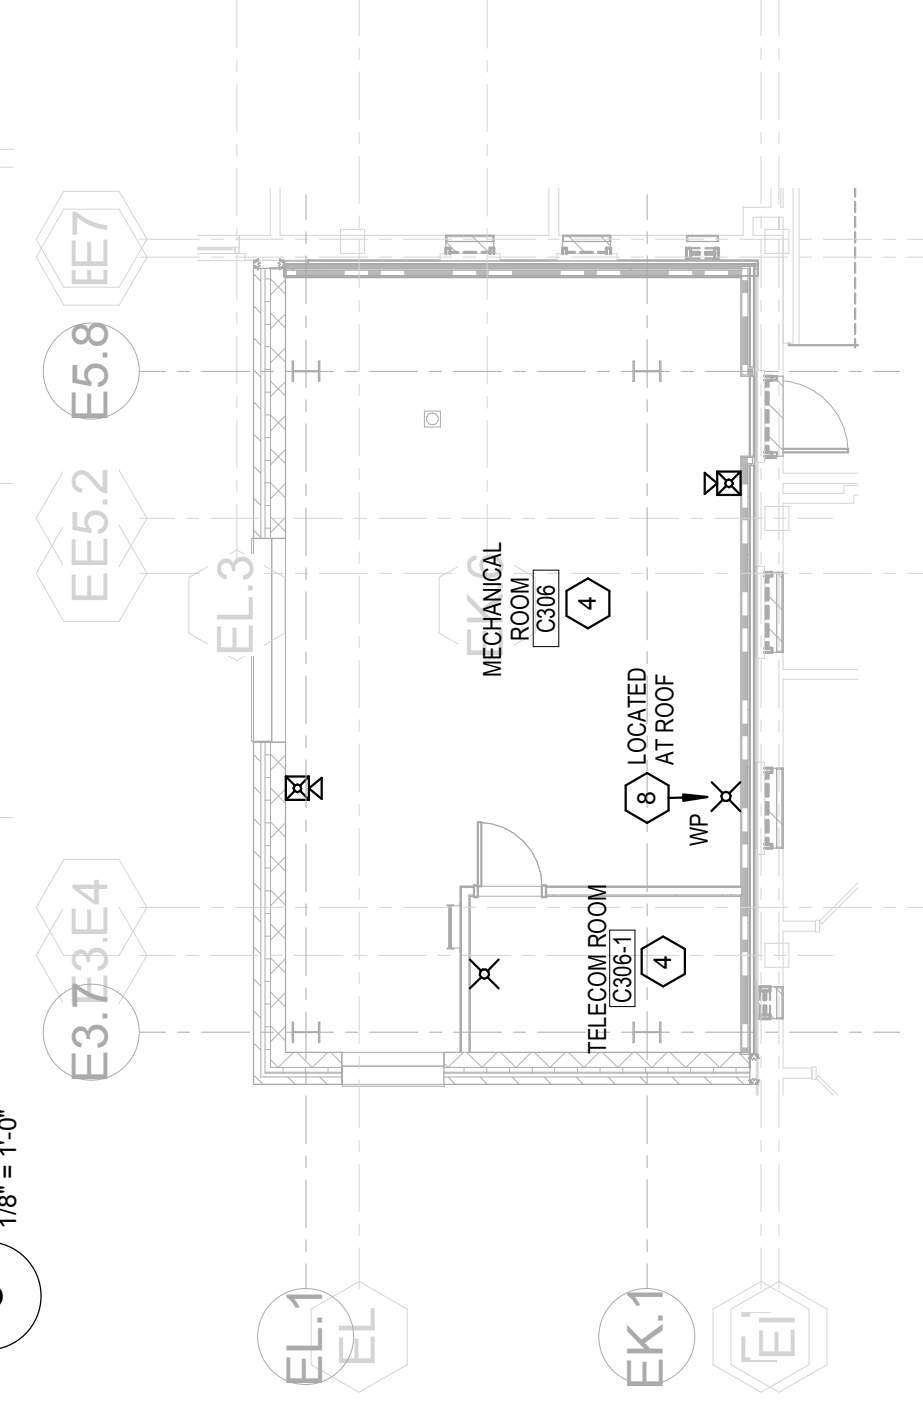

5 ENLARGED PLAN - GRADE FLOOR MECHANICAL ROOM C106  
1/8" = 1'-0"

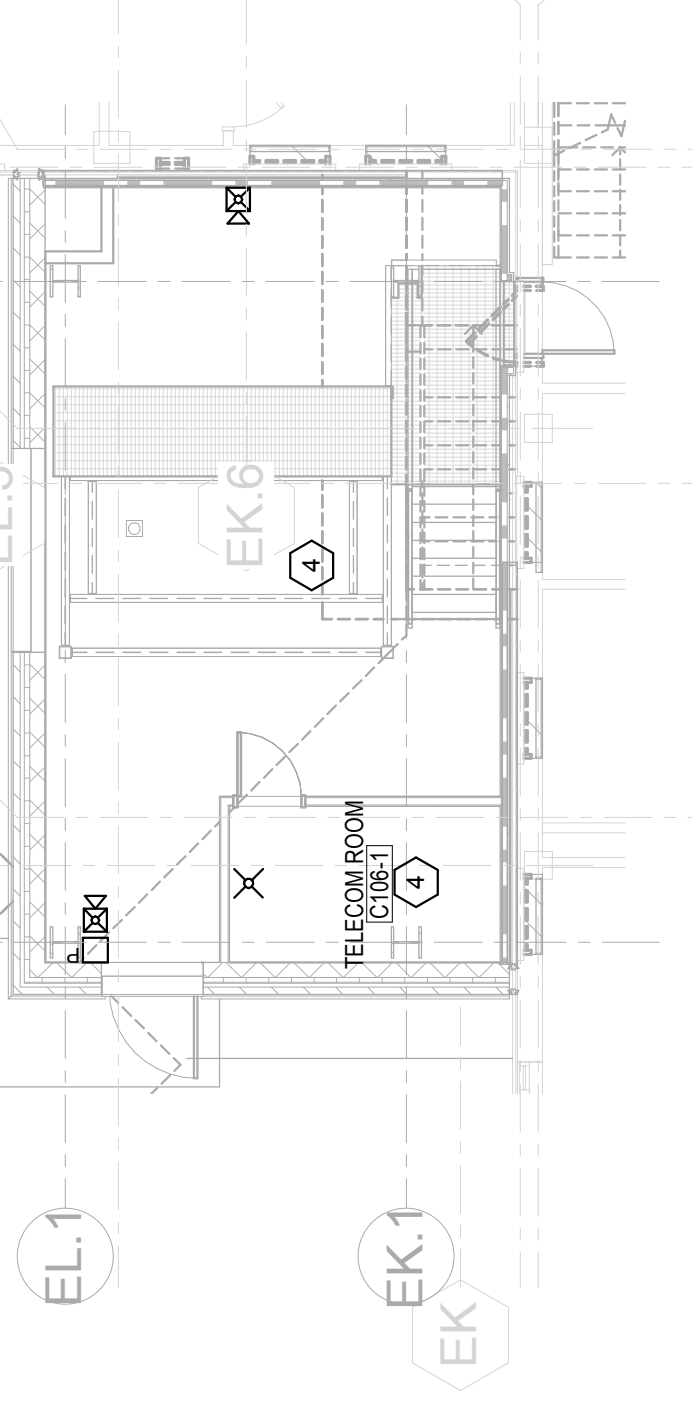


KEY PLAN - BUILDING 1(FIRE ALARM)

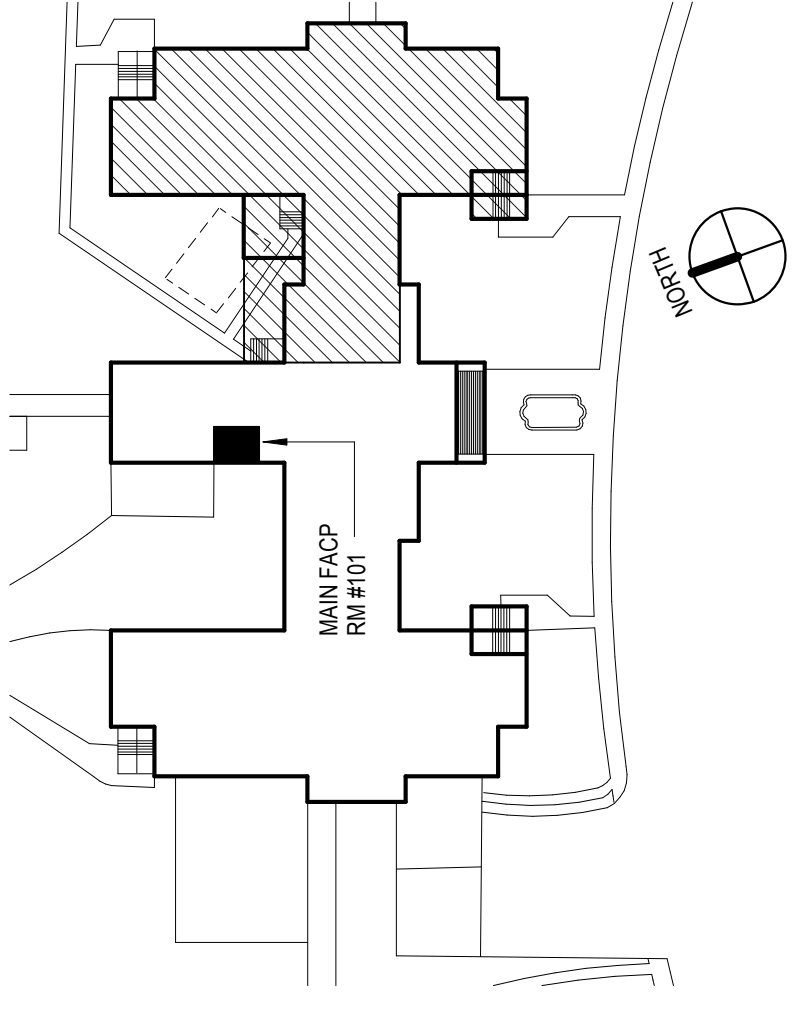

FULLY SPRINKLERED


1 FIRE ALARM NOTES

3 FIRE ALARM RISER DIAGRAM

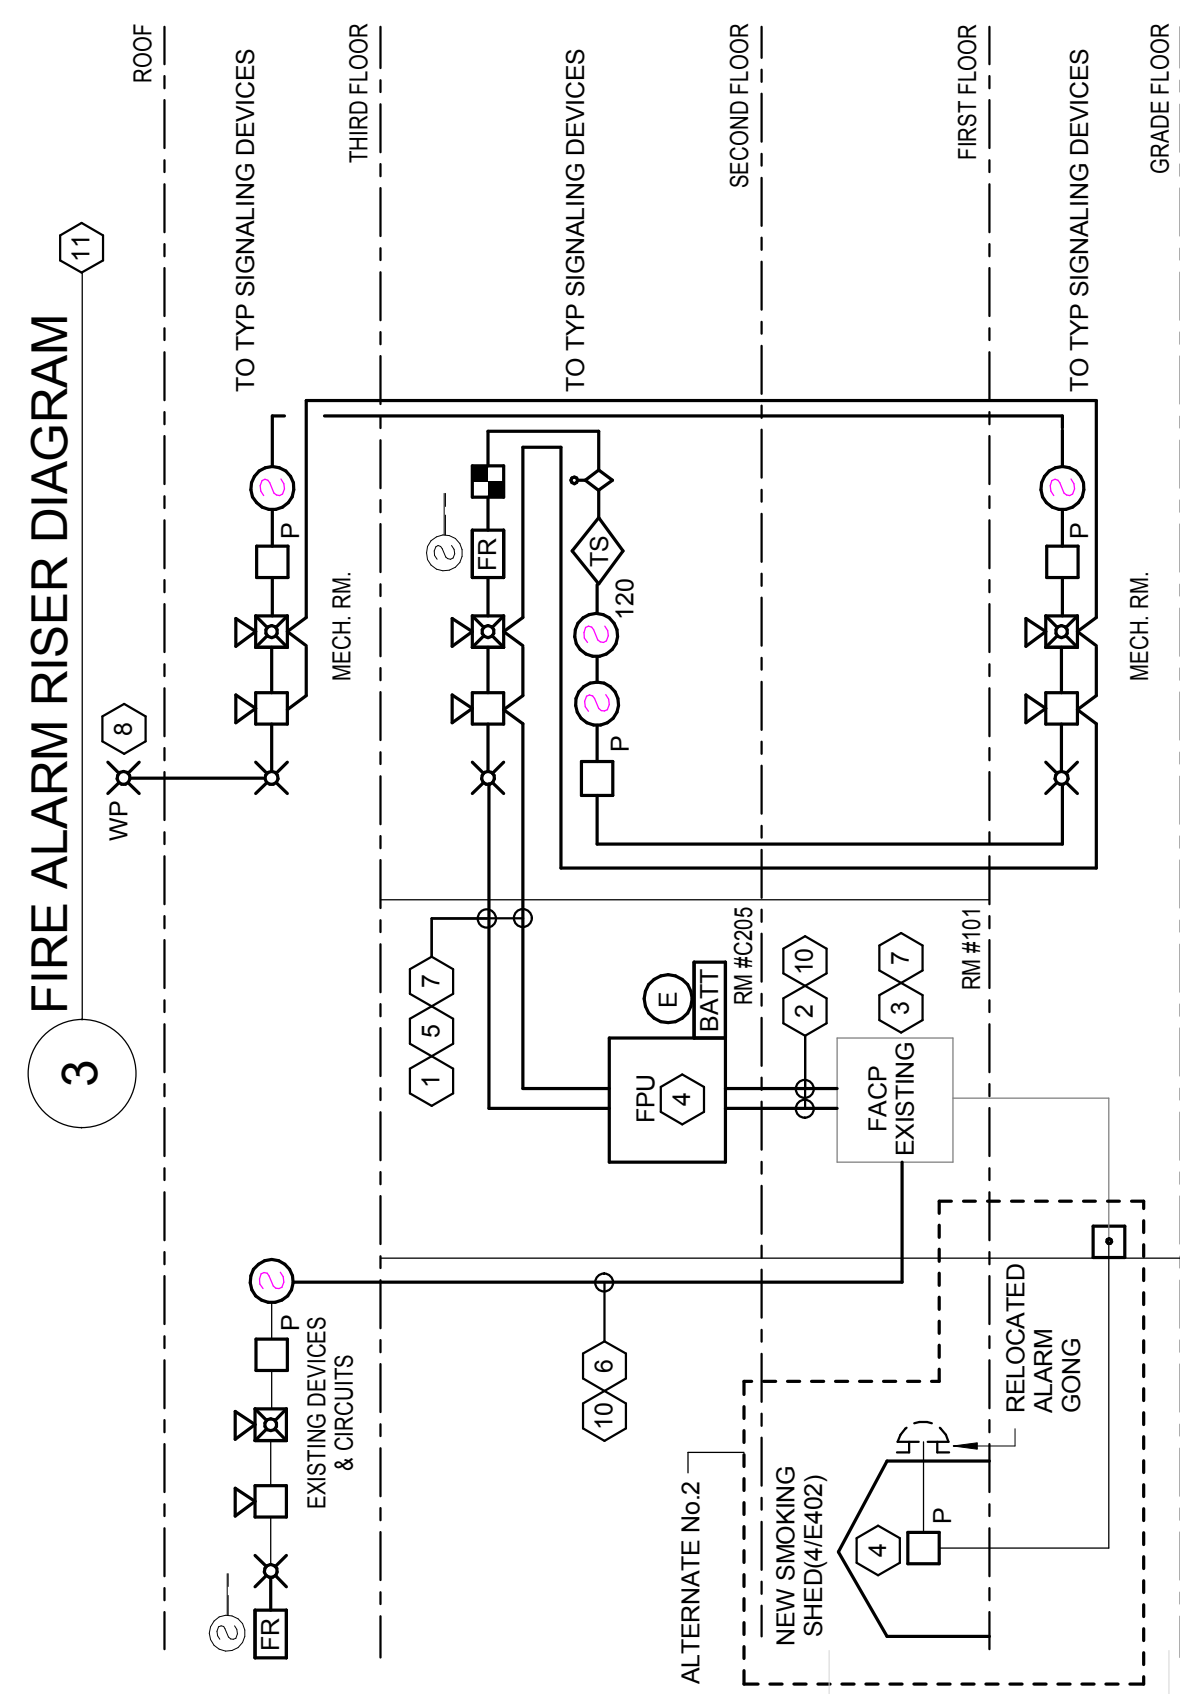


2 DIVISION 28 LEGEND


- FIRE ALARM SYSTEMS**
- ALARM FIRE MANUAL PULL STATION
  - ALARM LAMP LIGHT, SIGNAL LIGHT, STROBE
  - ALARM SPEAKER (VOICE TYPE)
  - ALARM SPEAKER (VOICE TYPE), ONE ASSEMBLY
  - DETECTOR, HEAT, LETTER INDICATES AS FOLLOWS:  
RTT = COMBINATION  
RT = RATE COMPENSATION  
RT = RATE OF
  - PHOTOELECTRIC SMOKE DETECTOR
  - 120VOLT, AC POWERED PHOTOELECTRIC SMOKE ALARM WITH SILENCE FEATURE. DEVICE SHALL HAVE INCOMING VOLTAGE TO THE FIRE ALARM CONTROL PANEL ON DEVICE ALARM OR LOSS OF POWER. THE DEVICE SHALL BE INSTALLED IN ACCORDANCE WITH THE VA PRIOR TO SYSTEM TESTING.
  - DETECTOR, SMOKE FOR DUCT
  - ELECTROMAGNETIC TYPE DOOR HOLDER OUTLET
  - FAN SHUT DOWN RELAY 7-0 AFF
  - ROLLING COUNTER DOOR RELAY
  - FIRE ALARM ADDRESSABLE RELAY (MONITOR/CONTROL POINT)
  - ALARM CHECK VALVE
  - DETECTOR, FLOW SWITCH
  - ALARM TAMPER SWITCH
  - ALARM FIRE PANEL LETTERS INDICATE AS FOLLOWS:  
FACC = CENTRAL  
FACP = CONTROL PANEL  
FMAP = MASTER CONTROL PANEL  
FACP = ANNUNCIATOR
  - ALARM FIRE, TERMINAL CABINET
  - ALARM, REMOTE PROCESSING UNIT/TRANSPONDER
  - ALARM FIRE, LETTERS INDICATE AS FOLLOWS:  
BATT = BATTERIES & CHARGER
  - RELOCATED FIRE ALARM GONG AT EXISTING SMOKE SHED.

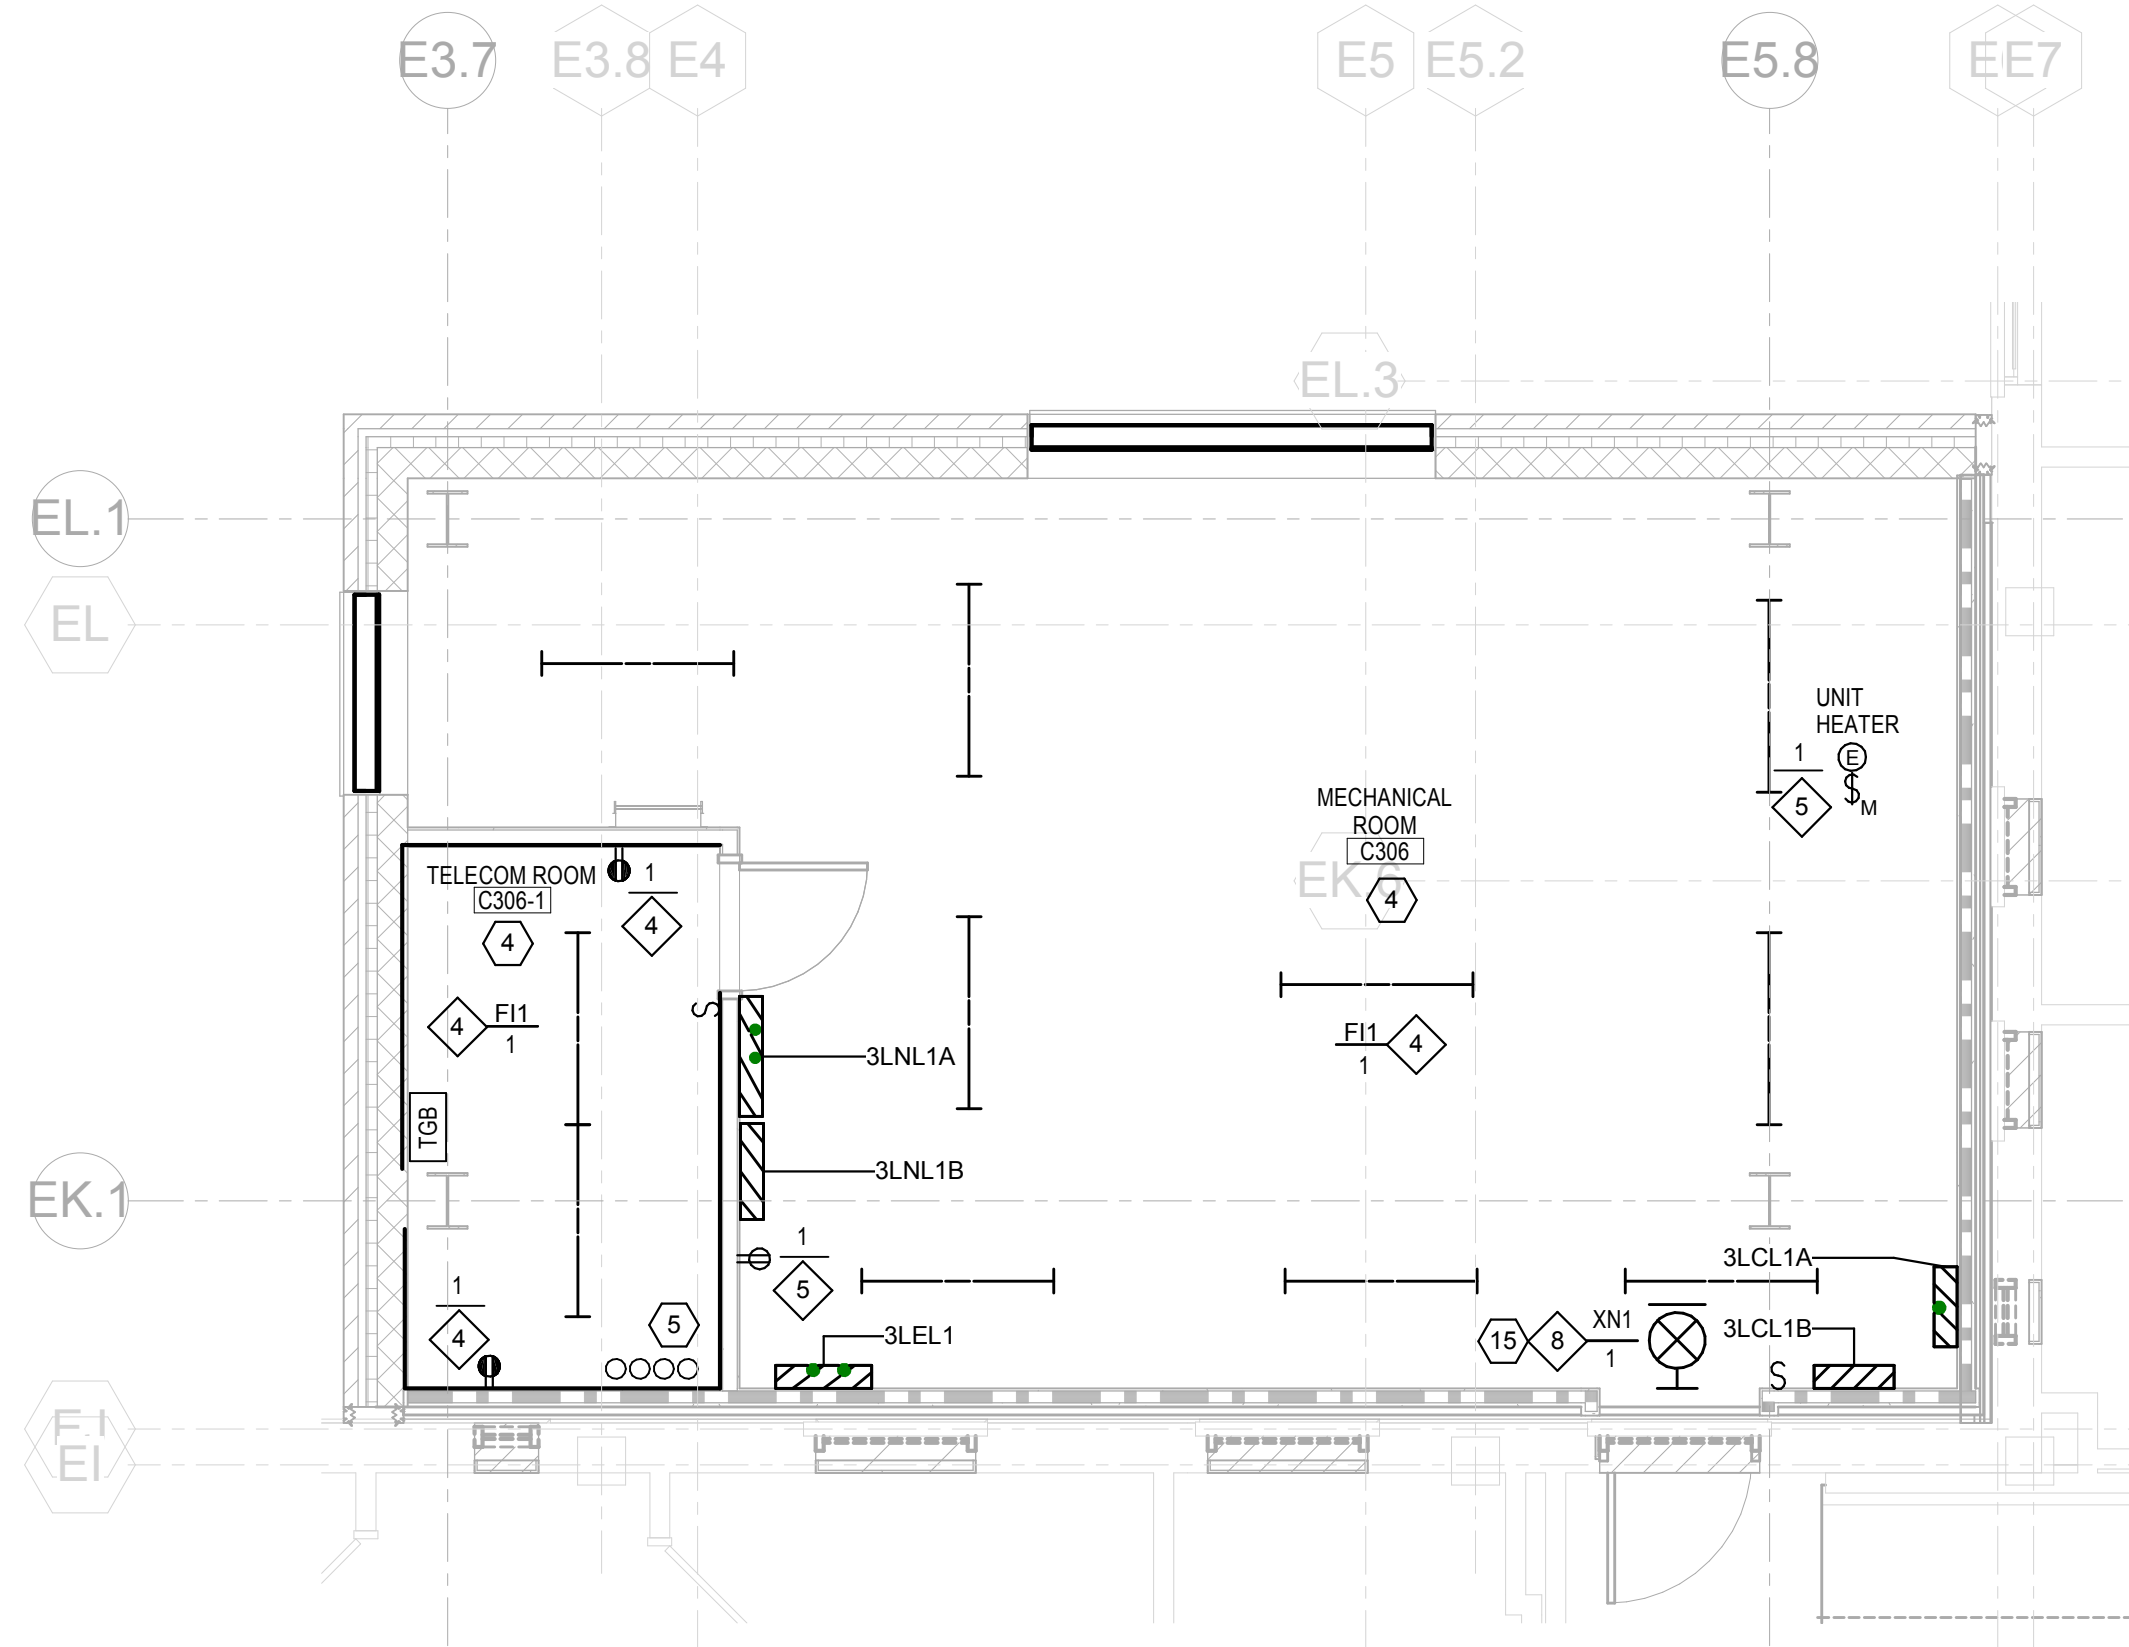


5 ENLARGED PLAN - THIRD FLOOR MECHANICAL ROOM C306  
1/4" = 1'-0"

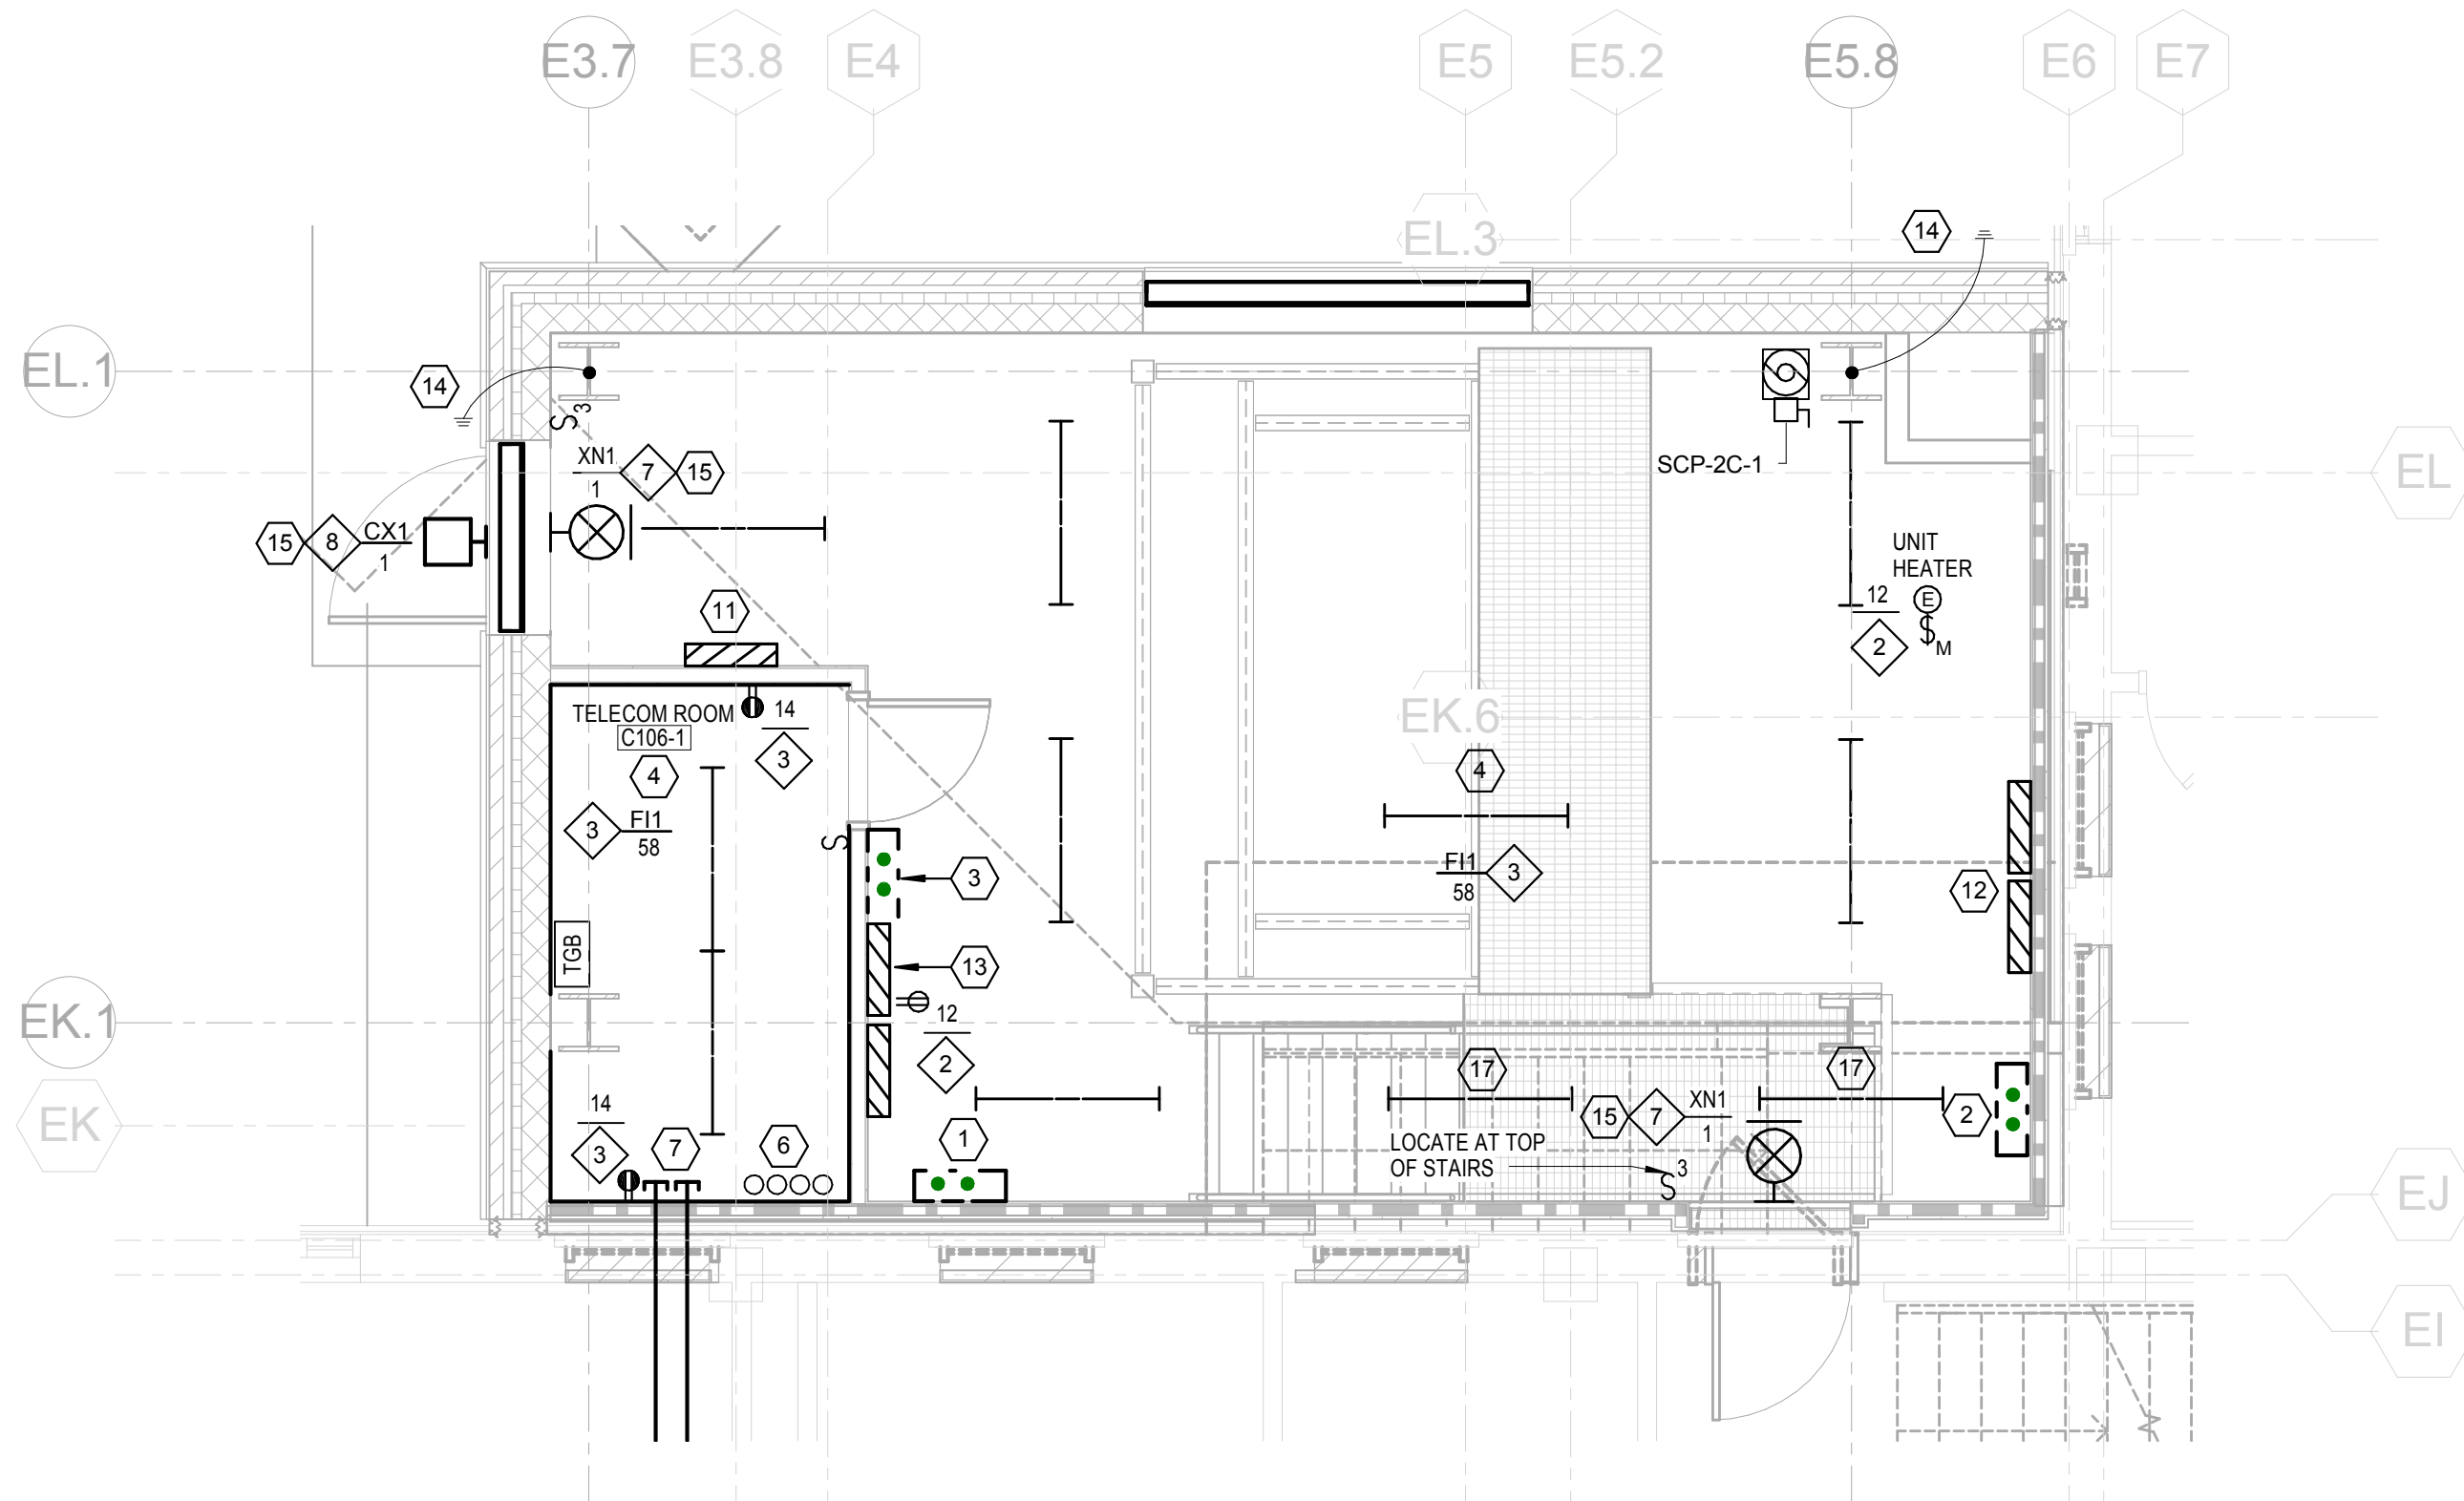

3 ENLARGED PLAN - GRADE FLOOR MECHANICAL ROOM C106  
1/4" = 1'-0"

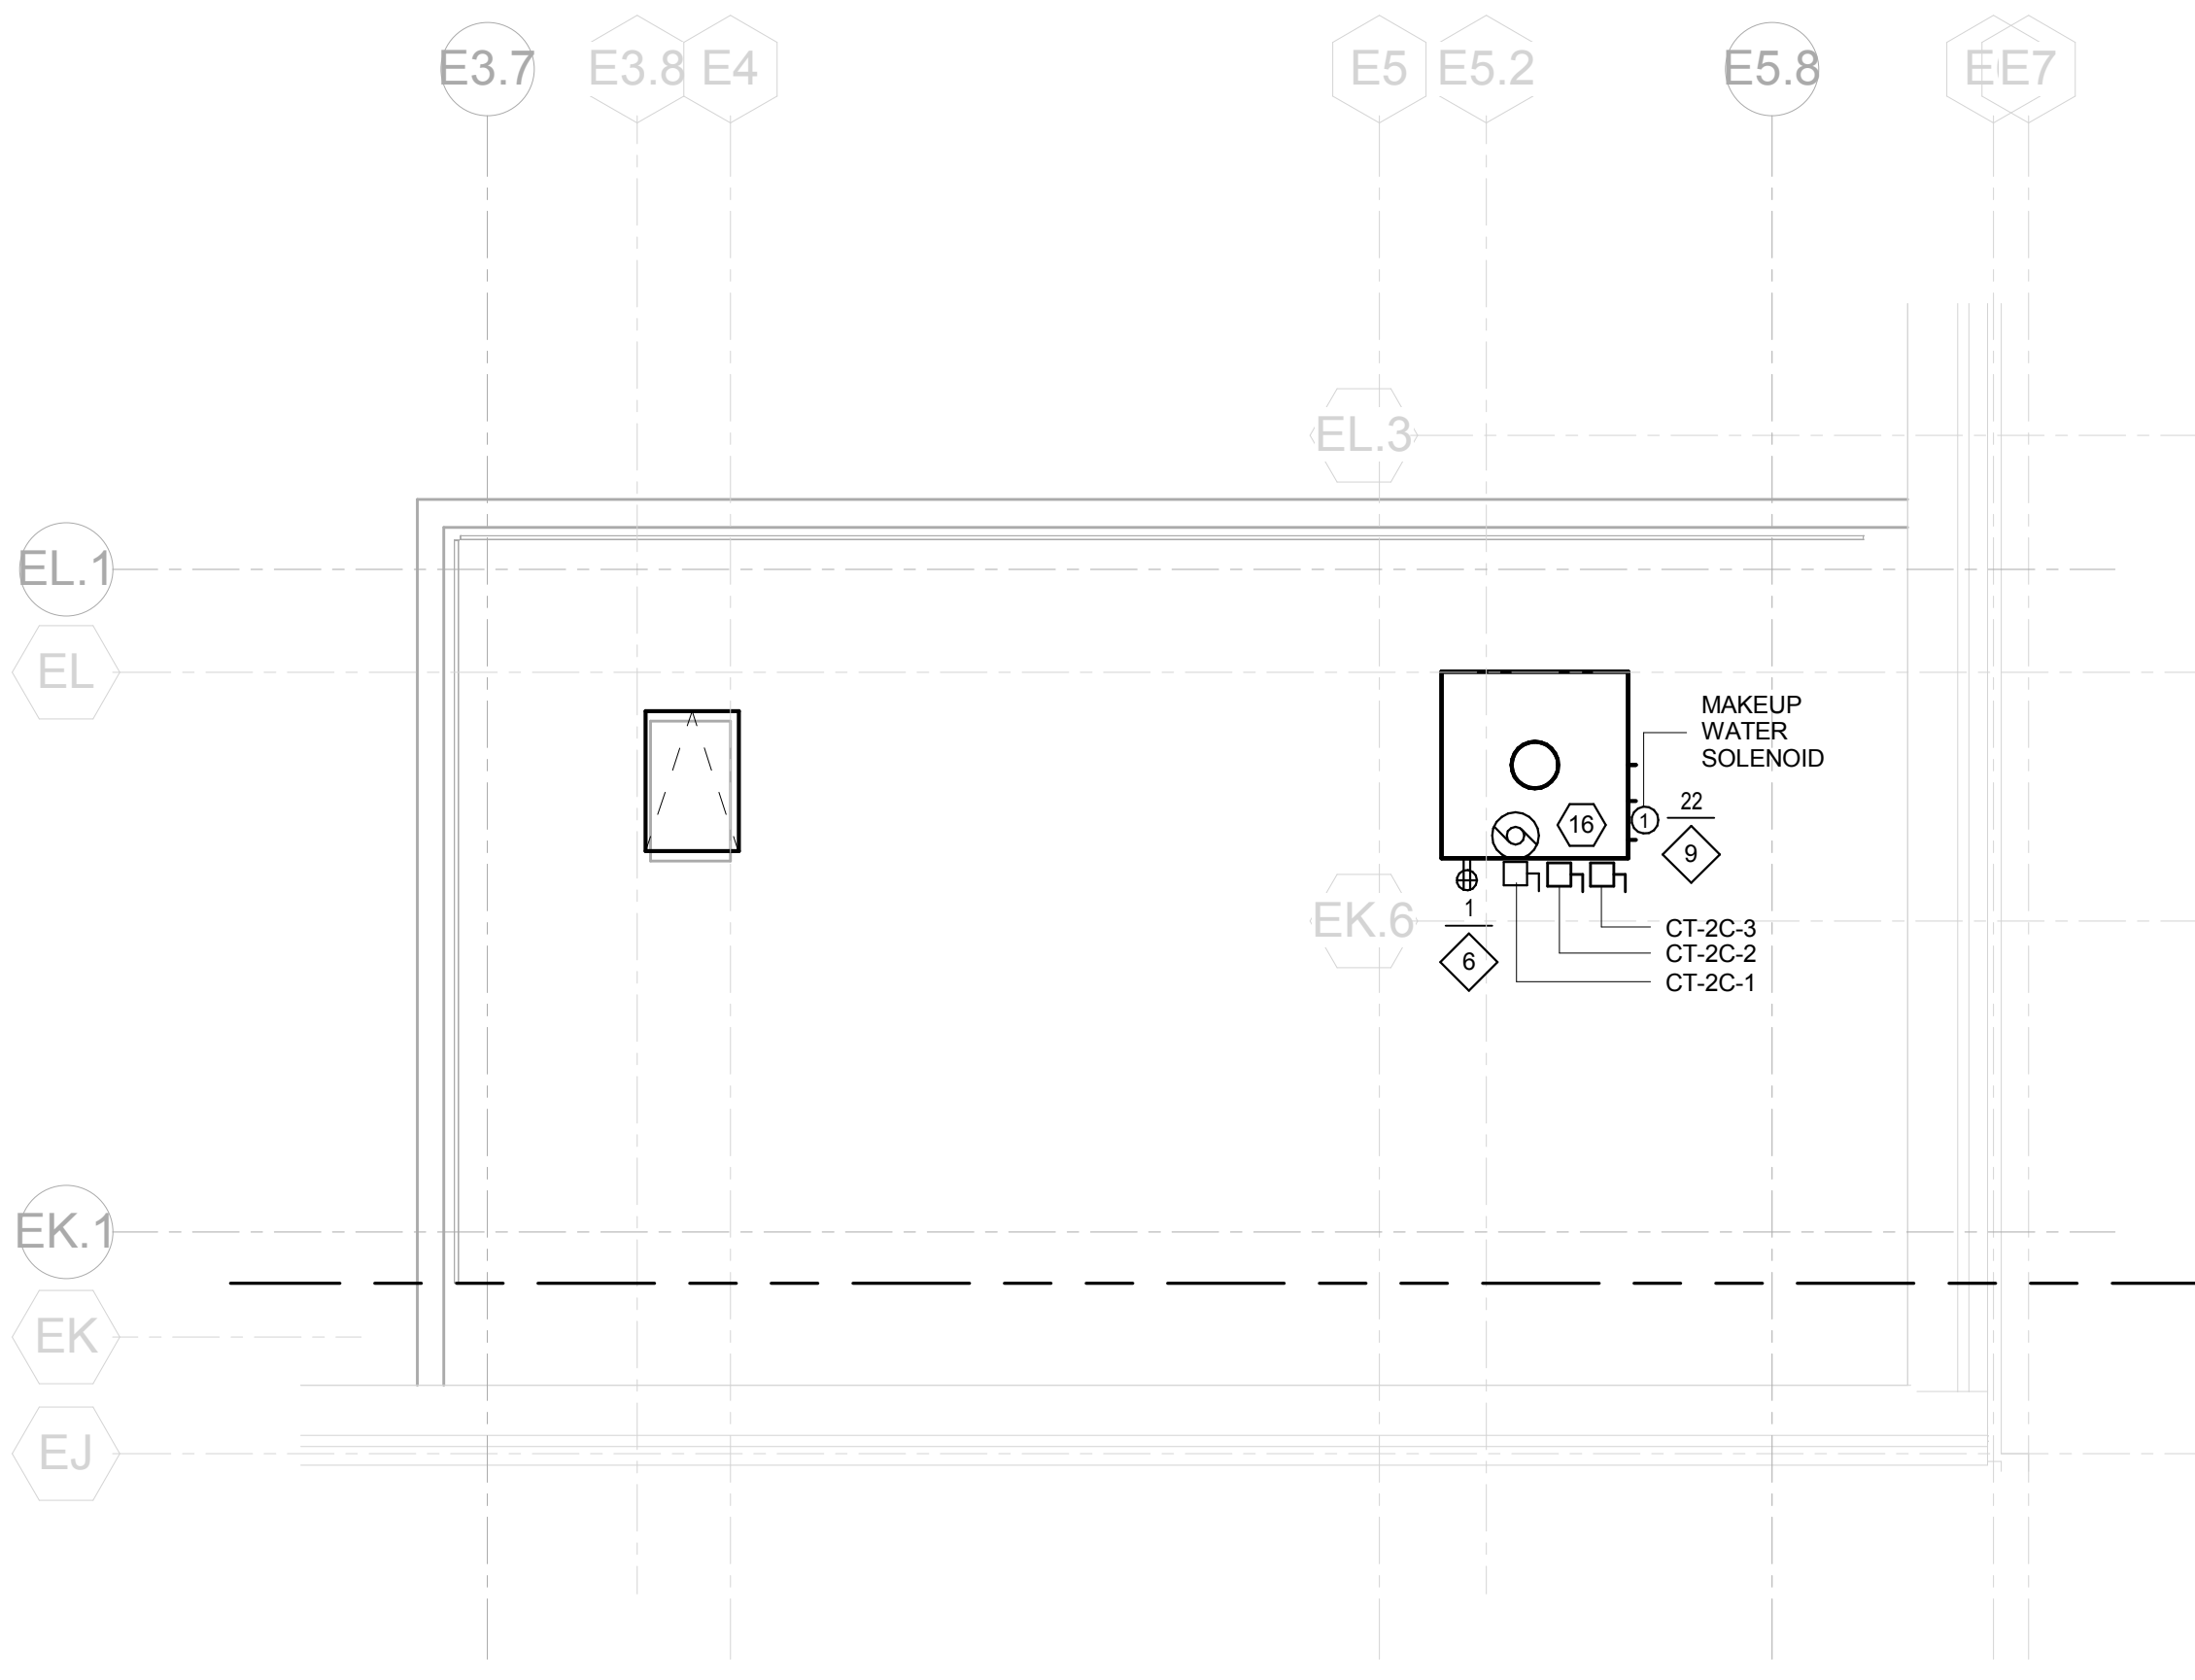

6 ENLARGED PLAN - PARTIAL ROOF PLAN  
1/4" = 1'-0"

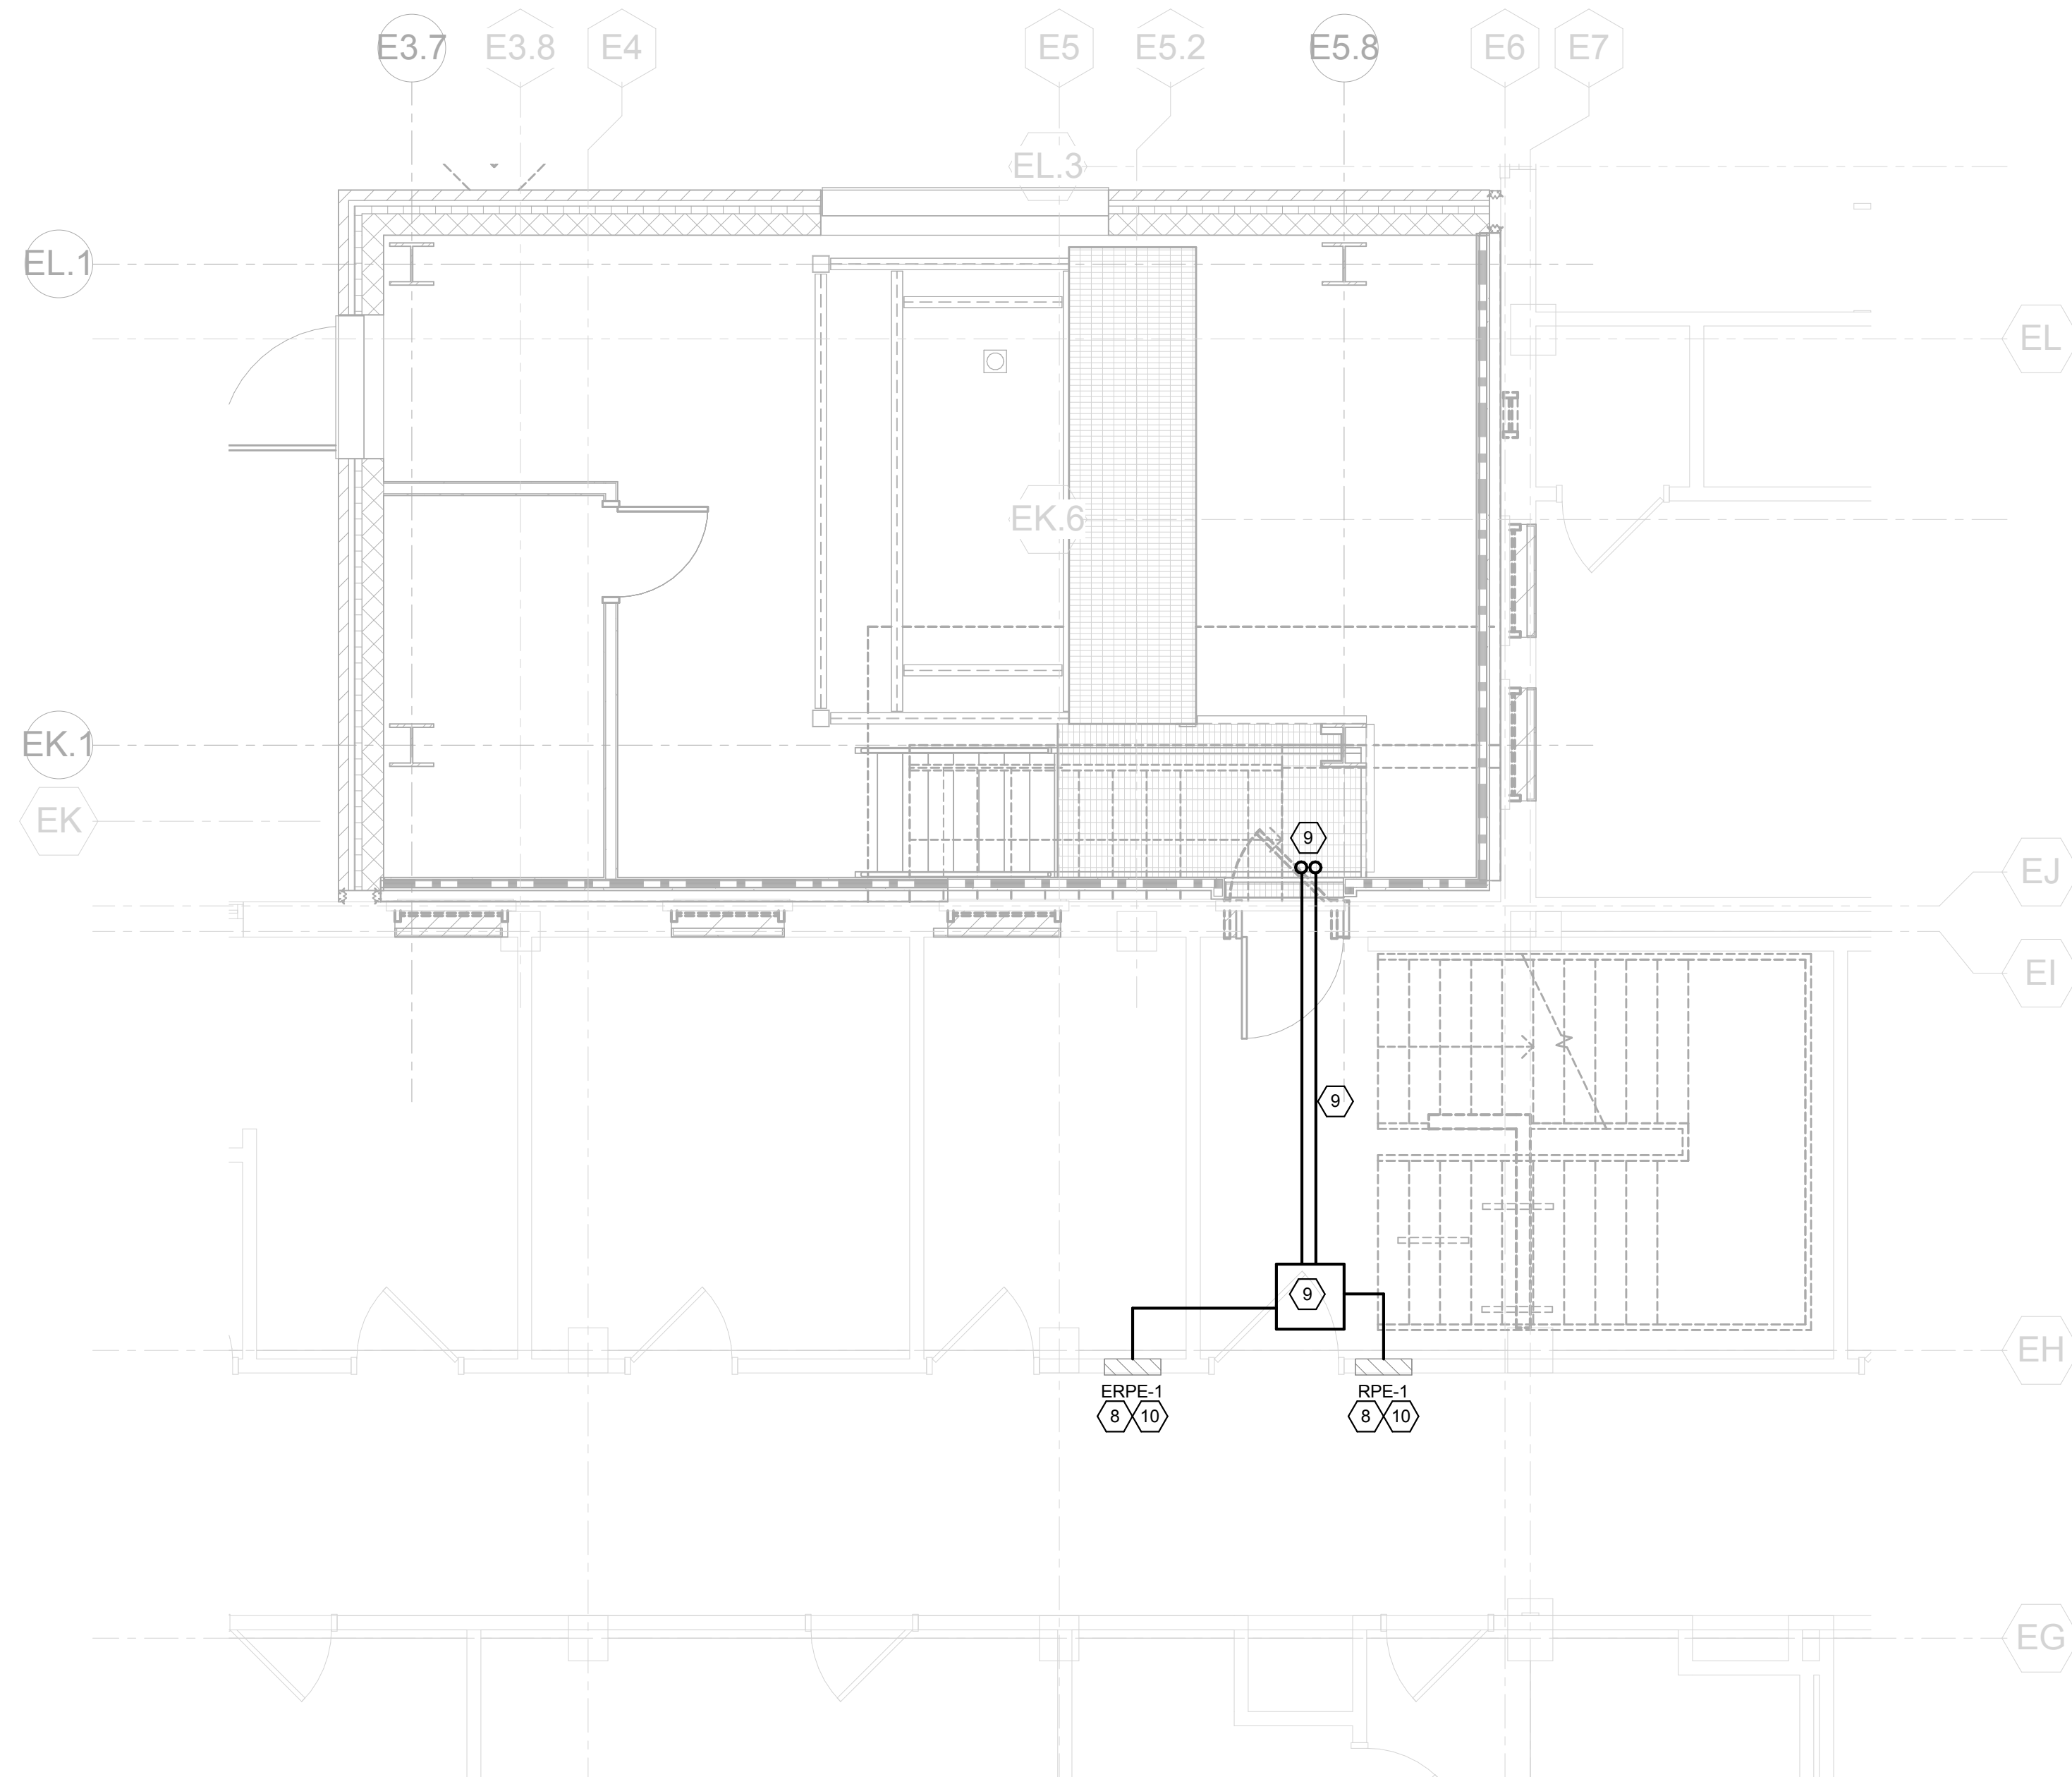


4 ENLARGED PLAN - FIRST FLOOR EAST CORRIDOR  
1/4" = 1'-0"

## NOTES

1. RISER CONDUIT, JUNCTION/PULLBOX SERVING EMERGENCY EQUIPMENT PANELBOARDS ON FIRST AND SECOND FLOORS. COORDINATE RISER AND HORIZONTAL CONDUIT ROUTING WITH PROJECT MECHANICAL/PLUMBING CONTRACTORS PRIOR TO ROUGH-IN.
2. RISER CONDUIT, JUNCTION/PULLBOX SERVING EMERGENCY CRITICAL PANELBOARDS ON FIRST AND SECOND FLOORS. COORDINATE RISER AND HORIZONTAL CONDUIT ROUTING WITH PROJECT MECHANICAL/PLUMBING CONTRACTORS PRIOR TO ROUGH-IN.
3. RISER CONDUIT, JUNCTION/PULLBOX SERVING NORMAL PANELBOARDS ON FIRST AND SECOND FLOORS. COORDINATE RISER AND HORIZONTAL CONDUIT ROUTING WITH PROJECT MECHANICAL/PLUMBING CONTRACTORS PRIOR TO ROUGH-IN.
4. COORDINATE FINAL LOCATION OF LUMINAIRES WITHIN SPACE WITH STRUCTURAL ELEMENTS AND FINAL MECHANICAL SYSTEMS INSTALLATION. TYPICAL FOR ALL LUMINAIRES WITHIN SPACE.
5. (4) 4" CONDUITS STUBBED INTO ROOM FROM LEVEL BELOW.
6. (4) 4" CONDUITS STUBBED UP INTO ROOM ABOVE.
7. OVERHEAD DATA/TELEPHONE CONDUITS FROM MAIN TELECOM ROOM STUBBED INTO NEW TELECOM ROOM. REFER TO DRAWING EP101 FOR CONTINUATION.
8. EXISTING CRITICAL PANELBOARD SERVING FIRST FLOOR. COORDINATE PHASING OF RECONNECTION WITH COTR TO MINIMIZE DOWNTIME TO SPACE.
9. PROVIDE NEW FEEDER FROM 3LCL1 ROUTED DOWN TO FIRST FLOOR CEILING AREA AND FEED TO EXISTING PANEL LOCATION. COORDINATE PROPOSED ROUTING WITH COTR PRIOR TO INSTALLATION TO MINIMIZE DISRUPTION TO EXISTING FIRST FLOOR CEILING SPACE AND OCCUPANTS.
10. AFTER RECONNECTION OF THE EXISTING PANELBOARD TO THE NEW FEEDER, REMOVE THE EXISTING POWER FEEDER SERVING THE EXISTING PANEL BACK TO MAIN ELECTRICAL ROOM AT THE GRADE FLOOR. EXISTING FEEDER IS ROUTED UP TO SECOND FLOOR, THROUGH SECOND FLOOR WARD C, THEN TO THE CENTRAL CORRIDOR AND DOWN TO THE MAIN ELECTRICAL ROOM VIA A VERTICAL CHASE.
11. CONDUIT STUB-UP AND FUTURE SPACE ALLOCATION FOR EMERGENCY EQUIPMENT PANELBOARDS SERVING GRADE AND FIRST FLOORS. COORDINATE CONDUIT LOCATIONS WITH PROJECT MECHANICAL/PLUMBING CONTRACTORS PRIOR TO ROUGH-IN.
12. CONDUIT STUB-UP AND FUTURE SPACE ALLOCATION FOR EMERGENCY CRITICAL PANELBOARDS SERVING LEVELS GRADE AND FIRST FLOORS. COORDINATE CONDUIT LOCATIONS WITH PROJECT MECHANICAL/PLUMBING CONTRACTORS PRIOR TO ROUGH-IN.
13. CONDUIT STUB-UP AND FUTURE SPACE ALLOCATION FOR NORMAL PANELBOARDS SERVING GRADE AND FIRST FLOORS. COORDINATE CONDUIT LOCATIONS WITH PROJECT MECHANICAL/PLUMBING CONTRACTORS PRIOR TO ROUGH-IN.
14. PROVIDE GROUND ROD AND BONDING OF NEW BUILDING STEEL COLUMNS (RE:2EP501).
15. CIRCUIT NUMBERING SHOWN TO INDICATED SEGREGATION OF CIRCUITS FOR DESIGN INTENT. CONTRACTOR TO VERIFY CIRCUIT NUMBERING IN THE FIELD. PROVIDE NEW 120V, 1P-20A BRANCH CIRCUIT BREAKER TO MATCH EXISTING CIRCUIT BREAKER TYPE & AIC RATING. CONTRACTOR SHALL REPLACE ALL EXISTING CEILING TILES DAMAGED BY THE INSTALLATION OF NEW LIFE SAFETY BRANCH CIRCUITS SERVING SPACE. SEAL ALL CONDUIT PENETRATIONS THROUGH RATED WALLS. PROVIDE ALL REQUIRED WALL PATCHING TO MATCH EXISTING. PROVIDE AN APPROVED SMOKE BARRIER SELF-SEALING PENETRATION SYSTEM AT ALL PENETRATIONS OF SMOKE COMPARTMENTS/ZONES.
16. SEAL ALL ROOF PENETRATIONS. COORDINATE WITH ROOFING MANUFACTURER FOR APPROVED METHODS AND PRODUCT TYPES.
17. STAGGER MOUNTING HEIGHT OF LUMINAIRE TO MAINTAIN 8'-6" ABOVE STAIR TREAD.
18. PROVIDE EXPANSION AND DEFLECTION COUPLINGS AT THE EXPANSION JOINTS IN THE NEW MECHANICAL ROOM AND EXISTING BUILDING WALL INTERFACE FOR ALL RACEWAYS SERVED BY EQUIPMENT LOCATED ON OR WITHIN THE EXISTING BUILDING AND SUPPORTED FROM THE NEW ROOM CEILING OR WALLS.

## BRANCH CIRCUIT NOTES

1. UNLESS OTHERWISE NOTED, ALL NORMAL BRANCH CIRCUITS THIS AREA SHALL BE CIRCUITED NEW TO PANELBOARD 2LNL1B.
2. UNLESS OTHERWISE NOTED, ALL EQUIPMENT BRANCH CIRCUITS THIS AREA SHALL BE CIRCUITED TO NEW PANELBOARD 2LEL1A/B.
3. UNLESS OTHERWISE NOTED, ALL CRITICAL BRANCH CIRCUITS THIS AREA SHALL BE CIRCUITED TO NEW PANELBOARD 2LCL1A/B.
4. CIRCUIT CRITICAL BRANCH CIRCUITS TO PANELBOARD 3LCL1A/B.
5. CIRCUIT EQUIPMENT BRANCH CIRCUITS PANELBOARD 3LEL1A/B.
6. CIRCUIT NORMAL BRANCH CIRCUITS THIS AREA SHALL BE CIRCUITED NEW TO PANELBOARD 3LNL1B.
7. CIRCUIT LIFE SAFETY BRANCH CIRCUITS TO PANELBOARD 1LSL1 LOCATED IN ELEVATOR/CENTRAL CORRIDOR OF FLOOR 1.
8. CIRCUIT LIFE SAFETY BRANCH CIRCUITS TO PANELBOARD 3LSL1 LOCATED IN ELEVATOR/CENTRAL CORRIDOR OF FLOOR 3.
9. CIRCUIT NORMAL BRANCH CIRCUITS TO PANELBOARD 2LNL1A.

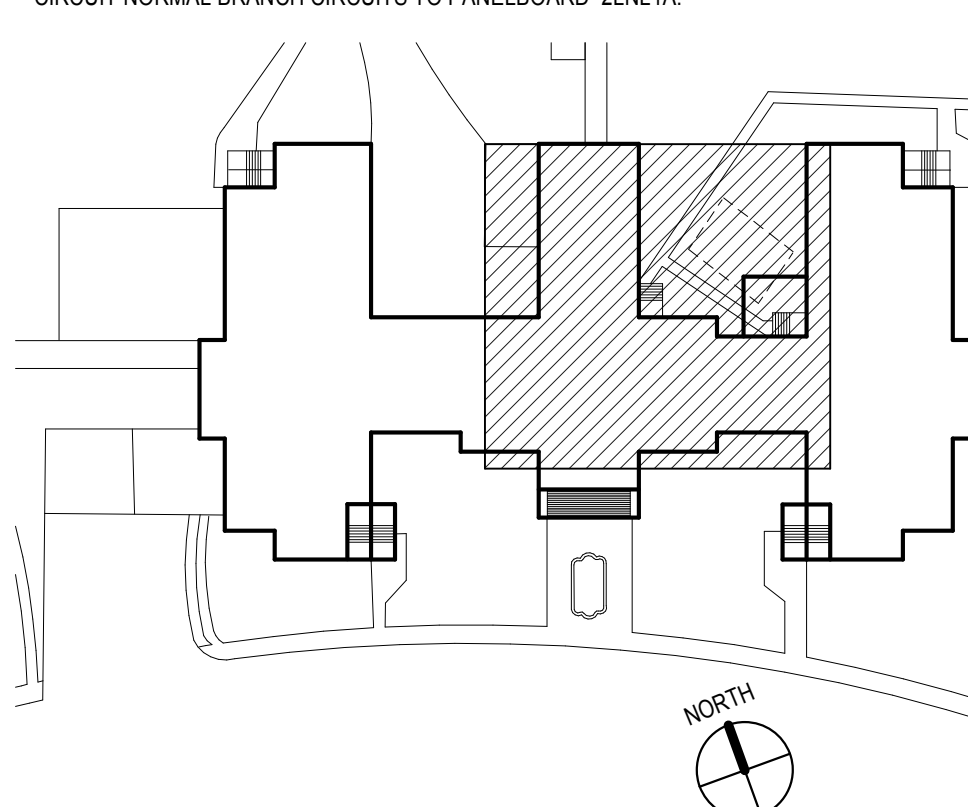

KEY PLAN - BUILDING 1(ELECTRICAL)

FULLY SPRINKLERED

Revisions	Date
ALTERNATE No.4	07/01/14
ALTERNATE No.2 and ALTERNATE No.3	06/19/14
CONSTRUCTION DOCUMENT - 100% SUBMISSION	07/19/13
CONSTRUCTION DOCUMENT - 90% SUBMISSION	04/05/13
FIRE/LIFE SAFETY REVIEW	03/15/13
DESIGN DEVELOPMENT - 60% SUBMISSION (3RD)	11/09/12
DESIGN DEVELOPMENT - 60% SUBMISSION (2ND)	10/05/12
DESIGN DEVELOPMENT - 60% SUBMISSION (1ST)	08/22/12
SCHEMATIC DESIGN - 30% SUBMISSION	09/09/11

VA WESTERN NEW YORK HEALTHCARE SYSTEM  
222 RICHMOND AVE  
BATAVIA, NEW YORK 14020

**CANNON DESIGN**  
2170 Whitehaven Road, Grand Island, New York 14027  
T: 716.773.8800 F: 716.773.5909  
Boston • New York • Baltimore • Washington DC • Buffalo  
Toronto • Chicago • St. Louis • Calgary • Vancouver  
Victoria • San Francisco • Los Angeles • Shanghai  
Architect  
CANNON PROJECT #: 3526.00  
stamp

CARDIOLOGY MANAGER  
DATE  
ENGINEERING MANAGER  
DATE  
INFECTION CONTROL  
DATE  
CARLINE MANAGER  
DATE  
SAFETY OFFICER  
DATE  
CHIEF OF STAFF  
DATE


Drawing Title  
**ENLARGED PLANS**  
Project Title  
**WARD C RENOVATIONS**  
Building Number  
1  
Checked  
T.G.F.  
Drawn  
D.J.J.  
Location  
V.A.M.C. BATAVIA, NEW YORK

Medical Center Director  
Associate Medical Center Director


Date  
09/09/11  
Station No.  
5284  
353  
E401



three eighths inch = one foot  
one and one-half inch = one foot  
one inch = one foot  
three-quarters inch = one foot  
one-half inch = one foot  
three-eighths inch = one foot  
one-quarter inch = one foot  
three-sixteenths inch = one foot  
one-eighth inch = one foot

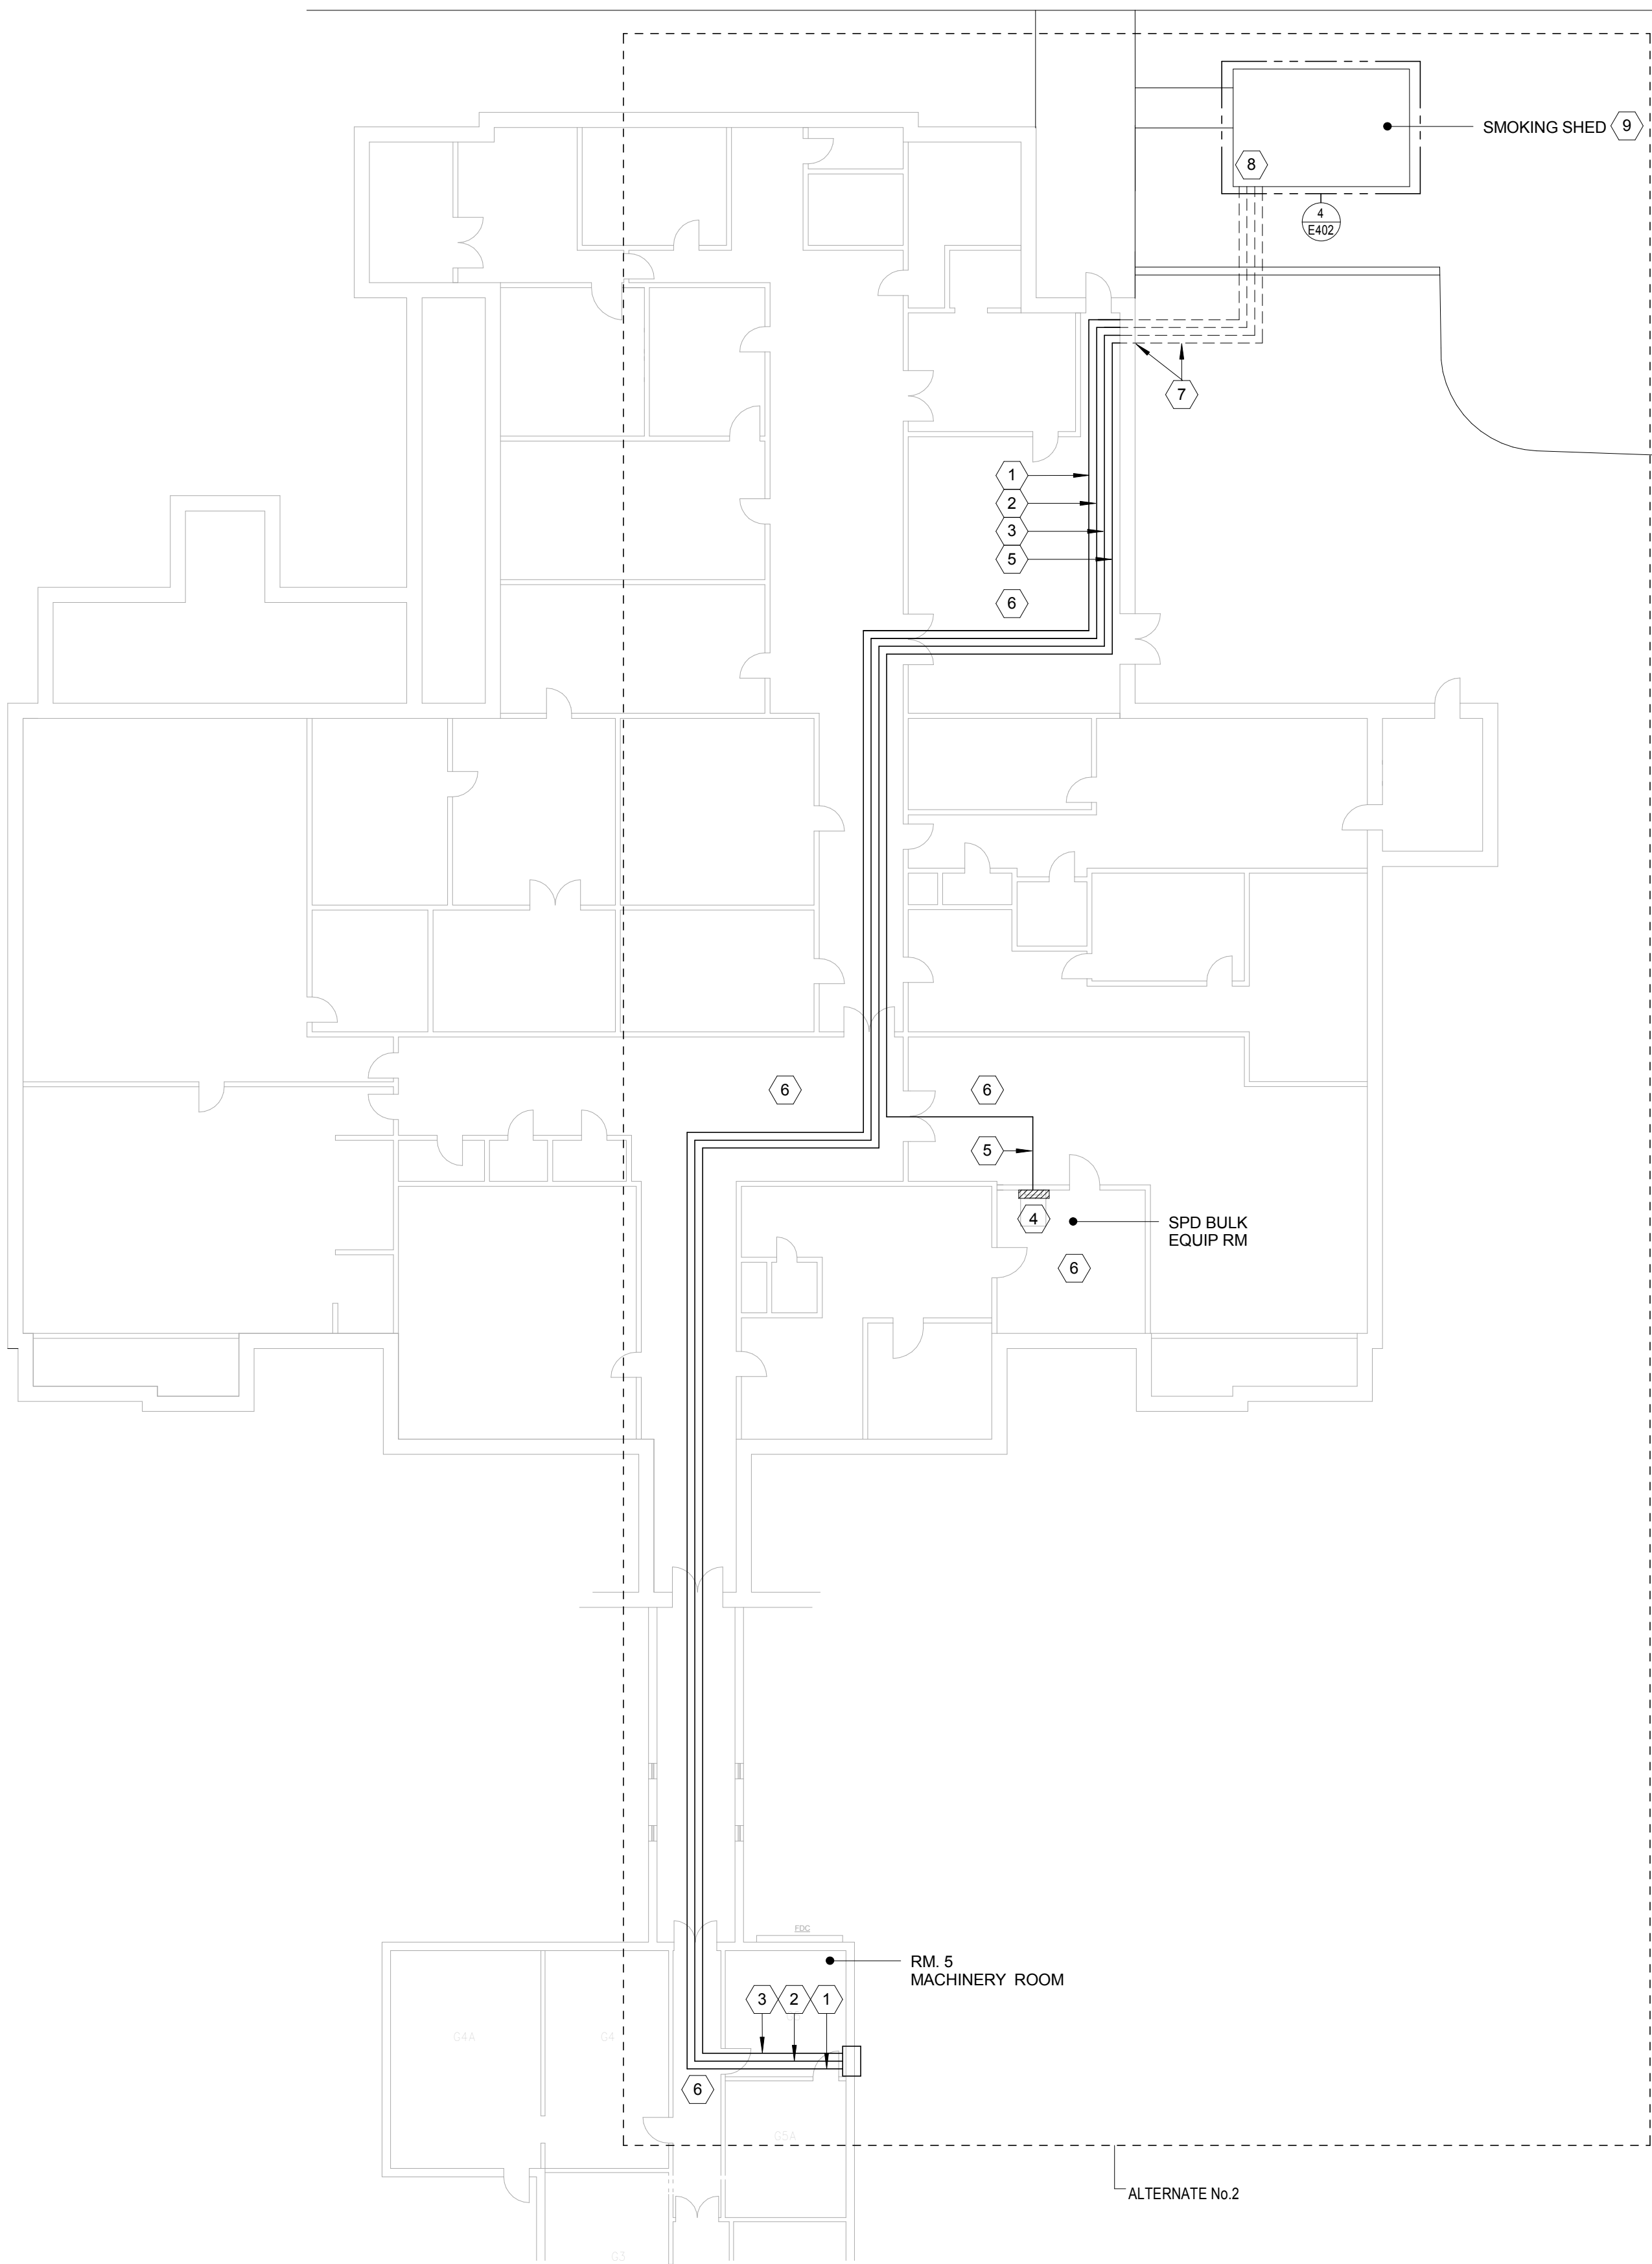

3 BLDG#2 GROUND FLOOR - POWER & SYSTEMS PLAN  
1/16" = 1'-0"

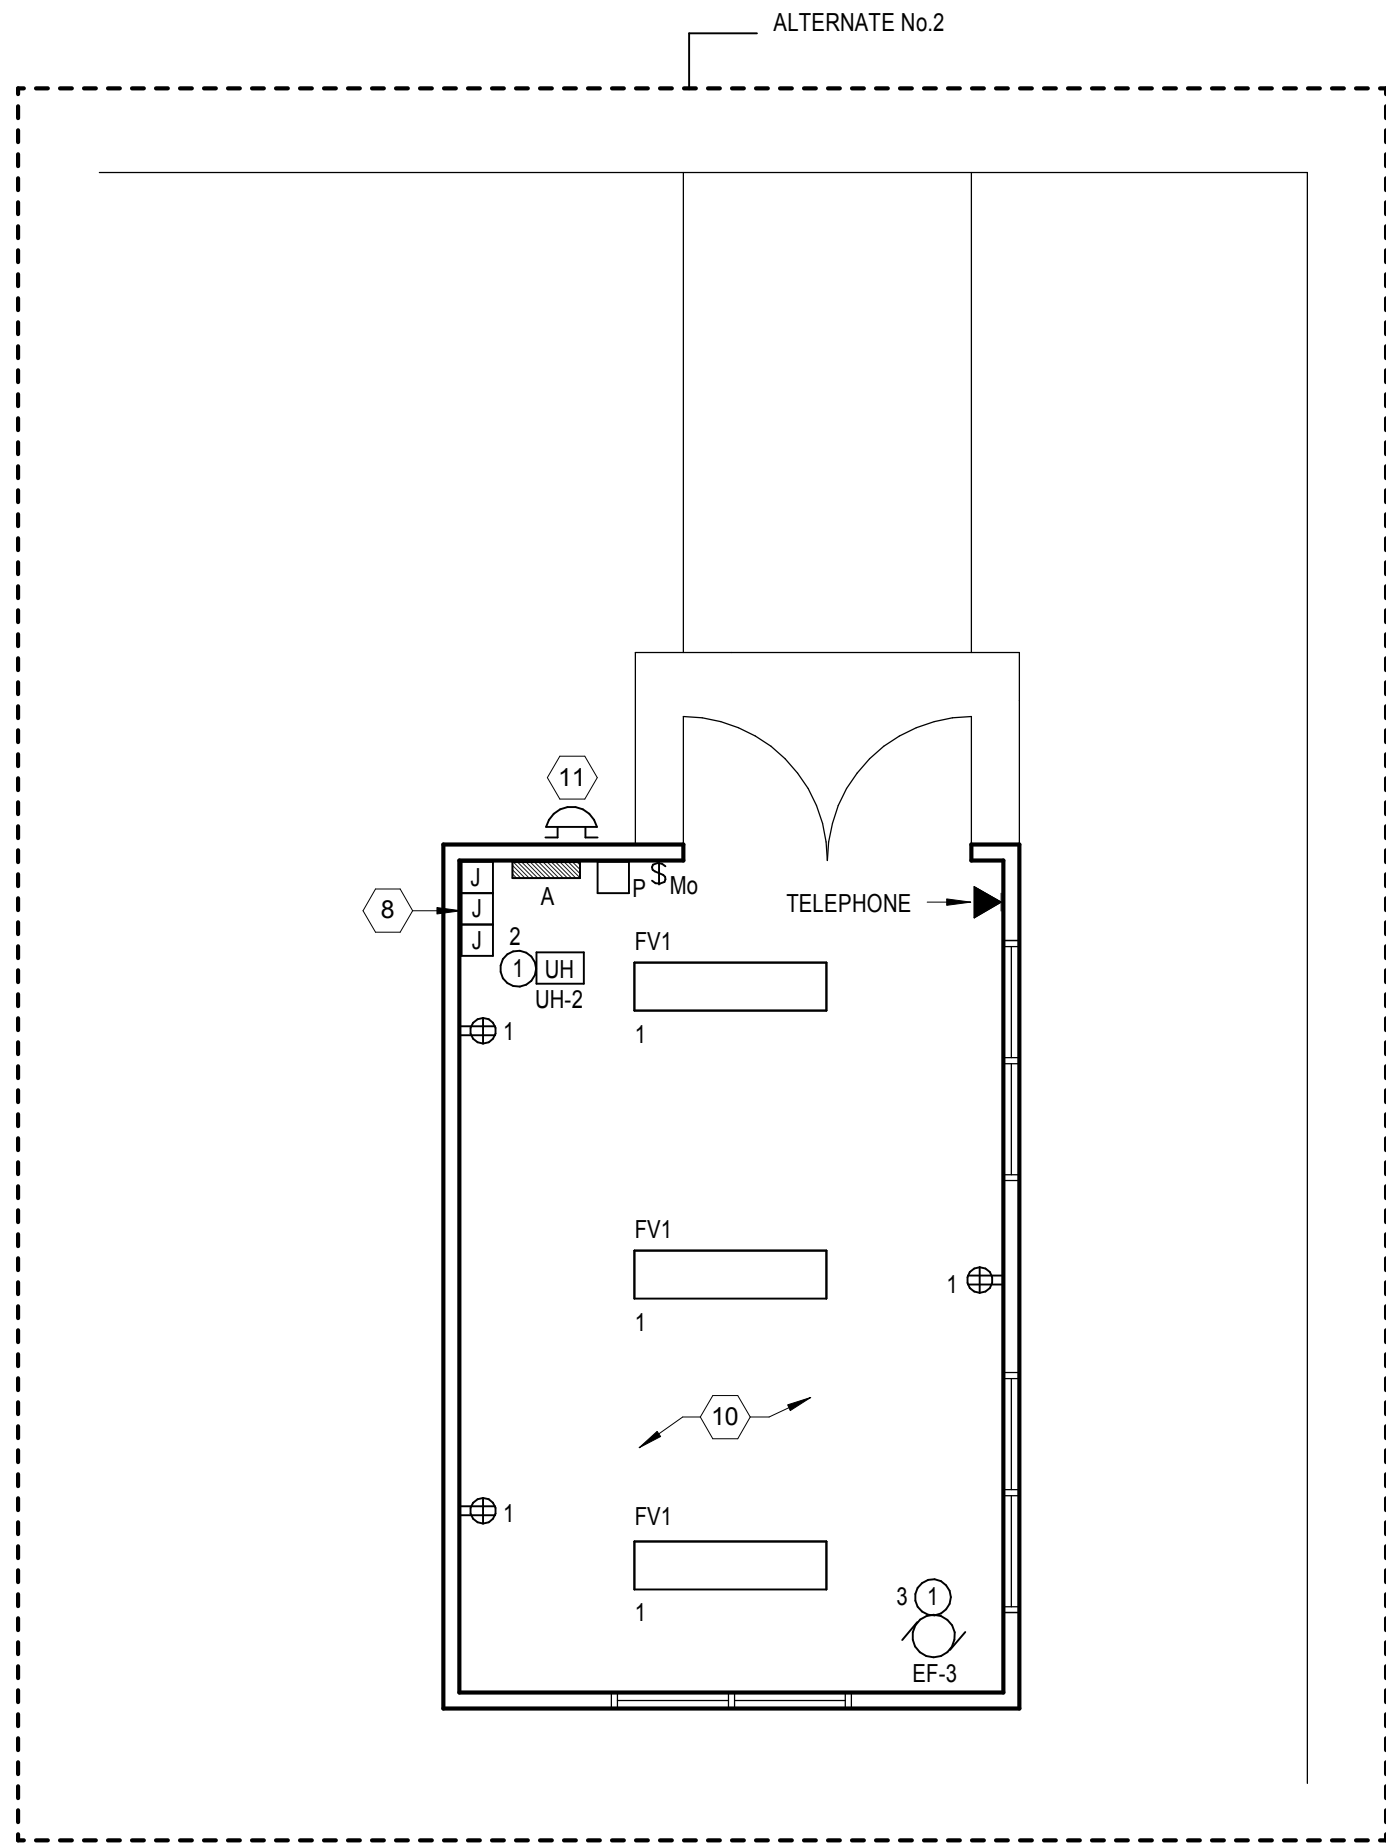

4 SMOKE SHED - POWER & SYSTEMS PLAN  
1/4" = 1'-0"

1 NOTES

- EXISTING SMOKING SHED TELEPHONE CABLING BUILDING EXIT POINT. REFER TO ED101 FOR DEMOLITION DETAILS. PROVIDE A WALL MOUNTED JUNCTION BOX AT EXISTING CABLE LOCATION. EXTEND NEW TELEPHONE CABLING IN 1/2" FROM JUNCTION BOX THROUGH BUILDING #1 AND #2 CEILING SPACES. OUT TO NEW SMOKING SHED LOCATION. COORDINATE FINAL ROUTING IN THE FIELD TO SUIT THE EXISTING CEILING CONDITIONS. PROVIDE A JUNCTION BOX FOR EVERY 180-DEGREES ACCUMULATION OF BRANCH CABLE TRANSITION.
- EXISTING SMOKING SHED FIRE ALARM CABLING (MANUAL PULL STATION) BUILDING EXIT POINT. REFER TO ED101 FOR DEMOLITION DETAILS. PROVIDE A WALL MOUNTED JUNCTION BOX AT EXISTING CABLE LOCATION. EXTEND NEW FIRE ALARM CABLING IN 1/2" FROM JUNCTION BOX THROUGH BUILDING #1 AND #2 CEILING SPACES. OUT TO NEW SMOKING SHED LOCATION. COORDINATE FINAL ROUTING IN THE FIELD TO SUIT THE EXISTING CEILING CONDITIONS. PROVIDE A JUNCTION BOX FOR EVERY 180-DEGREES ACCUMULATION OF BRANCH CABLE TRANSITION.
- EXISTING SMOKING SHED LOW-VOLTAGE PRESSURE MONITORING CABLING BUILDING EXIT POINT. REFER TO ED101 FOR DEMOLITION DETAILS. PROVIDE A WALL MOUNTED JUNCTION BOX AT EXISTING CABLE LOCATION. EXTEND NEW FIRE ALARM CABLING IN 1/2" FROM JUNCTION BOX THROUGH BUILDING #1 AND #2 CEILING SPACES. OUT TO NEW SMOKING SHED LOCATION. COORDINATE FINAL ROUTING IN THE FIELD TO SUIT THE EXISTING CEILING CONDITIONS. COORDINATE FINAL CABLING, CONNECTION, AND REPROGRAMMING REQUIREMENTS WITH THE MECHANICAL DRAWINGS. PROVIDE A JUNCTION BOX FOR EVERY 180-DEGREES ACCUMULATION OF BRANCH CABLE TRANSITION. REFER TO MECHANICAL DRAWINGS FOR FINAL CONNECTION INFORMATION.
- EXISTING BUILDING #2 BRANCH PANELBOARD LOCATED IN S.P.D. BULK EQUIP. RM. PROVIDE A 2P-60A CIRCUIT BREAKER IN EXISTING PANELBOARD. MATCH EXISTING IN MANUFACTURER, TYPE, AND INTERRUPTING RATING. UPDATE PANEL CIRCUIT DIRECTORY ACCORDINGLY.
- PROVIDE A 2P-60A FEEDER THROUGH BUILDING #2 CEILING SPACES AND OUT TO NEW SMOKING SHED LOCATION. COORDINATE FINAL ROUTING IN THE FIELD TO SUIT THE EXISTING CEILING CONDITIONS. PROVIDE A JUNCTION BOX FOR EVERY 180-DEGREES ACCUMULATION OF BRANCH CABLE TRANSITION.
- REPLACE ALL EXISTING CEILING TILES DAMAGED BY THE INSTALLATION OF NEW LIFE SAFETY BRANCH CIRCUITS SERVING WARD-C. SEAL ALL CONDUIT PENETRATIONS THROUGH RATED WALLS. PROVIDE ALL REQUIRED WALL PATCHING TO MATCH EXISTING.
- EXTEND CONDUITS FOR SMOKING SHED THROUGH EXTERIOR WALL, BELOW EXTERIOR GRADE, AND STUB-UP INSIDE NEW SMOKING SHED.
- PROVIDE ACCESSIBLE JUNCTION BOXES RECESSED WITHIN INTERIOR WALL FOR BRANCH CABLING EXTENSION TO ASSOCIATED DEVICES.
- REFER TO ARCHITECTURAL SITE PLAN CS102 FOR FURTHER DETAILS AND INFORMATION.
- ALL ELECTRICAL DEVICES AND BACKBOXES SHALL BE FLUSH MOUNTED AND ALL CONDUIT INSTALLED RECESSED WITHIN WALLS AND CEILING.
- RECONNECT EXISTING EXTERIOR ALARM GONG, ASSOCIATED CONTROL RELAY AND POWER CONNECTION. TEST FIRE ALARM SYSTEM ON COMPLETION OF MANUAL PULLSTATION AND ALARM GONG INSTALLATION.

2 BRANCH CIRCUIT NOTES

- UNLESS OTHERWISE NOTED, ALL BRANCH CIRCUITS SERVING SMOKING SHED AREA SHALL BE CIRCUITED TO EXISTING PANELBOARD A.

Revisions	Date
ALTERNATE No.4	07/01/14
ALTERNATE No.2 and ALTERNATE No.3	08/19/14
CONSTRUCTION DOCUMENT - 100% SUBMISSION	07/19/13
CONSTRUCTION DOCUMENT - 90% SUBMISSION	04/05/13
FIRE/LIFE SAFETY REVIEW	03/15/13
DESIGN DEVELOPMENT - 60% SUBMISSION (3RD)	11/09/12
DESIGN DEVELOPMENT - 60% SUBMISSION (2ND)	10/05/12
DESIGN DEVELOPMENT - 60% SUBMISSION (1ST)	08/22/12
SCHEMATIC DESIGN - 30% SUBMISSION	09/09/11

VA WESTERN NEW YORK HEALTHCARE SYSTEM  
222 RICHMOND AVE  
BATAVIA, NEW YORK 14020

**CANNONDESIGN**  
2170 Whitehaven Road, Grand Island, New York 14072  
T: 716.773.8800 F: 716.773.5909

Boston ■ New York ■ Baltimore ■ Washington DC ■ Buffalo  
Toronto ■ Chicago ■ St. Louis ■ Calgary ■ Vancouver  
Victoria ■ San Francisco ■ Los Angeles ■ Shanghai

Architect  
CANNON PROJECT #: 3526.00

stamp

CARDIOLOGY MANAGER

DATE

ENGINEERING MANAGER

DATE

INFECTION CONTROL

DATE

CARELINE MANAGER

DATE

SAFETY OFFICER

DATE

CHIEF OF STAFF

DATE

Drawing Title

ENLARGED PLANS

Project Title

WARD C RENOVATIONS

Date

09/09/11

Station No.

5284

Building Number

1

Checked

T.G.F.

Drawn

D.J.J.


Location

V.A.M.C. BATAVIA, NEW YORK


353

E402


FULLY SPRINKLERED

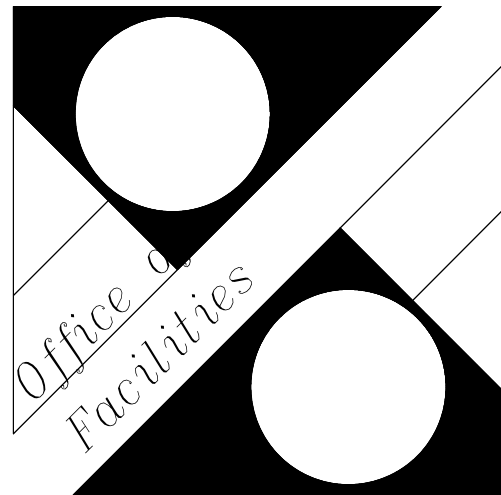


Department of Veterans Affairs

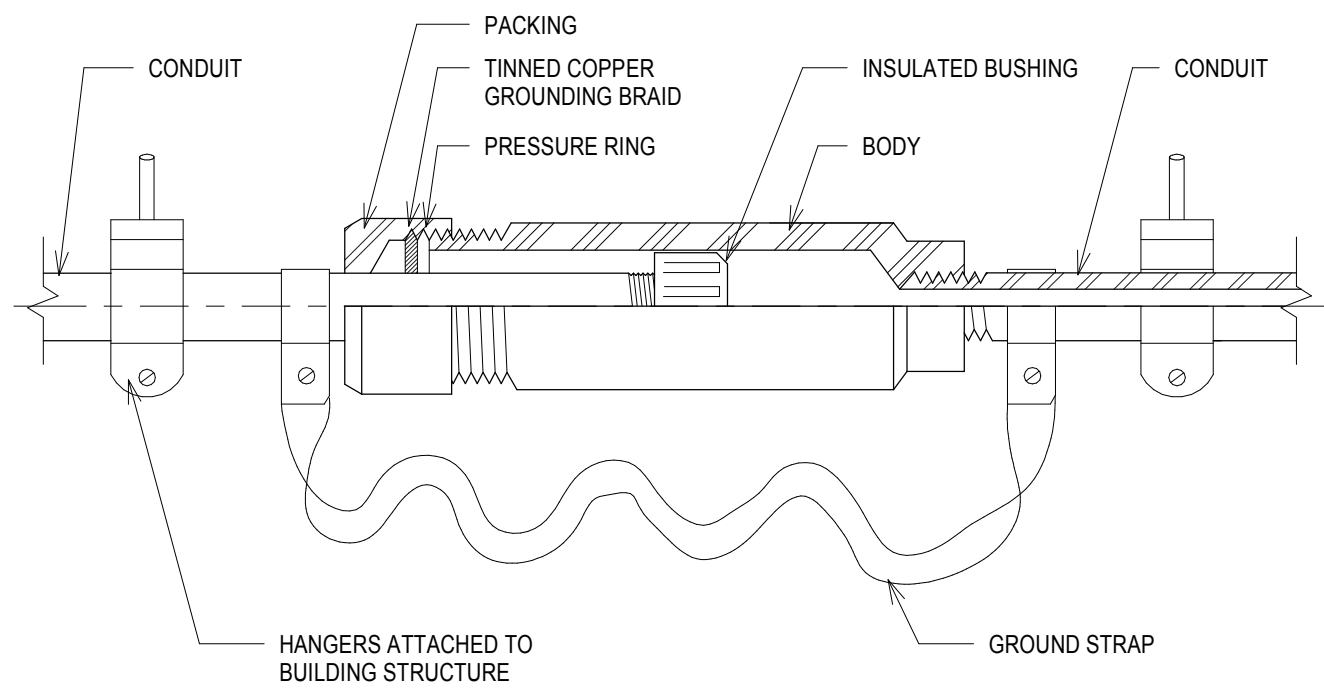

8 CONDUIT EXPANSION FITTING DETAIL

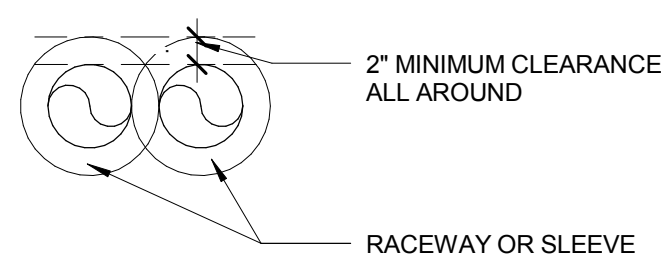


CLEARANCE REQUIREMENTS

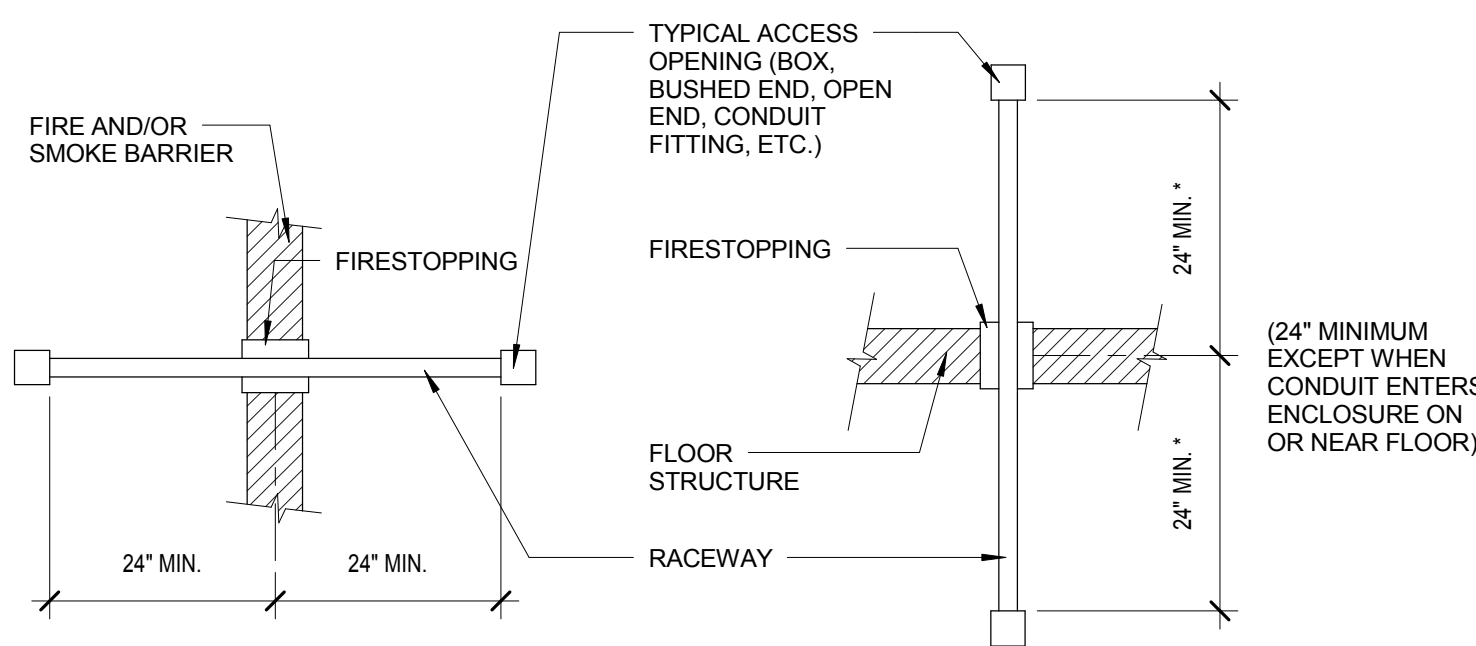


ELEVATION

ELEVATION

7 PENETRATION THROUGH VERT. HORIZ. FIRE AND SMOKE BARRIER

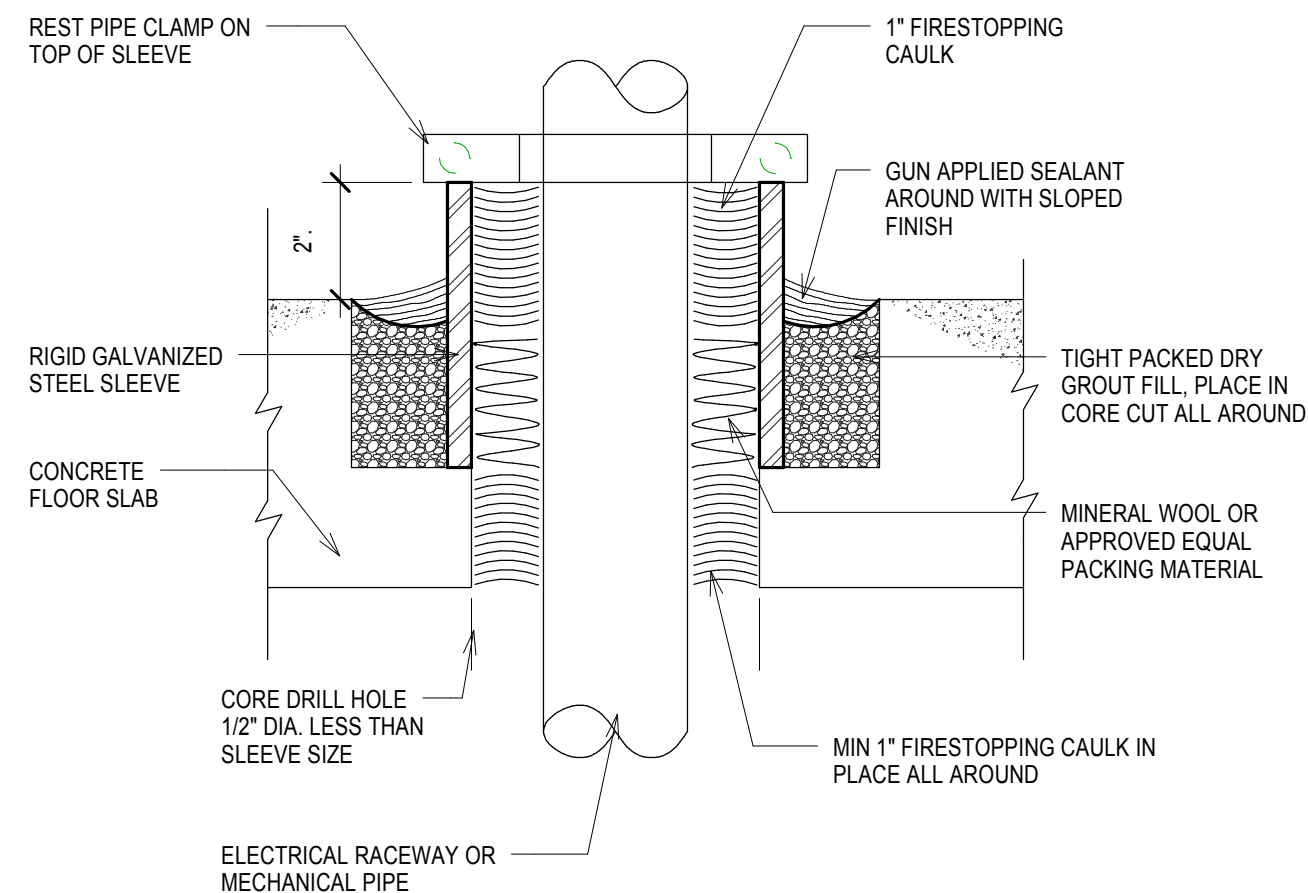



6 AFTER SET SLEEVE IN CONCRETE FLOOR SLAB DETAIL

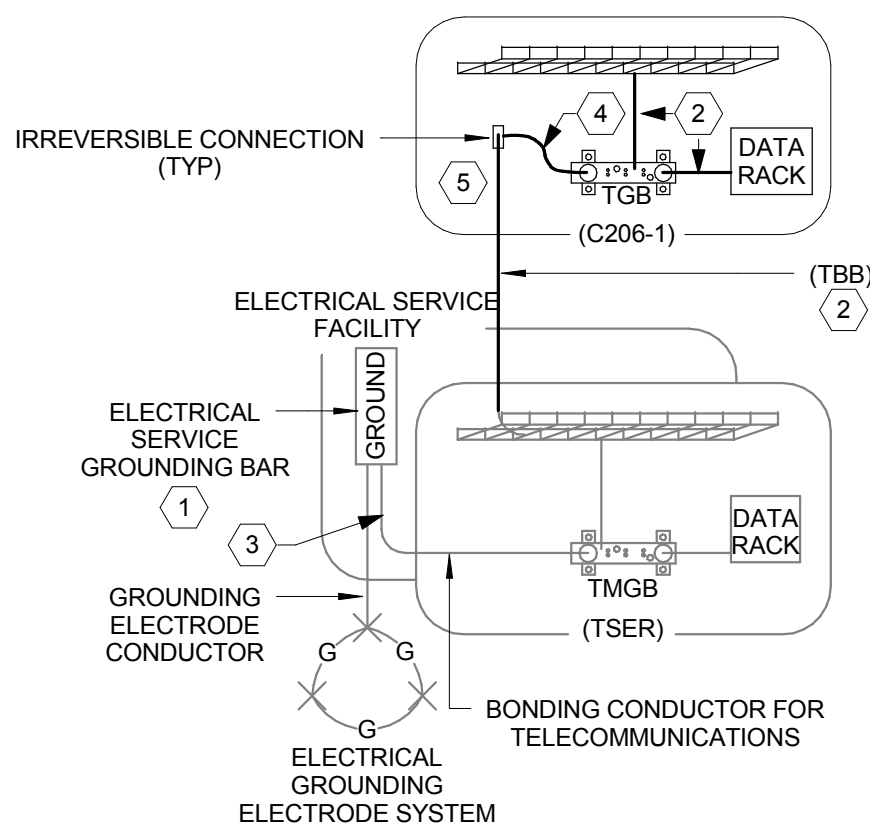

NOTES

1. INTERSYSTEM BONDING TERMINATION PER NEC FOR OUTSIDE WIRING FROM RADIO ANTENNA, CATV SYSTEMS, TELEPHONE SYSTEMS, NETWORKED POWERED BROADBAND COMMUNICATIONS SYSTEMS, TELEVISION ANTENNA, FIRE ALARM, BURGLAR ALARM & CENTRAL STATION SYSTEMS.
2. COPPER CONDUCTOR SIZED PER TELECOMMUNICATIONS BONDING SIZE TABLE.
3. MINIMUM CONDUCTOR SIZE SHALL BE LARGER DIAMETER THAN LONGEST TELECOMMUNICATIONS BONDING BACKBONE (TBB) SIZE. ROUTE TELECOM GROUND CONDUCTOR TO MAIN ELECTRICAL ROOM THROUGH SEPARATE CONDUIT INSTALLED IN THE EXTERIOR POWER DUCTBANK/CONDUIT SYSTEM.
4. MINIMUM CONDUCTOR SIZE SHALL BE ONE GAGE SMALLER IN DIAMETER THAN ASSOCIATED TBB.
5. PROVIDE BONDING CONNECTION TO ALL EQUIPMENT PANELS, RACKS, BACKBOARDS, SLEEVES, CABLE TRAY/RUNWAY, STATIC DISSIPATIVE FLOORING AND PANELBOARDS LOCATED IN ROOM.

5 TELECOMMUNICATIONS BONDING

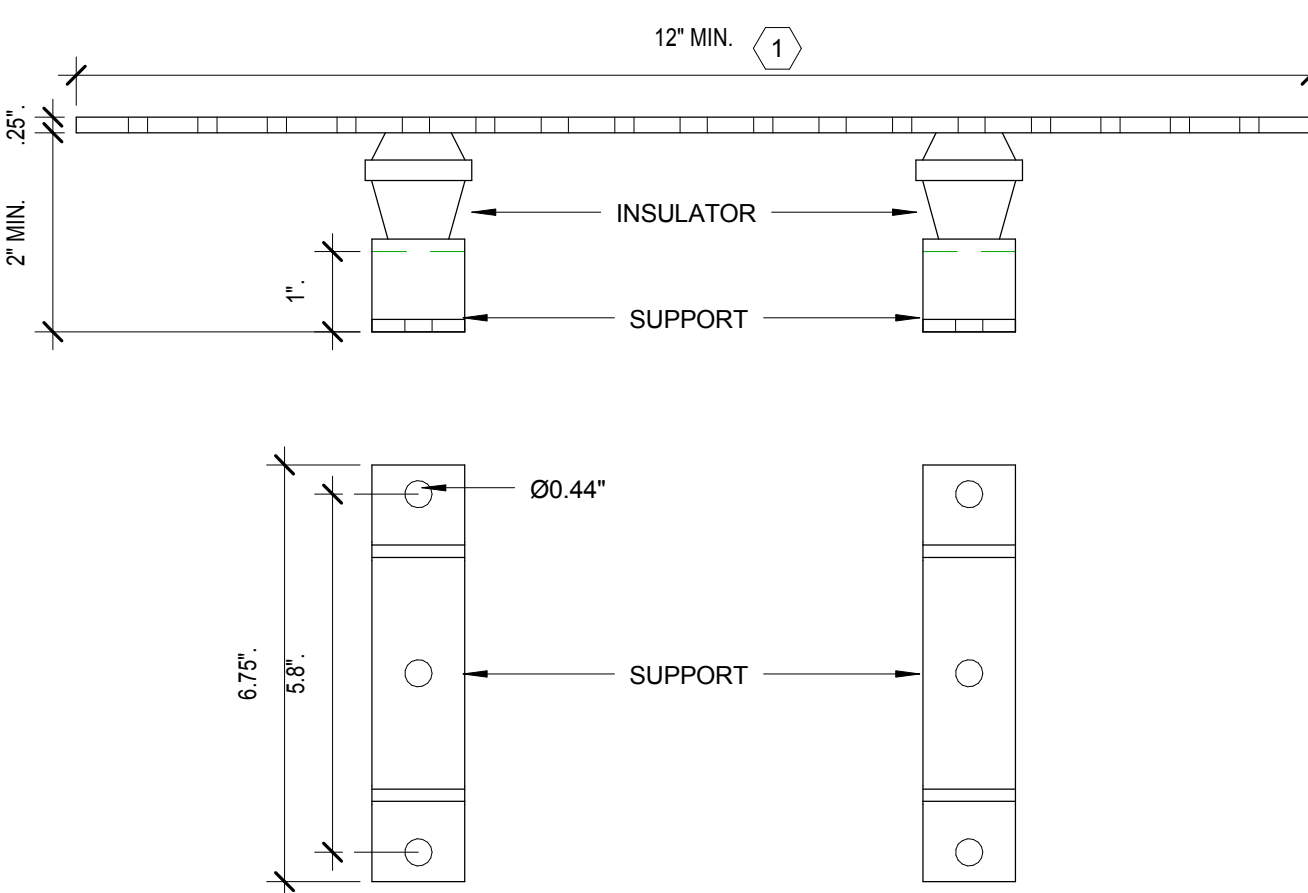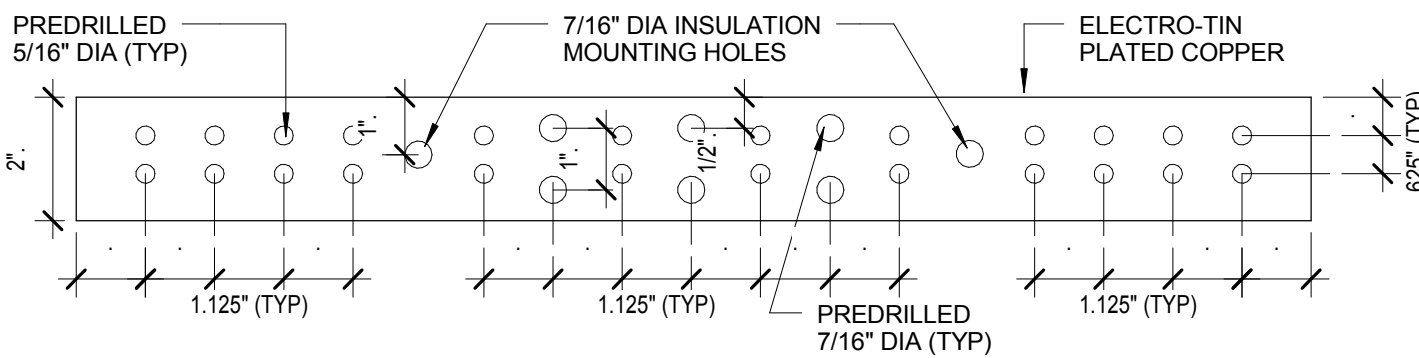

NOTES

1. VARY LENGTH TO MEET APPLICATION REQUIREMENTS OF LISTED COMPRESSIONS TWO-HOLE LUGS.


4 TELECOMMUNICATIONS GROUNDING BUSBAR (TGB)

MINIMUM SIZE BONDING CONDUCTOR FOR TELECOMMUNICATIONS		
CONDUCTOR LENGTH (FEET)	CONDUCTOR SIZE (AWG)	MAXIMUM AREA (CIRCULAR MILS)
13	6	26,240
21	4	41,740
26	3	52,620
33	2	66,360
42	1	83,680
53	1/0	105,600
67	2/0	133,100
84	3/0	167,800
106	4/0	211,600
125	250	250,000
150	300	300,000
175	350	350,000
200	400	400,000
250	500	500,000
300	600	600,000
350	700	700,000
375	750	750,000
400	800	800,000
450	900	900,000
500	1000	1,000,000
625	1250	1,250,000
750	1500	1,500,000
875	1750	1,750,000
1000	2000	2,000,000


DESIGN GUIDE BASIS:

1. MAXIMUM VALUE OF 0.1 OHM AT EACH POINT
2. 2K CIRCULAR MILS NEEDED FOR EVERY FOOT
3. NEC TABLE 8
4. WHERE NECESSARY TO COMPLY WITH SPECIFICATION REQUIREMENTS, CONDUCTOR MAY BE SIZED ONE AWG LARGER THAN GIVEN IN THIS TABLE.

3 TELECOMMUNICATIONS BONDING SIZE TABLE

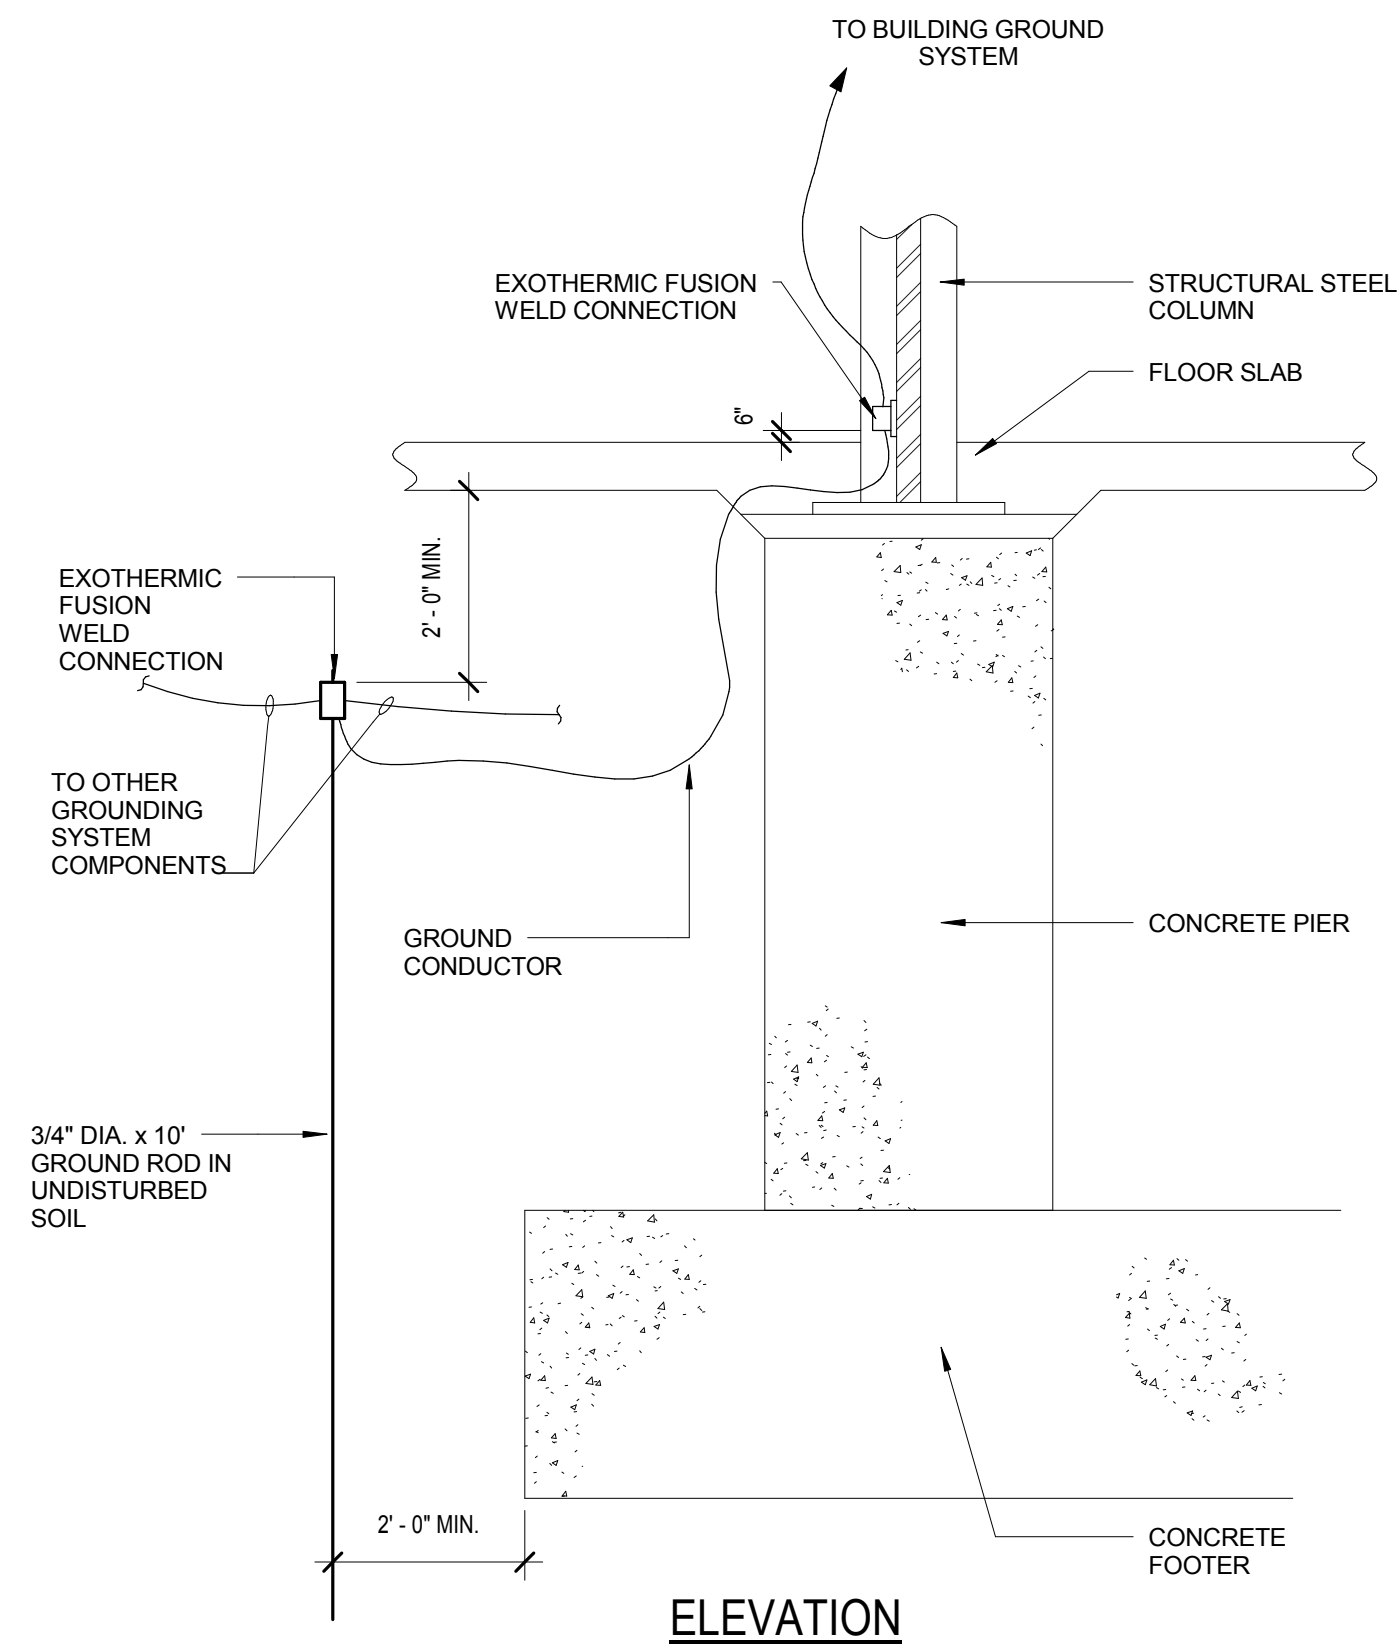

2 BUILDING GROUNDING

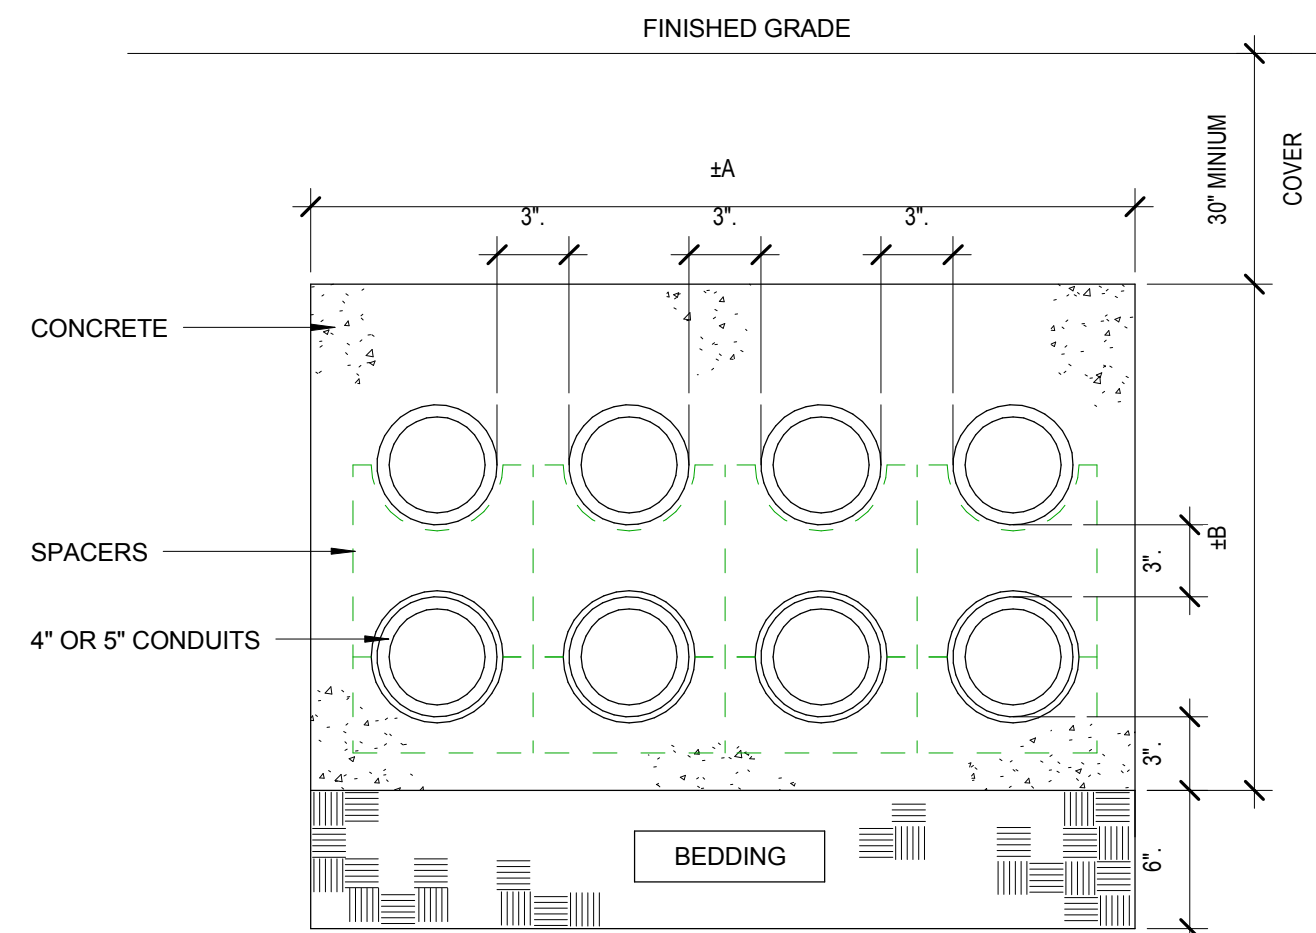

ELEVATION

NOTE:  
USE SIMILAR SPACINGS FOR CONFIGURATIONS NOT IDENTIFIED.

No. OF DUCTS	DUCT SIZE	CONFIG. (A/B DUCTS)	A	B
9	4"	3A/3B	24"	24"

1 DUCT BANK

Revisions	Date
ALTERNATE No. 4	07/01/14
ALTERNATE No. 2 and ALTERNATE No. 3	06/19/14
CONSTRUCTION DOCUMENT - 100% SUBMISSION	07/19/13
CONSTRUCTION DOCUMENT - 90% SUBMISSION	04/05/13
FIRE/LIFE SAFETY REVIEW	03/15/13
DESIGN DEVELOPMENT - 60% SUBMISSION (3RD)	11/09/12
DESIGN DEVELOPMENT - 60% SUBMISSION (2ND)	10/05/12
DESIGN DEVELOPMENT - 60% SUBMISSION (1ST)	08/22/12
SCHEMATIC DESIGN - 30% SUBMISSION	09/09/11

VA WESTERN NEW YORK HEALTHCARE SYSTEM  
222 RICHMOND AVE  
BATAVIA, NEW YORK 14020

**CANNONDESIGN**  
2170 Whitehaven Road, Grand Island, New York 14072  
T: 716.773.6800 F: 716.773.5909

Boston • New York • Baltimore • Washington DC • Buffalo  
Toronto • Chicago • St. Louis • Calgary • Vancouver  
Victoria • San Francisco • Los Angeles • Shanghai

Architect CANNON PROJECT #: 3526.00

stamp


CARDIOLOGY MANAGER	DATE	ENGINEERING MANAGER	DATE
INFECTION CONTROL	DATE	CARELINE MANAGER	DATE
SAFETY OFFICER	DATE	CHIEF OF STAFF	DATE

Drawing Title	
ELECTRICAL DETAILS	
MEDICAL CENTER DIRECTOR	DATE
ASSOCIATE MEDICAL CENTER DIRECTOR	DATE

Project Title	
WARD C RENOVATIONS	
Building Number	Checked T.G.F.
Location	Drawn D.J.J.
V.A.M.C. BATAVIA, NEW YORK	


Date	09/09/11
Station No.	528A
353	E501



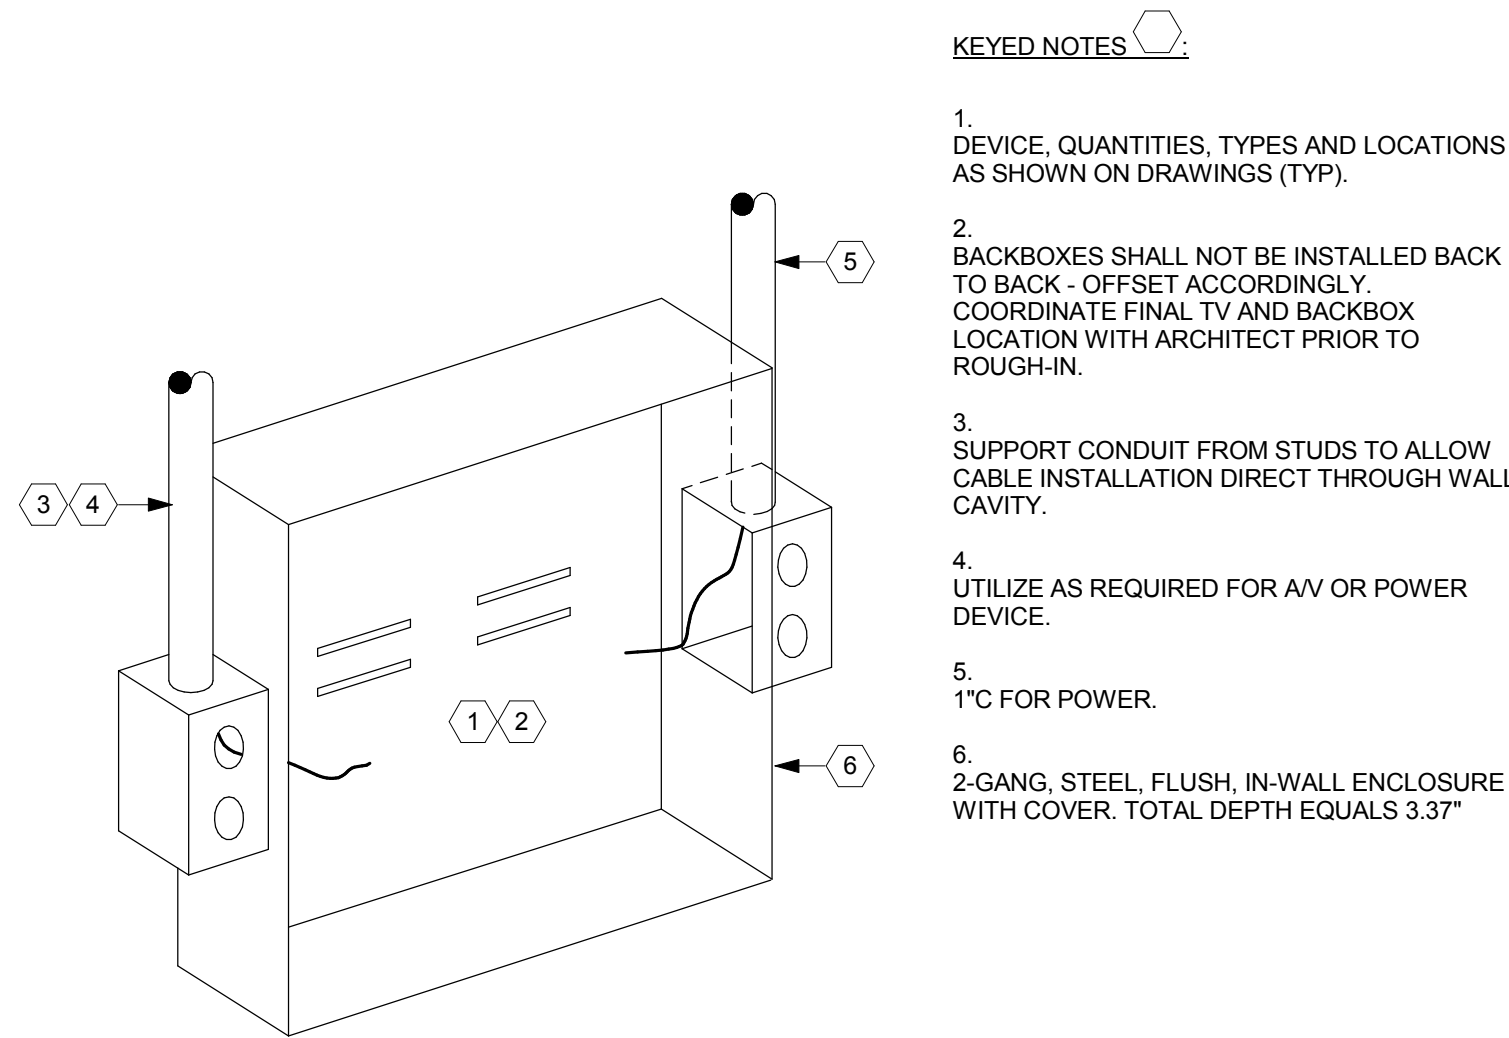


NOTE:  
PROVIDE BACKBOXES FOR ALL CONDUIT STUBS AND FIRE-RATED PUTTY  
PADS AT FIRE-RATED WALLS.

#### 4 MULTI-SERVICE TV WALL BOX

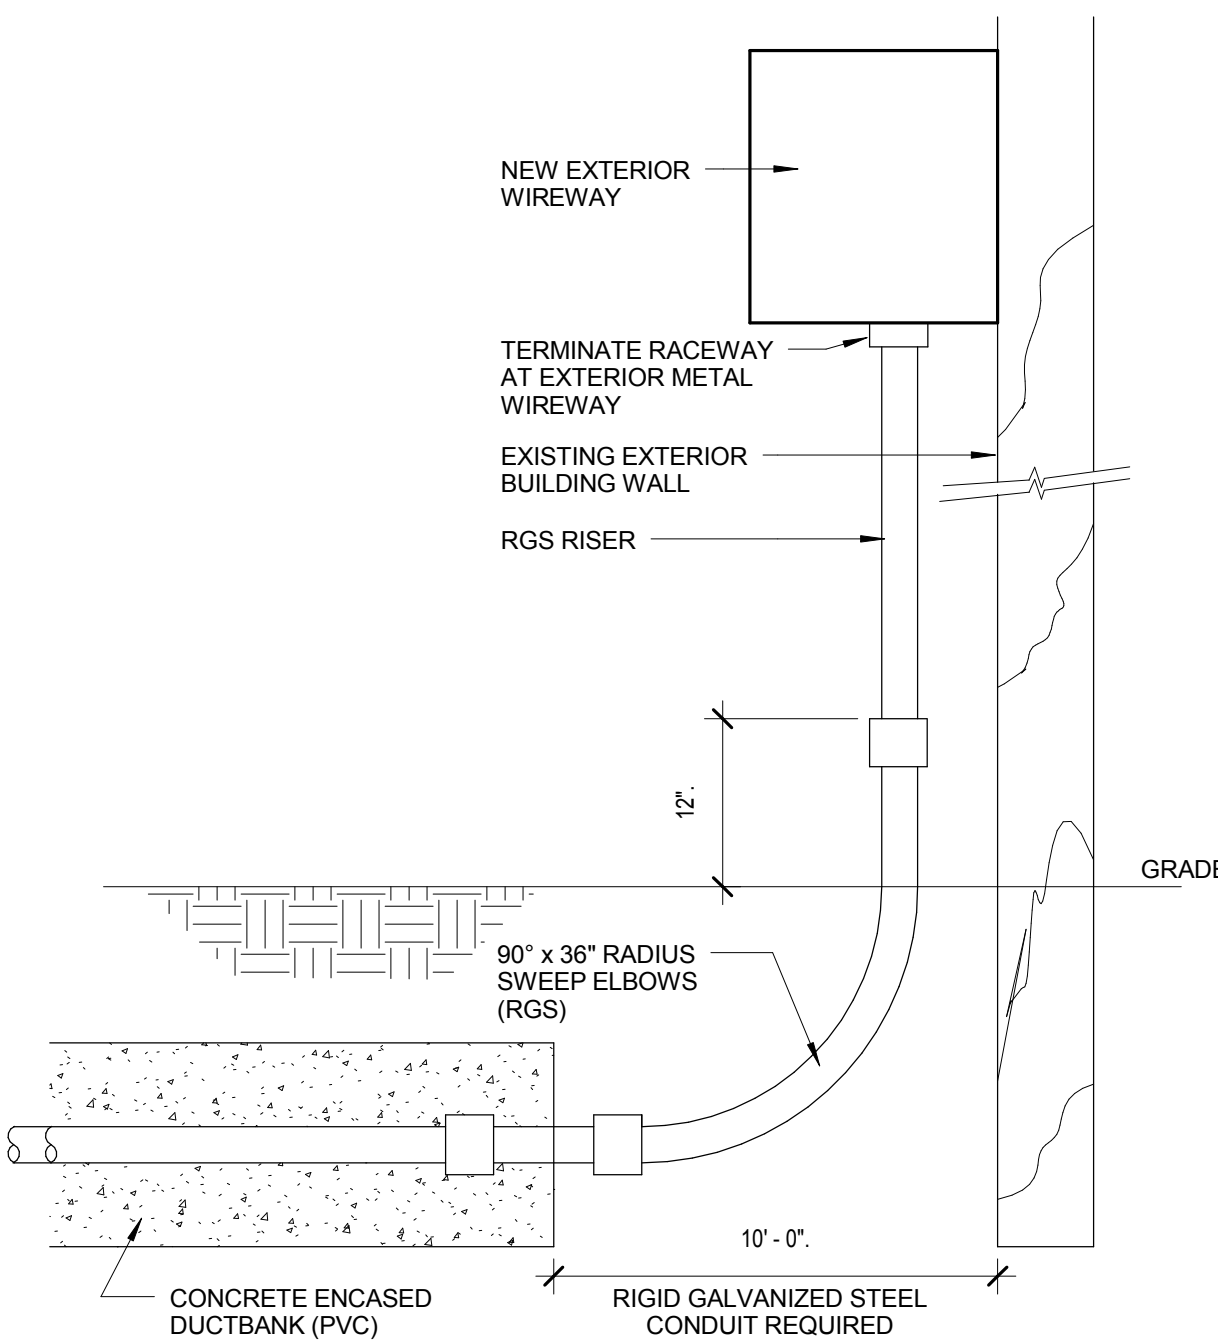


#### 3 CONDUIT RISER AT EXISTING BUILDING

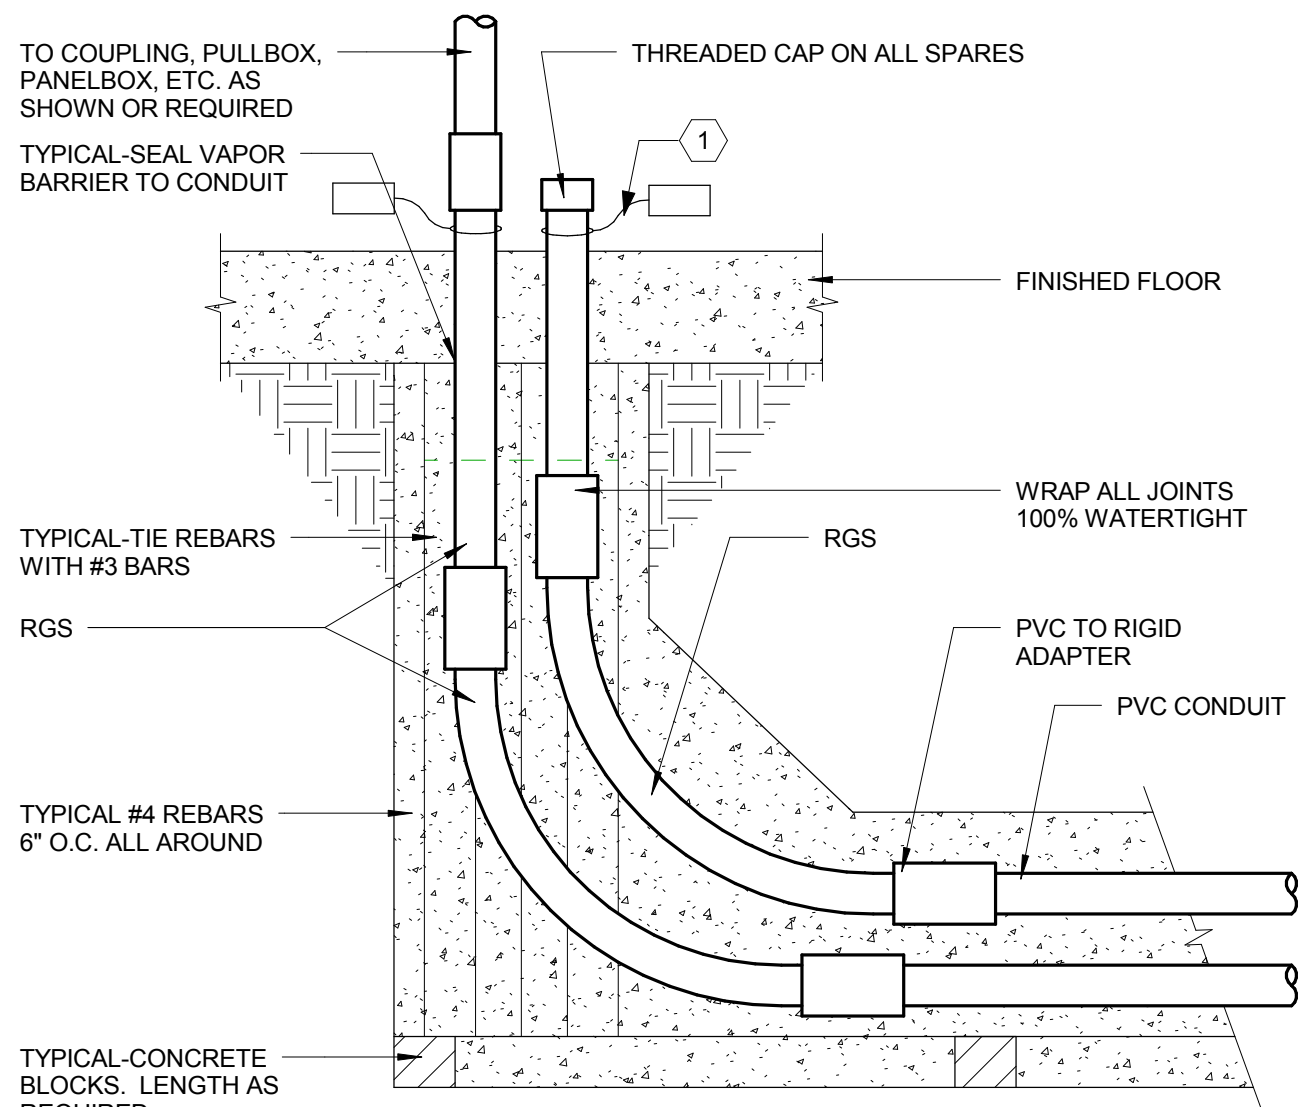

NOTES:  
1. AT EACH CONDUIT STUB-UP, AFFIX ENGRAVED METAL NAMEPLATE INDICATING CONDUIT NO. OR  
CIRCUIT IDENTIFICATION. ATTACH WITH NYLON CABLE TIE.

#### 2 CONDUIT STUB-UP INSIDE BUILDING

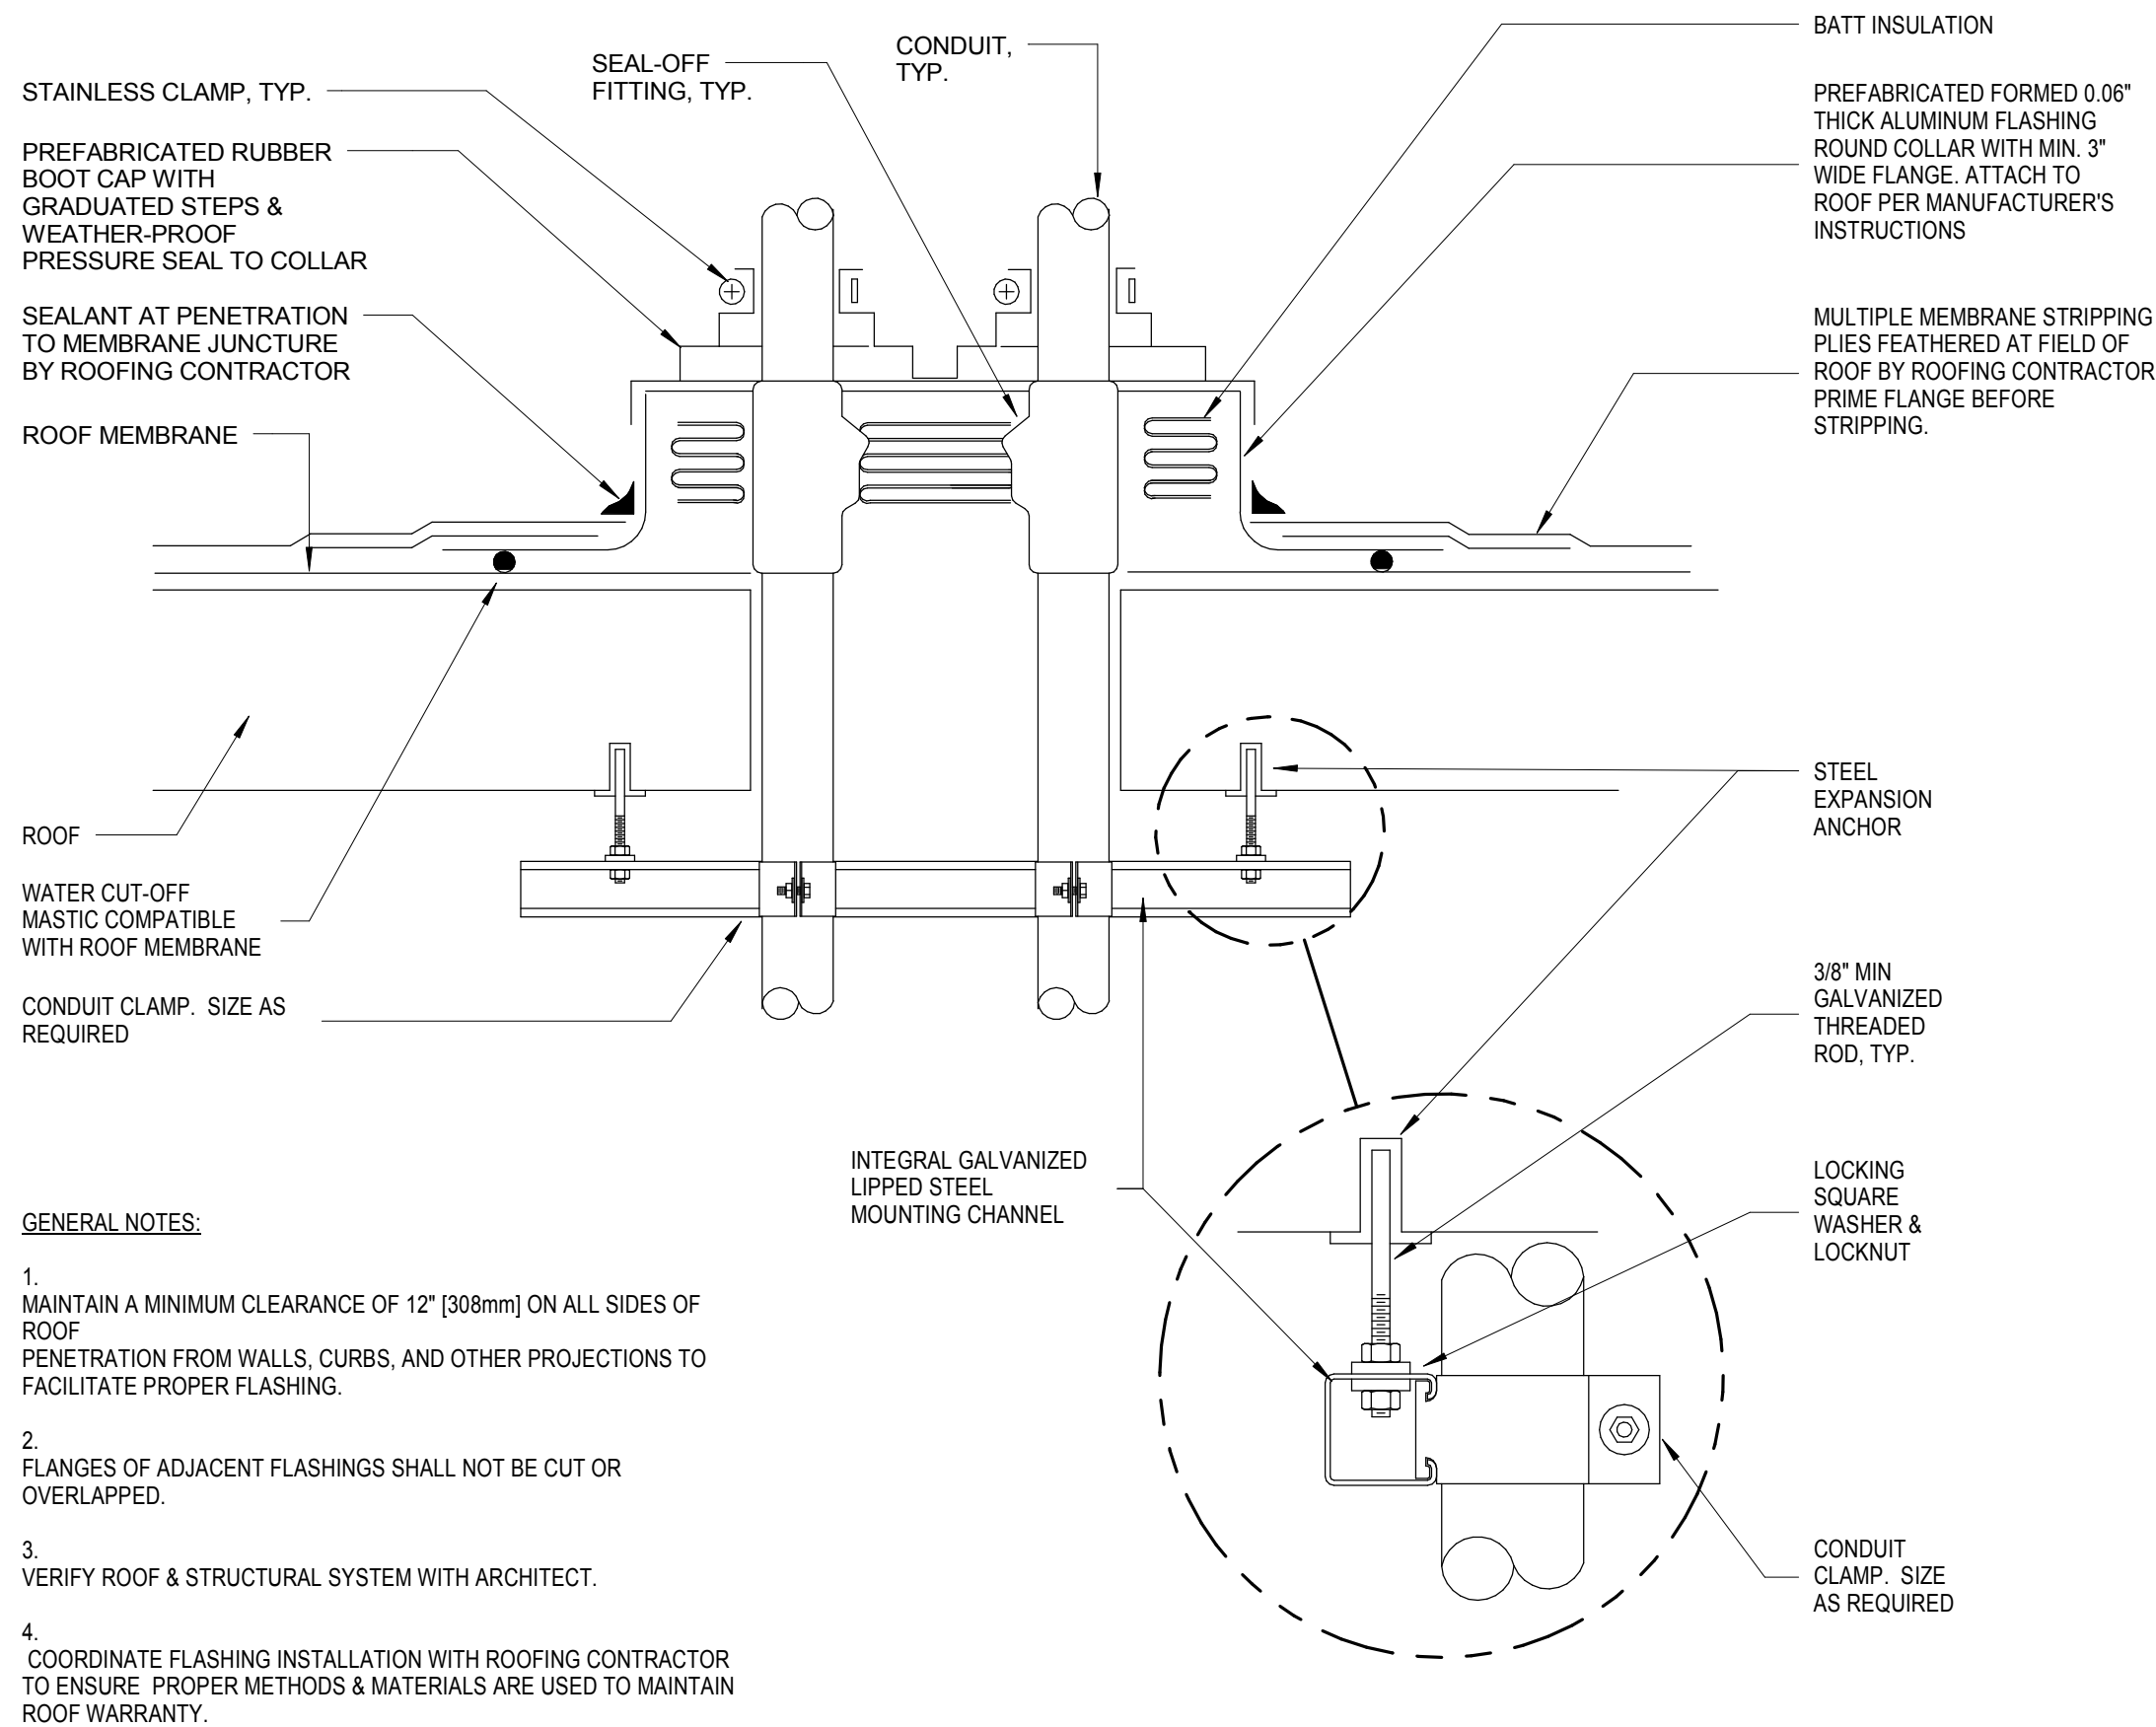

GENERAL NOTES:  
1. MAINTAIN A MINIMUM CLEARANCE OF 12" (308mm) ON ALL SIDES OF  
ROOF PENETRATION FROM WALLS, CURBS, AND OTHER PROJECTIONS TO  
FACILITATE PROPER FLASHING.  
2. FLANGES OF ADJACENT FLASHINGS SHALL NOT BE CUT OR  
OVERLAPPED.  
3. VERIFY ROOF & STRUCTURAL SYSTEM WITH ARCHITECT.  
4. COORDINATE FLASHING INSTALLATION WITH ROOFING CONTRACTOR  
TO ENSURE PROPER METHODS & MATERIALS ARE USED TO MAINTAIN  
ROOF WARRANTY.

#### 1 ROOF PENETRATION DETAIL

ALTERNATE No. 4	07/01/14
ALTERNATE No. 2 and ALTERNATE No. 3	06/19/14
CONSTRUCTION DOCUMENT - 100% SUBMISSION	07/19/13
CONSTRUCTION DOCUMENT - 90% SUBMISSION	04/05/13
FIRE/LIFE SAFETY REVIEW	03/15/13
DESIGN DEVELOPMENT - 60% SUBMISSION (3RD)	11/09/12
DESIGN DEVELOPMENT - 60% SUBMISSION (2ND)	10/05/12
DESIGN DEVELOPMENT - 60% SUBMISSION (1ST)	08/22/12
SCHEMATIC DESIGN - 30% SUBMISSION	09/09/11
Revisions	Date

VA WESTERN NEW YORK HEALTHCARE SYSTEM  
222 RICHMOND AVE  
BATAVIA, NEW YORK 14020

**CANNONDESIGN**

2170 Whitehaven Road, Grand Island, New York 14072  
T: 716.773.8800 F: 716.773.5909

Boston ■ New York ■ Baltimore ■ Washington DC ■ Buffalo  
Toronto ■ Chicago ■ St. Louis ■ Calgary ■ Vancouver  
Victoria ■ San Francisco ■ Los Angeles ■ Shanghai

CANNON PROJECT #: 3526.00

Architect

stamp

CARDIOLOGY MANAGER

DATE

ENGINEERING MANAGER

DATE

INFECTION CONTROL

DATE

CARELINE MANAGER

DATE

SAFETY OFFICER

DATE

CHIEF OF STAFF

DATE

Drawing Title

ELECTRICAL DETAILS

MEDICAL CENTER DIRECTOR

DATE

ASSOCIATE MEDICAL CENTER DIRECTOR

DATE

Project Title

WARD C RENOVATIONS

Building Number

1

Checked

T.G.F.

Drawn

D.J.J.

Location

V.A.M.C. BATAVIA, NEW YORK

Date

09/09/11

Station No.

5284

353

E502

FULLY SPRINKLERED




Department of  
Veterans Affairs

	HAND	OFF	AUTO		HAND	OFF	AUTO
A1	CLOSED	OPEN	CLOSED	B1	OPEN	CLOSED	OPEN
A2	CLOSED	OPEN	OPEN	B2	CLOSED	OPEN	OPEN
A3	CLOSED	OPEN	CLOSED	B3	OPEN	OPEN	CLOSED


A1/B1 H-O-A OR O-A SELECTOR SWITCH MAINTAINED CONTACT (\* = CONTACT NUMBER)

	NORMALLY CLOSED MOMENTARY CONTACT SWITCH		1 IN SERVICE INTERLOCK DEVICE (EIP SWITCH IN SERVICE INDICATOR, ETC.) PROVIDE SEPARATE CONTACT FOR EACH REQUIRED DEVICE.
	NORMALLY OPEN MOMENTARY CONTACT SWITCH		2 PARALLELED STARTING DEVICE (DIVISION 15 TEMPERATURE CONTROL SYSTEM CONTACT, FIRE ALARM CONTACT, STAGGER START CONTACT, INTERLOCK, ETC.)
	MOTOR THERMAL OVERLOAD		3 MOMENTARY CONTACT PUSH BUTTON SWITCH AT FIRE FIGHTERS COMMAND CENTER.
	FIELD WIRING		4 SMOKE EXHAUST EIP SWITCHES.
	GREEN PILOT LIGHT		5 PARALLELED START/STOP DEVICE (DIVISION 15 TEMPERATURE CONTROL SYSTEM CONTACT, START/STOP PUSHBUTTON STAGGER START CONTACT, INTERLOCK, P.I.E SWITCH, ETC.) JUMPER IF NONE REQUIRED.
	RED PILOT LIGHT		6 EIP HOLDING COIL FOR SMOKE DAMPERS AND OUTSIDE AIR.
	AMBER PILOT LIGHT		7 ALLOW RUN INTERLOCK DEVICE (DAMPER END SWITCH, FREEZE/STAT, FIRE/STAT, P.I.E SWITCH, FLOW SWITCH, INTERLOCK, ETC.) WIRED IN SERIES. JUMPER IF NONE REQUIRED.
	BLUE PILOT LIGHT		8 DIVISION 15 TEMPERATURE CONTROL SYSTEM NORMALLY OPEN START/STOP CONTACT FOR SMOKE PURGE OVERRIDE ONLY.
	M MOTOR CONTACTS AND HOLDING COIL		FA NORMALLY CLOSED FIRE ALARM SHUTDOWN CONTACT (REFER TO SECTIONS 15025 AND 16025 FOR DIVISION OF WORK) JUMPER IF NOT REQUIRED.
	CR CONTROL RELAY CONTACTS AND HOLDING COIL		
	L LOW SPEED CONTACTS AND HOLDING COIL		
	H HIGH SPEED CONTACTS AND HOLDING COIL		
	SE SMOKE EXHAUST CONTACTS AND HOLDING COIL		
	OL MOTOR OVERLOAD RELAYS		

## 10 MOTOR STARTER CONTROL CIRCUIT LEGEND

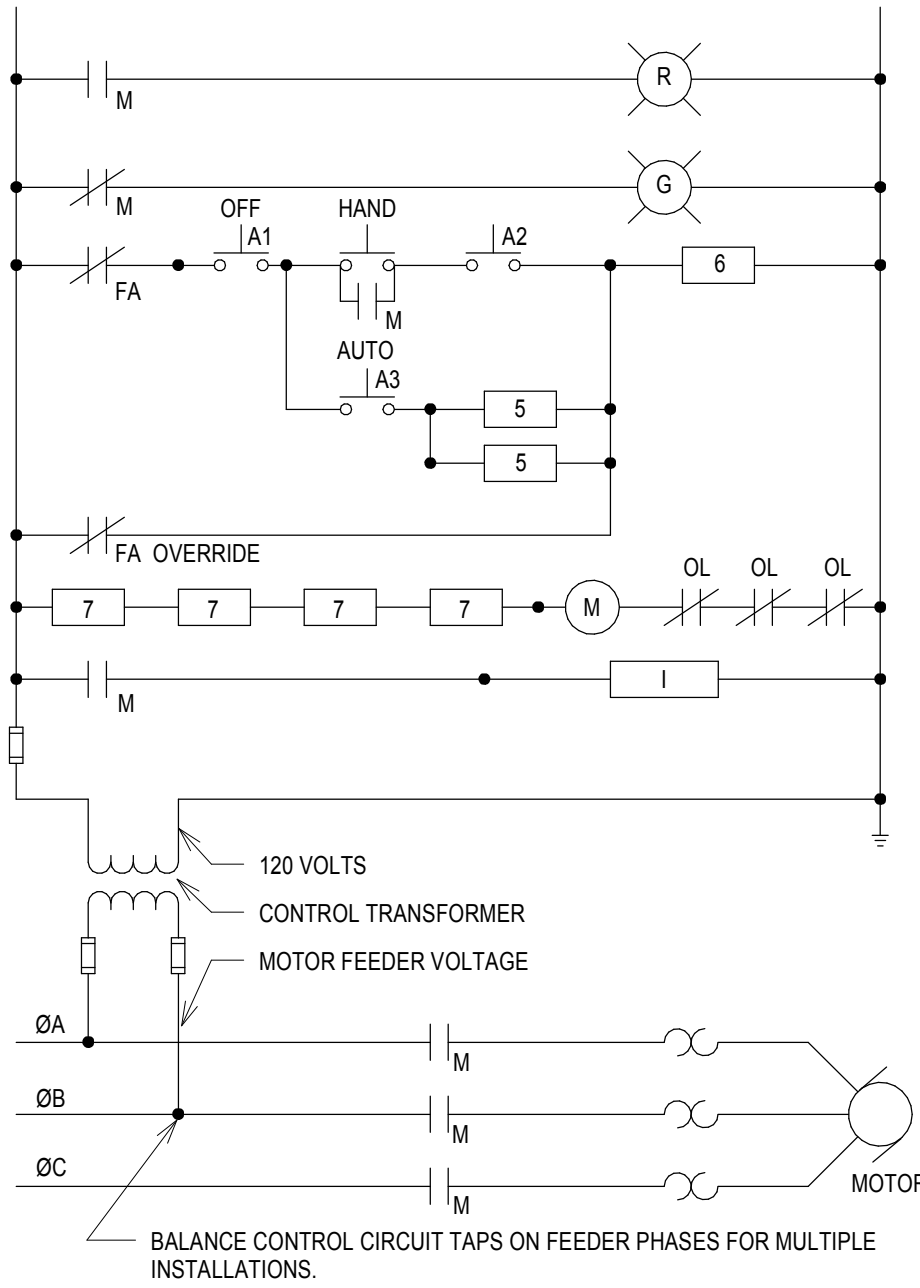


## 9 HAND-OFF-AUTO STARTER CONTROL CIRCUIT FOR AHU'S DETAIL

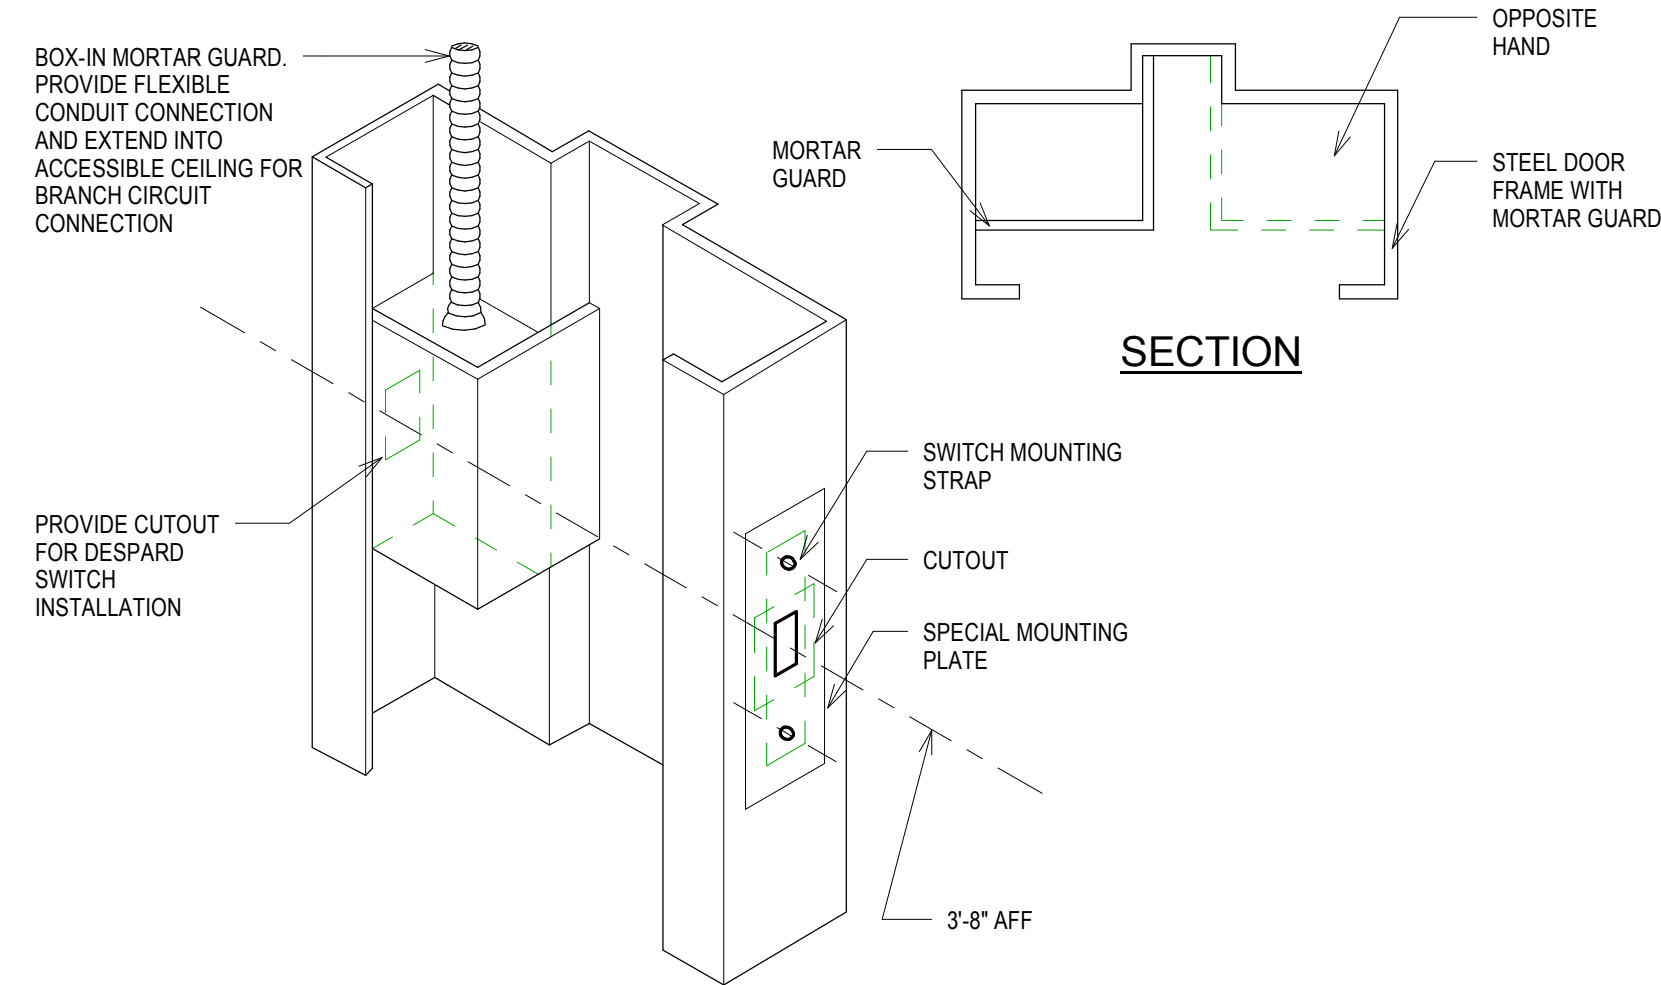


INTERIOR & EXTERIOR ISOMETRIC

## 8 STEEL DOOR MULLION SWITCH DETAIL

1/8" = 1'-0"

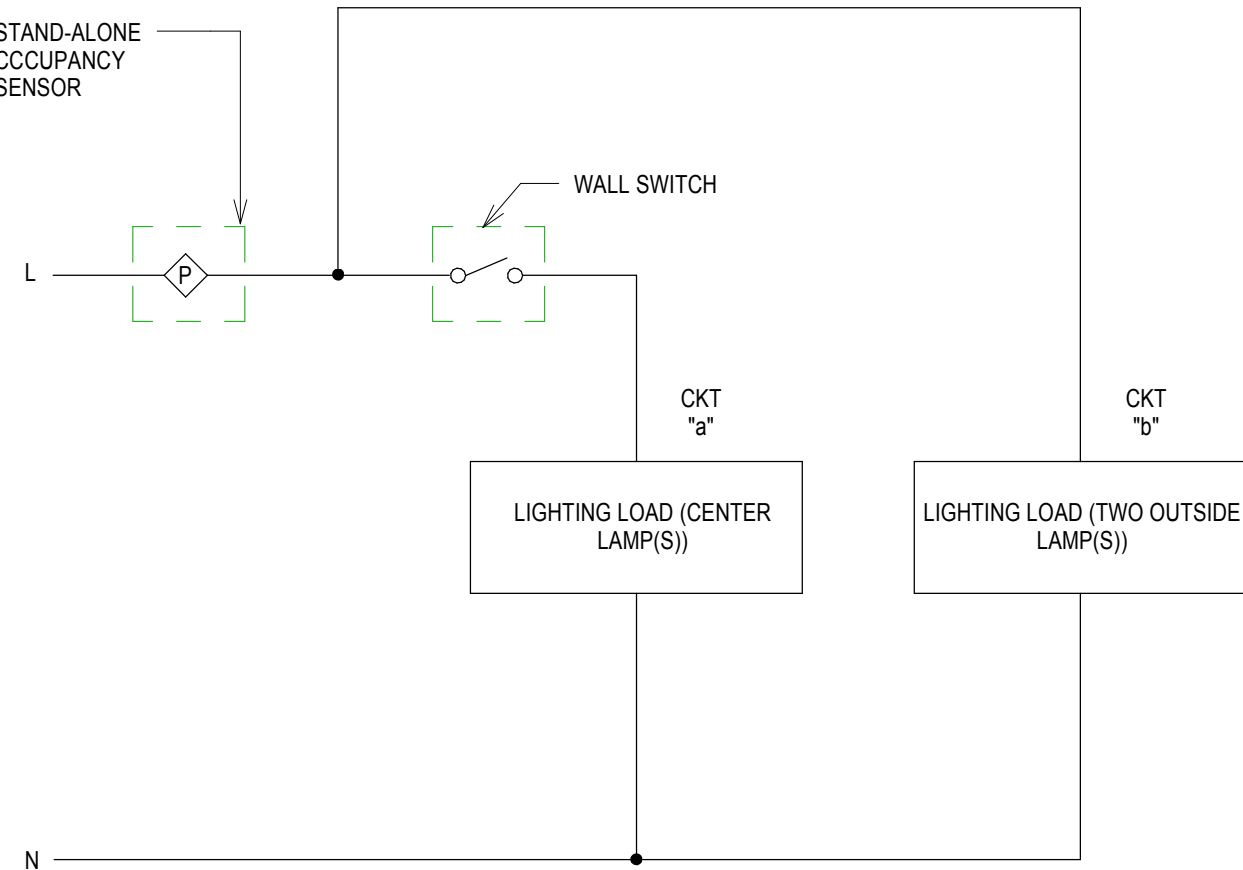


## 7 AUTOMATIC LIGHTING CONTROL WITH MANUAL OVERRIDE WIRING SCHEMATIC (STAND-ALONE SENSOR)

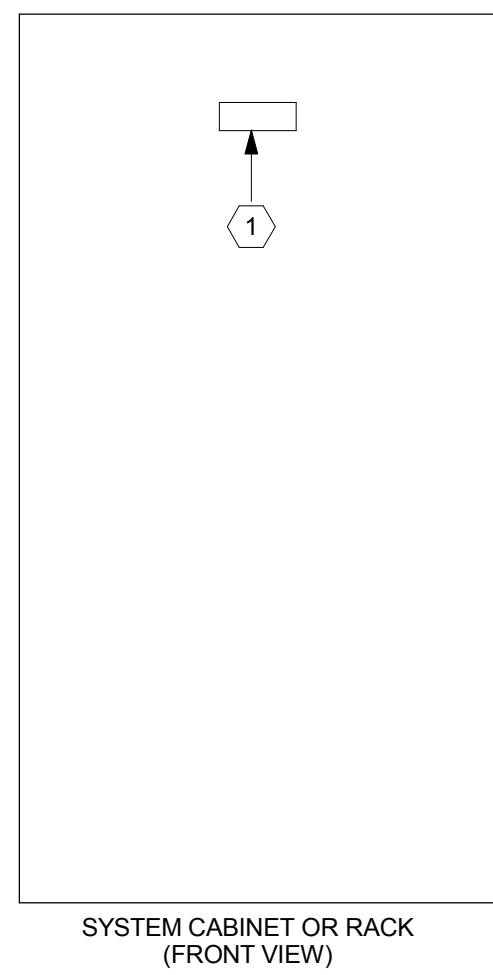


NOTES:  
1. EQUIPMENT IDENTIFICATION LABEL.


## 6 CABINETS AND RACKS

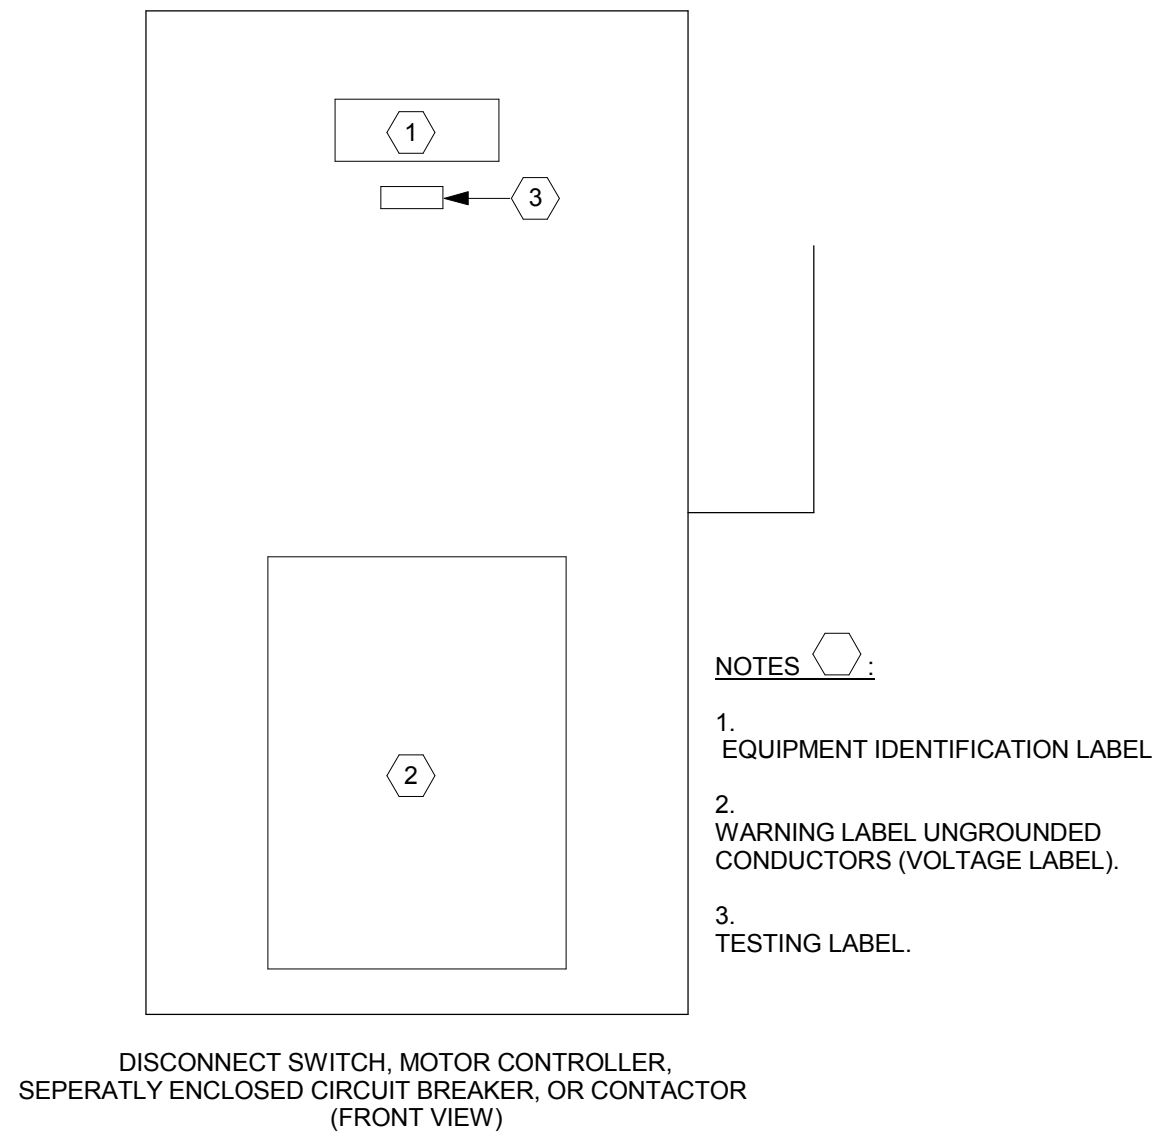

## 5 MISC. PROTECTIVE DEVICES

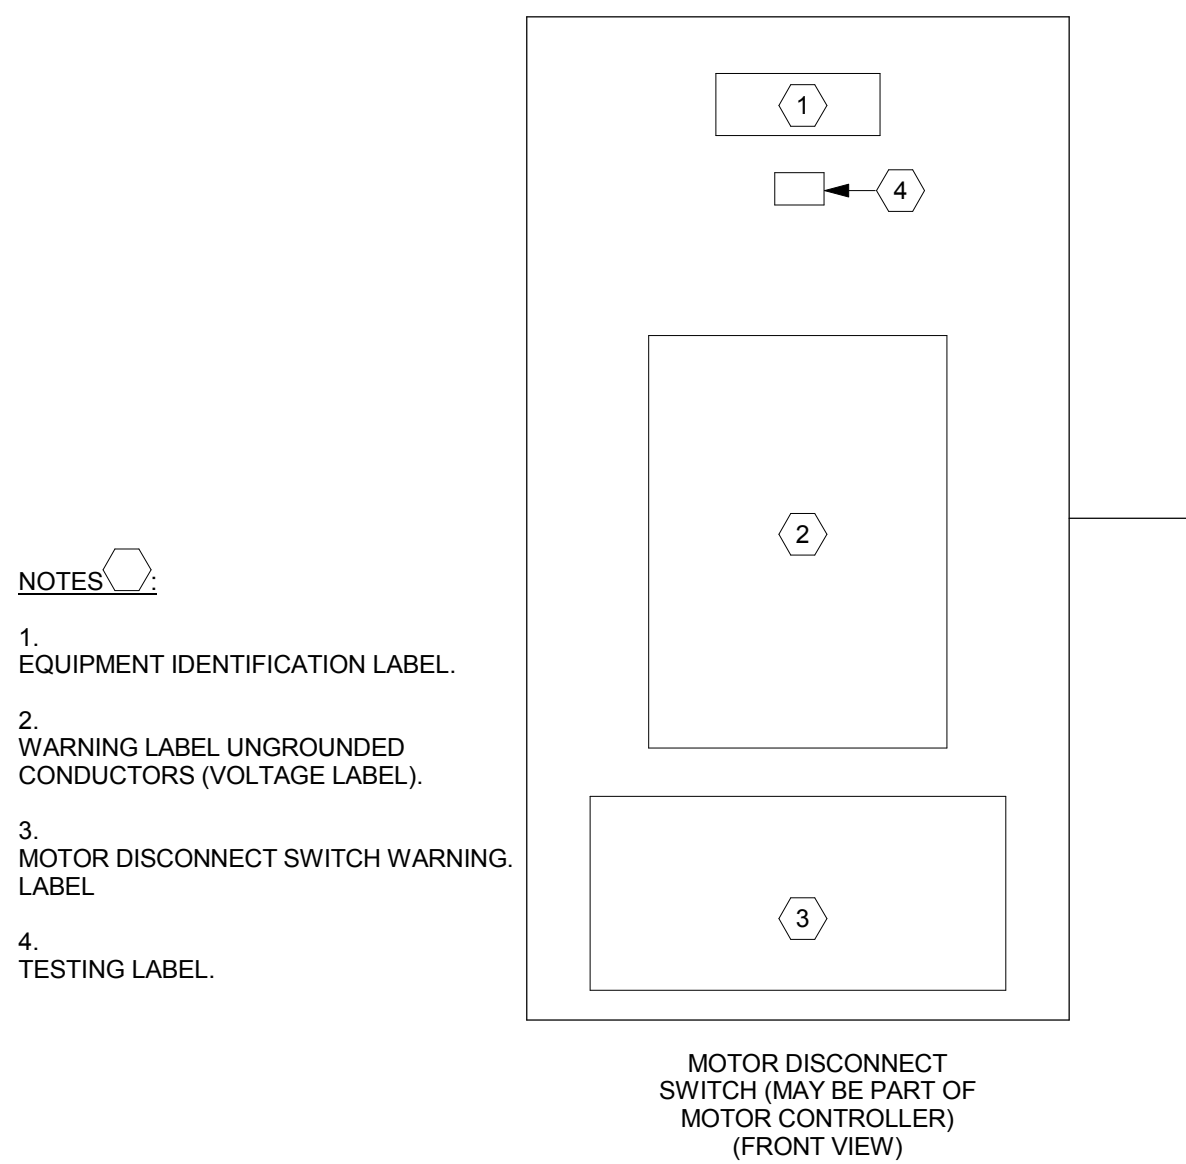


## 4 MOTOR DISCONNECT

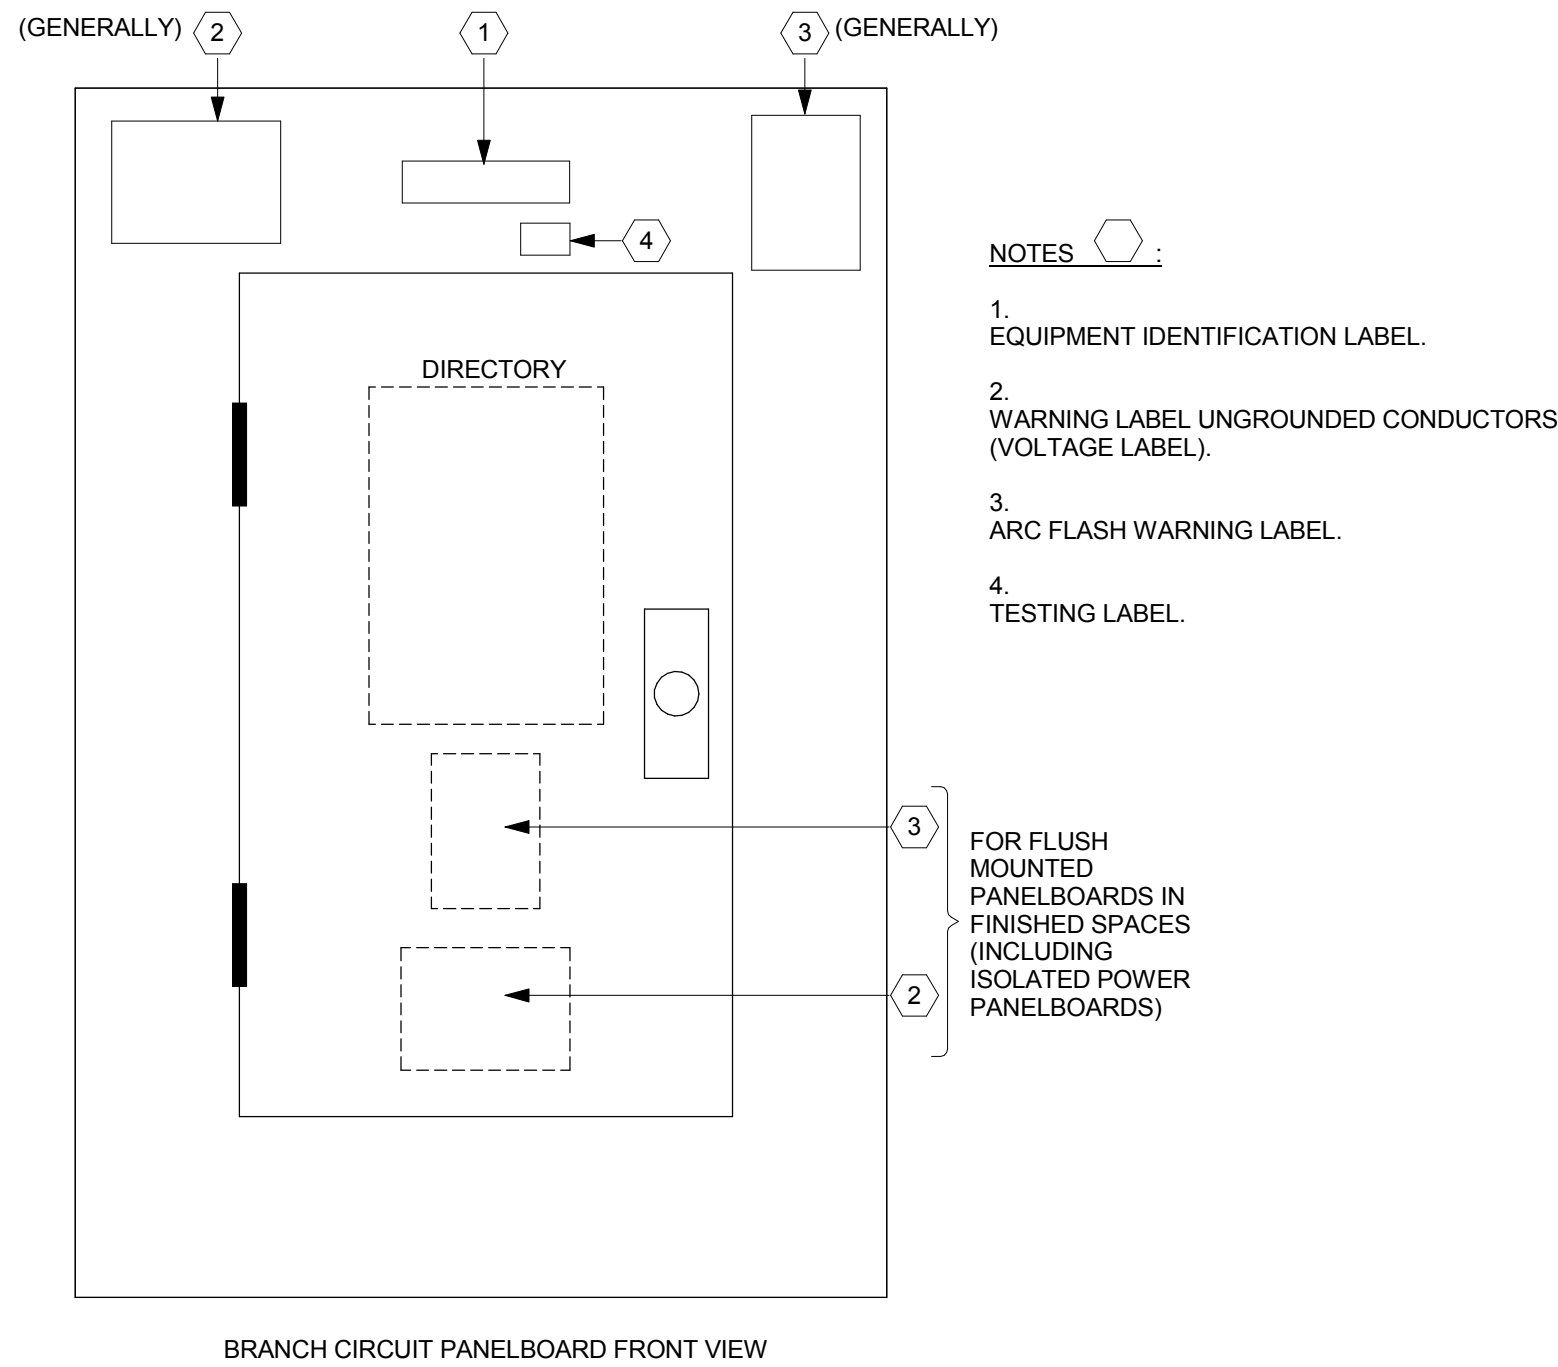


## 3 PANELBOARD


## EQUIPMENT IDENTIFICATION LABEL

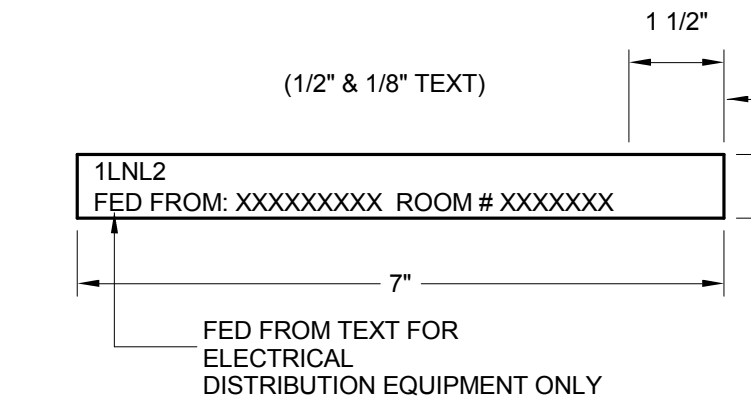


## PROTECTIVE DEVICE LOAD LABEL SAMPLE

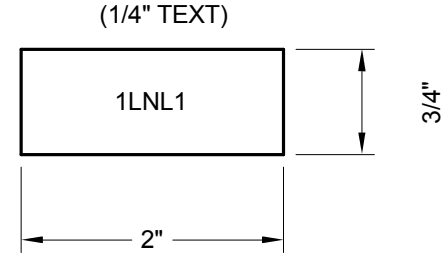


## VOLTAGE LABEL SAMPLE

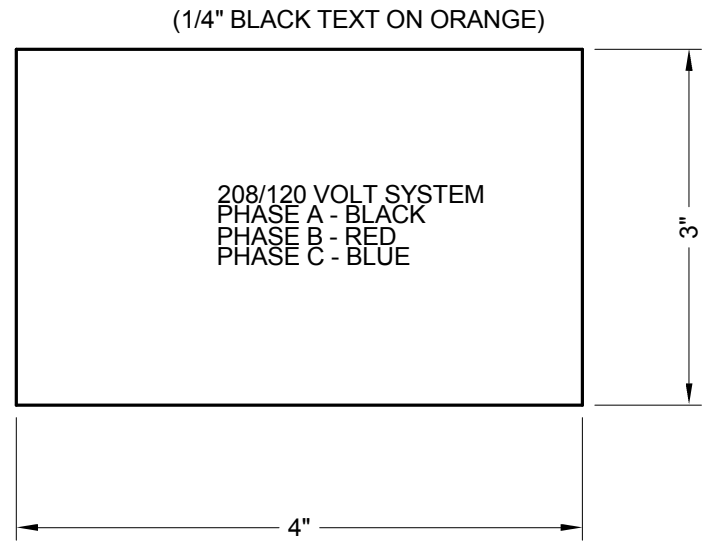


## MOTOR DISCONNECT SWITCH WARNING LABEL

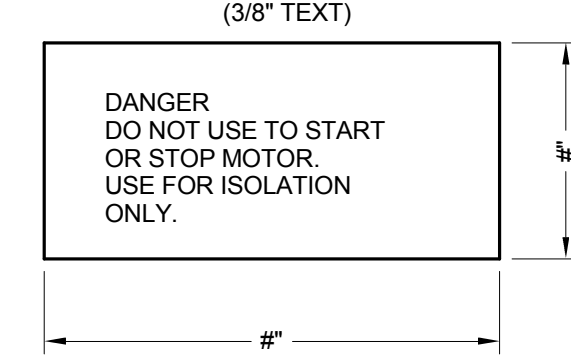

## ASSEMBLY NAMEPLATE SAMPLE

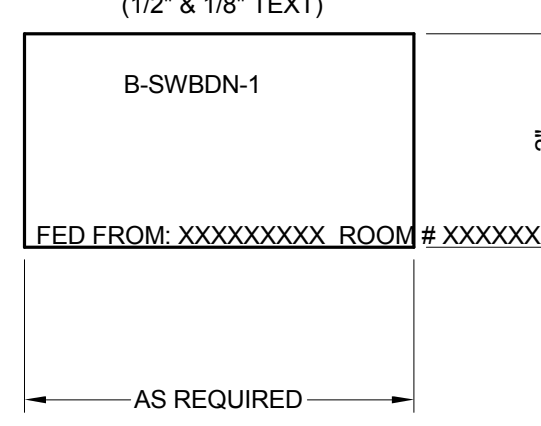

## 2 ELECTRICAL IDENTIFICATION LABELS

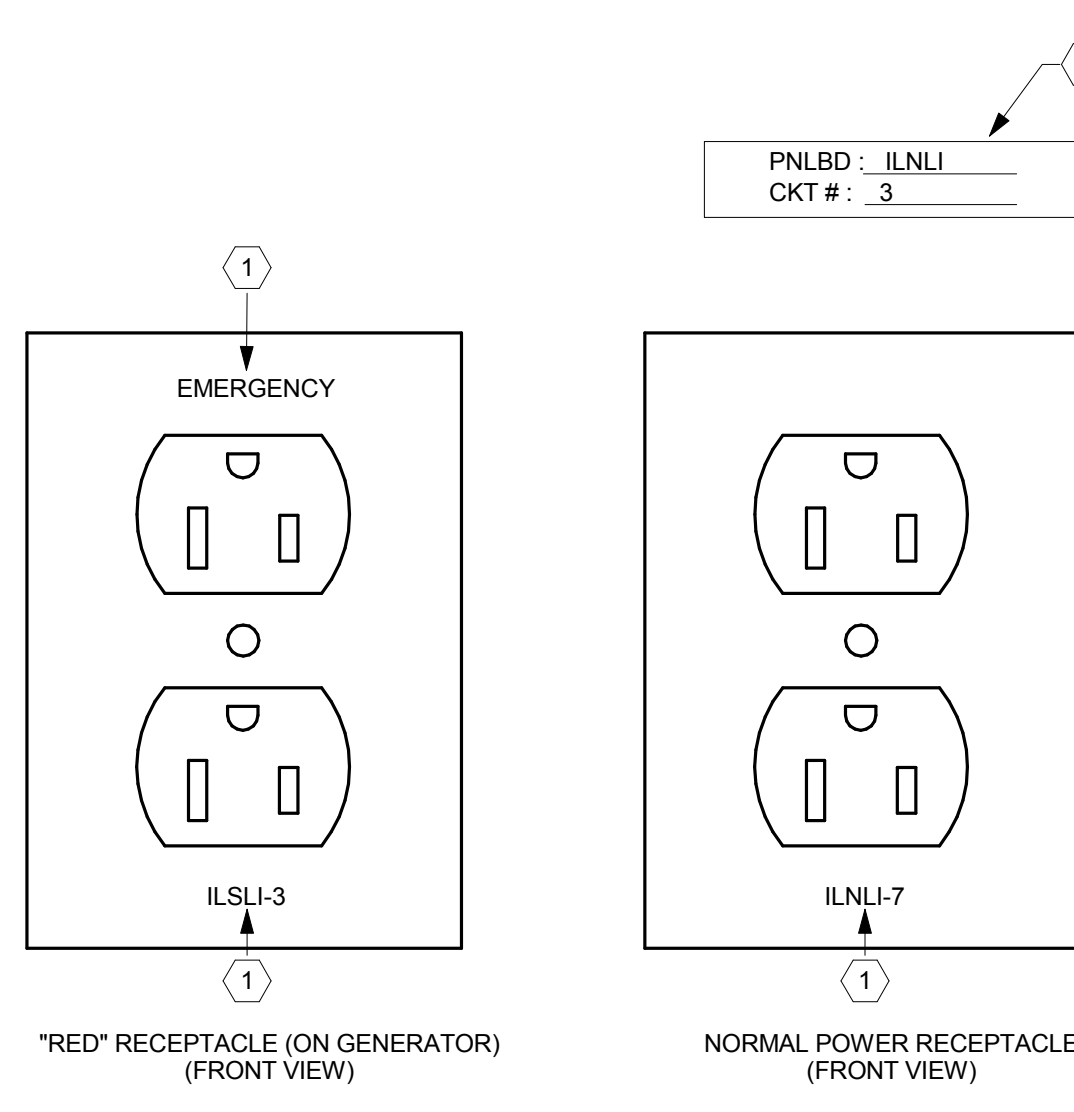

NOTES:  
1. LASER OR MECHANICALLY ENGRAVED ONTO WALL PLATE.  
2. SELF-ADHESIVE LABEL ON BACK OF WALL PLATE COVER.

## 1 RECEPTACLE CIRCUIT

ALTERNATE No. 4	07/01/14
ALTERNATE No. 2 and ALTERNATE No. 3	06/19/14
CONSTRUCTION DOCUMENT - 100% SUBMISSION	07/19/13
CONSTRUCTION DOCUMENT - 90% SUBMISSION	04/05/13
FIRE/LIFE SAFETY REVIEW	03/15/13
DESIGN DEVELOPMENT - 60% SUBMISSION (3RD)	11/09/12
DESIGN DEVELOPMENT - 60% SUBMISSION (2ND)	10/05/12
DESIGN DEVELOPMENT - 60% SUBMISSION (1ST)	08/22/12
SCHEMATIC DESIGN - 30% SUBMISSION	09/09/11
Revisions	Date

VA WESTERN NEW YORK HEALTHCARE SYSTEM  
222 RICHMOND AVE  
BATAVIA, NEW YORK 14020

**CANNONDESIGN**  
2170 Whitehaven Road, Grand Island, New York 14072  
T: 716.773.8800 F: 716.773.5909

Boston ■ New York ■ Baltimore ■ Washington DC ■ Buffalo  
Toronto ■ Chicago ■ St. Louis ■ Calgary ■ Vancouver  
Victoria ■ San Francisco ■ Los Angeles ■ Shanghai

Architect CANNON PROJECT #: 3526.00

stamp

CARDIOLOGY MANAGER

DATE

ENGINEERING MANAGER

DATE

INFECTION CONTROL

DATE

CARELINE MANAGER

DATE

SAFETY OFFICER

DATE

CHIEF OF STAFF

DATE

Drawing Title

ELECTRICAL DETAILS

MEDICAL CENTER DIRECTOR

DATE

ASSOCIATE MEDICAL CENTER DIRECTOR

DATE

Project Title

WARD C RENOVATIONS

Building Number

1

Checked T.G.F.

Drawn DJJ

Location V.A.M.C. BATAVIA, NEW YORK

Date

09/09/11

Station No.

5284


353

E503

FULLY SPRINKLERED




Department of Veterans Affairs

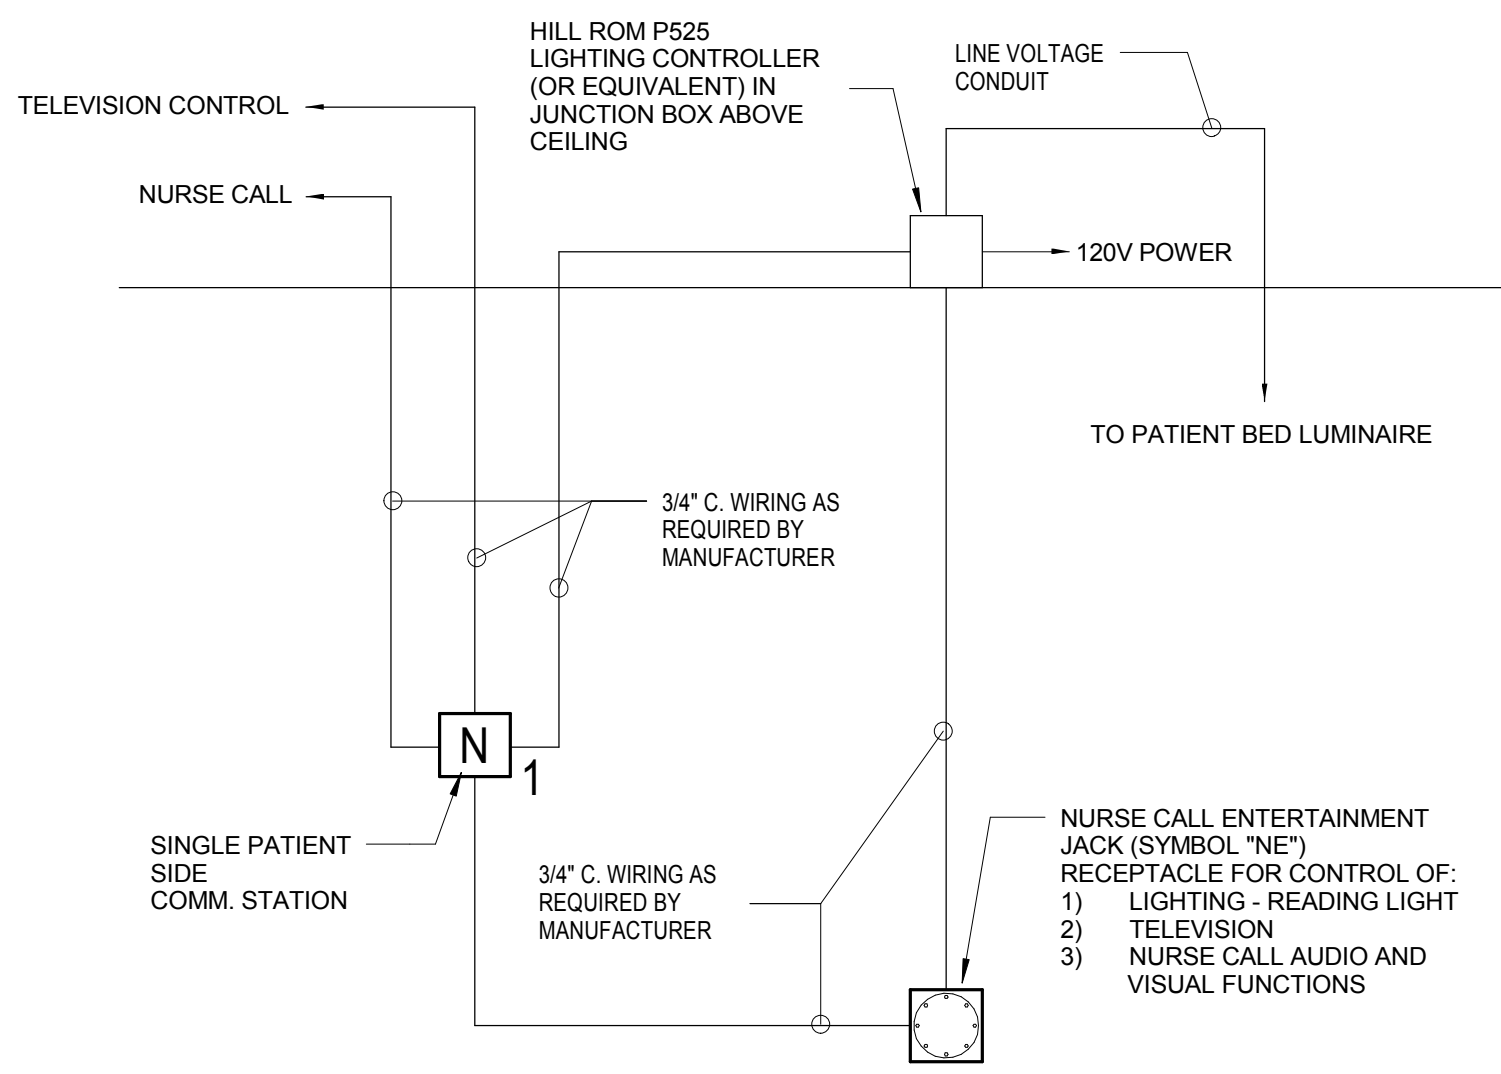

NOTE : TYPICAL FOR ALL RESIDENT ROOMS.


9 NURSE CALL PATIENT BED CONTROL INTERFACE

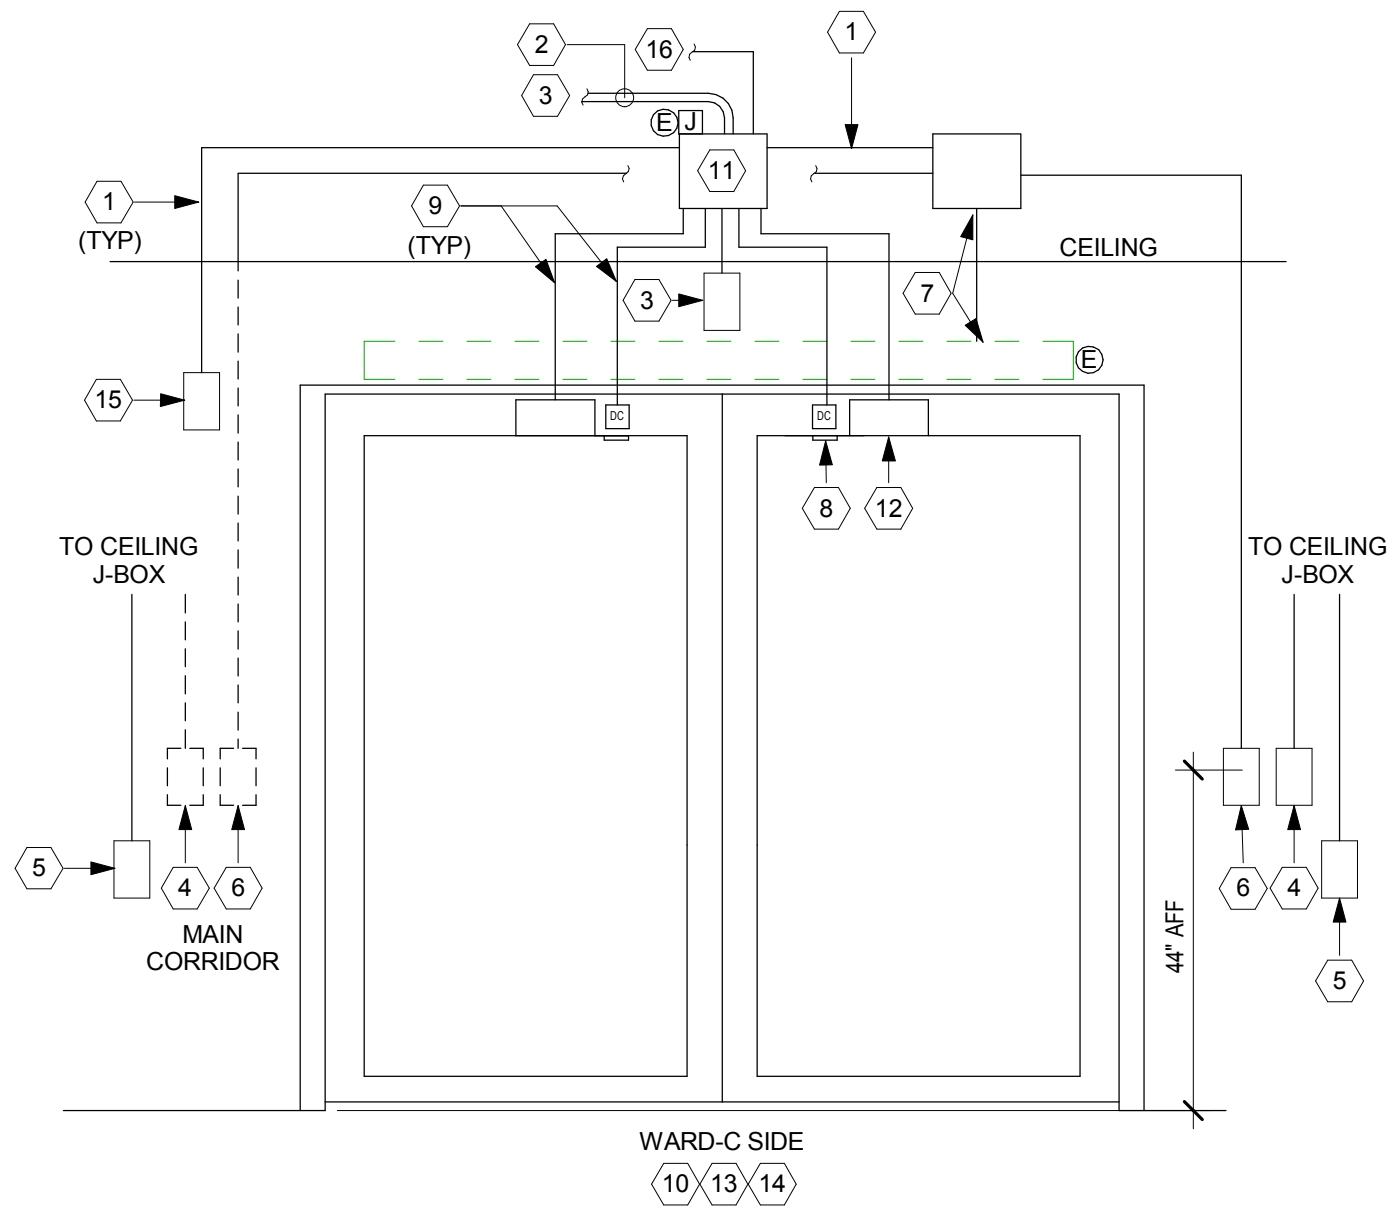

7 DOUBLE DOOR WITH POWER ASSIST

NOTES

- 3/4" FLEXIBLE CONDUIT WITH PULL STRING. COORDINATE CABLE TYPE & QUANTITY WITH MANUFACTURER'S REQUIREMENTS PRIOR TO ROUGH-IN.
- 1" C ROUTED ABOVE CEILING ABOVE SUSPENDED CEILING TO MULTIPLEXER/JUNCTION BOX ABOVE THE CEILING AT THE NURSES STATION.
- REQUEST TO EXIT DEVICE.
- ALARM OVERRIDE KEYPAD 2-GANG JUNCTION BOX. LOCATED ON EACH SIDE OF DOOR AS SHOWN ON DRAWINGS.
- DOOR TRANSMITTER WAND ANTENNA (PROVIDED BY OTHERS). LOCATE AS SHOWN ON DRAWINGS.
- DOOR OPERATOR PUSH PLATE 2-GANG JUNCTION BOX. LOCATED ON EACH SIDE OF DOOR AS SHOWN ON DRAWINGS. (PROVIDED BY OTHERS, DEVICE & CABLING INSTALLED BY DIV.26)
- POWERED DOOR OPERATOR & CONTROL UNIT (PROVIDED AND INSTALLED BY DIV. 8. WIRED BY DIV.26). COORDINATE THE INTERCONNECTION CONDUIT/CABLING BETWEEN THE DOOR OPERATOR AND DOOR LOCK CONTROL UNIT WITH EQUIPMENT SHOP DRAWINGS PRIOR TO ROUGH-IN.
- MORTAR GUARD BOX FOR FLUSH MAGNETIC DOOR CONTACT BY DIV. 26. 3/4" HOLE IN DOOR FRAME AND TOP OF DOOR BUCK BY DIVISION 8.
- ROUTE THROUGH ALUMINUM FRAME AT STOREFRONT/CURTAIN WALL LOCATIONS AS REQUIRED.
- MOUNT DOOR CONTROL DEVICES ON SECURE SIDE OF DOOR.
- WANDER GUARD CONTROL ENCLOSURE JUNCTION BOX - SHALL CONTAIN WANDER GUARD RECEIVER, CONTROL INTERFACE MODULE AND POWER SUPPLY FOR DOOR DEVICES. ENCLOSURE & EQUIPMENT BY OWNER. COORDINATE FINAL EQUIPMENT SIZE & REQUIREMENTS WITH THE VA PRIOR TO ROUGH-IN.
- DOOR LOCKING DEVICE (DEVICE BY OTHERS).
- COORDINATE WORK WITH DIVISION 8 AND DIVISION 28.
- PROVIDE FOR ROUGH-IN & POWER CONNECTIONS FOR THE DOOR WANDER GUARD SYSTEM (INSTALLATION OF SYSTEM DEVICES & CABLING BY OTHERS).
- DOOR SOUNDER DEVICE (DEVICE & CABLING BY OTHERS).
- CONNECTION TO FIRE ALARM FOR DOOR/LOCK RELEASE ON SYSTEM ALARM. COORDINATE FINAL LOCATION OF CONTROLLER WITH EQUIPMENT SUPPLIER PRIOR TO ROUGH-IN.

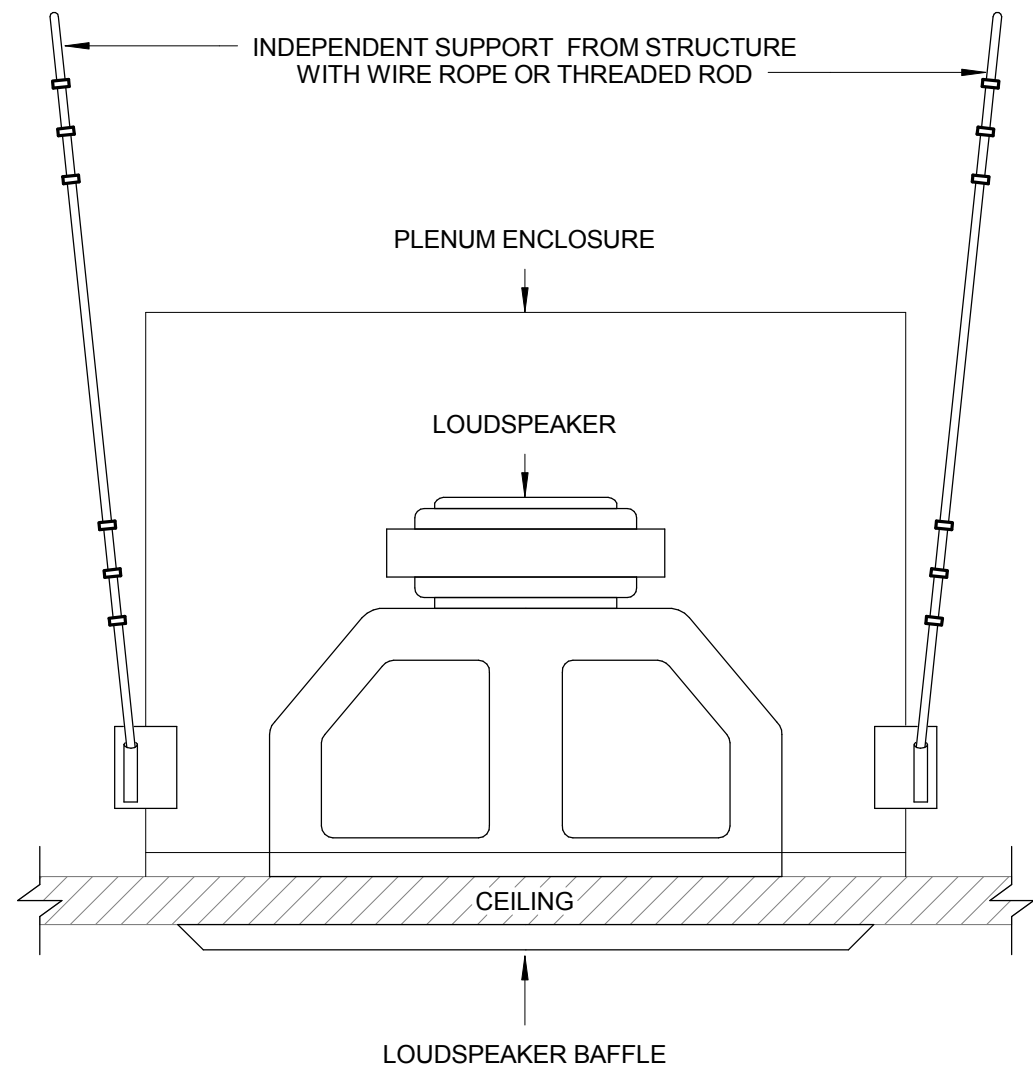


5 CEILING SPEAKER (SECTION)

CONDUIT CAPACITY CHART FOR TELECOMMUNICATIONS										
CONDUIT	CABLE OUTSIDE DIAMETER in (mm) / CABLE TYPE *									
	INSIDE DIAMETER (mm)	TRADE SIZE	.13 (3.3)	.18 (4.6)	.22 (5.6)	.24 (6.1) CAT 5e	.29 (7.4) CAT 6	.31 (7.9) CAT 6A STP	.37 (9.4)	.53 (13.5)
21	3/4	6	5	4	3	2	2	1	0	
27	1	8	8	7	6	3	3	2	1	
35	1-1/4	16	14	12	10	6	4	3	1	
41	1-1/2	20	18	16	15	7	6	4	2	
53	2	30	26	22	20	14	12	7	4	
63	2-1/2	45	40	36	30	17	14	12	6	
78	3	70	60	50	40	20	20	17	7	
91	3-1/2	-	-	-	-	-	-	22	12	
103	4	-	-	-	-	-	-	30	14	

NOTES


- \* CABLE TYPE SHOWN IS FOR TYPICAL CABLES AND VARIES FROM MANUFACTURER. VERIFY CABLE OUTSIDE DIAMETER OF ACTUAL MANUFACTURER UTILIZED PRIOR TO ROUGH-IN.
- UTILIZE ACTUAL FILL RATES PER NEC IF CABLES OF MULTIPLE DIAMETERS ARE UTILIZED IN A SINGLE CONDUIT.

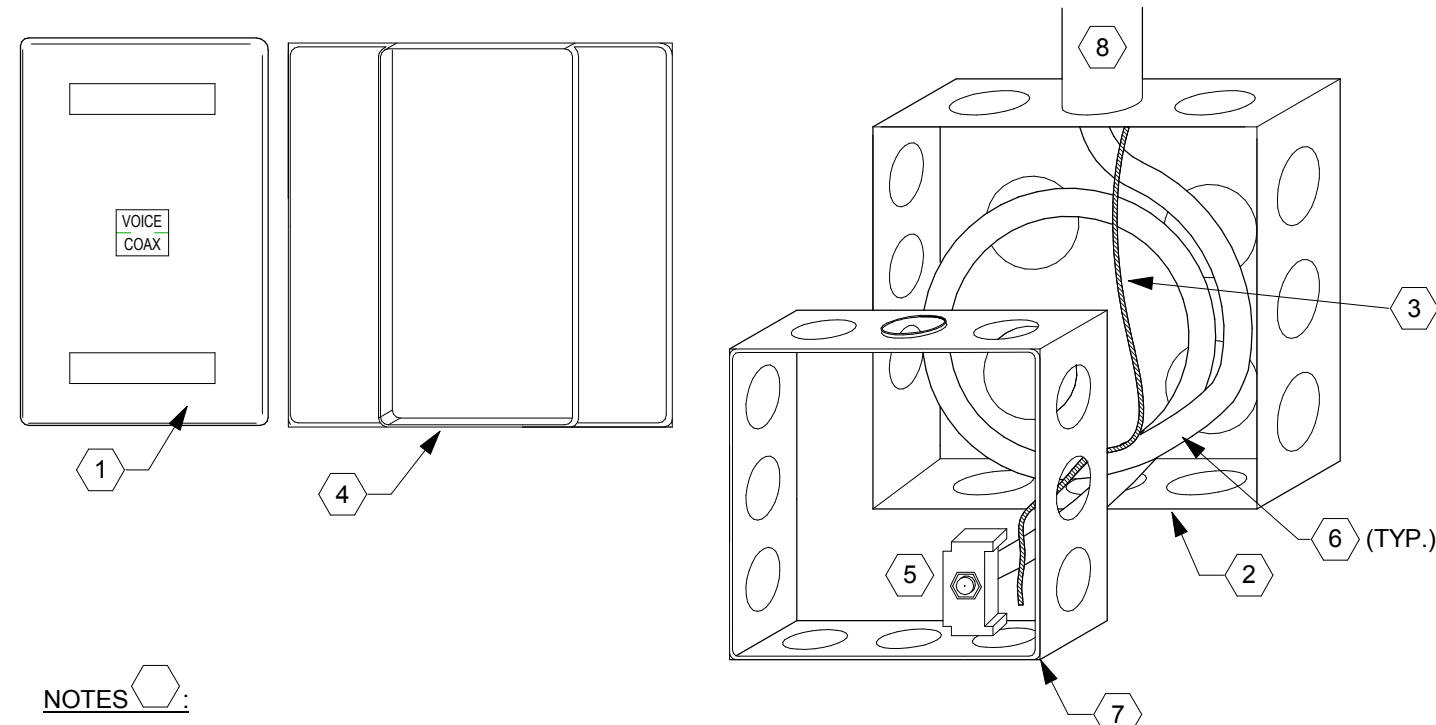

NOTES

- 1 PORT. SINGLE GANG COVERPLATE WITH LABELS AND MOUNTING HARDWARE. PROVIDE BLANK INSERTS FOR ALL UNUSED PORTS.
- 4-11/16" X 4-11/16" SQUARE OUTLET BOX, WITH SINGLE GANG ADAPTER RING.
- NYLON PULL CORD TO FAR END CONDUIT TERMINATION POINT.
- SINGLE GANG MUDRING.
- SERIES 6 (RG-6) F-CONNECTOR MODULAR INSERT (BULKHEAD TYPE).
- SERIES 6 (RG-6) COAXIAL CABLE, FROM LOCAL TELECOMMUNICATIONS ROOM, WITH SERVICE LOOP.
- 4-11/16" X 4-11/16" X 1-1/2" DEEP SQUARE OUTLET BOX EXTENSION RING.
- CONDUIT STUB TO ACCESSIBLE CEILING SPACE.
- COORDINATE WITH SPECIFIC BACKBOX DEVICE SYMBOLS AS SHOWN ON DRAWINGS TO DETERMINE ROUGH-IN REQUIREMENTS AND LOCATIONS.


4 CONDUIT CAPACITY CHART1

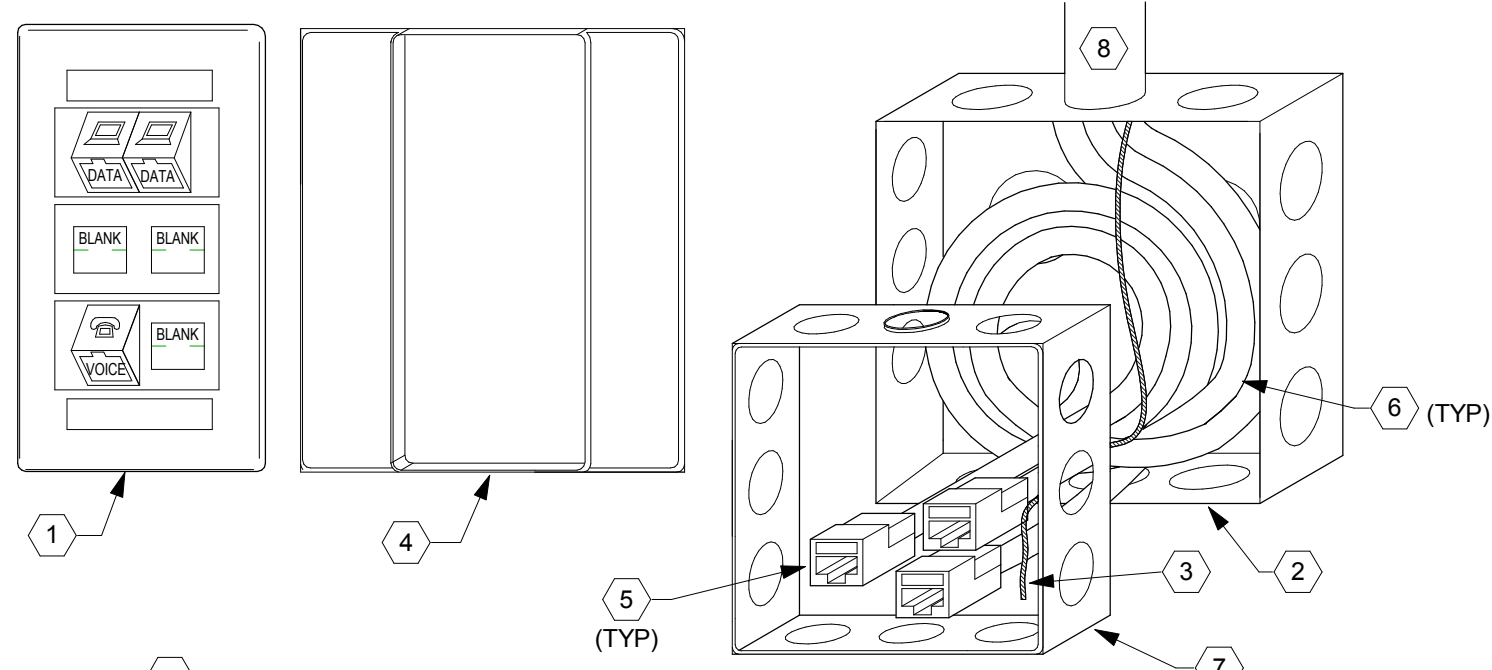

NOTES

- 6 PORT. SINGLE GANG COVERPLATE WITH LABELS AND MOUNTING HARDWARE. PROVIDE BLANK INSERTS FOR ALL UNUSED PORTS.
- 4-11/16" X 4-11/16" SQUARE OUTLET BOX, WITH SINGLE GANG ADAPTER RING.
- NYLON PULL CORD TO FAR END CONDUIT TERMINATION POINT.
- SINGLE GANG ADAPTER.
- MODULAR JACK 110 TO RJ45 ANGLED WITH ICONS, UNIVERSAL WIRING PATTERN, NON KEYED, EIGHT POSITION (4 PAIR).
- CAT 6 TWISTED PAIR TYPE 4 PAIR, HORIZONTAL CABLE, FROM LOCAL TELECOMMUNICATIONS ROOM, WITH SERVICE LOOP.
- 4-11/16" X 4-11/16" X 1-1/2" DEEP SQUARE OUTLET BOX EXTENSION RING.
- CONDUIT STUB TO ACCESSIBLE CEILING SPACE.
- COORDINATE WITH SPECIFIC BACKBOX DEVICE SYMBOLS AS SHOWN ON DRAWINGS TO DETERMINE ROUGH-IN REQUIREMENTS AND LOCATIONS.

2 TYPICAL TELECOMMUNICATIONS OUTLET 'V1' 9

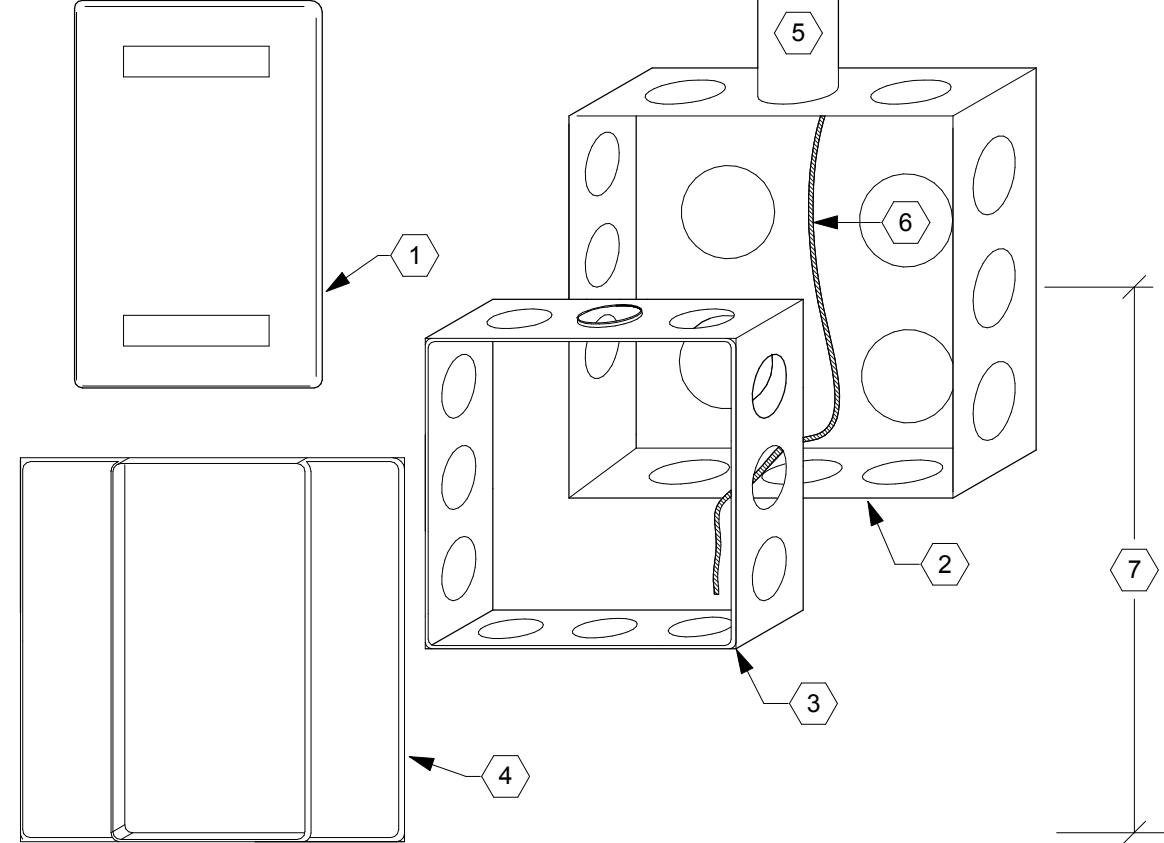


NOTES


- SINGLE GANG BLANK COVERPLATE WITH MOUNTING HARDWARE.
- 4-11/16" X 4-11/16" X 2-1/8" DEEP SQUARE OUTLET BOX.
- 4-11/16" X 4-11/16" X 1-1/2" DEEP SQUARE OUTLET BOX EXTENSION RING
- SINGLE GANG ADAPTER.
- CONDUIT STUB TO ACCESSIBLE CEILING SPACE.
- NYLON PULL CORD TO FAR END CONDUIT TERMINATION POINT.
- MOUNTING HEIGHT AS SHOWN BY DEVICE SYMBOL.

3 TYPICAL TELECOMMUNICATIONS OUTLET 9

1 TYPICAL TELECOMMUNICATIONS ROUGH-IN OUTLET

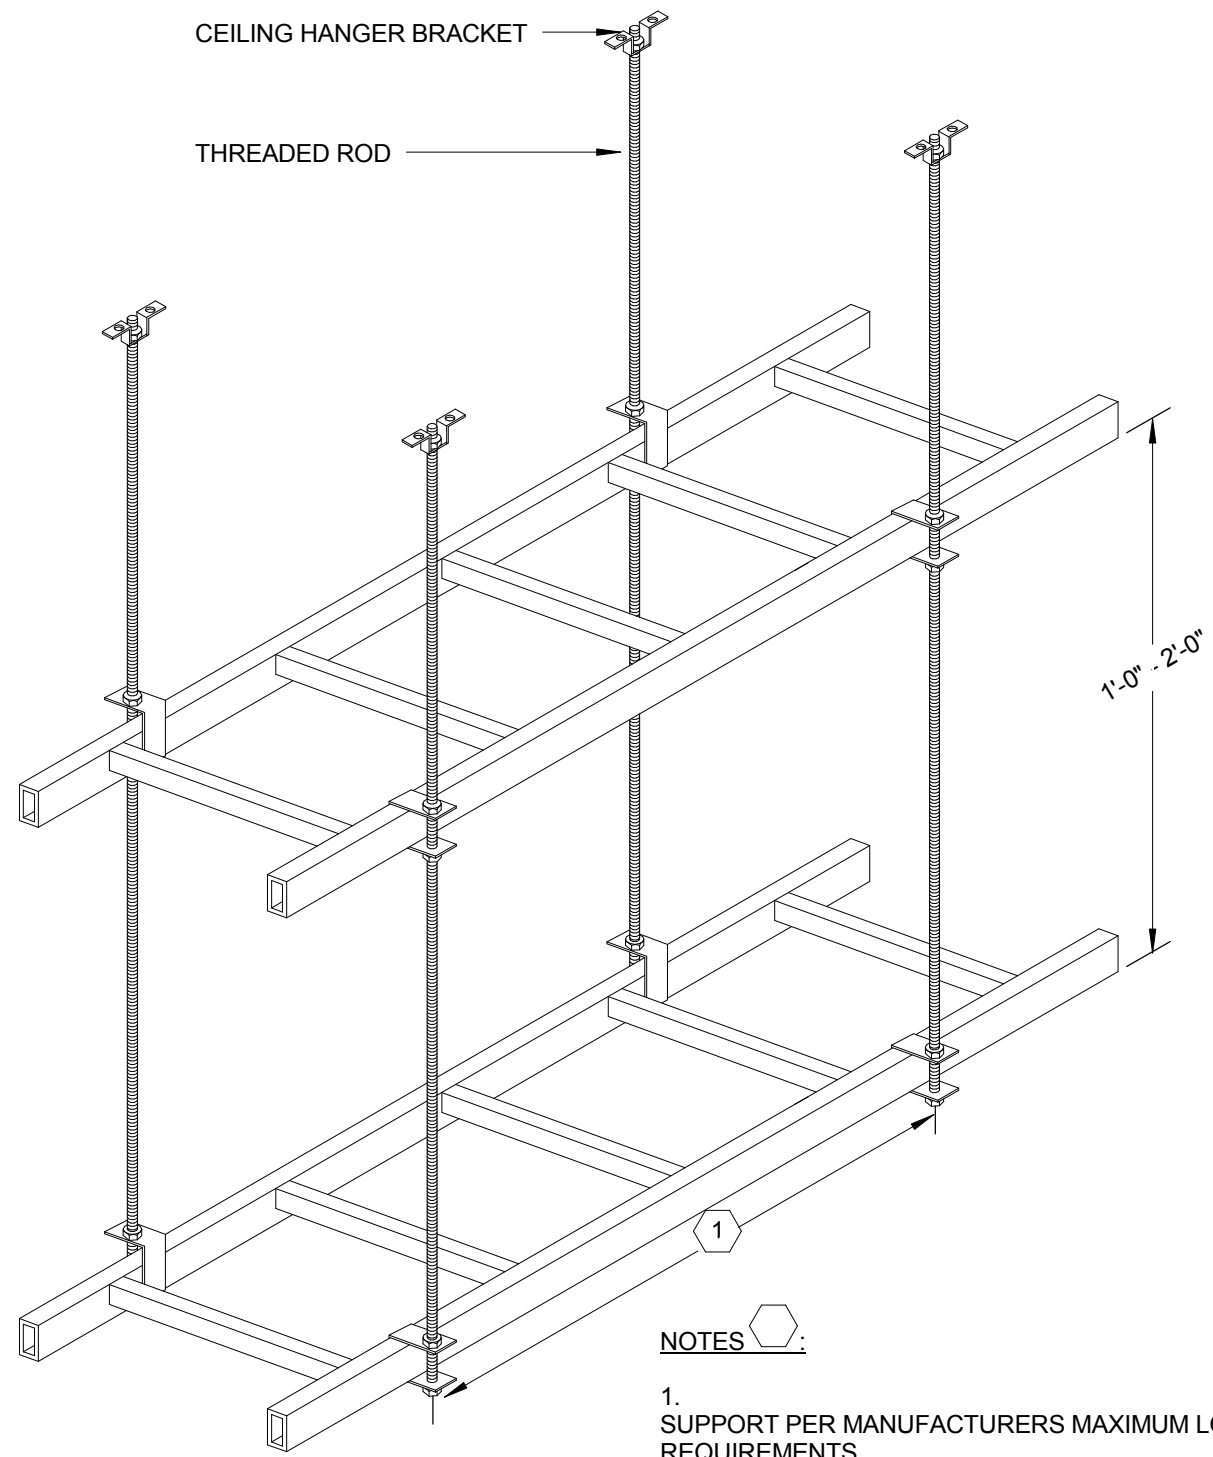

8 MULTI-TIER CABLE RUNWAY

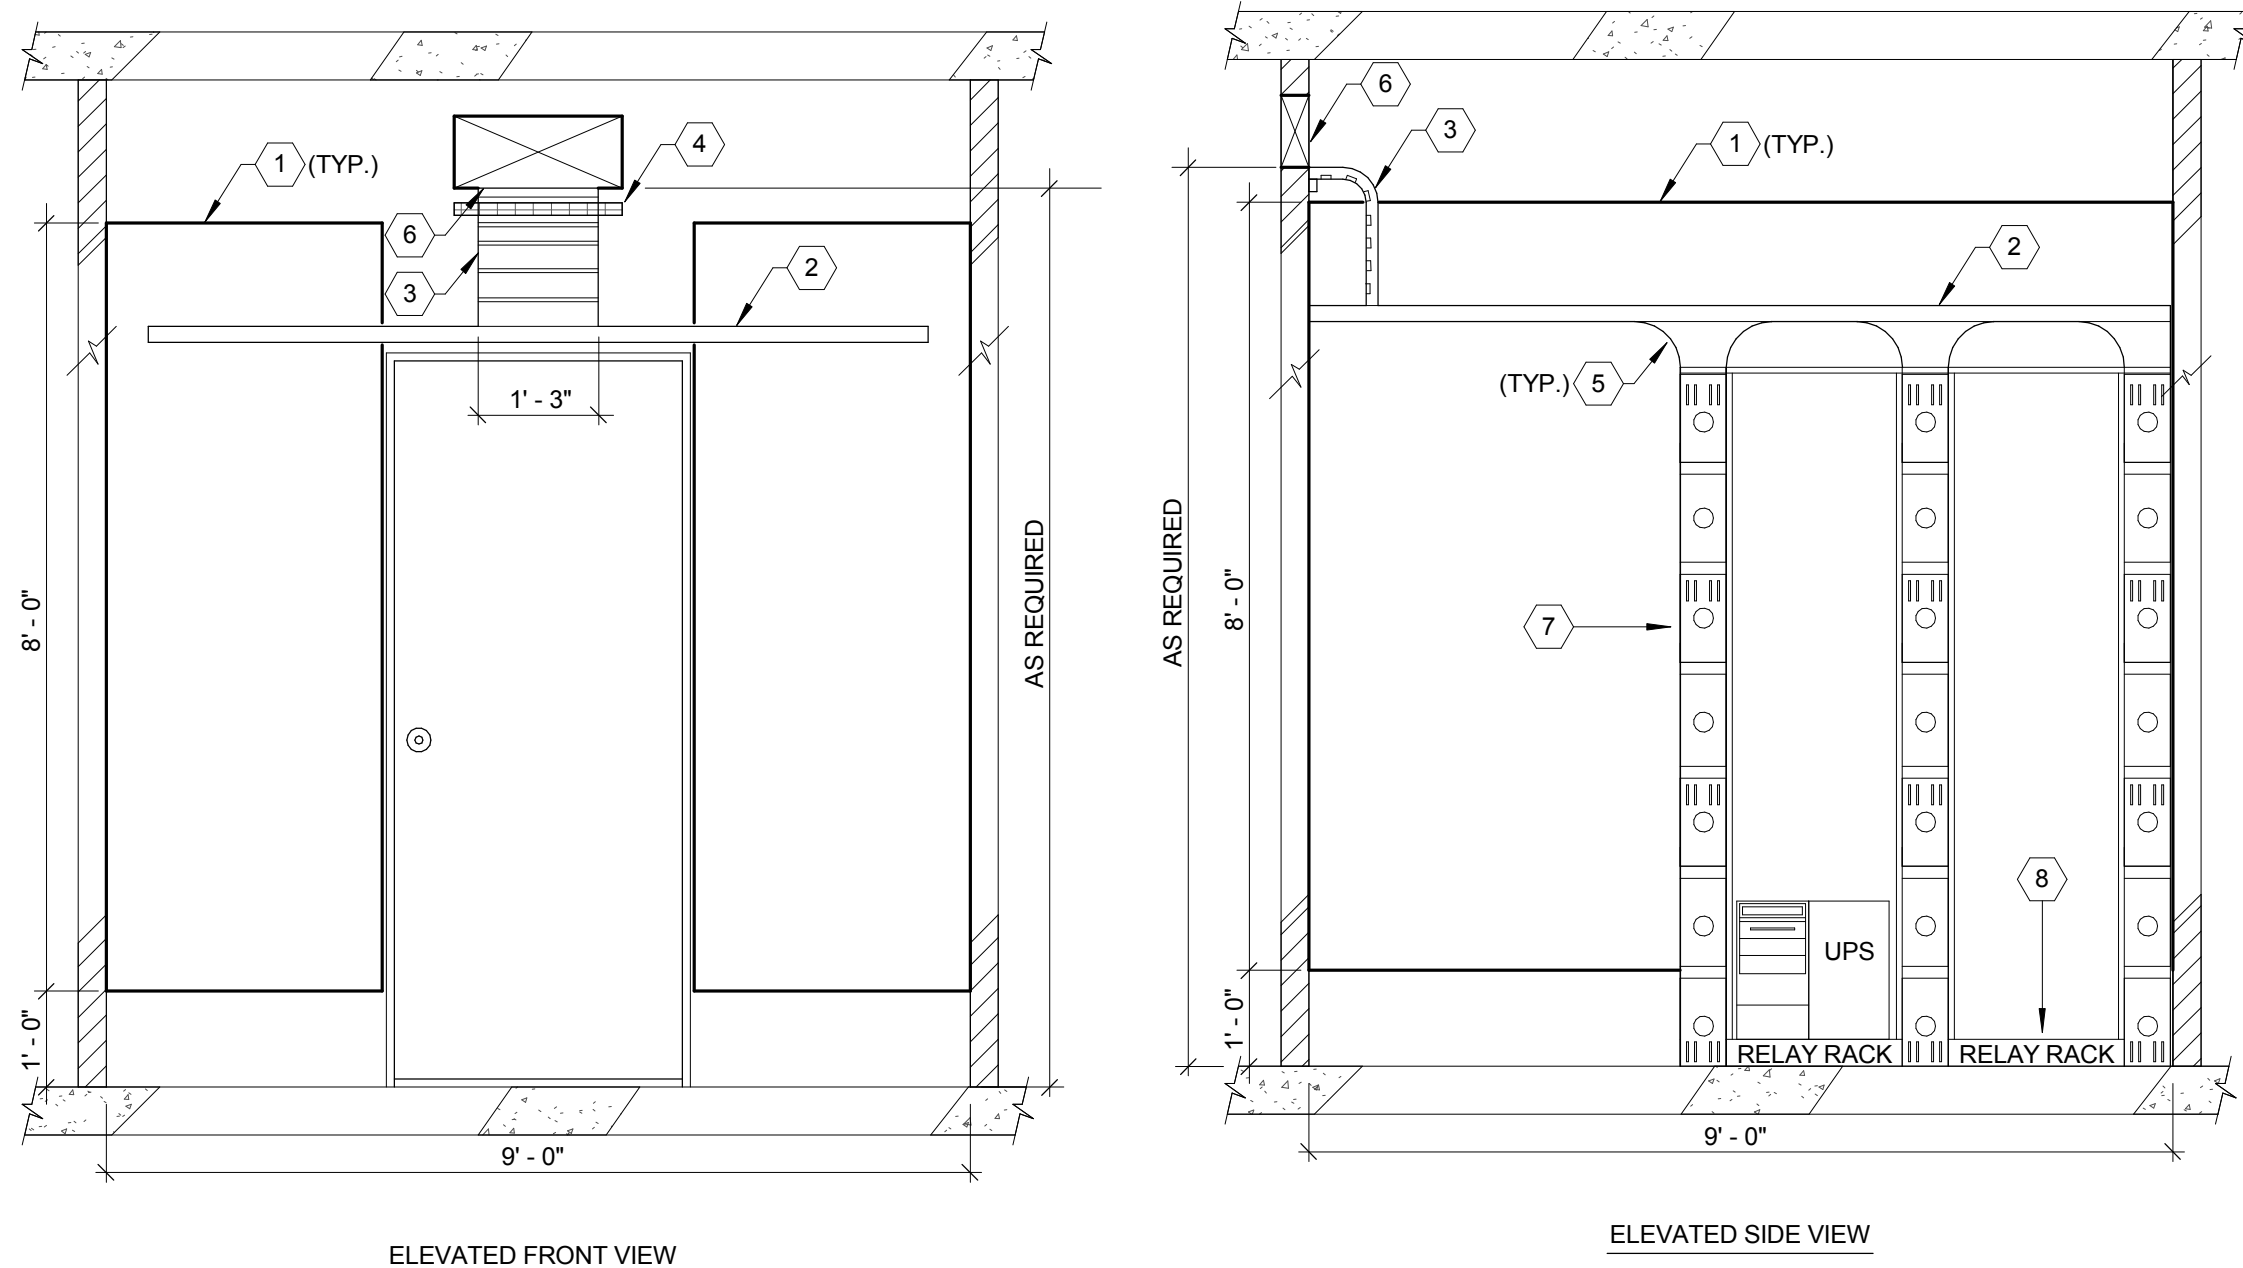

NOTES

- 3/4" PLYWOOD BACKBOARD.
- CABLE RUNWAY.
- CABLE RUNWAY 90-DEGREE OUTSIDE RADIUS BEND.
- SLOTTED CHANNEL STRUT.
- CABLE RUNWAY RADIUS DROP.
- FRAME AND FINISH PENETRATION. COORDINATE FIRE RATING AND FIRE STOP AS REQUIRED.
- CABLE MANAGEMENT WITH COVERS.
- 45 RMU, 19-INCH ETA 310-D COMPLIANT 2 POST RACK.

6 TYPICAL TELECOMMUNICATIONS ROOM ELEVATIONS

ALTERNATE No.4	07/01/14
ALTERNATE No.2 and ALTERNATE No.3	06/19/14
CONSTRUCTION DOCUMENT - 100% SUBMISSION	07/19/13
CONSTRUCTION DOCUMENT - 90% SUBMISSION	04/05/13
FIRE/LIFE SAFETY REVIEW	03/15/13
DESIGN DEVELOPMENT - 60% SUBMISSION (3RD)	11/09/12
DESIGN DEVELOPMENT - 60% SUBMISSION (2ND)	10/05/12
DESIGN DEVELOPMENT - 60% SUBMISSION (1ST)	06/22/12
SCHEMATIC DESIGN - 30% SUBMISSION	09/09/11
Revisions	Date

VA WESTERN NEW YORK HEALTHCARE SYSTEM
222 RICHMOND AVE
BATAVIA, NEW YORK 14020

<b>CANNONDESIGN</b>
2170 Whitehaven Road, Grand Island, New York 14072
T: 716.773.6800 F: 716.773.5909
Boston ■ New York ■ Baltimore ■ Washington DC ■ Buffalo
Toronto ■ Chicago ■ St. Louis ■ Calgary ■ Vancouver
Victoria ■ San Francisco ■ Los Angeles ■ Shanghai
Architect
CANNON PROJECT #: 3526.00
stamp

CARDIOLOGY MANAGER	DATE	ENGINEERING MANAGER	DATE
INFECTION CONTROL	DATE	CARELINE MANAGER	DATE
SAFETY OFFICER	DATE	CHIEF OF STAFF	DATE


Drawing Title	ELECTRICAL DETAILS
Project Title	WARD C RENOVATIONS
Building Number	1
Checked	T.G.F.
Drawn	DJW
Location	V.A.M.C. BATAVIA, NEW YORK

Medical Center Director	DATE
Associate Medical Center Director	DATE

Date	09/09/11
Station No.	528A
353	E504

Office Facilities
Department of Veterans Affairs

FULLY SPRINKLERED

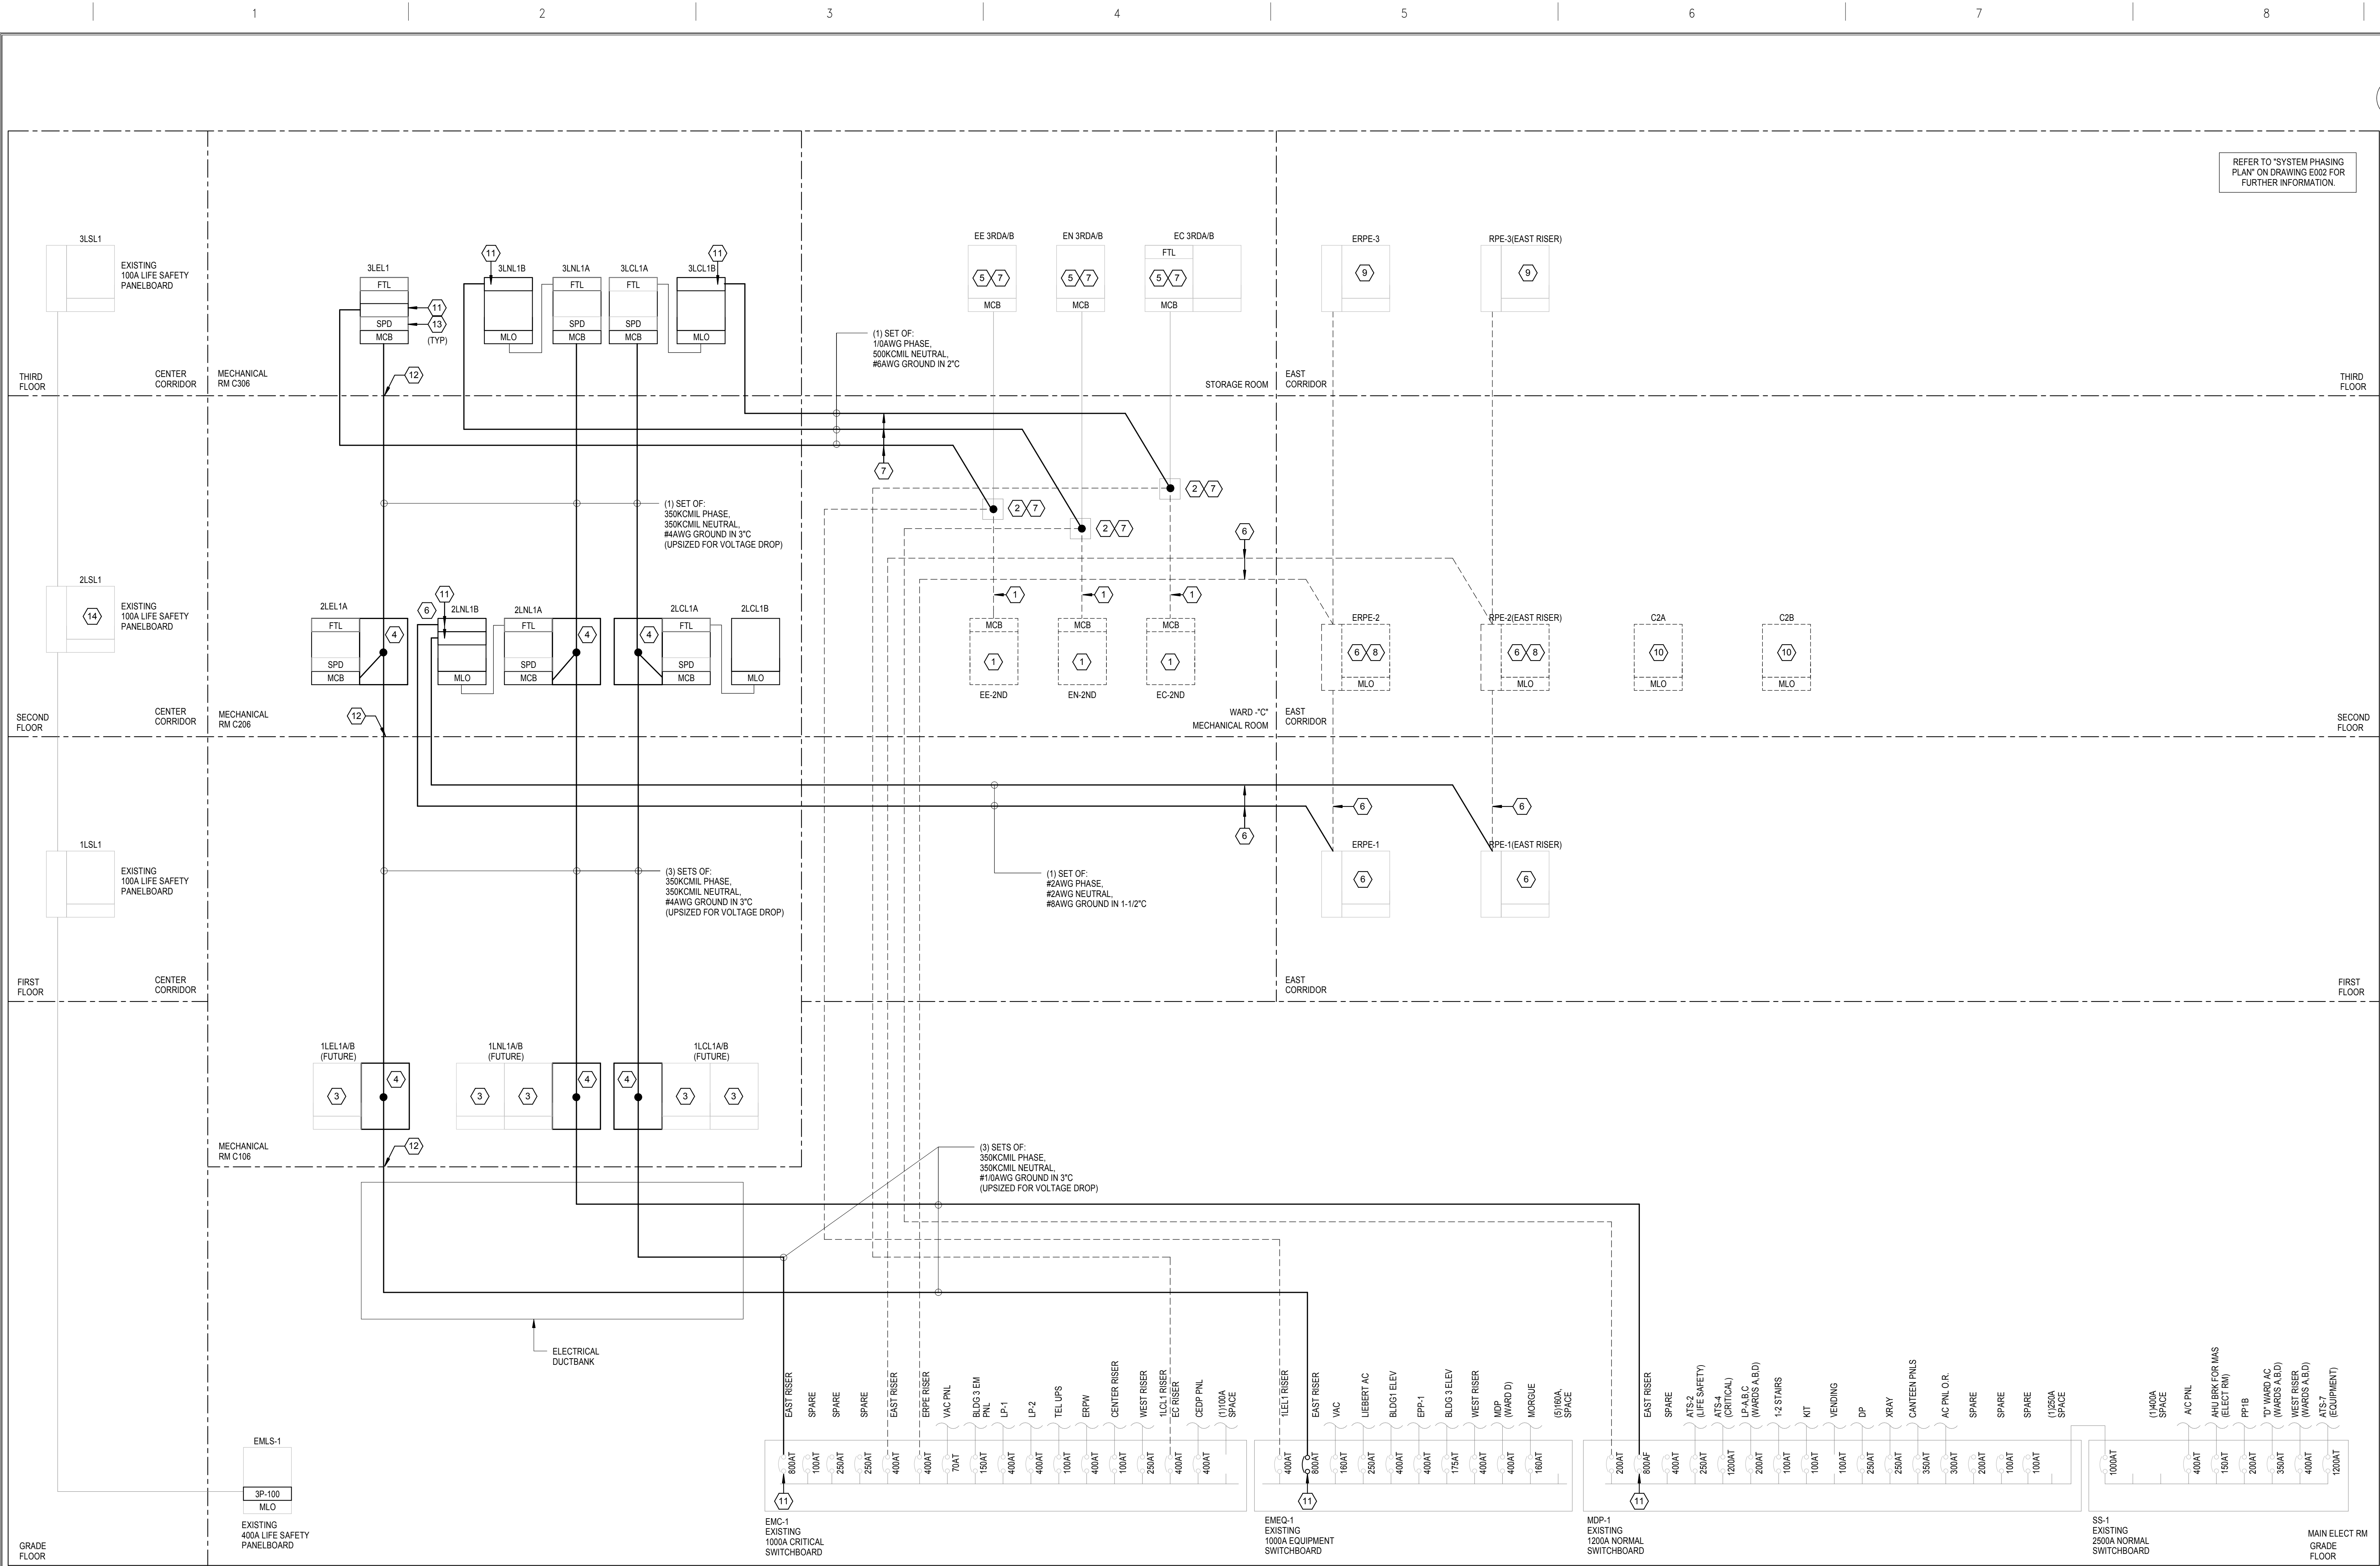

1 POWER RISER DIAGRAM 15

2 RISER NOTES 15

1. REMOVE EXISTING PANELBOARD AND FEEDER BACK TO THE SECOND FLOOR CEILING JUNCTION BOX. THIRD FLOOR PANELBOARD AND FEEDER TO BE KEPT INTACT AND FUNCTIONING EXCEPT FOR A MINIMUM DOWNTIME FOR SECOND FLOOR FEEDER REMOVAL.
2. EXISTING CEILING MOUNTED JUNCTION BOXES FEEDING PANELS ON THIRD FLOOR TO REMAIN.
3. FUTURE PANELBOARD AND JUNCTIONPULBOX FOR FUTURE RENOVATIONS. NOT IN WORK SCOPE.
4. NEW FEEDER JUNCTIONPULBOX. PROVIDE PARALLEL INSULATED MECHANICAL TAP CONNECTOR WITHIN ENCLOSURE TO FEED ADJACENT PANELBOARD AND PANELBOARD ON THE LEVEL ABOVE. MINIMIZE ENCLOSURE DEPTH BY STAGGERING CONNECTORS WITHIN ENCLOSURE.
5. REMOVE EXISTING PANELBOARD MAIN CIRCUIT BREAKER AND REPLACE WITH NEW ADJUSTABLE ELECTRONIC TRIP(S) CIRCUIT BREAKER FOR SYSTEM BREAKER. COORDINATION. EXISTING CIRCUIT BREAKERS AND PANELBOARDS ARE EATON/CUTLER HAMMER TYPE.
6. EXISTING FIRST FLOOR CRITICAL PANELBOARDS ERPE-1 AND RPE-1 ARE FED FROM A JUNCTION BOX LOCATED IN A CHASE TO BE DEMOLISHED ON THE SECOND FLOOR. EXISTING FEEDER AND PANELBOARD TO BE KEPT INTACT AND FUNCTIONING THROUGHOUT THE WARD C RENOVATION. EXISTING CRITICAL FEEDER/PANELBOARD WILL BE RECONNECTED TO THE NORMAL POWER SYSTEM PER DIRECTION FROM THE VA UNDER THIS PROJECT. PROVIDE A NEW FEEDER TO EXISTING PANELBOARD FROM NEW SECOND FLOOR NORMAL POWER PANELBOARD. REFEED SHALL MINIMIZE DOWNTIME TO EXISTING PANELBOARD. REMOVE EXISTING FEEDER ROUTED UP TO AND THROUGH SECOND FLOOR AND BACK DOWN TO THE MAIN ELECTRICAL ROOM IN ITS ENTIRETY.
7. EXISTING THIRD FLOOR PANELBOARD IS FED FROM A JUNCTION BOX LOCATED AT THE CEILING IN SECOND FLOOR. EXISTING FEEDER AND PANELBOARD TO BE KEPT INTACT AND FUNCTIONING THROUGHOUT THE WARD C RENOVATION. PROVIDE A NEW FEEDER FROM NEW THIRD FLOOR PANELBOARD TO THE EXISTING JUNCTION BOX. REFEED SHALL MINIMIZE DOWNTIME TO EXISTING PANELBOARD.
8. REMOVE EXISTING PANELBOARD AND RISER FEEDER UP FROM THIRD FLOOR AND DOWN TO FIRST FLOOR PANELBOARD.
9. EXISTING PANELBOARD TO BE REMOVED BY OTHERS UNDER A PRIOR PROJECT. NOT IN WORK SCOPE.
10. REMOVE EXISTING PANELBOARD AND ASSOCIATED FEEDER BACK TO SOURCE.
11. PROVIDE AN EXTERNALLY ADJUSTABLE ELECTRONIC TRIP(S) CIRCUIT BREAKER FOR SYSTEM BREAKER COORDINATION. EXISTING CIRCUIT BREAKERS AND EQUIPMENT ARE EATON/CUTLER HAMMER. COORDINATE NEW CIRCUIT BREAKER LOCATION WITHIN EXISTING EQUIPMENT PRIOR TO ORDERING BREAKER. PROVIDE NEW DEADFRONT SHEET METAL AND PHENOLIC LABELING AS REQUIRED FOR NEW BREAKER.
12. PROVIDE FLOOR SLEEVES EXTENDING A MINIMUM 4" ABOVE & BELOW FLOOR SLAB FOR CONDUIT RISERS. COORDINATE FLOOR PENETRATIONS WITH STRUCTURAL DRAWINGS. PER THE NEC, THERE SHALL BE A MAXIMUM OF 8-INCHES OF EQUIPMENT/CONDUIT EXTENSION INTO PANELBOARD DEDICATED EQUIPMENT WORKING SPACE. PANELBOARD STANDOFFS FOR WALL MAY BE REQUIRED.
13. SURGE PROTECTIVE DEVICE. COORDINATE FINAL CIRCUIT BREAKER SIZE WITH MANUFACTURER'S RECOMMENDATIONS.
14. UTILIZE EXISTING BRANCH CIRCUIT BREAKERS IN EXISTING LIFE SAFETY PANELBOARD FOR NEW BRANCH CIRCUITS FEEDING RENOVATIONS TO WARD-C.
15. THE FOLLOWING ELECTRICAL SYSTEM BRANCHES SHALL BE COORDINATED DOWN TO THE LAST OVERCURRENT PROTECTIVE DEVICE IN THE SYSTEM: LIFE SAFETY, CRITICAL, AND EQUIPMENT SYSTEM BRANCH. PROVIDE/ADJUST OVERCURRENT PROTECTIVE DEVICES TO MEET THE CONTRACTOR PROVIDED SHORT CIRCUIT AND OVERCURRENT PROTECTION COORDINATION STUDY.

ALTERNATE No. 4	07/01/14
ALTERNATE No. 2 and ALTERNATE No. 3	06/19/14
CONSTRUCTION DOCUMENT - 100% SUBMISSION	07/19/13
CONSTRUCTION DOCUMENT - 90% SUBMISSION	04/05/13
FIRE/LIFE SAFETY REVIEW	03/15/13
DESIGN DEVELOPMENT - 60% SUBMISSION (3RD)	11/09/12
DESIGN DEVELOPMENT - 60% SUBMISSION (2ND)	10/05/12
DESIGN DEVELOPMENT - 60% SUBMISSION (1ST)	06/22/12
SCHEMATIC DESIGN - 30% SUBMISSION	09/09/11
Revisions	Date

VA WESTERN NEW YORK HEALTHCARE SYSTEM  
222 RICHMOND AVE  
BATAVIA, NEW YORK 14020

**CANNON DESIGN**  
2170 Whitehaven Road, Grand Island, New York 14052  
T: 716.773.6800 F: 716.773.5909

Boston • New York • Baltimore • Washington DC • Buffalo  
Toronto • Chicago • St. Louis • Calgary • Vancouver  
Victoria • San Francisco • Los Angeles • Shanghai

Architect CANNON PROJECT #: 3526.00

stamp

CARDIOLOGY MANAGER	DATE	ENGINEERING MANAGER	DATE
INFECTION CONTROL	DATE	CARELINE MANAGER	DATE
SAFETY OFFICER	DATE	CHIEF OF STAFF	DATE

Drawing Title	POWER RISER DIAGRAM
MEDICAL CENTER DIRECTOR	DATE
ASSOCIATE MEDICAL CENTER DIRECTOR	DATE




Project Title	WARD C RENOVATIONS
Building Number	1
Location	V.A.M.C. BATAVIA, NEW YORK

Date	09/09/11
Station No.	528A
353	E601



one-eighth inch = one foot  
one-quarter inch = one foot  
three-eighths inch = one foot  
one-half inch = one foot  
three-quarters inch = one foot  
one inch = one foot  
one and one-half inch = one foot  
two inches = one foot  
three inches = one foot

LUMINAIRE SCHEDULE											
TAG	DESCRIPTION	INSTALL'N METHOD	DEPTH	LAMP		BALLAST		INPUT WATTS	SHIELDING/OPTICS	FEATURES/OPTIONS	NOTES
				SPEC	QTY	SPEC	VOLT				
CD1	10 IN SQUARE-LENSED APERTURE-HORIZONTAL LAMP-COMPACT FLUORESCENT SHOWER LIGHT	RECESSED	-	F26TT	2	ELEC/CFL	120V	54	WHITE UPPER HOUSING-DROPPED OPAL LENS	NON-METALLIC CEILING WHITE CEILING TRIM-UL LISTED WET LOCATION-4C RATED	
CD2	10 IN SQUARE-LENSED APERTURE-HORIZONTAL LAMP-COMPACT FLUORESCENT SHOWER LIGHT	RECESSED	-	F32TT	2	ELEC/CFL	120V	68	WHITE UPPER HOUSING-DROPPED OPAL LENS	NON-METALLIC CEILING WHITE CEILING TRIM-UL LISTED WET LOCATION-4C RATED	
CX1	EXTERIOR FULL-CUTTOF WALLPACK 12 IN L X 7 IN W X 6 IN H	SURFACE	-	F32TT	1	ELEC/CFL, COLD TEMP BALLAST	120V	36	HYDROFORMED REFLECTOR WITH MEDIUM DISTRIBUTION. INTEGRAL PHOTOELECTRIC ON/OFF BUTTON.	DIE-CAST ALUMINUM HOUSING & DOOR FRAME, 1/8 IN TEMPERED GLASS LENS, DOOR FRAME FULLY GASKETED WITH ONE-PIECE SOLID SILICONE, BLACK TEXTURED PPC FINISH.	
FI1	4' STRIP WITH INDUSTRIAL REFLECTOR	SURFACE/ SUSPEND PER PLANS	4 IN	F28T5	2	ELECT/T5	120V	63	MIN 8% UPLIGHT APERTURED SYMMETRICAL STEEL REFLT WITH WH FINISH, PAF	WIREGUARD, DIE-FORMED COLD ROLLED STEEL HOUSING, HIGH GLOSS BAKED WH ENAMEL FINISH, UL DAMP LOCATION, PROVIDE CHAIN HANGERS WHERE SUSPENDED	
FT1	2X2 LENSED TROFFER	RECESSED	≤ 6 IN	F14T5	4	ELECT/T5	120V	68	PATTERN 19 LENS	RECESSED ALUMINUM DOOR - STATIC	
FT2	2X4 LENSED TROFFER	RECESSED	≤ 6 IN	F28T5	3	ELECT/T5	120V	96	PATTERN 19 LENS	RECESSED ALUMINUM DOOR - STATIC	
FT3	2X4 DAMP LOCATION TROFFER	RECESSED	≤ 6 IN	F28T5	4	ELECT/T5	120V	116	PATTERN 19 LENS	DOUBLE GASKETED- SEALED TROFFER - FLUSH ALUMINUM DOOR - PPC	
FP1	DINING/ACTIVITIES - 24 IN DIA BOWL 6 IN TALL, 1 IN* PENDANT LENGTH	PENDANT	18 IN	F32TT	4	ELECT/CFL DIM	120V	136		BRUSHED ALUM. FINISH, SANDBLASTED ACRYLIC BOWL	
FV1	SMOKING SHED 4' WET LISTED SURFACE MOUNTED LUMINAIRE	SURFACE	≤ 6 IN	F28T5	1	ELECT/T5 COLD TEMP BALLAST	120V	33	HIGH IMPACT DIFFUSER	IMPACT-RESISTANT, UV-STABILIZ-ED FIBERGLASS-REINFORCED POLYESTER FULLY GASKETED HOUSING, CORROSION RESIST-ANT CAM LATCHES, UL WET LOCATION	
FW1	CORRIDOR WALL SCONCE - 2 IN L X 2 IN W X 11 IN H RECTILINEAR ACRYLIC LENS ON A METAL BASE	SURFACE WALL		18WTT 2G11	1	ELECT/CFL	120V	18	TRANSLUCENT ACRYLIC LENS - FROST IN COLOR.	BASE FINISH - SATIN NICKEL	
FW2	RESIDENT ROOM VANITY UP/DN LIGHT, 2FT LENGTH	SURFACE WALL		F14T5	2	ELECT/T5	120V	34	UV STABILIZED HIGH IMPACT RESISTANT FROST ACRYLIC LENS, LENS W/INTERNAL PRISMS & SMOOTH EXTERIOR - NOMINAL THICKNESS .080", LENS SECURELY POSITIONED IN BODY CHANNELS	MARINE GRADE ALUM. BODY W/DIE CAST END CAPS, COUNTERSUNK FASTENERS, POLYESTER POWDER COAT W/ANTIMICROBIAL FINISH	
FW3	2' NARROW WRAPAROUND	SURFACE/ SUSPEND PER PLANS	4-1/2"	F14T5	2	ELECT/T5	120V	34	EXTRUDED CLEAR PRISMATIC ACRYLIC WRAPAROUND LENS	DIE-FORMED COLD ROLLED STEEL HOUSING, HIGH GLOSS BAKED WH ENAMEL FINISH, WELDED STEEL END PLATES, PROVIDE HANGERS WHERE SUSPENDED	

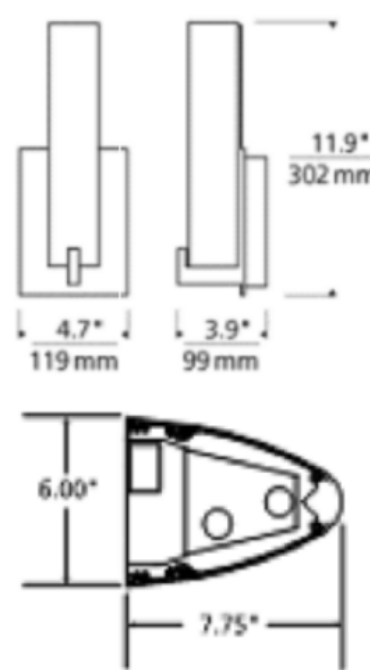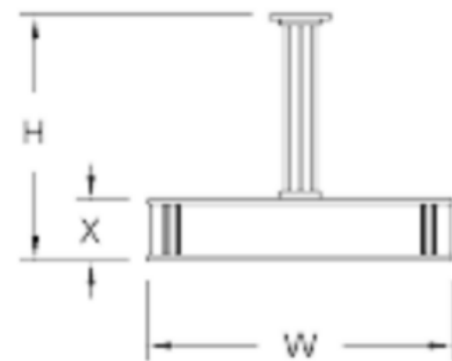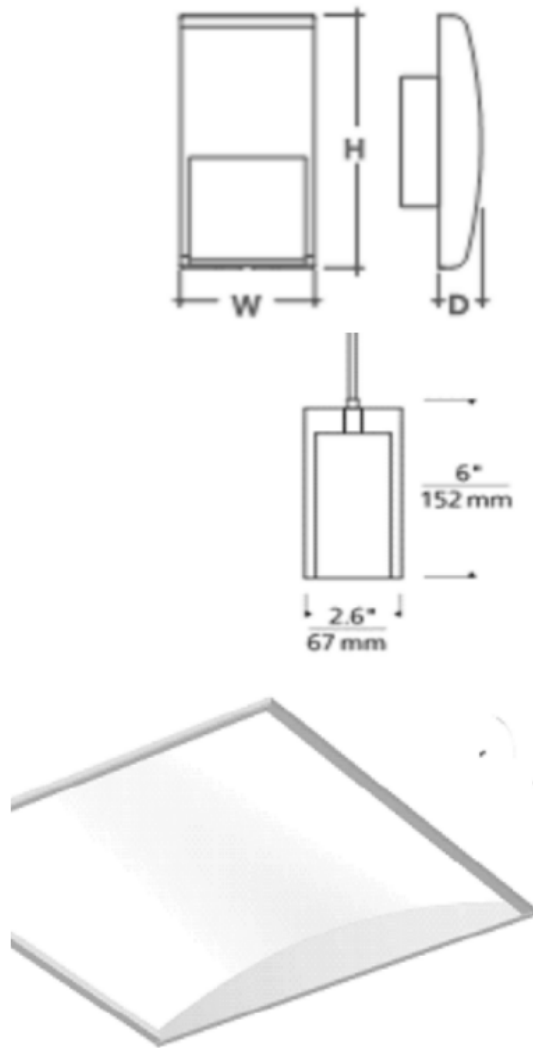

LUMINAIRE SCHEDULE												
TAG	DESCRIPTION	INSTALL'N METHOD	DEPTH	LAMP		BALLAST		INPUT WATTS	SHIELDING/OPTICS	FEATURES/OPTIONS	NOTES	
				SPEC	QTY	SPEC	VOLT					
LD1	6 IN ROUND DOWNLIGHT WITH INTEGRAL LENS	RECESSED	≤ 8 IN	LED 3500K	1	INTEGRAL DRIVER B4-LEVEL HI/LO SWITCHING BALLAST	120V	27	WIDE DISTRIBUTION REFLECTOR, REMOTE PHOSPHOR LENS ASSEMBLY, LOWER TRIM DIE-FORMED OF 0.40 LOW IRIDESCENT ALUMINUM - SELF FLANGED WHITE.	DIE CAST ALUMINUM HEAT SINK, PRECISION DIE STAMPED 18GA GALVANIZED STEEL MOUNTING PAN & YOKE ASSEMBLY, C-CHANNELS TO PROVIDE FOR VERTICAL & HORZ. ADJUSTMENT.		
LD2	6 IN ROUND DOWNLIGHT WITH INTEGRAL LENS	RECESSED	≤ 8 IN	LED 3500K	1	INTEGRAL DRIVER B4-LEVEL HI/LO SWITCHING BALLAST	120V	27	MEDIUM DISTRIBUTION REFLECTOR, REMOTE PHOSPHOR LENS ASSEMBLY, LOWER TRIM DIE-FORMED OF 0.40 LOW IRIDESCENT ALUMINUM - SELF FLANGED WHITE.	DIE CAST ALUMINUM HEAT SINK, PRECISION DIE STAMPED 18GA GALVANIZED STEEL MOUNTING PAN & YOKE ASSEMBLY, C-CHANNELS TO PROVIDE FOR VERTICAL & HORZ. ADJUSTMENT.		
LN1	NIGHT LIGHT - 6 IN H X 3 IN W RECTANGULAR	SURFACE WALL	≤ 1.5 IN	LED	1	INTEGRAL DRIVER	120V	<3	LED SHALL BE ABMER IN COLOR, MOLDED ACRYLIC LENS, FACEPLATE & REFLECTOR SHALL HAVE POLYESTER POWDERCOAT PAINT FINISH W/ANTIMICROBIAL FINISH.	FACEPLATE DIE CAST ALUMINUM, BACKPLATE FORMED 18 GAUGE GALVANIZED STEEL PROVIDED W/NEOPREME GASKET, INTERGAL PHOTOCELL	1	
LP1	NURSES STATION RECTANGULAR PENDANT - 2.6 IN L x 2.6 IN W x 6 IN H, 30 IN PENDANT LENGTH	PENDANT		LED 3000K	1	REMOTE DRIVER	120V	6	RECTANGULAR PRESSED GLASS SHADE SHALL BE FROST IN COLOR.	REMOTE DRIVER SHALL BE LOCATED IN CEILING SPACE ABOVE NURSES STATION LAY-IN CEILING. FINISH - SATIN NICKEL.	3	
LT1	2X2 RECESSED INDIRECT TROFFER	RECESSED	≤ 6 IN	LED 3500K	1	INTEGRAL DRIVER	120V	40	CURVED ACRYLIC PANEL, EFFICACY - 90LM/W, 3600LM	DIE-FORMED POST PAINTED, 22GA COLD ROLLED STEEL, WHITE FINISH, HINGED FRAME FOR ACCESS BELOW CEILING.		
LU1	LED UNDER CABINET TASK LIGHTING LUMINAIRE	SURFACE UNDER MILLWORK CABINETRY		MULTI HIGH BRIGHT LED 4000K	AS REQ.	INTEGRAL DRIVER	120V	APPROX 0.6W PER FT.	110"X110" BEAM ANGLE LED LENS-CLEAR, RADIUS, POLY-CARBONATE LENS, CONFORMING TO HOUSING SHAPE	LOW PROFILE, ≤1"H X ≤2"W, ALUM. HSG-WHITE PPC FINISH-INDIVIDUAL LENGTHS AS REQ'D PER MILLWORK DIMENSIONS	2	
XX1	ILLUMINATED "EXIT" SIGN-AC ONLY	CEILING, WALL, PENDANT, OR EXT'D WALL MTD AS SHOWN		LED	≤ 5W PER FACE		120V		STENCIL CUT, DIE-CAST ALUMINUM FACE(S) WITH NYC CODE SIZE "EXIT" LETTERS & DIRECTIONAL CHEVRON(S)-RED ACRYLIC SHEET BACKING	DIE-CAST ALUMINUM HOUSING-DIE CAST ALUMINUM FACE(S) & DIRECTIONAL CHEVRON(S) AS SHOWN-PAINTED PPC FINISH-COLOR TBS		
GENERAL NOTES:												
A REFERENCED PRODUCTS ARE INCLUDED HEREIN, OF MANUFACTURERS & PRODUCTS, THAT GENERALLY CONFORM TO THE LUMINAIRE DESIGN INTENTS ESTABLISHED HEREIN, & IN THE PROJECT MANUAL. EQUIVALENT PRODUCTS BY OTHER MANUFACTURERS MAY BE CONSIDERED, PRIOR TO BID.												
B DETERMINE SPECIFIC LUMINAIRE PART NUMBERS BASED ON THE REFERENCED PRODUCT SERIES, WRITTEN DESCRIPTIONS & PROJECT MANUAL SPECIFICATIONS.												
C INCLUSION HEREIN OF MANUFACTURER'S SERIES &/OR MODEL NUMBERS DOES NOT IMPLY UNCONDITIONAL PRODUCT APPROVAL - MANUFACTURER'S STANDARD PRODUCTS MAY REQUIRE CUSTOM MODIFICATIONS TO MEET THE REQUIREMENTS SPECIFIED HEREIN & IN THE PROJECT MANUAL.												
D LISTED SIZES, LAMPING, & TYPES OF LUMINAIRES MAY NOT BE AVAILABLE FROM ANY GIVEN MANUFACTURER OR SERIES.												
E ALERT ARCHITECT TO DISCREPANCIES PRIOR TO BID.												
ABBREVIATIONS:												
CONC	CONCRETE	LOJRI	SEMI-SPECULAR			PPC	POLYESTER POWER COAT		S'SPEC	SEMI-SPECULAR		
DW	DRYWALL	NT	NARROW TEE GRID			PRISM	PRISMATIC		SS	STAINLESS STEEL		
DI	DIRECT/INDIRECT	PAF	PAINT AFTER FABRICATION			REFLT	REFLECTOR/REFLECTANCE		TBS	TO BE SELECTED BY ARCH		
EXP	EXPOSED	PARA	PARABOLIC			SP	SPLINE CEILING SYSTEM		UNIV	UNIVERSAL 120-277VAC		
LG	LAY-IN GRID	PL	PLASTER			SPEC			WH	WHITE		
NOTES:												
1 COORDINATE FINISH COLOR SELECTION WITH ARCHITECT PRIOR TO ORDERING												
2 COORDINATE FINAL LENGTH WITH SUBMITTED MILLWORK SHOP DRAWINGS												
3 COORDINATE FINAL PENDANT LENGTH WITH ARCHITECTURAL ELEVATIONS												
4												
5												
6												
7												

ALTERNATE No.4	07/01/14
ALTERNATE No.2 and ALTERNATE No.3	06/19/14
CONSTRUCTION DOCUMENT - 100% SUBMISSION	07/19/13
CONSTRUCTION DOCUMENT - 90% SUBMISSION	04/05/13
FIRE/LIFE SAFETY REVIEW	03/15/13
DESIGN DEVELOPMENT - 60% SUBMISSION (3RD)	11/09/12
DESIGN DEVELOPMENT - 60% SUBMISSION (2ND)	10/05/12
DESIGN DEVELOPMENT - 60% SUBMISSION (1ST)	08/22/12
SCHEMATIC DESIGN - 30% SUBMISSION	09/09/11
Revisions	Date

VA WESTERN NEW YORK HEALTHCARE SYSTEM  
222 RICHMOND AVE  
BATAVIA, NEW YORK 14020

**CANNON**DESIGN

2170 Whitehaven Road, Grand Island, New York 14072  
T: 716.773.6800 F: 716.773.5909

Boston ■ New York ■ Baltimore ■ Washington DC ■ Buffalo  
Toronto ■ Chicago ■ St. Louis ■ Calgary ■ Vancouver  
Victoria ■ San Francisco ■ Los Angeles ■ Shanghai

Architect

CANNON PROJECT #: 3526.00


stamp

CARDIOLOGY MANAGER	DATE	ENGINEERING MANAGER	DATE
INFECTION CONTROL	DATE	CARELINE MANAGER	DATE
SAFETY OFFICER	DATE	CHIEF OF STAFF	DATE

Drawing Title	ELECTRICAL SCHEDULES
MEDICAL CENTER DIRECTOR	DATE
ASSOCIATE MEDICAL CENTER DIRECTOR	DATE

Project Title	WARD C RENOVATIONS
Building Number	1
Location	V.A.M.C. BATAVIA, NEW YORK

Date	09/09/11
Station No.	528A
353	E602

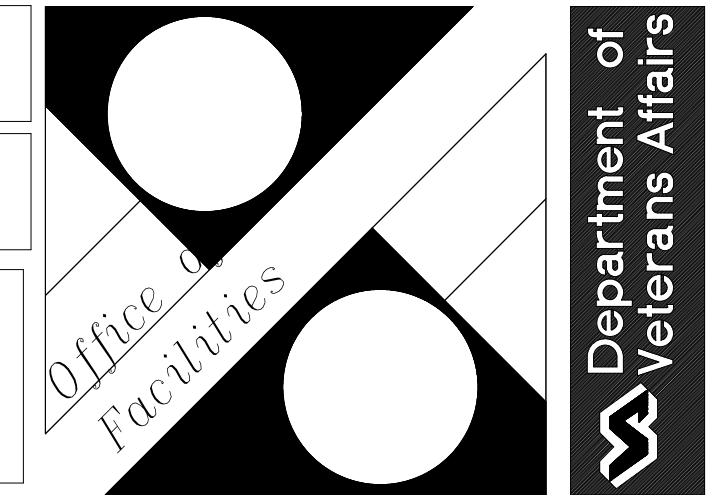

FULLY SPRINKLERED

## EQUIPMENT CONNECTION / MOTOR CONTROLLER SCHEDULE

EQUIPMENT DESIGNATION	DESCRIPTION	EQUIPMENT / MOTOR DATA							CONTROLLER DATA										LOCAL DISCONNECT SWITCH					SOURCE PROTECTIVE DEVICE					WIRING										REMARKS			
		HP	KW	FLA	NORMAL PWR	EMERGENCY POWER	VOLTAGE	PHASE	MOUNTING			TYPE	NEMA SIZE	OVERCURRENT PROTECTIVE DEVICE			SINGLE PHASE PROTECTION	NEMA ENCLOSURE	WEIGHT(LBS)	LOCATION	OVERCURRENT PROTECTIVE DEVICE			NEMA ENCLOSURE	WEIGHT(LBS)	LOCATION	MCP	FUSE	BREAKER	POLE AMPS	PANELBOARD OR MCC	PHASE		NEUTRAL		GROUND		CONDUIT		CONNECTION TYPE		
									PACKAGED	SEPARATE	MCC			MCP	FUSE	RATING					MCP	FUSE	RATING									QUANTITY	SIZE	QUANTITY	SIZE	QUANTITY	SIZE	QUANTITY			SIZE	CONNECTION TYPE
AHU-2C-1	AIR HANDLING UNIT	10	-	-	-	X	208	-	X	-	VSD								C206		X	70A	1			C206		X	90	2LE1L	3	4	-	-	1	8	1	1	CP	1.4		
CH-2C-1	CHILLER	-	30		X	-	208	-	-	-	-								C206		-	-	-			-	X	150	2LNL1	3	10	-	-	1	6	1	1-1/2	CP	1.4			
CT-2C-1	COOLING TOWER UNIT	3	-	-	X	-	208	-	X	-	VSD								C206		X	20A	3R			ROOF		X	35	2LNL1	3	8	-	-	1	10	1	3/4	CP	1.4		
CT-2C-2	COOLING TOWER BASIN SKID	-	3	-	X	-	208	-	X	-	CP								ROOF		X	30A	3R			ROOF		X	30	2LNL1	3	8	-	-	1	10	1	1	CP	1.4		
CT-2C-3	COOLING TOWER BASIN HEATER	-	4	-	X	-	208	-	X	-	CP								ROOF		X	20A	3R			ROOF		X	20	2LNL1	3	8	-	-	1	10	1	1	CP	1.4		
CT-2C-1 WT SYSTEM	COOLING TOWER WATER TREATMENT SYSTEM (CONTINUED)	-	-	-	X	-	120	-	X	-	CP								C206		-	-	-			-	X	20	2LNL1	1	12	-	-	1	12	1	3/4	CP	1.3,4			
EF-2C-1	EXHAUST FAN	0.75	-	-	-	X	208	-	X	-	AL								C206		X	15A	1			C206		X	20	2LE1L	3	12	-	-	1	12	1	3/4	CP	1.4		
EF-2C-2	EXHAUST FAN	0.25	-	-	-	X	208	-	X	-	AL								C206		X	15A	1			C206		X	20	2LE1L	3	12	-	-	1	12	1	3/4	CP	1.4,5		
CHP-2C-1	PRIMARY CHILLED WATER PUMP	1.5	-	-	-	X	208	-	X	-	ALC								C206		X	15A	1			C206		X	20	2LE1L	3	10	-	-	1	10	1	3/4	CP	1.4		
CWP-2C-1	CONDENSER WATER PUMP	5	-	-	-	X	208	-	X	-	ALC								C206		X	35A	1			C206		X	35	2LE1L	3	10	-	-	1	10	1	3/4	CP	1.4		
CWP-2C-2	CONDENSER WATER PUMP(BACK-UP)	5	-	-	-	X	208	-	X	-	ALC								C206		X	35A	1			C206		X	35	2LE1L	3	10	-	-	1	10	1	3/4	CP	1.4		
SCHP-2C-1	CHILLED WATER PUMP	3	-	-	-	X	208	-	X	-	VSD								C206		X	20A	1			C206		X	35	2LE1L	3	10	-	-	1	10	1	3/4	CP	1.4		
SCHP-2C-2	CHILLED WATER PUMP(BACK-UP)	3	-	-	-	X	208	-	X	-	VSD								C206		X	20A	1			C206		X	35	2LE1L	3	10	-	-	1	10	1	3/4	CP	1.4		
SCP-2C-1	STEAM CONDENSATE PUMP	1	-	-	-	X	208	X	-	-	CP								C106		-	-	-			-	X	15	2LE1L	3	12	-	-	1	1	1	3/4	CP	1.4			
SF-2C-1	SUPPLY FAN	0.25	-	-	-	X	208	-	X	-	AL								C206		X	15A	1			C206		X	15	2LE1L	2	12	-	-	1	12	1	3/4	CP	1.4,5		
RP-1	RECIRCULATION PUMP	0.5	-	-	-	X	120	-	X	-	AL								G6		X	20A	1			G5		X	20	PWP-1	1	12	-	-	1	1	1	3/4	CP	1.2,4		
RF-2C-1	RETURN FAN	2	-	-	-	X	208	-	X	-	AL								C206		X	15A	1			C206		X	20	2LE1L	3	12	-	-	1	12	1	3/4	CP	1.4		
CONTROLLER TYPE:		CONNECTION TYPE:											GENERAL NOTES:										REMARKS:																			
AL ACROSS THE LINE H-O-A		CP CONTROL PANEL- MAKE DIRECT CONNECTION											A. FINAL CONNECTIONS TO ALL EQUIPMENT SHALL BE MADE BY DIVISION 26.										1. COORDINATE FINAL OVERCURRENT PROTECTION DEVICE SIZING WITH SUBMITTED EQUIPMENT MANUFACTURER'S SHOP DRAWINGS.																			
ALC ACROSS THE LINE COMBINATION DISCONNECT H-O-A		DR STANDARD PANEL- 5-20R DUPLEX RECEPTACLE											INTERCONNECT TO ALL ASSOCIATED EQUIPMENT ELECTRICAL DEVICES.										2. PROVIDE NEW CIRCUIT BREAKER IN EXISTING PANELBOARD. COORDINATE DEVICE TYPE & INTERRUPTING RATING TO MATCH BREAKERS IN EXISTING PANELBOARD.																			
ALO ACROSS THE LINE COMBINATION DISCONNECT O-A		JB JUNCTION BOX											B. VERIFY ALL RECEPTACLE TYPES AND BRANCH WIRING WITH EQUIPMENT SUPPLIER										3. PROVIDE (B) 1P-20A BRANCH CIRCUITS AND CIRCUIT BREAKERS FOR COOLING TOWER WATER TREATMENT SYSTEM. PROVIDE ASSOCIATED RECEPTACLE OR DIRECT CONNECTION AS REQUIRED PER THE MANUFACTURER.																			
RV REDUCED VOLTAGE		DC DIRECT CONNECTION TO EQUIPMENT											FOR COORDINATION OF EQUIPMENT PLUGS AND WIRING PRIOR TO INSTALLATION.										4. COORDINATE FINAL EQUIPMENT CONNECTIONS WITH MANUFACTURER'S SUBMITTED SHOP DRAWINGS PRIOR TO ROUGH-IN.																			
RVC REDUCED VOLTAGE COMBINATION DISCONNECT		RC RECEPTACLE TO MATCH EQUIPMENT PLUG																					5. 1-PHASE FAN UNIT. COORDINATE FINAL EQUIPMENT CONNECTIONS WITH MANUFACTURER'S SUBMITTED SHOP DRAWINGS PRIOR TO ROUGH-IN.																			
2S TWO SPEED																																										
VSD VARIABLE SPEED DRIVE																																										
TS FRACTIONAL HP MANUAL STARTER		NU NEAR UNIT											C. CONTRACTOR SHALL PROVIDE POWER CONNECTIONS TO VSD/ALC AND FROM VSD/ALC																													
		OU ON UNIT											TO LOCAL EQUIPMENT DISCONNECTING MEANS OR EQUIPMENT CONNECTION BOX.																													
		PCU PACKAGE CONTROL UNIT											COORDINATE FINAL VSD/ALC PLACEMENT WITH THE MECHANICAL DESIGN DOCUMENTS.																													
		MCC MOTOR CONTROL CENTER																																								

## SCHEDULE OF PANELBOARDS

PANEL/BOARD DESIGNATION	VOLTAGE					RATINGS		MAINS					BRANCH DEVICES										FEATURES								REMARKS								
	480V 3PH 3W	480V 3PH 4W	208V 3PH 3W	208V 3PH 4W	240V 1PH 3W	BUS AMPS	MIN. AIC RATING (K=1000)	MLO	MAIN DEVICE			SFL	FTL	TYPE	FRAME	TRIP	POLES	ACTIVE	SHADE	TOTAL DEVICES	TOTAL SPACES	TOTAL POLES	MOUNTING	EMAS SYSTEM	DOUBLE SECTION	RISER GUTTER	200% NEUTRAL	ISOLATED GROUND BUS	ELECTRONIC	NEMA ENCLOSURE									
									TYPE	FRAME	TRIP																												
2LCL1A				X		400	35		AT	400	400		X		20	30	1	1	0	1	0	1	S			X					1								
															20	20	1	33	8	41	0	41	S																
2LCL1B				X		400	35	X							20	20	1	12	30	42	0	42	S								1								
2LEL1				X		400	35		AT	400	400		X		100	90	3	1	0	1	0	3	S			X					2								
															100	60	3	1	0	1	0	3																	
															100	35	3	4	0	4	0	12																	
															100	30	3	1	0	1	0	3																	
															100	20	3	3	0	3	0	9																	
															100	15	3	1	0	1	0	3																	
															100	15	2	2	0	2	0	4																	
															100	20	1	9	34	43	0	43																	
															100	15	1	0	4	4	0	4																	
2LNL1A				X		400	35		AT	400	400		X	AT	225	150	3	1	0	1	0	3	S			X					1								
														AT	100	100	3	2	0	2	0	6																	
															100	35	3	1	0	1	0	3																	
															100	30	3	1	0	1	0	3																	
															100	20	3	1	0	1	0	3																	
															100	20	1	5	19	24	0	24																	
2LNL1B				X		400	35	X							100	50	2	2	0	2	0	4	S								2								
															100	30	2	1	0	1	0	2																	
															100	30	1	1	0	1	0	1																	
															100	20	1	52	25	77	0	77																	
3LCL1A				X		400	35		AT	400	400		X	AT	225	150	3	1	0	1	0	3	S			X					1								
															100	20	1	0	39	39	0	39																	
3LCL1B				X		400	35	X							100	20	1	0	42	42	0	42									1								
3LEL1A				X		400	35		AT	400	400		X	AT	225	150	3	1	0	3	0	3	S			X					1								
															100	20	1	39	42	39	42	81																	
3LEL1B				X		400	35		AT	400	400		X	AT	225	150	3	1	0	3	0	3	S			X					1								
															100	20	1	39	0	39	0	39																	
3LNL1B				X		400	35	X							100	20	1	0	84	84	0	84									2								
A (SMOKING SHED)					X	60	35			100	60				100	20	1	12	0	12	0	12	F								3								
DEVICE TYPE: STANDARD THERMAL MAGNETIC BREAKER, UNLESS NOTED OTHERWISE. C CURRENT LIMITING BREAKER F SWITCH AND FUSE P CURRENT TRIPPING FUSE R 100% RATED AT SOLID STATE BREAKER - FULLY ADJUSTABLE L.S.I. SETTINGS (VERIFY FINAL SETTINGS WITH CIRCUIT BREAKER COORDINATION STUDY)										TRIP: NON-INTERCHANGEABLE FOR THERMAL MAGNETIC BREAKER, UNLESS NOTED OTHERWISE. A ARC FAULT CIRCUIT INTERRUPTING C INTERCHANGEABLE G GROUND FAULT INTERRUPTING S WITH SHUNT TRIP										MOUNTING: S SURFACE F FLUSH										GENERAL NOTES: 1. SERIES AIC RATINGS ARE NOT ACCEPTABLE. 2. DEFAULT NEMA RATING IS 1 IF LEFT BLANK.  REMARKS: 1. 42 POLE PANELBOARD 2. 84 POLE PANELBOARD 3. FLUSH MOUNTED LOAD CENTER. COORDINATE INSTALLATION WITH SMOKING SHED MANUFACTURER.									

ALTERNATE No 4	07/01/14
ALTERNATE No 2 and ALTERNATE No 3	06/19/14
CONSTRUCTION DOCUMENT - 100% SUBMISSION	07/19/13
CONSTRUCTION DOCUMENT - 90% SUBMISSION	04/05/13
FIRE/ LIFE SAFETY REVIEW	03/15/13
DESIGN DEVELOPMENT - 60% SUBMISSION (3RD)	11/09/12
DESIGN DEVELOPMENT - 60% SUBMISSION (2ND)	10/05/12
DESIGN DEVELOPMENT - 60% SUBMISSION (1ST)	06/22/12
SCHEMATIC DESIGN - 30% SUBMISSION	09/09/11
Revisions	Date

VA WESTERN NEW YORK HEALTHCARE SYSTEM  
222 RICHMOND AVE  
BATAVIA, NEW YORK 14020

**CANNONDESIGN**

2170 Whitehaven Road, Grand Island, New York 14072  
T: 716.773.6800 F: 716.773.5909

Boston ■ New York ■ Baltimore ■ Washington DC ■ Buffalo  
Toronto ■ Chicago ■ St. Louis ■ Calgary ■ Vancouver  
Victoria ■ San Francisco ■ Los Angeles ■ Shanghai

Architec

CANNON PROJECT #: 3526.00

stamp

CARDIOLOGY MANAGER

DATE \_\_\_\_\_

ENGINEERING MANAGER

DATE \_\_\_\_\_

INFECTION CONTROL

DATE \_\_\_\_\_

CARELINE MANAGER

DATE \_\_\_\_\_

SAFETY OFFICER

DATE \_\_\_\_\_

CHIEF OF STAFF

DATE \_\_\_\_\_

Drawing Title

## ELECTRICAL SCHEDULES

Project Title

## WARD C RENOVATIONS

Building Number

Location	V.A.M.C. BATAVIA, NEW YORK
----------	----------------------------

Date \_\_\_\_\_

09/09/11

Station No. 5

528A


353

E603


FULLY SPRINKLERED




Department of  
Veterans Affairs

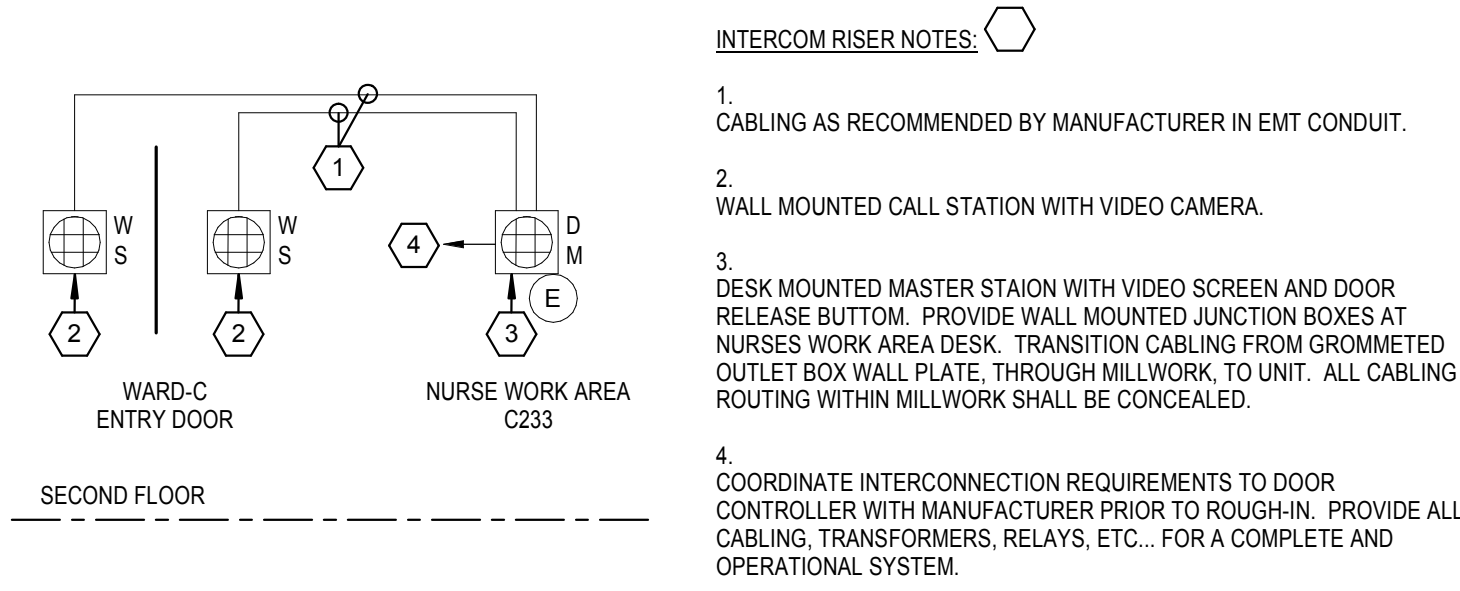


5 INTERCOM RISER DIAGRAM  
1/8" = 1'-0"

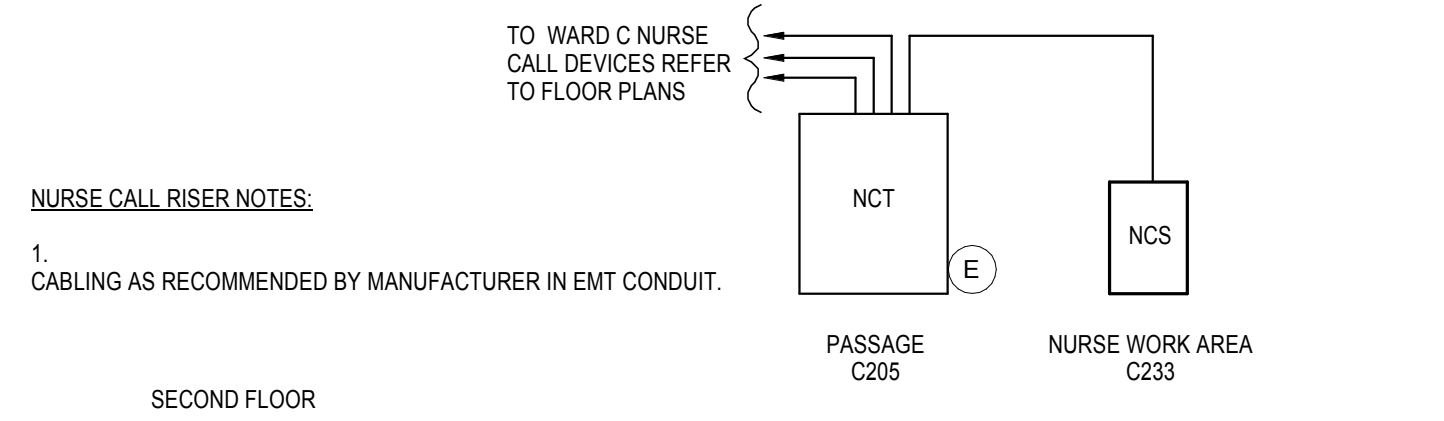


4 NURSE CALL RISER DIAGRAM

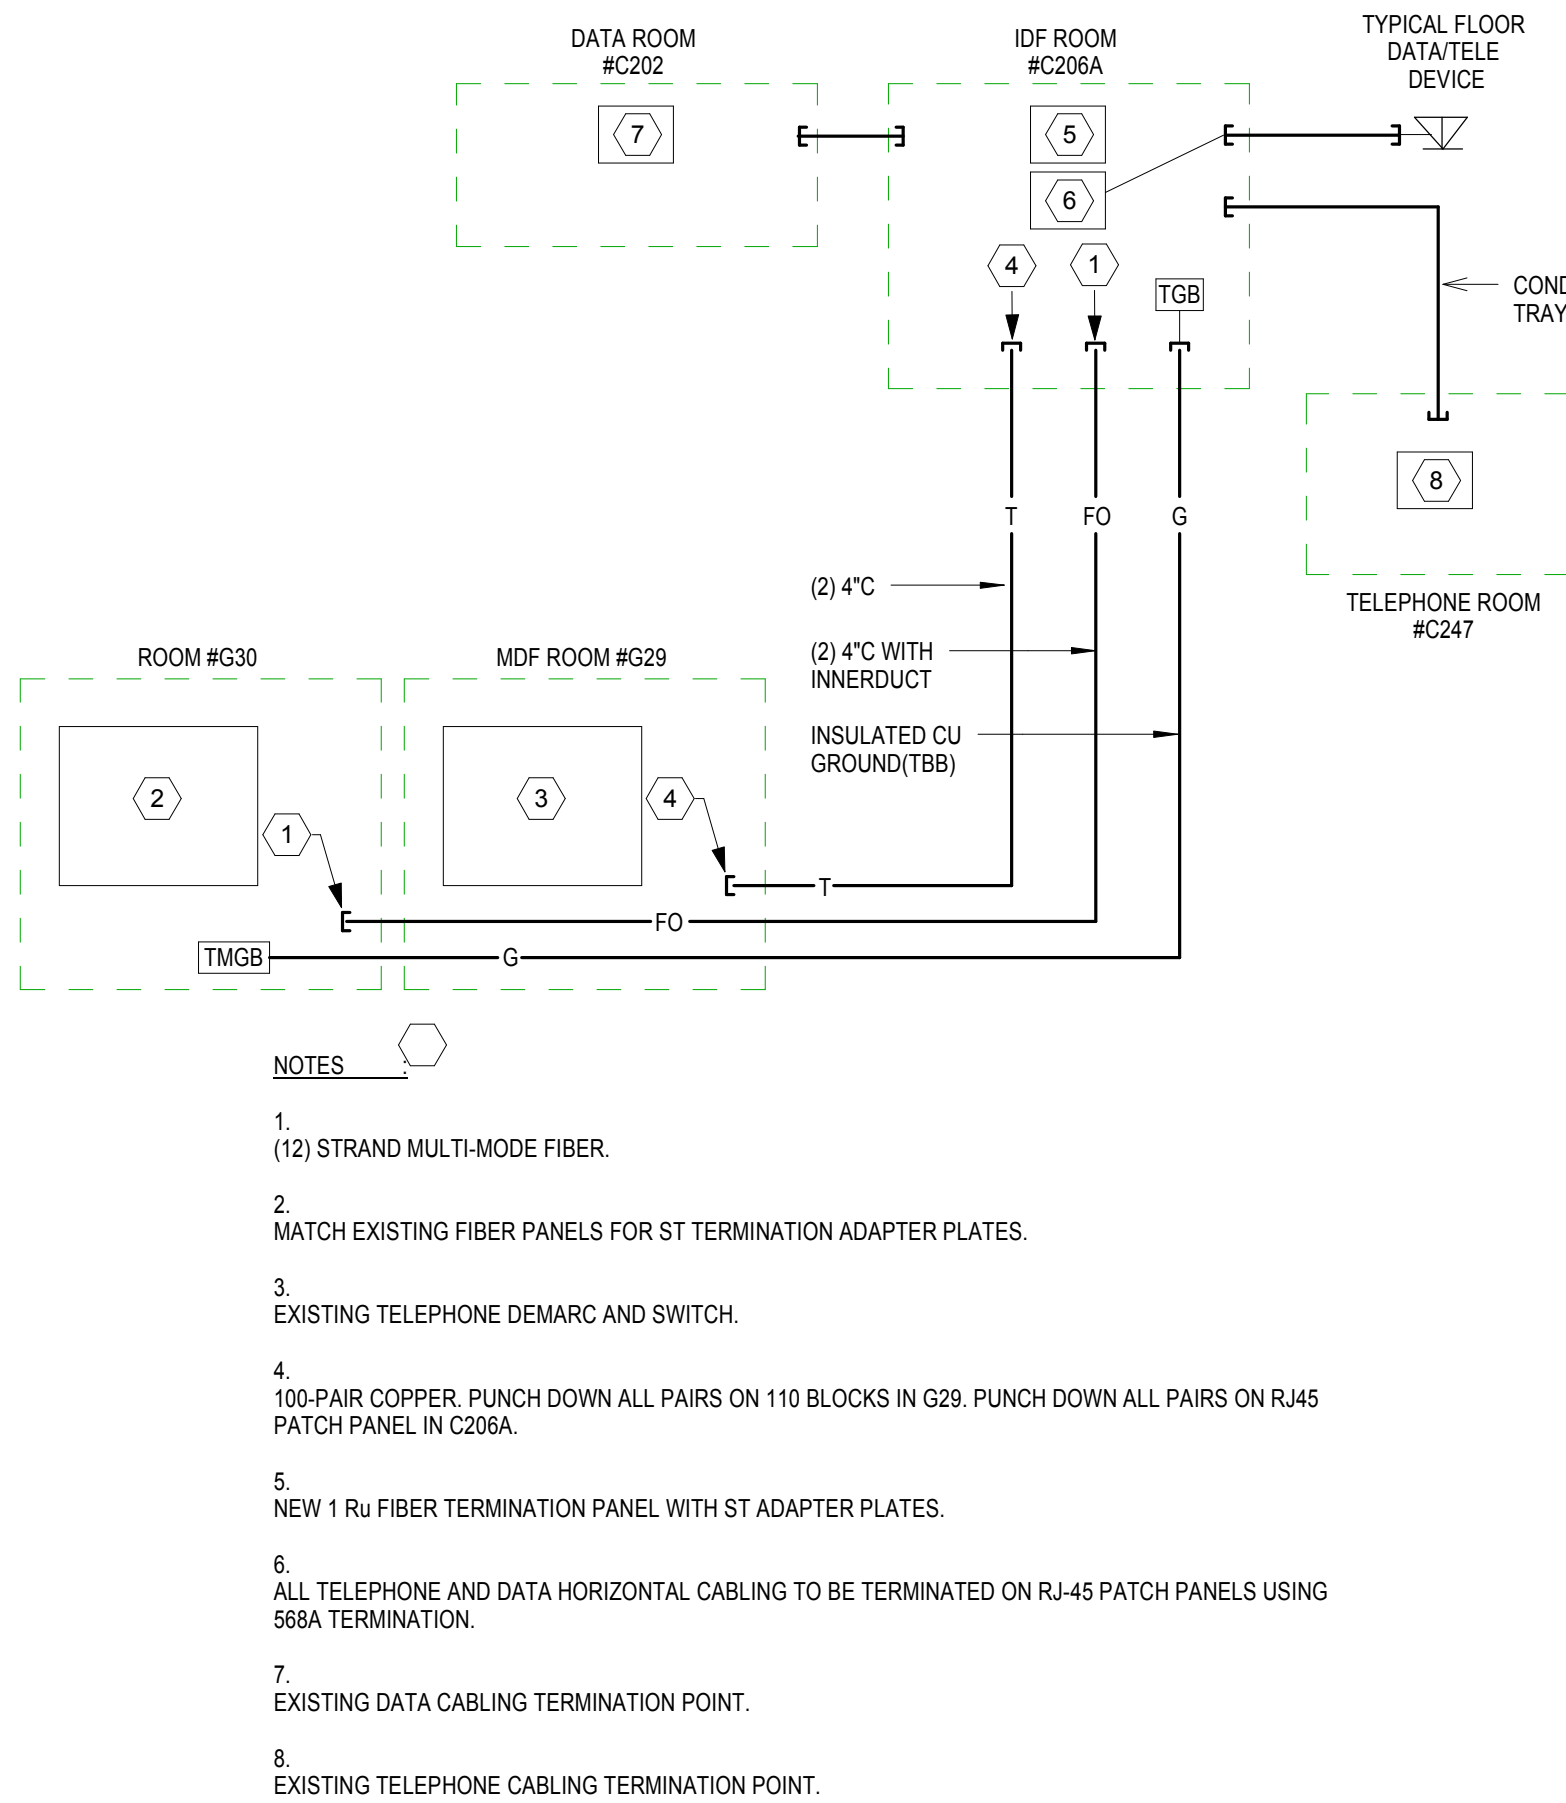

3 COMMUNICATION RISER DIAGRAM

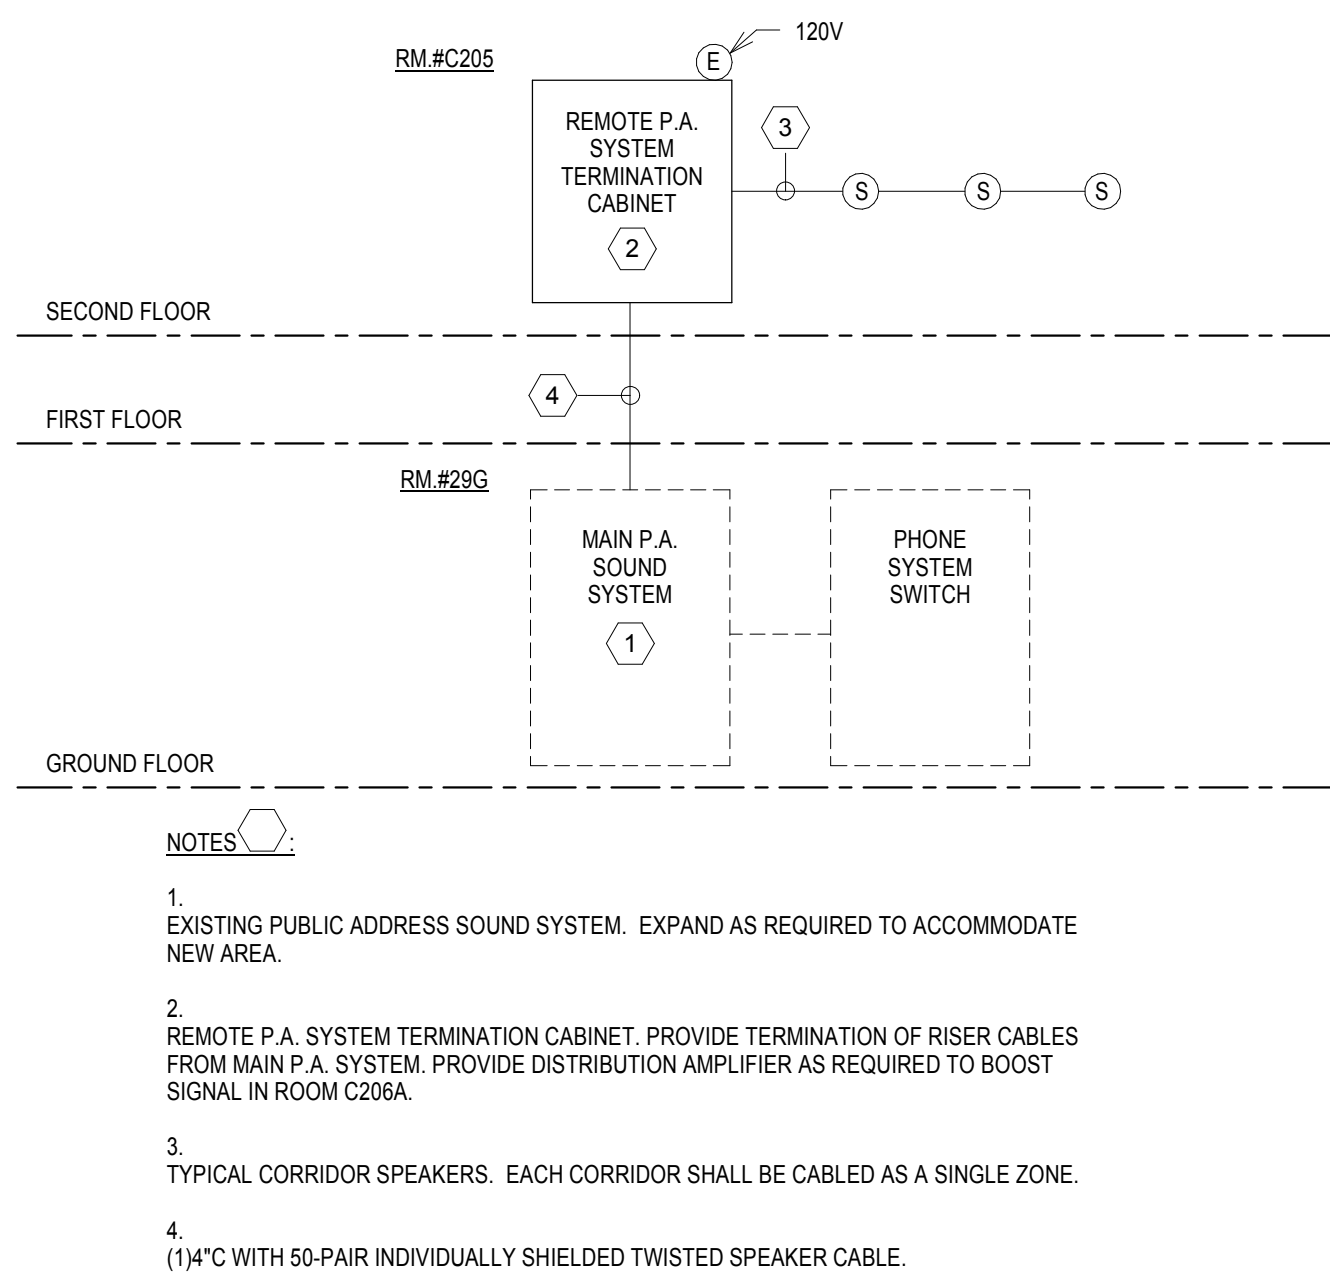

2 PUBLIC ADDRESS SYSTEM EXPANSION RISER DIAGRAM

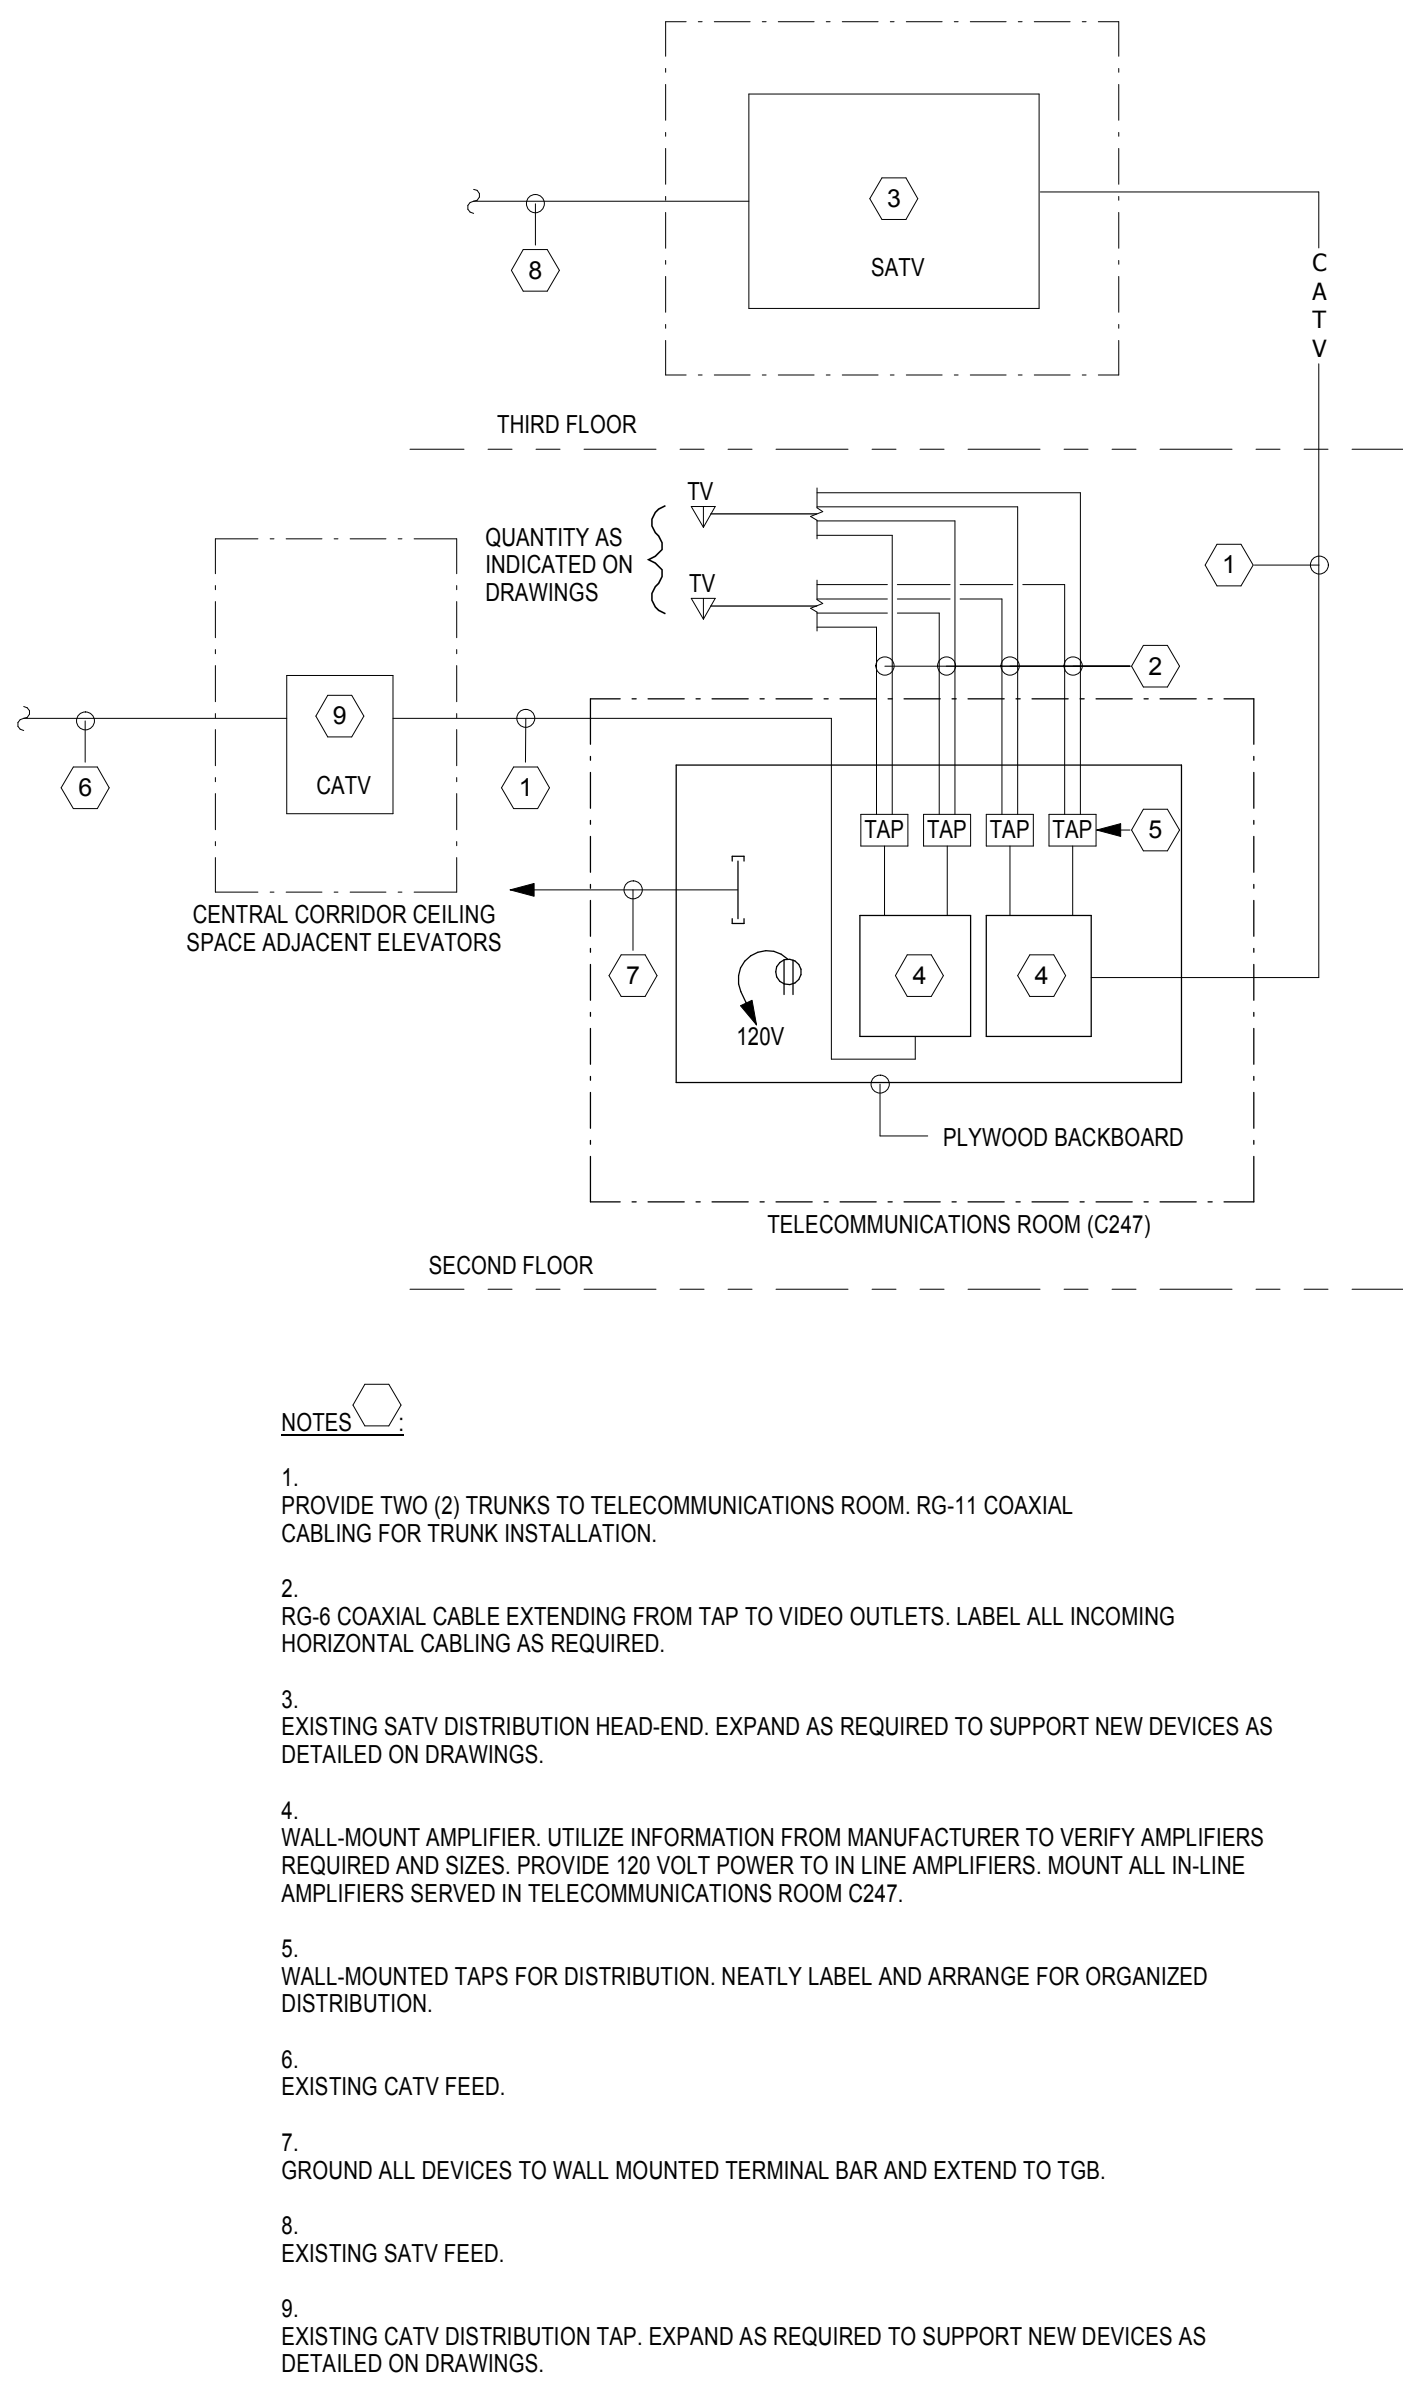

1 VIDEO DISTRIBUTION RISER DIAGRAM

ALTERNATE No.4	07/01/14
ALTERNATE No.2 and ALTERNATE No.3	06/19/14
CONSTRUCTION DOCUMENT - 100% SUBMISSION	07/19/13
CONSTRUCTION DOCUMENT - 90% SUBMISSION	04/05/13
FIRE/LIFE SAFETY REVIEW	03/15/13
DESIGN DEVELOPMENT - 60% SUBMISSION (3RD)	11/09/12
DESIGN DEVELOPMENT - 60% SUBMISSION (2ND)	10/05/12
DESIGN DEVELOPMENT - 60% SUBMISSION (1ST)	08/22/12
SCHEMATIC DESIGN - 30% SUBMISSION	09/09/11
Revisions	Date

VA WESTERN NEW YORK HEALTHCARE SYSTEM  
222 RICHMOND AVE  
BATAVIA, NEW YORK 14020

**CANNONDESIGN**

2170 Whitehaven Road, Grand Island, New York 14027  
T: 716.773.8800 F: 716.773.5909

Boston ■ New York ■ Baltimore ■ Washington DC ■ Buffalo  
Toronto ■ Chicago ■ St. Louis ■ Calgary ■ Vancouver  
Victoria ■ San Francisco ■ Los Angeles ■ Shanghai

Architect CANNON PROJECT #: 3526.00

stamp

CARDIOLOGY MANAGER

DATE

ENGINEERING MANAGER

DATE

INFECTION CONTROL

DATE

CARELINE MANAGER

DATE

SAFETY OFFICER

DATE

CHIEF OF STAFF

DATE

Drawing Title  
SYSTEMS RISER DIAGRAMS

MEDICAL CENTER DIRECTOR

DATE

ASSOCIATE MEDICAL CENTER DIRECTOR

DATE

Project Title  
WARD C RENOVATIONS

Building Number

Checked T.G.F.

Drawn D.J.J.

Location  
V.A.M.C. BATAVIA, NEW YORK

Date  
09/09/11

Station No.  
5284

353


E604

FULLY SPRINKLERED



Department of  
Veterans Affairs

three-eighths inch = one foot  
one-half inch = one foot  
three-quarters inch = one foot  
one-quarter inch = one foot  
one-eighth inch = one foot

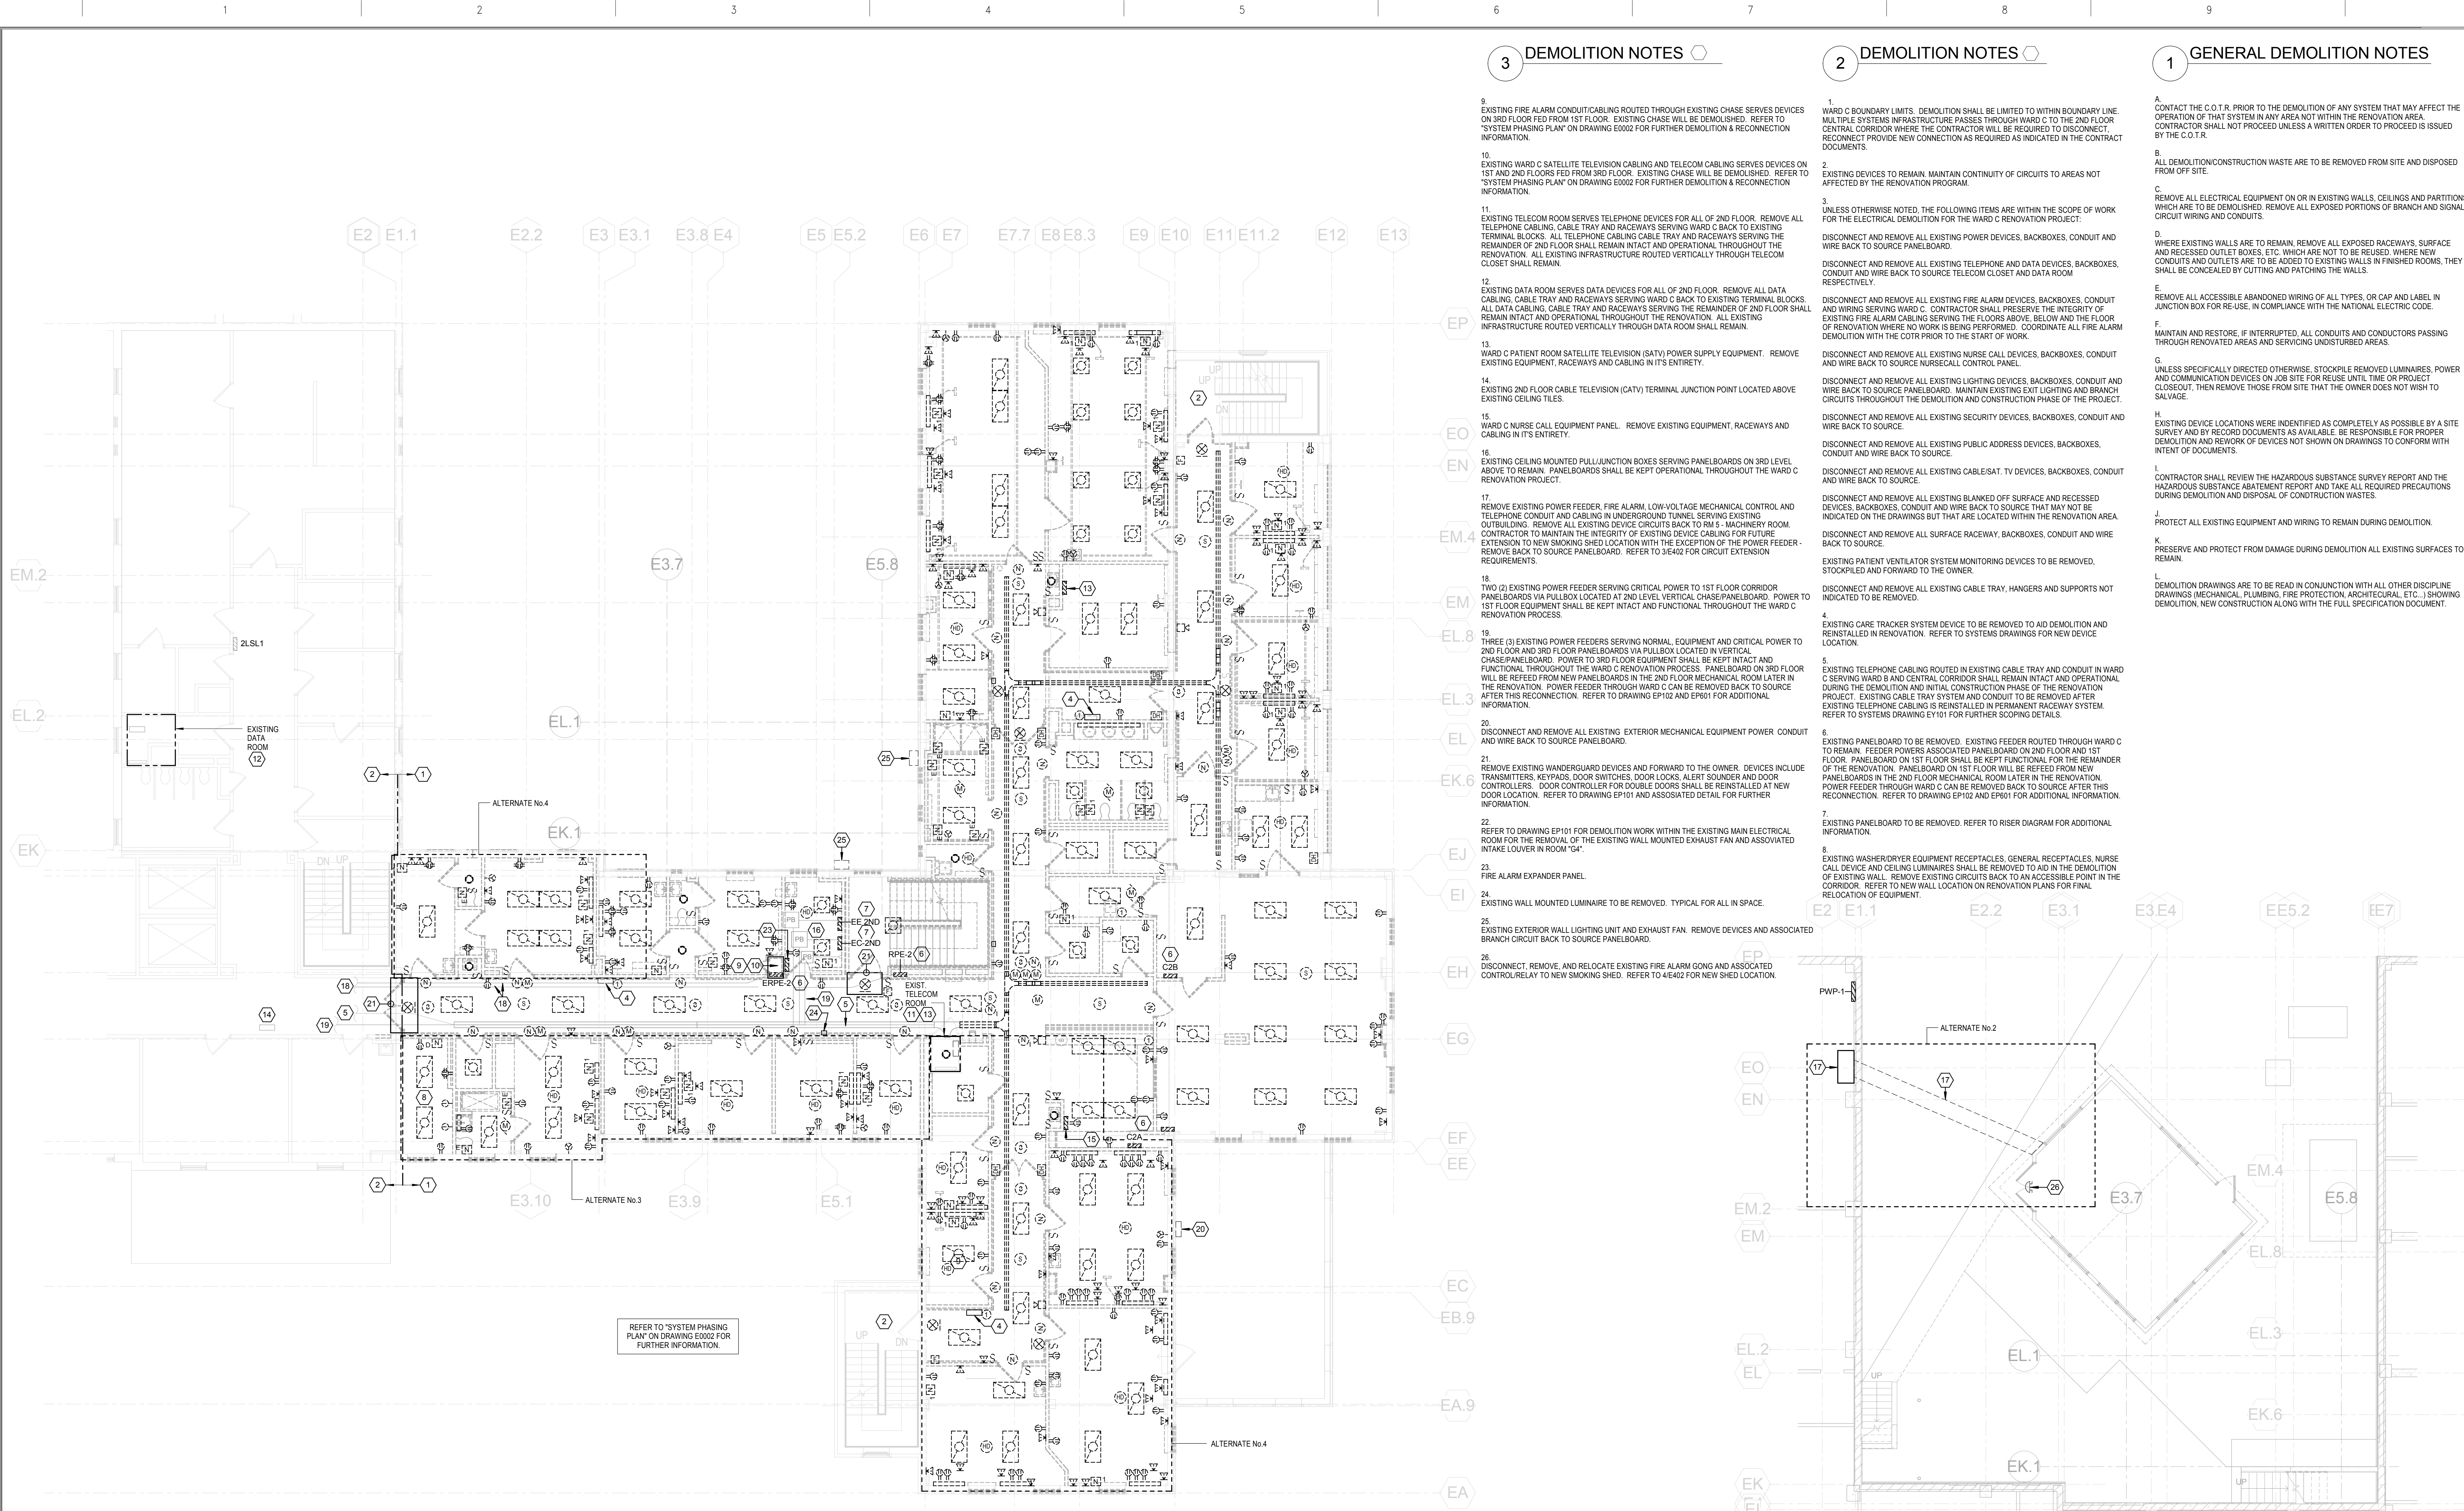

4 SECOND FLOOR - PARTIAL ELECTRICAL DEMOLITION PLAN  
1/8" = 1'-0"

5 GROUND FLOOR - ELECTRICAL DEMOLITION PLAN  
1/8" = 1'-0"

ALTERNATE No. 4	07/01/14
ALTERNATE No. 2 and ALTERNATE No. 3	06/19/14
CONSTRUCTION DOCUMENT - 100% SUBMISSION	07/19/13
CONSTRUCTION DOCUMENT - 90% SUBMISSION	04/05/13
FIRE/LIFE SAFETY REVIEW	03/15/13
DESIGN DEVELOPMENT - 60% SUBMISSION (3RD)	11/09/12
DESIGN DEVELOPMENT - 60% SUBMISSION (2ND)	10/05/12
DESIGN DEVELOPMENT - 60% SUBMISSION (1ST)	08/22/12
SCHEMATIC DESIGN - 30% SUBMISSION	09/09/11
Revisions	Date

VA WESTERN NEW YORK HEALTHCARE SYSTEM  
222 RICHMOND AVE  
BATAVIA, NEW YORK 14020

**CANNON**DESIGN  
2170 Whitehaven Road, Grand Island, New York 14072  
T: 716.773.8800 F: 716.773.5909  
Boston ■ New York ■ Baltimore ■ Washington DC ■ Buffalo  
Toronto ■ Chicago ■ St. Louis ■ Calgary ■ Vancouver  
Victoria ■ San Francisco ■ Los Angeles ■ Shanghai

Architect  
CANNON PROJECT #: 3526.00  
stamp

CARDIOLOGY MANAGER	DATE	ENGINEERING MANAGER	DATE
INFECTION CONTROL	DATE	CARELINE MANAGER	DATE
SAFETY OFFICER	DATE	CHIEF OF STAFF	DATE

Drawing Title <b>PARTIAL DEMOLITION PLAN</b>	Project Title <b>WARD C RENOVATIONS</b>
MEDICAL CENTER DIRECTOR	DATE
ASSOCIATE MEDICAL CENTER DIRECTOR	DATE

Building Number 1	Checked T.G.F.	Drawn D.J.J.
Location V.A.M.C. BATAVIA, NEW YORK		

Date 09/09/11	Station No. 5284
353	ED101



FULLY SPRINKLERED