




- KEYED NOTES:**
- 1 DEMO EXISTING FAN COIL UNIT.
 - 2 DEMO EXISTING HEATING COIL.
 - 3 DEMO EXISTING THERMOSTAT.
 - 4 DEMO EXISTING AIR DEVICES AND DUCTWORK BACK TO FAN COIL UNIT.
 - 5 DEMO EXISTING AIR DEVICE AND BRANCH DUCTWORK BACK TO MAIN.
 - 6 DEMO EXISTING REHEAT COIL.
 - 7 FROM LOBBY DUCTWORK.
 - 8 FROM EXHAUST FAN EF-37.
 - 9 FROM UNIT AC-4.




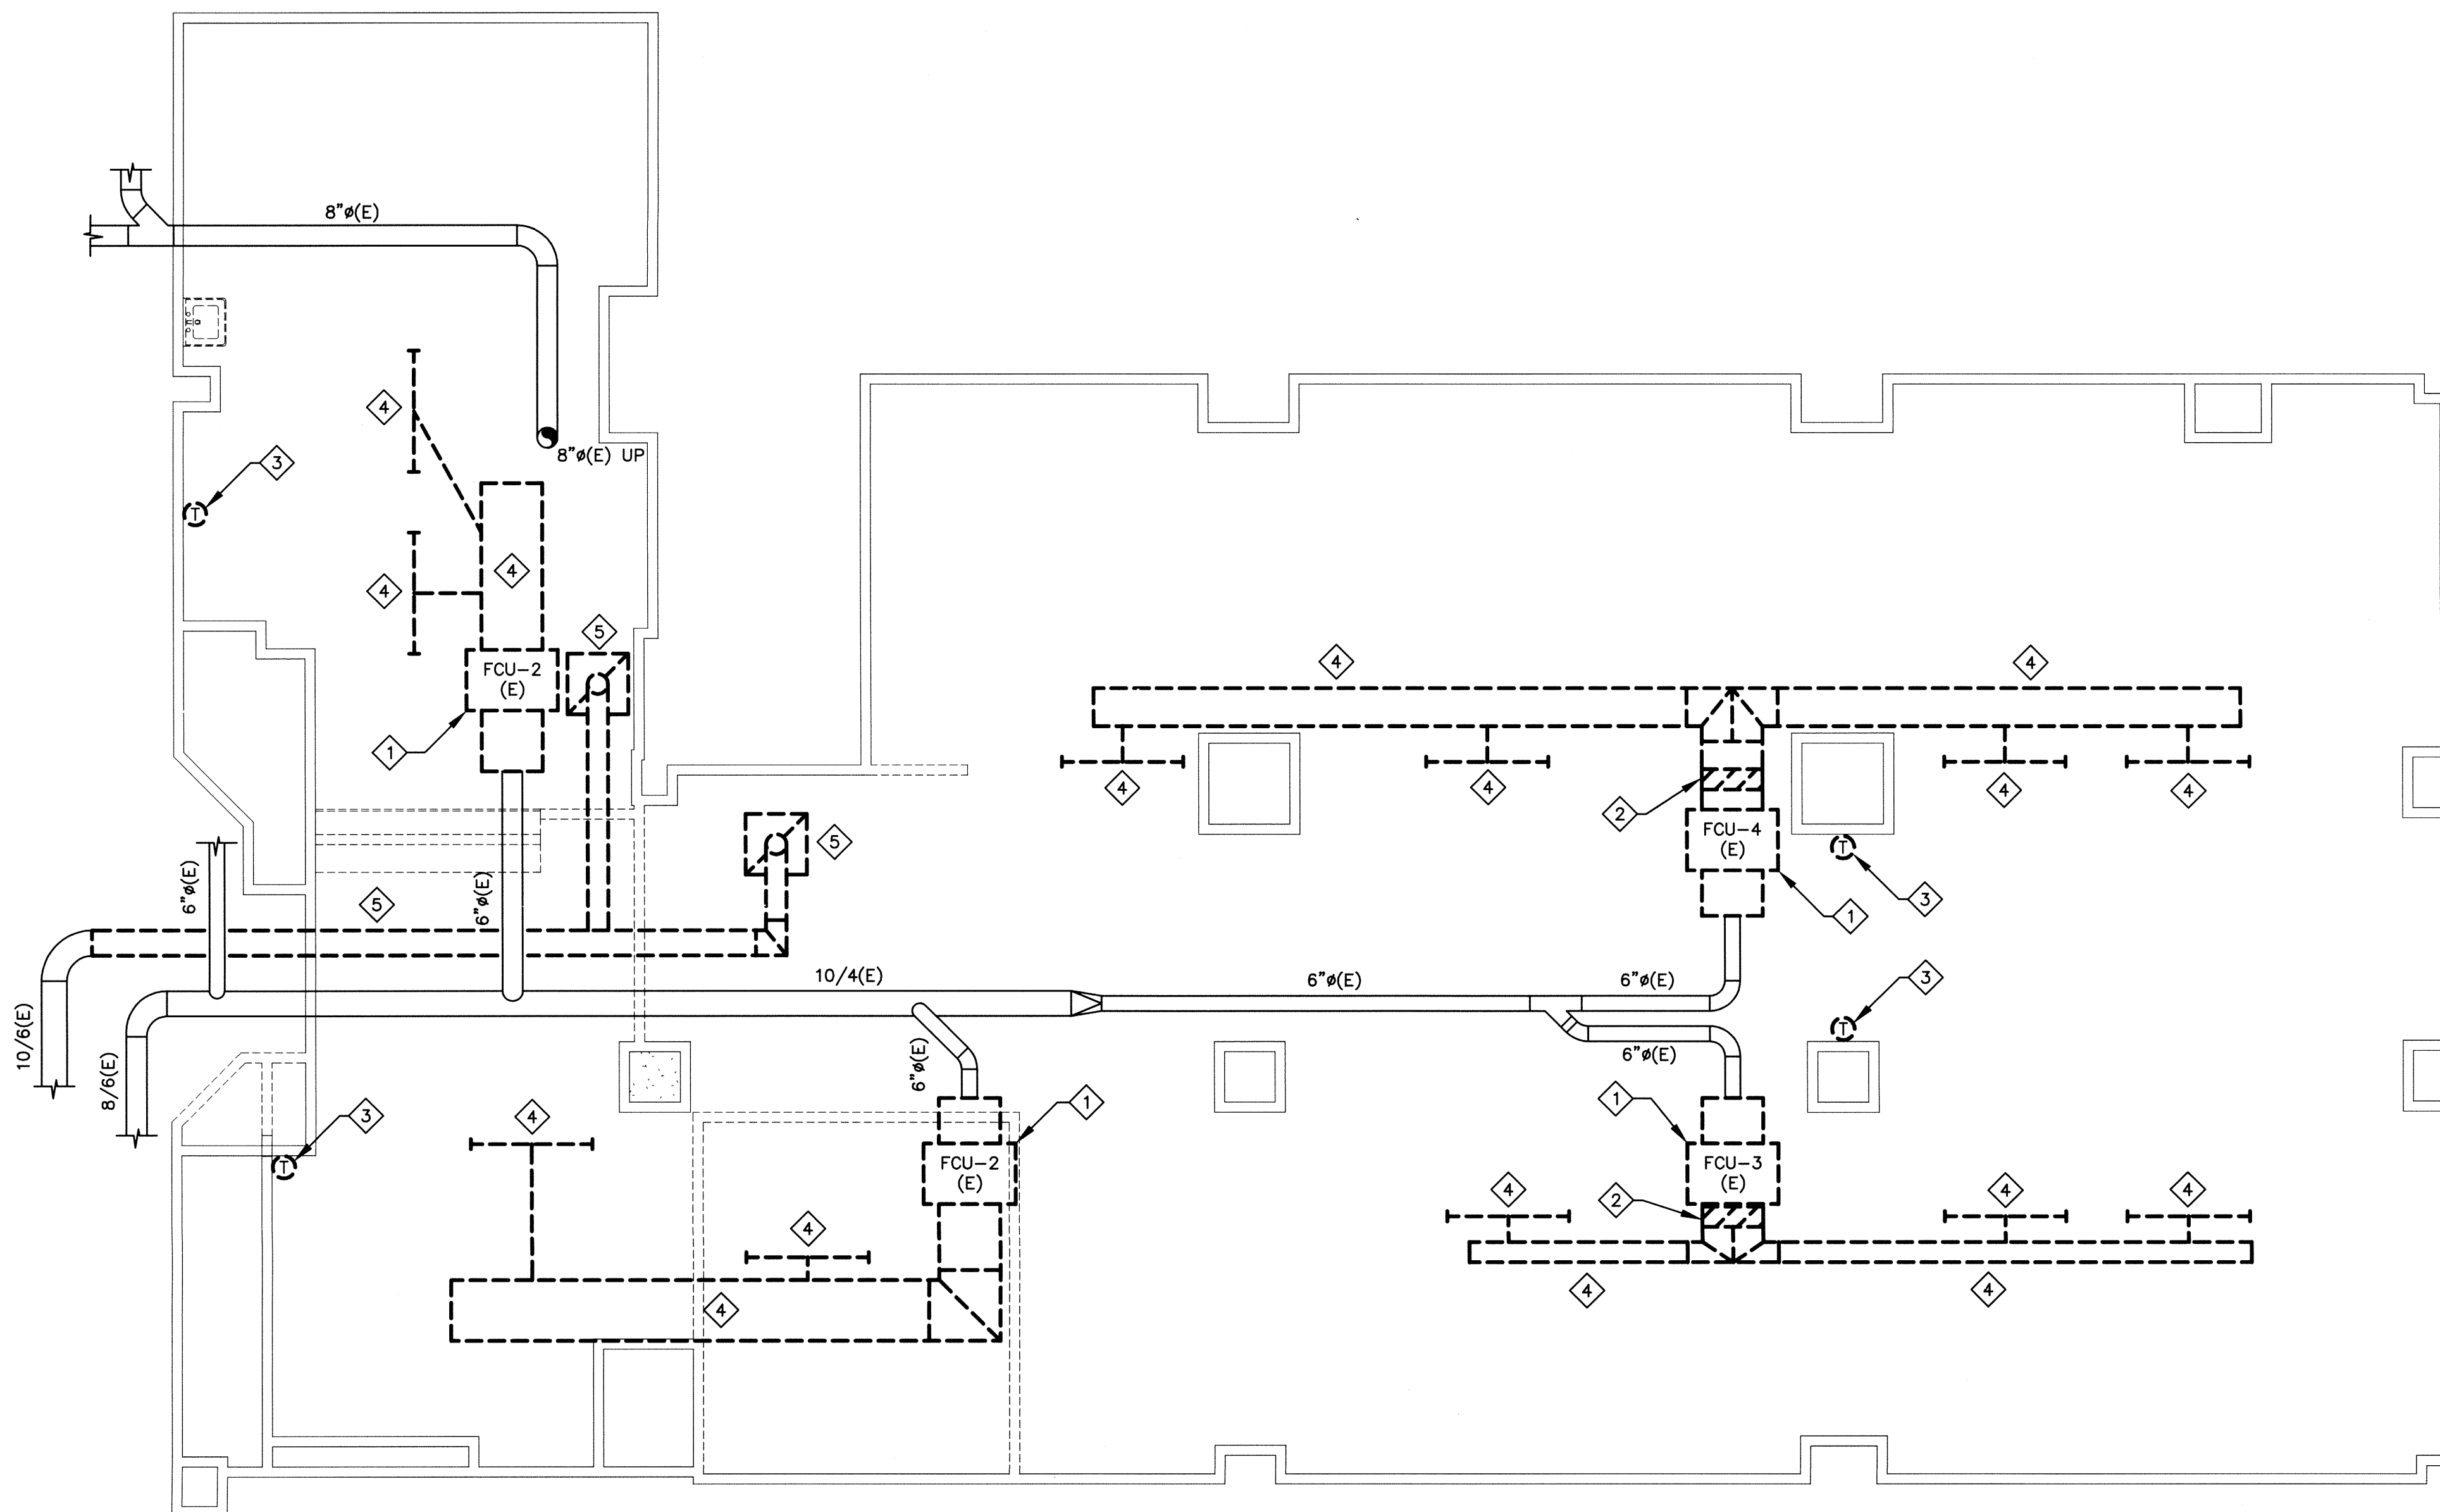

LIBRARY MECHANICAL DEMOLITION PLAN
SCALE: 1/4" = 1'-0"

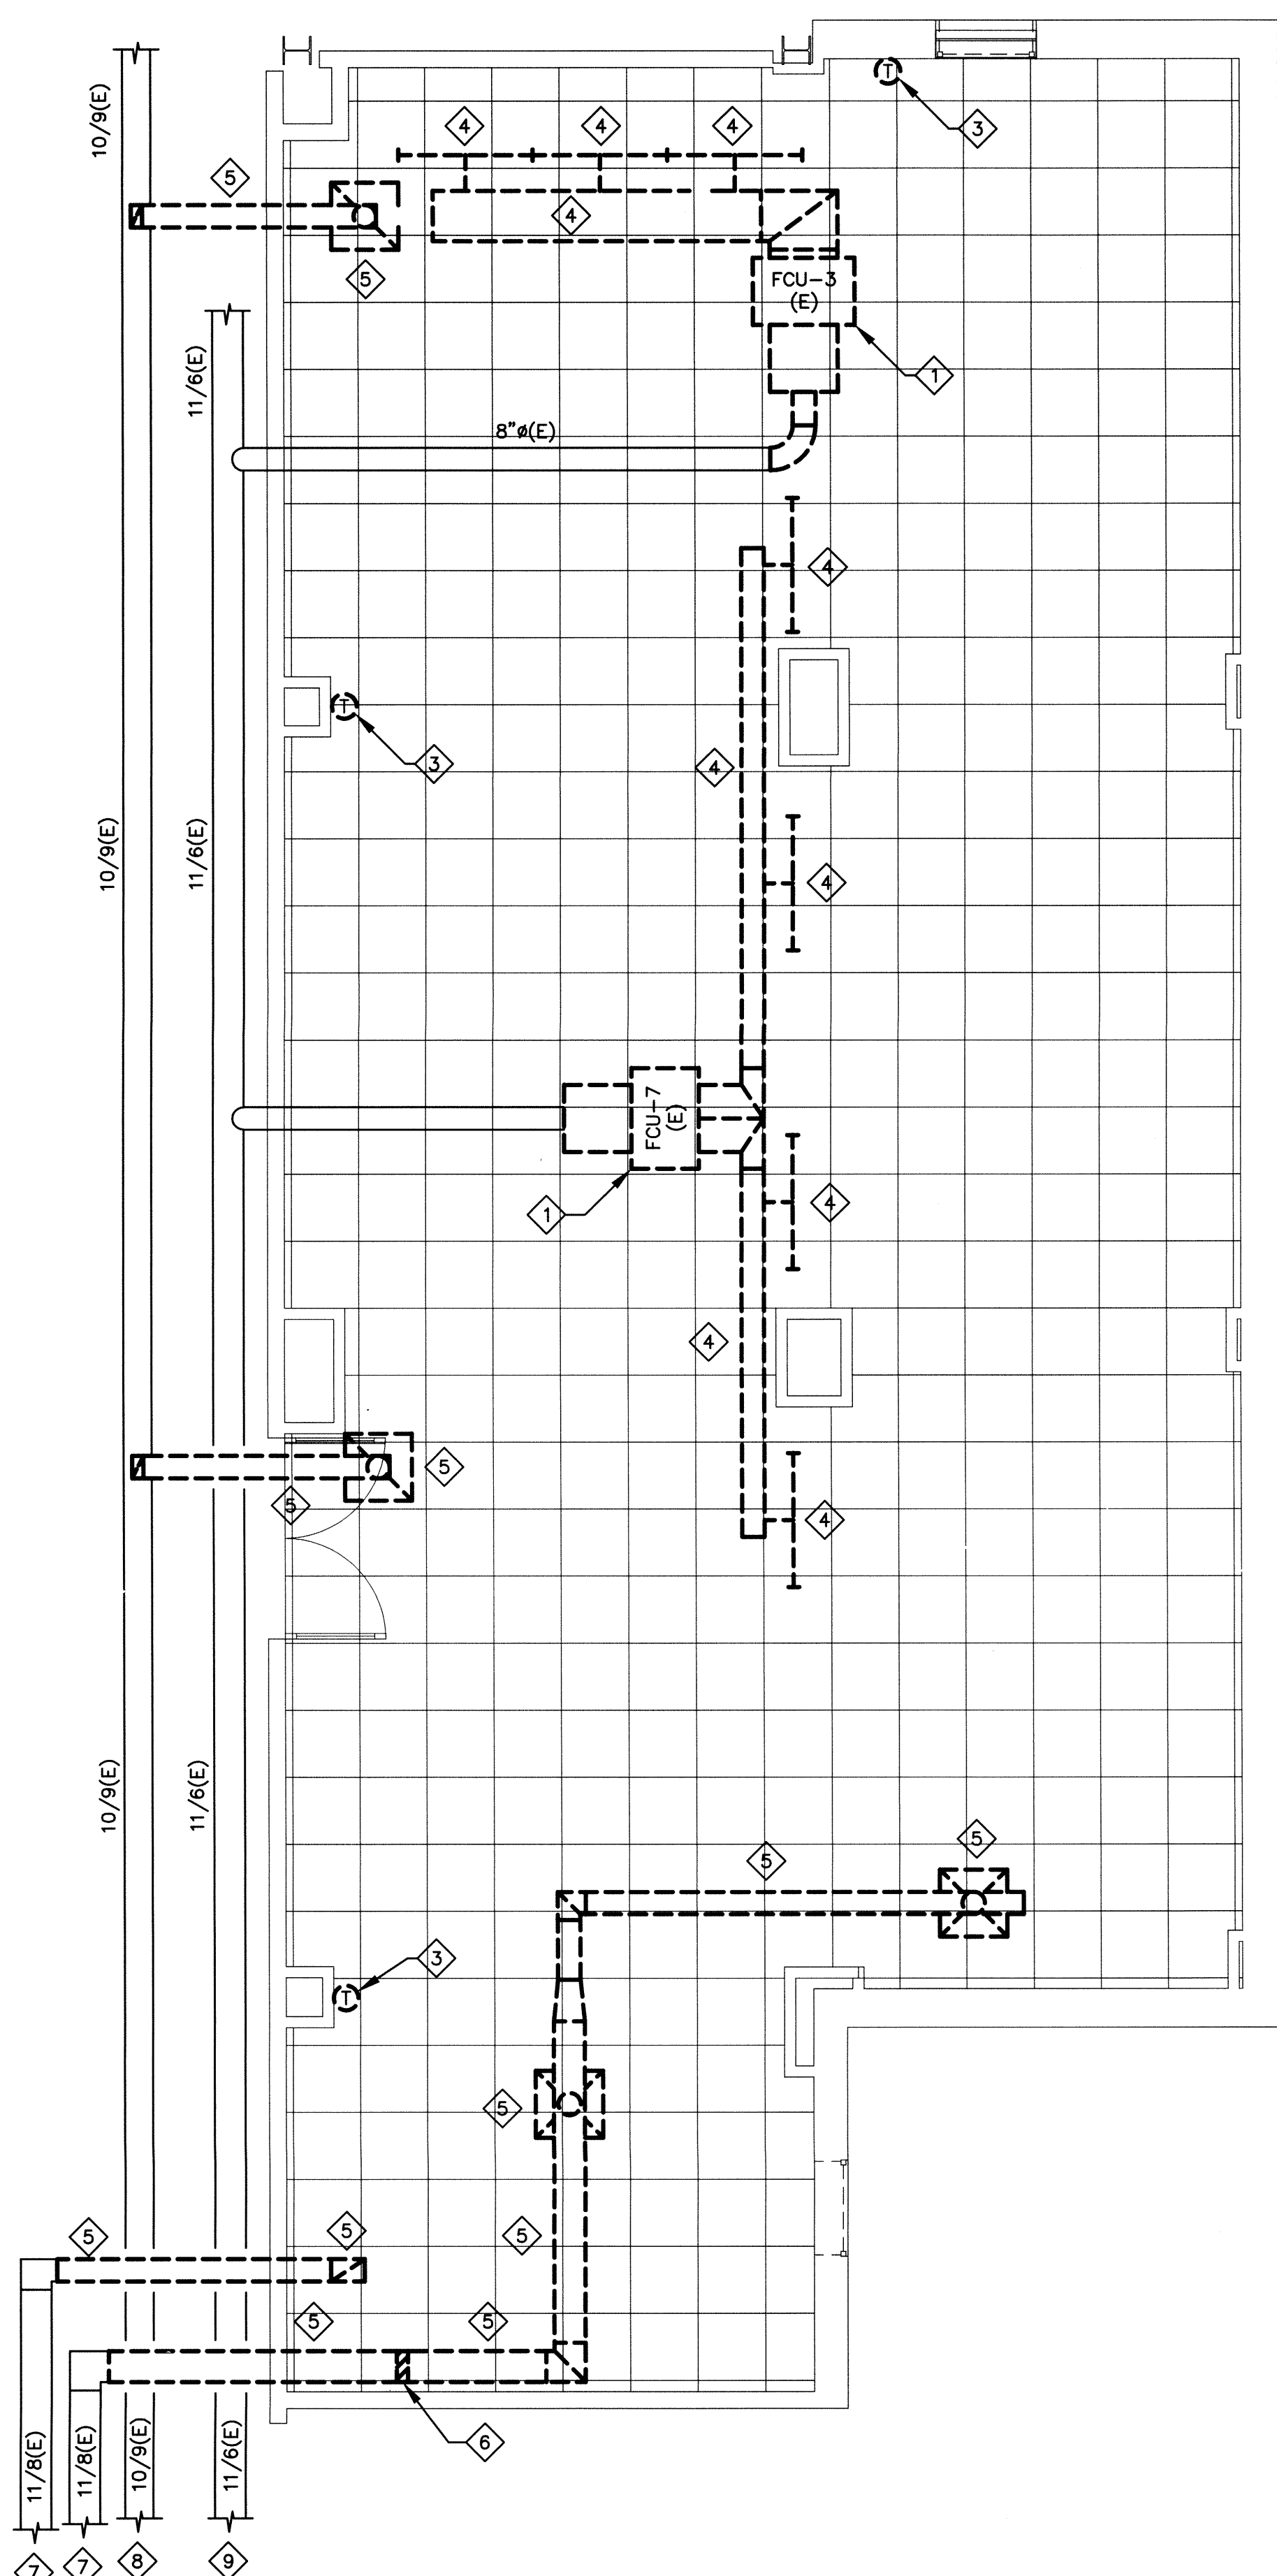

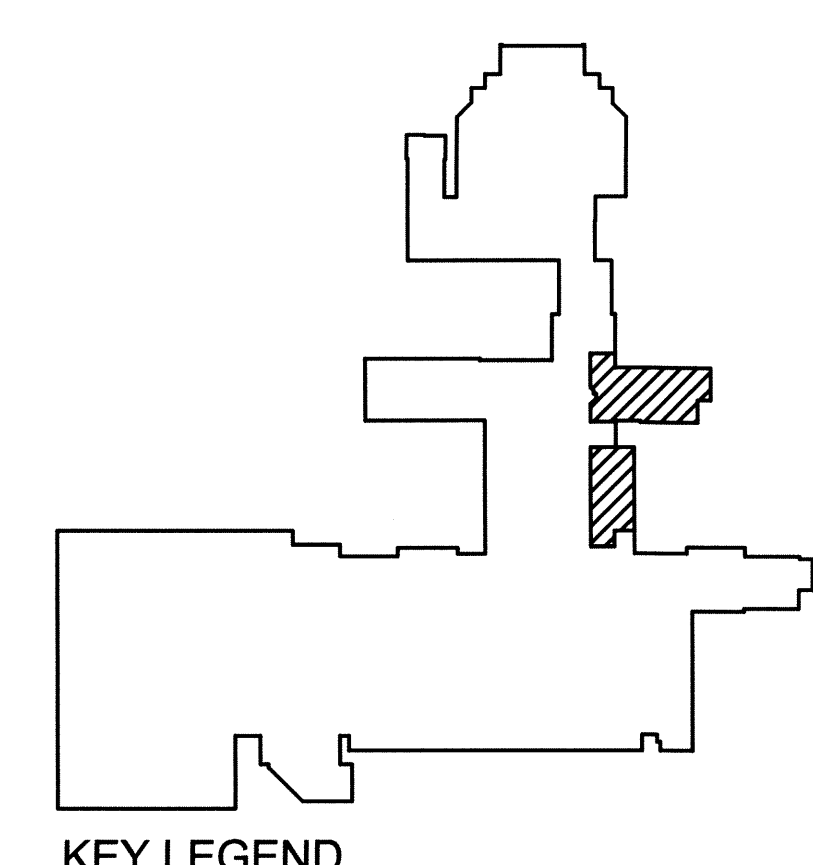CANTEEN MECHANICAL DEMOLITION PLAN
SCALE: 1/4" = 1'-0"



		ARCHITECTS/ENGINEERS/CONSULTANTS:						Drawing Title MECHANICAL DEMOLITION PLANS		Project Title CANTEEN AND LIBRARY		Project Number 635-12-314		Office of Construction and Facilities Management 			
		ARCHITECT SPUR DESIGN, LLC 7700 NORTH HUDSON AVE SUITE 9 OKLAHOMA CITY, OK 73116		MEP ENGINEER PROJECT SOLUTIONS 2005 W. BROADWAY SUITE 210 COLUMBIA, MO 65203		STRUCTURAL ENGINEER SPUR DESIGN, LLC 7700 NORTH HUDSON AVE SUITE 9 OKLAHOMA CITY, OK 73116		Medical Center Director		Location OKLAHOMA CITY VAMC		Building Number					
100% Construction Documents												Drawing Number					
95% Construction Documents		03/14/2014															
65% Design Development		03/22/2013															
35% Schematic Design		09/24/2012															
Revisions:										Date 04/28/2014		Checked KLS		Drawn MDW		M-100	

A

B


C

D


E

F

G

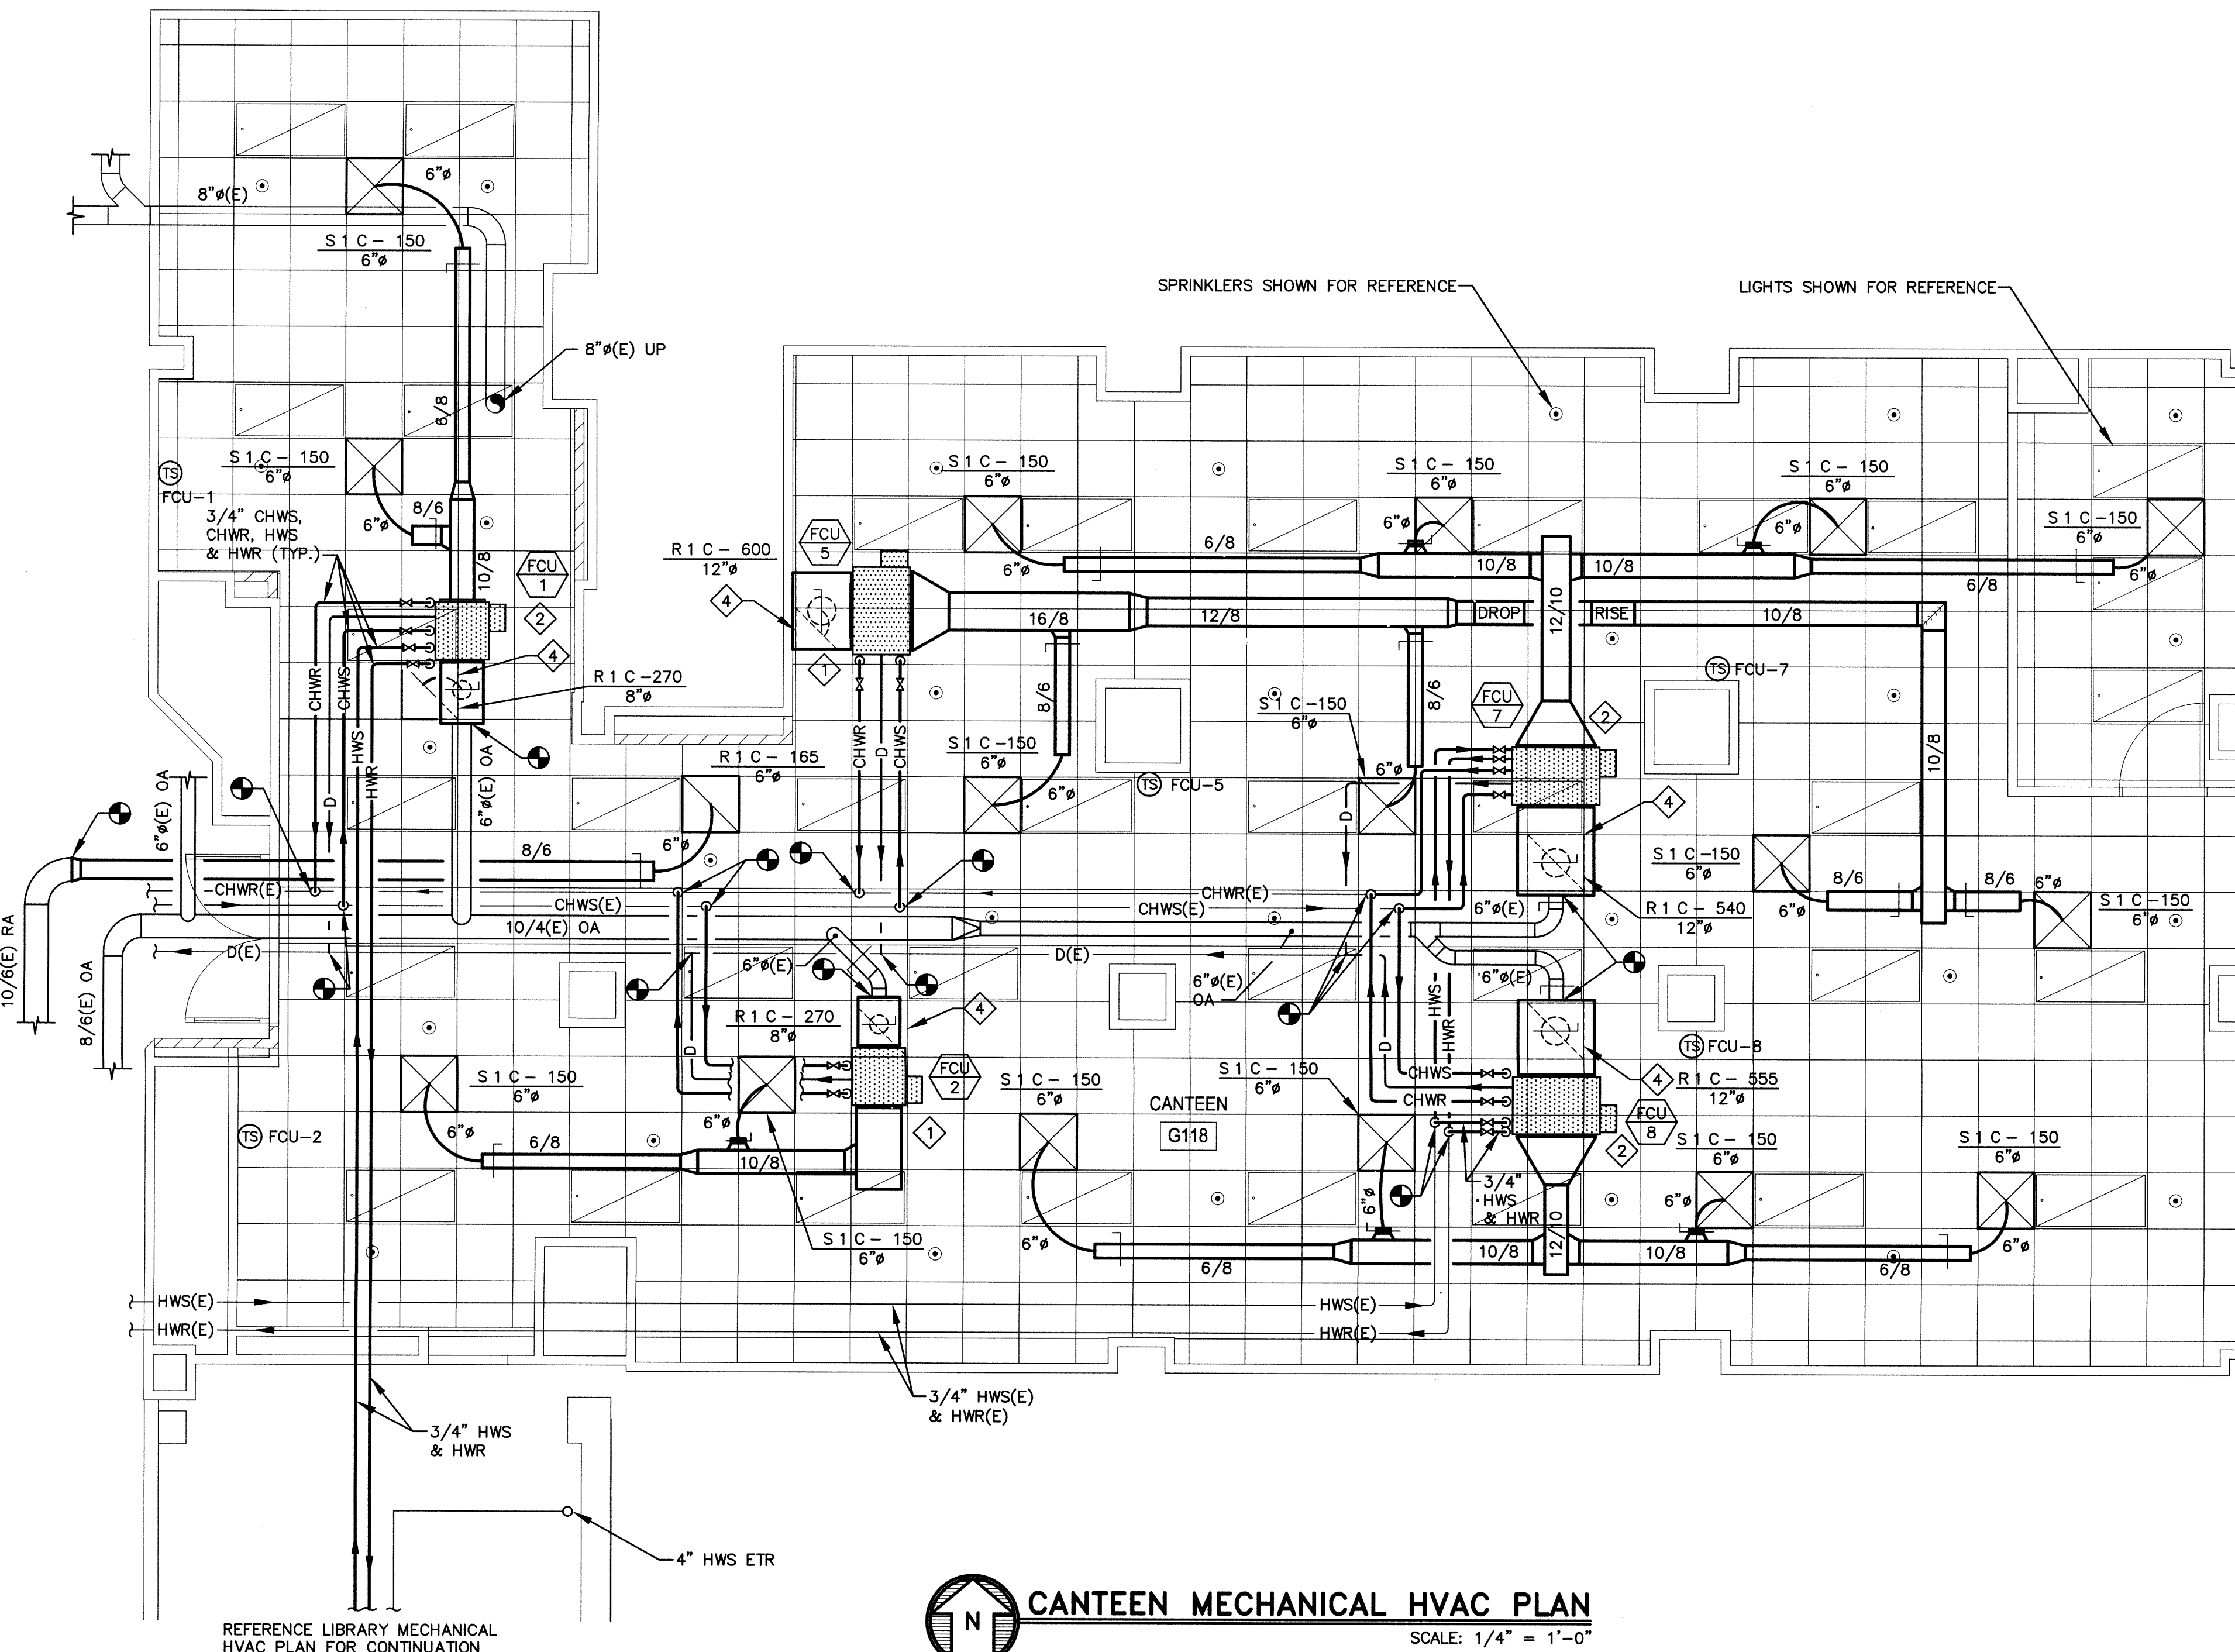


CANTEEN MECHANICAL HVAC PLAN
SCALE: 1/4" = 1'-0"

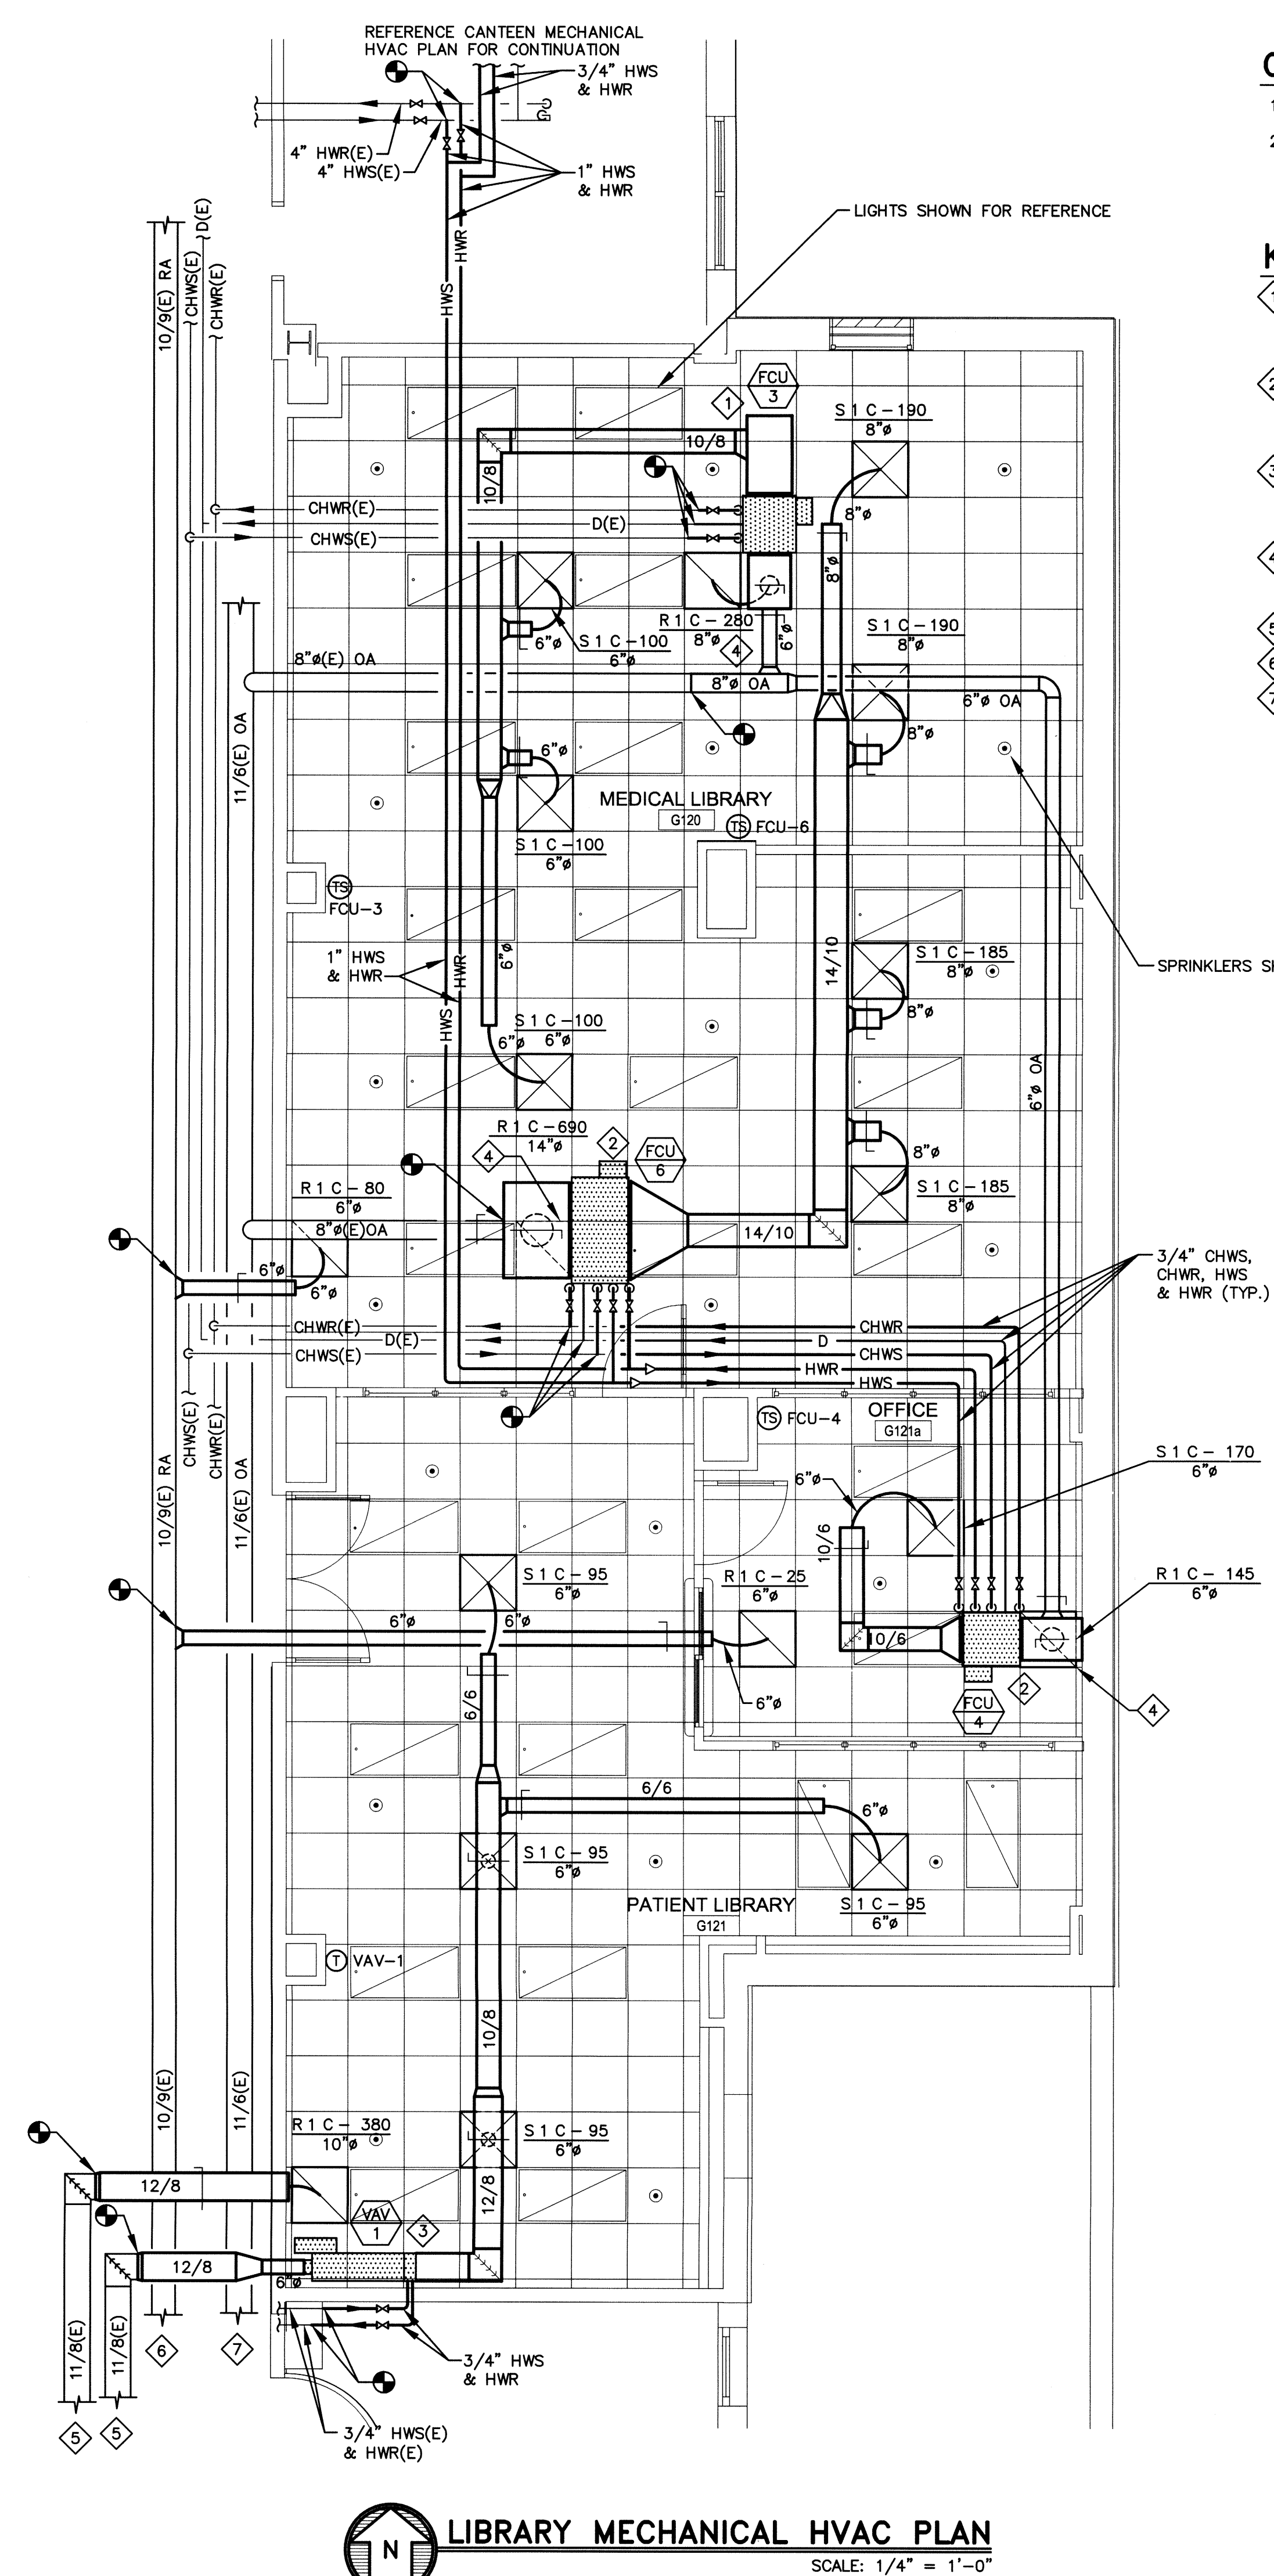

LIBRARY MECHANICAL HVAC PLAN
SCALE: 1/4" = 1'-0"

- GENERAL NOTES:**
- SEE SHEET M501 FOR ALL APPLICABLE DETAILS.
 - ADD BALANCE DAMPERS TO EXISTING OA DUCTWORK AT NEW FAN COIL UNITS FOR BALANCING OA CFM TO MATCH SCHEDULED VALUES LISTED ON M502.
- KEYED NOTES:**
- NEW FAN COIL UNIT. SEE SCHEDULE ON SHEET M502. CONNECT NEW CHILLED WATER LINES, CONDENSATE DRAIN LINES, VALVES, ETC. TO EXISTING LINES. SEE DETAIL 1 ON SHEET M501. CONNECT TO EXISTING DDC CONTROL SYSTEM.
 - NEW FAN COIL UNIT. SEE SCHEDULE ON SHEET M502. CONNECT NEW CHILLED WATER LINES, CONDENSATE DRAIN LINES, HOT WATER LINES, VALVES, ETC. TO EXISTING LINES. SEE DETAIL 2 ON SHEET M501. CONNECT TO EXISTING DDC CONTROL SYSTEM.
 - NEW VAV BOX. SEE SCHEDULE ON SHEET M502. CONNECT NEW HOT WATER LINES, VALVES, ETC. FROM VAV BOX TO EXISTING HOT WATER LINES. SEE DETAIL 3 ON SHEET M501. CONNECT TO EXISTING DDC CONTROL SYSTEM.
 - NEW RETURN GRILLE FOR FAN COIL UNIT. POSITION GRILLE IN NEW CEILING GRID. RUN FLEX FROM BOTTOM OF FCU RA/OA PLENUM TO GRILLE.
 - FROM LOBBY DUCTWORK.
 - FROM EXHAUST FAN EF-37.
 - FROM UNIT AC-4.

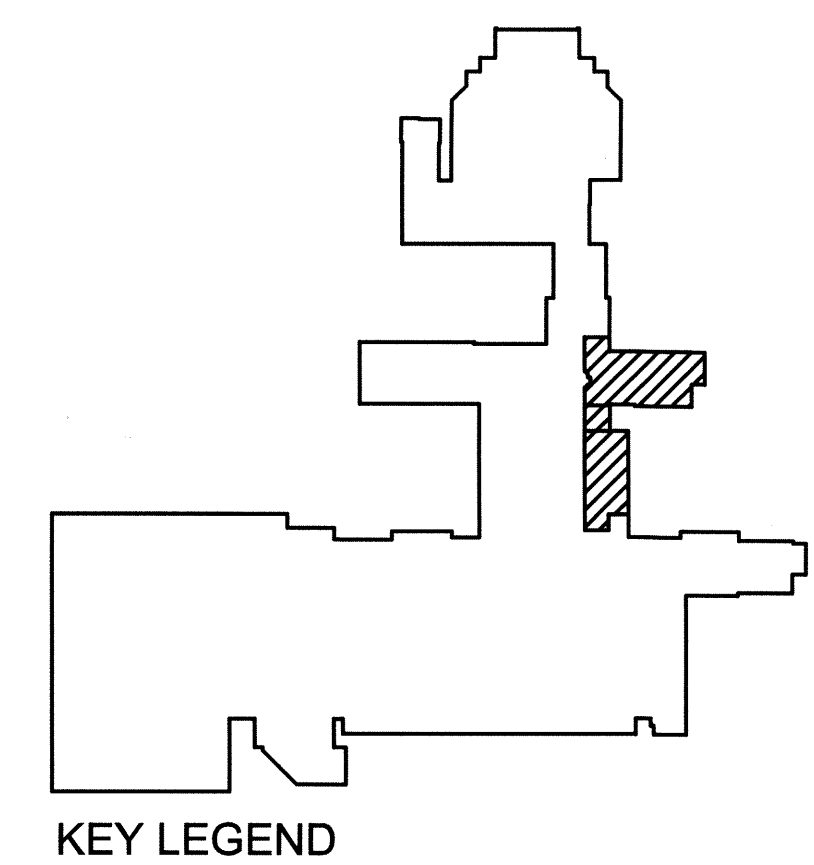

ARCHITECTS/ENGINEERS/CONSULTANTS:			
<div>100% Construction Documents</div> <div>50% Construction Documents</div> <div>65% Design Development</div> <div>35% Schematic Design</div> <div>Revisions:</div>	ARCHITECT SPUR DESIGN, LLC 7700 NORTH HUDSON AVE SUITE 9 OKLAHOMA CITY, OK 73116		MEP ENGINEER PROJECT SOLUTIONS 2005 W. BROADWAY SUITE 210 COLUMBIA, MO 65203
	STRUCTURAL ENGINEER SPUR DESIGN, LLC 7700 NORTH HUDSON AVE SUITE 9 OKLAHOMA CITY, OK 73116		SPUR DESIGN, LLC 7700 NORTH HUDSON AVE SUITE 9 OKLAHOMA CITY, OK 73116



SPUR DESIGN

7700 NORTH HUDSON, SUITE 9
OKLAHOMA CITY, OK 73116
PHONE: 405.842.0100
WWW.SPUR-DESIGN.COM

Drawing Title MECHANICAL HVAC PLANS		Project Title CANTEEN AND LIBRARY		Project Number 635-12-314	
Medical Center Director		Location OKLAHOMA CITY VAMC		Building Number	
Chief Engineer		Date 04/28/2014	Checked KLS	Drawn MDW	Drawing Number M-101
Office of Construction and Facilities Management Department of Veterans Affairs					

A

B


C

D


E

F


G

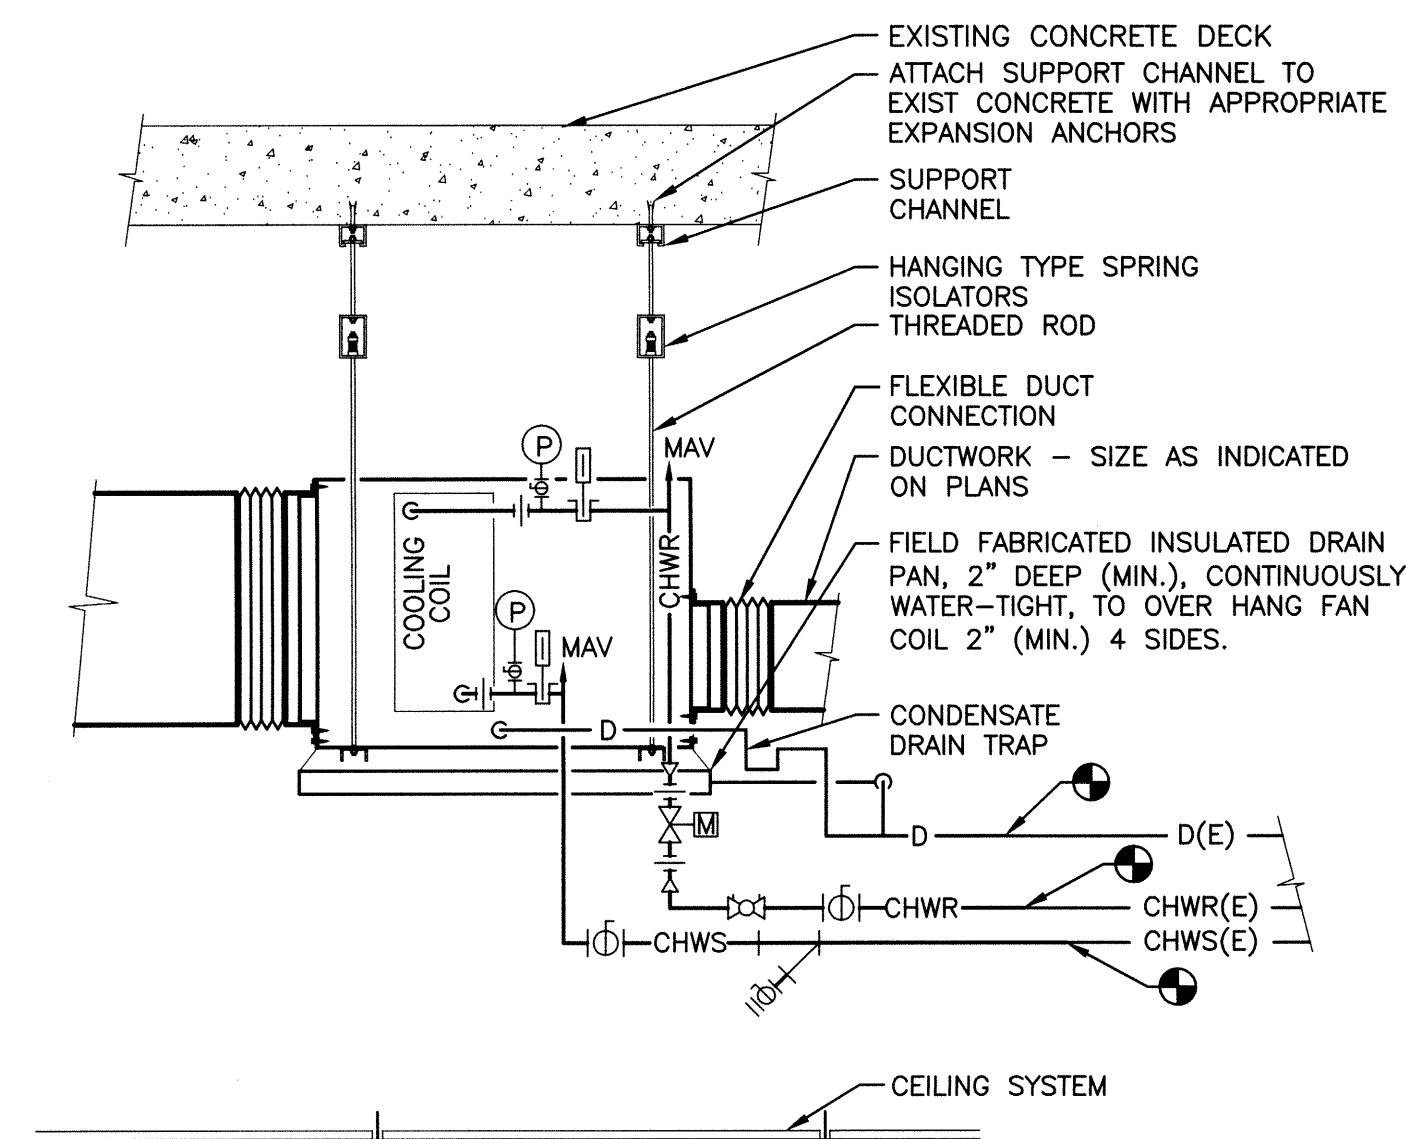


2- PIPE FAN COIL INSTALLATION DETAIL
SCALE: NONE

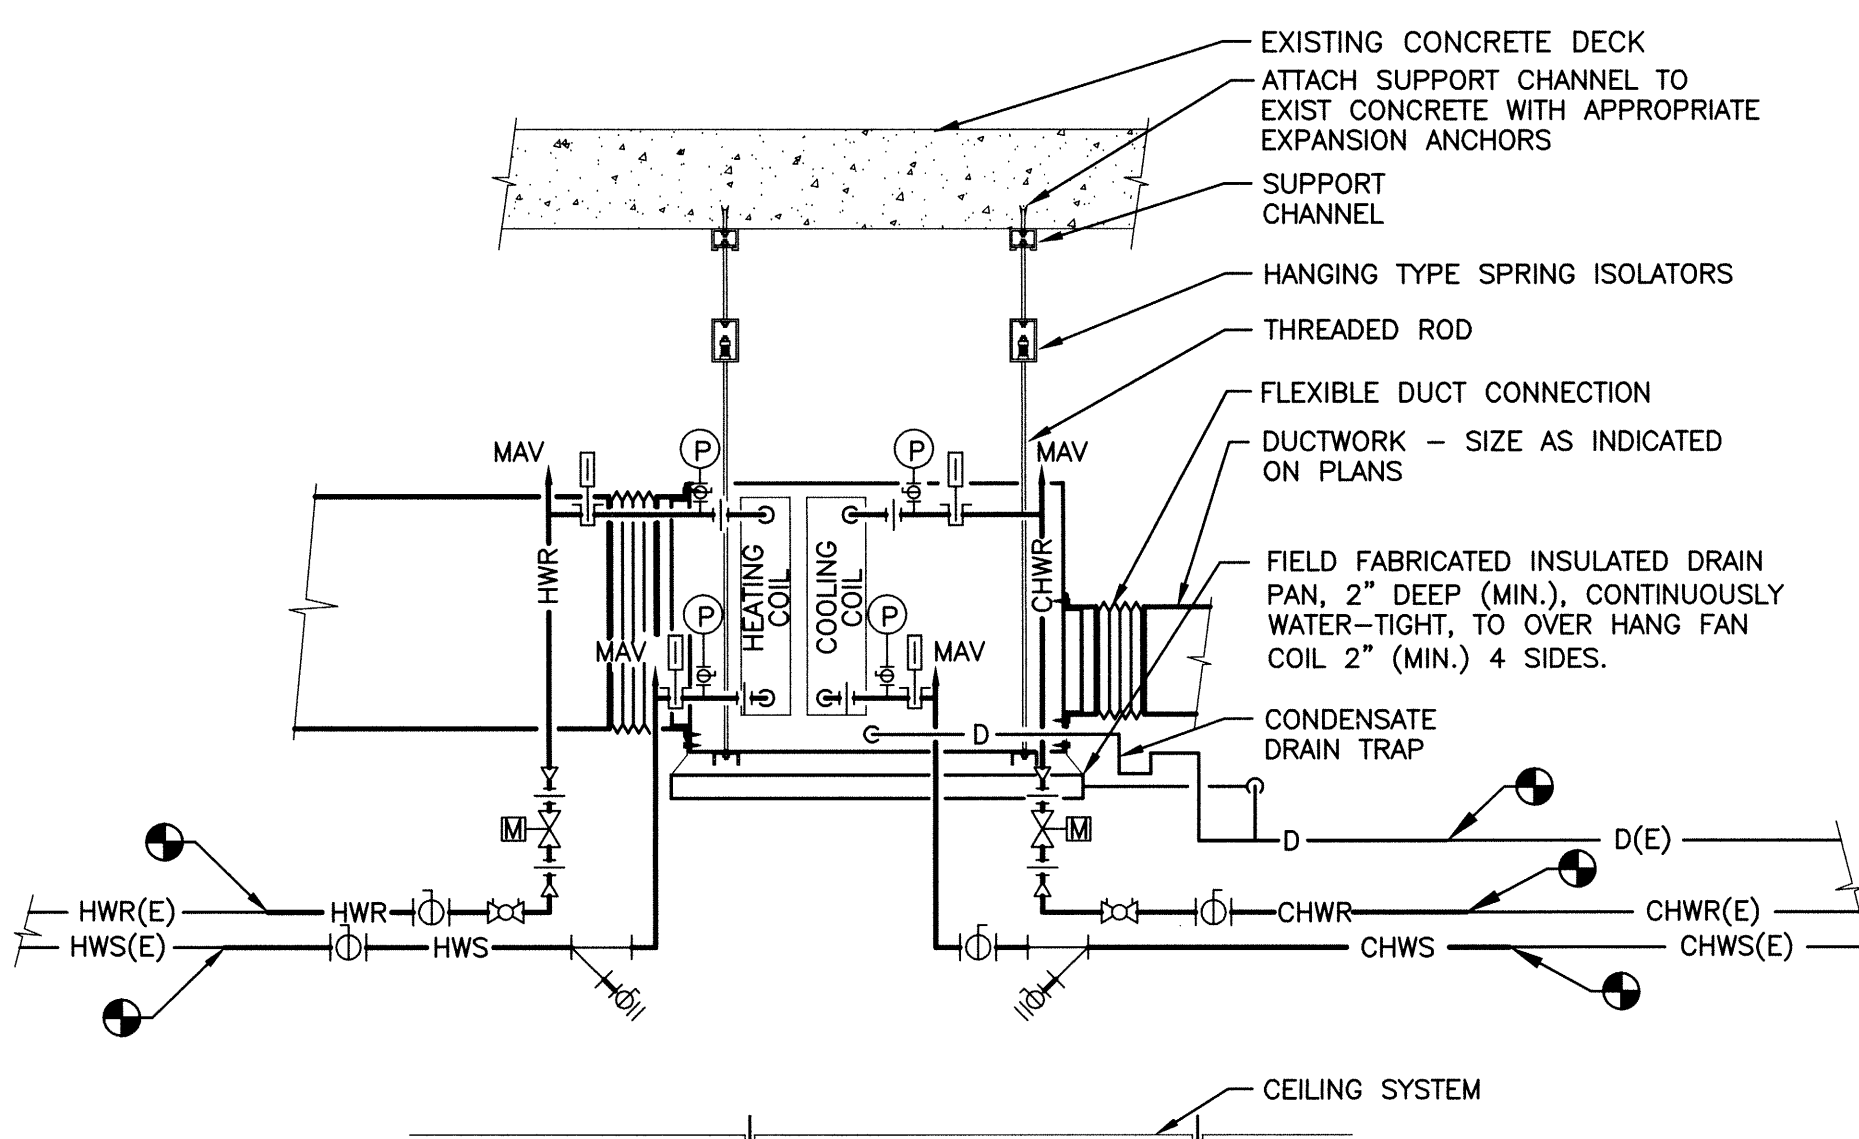

4- PIPE FAN COIL INSTALLATION DETAIL
SCALE: NONE

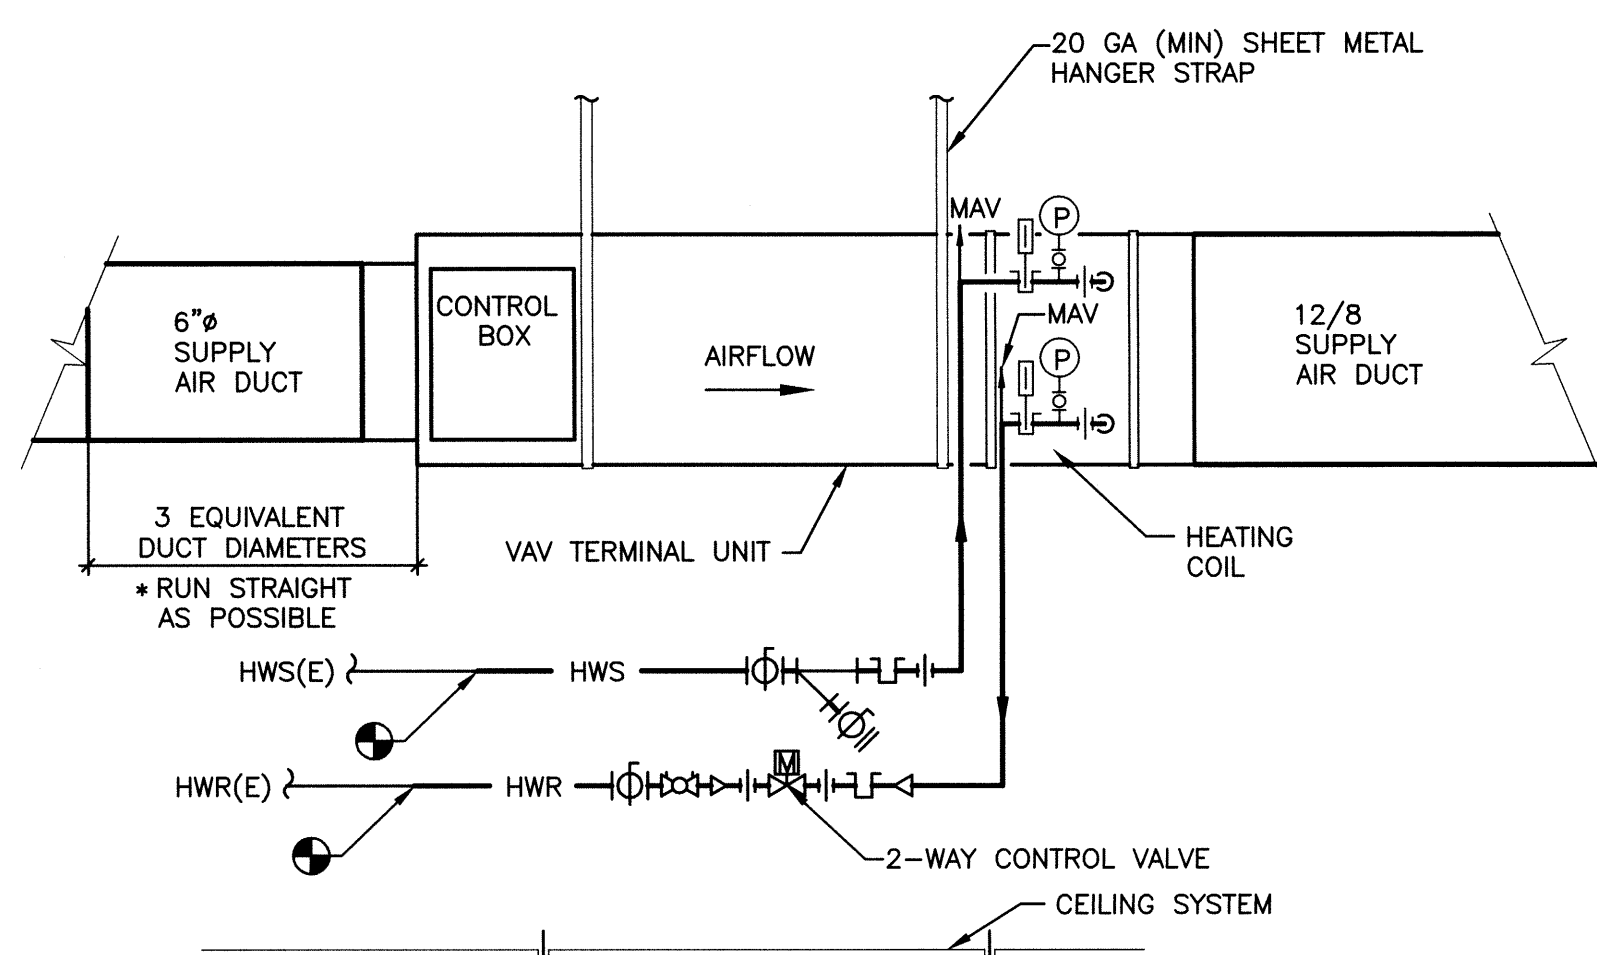


3 VAV TERMINAL UNIT INSTALLATION DETAIL
SCALE: NONE

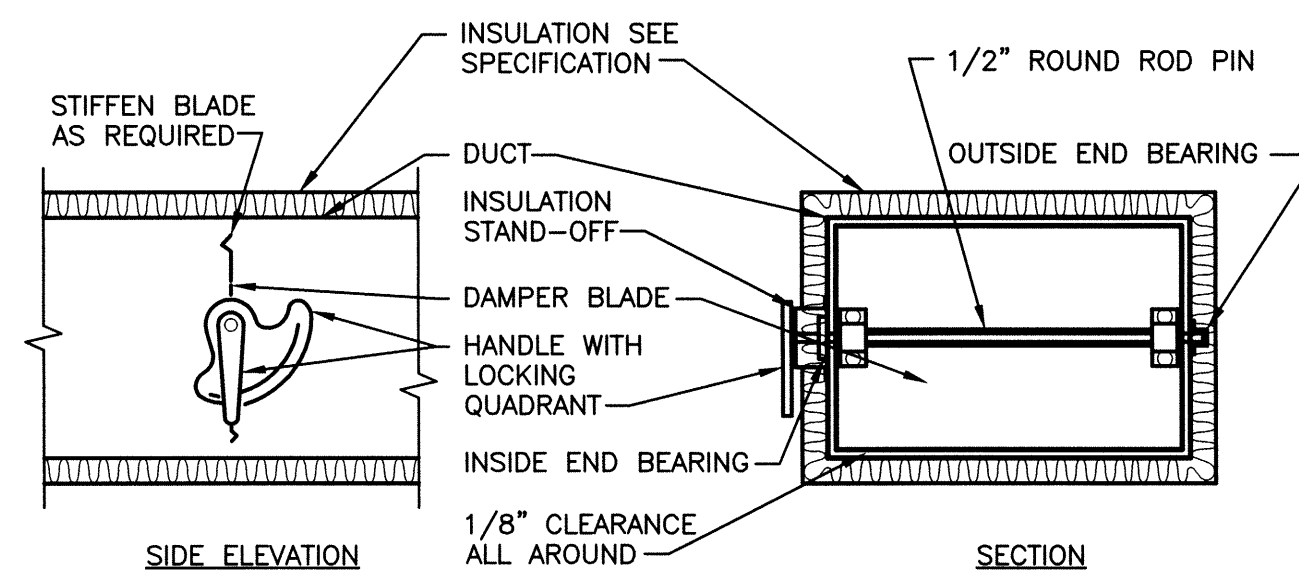


NOTE:
1. DELETE INSULATION STAND-OFF ON DUCTWORK WITHOUT EXTERIOR INSULATION.
2. DETAIL SHOWS SINGLE BLADE DAMPER. DAMPER INSTALLATION SHALL BE SIMILAR FOR MULTI-BLADE DAMPERS & ROUND DAMPERS.


4 VOLUME DAMPER DETAIL
SCALE: NONE

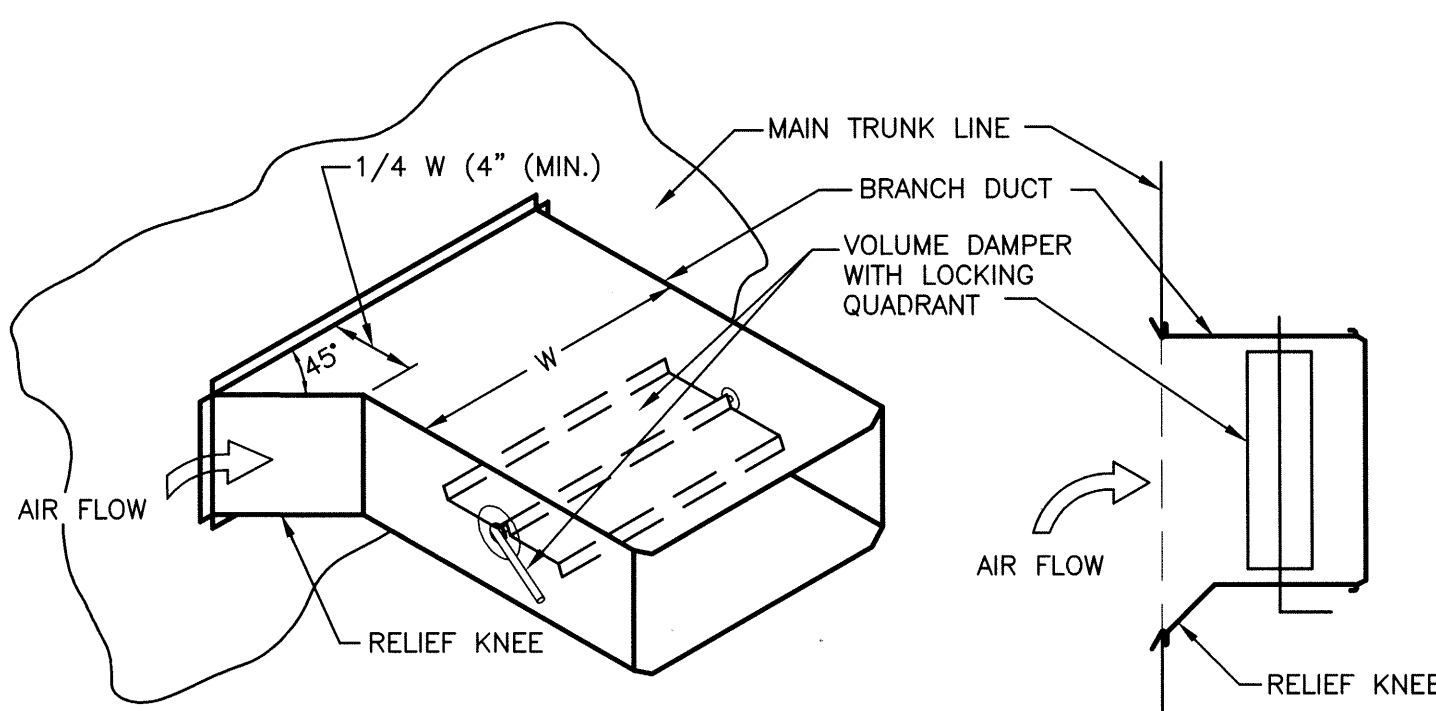


5 RECTANGULAR BRANCH DUCT TAKEOFF DETAIL
SCALE: NONE

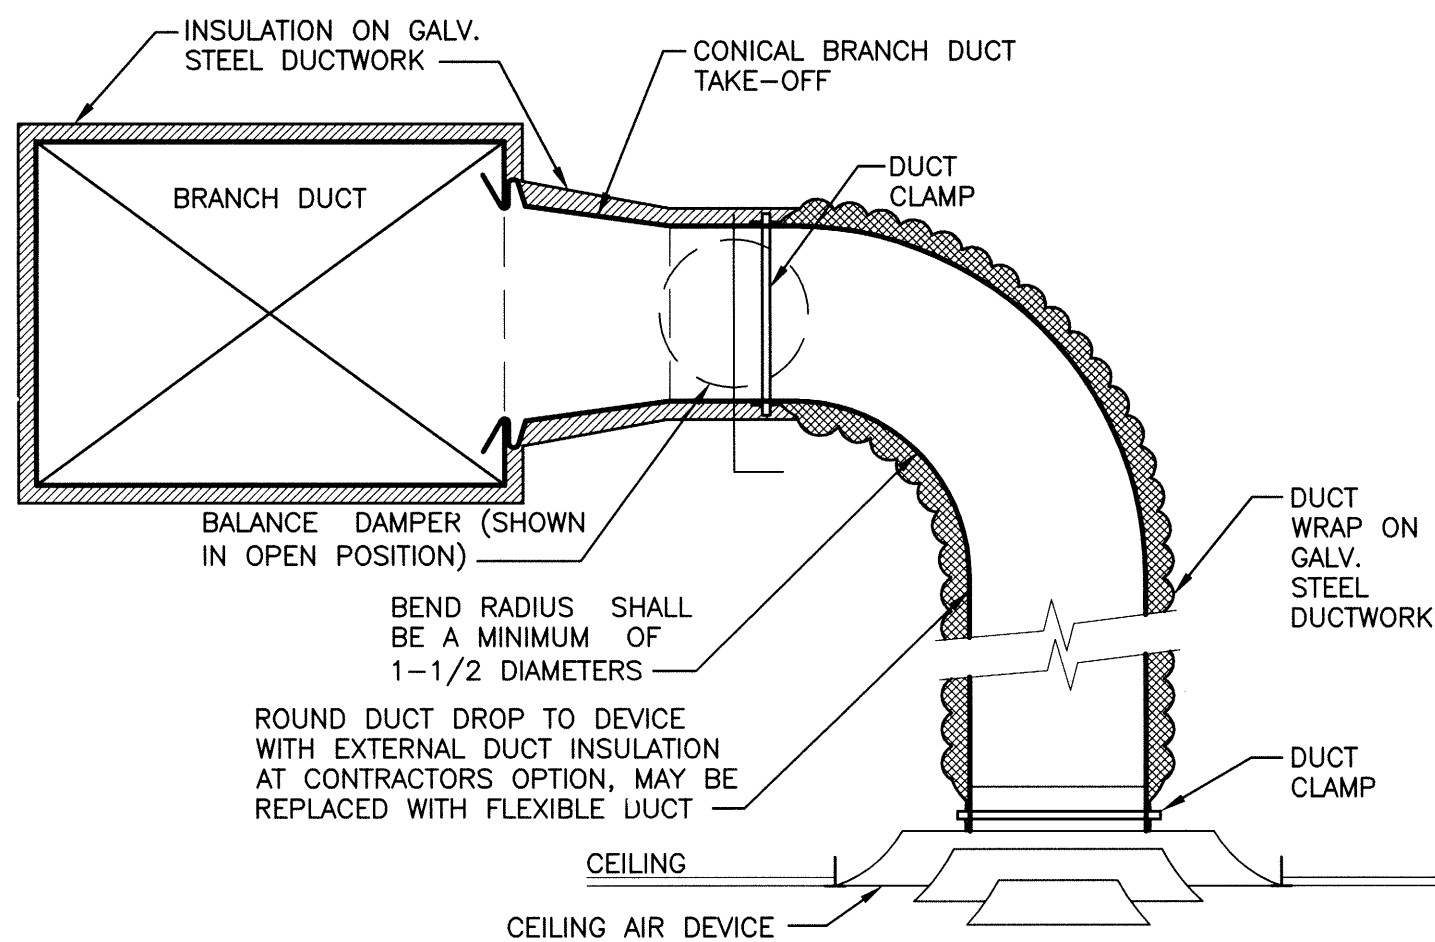


6 LAY-IN AIR DEVICE INSTALLATION DETAIL
SCALE: NONE

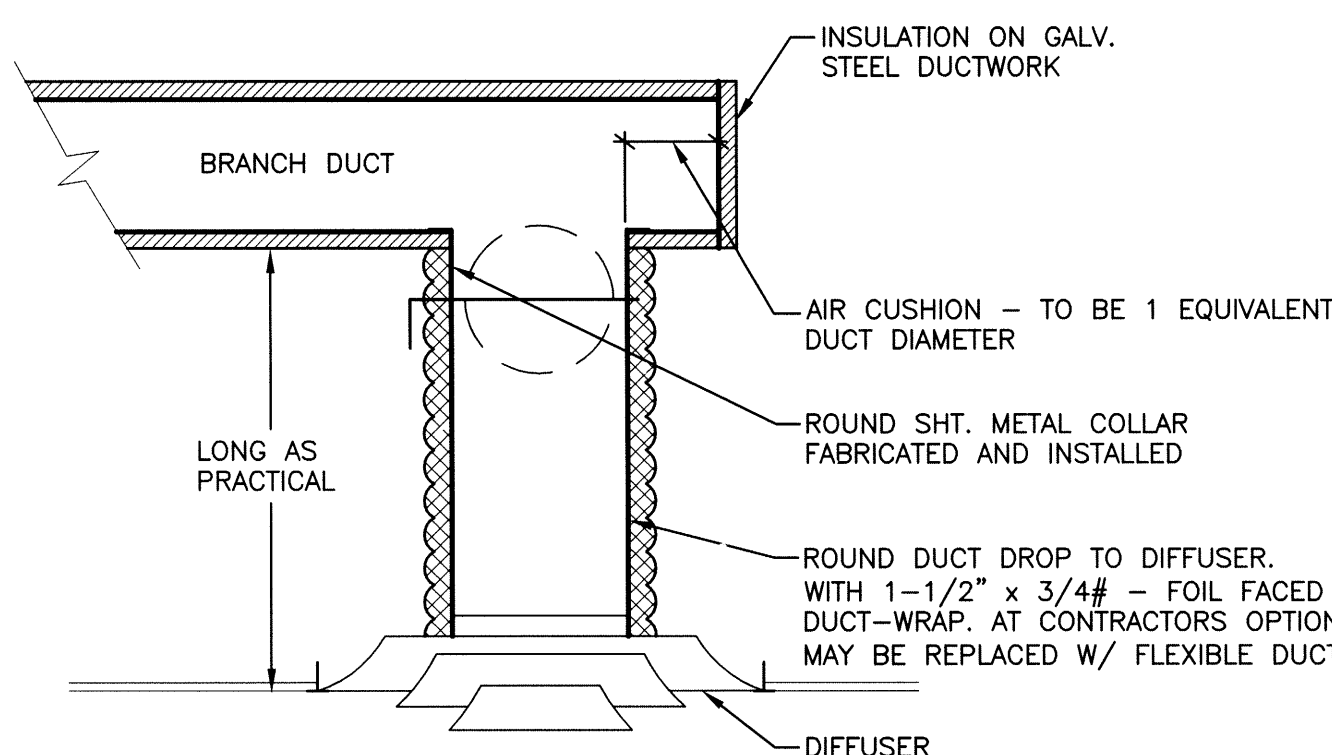


7 LAY-IN DIFFUSER MOUNTING DETAIL
SCALE: NONE

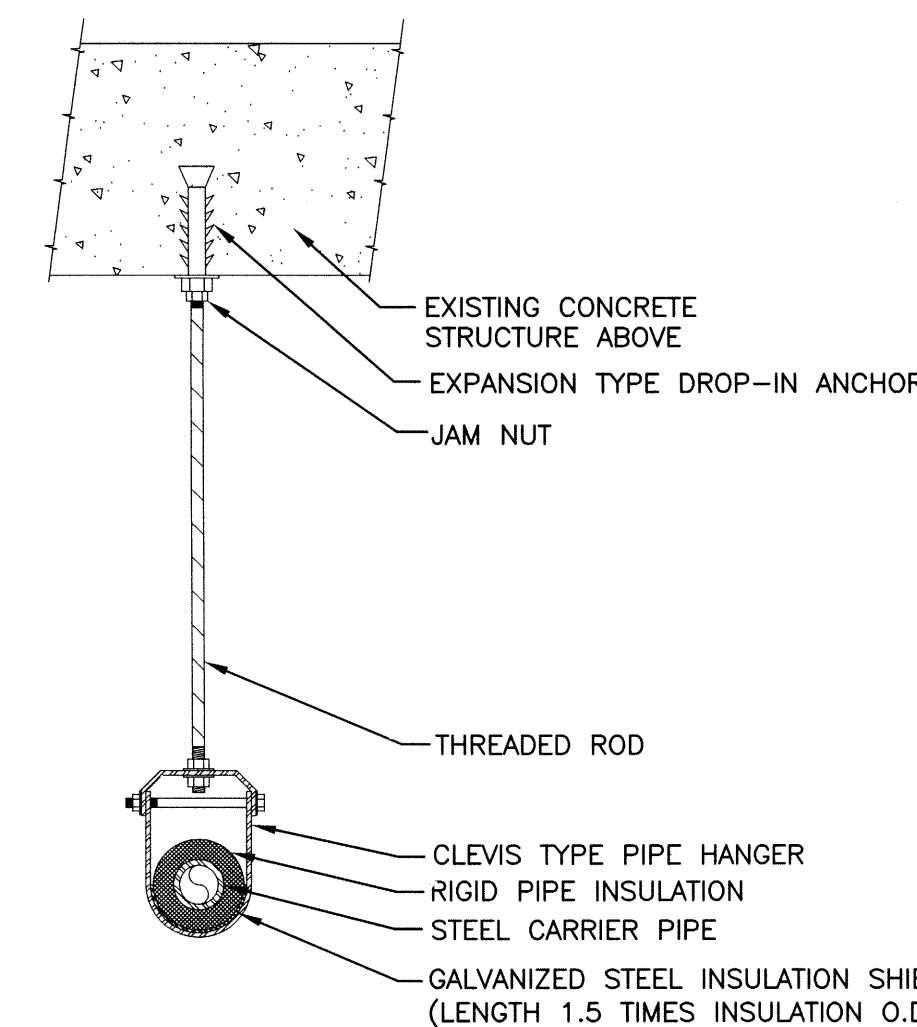

8 CLEVIS TYPE PIPE HANGER DETAIL
SCALE: NONE

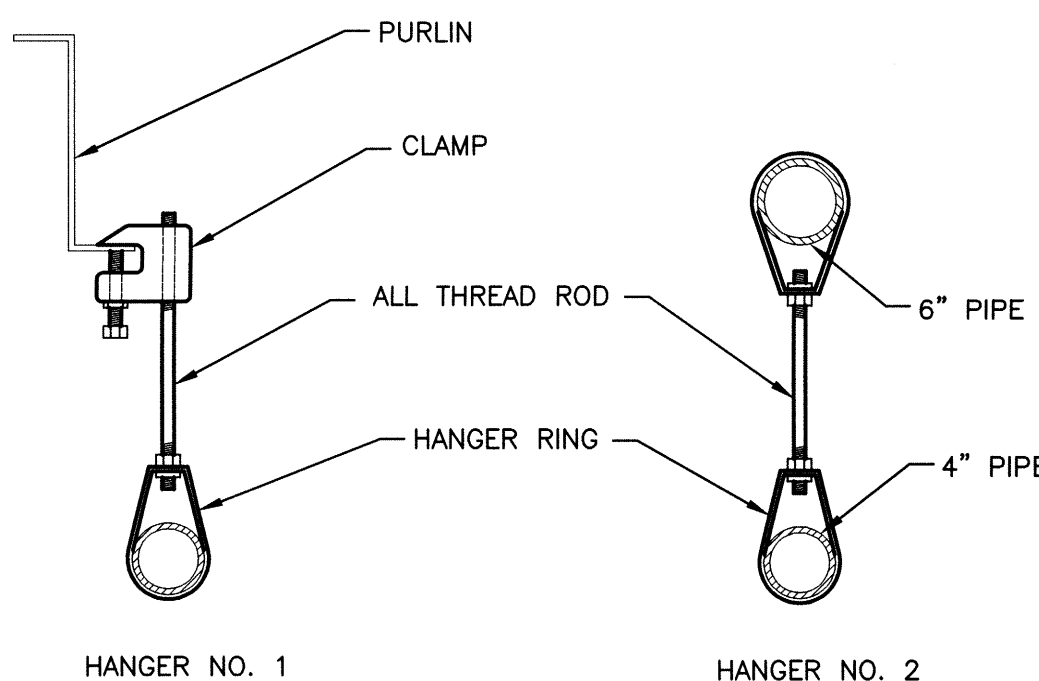


9 TYPICAL PIPE HANGER DETAIL
SCALE: NONE

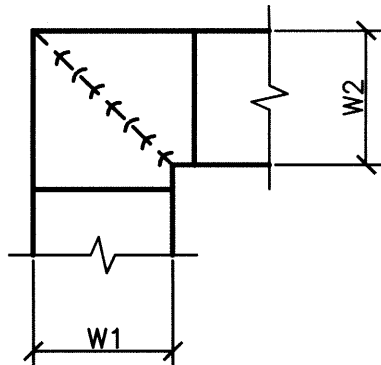


NOTE:
1. ALL VANE ELBOWS SHALL BE CONSTRUCTED AND INSTALLED AS DETAILED BY SMACNA.
2. WHEN W1 DOES NOT EQUAL W2, VANE SHALL BE SINGLE THICKNESS VANE TYPE REGARDLESS OF W DIMENSION.
3. ALL SINGLE THICKNESS VANES SHALL HAVE A 2" RADIUS, 1-1/2" MAXIMUM SPACE BETWEEN VANES AND A 3/4" TRAILING EDGE.
4. WHEN W EQUALS W2 AND W1 IS GREATER THAN 20" VANES SHALL BE DOUBLE VANE TYPE.

10 DUCTWORK SQUARE VANE ELBOWS
SCALE: NONE

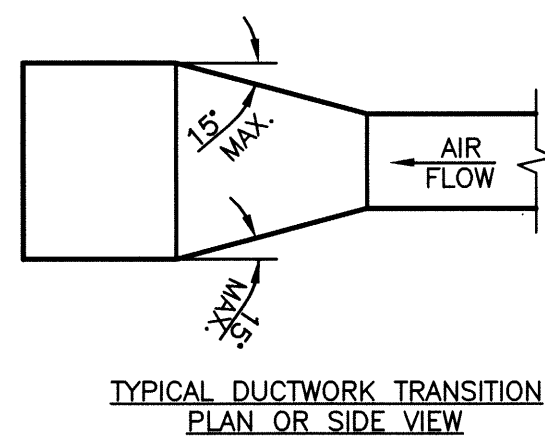


NOTE:
UNLESS OTHERWISE INDICATED ON PLANS, MAXIMUM ANGLES SHOWN SHALL APPLY.

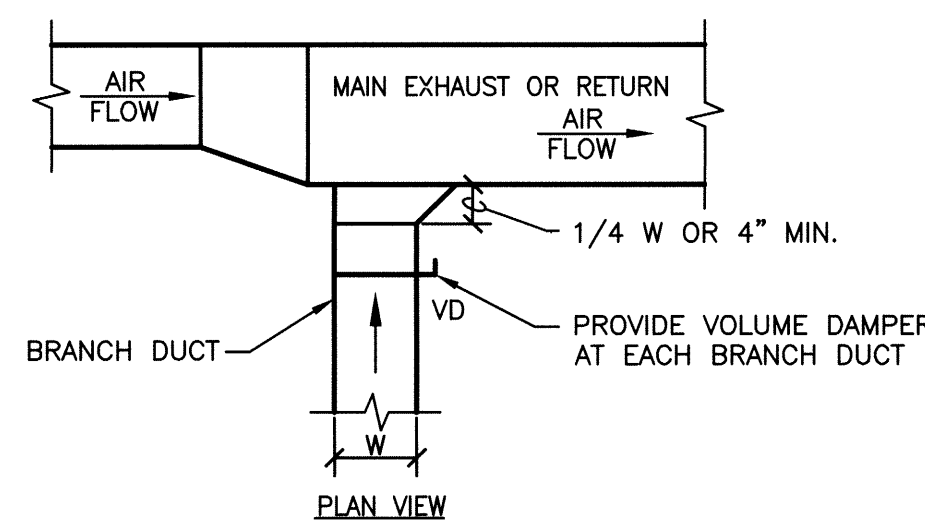


11 DUCTWORK TRANSITION
SCALE: NONE

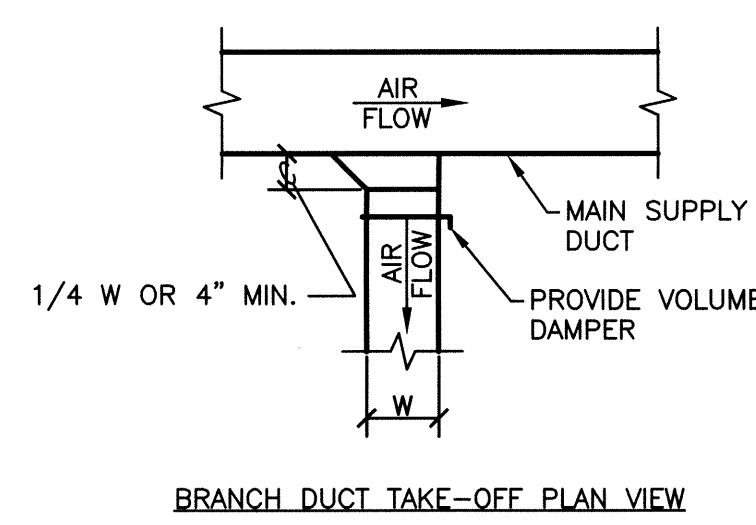

12 EXHAUST OR RETURN BRANCH DUCTWORK
SCALE: NONE




13 SUPPLY DUCTWORK TAKE-OFF
SCALE: NONE

		ARCHITECTS/ENGINEERS/CONSULTANTS:			 <i>04/28/14</i>	 7700 NORTH HUDSON, SUITE 9 OKLAHOMA CITY, OK 73116 PHONE: 405.842.6100 WWW.SPUR-DESIGN.COM	Drawing Title MECHANICAL DETAILS		Project Title CANTEEN AND LIBRARY		Project Number 635-12-314		Office of Construction and Facilities Management 
		ARCHITECT SPUR DESIGN, LLC 7700 NORTH HUDSON AVE SUITE 9 OKLAHOMA CITY, OK 73116	MEP ENGINEER PROJECT SOLUTIONS 2005 W. BROADWAY SUITE 210 COLUMBIA, MO 65203	STRUCTURAL ENGINEER SPUR DESIGN, LLC 7700 NORTH HUDSON AVE SUITE 9 OKLAHOMA CITY, OK 73116			Medical Center Director	Location OKLAHOMA CITY VAMC		Building Number		Drawing Number M-501	
100% Construction Documents													
65% Construction Documents	03/14/2014												
65% Design Development	03/22/2013												
35% Schematic Design	09/24/2012												
Revisions:						Chief Engineer		Date 04/28/2014	Checked KLS	Drawn MDW			

FAN COIL UNIT (FCU) SCHEDULE

FAN COIL UNIT (FCU) SCHEDULE																																			
MARK	MFG.	MODEL #	UNIT SIZE	OUTSIDE AIRFLOW (CFM)	SUPPLY FAN SECTION				COOLING COIL										HEATING COIL						FILTER SECTION			ELECTRICAL DATA			UNIT WEIGHT (LBS)	REMARKS			
					AIRFLOW (CFM)	ESP IN. W.C.	MOTOR QTY	DATA HP	COIL TYPE	CAP. (MBH) TOTAL	SENS.	E.A.T. DB/WB	L.A.T. DB/WB	E.W.T.	L.W.T.	ROWS	GPM	FACE VEL. (FPM)	WPD (FT H2O)	COIL TYPE	CAP. (MBH)	E.W.T.	L.W.T.	ROWS	GPM	WPD (FT H2O)	FILTER TYPE	NO. OF FILTERS	FILTER SIZE	DISCONNECT SWITCH			VOLTAGE & PHASE	STARTER	VFD
<div>FCU 1</div>	TRANE UNITRANE	FCCB0301J	030	30	300	0.05"	1	39 W	CHW	6.66	5.03	75/60	55/52	45	55	2	1.4	375	9.79	HOT WATER	10.85	180	150	1	0.7	1.23	MERV-13	1	9"x19"	BY ELEC.	115/1	N/A	N/A	81	SEE NOTE #1.
<div>FCU 2</div>	TRANE UNITRANE	FCCB0301K	030	30	300	0.05"	1	39 W	CHW	6.71	5.07	75/60	55/52	45	55	2	1.4	375	9.90	---	---	---	---	---	---	---	MERV-13	1	9"x19"	BY ELEC.	115/1	N/A	N/A	81	UNIT IS FOR COOLING ONLY. SEE NOTE #1.
<div>FCU 3</div>	TRANE UNITRANE	FCCB0301J	030	20	300	0.05"	1	39 W	CHW	6.71	5.07	75/62	55/53	45	55	2	1.4	375	9.90	---	---	---	---	---	---	---	MERV-13	1	9"x19"	BY ELEC.	115/1	N/A	N/A	81	UNIT IS FOR COOLING ONLY. SEE NOTE #1.
<div>FCU 4</div>	TRANE UNITRANE	FCCB0201K	020	25	170	0.05"	1	37 W	CHW	5.82	4.28	75/60	55/52	45	55	2	1.2	213	7.75	HOT WATER	9.37	180	150	1	0.6	0.95	MERV-13	1	9"x19"	BY ELEC.	115/1	N/A	N/A	81	SEE NOTE #1.
<div>FCU 5</div>	TRANE UNITRANE	FCCB0601K	060	0	600	0.05"	1	79 W	CHW	14.73	11.13	75/60	55/52	45	55	2	3.0	375	11.56	---	---	---	---	---	---	---	MERV-13	1	9"x34"	BY ELEC.	115/1	N/A	N/A	139	UNIT IS FOR COOLING ONLY. SEE NOTE #1.
<div>FCU 6</div>	TRANE UNITRANE	FCCB0801K	080	60	750	0.05"	1	122 W	CHW	15.25	12.35	75/62	55/53	45	55	2	3.1	357	3.47	HOT WATER	28.15	180	150	1	1.9	12.21	MERV-13	1	9"x42"	BY ELEC.	115/1	N/A	N/A	147	SEE NOTE #1.
<div>FCU 7</div>	TRANE UNITRANE	FCCB0601J	060	60	600	0.05"	1	79 W	CHW	14.65	11.05	75/60	55/52	45	55	2	3.0	375	11.45	HOT WATER	22.51	180	150	1	1.5	6.82	MERV-13	1	9"x34"	BY ELEC.	115/1	N/A	N/A	139	SEE NOTE #1.
<div>FCU 8</div>	TRANE UNITRANE	FCCB0601K	060	45	600	0.05"	1	79 W	CHW	14.65	11.05	75/60	55/52	45	55	2	3.0	375	11.45	HOT WATER	22.51	180	150	1	1.5	6.82	MERV-13	1	9"x34"	BY ELEC.	115/1	N/A	N/A	139	SEE NOTE #1.

NOTES:
1. PROVIDE WITH STAINLESS STEEL DRAIN PAN AND CONDENSATE OVERFLOW DETECTION.

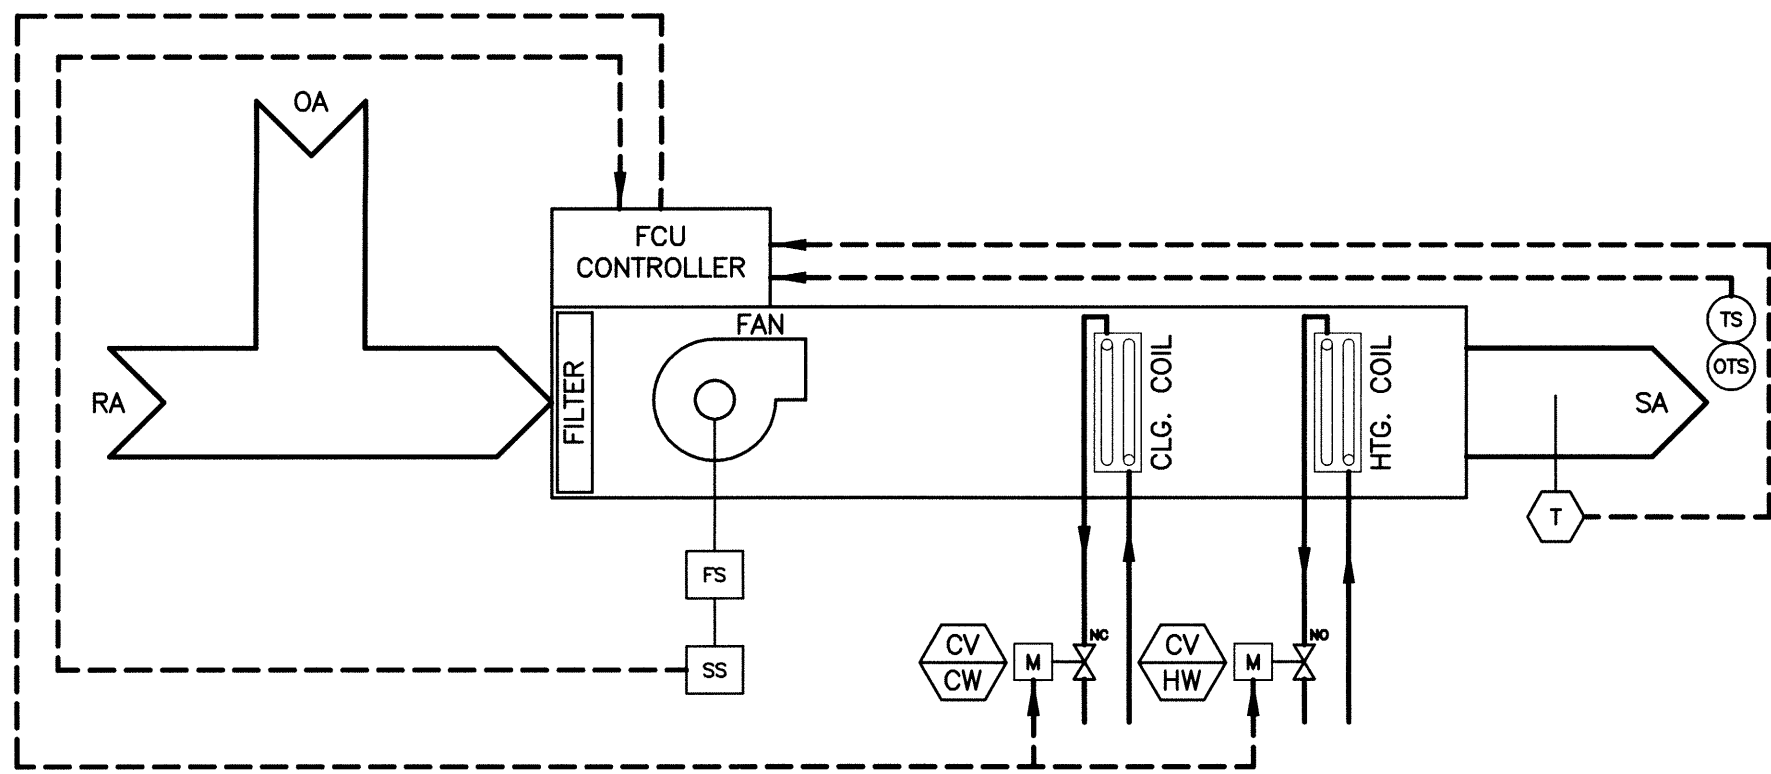

FOUR PIPE FAN COIL UNIT (FCU-1, 4, 6, 7, 8)
SCHEMATIC DIAGRAM

FOUR PIPE FCU SEQUENCE OF OPERATION

SYSTEM DESCRIPTION:

THE FAN COIL UNIT SHALL BE CONTROLLED AND MONITORED WITH A STAND ALONE DDC CONTROLLER AND SHALL BE COMPATIBLE WITH JOHNSON CONTROLS, EXTENDED ARCHITECTURE CONTROLS BY JOHNSON CONTROLS OR ALC.

FAN COIL UNIT CONTROLLERS SHALL BE COMPATIBLE AND CAPABLE OF INTEGRATING WITH THE OWNER'S EXISTING BUILDING MANAGEMENT SYSTEM (BMS), BY MEANS OF A NETWORK, AND REPORT THESE ITEMS AS A MINIMUM: SPACE TEMPERATURE, SPACE TEMPERATURE SETPOINT, SUPPLY AIR TEMPERATURE, FAN STATUS, AND HEATING AND COOLING COIL STATUS.

DEENERGIZED STATE:

THE FAN COIL UNIT INCLUDING THE SUPPLY FAN SHALL BE OFF. CV-HW SHALL BE FULLY CLOSED AND CV-CW SHALL BE FULLY OPEN.

OCCUPIED/UNOCCUPIED MODE DETERMINATION:

THE CENTRAL DDC SYSTEM SCHEDULER WILL SEND A SIGNAL TO THE FAN COIL UNITARY CONTROLLER THAT WILL ENERGIZE THE UNIT INTO OCCUPIED MODE OR DEENERGIZE THE UNIT INTO THE UNOCCUPIED MODE.

OCCUPIED MODE:

THE SUPPLY FAN SHALL RUN CONTINUOUSLY.

TEMPERATURE ABOVE SETPOINT AS SENSED BY TS SHALL CAUSE CV-CW TO MODULATE OPEN TO SATISFY SPACE TEMPERATURE.

TEMPERATURE BELOW SETPOINT AS SENSED BY TS SHALL CAUSE CV-HW TO MODULATE OPEN TO SATISFY SPACE TEMPERATURE.

UNOCCUPIED MODE:

SPACE TEMPERATURE ABOVE 80°F (ADJ.) AS SENSED BY TS SHALL ENERGIZE THE SUPPLY FAN AND OPEN CV-CW TO OPEN AND MODULATE TO MAINTAIN UNOCCUPIED SETPOINT.


SPACE TEMPERATURE BELOW 60°F (ADJ.) AS SENSED BY TS SHALL ENERGIZE THE SUPPLY FAN AND OPEN CV-HW TO OPEN AND MODULATE TO MAINTAIN UNOCCUPIED SETPOINT.

GENERAL:

UNIT DISCHARGE AIR TEMPERATURE SHALL BE AVAILABLE AT BMS FOR TROUBLESHOOTING.

CONTROL POINT DESCRIPTOR LEGEND

POINT_NAME	POINT_TYPE	DESCRIPTOR
T	AI	DISCHARGE AIR TEMPERATURE
TS	AI	SPACE TEMPERATURE
OTS	AI	OCCUPIED TEMPERATURE SETPOINT
CV-HW	AO	HOT WATER CONTROL VALVE
CV-CW	AO	CHILLED WATER CONTROL VALVE
DO	DI	FAN START/STOP
FS	DI	FAN STATUS

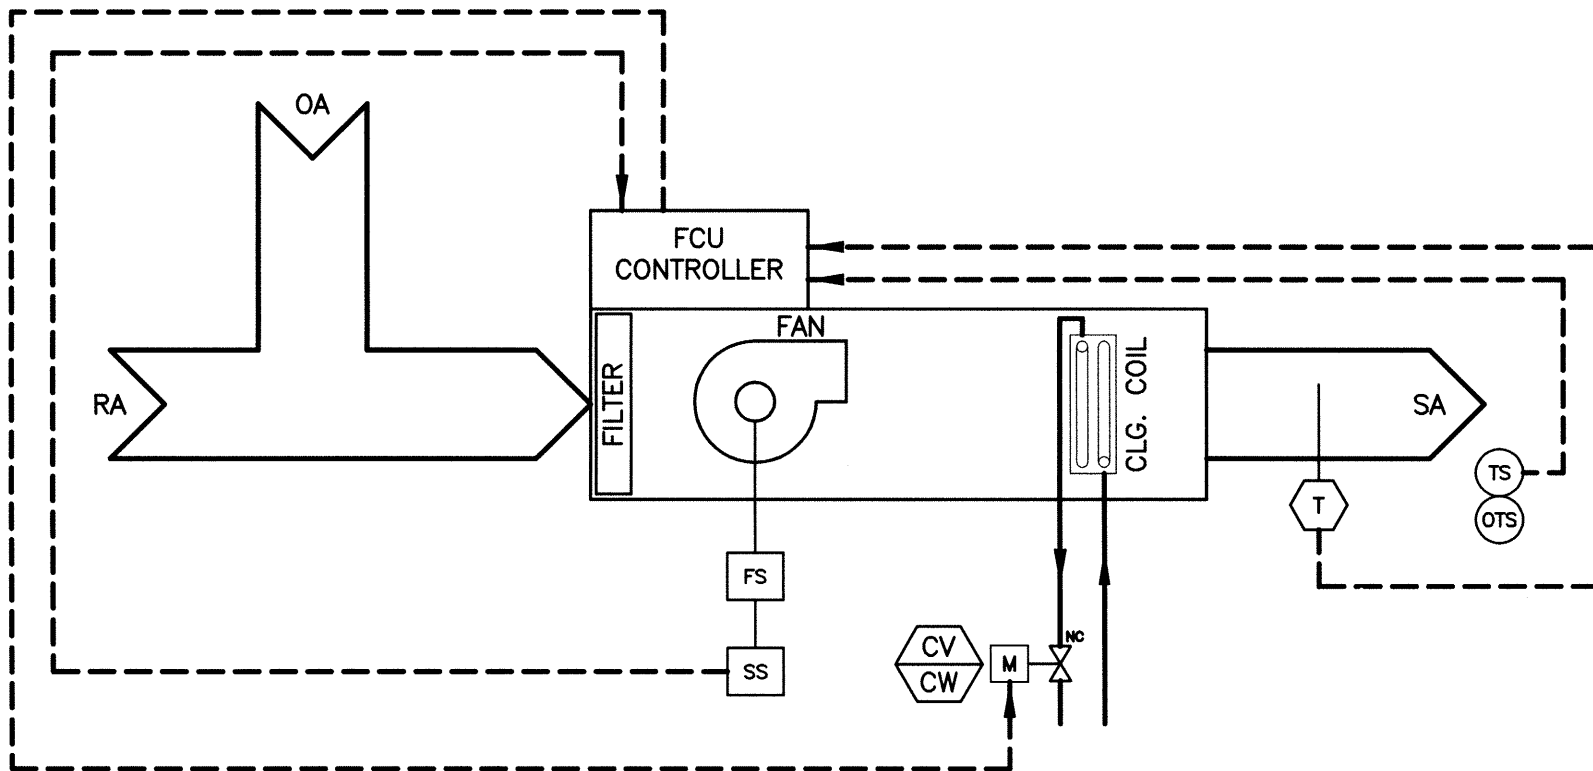

TWO PIPE FAN COIL UNIT (FCU-2, 3, 5)
SCHEMATIC DIAGRAM

TWO PIPE FCU SEQUENCE OF OPERATION

SYSTEM DESCRIPTION:

THE FAN COIL UNIT SHALL BE CONTROLLED AND MONITORED WITH A STAND ALONE DDC CONTROLLER AND SHALL BE COMPATIBLE WITH JOHNSON CONTROLS, EXTENDED ARCHITECTURE CONTROLS BY JOHNSON CONTROLS OR ALC.

FAN COIL UNIT CONTROLLERS SHALL BE COMPATIBLE AND CAPABLE OF INTEGRATING WITH THE OWNER'S EXISTING BUILDING MANAGEMENT SYSTEM (BMS), BY MEANS OF A NETWORK, AND REPORT THESE ITEMS AS A MINIMUM: SPACE TEMPERATURE, SPACE TEMPERATURE SETPOINT, SUPPLY AIR TEMPERATURE, FAN STATUS, AND HEATING COIL STATUS.

DEENERGIZED STATE:

THE FAN COIL UNIT INCLUDING THE SUPPLY FAN SHALL BE OFF. CV-CW SHALL BE FULLY OPEN.

OCCUPIED/UNOCCUPIED MODE DETERMINATION:

THE CENTRAL DDC SYSTEM SCHEDULER WILL SEND A SIGNAL TO THE FAN COIL UNITARY CONTROLLER THAT WILL ENERGIZE THE UNIT INTO OCCUPIED MODE OR DEENERGIZE THE UNIT INTO THE UNOCCUPIED MODE.

OCCUPIED MODE:

THE SUPPLY FAN SHALL RUN CONTINUOUSLY.

TEMPERATURE ABOVE SETPOINT AS SENSED BY TS SHALL CAUSE CV-CW TO MODULATE OPEN TO SATISFY SPACE TEMPERATURE.

TEMPERATURE BELOW SETPOINT AS SENSED BY TS SHALL CAUSE CV-CW TO MODULATE CLOSED TO SATISFY SPACE TEMPERATURE.

UNOCCUPIED MODE:

SPACE TEMPERATURE ABOVE 80°F (ADJ.) AS SENSED BY TS SHALL ENERGIZE THE SUPPLY FAN AND CV-CW TO OPEN AND MODULATE TO MAINTAIN UNOCCUPIED SETPOINT.

GENERAL:

UNIT DISCHARGE AIR TEMPERATURE SHALL BE AVAILABLE AT BMS FOR TROUBLESHOOTING.

CONTROL POINT DESCRIPTOR LEGEND


POINT_NAME	POINT_TYPE	DESCRIPTOR
T	AI	DISCHARGE AIR TEMPERATURE
TS	AI	SPACE THERMOSTAT
OTS	AI	OCCUPIED TEMPERATURE SETPOINT
CV-CW	AO	CHILLED WATER CONTROL VALVE
SS	DO	FAN START/STOP
FS	DI	FAN STATUS

VARIABLE AIR VOLUME (VAV) UNIT SCHEDULE

VARIABLE AIR VOLUME (VAV) UNIT SCHEDULE												
MARK	MFR.	MODEL	PRIMARY CFM		REHEAT CAPACITY (MBH)	GPM	ELECTRICAL DATA				UNIT WEIGHT (LBS)	REMARKS
			MAX.	MIN.			DISCONNECT SWITCH	VOLTAGE & PHASE	STARTER	VFD		
VAV 1	TITUS	DESV 6"	380	270	13.1	1.3	BY ELEC.	115V 1Ø	N/A	N/A	52	PROVIDE DDC READY BOX FOR JOHNSON CONTROLS. PROVIDE WITH INTEGRAL SOUND ATTENUATOR AND 1 ROW HOT WATER REHEAT COIL. PROVIDE WITH BOTTOM INSULATED ACCESS DOOR.

AIR DEVICE SCHEDULE

MARK	MFG.	MODEL	TYPE	FACE SIZE	MATERIAL	FINISH	REMARKS/ACCESSORIES
S1	TITUS	TMS	LAY-IN	24"x24"	STEEL	WHITE	
R1	TITUS	PAR	LAY-IN	24"x24"	STEEL	WHITE	

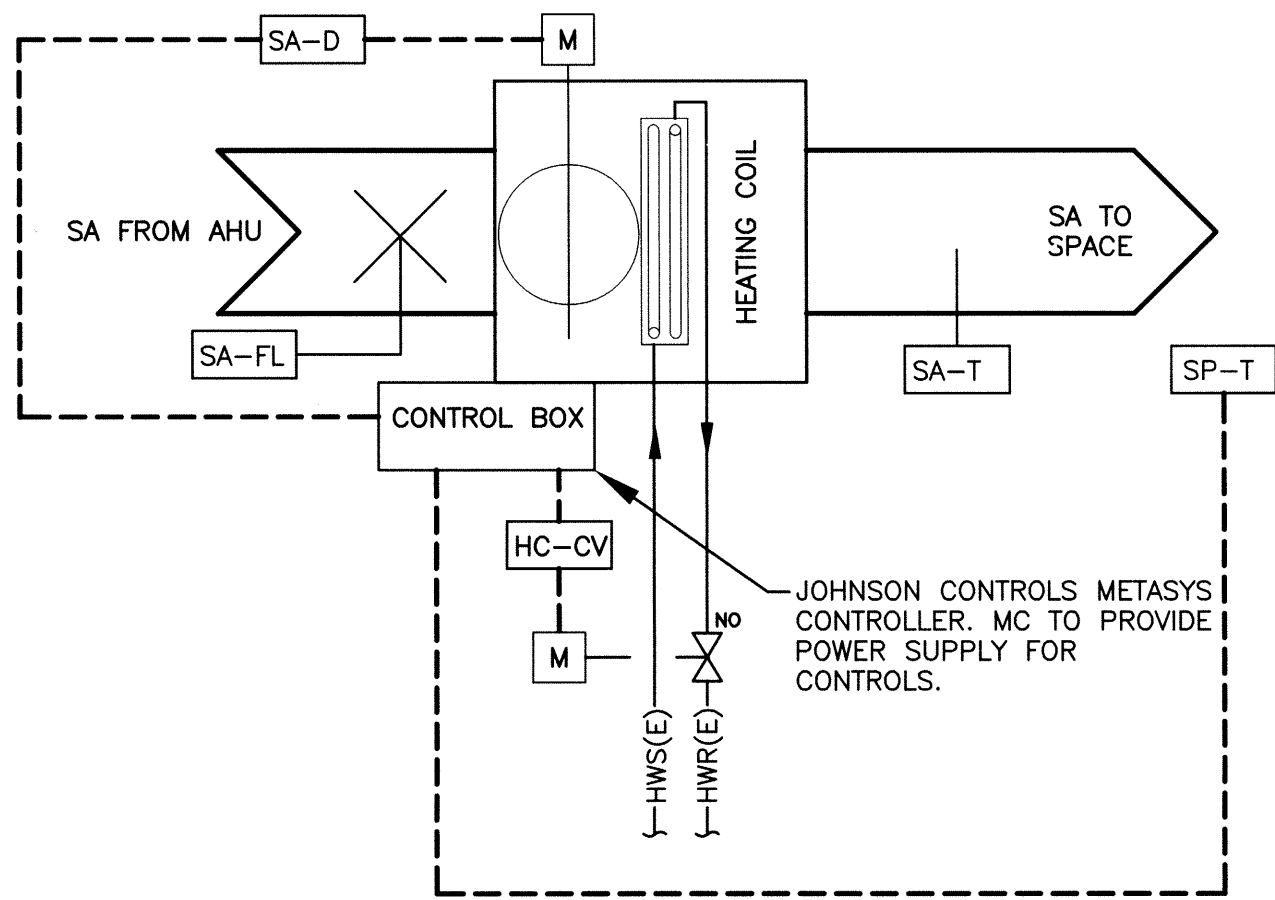

VAV-1 SEQUENCE OF OPERATION

GENERAL REQUIREMENTS

TERMINAL UNITS SHALL BE CONTROLLED AND MONITORED WITH A STAND ALONE DDC CONTROLLER AND SHALL BE COMPATIBLE WITH JOHNSON CONTROLS, EXTENDED ARCHITECTURE CONTROLS BY JOHNSON CONTROLS OR ALC.

TERMINAL UNIT CONTROLLERS SHALL BE COMPATIBLE AND CAPABLE OF INTEGRATING WITH THE OWNER'S EXISTING BUILDING MANAGEMENT SYSTEM (BMS), BY MEANS OF A NETWORK, AND REPORT THESE ITEMS AS A MINIMUM: SPACE TEMPERATURE, SPACE TEMPERATURE SETPOINT, SUPPLY AIR TEMPERATURE, CONTROL DAMPER STATUS, AND REHEAT COIL STATUS.

OCCUPIED MODE OPERATIONS

TERMINAL UNIT DAMPER SA-D SHALL MODULATE BETWEEN MAX AND MIN CFM PER VAV SCHEDULE TO MAINTAIN CONSTANT ROOM SETPOINT. (75 DEG F, ADJ.).

UPON A DECREASE IN SPACE TEMPERATURE BELOW OCCUPIED SETPOINT (70 DEG F, ADJ.), THE REHEAT COIL VALVE SHALL OPEN TO MAINTAIN SPACE SETPOINT AFTER UNIT AT MIN CFM.

UPON AN INCREASE IN SPACE TEMPERATURE ABOVE SETPOINT THE REHEAT COIL VALVE SHALL CLOSE.

UNOCCUPIED MODE OPERATIONS

TERMINAL UNIT SHALL BE DE-ENERGIZED.

UPON AN INCREASE IN TEMPERATURE ABOVE UNOCCUPIED SETPOINT (80 DEG F, ADJ.), TERMINAL UNIT SHALL ENERGIZE AT MIN CFM UNTIL UNOCCUPIED SETPOINT IS REACHED.

UPON A DECREASE IN TEMPERATURE BELOW UNOCCUPIED SETPOINT (65 DEG F, ADJ.), TERMINAL UNIT SHALL ENERGIZE AT MIN CFM AND REHEAT COIL VALVE SHALL OPEN UNTIL UNOCCUPIED SETPOINT IS REACHED.

VAV TERMINAL UNIT DDC POINT LIST

POINT NO.	POINT NO. DESCRIPTION	TYPE	DISPLAY UNITS
SA-D	VAV CONTROL DAMPER	AO	% OPEN
SA-T	SUPPLY AIR TEMPERATURE	AI	DEG F
SP-T	SPACE TEMPERATURE	AI	DEG F
HC-CV	HEATING COIL CONTROL VALVE	DO	OPEN/CLOSE
SA-FL	SUPPLY AIRFLOW	AI	CFM

VAV DDC POINT NAME NOMENCLATURE

SYSTEM:		DEVICE:	
SUPPLY AIR	- SA	D	- DAMPER
CONDITIONED SPACE	- SP	T	- TEMPERATURE
HEATING COIL	- HC	CV	- CONTROL VALVE
		FL	- AIRFLOW

ARCHITECTS/ENGINEERS/CONSULTANTS:

ARCHITECT	MEP ENGINEER	STRUCTURAL ENGINEER
SPUR DESIGN, LLC 7700 NORTH HUDSON AVE SUITE 9 OKLAHOMA CITY, OK 73116	PROJECT SOLUTIONS 2005 W. BROADWAY SUITE 210 COLUMBIA, MO 65203	SPUR DESIGN, LLC 7700 NORTH HUDSON AVE SUITE 9 OKLAHOMA CITY, OK 73116

SPUR DESIGN, LLC
7700 NORTH HUDSON AVE
SUITE 9
OKLAHOMA CITY, OK 73116



OKLAHOMA CERTIFICATE OF AUTHORITY: 0095

SPUR DESIGN
7700 NORTH HUDSON, SUITE 9
OKLAHOMA CITY, OK 73116
PHONE: 405.842.6100
WWW.SPUR-DESIGN.COM

Drawing Title
MECHANICAL SCHEDULES

Medical Center Director

Chief Engineer

Project Title
CANTEN AND LIBRARY

Location
OKLAHOMA CITY VAMC

Date
04/28/2014

Checked
KLS

Drawn
MDW

Project Number
635-12-314

Building Number

Drawing Number

M-502

Office of
Construction
and Facilities
Management

Department of
Veterans Affairs