


DEMOLITION NOTES: (ALL NOTES ARE NOT APPLICABLE TO ALL SHEETS)

- ① CEILING SLOPES TO ACCOMMODATE MECHANICAL EQUIPMENT. REPLACE CEILING GRID/TILES AS NEEDED. MATCH EXISTING TYPE, COLOR, LAYOUT & HEIGHT.
- ② CEILING IN THESE AREAS TO BE COMPLETELY REMOVED AND NEW CEILING INSTALLED TO MATCH EXISTING LAYOUT. EXISTING PLASTER CEILING ABOVE LAY-IN CEILING TO BE COMPLETELY REMOVED. REFER TO HVAC PLANS FOR UNIT LOCATIONS.
- ③ SEE MECH. NOTES FOR RE-PIPING WALL MOUNTED RADIATORS. TYP. PATCH/REPAIR FLOOR/WALL & PAINT/TEXTURE WALL TO MATCH EXIST.
- ④ REMOVE/REPLACE C.G. GRID & TILES AS REQUIRED TO REMOVE EXIST. HVAC AND INSTALL NEW. REUSE EXIST. C.G. TILES AS REQUIRED TO MAINTAIN A UNIFORM APPEARANCE. REINSTALL ALL EXISTING CEILING MOUNTED DEVICES.
- ⑤ REMOVE & REPLACE T/STAT AND/OR FAN CONTROL SWITCH AS INDICATED ON HVAC PLANS. PATCH/REPAIR & PAINT/TEXTURE WALL TO MATCH EXISTING CONDITIONS.
- ⑥ REMOVE EXISTING C.G. INSTALL NEW C.G. GRID & TILES MATCH EXIST.
- ⑦ REMOVE DUCTWORK AS REQUIRED PER HVAC PLANS. PATCH/REPAIR WALL ABOVE C.G. TO RESTORE (1) HOUR FIRE RATING.
- ⑧ REMOVE REGISTER/DUCTWORK AS REQUIRED PER HVAC PLANS. PATCH/REPAIR WALL TO RESTORE (1) HOUR FIRE RATING.
- ⑨ CEILING IN THESE AREAS TO BE COMPLETELY REMOVED AND NEW CEILING INSTALLED TO MATCH EXISTING LAYOUT. EXISTING PLASTER CEILING ABOVE TO BE REMOVED AROUND NEW FCU. REFER TO HVAC PLANS FOR UNIT LOCATIONS AND CLEARANCES.
- ⑩ REMOVE EQUIP. PER HVAC PLANS. REPAIR WALL EXTERIOR & INTERIOR.
- ⑪ INSTALL NEW 2'-0" x 2'-0" LAY-IN CEILING TILES. USE EXISTING 2'-0" x 4'-0" CEILING LAYOUT TO MATCH. ADJUST AS NEEDED TO AVOID EXISTING SPRINKLER HEADS. REFER TO SPECIFICATIONS FOR 2'-0" x 2'-0" TILES. REINSTALL ALL EXISTING CEILING MOUNTED DEVICES.
- ⑫ COORDINATE AN ACCEPTABLE TEMPORARY BARRIER WITH THE VA'S INFECTIOUS CONTROL OFFICER IN HATCHED AREAS.
- ⑬ REFER TO MECHANICAL FOR REMOVAL OF WALL RADIATOR. PATCH/REPAIR & PAINT/TEXTURE WALL TO MATCH EXISTING CONDITIONS.
- ⑭ REFER TO MECHANICAL FOR REMOVAL OF FCU. PATCH/REPAIR FLOOR TO MATCH EXISTING CONDITIONS.
- ⑮ CEILING IN THESE AREAS TO BE COMPLETELY REMOVED & NEW CEILING INSTALLED TO MATCH EXISTING LAYOUT.
- ⑯ REFER TO HVAC PLANS FOR WORK IN THIS AREA. REPLACE ANY CEILING TILES/GRID DAMAGED BY HVAC WORK.
- ⑰ REWORK FURR-DOWN BEHIND FCU AS REQUIRED TO REMOVE/REPLACE FCU. PAINT/TEXTURE FURR-DOWN TO MATCH EXISTING WALLS.
- ⑱ PATCH WALL ABOVE CEILING TO MATCH EXISTING CONDITIONS.
- ⑲ REMOVE/REPLACE CEILING GRID & TILES AS REQUIRED TO INSTALL NEW HVAC EQUIPMENT. RE-USE EXISTING CEILING TILES AS REQUIRED TO MAINTAIN A UNIFORM APPEARANCE.

- SYMBOL LEGEND:**
- Ⓜ EXISTING FLOURESCENT LIGHT FIXTURES
 - EXISTING CAN LIGHT FIXTURES
 - ⊙ EXISTING EXIT LIGHT
 - ⊞ EXISTING CEILING GRID. SEE PLAN FOR LAYOUT
 - ⊞ NEW 2'-0" x 2'-0" ACOUSTICAL CEILING GRID
 - ⊞ EXISTING CEILING HEADER
 - ⊞ EXISTING SPEAKER
 - ⊞ EXISTING FIRE STROBE
 - ⊞ EXISTING SMOKE DETECTOR
 - ⊞ EXISTING MOTION SENSOR
 - ⊞ EXISTING SPRINKLER HEAD
 - ⊞ NURSE CALL LIGHT

- GENERAL NOTES:**
1. COLUMN LINES SHOWN FOR REFERENCE ONLY
 2. VERIFY ALL CEILING HEIGHTS
 3. SALVAGE EXISTING CEILING TILE & USE WHERE NEEDED TO MAINTAIN A UNIFORM APPEARANCE
 4. REFER TO MAINTENANCE STAFF ON-SITE FOR PAINT COLOR #S. PAINT/TEXTURE ANY WALL DISTURBED DURING CONSTRUCTION OR WHERE EQUIPMENT IS REMOVED.
 5. REFER TO MECHANICAL PLANS FOR HVAC UNITS TO BE REPLACED. REPLACE CEILING GRID/TILES AS NEEDED. MATCH EXISTING TYPE, COLOR, LAYOUT & HEIGHT
 6. VA TO DEMO SHOWERTUB & CERAMIC TILE WALLS IN COPY ROOM 5405-1. G.C. TO ADD GYP. DR. OVER STUD WALLS WHERE REOD & TAPED/TEXTURE & PAINT. INSTALL NEW V.C.T. FLOORING & VINYL BASE.
 7. REFER TO MECHANICAL PLANS FOR WALL MOUNTED RADIATOR. DEMOLITION. PATCH/REPAIR AND PAINT WALL BEHIND RADIATORS. TYPICAL ON FIRST FLOOR IN AREA OF WORK.
 8. IF A ROOM HAS NO CEILING OR NOTES, THEN THERE IS NO ARCHITECTURAL WORK IN THAT ROOM.




1 LEVEL 2, C WING: ARCHITECTURAL RCP DEMO PLAN
1/8"=1'-0"

ASBESTOS NOTE:
IF THE EXECUTION OF THIS WORK REQUIRES THE DISTURBING OF ANY SUBSTANCE WHICH APPEARS TO BE ASBESTOS OR WHICH MAY CONTAIN ASBESTOS FIBER, NOTIFY THE OWNER BEFORE CONTINUING WORK AT THE SUSPECT LOCATION. ANY MATERIAL TESTING POSITIVE SHALL BE REMOVED BY THE OWNER BEFORE WORK CONTINUES.

NOTE: EXISTING CONDITIONS SHOWN WERE DERIVED FROM OWNER FURNISHED DRAWINGS AND FIELD OBSERVATIONS. SOME BUILDING FEATURES AND MEP SYSTEMS ARE NOT SHOWN FOR CLARITY. FIELD VERIFY BUILDING CONSTRUCTION. FIELD VERIFY THE LOCATION, SIZE AND QUANTITY OF ALL EQUIPMENT.

NOTE: REFER TO DETAILS AND SCHEMATICS FOR PIPING, VALVES, FITTINGS AND OTHER APPURTENANCES REQUIRED, BUT NOT SHOWN FOR CLARITY.



REVISIONS:	DESCRIPTION:	DATE:



Dept. of Veterans Affairs
Jack C. Montgomery
Medical Center
1011 Honor Height Drive
Muskogee, Oklahoma 74401

ENGINEER:
RMD CONSULTING, LLC
2815 VALLEY VIEW LANE, STE. 214
DALLAS, TX 75234
P: 972-488-8077 F: 972-488-8174
PROJECT NUMBER: 11-5801
OK REG. ENGINEERING FIRM: 5183

CONSULTANTS:
ARCHITECT:
ARCHITECTURAL CONCEPTS, INC.
669 AIRPORT FREEWAY, STE. 400
HURST, TX 76053
P: 817-285-8885 F: 817-285-8021

APPROVED:	APPROVED: Interior Designer	APPROVED: Safety Manager	APPROVED: Medical Center Director
APPROVED:	APPROVED:	APPROVED: Infection Control Nurse	APPROVED: Associate Director
APPROVED:	APPROVED:	APPROVED: Industrial Hygienist	APPROVED: Chief of Staff
APPROVED:	APPROVED:	APPROVED: President A.F.G.E. 2250	APPROVED: Chief of Engineering Service

DRAWING TITLE:
LEVEL 2, C WING:
ARCH. RCP DEMO PLAN

PROJECT NO.: 6223-10-104
CONTRACT NO.: VA256-P-1355

BUILDING NO.: 01
AUTOCAD FILE NAME:

PROJECT TITLE:
REPLACE INDUCTION
UNITS IN BLDG. #1

DATE: 05/28/2013
SCALE: 1/8"=1'-0"

DRAWING NO.: AD-2.1
DWG. OF 97

DESIGNED BY: PRM
DRAWN BY: BB
CHECKED BY: PRM

LOCATION: Jack C. Montgomery VA Medical Center

DEPARTMENT OF VETERANS AFFAIRS

DEMOLITION NOTES: (ALL NOTES ARE NOT APPLICABLE TO ALL SHEETS)


- 1 CEILING SLOPES TO ACCOMMODATE MECHANICAL EQUIPMENT
REPLACE CEILING GRID/TILES AS NEEDED. MATCH EXISTING TYPE,
COLOR, LAYOUT & HEIGHT
- 2 CEILING IN THESE AREAS TO BE COMPLETELY REMOVED AND NEW
CEILING INSTALLED TO MATCH EXISTING LAYOUT. EXISTING PLASTER
CEILING ABOVE LAY-IN CEILING TO BE COMPLETELY REMOVED. REFER TO
HVAC PLANS FOR UNIT LOCATIONS.
- 3 SEE MECH NOTES FOR RE-PIPPING WALL MOUNTED RADIATORS. TYP.
PATCH/REPAIR FLOORWALL & PAINT/TEXTURE WALL TO MATCH EXIST.
- 4 REMOVE/REPLACE CLG. GRID & TILES AS REQUIRED TO REMOVE EXIST.
HVAC AND INSTALL NEW REUSE EXIST. CLG. TILES AS REQUIRED TO
MAINTAIN A UNIFORM APPEARANCE. REINSTALL ALL EXISTING CEILING
MOUNTED DEVICES.
- 5 REMOVE & REPLACE TSTAT AND/OR FAN CONTROL SWITCH AS INDICATED
ON HVAC PLANS. PATCH/REPAIR & PAINT/TEXTURE WALL TO MATCH
EXISTING CONDITIONS.
- 6 REMOVE EXISTING CLG., INSTALL NEW CLG. GRID & TILES MATCH EXIST.
- 7 REMOVE DUCTWORK AS REQUIRED PER HVAC PLANS. PATCH/REPAIR
WALL ABOVE CLG. TO RESTORE (1) HOUR FIRE RATING.
- 8 REMOVE REGISTER/DUCTWORK AS REQUIRED PER HVAC PLANS.
PATCH/REPAIR WALL TO RESTORE (1) HOUR FIRE RATING.
- 9 CEILING IN THESE AREAS TO BE COMPLETELY REMOVED AND
REINSTALLED TO MATCH EXISTING LAYOUT. EXISTING PLASTER
CEILING ABOVE TO BE REMOVED AROUND NEW FOU. REFER TO
HVAC PLANS FOR UNIT LOCATIONS AND CLEARANCES.
- 10 REMOVE EQUIP. PER HVAC PLANS. REPAIR WALL EXTERIOR & INTERIOR
- 11 INSTALL NEW 2'-0" x 2'-0" LAY-IN CEILING TILES. USE EXISTING 2'-0" x 2'-0"
CEILING LAYOUT TO MATCH. ADJUST AS NEEDED TO AVOID EXISTING
SPRINKLER HEADS. REFER TO SPECIFICATIONS FOR 2'-0" x 2'-0" TILE.
REINSTALL ALL EXISTING CEILING MOUNTED DEVICES.
- 12 COORDINATE AN ACCEPTABLE TEMPORARY BARRIER WITH THE
V.A.'S INFECTIOUS CONTROL OFFICER IN HATCHED AREAS.
- 13 REFER TO MECHANICAL FOR REMOVAL OF WALL RADIATOR. PATCH/
REPAIR & PAINT/TEXTURE WALL TO MATCH EXISTING CONDITIONS.
- 14 REFER TO MECHANICAL FOR REMOVAL OF FOU. PATCH/REPAIR FLOOR
TO MATCH EXISTING CONDITIONS.
- 15 CEILING IN THESE AREAS TO BE COMPLETELY REMOVED & NEW CEILING
INSTALLED TO MATCH EXISTING LAYOUT.
- 16 REFER TO HVAC PLANS FOR WORK IN THIS AREA. REPLACE ANY CEILING
TILES/DAMAGED BY HVAC WORK.
- 17 REWORK FURR-DOWN BEHIND FOU AS REQUIRED TO REMOVE/REPLACE
FOU. PAINT/TEXTURE FURR-DOWN TO MATCH EXISTING WALLS.
- 18 PATCH WALL ABOVE CEILING TO MATCH EXISTING CONDITIONS.
- 19 REMOVE/REPLACE CEILING GRID & TILES AS REQUIRED TO INSTALL NEW
HVAC EQUIPMENT. RE-USE EXISTING CEILING TILES AS REQUIRED TO
MAINTAIN A UNIFORM APPEARANCE.

SYMBOL LEGEND:

- EXISTING FLOURESCENT LIGHT FIXTURES
- EXISTING CAN LIGHT FIXTURES
- EXISTING EXIT LIGHT
- EXISTING CEILING GRID, SEE PLAN FOR LAYOUT
- NEW 2'-0" x 2'-0" ACoustical CEILING GRID
- EXISTING CEILING HEADER
- EXISTING SPEAKER
- EXISTING FIRE STROBE
- EXISTING SMOKE DETECTOR
- EXISTING MOTION SENSOR
- EXISTING SPRINKLER HEAD
- NURSE CALL LIGHT

GENERAL NOTES:

1. COLUMN LINES SHOWN FOR REFERENCE ONLY
2. VERIFY ALL CEILING HEIGHTS
3. SALVAGE EXISTING CEILING TILE & USE WHERE NEEDED TO
MAINTAIN A UNIFORM APPEARANCE
4. REFER TO MAINTENANCE STAFF ON-SITE FOR PAINT COLOR #S.
PAINT/TEXTURE ANY WALL DISTURBED DURING CONSTRUCTION OR
WHERE EQUIPMENT IS REMOVED.
5. REFER TO MECHANICAL PLANS FOR HVAC UNITS TO BE REPLACED.
REPLACE CEILING GRID/TILES AS NEEDED. MATCH EXISTING TYPE,
COLOR, LAYOUT & HEIGHT
6. VA TO DEMO SHOWER/TUB & CERAMIC TILE WALLS IN COPY ROOM
5405-1. G.C. TO ADD GYP. BD. OVER STUD WALLS WHERE REG'D &
TAPEB'D/TEXTURE & PAINT. INSTALL NEW V.C.T. FLOORINGS &
VINYL BASE.
7. REFER TO MECHANICAL PLANS FOR WALL MOUNTED RADIATOR
DEMOLITION. PATCH/REPAIR AND REPAINT WALL BEHIND RADIATORS.
TYPICAL ON FIRST FLOOR IN AREA OF WORK.
8. IF A ROOM HAS NO CEILING OR NOTES, THEN THERE IS NO
ARCHITECTURAL WORK IN THAT ROOM.


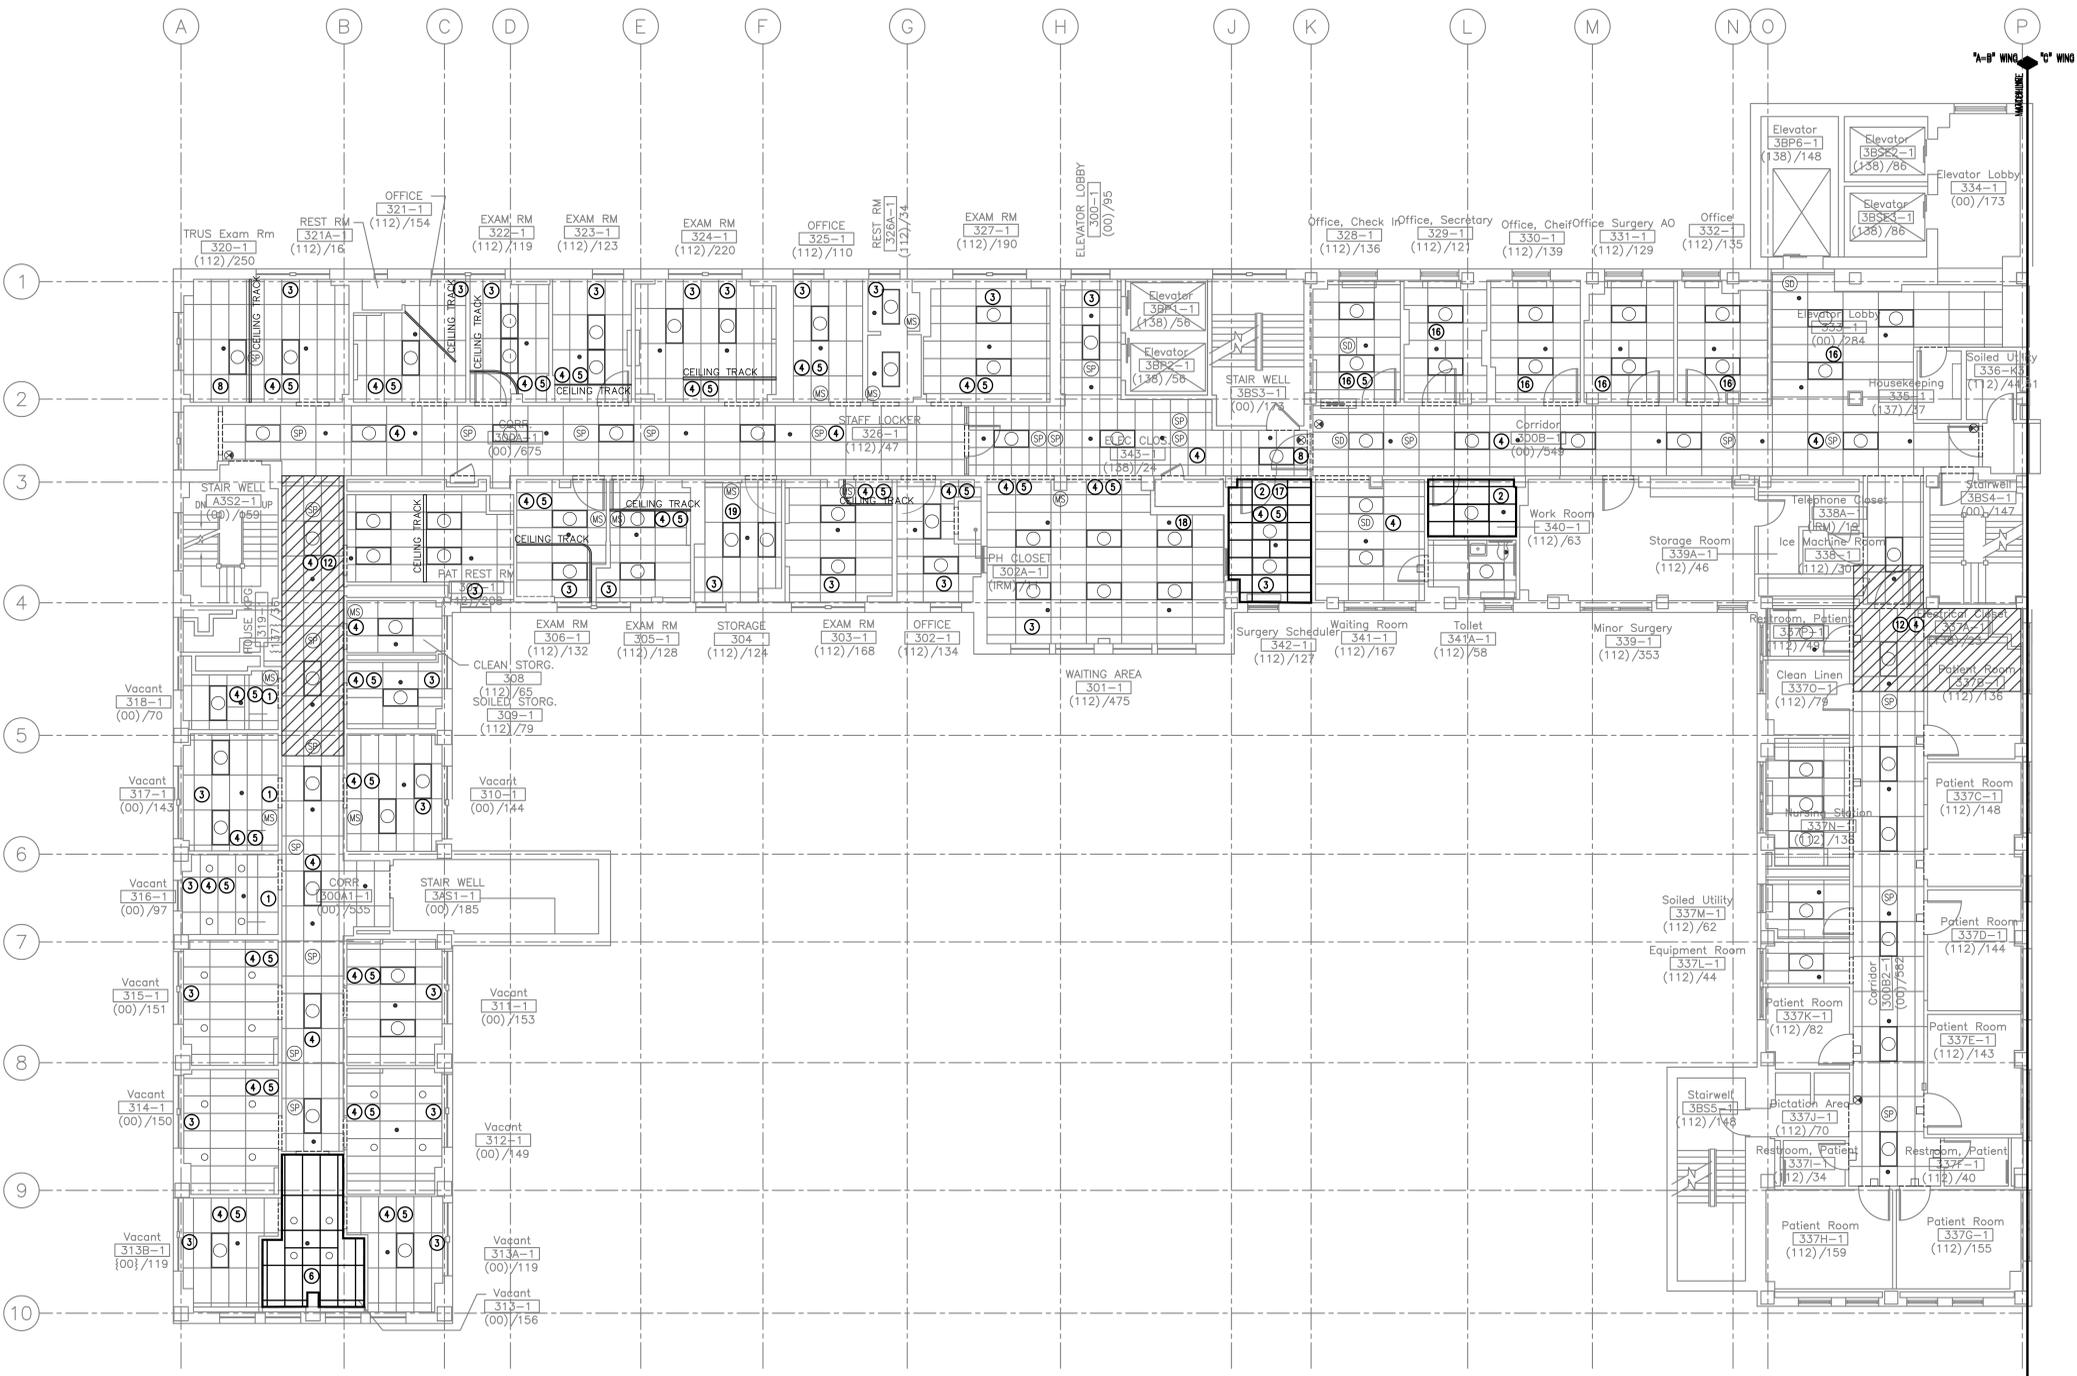


1 LEVEL 3, A-B WING: ARCHITECTURAL RCP DEMO PLAN
1/8"=1'-0"

ASBESTOS NOTE:
IF THE EXECUTION OF THIS WORK REQUIRES THE DISTURBING OF ANY SUBSTANCE WHICH APPEARS TO BE ASBESTOS OR
WHICH MAY CONTAIN ASBESTOS FIBER, NOTIFY THE OWNER BEFORE CONTINUING WORK AT THE SUSPECT LOCATION. ANY
MATERIAL TESTING POSITIVE SHALL BE REMOVED BY THE OWNER BEFORE WORK CONTINUES.

NOTE: EXISTING CONDITIONS SHOWN WERE DERIVED FROM OWNER FURNISHED DRAWINGS AND FIELD OBSERVATIONS. SOME
BUILDING FEATURES AND MEP SYSTEMS ARE NOT SHOWN FOR CLARITY. FIELD VERIFY BUILDING CONSTRUCTION. FIELD VERIFY
THE LOCATION, SIZE AND QUANTITY OF ALL EQUIPMENT.

NOTE: REFER TO DETAILS AND SCHEMATICS FOR PIPING, VALVES, FITTINGS AND OTHER APPURTENANCES REQUIRED, BUT NOT
SHOWN FOR CLARITY.



REVISIONS:	DESCRIPTION:	DATE:

Dept. of Veterans Affairs
Jack C. Montgomery
Medical Center
1011 Honor Height Drive
Muskogee, Oklahoma 74401

ENGINEER:
RMD CONSULTING, LLC
2815 VALLEY VIEW LANE, STE. 214
DALLAS, TX 75234
P: 972-488-8077 F: 972-488-8174
PROJECT NUMBER: 11-5801
OK REG. ENGINEERING FIRM: 5183

CONSULTANTS:
ARCHITECT:
ARCHITECTURAL CONCEPTS, INC.
669 AIRPORT FREEWAY, STE. 400
HURST, TX 76053
P: 817-285-8885 F: 817-285-8021

APPROVED:	APPROVED: Interior Designer	APPROVED: Safety Manager	APPROVED: Medical Center Director
APPROVED:	APPROVED:	APPROVED: Infection Control Nurse	APPROVED: Associate Director
APPROVED:	APPROVED:	APPROVED: Industrial Hygienist	APPROVED: Chief of Staff
APPROVED:	APPROVED:	APPROVED: President A.F.G.E. 2250	APPROVED: Chief of Engineering Service

DRAWING TITLE	PROJECT NO.	CONTRACT NO.	DESIGNED BY:	DRAWN BY:	CHECKED BY:
LEVEL 3, A-B WING: ARCH. RCP DEMO PLAN	023-10-104	VA256-P-1355	PRM	BB	PRM
BUILDING NO.	AUTOCAD FILE NAME:	LOCATION	DATE: 05/28/2013		
01		Jack C. Montgomery VA Medical Center	SCALE: 1/8"=1'-0"		

PROJECT TITLE	DATE:	DRAWING NO.
REPLACE INDUCTION UNITS IN BLDG. #1	05/28/2013	AD-3.0
DWG. 08 of 97	DEPARTMENT OF VETERANS AFFAIRS	

DEMOLITION NOTES: (ALL NOTES ARE NOT APPLICABLE TO ALL SHEETS)


- 1 CEILING SLOPES TO ACCOMMODATE MECHANICAL EQUIPMENT. REPLACE CEILING GRID/TILES AS NEEDED. MATCH EXISTING TYPE, COLOR, LAYOUT & HEIGHT.
- 2 CEILING IN THESE AREAS TO BE COMPLETELY REMOVED AND NEW CEILING INSTALLED TO MATCH EXISTING LAYOUT. EXISTING PLASTER CEILING ABOVE LAY IN CEILING TO BE COMPLETELY REMOVED. REFER TO HVAC PLANS FOR UNIT LOCATIONS.
- 3 SEE MECH. NOTES FOR RE-PIPPING WALL MOUNTED RADIATORS, TYP. PATCH/REPAIR FLOOR/WALL & PAINT/TEXTURE WALL TO MATCH EXIST.
- 4 REMOVE/REPLACE CLG. GRID & TILES AS REQUIRED TO REMOVE EXIST. HVAC AND INSTALL NEW. REUSE EXIST. CLG. TILES AS REQUIRED TO MAINTAIN A UNIFORM APPEARANCE. REINSTALL ALL EXISTING CEILING MOUNTED DEVICES.
- 5 REMOVE & REPLACE TSTAT AND/OR FAN CONTROL SWITCH AS INDICATED ON HVAC PLANS. PATCH/REPAIR & PAINT/TEXTURE WALL TO MATCH EXISTING CONDITIONS.
- 6 REMOVE EXISTING CLG. INSTALL NEW CLG. GRID & TILES MATCH EXIST.
- 7 REMOVE DUCTWORK AS REQUIRED PER HVAC PLANS. PATCH/REPAIR WALL ABOVE CLG. TO RESTORE (1) HOUR FIRE RATING.
- 8 REMOVE REGISTER/DUCTWORK AS REQUIRED PER HVAC PLANS. PATCH/REPAIR WALL TO RESTORE (1) HOUR FIRE RATING.
- 9 CEILING IN THESE AREAS TO BE COMPLETELY REMOVED AND REINSTALLED TO MATCH EXISTING LAYOUT. EXISTING PLASTER CEILING ABOVE TO BE REMOVED AROUND NEW FCU. REFER TO HVAC PLANS FOR UNIT LOCATIONS AND CLEARANCES.
- 10 REMOVE EQUIP. PER HVAC PLANS. REPAIR WALL EXTERIOR & INTERIOR.
- 11 INSTALL NEW 2'-0"X2'-0" LAY IN CEILING TILES. USE EXISTING 2'-0"X2'-0" CEILING LAYOUT TO MATCH. ADJUST AS NEEDED TO AVOID EXISTING SPRINKLER HEADS. REFER TO SPECIFICATIONS FOR 2'-0"X2'-0" TILE. REINSTALL ALL EXISTING CEILING MOUNTED DEVICES.
- 12 COORDINATE AN ACCEPTABLE TEMPORARY BARRIER WITH THE V.A.'S INFECTIOUS CONTROL OFFICER IN HATCHED AREAS.
- 13 REFER TO MECHANICAL FOR REMOVAL OF WALL RADIATOR. PATCH/REPAIR & PAINT/TEXTURE WALL TO MATCH EXISTING CONDITIONS.
- 14 REFER TO MECHANICAL FOR REMOVAL OF FCU. PATCH/REPAIR FLOOR TO MATCH EXISTING CONDITIONS.
- 15 CEILING IN THESE AREAS TO BE COMPLETELY REMOVED & NEW CEILING INSTALLED TO MATCH EXISTING LAYOUT.
- 16 REFER TO HVAC PLANS FOR WORK IN THIS AREA. REPLACE ANY CEILING TILES/GRID DAMAGED BY HVAC WORK.
- 17 REWORK FURR-DOWN BEHIND FCU AS REQUIRED TO REMOVE/REPLACE FCU. PAINT/TEXTURE FURR-DOWN TO MATCH EXISTING WALLS.
- 18 PATCH WALL ABOVE CEILING TO MATCH EXISTING CONDITIONS.
- 19 REMOVE/REPLACE CEILING GRID & TILES AS REQUIRED TO INSTALL NEW HVAC EQUIPMENT. RE-USE EXISTING CEILING TILES AS REQUIRED TO MAINTAIN A UNIFORM APPEARANCE.
- 20 NEW WALL, 5/8" SIP. BD. OVER 3/8" MTL. STUDS. EXTEND THROUGH CEILING. TEXTURE, PAINT WALL AND INSTALL COVE BASE TO MATCH EXISTING. ADJUST CEILING AS REQ'D. REFER TO ELECTRICAL.

SYMBOL LEGEND:

- EXISTING FLOURESCENT LIGHT FIXTURES
- EXISTING CAN LIGHT FIXTURES
- EXISTING EXIT LIGHT
- EXISTING CEILING GRID. SEE PLAN FOR LAYOUT
- NEW 2'-0"X2'-0" ACOUSTICAL CEILING GRID
- EXISTING CEILING HEADER
- EXISTING SPEAKER
- EXISTING FIRE STROBE
- EXISTING SMOKE DETECTOR
- EXISTING MOTION SENSOR
- EXISTING SPRINKLER HEAD
- NURSE CALL LIGHT

GENERAL NOTES:

1. COLUMN LINES SHOWN FOR REFERENCE ONLY
2. VERIFY ALL CEILING HEIGHTS
3. SALVAGE EXISTING CEILING TILE & USE WHERE NEEDED TO MAINTAIN A UNIFORM APPEARANCE
4. REFER TO MAINTENANCE STAFF ON-SITE FOR PAINT COLOR P/S. PAINT/TEXTURE ANY WALL DISTURBED DURING CONSTRUCTION OR WHERE EQUIPMENT IS REMOVED.
5. REFER TO MECHANICAL PLANS FOR HVAC UNITS TO BE REPLACED. REPLACE CEILING GRID/TILES AS NEEDED. MATCH EXISTING TYPE, COLOR, LAYOUT & HEIGHT
6. VA TO DEMO SHOWER/TUB & CERAMIC TILE WALLS IN COPY ROOM 3405-1. S.C. TO ADD 6"X6" BD. OVER STUD WALLS WHERE REQ'D & TAPEB'D/TEXTURE & PAINT. INSTALL NEW V.C.T. FLOORING & VINYL BASE.
7. REFER TO MECHANICAL PLANS FOR WALL MOUNTED RADIATOR DEMOLITION. PATCH/REPAIR AND REPAINT WALL BEHIND RADIATORS. TYPICAL ON FIRST FLOOR IN AREA OF WORK.
8. IF A ROOM HAS NO CEILING OR NOTES, THEN THERE IS NO ARCHITECTURAL WORK IN THAT ROOM.




KEY PLAN
SCALE: NO SCALE
PROJECT NORTH

ASBESTOS NOTE:
IF THE EXECUTION OF THIS WORK REQUIRES THE DISTURBING OF ANY SUBSTANCE WHICH APPEARS TO BE ASBESTOS OR WHICH MAY CONTAIN ASBESTOS FIBER, NOTIFY THE OWNER BEFORE CONTINUING WORK AT THE SUSPECT LOCATION. ANY MATERIAL TESTING POSITIVE SHALL BE REMOVED BY THE OWNER BEFORE WORK CONTINUES.

NOTE: EXISTING CONDITIONS SHOWN WERE DERIVED FROM OWNER FURNISHED DRAWINGS AND FIELD OBSERVATIONS. SOME BUILDING FEATURES AND MEP SYSTEMS ARE NOT SHOWN FOR CLARITY. FIELD VERIFY BUILDING CONSTRUCTION. FIELD VERIFY THE LOCATION, SIZE AND QUANTITY OF ALL EQUIPMENT.

NOTE: REFER TO DETAILS AND SCHEMATICS FOR PIPING, VALVES, FITTINGS AND OTHER APPURTENANCES REQUIRED, BUT NOT SHOWN FOR CLARITY.

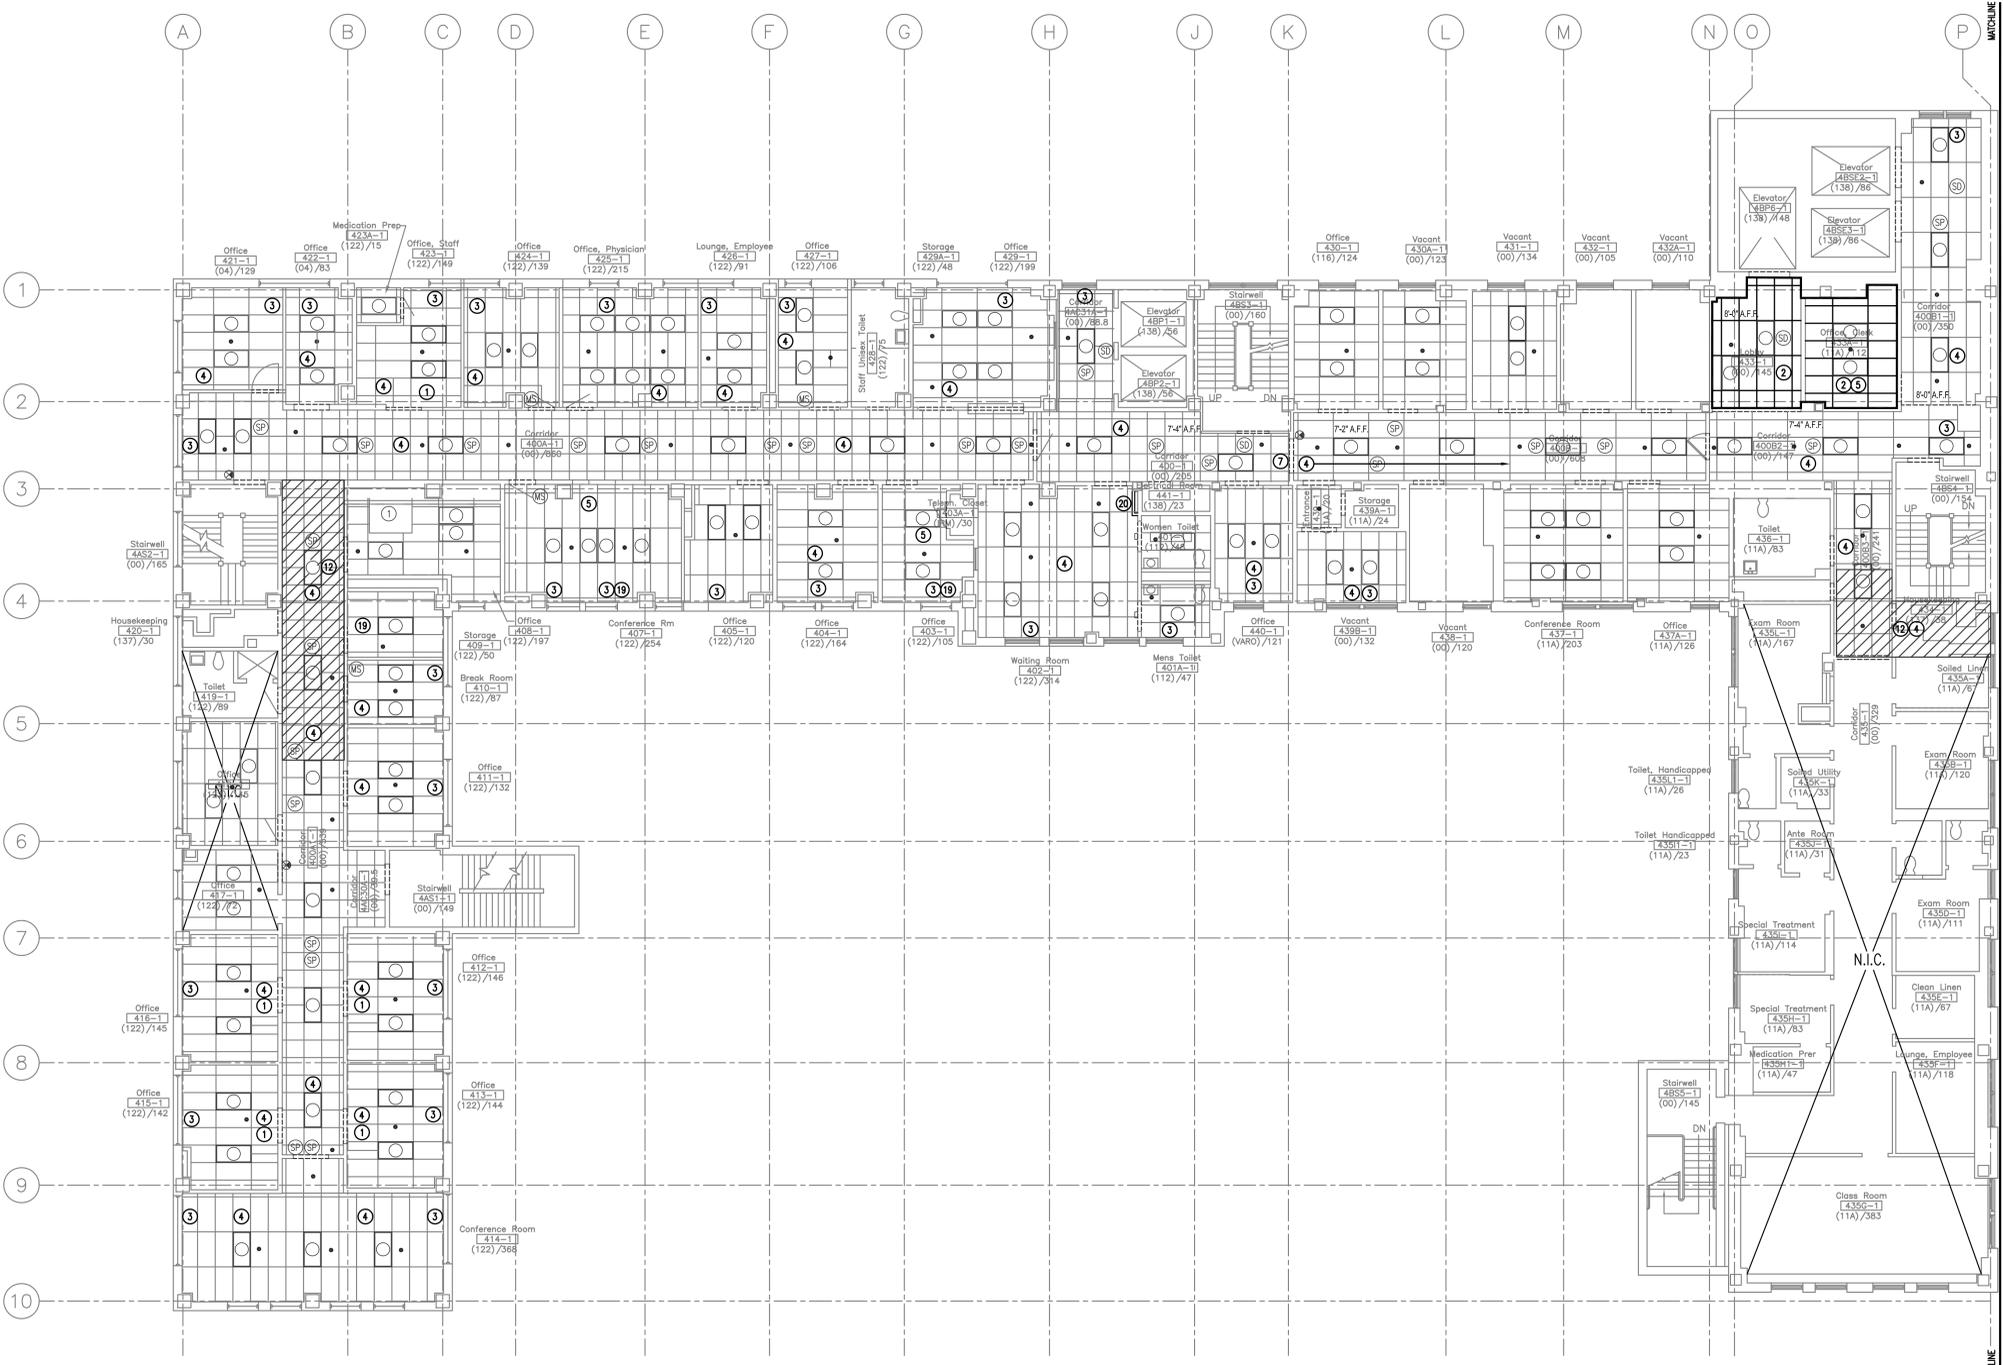

1 LEVEL 4, A-B WING: ARCHITECTURAL RCP DEMO PLAN
1/8"=1'-0"

REVISIONS:	DESCRIPTION:	DATE:

Dept. of Veterans Affairs
Jack C. Montgomery
Medical Center
 1011 Honor Height Drive
 Muskogee, Oklahoma 74401

ENGINEER:
 RMD CONSULTING, LLC
 2815 VALLEY VIEW LANE, STE. 214
 DALLAS, TX 75234
 P: 972-488-8077 F: 972-488-8174
 PROJECT NUMBER: 11-5801
 OK REG. ENGINEERING FIRM: 5183

CONSULTANTS:
ARCHITECT:
 ARCHITECTURAL CONCEPTS, INC.
 669 AIRPORT FREEWAY, STE. 400
 HURST, TX 76053
 P: 817-285-8885 F: 817-285-8021

APPROVED:	APPROVED: Interior Designer	APPROVED: Safety Manager	APPROVED: Medical Center Director
APPROVED:	APPROVED:	APPROVED: Infection Control Nurse	APPROVED: Associate Director
APPROVED:	APPROVED:	APPROVED: Industrial Hygienist	APPROVED: Chief of Staff
APPROVED:	APPROVED:	APPROVED: President A.F.G.E. 2250	APPROVED: Chief of Engineering Service

DRAWING TITLE	PROJECT NO.	CONTRACT NO.	DESIGNED BY:	DRAWN BY:	CHECKED BY:
LEVEL 4, A-B WING: ARCH RCP DEMO. PLAN	023-10-104	VA256-P-1355	PRM	BB	PRM
BUILDING NO.	AUTOCAD FILE NAME:	LOCATION	DATE:	SCALE:	DRAWING NO.
01		Jack C. Montgomery VA Medical Center	05/28/2013	1/8"=1'-0"	AD-4.0

PROJECT TITLE	DATE:	SCALE:	DRAWING NO.
REPLACE INDUCTION UNITS IN BLDG. #1	05/28/2013	1/8"=1'-0"	AD-4.0
DWG. 09 of 97			

DEPARTMENT OF VETERANS AFFAIRS