



one foot  
 one half inch  
 three eighths inch  
 one quarter inch  
 one eighth inch  
 one sixteenth inch  
 one thirty second inch

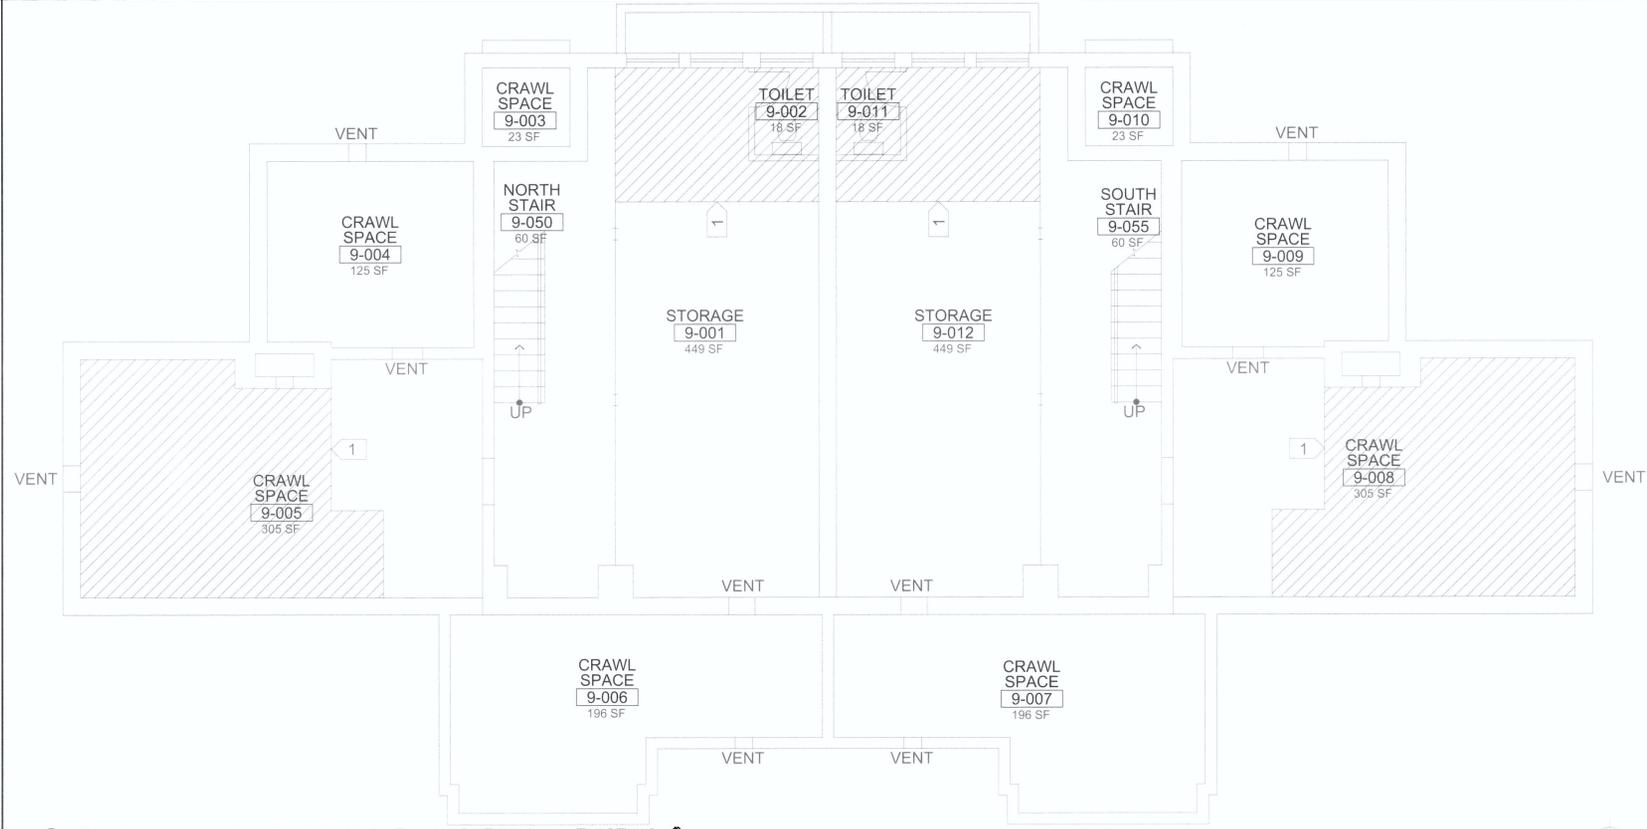

1 BUILDING 9 - BASEMENT FLOOR HVAC PLAN - EXISTING

1/4" = 1' - 0"

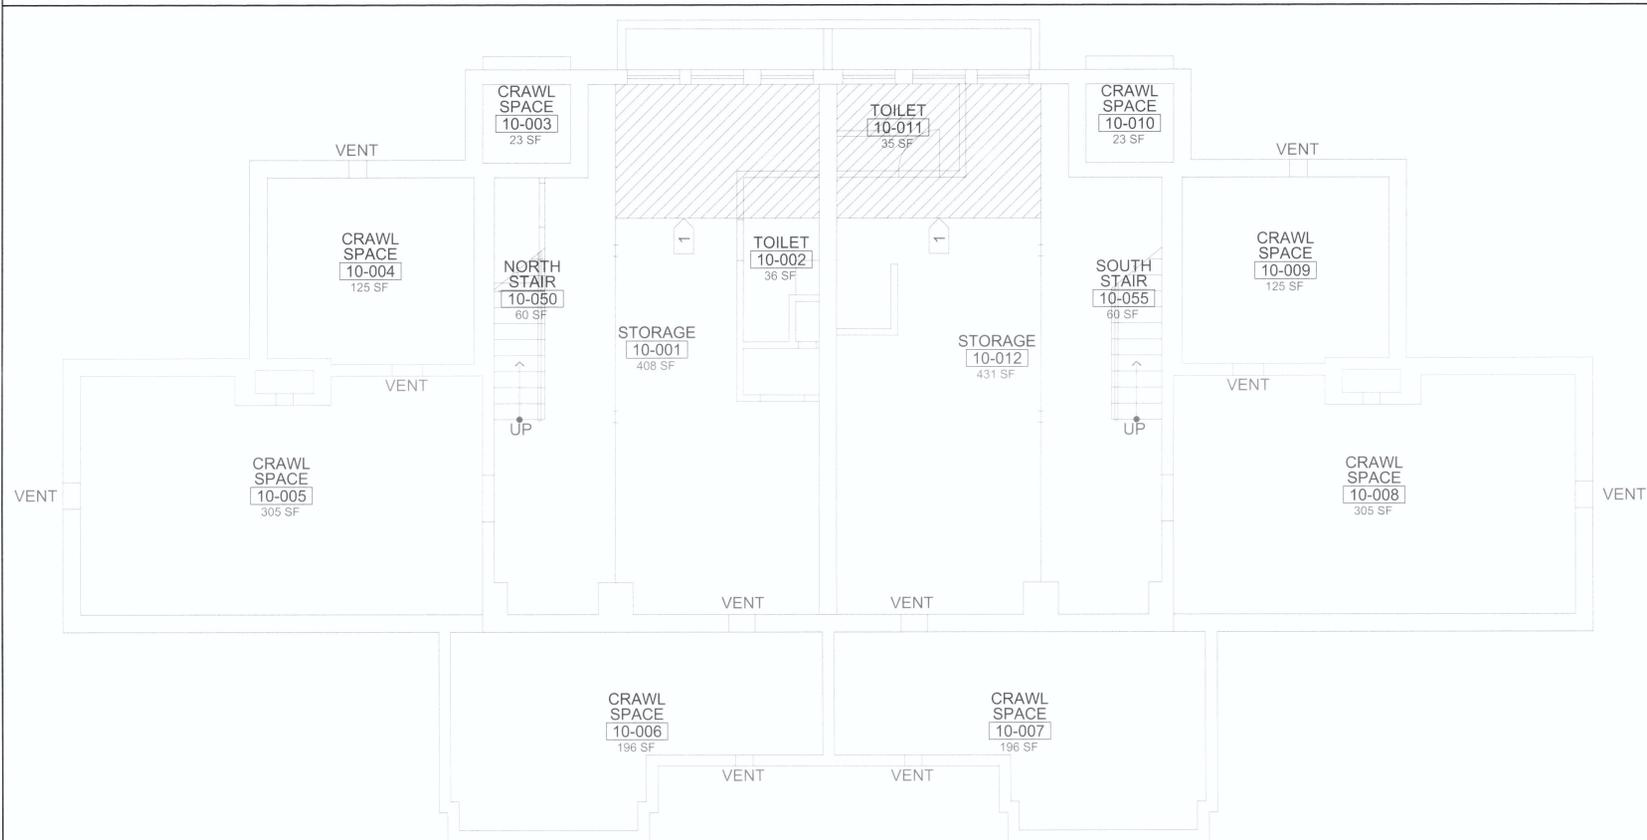

1 BUILDING 10 - BASEMENT FLOOR HVAC PLAN - EXISTING

1/4" = 1' - 0"

**PHASING AND SHUTDOWN SCHEDULE**  
 UNDER NO CIRCUMSTANCES SHALL EXISTING SERVICES BE INTERRUPTED WITHOUT PRIOR WRITTEN APPROVAL BY THE FACILITY. THE REQUEST FOR THE APPROVAL SHALL BE SUBMITTED TO THE FACILITY AND SHALL ALSO STATE THE MAXIMUM DURATION OF THE SHUTDOWN. ALL INTERRUPTION OF UTILITY TIE-IN WORK SHALL BE SCHEDULED WELL IN ADVANCE AND WRITTEN NOTICE SHALL BE GIVEN TO THE FACILITY AT LEAST FOURTEEN DAYS BEFORE THE DESIRED SHUTDOWN.

**LEGEND:**  
 AREA OF WORK

**GENERAL HVAC NOTES:**

1. PRIOR TO START OF SEISMIC WORK IN THE CRAWL SPACE FIELD IDENTIFY AND REPORT TO ARCHITECT ANY HVAC COMPONENTS INCLUDING BUT NOT LIMITED TO DUCTWORK, STEAM PIPING, AND SUPPORTS THAT ARE IN THE WAY OF NEW SEISMIC WORK.
2. INFORM THE FACILITY OF ANY HVAC COMPONENTS THAT ARE REQUIRED TO BE RELOCATED TO ALLOW CONSTRUCTION OF NEW SEISMIC WORK.
3. PROTECT ALL HVAC COMPONENTS THAT ARE NEAR CONSTRUCTION OF NEW SEISMIC WORK TO PRESERVE ITS INTEGRITY AND FUNCTION.
4. ALL HVAC SERVICES IN THE CRAWL SPACE ARE ACTIVE AND IN SERVICE. AFTER COMPLETION OF NEW SEISMIC WORK, VERIFY THAT ALL ELECTRICAL AND OTHER SERVICES ARE FUNCTIONING TO THEIR ORIGINAL CONDITIONS BEFORE THE CONSTRUCTION OF NEW SEISMIC WORK.
5. REFER TO ARCHITECTURAL AND STRUCTURAL DRAWINGS FOR ADDITIONAL INFORMATION.


**KEYED NOTES:**

1. REMOVE AND REINSTALL EXISTING HEATING HOT WATER PIPING AND ALL OTHER HVAC EQUIPMENT AFFECTED BY ARCHITECTURAL AND STRUCTURAL SEISMIC WORK. FIELD VERIFY BEFORE STARTING SEISMIC WORK.

Revisions:	Date

**CONSULTANTS:**

STRUCTURAL: DEGENKOLB ENGINEERS, 235 MONGOMERY STREET, SUITE 500, SAN FRANCISCO, CA 94104  
 MECHANICAL: HTC ENGINEERS, 1529 CYPRESS ST., SUITE 103, WALNUT CREEK, CA 94596  
 ELECTRICAL: BAY AREA CONSULTING ENGINEERS, 311 CALIFORNIA STREET, SUITE 720, SAN FRANCISCO, CA 94104  
 CIVIL ENGINEER: GHD CIVIL ENGINEERS, 2235 MERCURY WAY, SUITE 150, SANTA ROSA, CA 95407  
 ESTIMATING: CUMMING CORPORATION, 1970 BROADWAY, SUITE 630, OAKLAND, CA 94612  
 SURVEYORS: MARTIN M. RON ASSOCIATES, INC., 859 HARRISON ST., SUITE 200, SAN FRANCISCO, CA 94107  
 UTILITY LOCATORS: CRUZ BROTHERS LOCATORS, P.O. BOX 66768, SCOTT'S VALLEY, CA 95067



**ARCHITECT/ENGINEERS:**

**HGA** Architecture | Engineering | Planning  
 Hammel, Green and Abrahamson, Inc.  
 445 Bush Street - Fourth Floor  
 San Francisco, California USA 94108  
 Telephone 415.962.2592  
 Facsimile 415.962.2598

TRUE

Drawing Title  
 BLDG 9&10 - BASEMENT FLOOR  
 HVAC PLANS - EXISTING

Scale:

Approved: Project Director

Project Title  
**VA Medical Center  
 Seismic Replacement and  
 Retrofit**

Location  
**San Francisco, CA**

Date  
 10 / 22 / 2012

Checked  
 WHA

Drawn  
 MR

Project Number  
**2941-001-00**

Building Number  
**9, 10 & 22**

Drawing Number  
**M101**

**Office of  
 Facilities  
 Management**