


three inches = one foot
 one and one half inch = one foot
 one inch = one foot
 three quarters inch = one foot
 one half inch = one foot
 three eighths inch = one foot
 one quarter inch = one foot
 one eighth inch = one foot
 one sixteenth inch = one foot

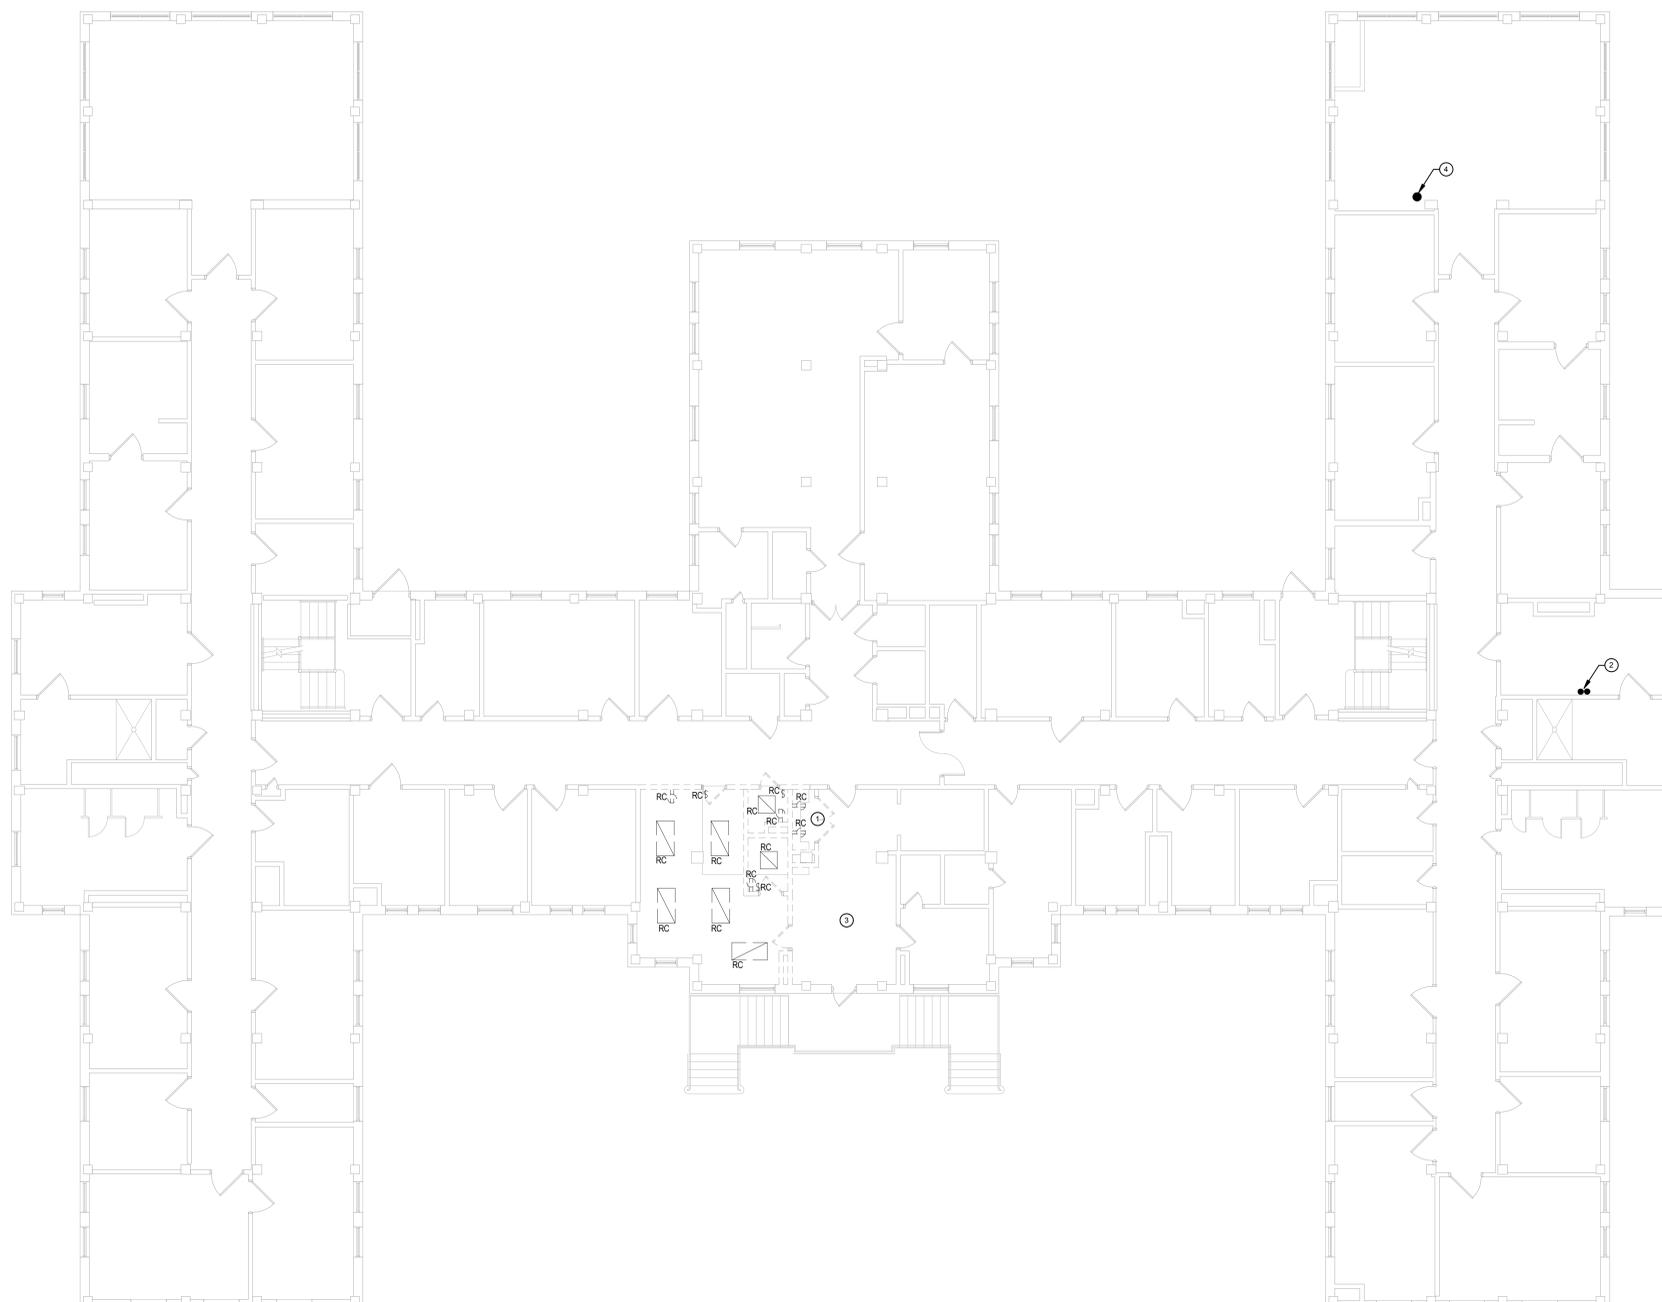

ELECTRICAL DEMOLITION NOTES (This Drawing)

- EQUIPMENT SHOWN TO BE REMOVED IS DIAGNOSTIC AND DOES NOT REPRESENT THE FULL SCOPE OF DEMOLITION WORK. REMOVE ALL POWER, LIGHTING, FIRE ALARM, AND TELECOMMUNICATIONS DEVICES AND EQUIPMENT LOCATED WITHIN RENOVATION AREA UNLESS NOTED OTHERWISE. REMOVE WIRING BACK TO SOURCE OF SIGNAL/TASK ORIGINATION. EXISTING TELECOMMUNICATIONS EQUIPMENT, INCLUDING TELECOMMUNICATION SWITCHES AND PATCH PANELS ARE TO BE REMOVED AND RELOCATED TO LOCATION SHOWN ON NEW WORK PLANS.
- CONTRACTOR SHALL PROVIDE A MINIMUM TWO WEEKS WRITTEN NOTICE PRIOR TO ANY SHUT DOWN. NOTICE IS TO INCLUDE BUT IS NOT LIMITED TO THE LOCATION, PANELS, AND DURATION OF SHUT DOWN.
- COTR SHALL HAVE RIGHT OF FIRST REFUSAL TO ANY EQUIPMENT, DEVICES, LUMINAIRES, ETC. DEMOLISHED FROM THE RENOVATION AREA PRIOR TO DISPOSAL.
- PROTECT THE EXISTING EQUIPMENT THAT IS TO REMAIN IN PLACE FROM DIRT, DUST, OR DAMAGE DURING THE COURSE OF DEMOLITION.
- THE EXISTING FIRE ALARM CIRCUITS SERVING AREAS OUTSIDE OF THE SCOPE OF WORK SHALL REMAIN OPERATIONAL DURING THE ENTIRE DURATION OF THE CONSTRUCTION.
- PROVIDE TEMPORARY SMOKE OR HEAT DETECTION ON THE FLOOR DURING THE ENTIRE DURATION OF CONSTRUCTION. SMOKE DETECTION SHALL BE PROTECTED FROM CONSTRUCTION DUST DURING WORKING HOURS ONLY, IN AREAS WHERE CONSTRUCTION WORK IS GOING TO BE OCCURRING.
- REMOVE ALL LIGHTING FIXTURES, EXIT SIGNS, SWITCHES, CONTROL DEVICES, WIRING AND CONDUIT IN THE AREA OF DEMOLITION. REMOVE ALL WIRING BACK TO THE PANELBOARD IT ORIGINATES FROM.
- REMOVE ALL RECEPTACLES, AND OTHER MISCELLANEOUS POWER CONNECTIONS TO EQUIPMENT IN THE AREA OF DEMOLITION SHOWN. REMOVE ALL CONDUIT AND WIRING BACK TO THE BRANCH PANELBOARD IT ORIGINATES FROM.

ELECTRICAL DEMOLITION NUMBERED NOTES (This Drawing)

- REMOVE EXISTING LIGHT AND LIGHT SWITCH IN THIS ROOM. EXISTING EQUIPMENT IN DATA CLOSET SHALL BE DISCONNECTED AND MOVED TO NEW DATA CLOSET AS SHOWN ON DRAWING E101. REFER TO NUMBERED NOTE 1 ON THAT DRAWING FOR REQUIREMENTS. CONTRACTOR SHALL PROVIDE A MINIMUM TWO WEEKS WRITTEN NOTICE PRIOR TO ANY SHUT DOWN. NOTICE IS TO INCLUDE BUT IS NOT LIMITED TO THE LOCATION, PANELS, AND DURATION OF SHUT DOWN.
- CONDUIT RISER FOR PANELBOARDS ON SECOND FLOOR. CONDUIT AND WIRING SHALL BE REMOVED BACK TO SOURCE ELECTRICAL. CONTRACTOR SHALL PATCH FLOOR AT THIS LOCATION AND PROVIDE PROPER FIRE PROOFING TO PROVIDE REQUIRED FLOOR RATING.
- REMOVE EXISTING LIGHTING IN THIS AREA. EXISTING SWITCHING AND CIRCUIT SHALL REMAIN AND BE CONNECTED TO NEW LIGHTING IN THIS AREA SHOWN ON DRAWING E101.
- CONDUIT RISER FOR PANELBOARD IN ATTIC. CONDUIT AND WIRING SHALL BE REMOVED BACK TO SOURCE. ELECTRICAL CONTRACTOR SHALL PATCH FLOOR AT THIS LOCATION AND PROVIDE PROPER FIRE PROOFING TO PROVIDE REQUIRED FLOOR RATING.

ELECTRICAL DEMOLITION LEGEND

ETR	EXISTING TO REMAIN
RR	REMOVE AND RELOCATE
RC	REMOVE COMPLETELY BACK TO SOURCE
RN	REMOVE AND REPLACE WITH NEW DEVICE. EXISTING CONDUIT, WIRING, AND BACKBOX SHALL BE REUSED
—	EXISTING TO REMAIN
- - -	TO BE DEMOLISHED

1 ELECTRICAL DEMOLITION PLAN - FIRST FLOOR
 1/8" = 1'-0"



**FULLY SPRINKLERED
 BID DOCUMENTS**

CONSULTANTS:  HOPE FURRER Associates, Inc.	ARCHITECTS/ENGINEERS:  A E works 6587 HAMILTON AVENUE PITTSBURGH, PENNSYLVANIA 15206 PH: 412.287.7333 FAX: 412.287.7334 www.ae-works.com	Drawing Title ELECTRICAL DEMOLITION PLAN - FIRST FLOOR	Project Title BUILDING 9 - SECOND FLOOR RENOVATION	Project Number 542-13-105	Office of Construction and Facilities Management 
		Approved: Project Director	Location: 1400 Blackhorse Hill Road Coatesville, PA 19320	Building Number 9	
Revisions:	Date	Date 05 / 12 / 14	Checked JJD	Drawn JMZ	