


one eighth inch = one foot  
0 4 6 8  
one quarter inch = one foot  
0 4 6 8  
three eighths inch = one foot  
0 4 6 8  
one half inch = one foot  
0 4 6 8  
three quarters inch = one foot  
0 4 6 8  
one inch = one foot  
0 4 6 8  
one and one half inches = one foot  
0 4 6 8  
two inches = one foot  
0 4 6 8  
three inches = one foot  
0 4 6 8

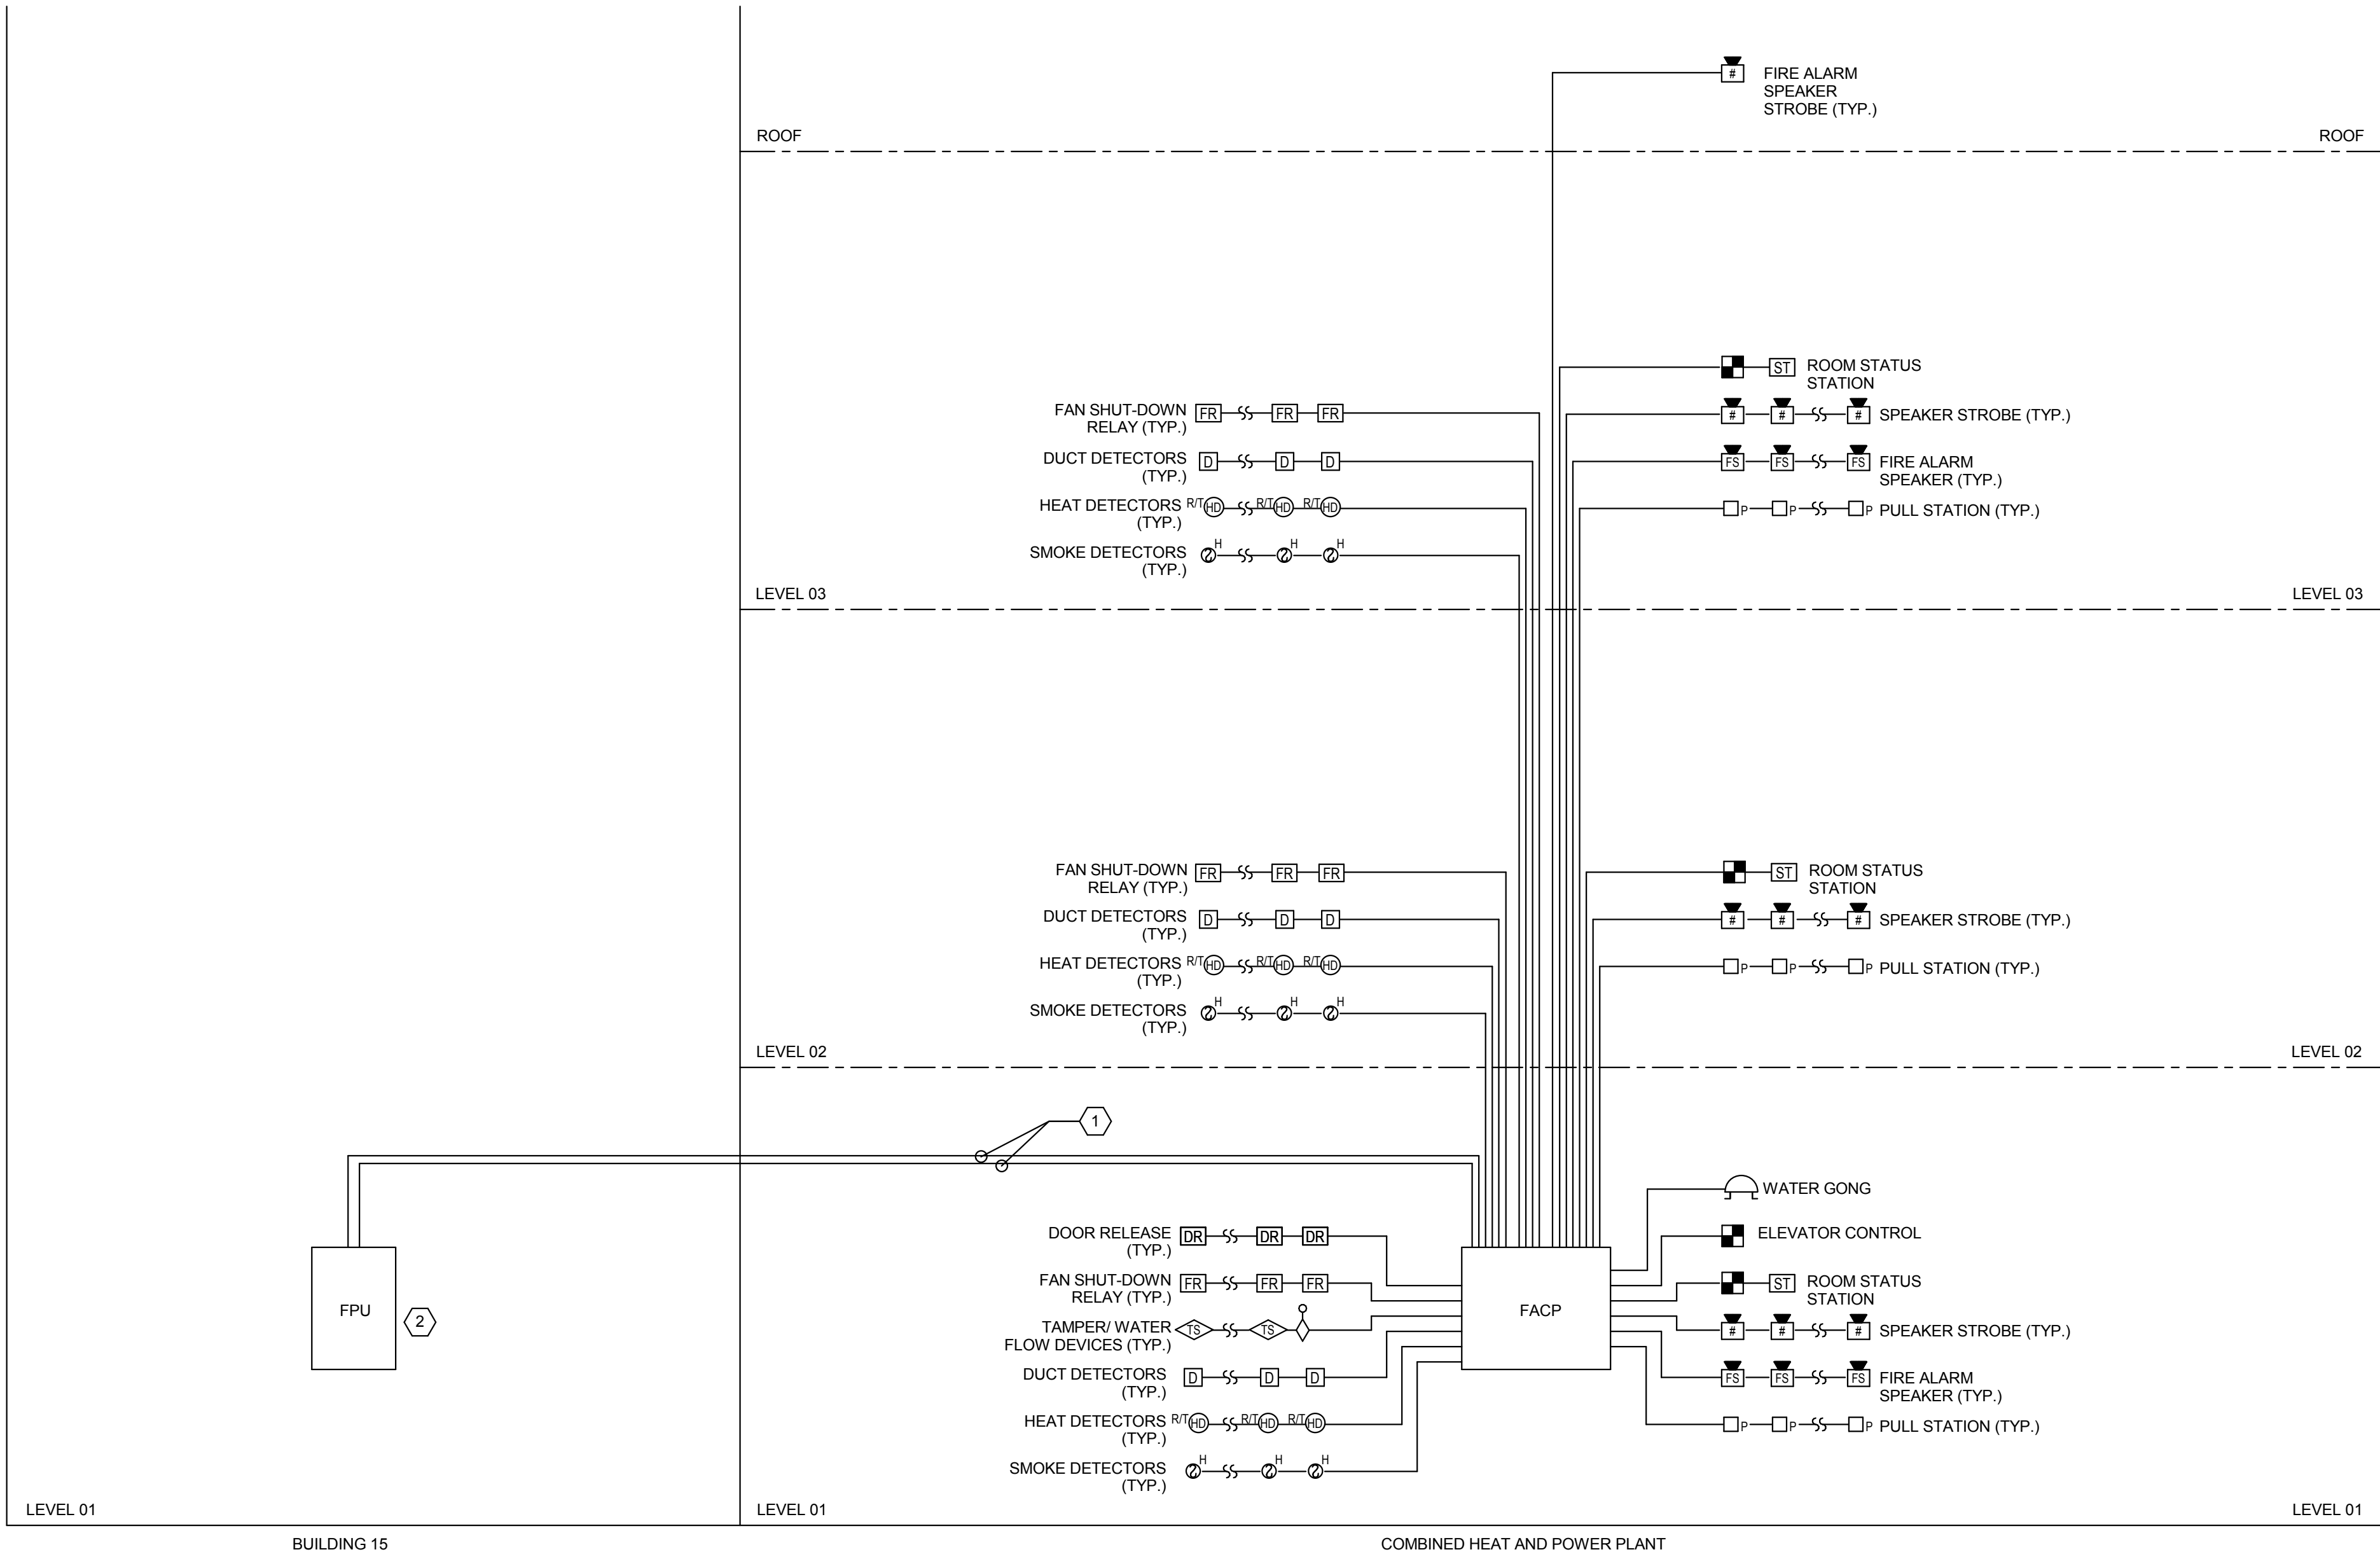

**GENERAL NOTES:**

- A. ALL DEVICES SHOWN CONNECTED TO EITHER A FPU OR FATC SHALL BE CONNECTED IN A PHYSICALLY SEPARATED LOOP.

**KEYED NOTES:**

1. PROVIDE 4 STRAND MULTIMODE FIBER IN 1" CONDUIT FROM FPU IN BUILDING 15 TO FACP IN BUILDING 19. PROVIDE 4 STRAND MULTIMODE FIBER IN 1" CONDUIT FROM FACP IN BUILDING 19 TO FPU IN BUILDING 15. EACH 4 STRAND FIBER SHALL NOT BE COMBINED IN A SINGLE CONDUIT AND SHALL FOLLOW SEPARATE PATHS.
2. UPDATE EXISTING GRAPHIC ANNUNCIATOR TO REFLECT NEW WORK

F4 FIRE ALARM RISER DIAGRAM

Rev. No.	Description	Date
1	ADDENDUM 5	09/04/2014

VA FORM 08-6231

ARCHITECT/ENGINEERS:

**CANNONDESIGN**

100 Cambridge Street, Suite 1400  
Boston, Massachusetts 02114  
T: 617.742.5440 F: 617.723.8832

Drawing Title

**RISER DIAGRAMS**

Approved: Project Director

**JOSEPH SIMONETTA**

Project Title

**WEST HAVEN COMBINED  
HEAT AND POWER (CHP)  
PLANT DESIGN**

Location  
VA MEDICAL CENTER - WEST HAVEN CAMPUS  
950 CAMPBELL AVE, WEST HAVEN, CT 06516

Date  
07/18/2014

Checked  
BP

Drawn  
EP

Project Number  
004243.00

Building Number  
19

Drawing Number

**EP.506**

Office of  
Construction  
and Facilities  
Management

**VA** Department of  
Veterans Affairs