KEYED NOTES:

1. NOT USED
2. FIRE PROOF AND SEAL ROOF OPENINGS TO ACHIEVE 1 1/2–HOUR FIRE RATING.
3. ROUTE 1–1/2" CONDENSATE DRAIN FROM RTU–101 TO SINK P–502 IN ROOM 8F–144.
4. LOCATE SMOKE DAMPERS BELOW ELEVATOR ACCESS FLOOR, TO VENT ELEVATOR SHAFT.
5. SEE ARCHITECTURAL ROOF PLAN FOR RTU–101 CURB FLASHING DETAILS.

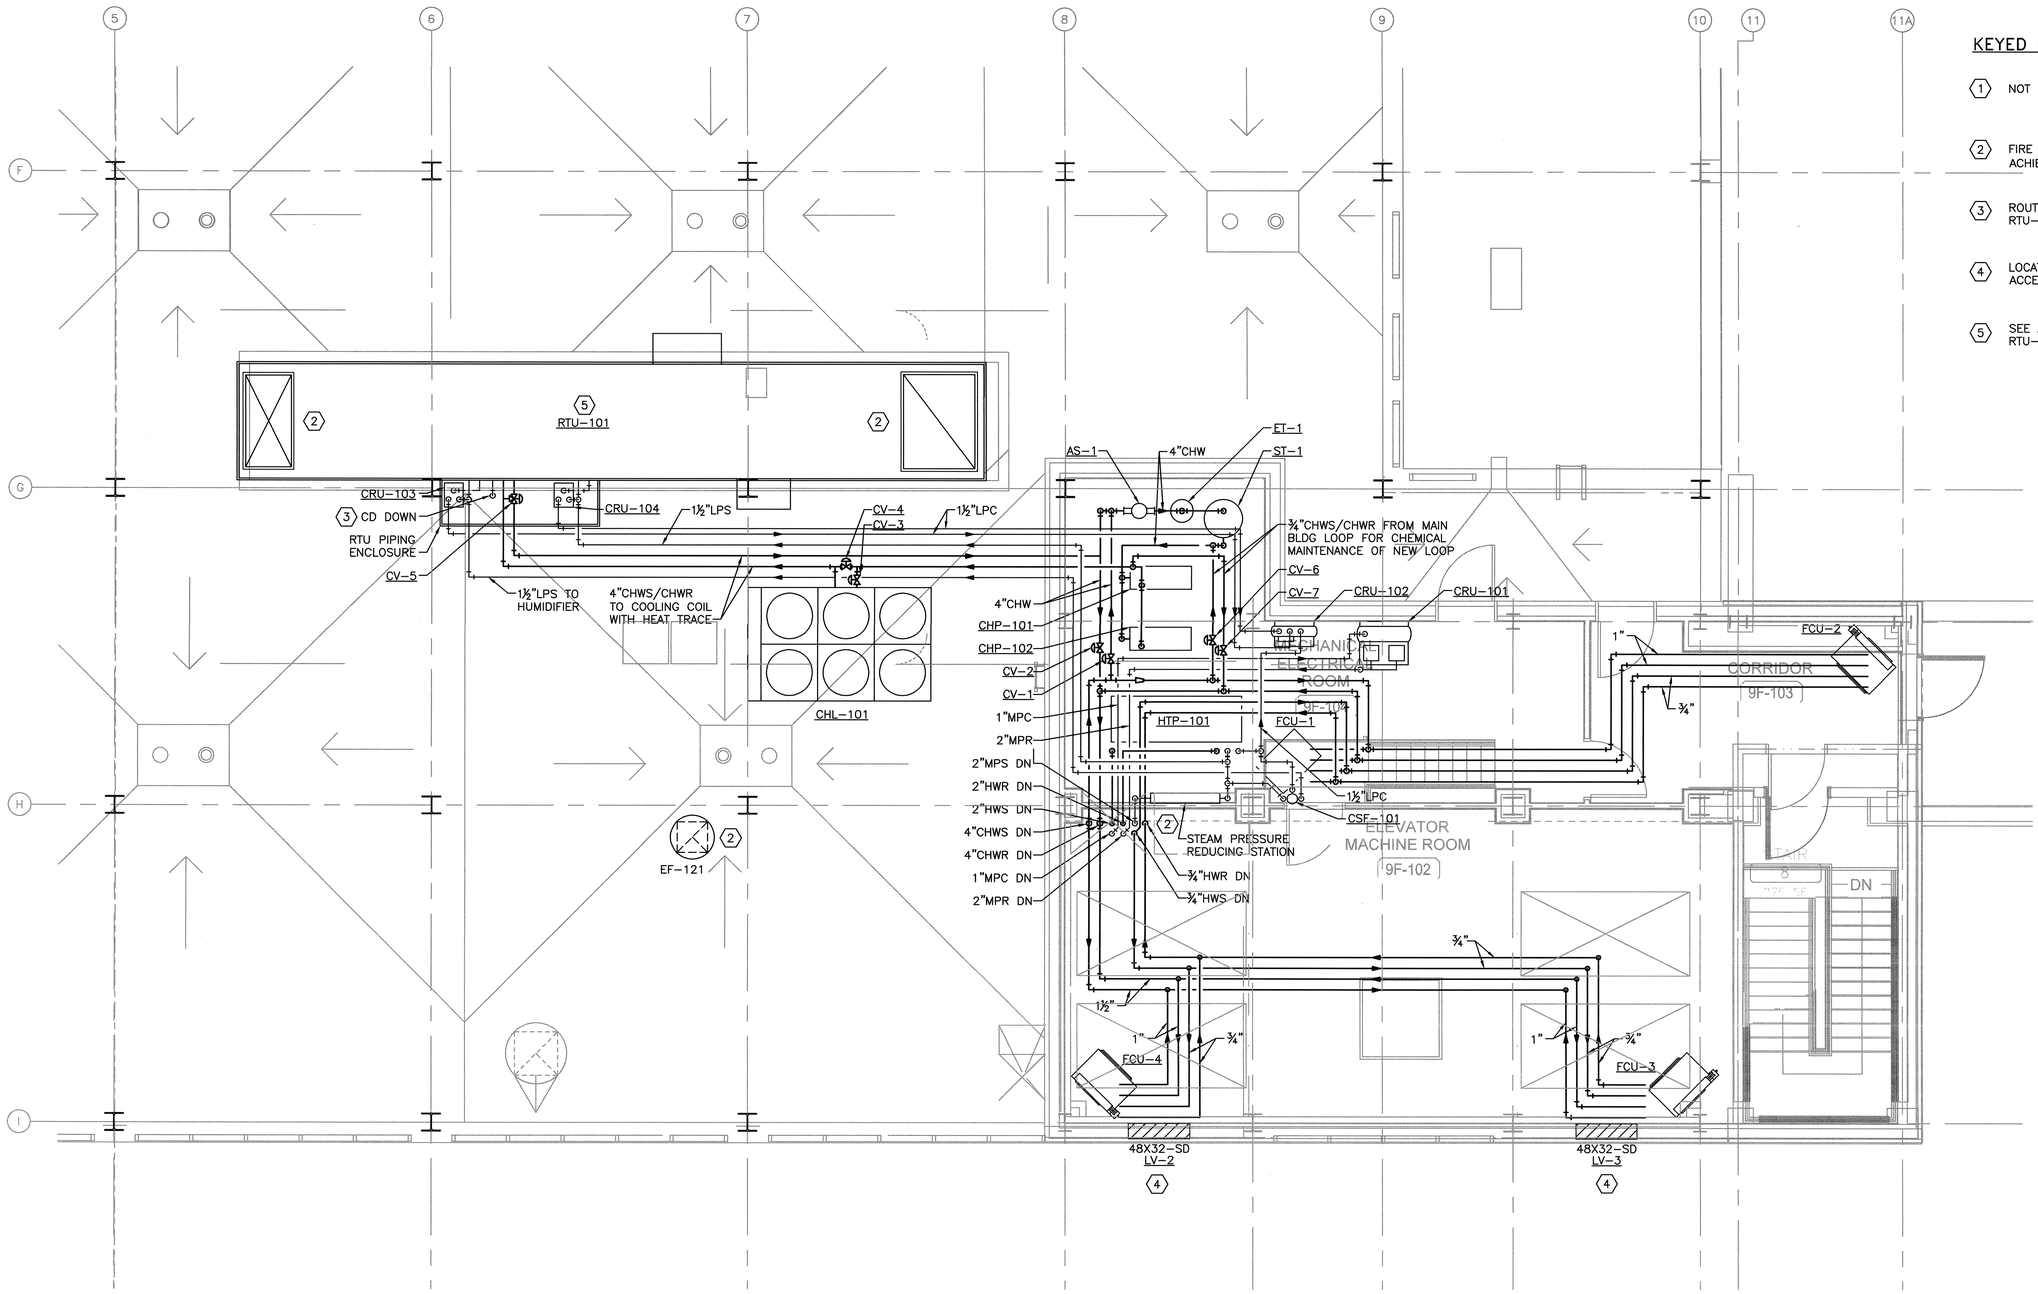

1 MP401 ENLARGED ROOF PIPING PLAN
SCALE: 1/4"=1'-0"

NORTH PLAN

4' 2' 0 4' 8' 12'
SCALE IN FEET (1/4"=1'-0")

FULLY SPRINKLERED

Revisions	Date

CONSULTANTS:

JAMES MARSHALL TAGERT 15160 4-1-13 OKLAHOMA REGISTERED PROFESSIONAL ENGINEER

ARCHITECT/ENGINEERS: CERT. OF AUTHORITY 3722 EXP. 06/30/2013
BENHAM / ELLERBE BECKET

Drawing Title: MECHANICAL ENLARGED ROOF PIPING PLAN	Project Title: OKC VA MEDICAL CENTER 8TH FLOOR SICU ADDITION	Project Number: 635-406	Office of Construction and Facilities Management
Approved: Project Director	Location: OKLAHOMA CITY, OK	Building Number: 001	
	Date: 04/01/2013 / Checked: JEB / Drawn: JMW	Drawing Number: MP401 Dwg. — of —	Department of Veterans Affairs

VA FORM 08–6231