


three inches = one foot
one and one half inches = one foot
one inch = one foot
three quarters inch = one foot
one half inch = one foot
three eighths inch = one foot
one quarter inch = one foot
one eighth inch = one foot
one sixteenth inch = one foot

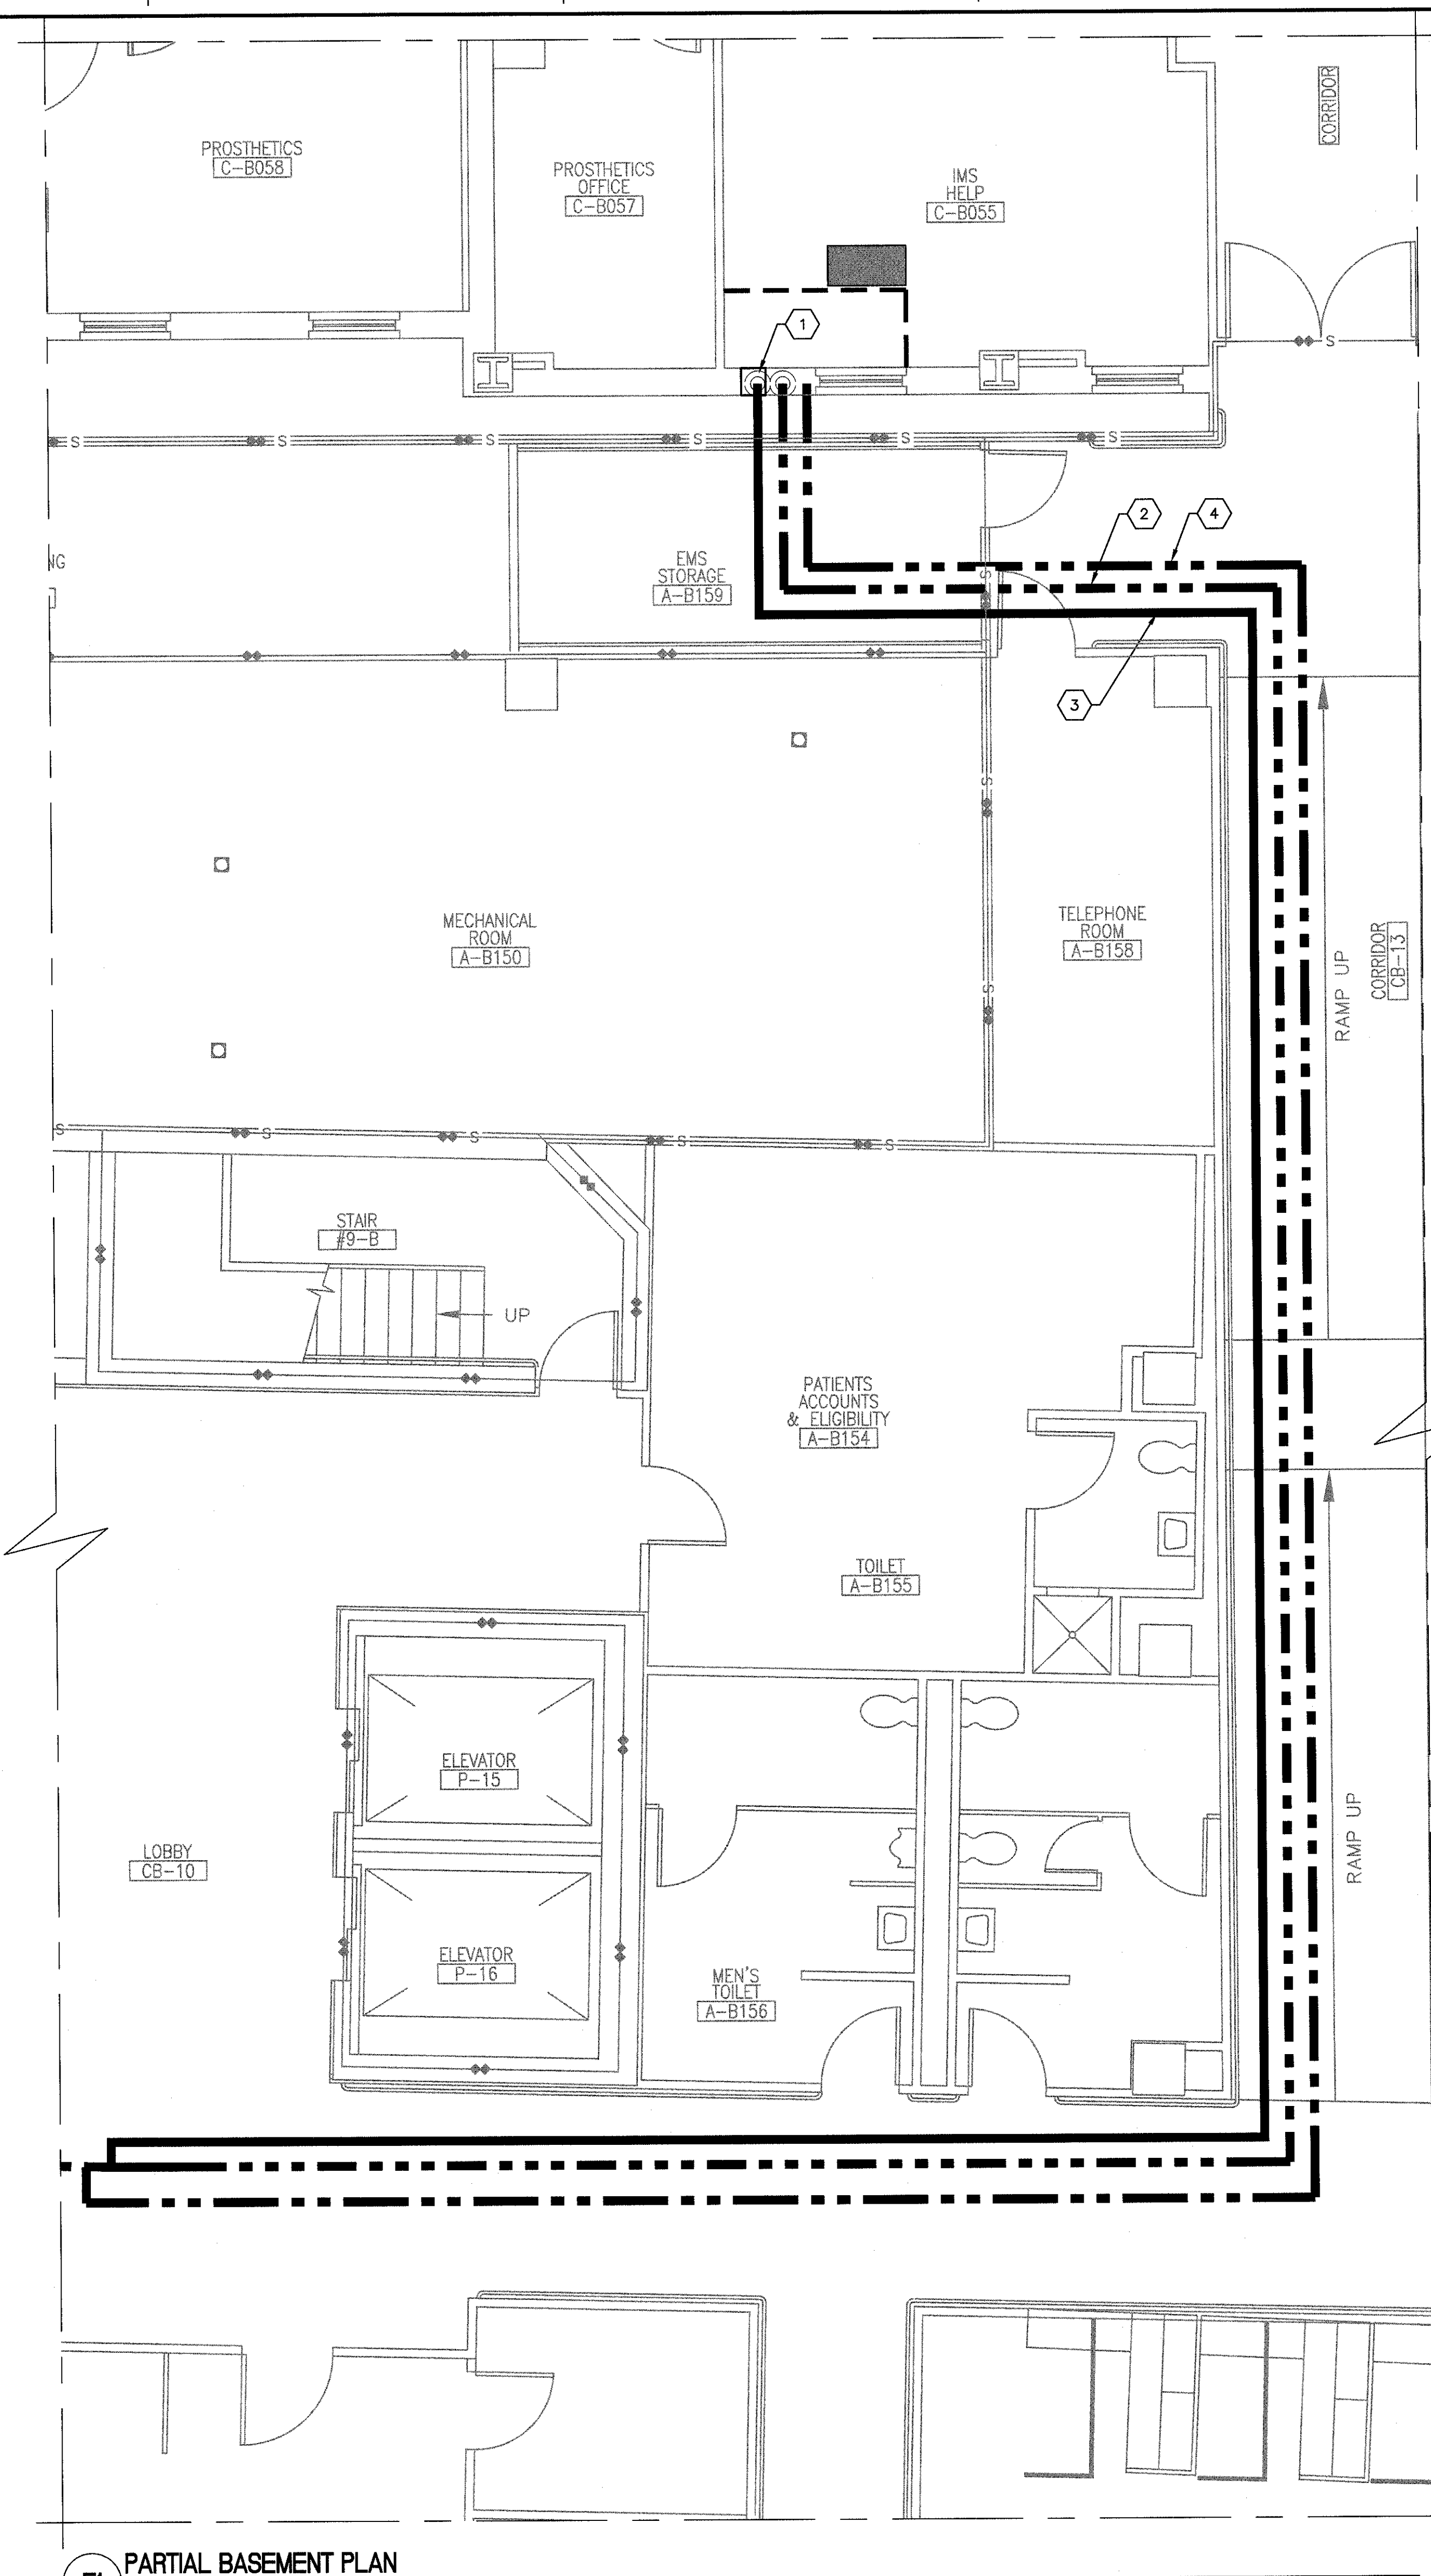

FI PARTIAL BASEMENT PLAN
SCALE: 1/4" = 1'-0"

- NOTES:**
- A. REFER TO SHEET A-001 FOR ABBREVIATIONS AND SYMBOLS.
 - B. REFER TO MECHANICAL, ELECTRICAL, AND PLUMBING SHEETS FOR ADDITIONAL INFORMATION.
 - C. COORDINATE WORK WITH ADJACENT PROJECTS THROUGH THE VA COR.
 - D. PROTECT ALL DOOR FRAMES, BUILDING STRUCTURES, WORK TO REMAIN, AND PREPARE FOR NEW FINISHES.
 - E. EXISTING STRUCTURAL MEMBERS WITHIN LIMITS OF WORK TO REMAIN.
 - F. EXISTING EXTERIOR WALL CONSTRUCTION, AND WINDOWS WITHIN LIMITS OF WORK TO REMAIN.
 - G. PERFORM DAILY CLEAN UP, AND PROTECT ALL AREAS TO REMAIN FROM DAMAGE.
 - H. 70% OF CONSTRUCTION WASTE SHALL BE DIVERTED FROM LANDFILLS.
 - I. ALL SALVAGED MATERIAL SHALL BE TURNED OVER TO THE VA UNLESS INSTRUCTED TO REINSTALL/RELOCATE AS PER THIS PROJECT'S SCOPE OF WORK.
 - J. ALL WORK ON THIS SHEET TO BE PERFORMED AFTER ACTIVE OFFICE HOURS TO AVOID CONFLICTS WITH HOSPITAL FUNCTIONS.

- KEY NOTES:**
- 1. INSTALL NEW FIRE PROTECTION PLUMBING INSIDE EXPOSED PARTITION. PATCH/REPAIR EXISTING PARTITION. PREPARE FOR NEW PAINTED FINISH TO MATCH ADJACENT FINISHES.
 - 2. EXISTING FIRE PROTECTION PLUMBING ABOVE CEILING.
 - 3. NEW FIRE PROTECTION PLUMBING ABOVE CEILING.
 - 4. FURNISH AND INSTALL TEMPORARY INFECTION AND DUST CONTROL BARRIERS ALONG FIRE PROTECTION PLUMBING ROUTE WHERE CEILING TILES ARE TO BE REMOVED.


INFECTION AND DUST CONTROL PLAN LEGEND
GENERAL NOTE: REFER TO SHEET AD101 FOR GENERAL INFECTION AND DUST CONTROL NOTES.

EXISTING PARTITION TO REMAIN	PROVIDE TEMPORARY INFECTION AND DUST CONTROL BARRIERS AT THIS LOCATION. REMOVE AFTER CONSTRUCTION IS COMPLETED.
DUST MAT (3'-0" X 2'-0")	

NOTE: ALL SYMBOLS MAY NOT BE USED


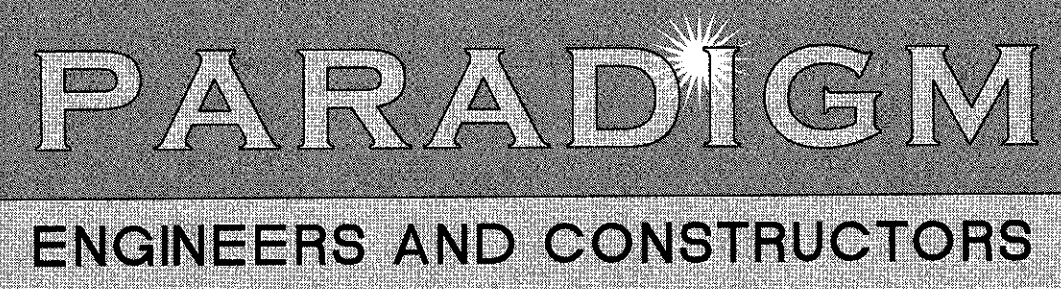

CEILING MODIFICATION LEGEND
GENERAL NOTE: REMOVE AND REPLACE ACOUSTICAL CEILING PANELS AS NEEDED TO INSTALL SPRINKLER PIPING ALONG PATH SHOWN. PROVIDE TEMPORARY, MOBILE INFECTION AND DUST CONTROL BARRIER ALONG NEW SPRINKLER PIPING ROUTE. REFER TO SHEET AD101 FOR GENERAL INFECTION AND DUST CONTROL NOTES.

PATH OF SPRINKLER PIPING TO BE INSTALLED	
EXISTING SPRINKLER PIPING	
NEW SPRINKLER PIPING	

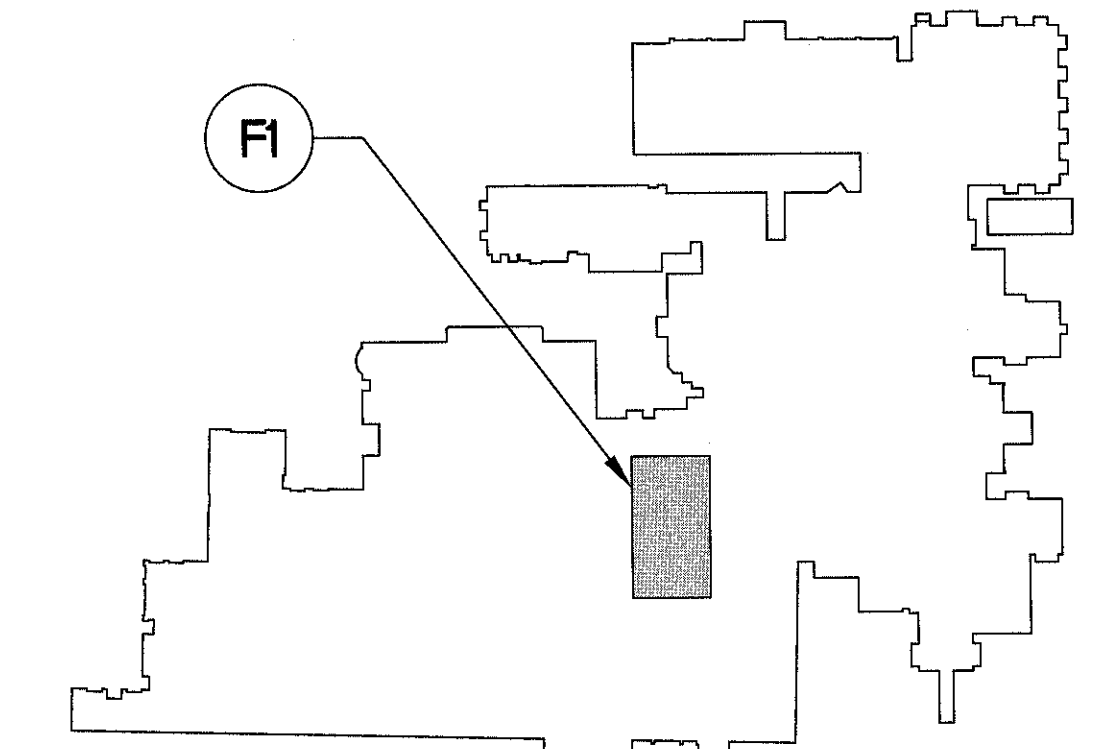

KEY PLAN
NOT TO SCALE

FULLY SPRINKLERED
BID DOCUMENTS - FOR CONSTRUCTION

Revisions: 	CONSULTANTS: 		ARCHITECT/ENGINEERS:  200 Envoy Circle #201, Louisville KY 40299 - PH: 502.339.8511 - www.paradigmusa.com	Drawing Title ARCHITECTURAL NEW WORK PLAN	Project Title REPLACE FIRE PUMP BUILDING 1	Project Number 583-13-121	Office of Construction and Facilities Management 
				Approved Project Director 	Location RICHARD L. ROUBENBUSH VAMC 1481 W 10TH STREET, INDIANAPOLIS IN 46202	Building Number 1	
				Date 12-2-2014	Checked JCP	Drawn LSS	