


1 MEP
1/4" = 1'-0"

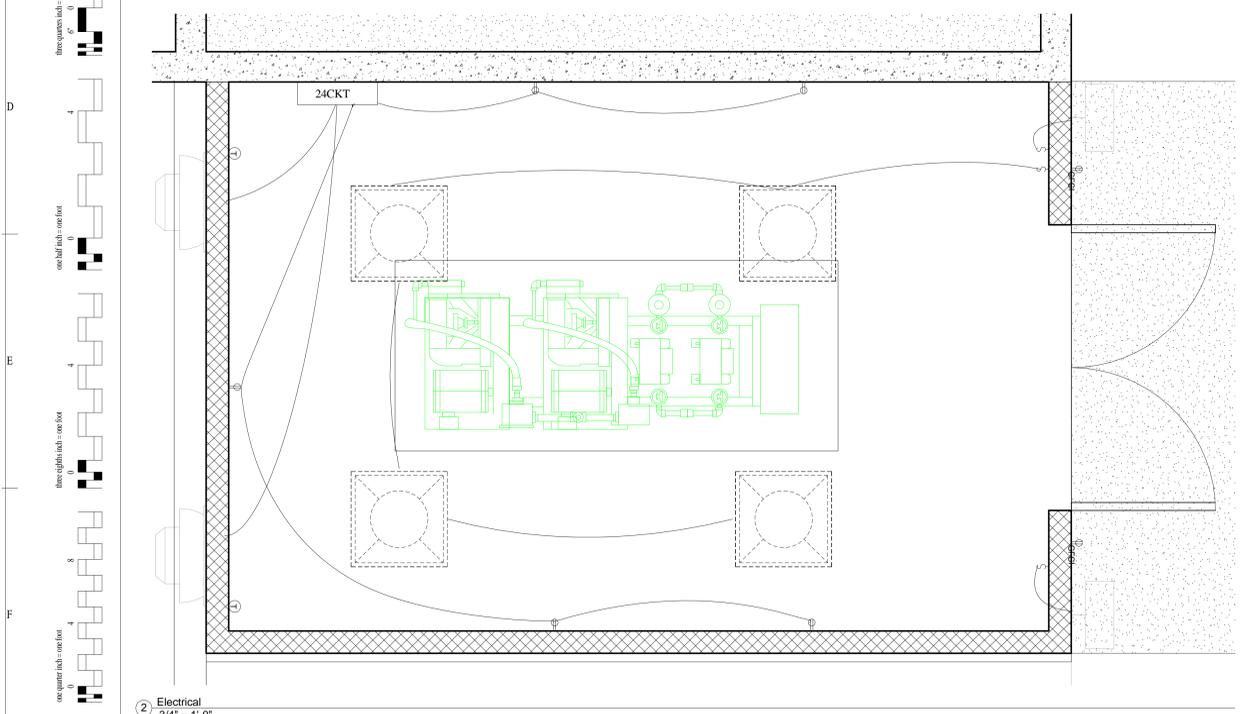

2 Electrical
3/4" = 1'-0"

NOTES BY SYMBOL "□"

- 1 EXISTING ELECTRICAL PANEL
- 2 150 CFM EXHAUST FAN
- 3 DUPLEX SCROLL AIR PLANT WITH DESICCANT AIR TREATMENT SYSTEMS
- 4 NEW ELECTRICAL PANEL FOR BUILDING
- 5 2" AIR INTAKE PIPE. TOP OF PIPE TO BE 25' ABOVE FINISHED GRADE. USE GUY WIRES AS NECESSARY.
- 6 NEW 7'-0" H X 3'-0" W DOUBLE DOORS W/ PANIC HARDWARE ON EACH LEAF. DOOR SHALL HAVE MORTIS HARDWARE WITH A LOCK NUMBER OF 4587UNR3R626.
- 7 NEW CONCRETE FOUNDATION. ELEVATION TO MATCH EXISTING EQUPT. PAD #3. (685.47)
- 8 3/4" AIR SUPPLY LINE BACK TO SYSTEM
- 9 EXISTING RETAINING WALL TO REMAIN
- 10 EXISTING SWALE TO BE REROUTED AS NEEDED
- 11 NEW LED WALL PACK LIGHTING TO BE INSTALLED
- 12 2 X 2 T8 RECESSED LIGHTING
- 13 2 X 2 CEILING GRID TO BE SET AT 8' A.F.F.
- 14 EXISTING ELECTRICAL MANHOLE
- 15 EXISTING UNDERGROUND ELECTRICAL CABLES
- 16 EXISTING CURB TO BE REMOVED AS NECESSARY TO ACCOMMODATE NEW DRIVE
- 17 4" THICK REINFORCED CONCRETE DRIVE. SLAB IS TO SLOPE TO ELEVATION OF ADJACENT CONCRETE STRUCTURES

Revisions:	Date

CONSULTANTS:			

ARCHITECT/ENGINEERS:			

Drawing Title	MEP/ SITE PLAN
Approved: Project Director	

Project Title	MED GAS PUMP BUILDING @ CLC
Location	TEMPLE, TX
Date	1/27/2015 1:07:19 PM
Checked	VG
Drawn	TB

Project Number	674-14-031
Building Number	221
Drawing Number	MEP1R

Office of Construction and Facilities Management
Department of Veterans Affairs