


- GENERAL NOTES:**
1. REFER TO ELECTRICAL DRAWING EP703 FOR UNDERGROUND DUCTBANK AND DIRECT BORED CONDUIT DETAILS.
 2. CONTRACTOR SHALL FIELD VERIFY THE LOCATION OF TRANSFORMER AND CONDUIT LOCATIONS. CONDUIT SHALL BE LOCATED IN THE MIDDLE OF THE DUCTBANK TO THE GENERATOR AND TRANSFORMER.
 3. CONDUIT INSIDE DIESEL TANK BUILDING SHALL BE 2-1/2\"/>
- DRAWING NOTES:**
1. REFER TO DRAWING EP704 FOR CONDUIT DETAIL.
 2. REFER TO DRAWING EP702 FOR WORK IN THIS AREA.
 3. REFER TO DRAWING EP704 FOR HANDHOLE DETAIL.

ENGINEERS STATEMENT


Per Title 8, Article 145, Section 7209 of the New York State Education Law, it is a violation of said law to offer this plan in any way unless under the direction of a licensed professional engineer or land surveyor. If altered, the altering engineer or surveyor shall affix to this plan their seal with the notation of, altered by _____, the date of alteration and a specific description of the alteration.

FOR CONSTRUCTION

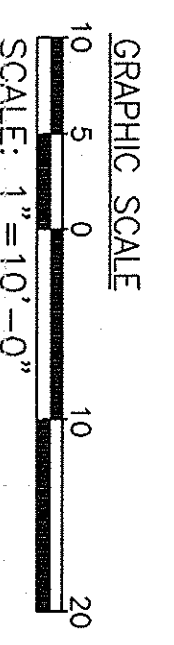

DESIGN/BUILD CONTRACTOR:

THE WHITING-TURNER CONTRACTING COMPANY
300 E. JOPPA ROAD, SUITE 800
BALTIMORE, MARYLAND 21286
VA CONTRACT NUMBER: VA701-RA-0063
VA PROJECT NUMBER: 101-09-067

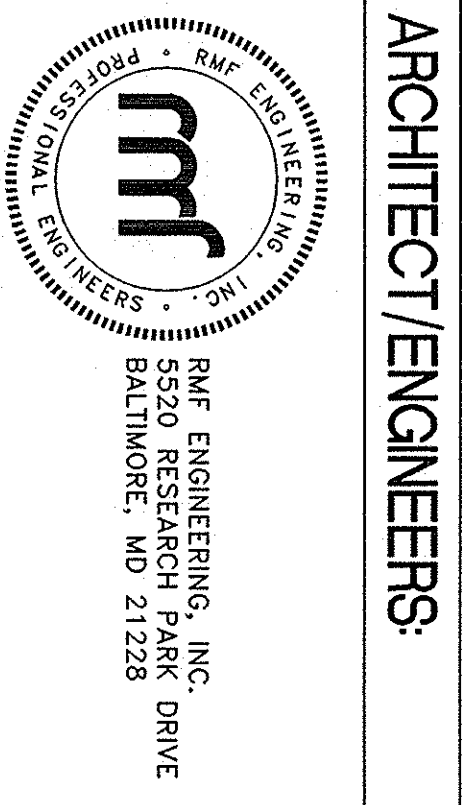

UTILITY PLAN - ELECTRICAL POWER

Project Name: VAAC - BIOMASS COGENERATION ENERGY CENTER
Location: CANANDAIGUA, NEW YORK

Project Number: 12855
Building Number: 12
Drawing Number: CU105
Dwg 8 of 19

