


PROVIDE PULLSTRING IN EACH CONDUIT FOR FUTURE USE (TYPICAL)

**NOTES:**

1. PROVIDE BEADED STRAPS FOR SUPPORT OF CONDUITS ON TOP RING OF EACH ASSEMBLY.
2. PROVIDE REBAR SUPPORTS AS REQUIRED.
3. PROVIDE CONDUIT SUPPORT REDUCERS AS REQUIRED FOR CONDUIT SIZE.
4. ALL CONDUIT SHOWN SHALL BE SCHEDULE 80 PVC.



**1 CONCRETE ENCASED DUCT BANK (8 DUCT)**  
E501 SCALE: NONE

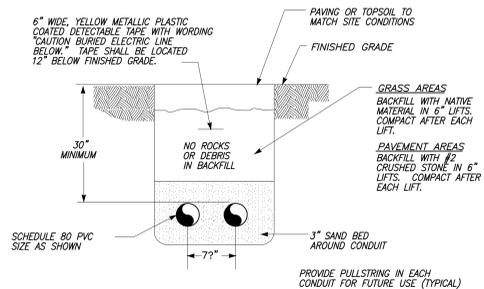


**NOTES:**

1. READ THE SPECIFICATION 16100
2. REPAIR ALL SETTLEMENT
3. MINIMUM TOP SOIL-6"

**2 TYPICAL DUCTBANK DETAIL (2 DUCTS)**  
E501 SCALE: NONE

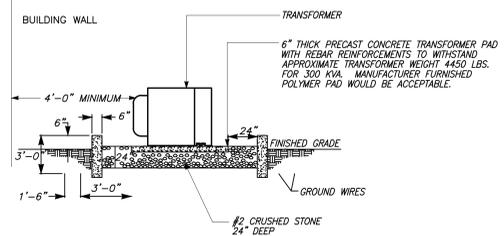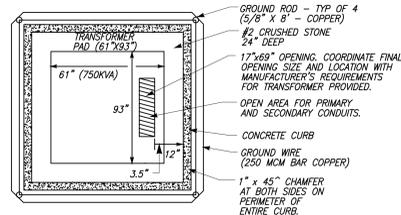


**3 TRANSFORMER PAD DETAIL**  
E501 SCALE: NONE

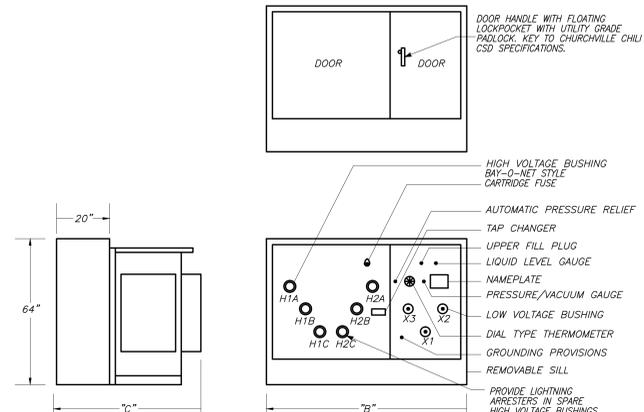

TRANS. #	KVA	DIMENSIONS (in.)		APPROX. WEIGHT (LBS)
		"B"	"C"	
T1	750	89"	57"	6500
T2	750	89"	57"	6500

**4 TRANSFORMER ELEVATION DETAIL**  
E501 SCALE: NONE

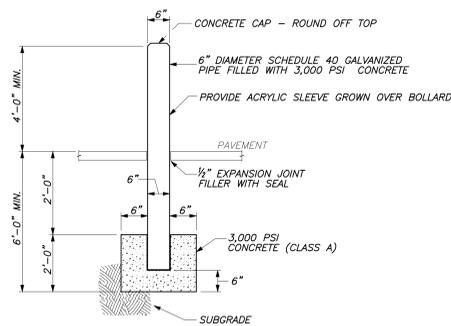

**5 PROTECTIVE BOLLARD DETAIL**  
E501 SCALE: NONE

100% SUBMISSION	02-06-14
Revisions	Date

VA WESTERN NEW YORK HEALTHCARE SYSTEM  
222 RICHMOND AVENUE  
BATAVIA, NEW YORK 14020

**ECAB** engineering, p.c.  
15 Schoen Place  
Suite 303  
Pittsford, NY 14534  
Phone: (585) 641-7121  
Fax: (585) 362-4175  
www.ecab.com

Consultant

stamp

Architect / Engineer

CARDIOLOGY MANAGER	DATE	ENGINEERING MANAGER	DATE
INFECTIOUS CONTROL	DATE	CARELINE MANAGER	DATE
SAFETY OFFICER	DATE	CHIEF OF STAFF	DATE

Drawing Title		Project Title	
ELECTRICAL DETAILS		VA BATAVIA EMERGENCY POWER UPGRADES	
MEDICAL CENTER DIRECTOR		Building Number	Checked
ASSOCIATE MEDICAL CENTER DIRECTOR		1	EJS
		Drawn	RS
		Location	
		V.A.M.C. BATAVIA, NEW YORK	

Date	June 6, 2014
Station No.	528-13-201
13-201-E501	

