


# JOHNSON CONTROLS METASYS

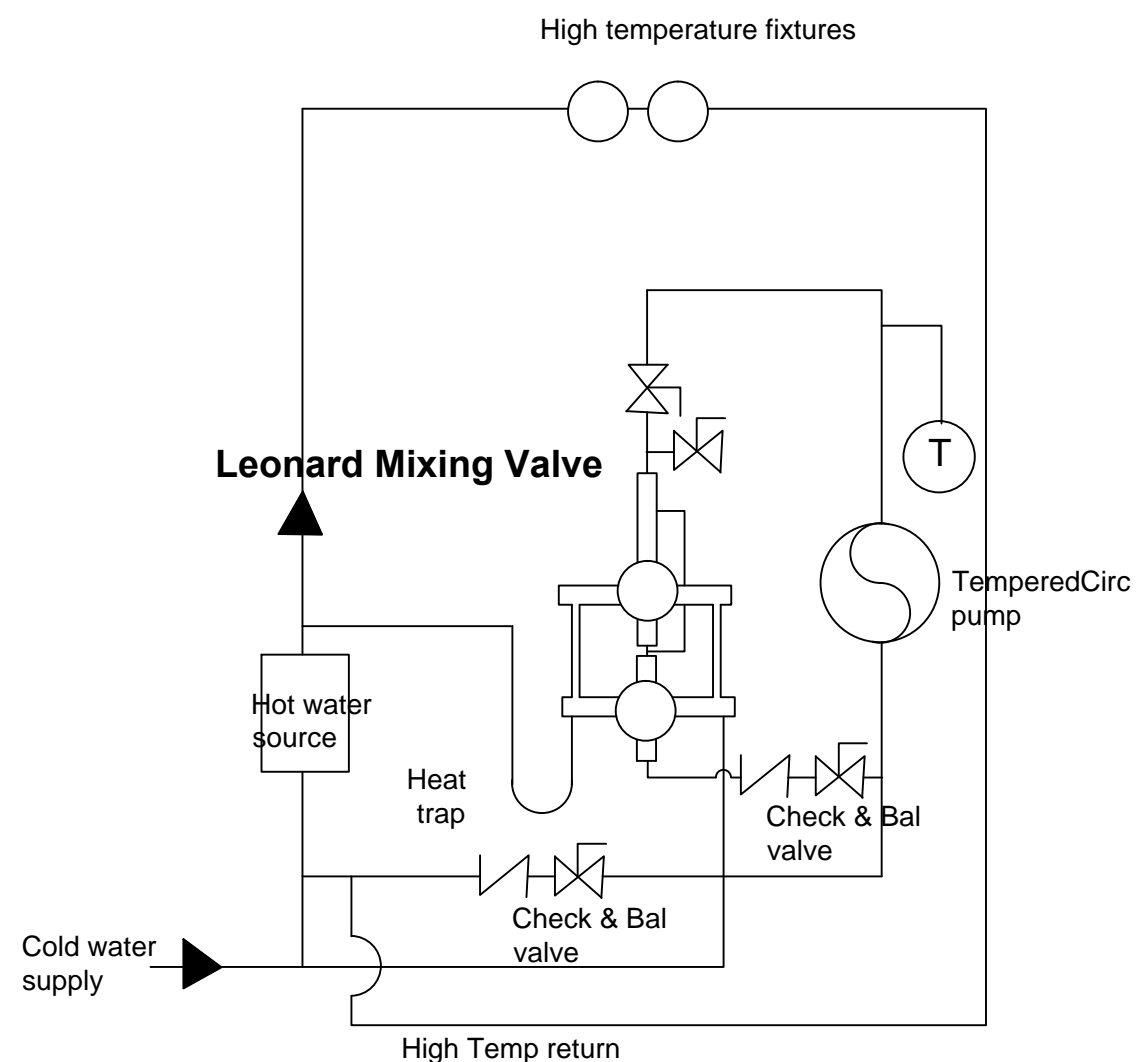

## WATER TEMPERATURE MONITORING FOR LEGIONELLA MITIGATION

575-14-108

OUT Patient Addition Room 2639-1

TS-TEMPERATURE SENSOR HOT WATER

DTMV-TEMPERATURE SENSOR DISCHARGE MIXING VALVE

TST-TANK STATUS

ICS-ION GENERATOR STATUS

RPS-RECIRC PUMP STATUS

RT-TEMPERATURE SENSOR RECIRC WATER

RPF-RECIRC PUMP FLOW

TSM-TEMPERATURE SENSOR MAIN WATER SUPPLY

