



1

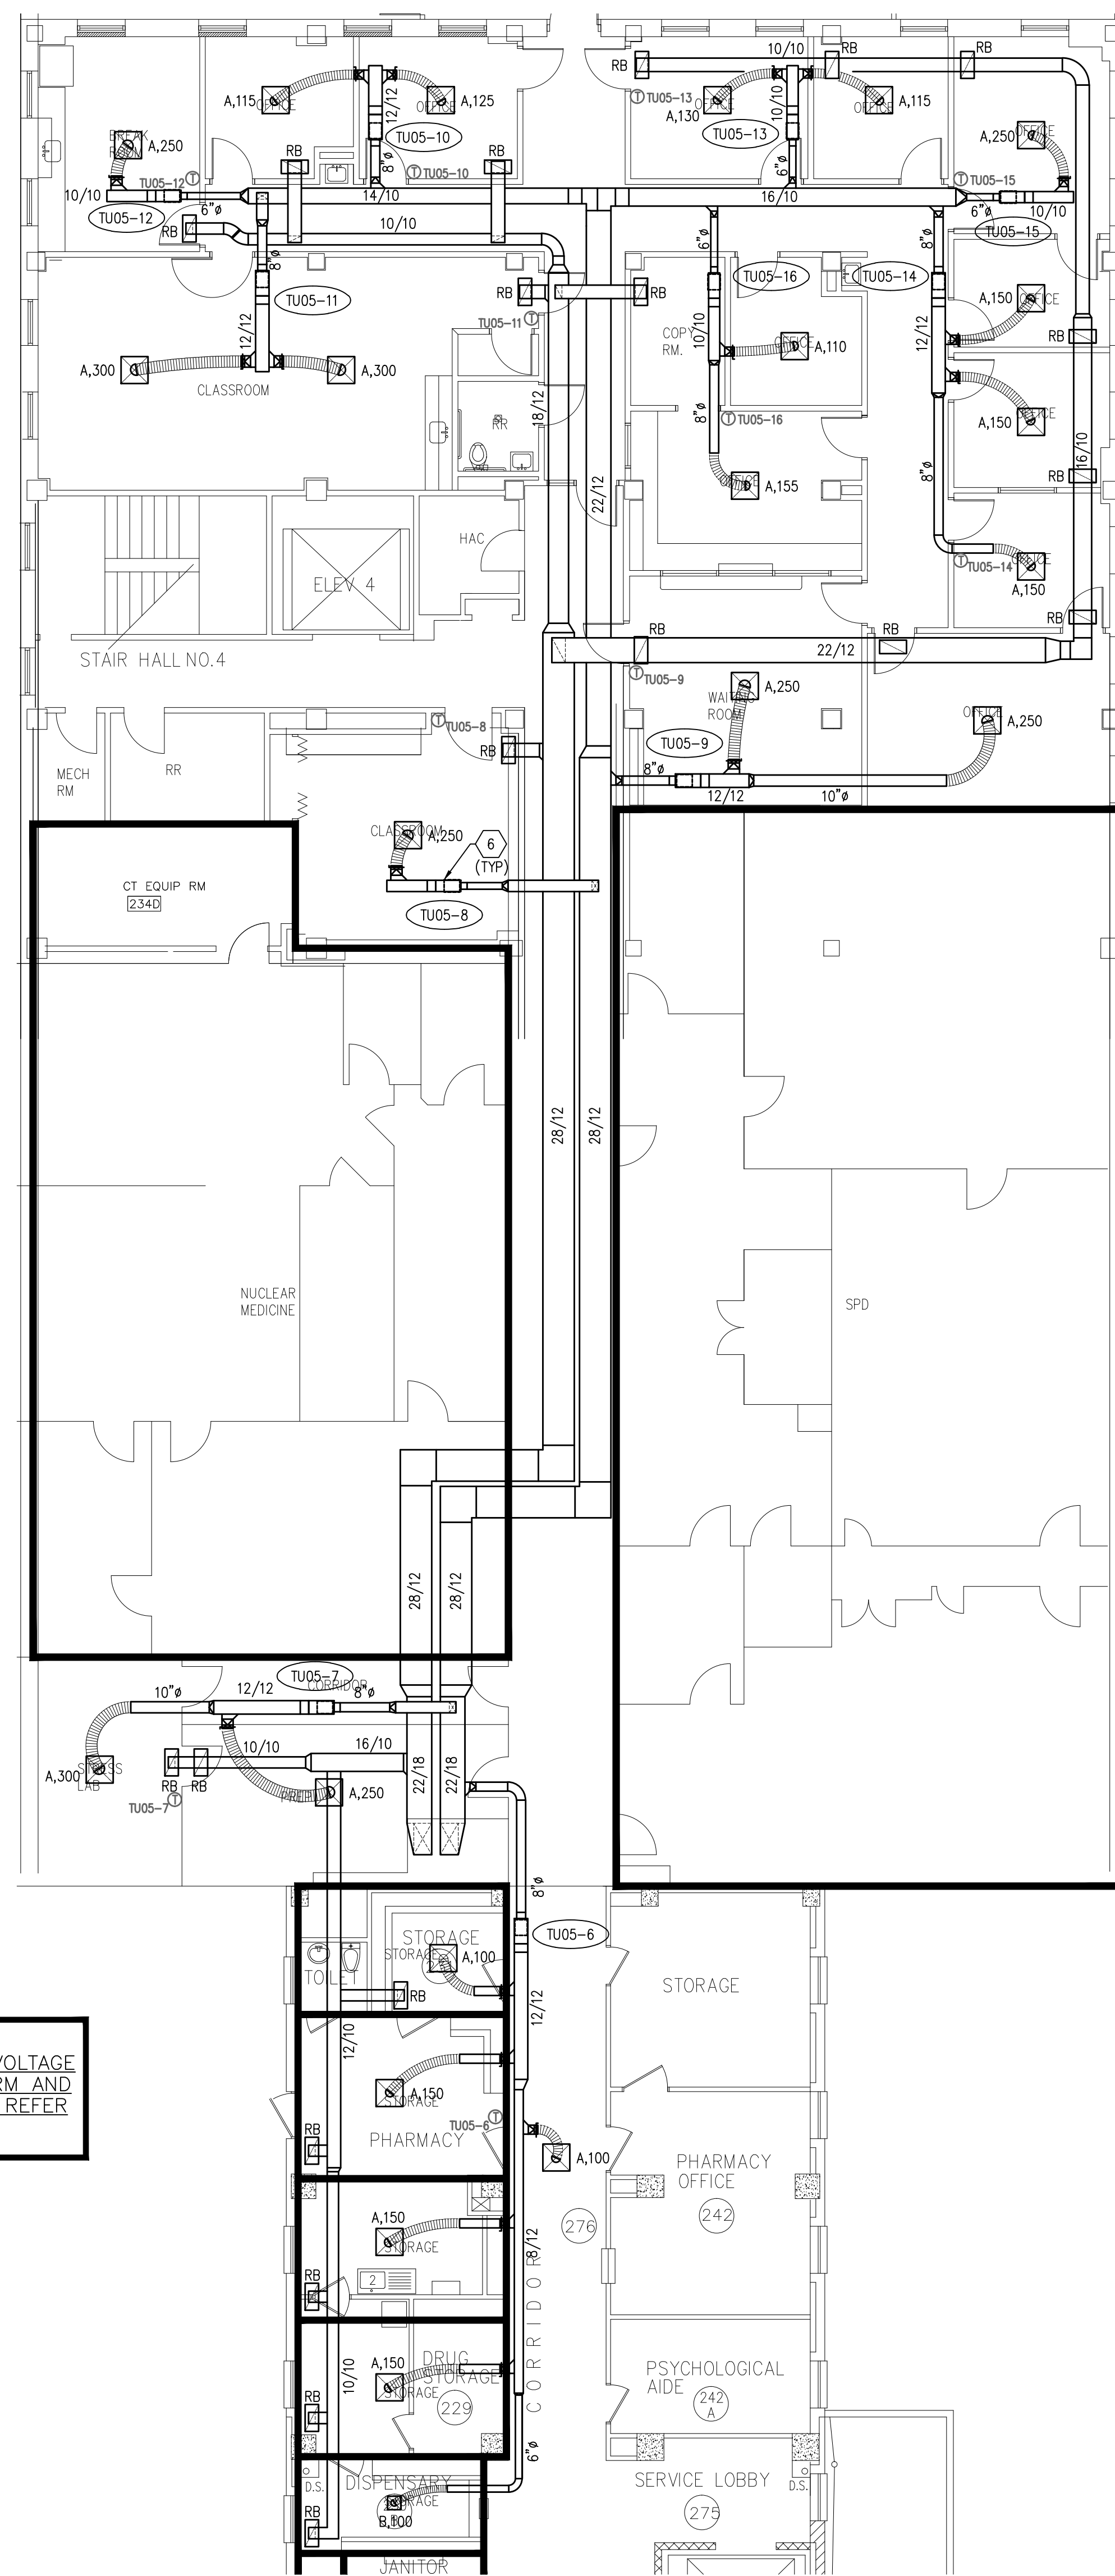


2


INCLUDE A LINE ITEM COST ALLOWANCE IN BID FOR LOW VOLTAGE POWER CIRCUIT AND FIRE ALARM AND SMOKE DETECTION INTERLOCK. REFER TO SPECIFICATION 23 31 00

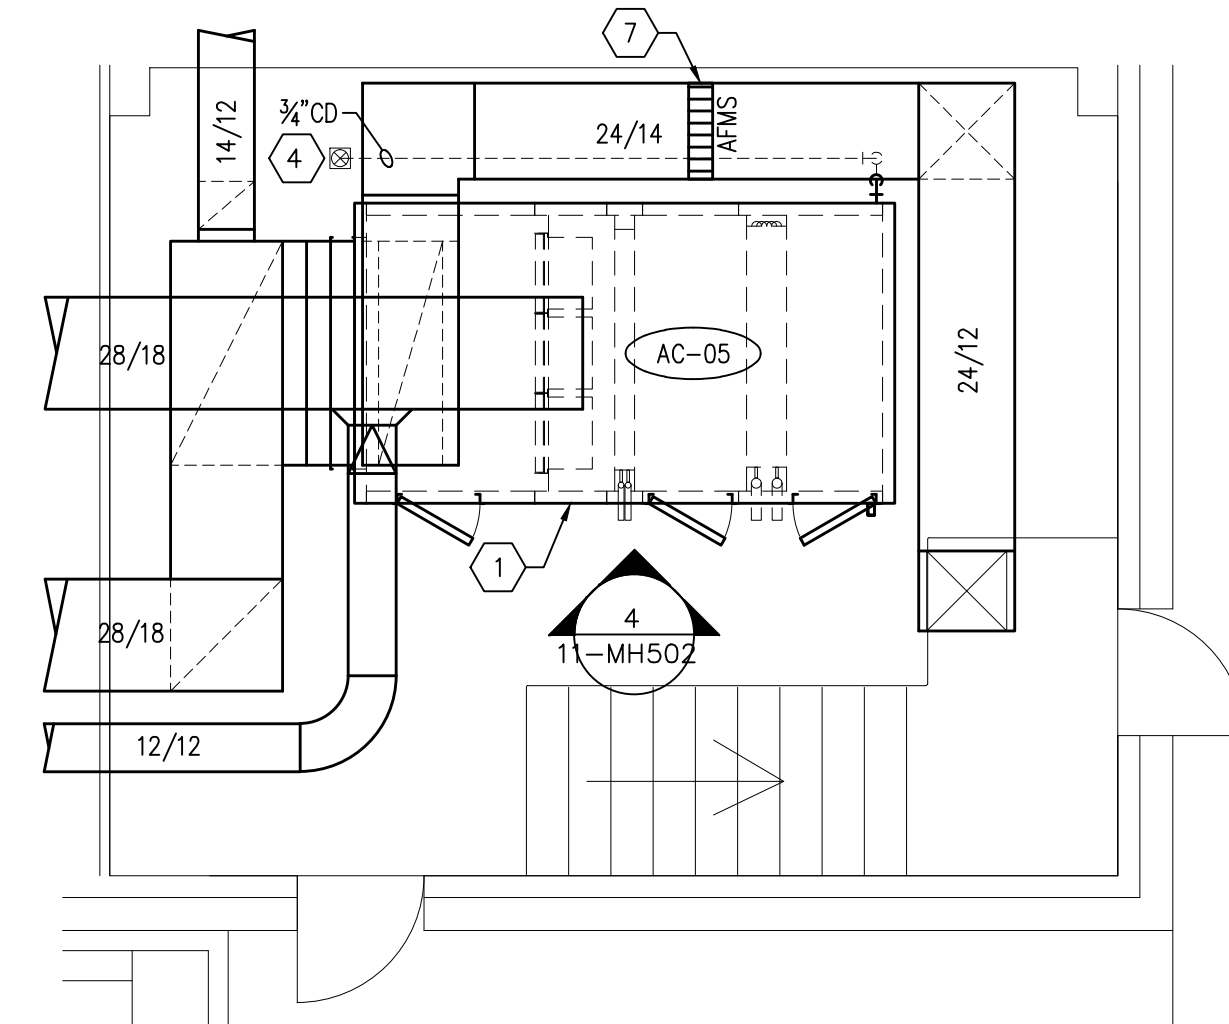

(3)

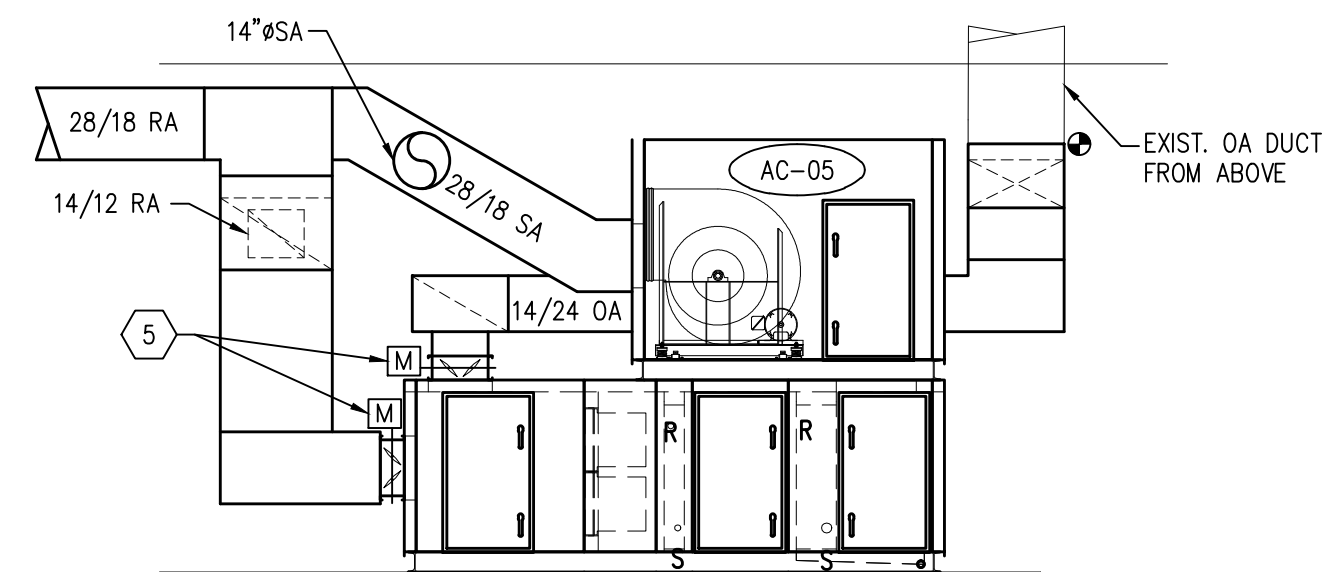

4

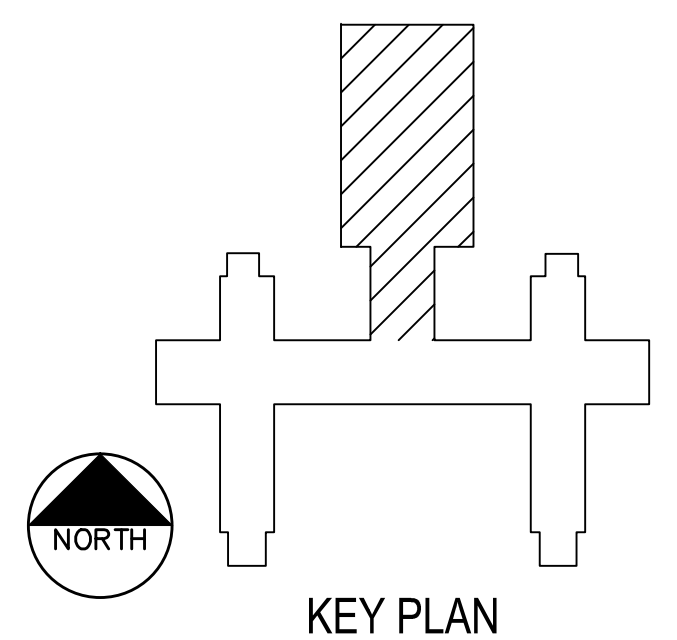VA FORM 08-6231