

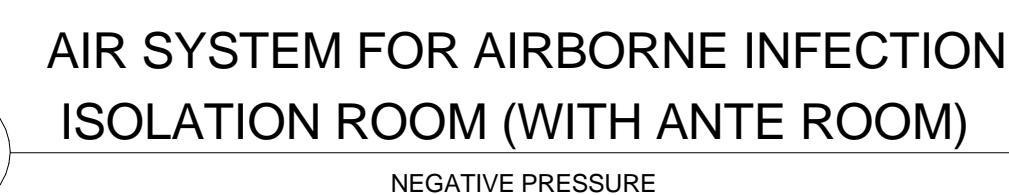
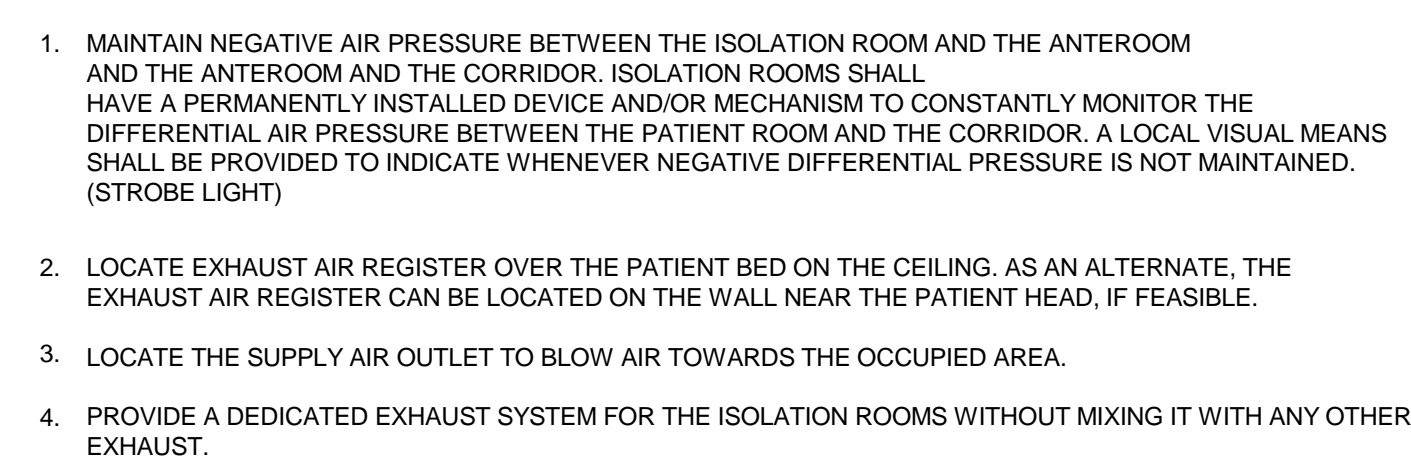
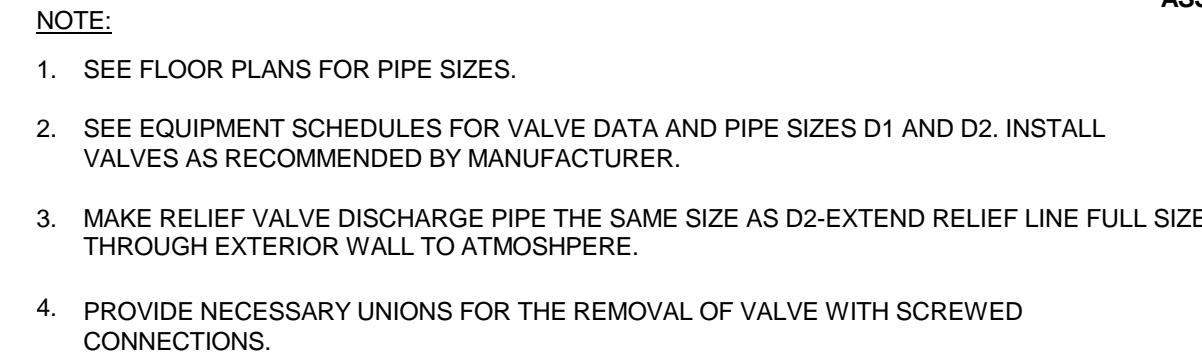


1. DIMENSION SHOWN IN SCHEDULE ARE MINIMUM REQUIRED. IF MANUFACTURER OF FURNISHED WATER METER CONNECTIONS RECOMMENDS A GREATER DIMENSION, USE THEIR RECOMMENDATION.
2. INSTALL THE WATER FLOW MEASURING DEVICE SO THE FLOW ARROW IS IN THE SAME DIRECTION AS THE FLOW.
3. THE WATER FLOW MEASURING DEVICE MAY BE INSTALLED IN EITHER HORIZONTAL OR VERTICAL PIPE. UNITS REQUIRING REMOTE METERS SHALL HAVE THE METER CONNECTIONS LOCATED ON OR NEAR THE SIDE WHEN INSTALLED IN HORIZONTAL PIPE. SEE SECTION 14-1. THE METER CONNECTIONS CAN BE INSTALLED IN ANY POSITION WHEN INSTALLED IN THE VERTICAL PIPE.



| | | |
|---|---------------|------------|
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| 1 | ADDENDUM #001 | 07-15-2014 |
| # | Revisions | Date |

120 Vassar Dr SE Suite 100
Albuquerque New Mexico 87106
Tel 505 242 6880 Fax 505 242 6881



| | |
|--------------------|---------|
| Date | Checked |
| SEPTEMBER 26, 2014 | ROS |

M505

Dwg. C

M505

Dwg. C

Department of
Veterans Affairs