


ANCHOR PIPES TO STRUCTURE. SEE DETAIL.

CONTROL VALVE SHALL BE 3-WAY MODULATING TYPE.

FULL SIZE BALL VALVES.

DO NOT INSTALL ANYTHING NEW (DUCTS, FITTINGS, TERMINAL UNITS ETC.) IN THE INDICATED SHADED ZONE (3' WIDE X 6' HIGH). THIS ZONE MUST STAY CLEAR FOR PERSONNEL ACCESS AND EXHAUST. ALL NEW ITEMS THAT MUST CROSS THIS ZONE ARE TO BE OFFSET UP AND OVER THIS ZONE. EXISTING ITEMS (DUCTS, TERMINAL UNITS ETC.) CAN STAY WHERE THEY ARE. IT IS NOT PART OF THE SCOPE OF WORK IN THIS CONTRACT TO RELOCATE THOSE EXISTING ITEMS OUT OF THIS ZONE UNLESS NOTED OTHERWISE.

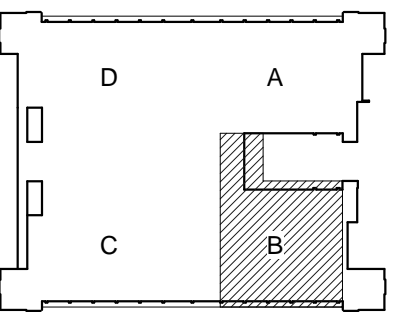

COMPLETION ITEM NO. _____
FULLY SPRINKLERED

[illegible]