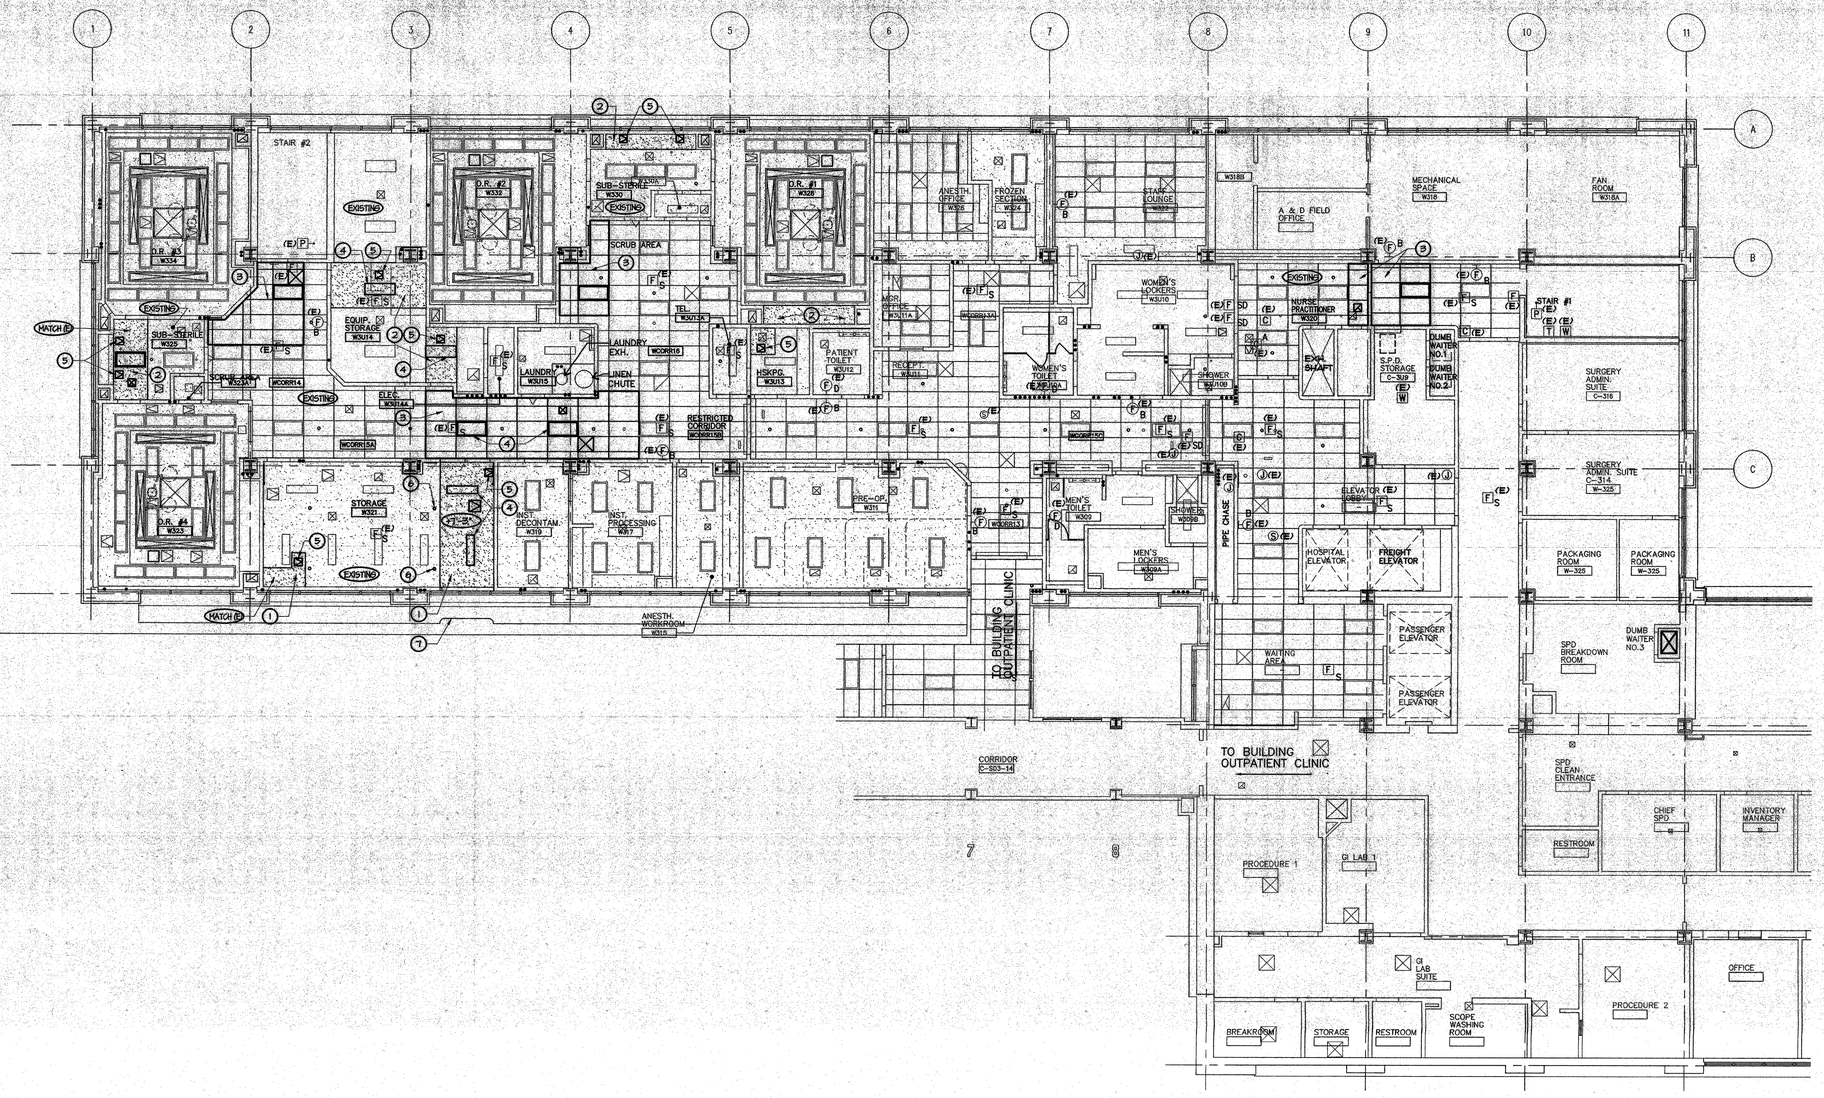

KEYNOTES

1. ONE-HOUR RATED SUSPENDED CEILING SYSTEM WITH ⅝" TYPE 'X' GYPSUM BOARD, SEE DETAILS 11/A5.50 22/A5.50
2. SUSPENDED CEILING WITH GYPSUM BASE AND VENEER PLASTER, SEE DETAILS 10/A5.50 22/A5.50
3. ACOUSTICAL CEILING PANELS AND SUSPENDED CEILING SYSTEMS, SEE DETAIL 6/A5.50
4. EXISTING LIGHT FIXTURE REINSTALLED. SEE ELECTRICAL DRAWINGS.
5. NEW 12"x12" ACCESS PANEL FOR MECHANICAL CONTROL DAMPERS. COORDINATE LOCATION WITH MECHANICAL DAMPER INSTALLATION
6. (E) FIRE SPRINKLER HD., RELOCATE BETWEEN 4" MIN. & 6" MAX. DISTANCE FROM FACE OF SOFFIT WALL.
7. GALV. METAL FLASHING ALONG EDGE OF SAN CUT CANOPY, SEE DETAILS 10/A5.62 14/A5.62

LEGEND

- X'-X" — NEW OR EXISTING CEILING HIEGHT
- NEW SUSPENDED CEILING WITH GYPSUM BOARD CEILING. MATCH EXISTING CEILING HIEGHT, FINISH & FIRE RATING IF APPLICABLE. UNLESS NOTED OTHERWISE
- EXISTING SUSPENDED CEILING GRID SYSTEM WITH ACOUSTICAL PANELS TO REMAIN.
- EXISTING ACOUSTICAL CEILING PANELS TO BE REINSTALLED OR REPLACED IF DAMAGED AFTER HVAC DUCTWORK IS COMPLETED. INSTALL SEALANT AT THE INTERSECTION OF WALL AND GRID. ALIGN WITH EXISTING CEILING HIEGHT.
- EXISTING LIGHT FIXTURES TO BE REINSTALLED AFTER HVAC DUCTWORK IS COMPLETED. IF LIGHT FIXTURES ARE DAMAGE DURING CONSTRUCTION THE FIXTURE SHALL BE REPLACED.
- EXISTING CEILING ACCESS PANEL (SIZE VARIES) TO BE REINSTALLED OR REPLACED IF DAMAGED AFTER HVAC DUCTWORK IS COMPLETED.
- HVAC GRILLES, SEE MECHANICAL DRAWINGS.
- HVAC GRILLES REINSTALLED, SEE MECHANICAL DRAWINGS.
- *FS — EXISTING FIRE SPRINKLER HEAD

CEILING / WALL — **EXISTING DEVICES TO REMAIN**

- (E) F B — EXISTING FIRE ALARM AUDIBLE VISUAL DEVICE MOUNTED 7'-6" A.F.F. UNLESS NOTED SUFFIX DENOTES.
  - G - GONG 6" DIA. UNLESS NOTED
  - H - HORN
  - D - FLASHING DOME LIGHT
- (E) F S — EXISTING SMOKE DETECTOR
- (E) F SD — EXISTING SMOKE DETECTOR DUCT TYPE.
- (E) T — EXISTING TAMPER SWITCH.
- (E) W — EXISTING WATER FLOW SWITCH.
- (E) F — EXISTING CEILING SMOKE DETECTOR
- (E) J — (E) J — EXISTING JUNCTION BOX, MOUNTED 1'-6" A.F.F. UNLESS OTHERWISE NOTED
- (E) S — EXISTING CEILING PAGING SPEAKER

SEE MECHANICAL & ELECTRICAL DRAWINGS FOR CORRESPONDING SYMBOLS

GENERAL NOTES

A. THE CONTRACTOR SHALL REINSTALL ALL EXISTING ELECTRONIC DEVICES IN THEIR ORIGINAL LOCATIONS. ALL REINSTALLED DEVICES SHALL BE IN WORKING ORDER AT THE COMPLETION. CLEAN ALL DEVICES BEFORE REINSTALLING.

B. REFER TO MECHANICAL & ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION.

C. CONTRACTOR SHALL PROTECT EXISTING AND REMAINING SURFACES & ITEMS FROM DAMAGE. REPAIR ANY DAMAGE TO ORIGINAL CONDITION.

D. REFER TO THE OCT. 2012 ABSESTOS CONTAINING MATERIAL SUMMARY BY MILLENIUM CONSULTING ASSOC. FOR TYPES AND EXTENT OF MATERIALS THAT MUST BE ABATED PRIOR TO START OF DEMOLITION.

E. REFER TO THE OCT. 24, 2013 LEAD SAMPLING REPORT BY LEON ENVIRONMENTAL SERVICES FOR TYPES & EXTENT OF MATERIALS CONTAINING LEAD-BASED PAINTS OR COATING THAT MUST BE ABATED PRIOR TO START OF SELECTIVE DEMOLITION.

KEY MAP



NORTH

SCALE: 1/8" = 1'-0"

Revisions:	Date
REVISION CONSTRUCTION DOCUMENTS (100%)	3-5-15
REVISION CONSTRUCTION DOCUMENTS (90%)	12-8-14
CONSTRUCTION DOCUMENTS (60%)	10-27-14

CONSULTANTS:

100% CONSTRUCTION DOCUMENTS

ARCHITECT/ENGINEERS: Project No. 13-9111.00

TETER, LLP
7535 N. PALM AVE. 201 | FRESNO, CA 93711 | 559.437.0887
125 S. BRIDGE ST. 150 | VISALIA, CA 93291 | 559.625.5246
1200 DISCOVERY DR. 160 | BAKERSFIELD, CA 93309 | 661.843.8400
1130 K STREET 225 | SACRAMENTO, CA 95814 | 916.538.4262
ARCHITECTS ENGINEERS CONNECTED

Drawing Title: PROPOSED REFLECTED CEILING PLAN, THIRD FLOOR

Approved: Project Director

Project Title: VA REPLACE SURGERY EXHAUST SYSTEM, BLDG 1, 3RD FLR

Location: FRESNO, CA

Date: 3-5-15 | Checked | Drawn

Project Number: 570-13-211

Building Number: 1

Drawing Number: AS120

Office of Construction and Facilities Management

Department of Veterans Affairs

VA FORM 08-6231