



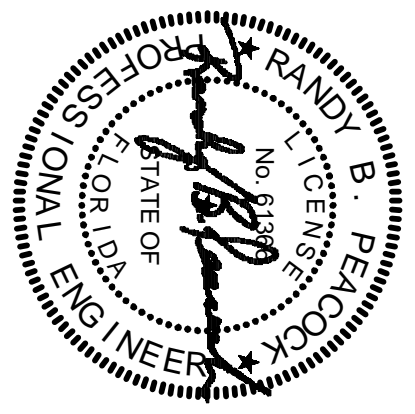

| | |
|---|-----------|
| 1. REMOVE RECEPTACLES AT ENROLLMENT AND TRAVEL DESK | 4/13/2015 |
| REVISIONS | DATE |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |

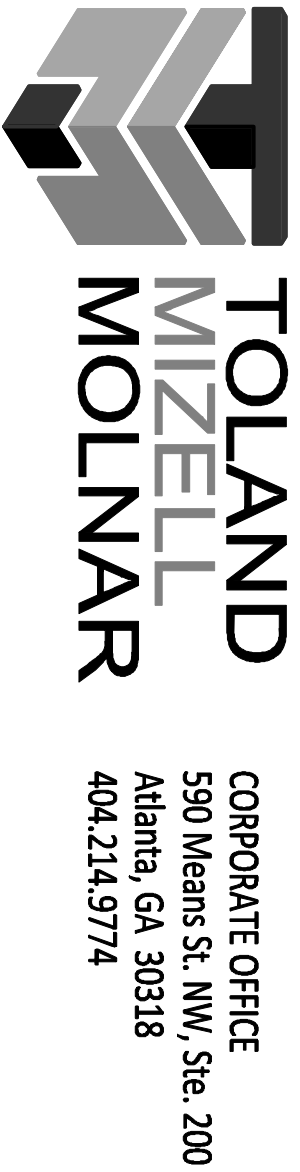

CLARK•NEXSEN
440 MARTIN LUTHER KING, JR. BLVD
MACON, GEORGIA 31201
478-749-8415 FAX 478-749-8239
WWW.CLARKNEXSEN.COM

TELEPHONE TRAGE A201 - POWER
SCALE: 1/4" = 1'-0"



GENERAL NOTES:
(THIS SHEET ONLY)
A. CONTRACTOR SHALL COORDINATE THE SITE PREPARATION AND FURNITURE REQUIREMENTS WITH THE FURNITURE CONTRACTOR. COORDINATE THE ELECTRICAL CONTRACTOR TO PROVIDE POWER AND DATA FOR THE MODULAR FURNITURE.

- DEMOLITION WORK KEYED NOTES:**
(THIS SHEET ONLY)
- 1 DEMOLISH ALL POWER FEEDS TO EXISTING SYSTEM FURNITURE IN A201. REMOVE CONDUIT AND WIRE BACK TO SOURCE. LABEL BREAKER AS SPARE.
 - 2 ALL ELECTRICAL EQUIPMENT IN ELECTRICAL ROOM A113 IS EXISTING TO REMAIN.
 - 3 EXISTING TO REMAIN RECEPTACLES AND CIRCUITING.
 - 4 DEMOLISH RECEPTACLE, WIRING, AND CONDUIT BACK TO SOURCE.
 - 5 REMOVE EXISTING RECEPTACLE AND MAINTAIN EXISTING CIRCUITRY FOR RECONNECTION TO NEW RECEPTACLES.

- NEW WORK KEYED NOTES:**
(THIS SHEET ONLY)
- 1 PROVIDE NEW 480V, 480/120/208V, 3PH, 3WYE, TRANSFORMER N111. MOUNT TRANSFORMER ON RGD/UNISTRUT SUPPORT SYSTEM FROM CEILING DECK SO THAT BOTTOM OF UNISTRUT IS AT 60" A.F.F. UTILIZE RUBBER PADS BETWEEN TRANSFORMER AND UNISTRUT TO DAMPEN VIBRATION. BOND TO GROUND WITH #20U GROUND.
 - 2 PROVIDE 70A/3P BREAKER IN THREE POLE SPACE IN EXISTING PANEL NHA. NHA IS A SQUARE D, I-LINE, 480/277V, 3A, 4W, 250A PANEBOARD, CAT. #1211050928033.
 - 3 PROVIDE NEW PANEBOARD NL42. SEE PANEBOARD SCHEDULE, SHEET E801. SEE RISER DIAGRAM, SHEET E801.
 - 4 PROVIDE 3/4" A863-17C FROM NEW BREAKER IN PANEL NHA TO NEW TRANSFORMER N111.
 - 5 PROVIDE 4#1/0 #665-27C FROM SECONDARY OF NEW TRANSFORMER N111 TO MAIN BREAKER IN PANEL NL42.
 - 6 PROVIDE 4" x 4" JUNCTION BOX AND CIRCUITING ABOVE CEILING FOR POWER POLE CONNECTION TO NEW SYSTEM FURNITURE. SEE PANEL SCHEDULE SHEET E801. COORDINATE LOCATION WITH SYSTEM FURNITURE VENDOR.
 - 7 PROVIDE 4" x 4" JUNCTION BOX ABOVE CEILING WITH SYSTEM FURNITURE CIRCUITS. PROVIDE FOUR CIRCUITS N111. CONDUIT RUN W/4 TO 4" x 4" JUNCTION BOX LOCATED AT 1'-0" A.F.F. AT EACH SYSTEM FURNITURE CONNECTION. COORDINATE LOCATION WITH SYSTEM FURNITURE VENDOR.
 - 8 PROVIDE CONNECTION TO ABOVE CEILING DUCT-ANCHORED ELECTRIC HEATER. DISCONNECTING MEANS PROVIDED BY MECHANICAL.
 - 9 PROVIDE HEATER CIRCUIT TO EXISTING SPARE 30A/3P BREAKER IN EXISTING PANEL NHA1. SEE PANEL SCHEDULE, SHEET E801.
 - 10 PROVIDE RECEPTACLE CIRCUITS TO SPARE BREAKER IN PANEL NLA WITH 2#12 #1261/27C.
 - 11 PROVIDE CONNECTION TO EXISTING NORMAL POWER CIRCUIT IN PANEL NLA WITH 2#12 #1261/27C.
 - 12 RECONNECT TO EXISTING CIRCUIT.

| | | | | | |
|-------------------------------|--|---|--|---------------------|----------------|
| Drawing Title | | Project Title | | Date | |
| ENLARGED FLOOR PLANS POWER | | UPGRADE RESTROOMS AND INTERIOR FINISHES - VIERA OPC FINAL SUBMITTAL | | 11-14-2014 | |
| Approved Project Engineer | | Building Number | | Checked WALSH | Drawn BRODY |
| | | Location | | DRAWING NO. E404 | |
| | | VIERA, FL | | Dwg. Of XX | |
| Veterans Administration | | | | | |

U.S. GOVERNMENT PRINTING OFFICE: 1984-420-425-2