
















SYMBOLS – CLOSE CIRCUIT TELEVISION SYSTEM

-  x VIDEO FIBER MULTIPLEXER (x INDICATES NUMBER OF CHANNELS)
-  CCTV DISTRIBUTION PANEL
-  FIXED CAMERA
-  PANTILT/zoom CAMERA

SYMBOLS – ACCESS CONTROL SYSTEM


-  CL CYpher LOCK
-  CR CARD READER
-  DC DOOR CONTACT
-  EPB EXIT PANIC BUTTON
-  EL ELECTRIFIED LOCK
-  ES ELECTRIC STRIKE
-  FPP x FIBER PATCH PANEL
-  IC CP INTERCOM CONTROL PANEL
-  IC DS INTERCOM DOOR STATION
-  IC MS INTERCOM MASTER STATION
-  KS KEY SWITCH
-  ML MAG LOCK
-  REX REQUEST TO EXIT
-  SCP SECURITY CONTROL PANEL
-  SMS SECURITY MANAGEMENT SYSTEM

SYMBOLS – INTRUSION DETECTION SYSTEM

-  IMS MOTION SENSOR


SYMBOLS – MISCELLANEOUS

-  x FIBER PATCH PANEL (x INDICATES NUMBER OF PORTS)

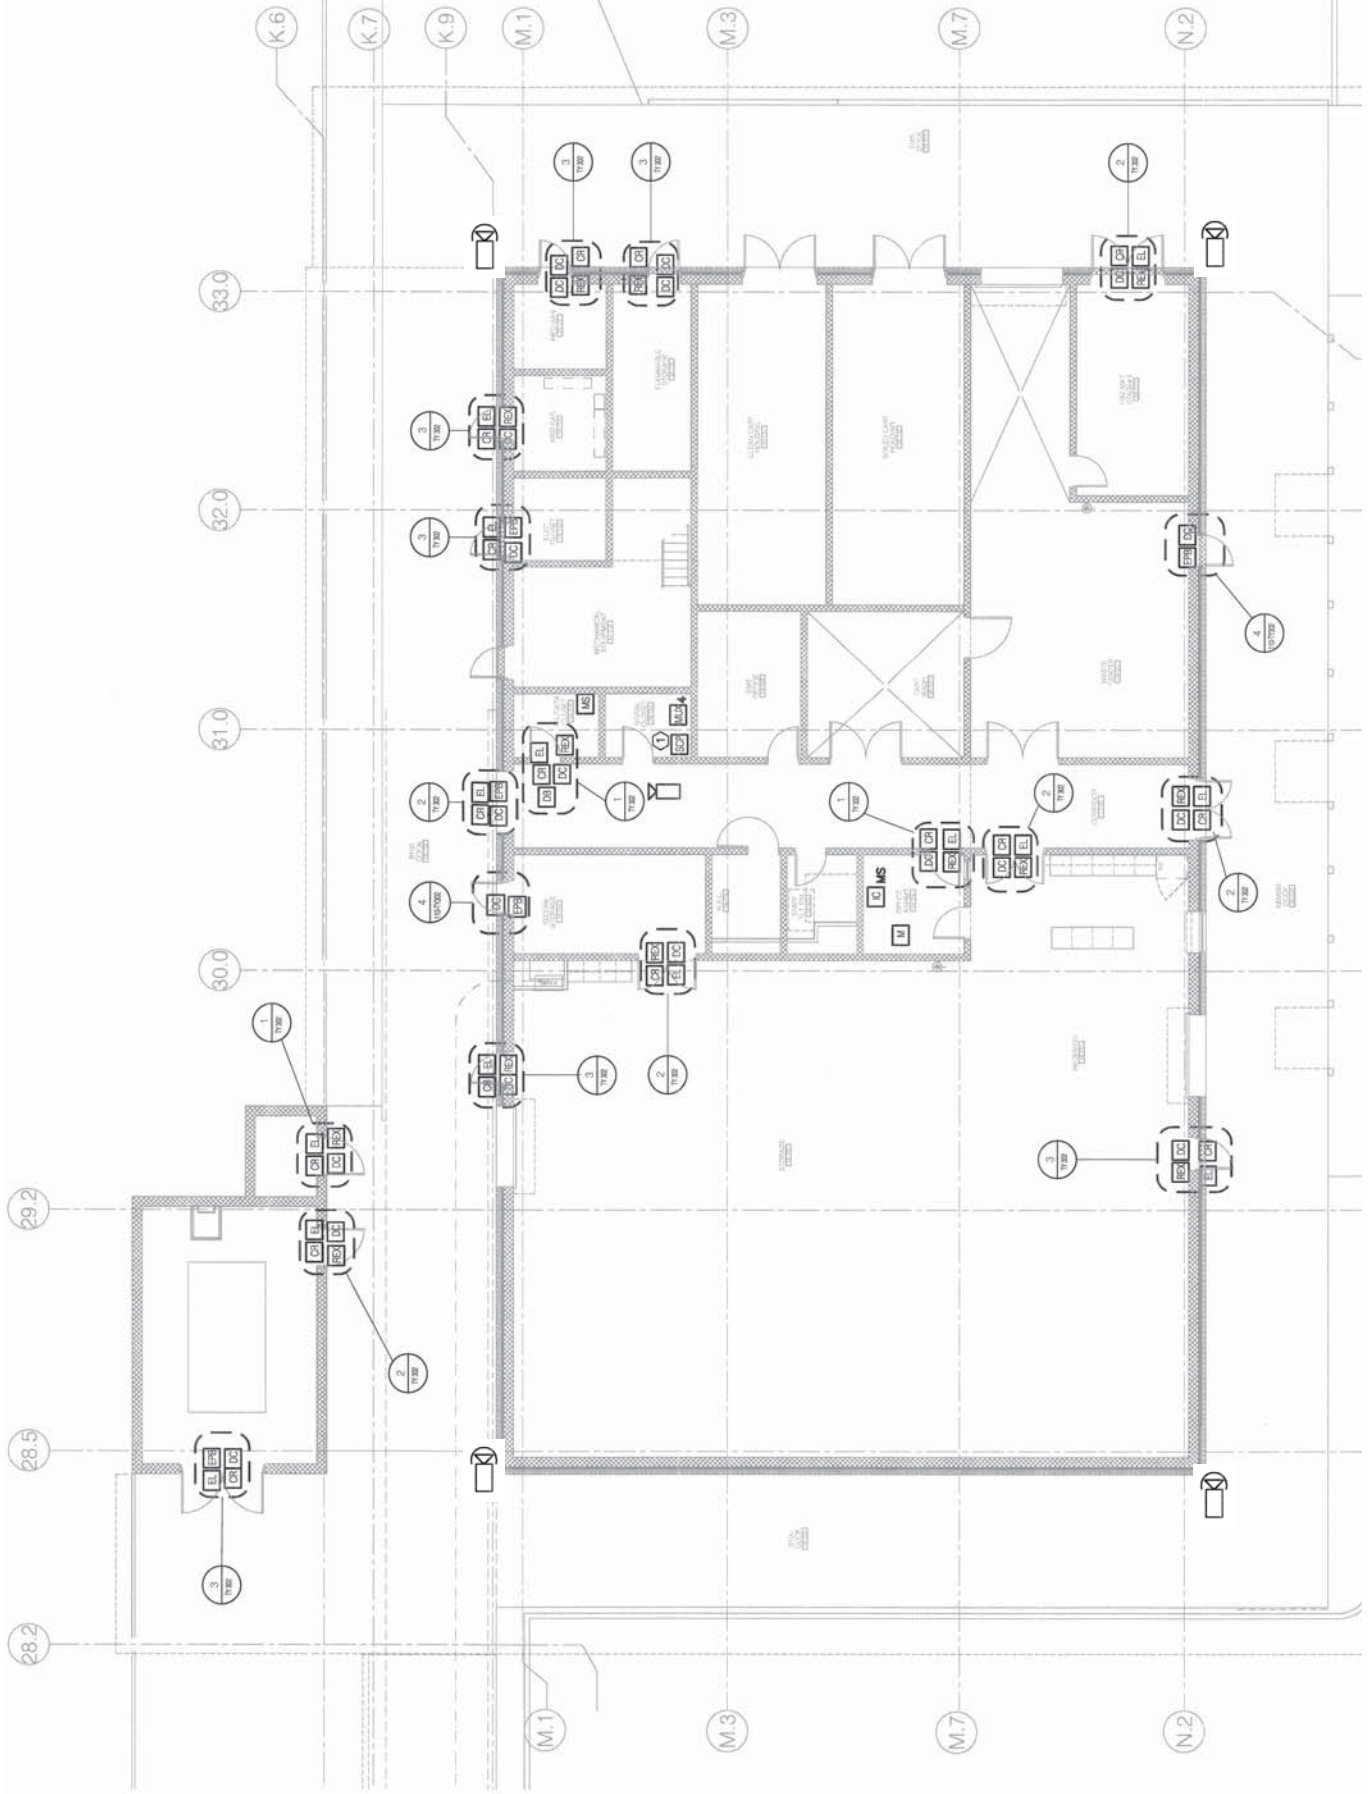

General Notes


- 1. Detail is for reference only. Required devices for each door location are shown on floor plans

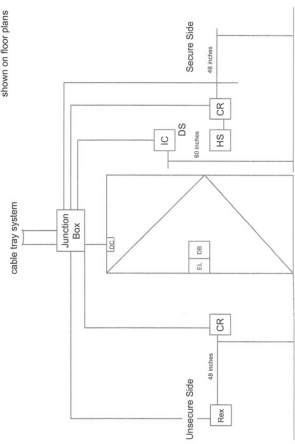

1 ENTRY/EXIT DOOR — SINGLE (TYPICAL)
NOT TO SCALE

General Notes


- 1. Unless otherwise noted, install EPB for egress only
- 2. Detail is for reference only. Required devices are shown on floor plans

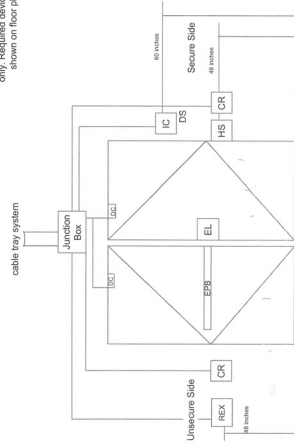

2 ENTRY/EXIT DOOR — DOUBLE (TYPICAL)
NOT TO SCALE

General Notes


- 1. Detail is for reference only. Required devices for each door location are shown on floor plans



3 EXIT DOOR — SINGLE (TYPICAL)
NOT TO SCALE

General Notes


- 1. Detail is for reference only. Required devices for each door location are shown on floor plans



4 MONITOR DOOR — SINGLE (TYPICAL)
NOT TO SCALE

General Notes


- 1. Detail is for reference only. Required devices are shown on floor plans



5 MONITOR DOOR — DOUBLE (TYPICAL)
NOT TO SCALE

General Notes

- 1. Provide 120VAC power wiring connections to all panels shown
- 2. Detail is for reference only. Required devices are shown on floor plans

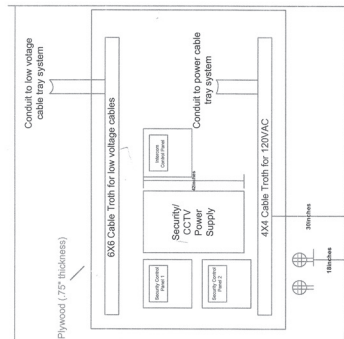

6 COMMUNICATION CLOSET DETAIL (TYPICAL)
NOT TO SCALE