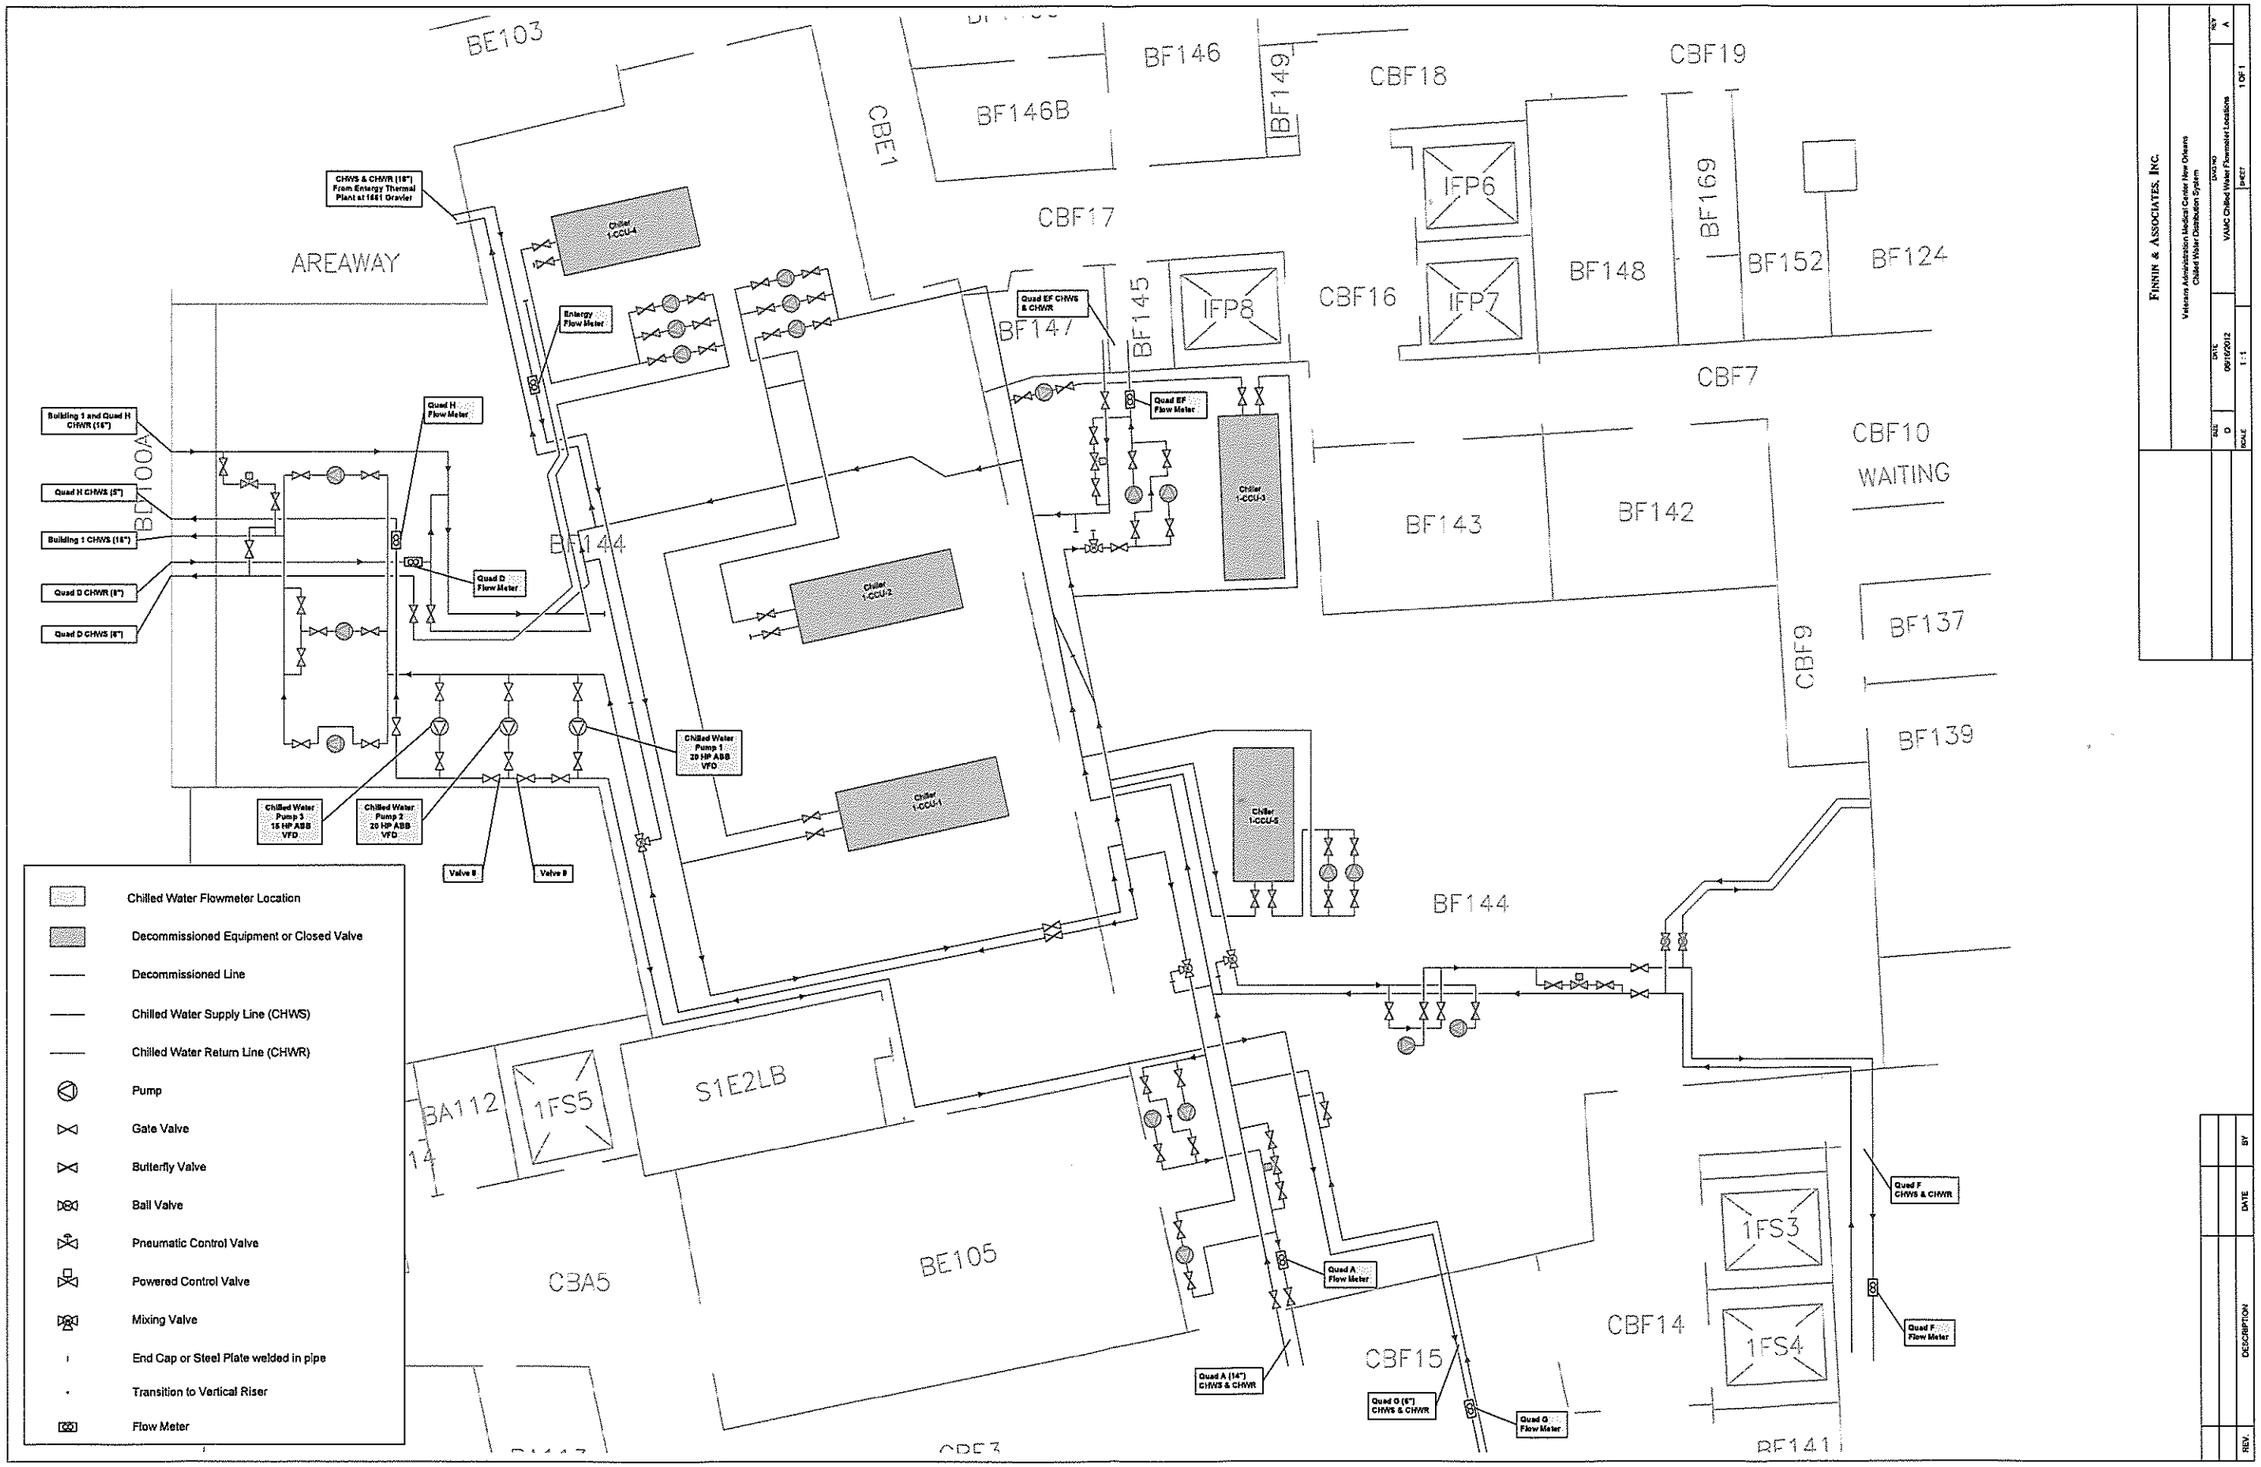

BE103
BF146
BF146B
BF149
CBF18
CBF19
CBE1
CBF17
IFP6
BF169
AREAWAY
CHWS & CHWR (16") From Entergy Thermal Plant at 1661 Gravier
Chiller 1-CCU-4
Entergy Flow Meter
BF147
BF145
IFP8
CBF16
IFP7
BF148
BF152
BF124
CBF7
Quad EF CHWS & CHWR
Quad EF Flow Meter
Chiller 1-CCU-3
CBF10
WAITING
Building 1 and Quad H CHWR (16")
Quad H CHWS (5")
Building 1 CHWS (16")
Quad D CHWR (8")
Quad D CHWS (8")
BD100A
Quad H Flow Meter
Quad D Flow Meter
BF144
Chiller 1-CCU-2
BF143
BF142
BF137
CBF9
BF139
Chilled Water Pump 1 20 HP ABB VFD
Chilled Water Pump 3 15 HP ABB VFD
Chilled Water Pump 2 20 HP ABB VFD
Valve 8
Valve 9
Chiller 1-CCU-1
Chiller 1-CCU-5
BF144
Chilled Water Flowmeter Location
Decommissioned Equipment or Closed Valve
Decommissioned Line
Chilled Water Supply Line (CHWS)
Chilled Water Return Line (CHWR)
Pump
Gate Valve
Butterfly Valve
Ball Valve
Pneumatic Control Valve
Powered Control Valve
Mixing Valve
End Cap or Steel Plate welded in pipe
Transition to Vertical Riser
Flow Meter
BA112
1FS5
S1E2LB
BE105
CBA5
Quad A Flow Meter
Quad A (14") CHWS & CHWR
CBF15
Quad G (6") CHWS & CHWR
Quad G Flow Meter
CBF14
1FS3
1FS4
Quad F CHWS & CHWR
Quad F Flow Meter
BF141
FINNIN & ASSOCIATES, INC.
Veterans Administration Medical Center New Orleans
Chilled Water Distribution System
VAMC Chilled Water Flowmeter Locations
D
06/16/2012
1:1
1 OF 1
REV.
DESCRIPTION
DATE
BY