

Prepared for:

**Department of Veterans Affairs  
Medical Center  
4100 West Third Street  
Dayton, OH 45428**

## **Upgrade Electrical Branch Lines B310**

Project Number 552-15-206

Heapy Engineering No. 2013-04016

Prepared by:



**Date: March 25, 2015**

**DEPARTMENT OF VETERANS AFFAIRS  
 VHA MASTER SPECIFICATIONS**

**TABLE OF CONTENTS  
 Section 00 01 10**

	<b>DIVISION 00 - SPECIAL SECTIONS</b>
00 01 15	List of Drawing Sheets
	<b>DIVISION 01 - GENERAL REQUIREMENTS</b>
01 00 00	General Requirements
01 32 16.15	Project Schedules
01 33 23	Shop Drawings, Product Data, and Samples
01 42 19	Reference Standards
01 74 19	Construction Waste Management
	<b>DIVISION 02 – EXISTING CONDITIONS</b>
02 82 13.19	Asbestos Floor Tile and Mastic Abatement
	<b>DIVISION 07 - THERMAL AND MOISTURE PROTECTION</b>
07 84 00	Firestopping
	<b>DIVISION 21 – FIRE SUPPRESSION</b>
21 05 11	Common Work Results for Fire Suppression
21 13 13	Wet-Pipe Sprinkler Systems
	<b>DIVISION 23 – HEATING, VENTILATING, AND AIR CONDITIONING (HVAC)</b>
23 05 11	Common Work Results for HVAC
23 81 00	Decentralized Unitary HVAC Equipment
	<b>DIVISION 26 – ELECTRICAL</b>
26 05 11	Requirements for Electrical Installations
26 05 19	Low-Voltage Electrical Power Conductors and Cables
26 05 26	Grounding and Bonding for Electrical Systems
26 05 33	Raceway and Boxes for Electrical Systems
26 05 73	Overcurrent Protective Device Coordination Study
26 22 00	Low-Voltage Transformers
26 24 16	Panelboards
26 27 26	Wiring Devices
26 29 21	Enclosed Switches and Circuit Breakers
26 36 24	Energy Monitoring and Control System (EMCS)
26 43 13	Surge Protector Device
26 51 00	Interior Lighting

	<b>DIVISION 27 – COMMUNICATIONS</b>
27 15 00	Communications Horizontal Cabling

**SECTION 00 01 15**  
**LIST OF DRAWING SHEETS**

The drawings listed below accompanying this specification form a part of the contract.

<u>Drawing No.</u>	<u>Title</u>
310G001	COVER SHEET
310E001	SYMBOLS
310E501	ELEVATIONS
310E502	EMCS RISER
310E503	SITE PHOTOGRAPHS
310E601	SINGLE LINE DIAGRAM
330E602	SINGLE LINE DIAGRAM - EMERGENCY
330E603	SINGLE LINE DIAGRAM – CHILLER PLANT
310E604	PANELBOARD SCHEDULES
310E605	PANELBOARD SCHEDULES
310E606	PANELBOARD SCHEDULES
310E607	PANELBOARD SCHEDULES
310EP100	ENLARGED ELECTRICAL ROOMS
310EP101	FIRST FLOOR PLAN - POWER
310EP102	SECOND FLOOR PLAN - POWER
310EP103	THIRD FLOOR PLAN - POWER
310EP104	FOURTH FLOOR PLAN - POWER
330EP101	OVERALL FLOOR PLANS
330EP102	OVERALL FLOOR PLANS
330EP103	OVERALL FLOOR PLANS
330EP104	OVERALL FLOOR PLANS
310ES101	SITE PLAN

--- END ---

**SECTION 01 00 00  
GENERAL REQUIREMENTS**

**TABLE OF CONTENTS**

1.1 GENERAL INTENTION .....	1
1.2 STATEMENT OF BID ITEM(S) .....	2
1.3 SPECIFICATIONS AND DRAWINGS FOR CONTRACTOR .....	2
1.4 CONSTRUCTION SECURITY REQUIREMENTS .....	2
1.5 FIRE SAFETY .....	6
1.6 OPERATIONS AND STORAGE AREAS .....	8
1.7 ALTERATIONS .....	11
1.8 INFECTION PREVENTION MEASURES .....	12
1.9 DISPOSAL AND RETENTION .....	15
1.10 PROTECTION OF EXISTING VEGETATION, STRUCTURES, EQUIPMENT, UTILITIES, AND IMPROVEMENTS.....	15
1.11 RESTORATION.....	16
1.12 PHYSICAL DATA .....	16
1.13 LAYOUT OF WORK.....	17
1.14 AS-BUILT DRAWINGS.....	17
1.15 USE OF ROADWAYS .....	18
1.16 TEMPORARY USE OF EXISTING ELEVATORS.....	18
1.17 TEMPORARY TOILETS.....	18
1.18 AVAILABILITY AND USE OF UTILITY SERVICES.....	18
1.19 TESTS.....	19
1.20 INSTRUCTIONS.....	19
1.21 RELOCATED EQUIPMENT/ITEMS .....	20

**SECTION 01 00 00  
GENERAL REQUIREMENTS**

**1.1 GENERAL INTENTION**

- A. Contractor shall completely prepare area of work for renovations, including demolition and removal of existing construction, and furnish labor and materials and perform work for Upgrade Electrical Branch Lines B310 (Project 552-15-206) as required by drawings and specifications.
- B. All references in the project documents to "Resident Engineer", "RE", "Project Engineer", Contracting Officers Technical Representative" or "COTR" shall be synonymous to "COR".
- C. Offices of Heapy Engineering, 1400 West Dorothy Lane, Dayton OH, 45409, as Architect-Engineers, will render certain technical services during construction. Such services shall be considered as advisory to the Government and shall not be construed as expressing or implying a contractual act of the Government without affirmations by Contracting Officer or his duly authorized representative.
- D. Before placement and installation of work subject to tests by testing laboratory retained by Department of Veterans Affairs, the Contractor shall notify the COR in sufficient time to enable testing laboratory personnel to be present at the site in time for proper taking and testing of specimens and field inspection. Such prior notice shall be not less than three work days unless otherwise designated by the COR.
- E. All employees of general contractor and subcontractors shall comply with VA security management program and obtain permission of the VA police, be identified by project and employer, and restricted from unauthorized access. All contractors' workforce are required to obtain and wear on a daily basis an ID Badge from VA Police. The process to obtain an ID Badge includes a background check. Any member of the contractor's workforce, including subcontractors who report to work without their VA issued ID Badge will be asked to leave the property. Replacement ID Badges will be furnished at the contractor's expense.
- F. Prior to commencing work, general contractor shall provide proof that a OSHA designated "competent person" (CP) (29 CFR 1926.20(b)(2)) will maintain a presence at the work site whenever the general or subcontractors are present. The OSHA "competent person" shall have a minimum of a 30 hour training.
- G. Training:

1. All employees of general contractor or subcontractors shall have the 10-hour or 30-hour OSHA Construction Safety course and other relevant competency training, as determined by VA CP with input from the ICRA team.
  2. Submit training records of all such employees for approval before the start of work. Training shall include level of OSHA Construction Safety course and relative level of specific trade (i.e. apprentice, journeyman, master).
- H. VHA Directive 2011-36, Safety and Health during Construction, dated 9/22/2011 in its entirety is made a part of this section. This directive requires a site-specific safety plan; general all-encompassing safety plans are not acceptable. Contractor shall submit site safety plan for review and approval prior to start of work.

### **1.2 STATEMENT OF BID ITEM(S)**

- A. ITEM I, BASE BID: All work specified or shown in the bid documents. Work includes general construction, panelboard replacement, new feeders, branch circuitry extension and a new EMCS system, and necessary removal of existing construction and certain other items. Contractor shall have 330 days from Notice to Proceed to complete Work associated with Item I, Base Bid. Work shall be completed in phases as noted on the drawings. The first 60 days shall be used for the submission and approval of the project schedule, shop drawings and the obtainment of all necessary construction materials by the contractor.
- B. ITEM II, DEDUCT ALTERNATE NO.1: Provide all work indicated in ITEM I above with the exception of the monitoring of ATs and generators through the EMCS of all equipment located in Building 330 Chiller Plant. Refer to drawings for more information. EMCS headend system shall remain sized for entire campus. Reduce 330 days in Item A above to 300 days.
- C. ITEM III, DEDUCT ALTERNATE NO. 2: Provide all work indicated in ITEM II above with the exception of the monitoring of ATs and generators through the EMCS of all equipment located in Building 330. Refer to drawings for more information. EMCS headend system shall remain sized for entire campus. Reduce 330 days in Item A above to 270 days.

### **1.3 SPECIFICATIONS AND DRAWINGS FOR CONTRACTOR**

- A. Sets of drawings may be made by the Contractor, at Contractor's expense, from electronic copies of the drawings furnished by Issuing Office.

### **1.4 CONSTRUCTION SECURITY REQUIREMENTS**

- A. Security Plan:

1. The security plan defines both physical and administrative security procedures that will remain effective for the entire duration of the project.
2. The General Contractor is responsible for assuring that all sub-contractors working on the project and their employees also comply with these regulations.

B. Security Procedures:

1. General Contractor's employees (to include all subcontractors) shall not enter the project site without an appropriate Dayton VA Medical Center badge. They may also be subject to inspection of their personal effects when entering or leaving the project site. The badging process is expected to take a minimum of six weeks. A badging briefing is provided in the solicitation. Before performing any work at the Dayton VA Medical Center, contractor personnel shall be appropriately badged in accordance with the following procedures:
  - a. Contractor shall submit names (first, middle, last) of personnel, to include birth dates and social security number, and foreign national status, expected to work on site to the VA COR, who will sponsor all personnel associated with the contract. A hand-out shall be provided at the pre-con outlining these requirements. The contractor shall distinguish between personnel expected to work 15 days or less, greater than 15 days but less than 180 days. Contractor may submit names throughout the contract period as well, and the same process applies.
  - b. For contractor personnel working fifteen days or less on site, the contractor shall report to the Police Station, Building 127, to obtain a temporary "Station" badge.
  - c. For contractor personnel working greater than fifteen days, contractor shall establish an appointment for obtaining a "Flash" badge from the Human Resources Department (HR) located at the Dayton VA Medical Center, Building 409 (second floor), using the following internet address: <https://va-piv.com>. Appointments may take a minimum of two weeks to be scheduled.
    - i. During the appointment at HR, the contractor shall be fingerprinted. Contractor shall verify the requirement for a follow-on appointment with Human Resources in order to pick up the completed badge. "Flash" badges are issued a minimum of two weeks following this appointment.
    - ii. Contractors approved to work but who do not yet have a "Flash" badge may obtain a "Station" badge following the procedures previously identified. "Station" badges will not be issued back-to-back to a single individual. If a

contractor's "Station" badge has expired, and the contractor has not received a "Flash" badge, that contractor will not be permitted to work on the site.

- iii. After receipt of the "Flash" badge, contractor personnel shall return to the Police Station any "Station" badges previously issued to the same individual.
  - iv. Contractor shall monitor expiration dates of expiring badges and reinitiate the previous process should personnel be required to work on site beyond the expiration date.
  - v. In situations where a prime contractor is employing personnel who are already badged (i.e. badge has been obtained under a different contract), those individuals do not need to be submitted until within four weeks of expiration of the badge.
  - vi. Contractors shall report lost/missing badges within 24 hours to the COR.
  - vii. Contractor shall ensure "Flash" badges are collected and turned into COR upon contract completion.
2. For working outside the "regular hours" as defined in the contract, The General Contractor shall give 3 days notice to the Contracting Officer so that security arrangements can be provided for the employees. This notice is separate from any notices required for utility shutdown described later in this section.
  3. No photography of VA premises is allowed without written permission of the Contracting Officer.
  4. VA reserves the right to close down or shut down the project site and order General Contractor's employees off the premises in the event of a national emergency. The General Contractor may return to the site only with the written approval of the Contracting Officer.

C. Key Control:

1. The General Contractor shall provide, at the request of the Contracting officer's representative (COR), duplicate keys and lock combinations. For the purpose of security, at any time, the COR may request and shall be provided immediate access to inspect locked containers and Contractor/subcontractor company vehicles.
2. The General Contractor shall turn over all permanent lock cylinders to the VA locksmith for permanent installation.

3. The Contractor may be provided government key(s) to access construction sites. These key(s) shall be turned over to the COR at the end of the project, or sooner if access to keyed areas is no longer required. Loss of key(s) may result in rekeying of entire lockset at the expense of the Contractor.

D. Document Control:

1. Before starting any work, the General Contractor/Sub Contractors shall submit an electronic security memorandum describing the approach to following goals and maintaining confidentiality of "sensitive information".
2. The General Contractor is responsible for safekeeping of all drawings, project manual and other project information. This information shall be shared only with those with a specific need to accomplish the project.
3. Certain documents, sketches, videos or photographs and drawings may be marked "Law Enforcement Sensitive" or "Sensitive Unclassified". Secure such information in separate containers and limit the access to only those who will need it for the project. Return the information to the Contracting Officer upon request.
4. These security documents shall not be removed or transmitted from the project site without the written approval of Contracting Officer.
5. All paper waste or electronic media such as CD's and diskettes shall be shredded and destroyed in a manner acceptable to the VA.
6. Notify Contracting Officer and Site Security Officer immediately when there is a loss or compromise of "sensitive information".
7. All electronic information shall be stored in specified location following VA standards and procedures using an Engineering Document Management Software (EDMS).
  - a. Security, access and maintenance of all project drawings, both scanned and electronic shall be performed and tracked through the EDMS system.
  - b. "Sensitive information" including drawings and other documents may be attached to e-mail provided all VA encryption procedures are followed.

E. Motor Vehicle Restrictions

1. Vehicle authorization request shall be required for any vehicle entering the site and such request shall be submitted 24 hours before the date and time of access. Access shall be restricted to picking up and dropping off materials and supplies.
2. Separate permits shall be issued for General Contractor and its employees for parking in designated areas only.

### 1.5 FIRE SAFETY

- A. Applicable Publications: Publications listed below form part of this Article to extent referenced. Publications are referenced in text by basic designations only.

1. American Society for Testing and Materials (ASTM):

E84-2009 ..... Surface Burning Characteristics of Building Materials

2. National Fire Protection Association (NFPA):

10-2010..... Standard for Portable Fire Extinguishers

30-2008..... Flammable and Combustible Liquids Code

51B-2009 ..... Standard for Fire Prevention During Welding, Cutting and Other  
Hot Work

70-2011..... National Electrical Code

101-2012 ..... Life Safety Code

241-2009 ..... Standard for Safeguarding Construction, Alteration, and  
Demolition Operations

3. Occupational Safety and Health Administration (OSHA):

29 CFR 1926 ..... Safety and Health Regulations for Construction

4. VHA Directive 2005-007

- B. Fire Safety Plan: Establish and maintain a fire protection program in accordance with 29 CFR 1926. Prior to start of work, prepare a plan detailing project-specific fire safety measures, including periodic status reports, and submit to COR for review for compliance with VHA Directive 2005-007, NFPA 101 and NFPA 241. Prior to beginning work, all employees of the contractor and/or any subcontractors shall undergo a safety briefing provided by the general contractor's competent person per OSHA requirements. This briefing shall include information on the

construction limits, VAMC safety guidelines, means of egress, break areas, work hours, locations of restrooms, use of VAMC equipment, etc. Provide documentation to the COR that all construction workers have undergone contractor's safety briefing.

- C. Site and Building Access: Maintain free and unobstructed access to facility emergency services and for fire, police and other emergency response forces in accordance with NFPA 241.
- D. Separate temporary facilities, such as trailers, storage sheds, and dumpsters, from existing buildings and new construction by distances in accordance with NFPA 241. For small facilities with less than 6 m (20 feet) exposing overall length, separate by 3m (10 feet).
- E. Temporary Construction Partitions:
  - 1. Install and maintain temporary construction partitions to provide smoke-tight separations between construction areas and adjoining areas. Construct partitions of gypsum board on both sides of metal steel studs. Extend the partitions through suspended ceilings to floor slab deck or roof. Seal joints and penetrations. At door openings, install Class C, ¾ hour fire/smoke rated doors with self-closing devices.
  - 2. Close openings in smoke barriers and fire-rated construction to maintain fire ratings. Seal penetrations with listed through-penetration firestop materials in accordance with Section 07 84 00, FIRESTOPPING.
- F. Temporary Heating and Electrical: Install, use and maintain installations in accordance with 29 CFR 1926, NFPA 241 and NFPA 70.
- G. Means of Egress: Do not block exiting for occupied buildings, including paths from exits to roads. Minimize disruptions and coordinate with COR.
- H. Egress Routes for Construction Workers: Maintain free and unobstructed egress. Inspect daily. Report findings and corrective actions weekly to COR.
- I. Fire Extinguishers: Provide and maintain extinguishers in construction areas and temporary storage areas in accordance with 29 CFR 1926, NFPA 241 and NFPA 10.
- J. Flammable and Combustible Liquids: Store, dispense and use liquids in accordance with 29 CFR
- K. Existing Fire Protection: Do not impair automatic sprinklers, smoke and heat detection, and fire alarm systems, except for portions immediately under construction, and temporarily for fire connections. Provide fire watch for impairments more than 4 hours in a 24-hour period. Request interruptions in accordance with Article, OPERATIONS AND STORAGE AREAS, and coordinate

with COR. All existing or temporary fire protection systems (fire alarms, sprinklers) located in construction areas shall be tested as coordinated with the medical center.

- L. Smoke Detectors: Prevent accidental operation. Remove temporary covers at end of work operations each day. Coordinate with COR and facility Safety Officer.
- M. Hot Work: Perform and safeguard hot work operations in accordance with NFPA 241 and NFPA 51B. Coordinate with COR. Obtain permits from facility Safety Officer at least 24 hours in advance. Designate contractor's responsible project-site fire prevention program manager to permit hot work.
- N. Fire Hazard Prevention and Safety Inspections: Inspect entire construction areas weekly. Coordinate with, and report findings and corrective actions weekly to COR.
- O. Smoking: Smoking is prohibited in and adjacent to construction areas inside existing buildings and additions under construction. In separate and detached buildings under construction, smoking is prohibited except in designated smoking rest areas.
- P. Dispose of waste and debris in accordance with NFPA 241. Remove from buildings daily.
- Q. Perform other construction, alteration and demolition operations in accordance with 29 CFR 1926.

#### **1.6 OPERATIONS AND STORAGE AREAS**

- A. The Contractor shall confine all operations (including storage of materials) on Government premises to areas authorized or approved by the Contracting Officer. The Contractor shall hold and save the Government, its officers and agents, free and harmless from liability of any nature occasioned by the Contractor's performance.
- B. Temporary buildings (e.g., storage sheds, shops, offices) and utilities may be erected by the Contractor only with the approval of the Contracting Officer and shall be built with labor and materials furnished by the Contractor without expense to the Government. The temporary buildings and utilities shall remain the property of the Contractor and shall be removed by the Contractor at its expense upon completion of the work.
- C. The Contractor shall, under regulations prescribed by the Contracting Officer, use only established roadways, or use temporary roadways constructed by the Contractor when and as authorized by the Contracting Officer. When materials are transported in prosecuting the work, vehicles shall not be loaded beyond the loading capacity recommended by the manufacturer of the vehicle or prescribed by any Federal, State, or local law or regulation. When it is necessary to cross curbs or sidewalks, the Contractor shall protect them from damage. The Contractor shall

repair or pay for the repair of any damaged curbs, sidewalks, or roads. Contractor shall not, at any time, block access to any roads, parking lots, sidewalks or other site structures.

**(FAR 52.236-10)**

- D. Working space and space available for storing materials shall be as determined by the COR. The Contractor is not guaranteed storage in the immediate vicinity of the worksite but will be afforded space for storing nonhazardous material on DVAMC property.
- E. Workmen are subject to rules of Medical Center applicable to their conduct.
- F. Execute work so as to interfere as little as possible with normal functioning of Medical Center and Cemetery as a whole, including operations of utility services, fire protection systems and any existing equipment, and with work being done by others. Use of equipment and tools that transmit vibrations and noises through the building structure, are not permitted in buildings that are occupied, during construction, jointly by patients or medical personnel, and Contractor's personnel, except as permitted by COR where required by limited working space.
1. Do not store materials and equipment in other than assigned areas.
  2. Schedule delivery of materials and equipment to immediate construction working areas within buildings in use by Department of Veterans Affairs in quantities sufficient for not more than two work days. Provide unobstructed access to Medical Center and Cemetery areas required to remain in operation.
- G. Phasing: To insure such executions, Contractor shall furnish the COR with a schedule of approximate phasing dates on which the Contractor intends to accomplish work in each specific area of site, building or portion thereof. In addition, Contractor shall notify the COR two weeks in advance of the proposed date of starting work in each specific area of site, building or portion thereof. Arrange such phasing dates to insure accomplishment of this work in successive phases mutually agreeable to COR and Contractor:
- H. Buildings 310 and 330 will be occupied during normal business hours; but most areas of alterations will be vacated on nights and weekends with the exception of the Emergency Department and emergency surgeries. **All work in non-mechanical/electrical spaces will be performed outside of normal business hours (5pm-5am M-F and anytime Sat-Sun). Work performed during normal business hours must NOT interrupt services or produce noise that would transfer to occupied portions of the building. ALL cutovers must be done outside of normal business hours and coordinated with COR 3 weeks in advance. Building 330 (main hospital) will remain occupied continuously and construction must be coordinated with COR extensively.**

1. Contractor shall take all measures and provide all material necessary for protecting existing equipment and property in affected areas of construction against dust and debris, so that equipment and affected areas to be used in the Medical Centers operations will not be hindered. Contractor shall permit access to Department of Veterans Affairs personnel and patients through other construction areas which serve as routes of access to such affected areas and equipment. Coordinate alteration work in areas occupied by Department of Veterans Affairs so that Medical Center operations will continue during the construction period.
- I. When area of construction is turned over to Contractor, Contractor shall accept entire responsibility therefore.
1. Contractor shall maintain a minimum temperature of 21 degrees C (70 degrees F) at all times, except as otherwise specified.
  2. Contractor shall maintain in operating condition existing fire protection and alarm equipment..
- J. Utilities Services: Maintain existing utility services for Medical Center at all times. Provide temporary facilities, labor, materials, equipment, connections, and utilities to assure uninterrupted services. Where necessary to cut existing conduits, wires, cables, etc. of utility services and communications systems (including telephone), they shall be cut and capped at suitable places where shown; or, in absence of such indication, where directed by COR.
1. No utility service such as water, gas, steam, sewers or electricity, or fire protection systems and communications systems may be interrupted without prior approval of COR. Electrical work shall be accomplished with all affected circuits or equipment de-energized. When an electrical outage cannot be accomplished, work on any energized circuits or equipment shall not commence without the Medical Center Director's prior knowledge and written approval. Refer to specification Sections 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS for additional requirements.
  2. Contractor will be advised (in writing) of approval of request, or of which other date and/or time such interruption will cause least inconvenience to operations of Medical Center. Interruption time approved by Medical Center will occur outside of Medical Center normal working hours.
  3. Interruptions of any system must be requested, in writing, at least 21 calendar days prior to the desired time and shall be performed as directed by the COR.
  4. In case of a contract construction emergency, service will be interrupted on approval of COR. Such approval will be confirmed in writing as soon as practical.

- K. Abandoned Lines: All service lines such as wires, cables, conduits, ducts, pipes and the like, and their hangers or supports, which are to be abandoned but are not required to be entirely removed, shall be sealed, capped or plugged. The lines shall not be capped in finished areas, but shall be removed and sealed, capped or plugged in ceilings, within furred spaces, in unfinished areas, or within walls or partitions; so that they are completely behind the finished surfaces.
- L. To minimize interference of construction activities with flow of Medical Center traffic, comply with the following:
  - 1. Keep roads, walks and entrances to grounds, to parking and to occupied areas of buildings clear of construction materials, debris and standing construction equipment and vehicles.
- M. Coordinate the work for this contract with other construction operations as directed by COR. This includes the scheduling of traffic and the use of roadways, as specified in Article, USE OF ROADWAYS.

#### **1.7 ALTERATIONS**

- A. Survey: Before any work is started, the Contractor shall make a thorough survey with COR, of areas of buildings in which alterations occur and areas which are anticipated routes of access, and furnish a report, signed by both, to the Contracting Officer. This report shall list by rooms and spaces:
  - 1. Existence and conditions of items such as plumbing fixtures and accessories, electrical fixtures, equipment, venetian blinds, shades, etc., required by drawings to be either reused or relocated, or both.
  - 2. Shall note any discrepancies between drawings and existing conditions at site.
  - 3. Shall designate areas for working space, materials storage and routes of access to areas within buildings where alterations occur and which have been agreed upon by Contractor and COR.
- B. Any items required by drawings to be either reused or relocated or both, found during this survey to be nonexistent, or in opinion of COR, to be in such condition that their use is impossible or impractical, shall be furnished and/or replaced by Contractor with new items in accordance with specifications which will be furnished by Government. Provided the contract work is changed by reason of this subparagraph B, the contract will be modified accordingly, under provisions of clause entitled "DIFFERING SITE CONDITIONS" (FAR 52.236-2) and "CHANGES" (FAR 52.243-4 and VAAR 852.236-88).

- C. Re-Survey: Seven days before expected partial or final inspection date, the Contractor and COR together shall make a thorough re-survey of the areas of buildings involved. They shall furnish a report on conditions then existing, of resilient flooring, doors, windows, walls and other surfaces as compared with conditions of same as noted in first condition survey report:
1. Re-survey report shall also list any damage caused by Contractor to such flooring and other surfaces, despite protection measures; and, will form basis for determining extent of repair work required of Contractor to restore damage caused by Contractor's workmen in executing work of this contract.
- D. Protection: Provide the following protective measures:
1. Wherever existing roof surfaces are disturbed they shall be protected against water infiltration. In case of leaks, they shall be repaired immediately upon discovery.
  2. Temporary protection against damage for portions of existing structures and grounds where work is to be done, materials handled and equipment moved and/or relocated.
  3. Protection of interior of existing structures at all times, from damage, dust and weather inclemency. Wherever work is performed, floor surfaces that are to remain in place shall be adequately protected prior to starting work, and this protection shall be maintained intact until all work in the area is completed.

### **1.8 INFECTION PREVENTION MEASURES**

- A. Implement the requirements of VAMC's Infection Control Risk Assessment (ICRA) team. ICRA Group may monitor dust in the vicinity of the construction work and require the Contractor to take corrective action immediately if the safe levels are exceeded.
- B. Establish and maintain a dust control program as part of the contractor's infection preventive measures in accordance with the guidelines provided by ICRA Group. Prior to start of work, prepare a plan detailing project-specific dust protection measures, including periodic status reports, and submit to COR for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.
1. All personnel involved in the construction or renovation activity shall be educated and trained in infection prevention measures established by the medical center. Prior to start of work, General Contractor Site Supervisor shall meet with Infection Control personnel to discuss the Dust Control Plan in context with medical center operations.
- C. Medical center Infection Control personnel shall monitor for airborne disease (e.g. aspergillosis) as appropriate during construction. A baseline of conditions may be established by the medical

center prior to the start of work and periodically during the construction stage to determine impact of construction activities on indoor air quality. In addition:

1. The COR and VAMC Infection Control personnel shall review pressure differential monitoring documentation to verify that pressure differentials in the construction zone and in the patient-care rooms are appropriate for their settings. Negative air pressure and HEPA filtrations shall be maintained in all construction areas. Upon notification, the contractor shall implement corrective measures to restore proper pressure differentials as needed.
  2. In case of any problem, the medical center, along with assistance from the contractor, shall conduct an environmental assessment to find and eliminate the source.
- D. In general, following preventive measures shall be adopted during construction to keep down dust and prevent mold.
1. Dampen debris to keep down dust and provide temporary construction partitions in existing structures where directed by COR. Blank off ducts and diffusers to prevent circulation of dust into occupied areas during construction.
  2. Do not perform dust producing tasks within occupied areas without the approval of the COR. For construction in any areas that will remain jointly occupied by the medical Center and Contractor's workers, the Contractor shall:
    - a. Provide dust proof temporary drywall construction barriers to completely separate construction from the operational areas of the hospital in order to contain dirt debris and dust. Barriers shall be sealed and made presentable on hospital occupied side. Install a self-closing rated door in a metal frame, commensurate with the partition, to allow worker access. Maintain negative air at all times. A fire retardant polystyrene, 6-mil thick or greater plastic barrier meeting local fire codes may be used where dust control is the only hazard, and an agreement is reached with the COR.
    - b. HEPA filtration is required where the exhaust dust may reenter the breathing zone. Contractor shall verify that construction exhaust to exterior is not reintroduced to the medical center through intake vents, or building openings. Install HEPA (High Efficiency Particulate Accumulator) filter vacuum system rated at 95% capture of 0.3 microns including pollen, mold spores and dust particles. Insure continuous negative air pressures occurring within the work area. HEPA filters should have ASHRAE 85 or other prefilter to extend the useful life of the HEPA. Provide both primary and secondary filtrations units. Exhaust hoses shall be heavy duty, flexible steel reinforced and exhausted so that dust is not reintroduced to the medical center.

- c. Adhesive Walk-off Mats, minimum 600mm x 900mm (24" x 36"), shall be used at all interior transitions from the construction area to occupied medical center area. These mats shall be changed as often as required to maintain clean work areas directly outside construction area at all times.
  - d. Vacuum and wet mop all transition areas from construction to the occupied medical center at the end of each workday. Vacuum shall utilize HEPA filtration. Maintain surrounding area frequently. Remove debris as they are created. Transport these outside the construction area in containers with tightly fitting lids.
  - e. The contractor shall not haul debris through patient-care areas without prior approval of the COR and the Medical Center. When, approved, debris shall be hauled in enclosed dust proof containers or wrapped in plastic and sealed with duct tape. No sharp objects should be allowed to cut through the plastic. Wipe down the exterior of the containers with a damp rag to remove dust. All equipment, tools, material, etc. transported through occupied areas shall be made free from dust and moisture by vacuuming and wipe down.
  - f. Using a HEPA vacuum, clean inside the barrier and vacuum ceiling tile prior to replacement. Any ceiling access panels opened for investigation beyond sealed areas shall be sealed immediately when unattended.
  - g. There shall be no standing water during construction. This includes water in equipment drip pans and open containers within the construction areas. All accidental spills must be cleaned up and dried within 12 hours. Remove and dispose of porous materials that remain damp for more than 72 hours.
  - h. At completion, remove construction barriers and ceiling protection carefully, outside of normal work hours. Vacuum and clean all surfaces free of dust after the removal.
- E. Final Cleanup:
- 1. Upon completion of project, or as work progresses, remove all construction debris from above ceiling, vertical shafts and utility chases that have been part of the construction.
  - 2. Perform HEPA vacuum cleaning of all surfaces in the construction area. This includes walls, ceilings, cabinets, furniture (built-in or free standing), partitions, flooring, etc.
  - 3. All new air ducts shall be cleaned prior to final inspection.

### **1.9 DISPOSAL AND RETENTION**

- A. Materials and equipment accruing from work removed and from demolition of buildings or structures, or parts thereof, shall be disposed of as follows:
1. Reserved items which are to remain property of the Government are noted on drawings or in specifications as items to be stored. Items that remain property of the Government shall be removed or dislodged from present locations in such a manner as to prevent damage which would be detrimental to re-installation and reuse. Store such items where directed by COR.
  2. Items not reserved shall become property of the Contractor and be removed by Contractor from Medical Center.
  3. Items of portable equipment and furnishings located in rooms and spaces in which work is to be done under this contract shall remain the property of the Government. When rooms and spaces are vacated by the Department of Veterans Affairs during the alteration period, such items which are NOT required by drawings and specifications to be either relocated or reused will be removed by the Government in advance of work to avoid interfering with Contractor's operation.

### **1.10 PROTECTION OF EXISTING VEGETATION, STRUCTURES, EQUIPMENT, UTILITIES, AND IMPROVEMENTS**

- A. The Contractor shall preserve and protect all structures, equipment, and vegetation (such as trees, shrubs, and grass) on or adjacent to the work site, which are not to be removed and which do not unreasonably interfere with the work required under this contract. The Contractor shall only remove trees when specifically authorized to do so, and shall avoid damaging vegetation that will remain in place. If any limbs or branches of trees are broken during contract performance, or by the careless operation of equipment, or by workmen, the Contractor shall trim those limbs or branches with a clean cut and paint the cut with a tree-pruning compound as directed by the Contracting Officer. The Contractor shall restore any grounds damaged during the course of the project to original condition. Ruts/Holes on lawns shall be corrected by filling with top soil and sod to original grade. Contractor shall be responsible for maintaining and watering replaced sod up to three weeks after placement and will replace dead/dying sod, which will also be maintained and watered up to three weeks after placement.
- B. The Contractor shall protect from damage all existing improvements and utilities at or near the work site and on adjacent property of a third party, the locations of which are made known to or should be known by the Contractor. The Contractor shall repair any damage to those facilities, including those that are the property of a third party, resulting from failure to comply with the requirements of this contract or failure to exercise reasonable care in performing the work. If the

Contractor fails or refuses to repair the damage promptly, the Contracting Officer may have the necessary work performed and charge the cost to the Contractor.

**(FAR 52.236-9)**

**1.11 RESTORATION**

- A. Remove, cut, alter, replace, patch and repair existing work as necessary to install new work. Except as otherwise shown or specified, do not cut, alter or remove any structural work, and do not disturb any ducts, plumbing, steam, gas, or electric work without approval of the COR. Existing work to be altered or extended and that is found to be defective in any way, shall be reported to the COR before it is disturbed. Materials and workmanship used in restoring work, shall conform in type and quality to that of original existing construction, except as otherwise shown or specified.
- B. Upon completion of contract, deliver work complete and undamaged. Existing work (walls, ceilings, partitions, floors, mechanical and electrical work, lawns, paving, roads, walks, etc.) disturbed or removed as a result of performing required new work, shall be patched, repaired, reinstalled, or replaced with new work, and refinished and left in as good condition as existed before commencing work.
- C. At Contractor's own expense, Contractor shall immediately restore to service and repair any damage caused by Contractor's workmen to existing piping and conduits, wires, cables, etc., of utility services or of fire protection systems and communications systems (including telephone) which are indicated on drawings and which are not scheduled for discontinuance or abandonment.
- D. Expense of repairs to such utilities and systems not shown on drawings or locations of which are unknown will be covered by adjustment to contract time and price in accordance with clause entitled "CHANGES" (FAR 52.243-4 and VAAR 852.236-88) and "DIFFERING SITE CONDITIONS" (FAR 52.236-2).

**1.12 PHYSICAL DATA**

- A. Data and information furnished or referred to below is for the Contractor's information. The Government shall not be responsible for any interpretation of or conclusion drawn from the data or information by the Contractor.

The following reports, which are dated April 9, 2014, prepared by Terracon Consultants, Inc.:

Asbestos Survey

Project: Upgrade Electrical Branch Lines Building 310

VA Project No. 552-15-206

Limited Testing of Paint for Lead Content

Project: Upgrade Electrical Branch Lines Building 310

VA Project No. 552-15-206

**(FAR 52.236-4)**

- B. Government does not guarantee that other materials will not be encountered nor that proportions, conditions or character of several materials will not vary from those indicated by explorations. Bidders are expected to examine site of work and logs of borings; and, after investigation, decide for themselves character of materials and make their bids accordingly. Upon proper application to Department of Veterans Affairs, bidders will be permitted to make subsurface explorations of their own at site.

**1.13 LAYOUT OF WORK**

- A. The Contractor shall lay out the work from Government established base lines and bench marks, indicated on the drawings, and shall be responsible for all measurements in connection with the layout. The Contractor shall furnish, at Contractor's own expense, all stakes, templates, platforms, equipment, tools, materials, and labor required to lay out any part of the work. The Contractor shall be responsible for executing the work to the lines and grades that may be established or indicated by the Contracting Officer. The Contractor shall also be responsible for maintaining and preserving all stakes and other marks established by the Contracting Officer until authorized to remove them. If such marks are destroyed by the Contractor or through Contractor's negligence before their removal is authorized, the Contracting Officer may replace them and deduct the expense of the replacement from any amounts due or to become due to the Contractor.

**(FAR 52.236-17)**

**1.14 AS-BUILT DRAWINGS**

- A. The contractor shall maintain two full size sets of as-built drawings which will be kept current during construction of the project, to include all contract changes, modifications and clarifications.
- B. All variations shall be shown in the same general detail as used in the contract drawings. To insure compliance, as-built drawings shall be made available for the COR's review, as often as requested.

- C. Contractor shall deliver two approved completed sets of as-built drawings to the Resident Engineer within 15 calendar days after each completed phase and after the acceptance of the project by the COR.
- D. Paragraphs A, B, & C shall also apply to all shop drawings.

#### **1.15 USE OF ROADWAYS**

- A. For hauling, use only established public roads and roads on Medical Center and Cemetery property.

#### **1.16 TEMPORARY USE OF EXISTING ELEVATORS**

- A. Use of existing elevators for handling building materials and Contractor's personnel will be permitted subject to following provisions:
  - 1. Contractor makes all arrangements with the COR for use of elevators. The COR will ascertain that elevators are in proper condition.
  - 2. Contractor covers and provides maximum protection of following elevator components:
    - a. Entrance jambs, heads soffits and threshold plates.
    - b. Entrance columns, canopy, return panels and inside surfaces of car enclosure walls.
    - c. Finish flooring.

#### **1.17 TEMPORARY TOILETS**

- A. Contractor may have for use of Contractor's workmen, such toilet accommodations as may be assigned to Contractor by Medical Center . Contractor shall keep such places clean and be responsible for any damage done thereto by Contractor's workmen. Failure to maintain satisfactory condition in toilets will deprive Contractor of the privilege to use such toilets.

#### **1.18 AVAILABILITY AND USE OF UTILITY SERVICES**

- A. The Government shall make all reasonably required amounts of utilities available to the Contractor from existing outlets and supplies, as specified in the contract. The Contractor shall carefully conserve any utilities furnished without charge.
- B. The Contractor, at Contractor's expense and in a workmanlike manner satisfactory to the Contracting Officer, shall install and maintain all necessary temporary connections and distribution lines, and all meters required to measure the amount of electricity used for the purpose of determining charges. Before final acceptance of the work by the Government, the

Contractor shall remove all the temporary connections, distribution lines, meters, and associated paraphernalia.

- C. Electricity (for Construction and Testing): Furnish all temporary electric services.
  - 1. Obtain electricity by connecting to the Medical Center electrical distribution system. The Contractor shall meter and pay for electricity required for electric cranes and hoisting devices, electrical welding devices and any electrical heating devices providing temporary heat. Electricity for all other uses is available at no cost to the Contractor.

### **1.19 TESTS**

- A. Before placement and installation of work subject to test, whether by Contractor or through a testing laboratory retained by Department of Veterans Affairs, the Contractor shall notify the COR to enable COR or government representative(s) to be present at the site for proper taking and testing of specimens and field inspection. Such prior notice shall be not less than three work days unless otherwise designated by the COR. Pre-test mechanical and electrical equipment and systems and make corrections required for proper operation of such systems before requesting final tests. Final test will not be conducted unless pre-tested.
- B. Conduct final tests required in various sections of specifications in presence of COR. Contractor shall furnish all labor, materials, equipment, instruments, and forms, to conduct and record such tests.
- C. Mechanical and electrical systems shall be balanced, controlled and coordinated. A system is defined as the entire complex which must be coordinated to work together during normal operation to produce results for which the system is designed.
- D. All related components as defined above shall be functioning when any system component is tested. Tests shall be completed within a reasonably short period of time during which operating and environmental conditions remain reasonably constant.
- E. Individual test result of any component, where required, will only be accepted when submitted with the test results of related components and of the entire system.

### **1.20 INSTRUCTIONS**

- A. Contractor shall furnish Maintenance and Operating manuals (hard copies and electronic) and verbal instructions when required by the various sections of the specifications and as hereinafter specified.
- B. Manuals: Maintenance and operating manuals and one compact disc (four hard copies and one electronic copy each) for each separate piece of equipment shall be delivered to the COR

coincidental with the delivery of the equipment to the job site. Manuals shall be complete, detailed guides for the maintenance and operation of equipment. They shall include complete information necessary for starting, adjusting, maintaining in continuous operation for long periods of time and dismantling and reassembling of the complete units and sub-assembly components. Manuals shall include an index covering all component parts clearly cross-referenced to diagrams and illustrations. Illustrations shall include "exploded" views showing and identifying each separate item. Emphasis shall be placed on the use of special tools and instruments. The function of each piece of equipment, component, accessory and control shall be clearly and thoroughly explained. All necessary precautions for the operation of the equipment and the reason for each precaution shall be clearly set forth. Manuals must reference the exact model, style and size of the piece of equipment and system being furnished. Manuals referencing equipment similar to but of a different model, style, and size than that furnished will not be accepted.

- C. Instructions: Contractor shall provide qualified, factory-trained manufacturers' representatives to give detailed instructions to assigned Department of Veterans Affairs personnel in the operation and complete maintenance for each piece of equipment. All such training will be at the job site. These requirements are more specifically detailed in the various technical sections. Instructions for different items of equipment that are component parts of a complete system, shall be given in an integrated, progressive manner. All instructors for every piece of component equipment in a system shall be available until instructions for all items included in the system have been completed. This is to assure proper instruction in the operation of inter-related systems. All instruction periods shall be at such times as scheduled by the COR and shall be considered concluded only when the COR is satisfied in regard to complete and thorough coverage. Unless specified to provide more detailed instruction, the Contractor shall provide a minimum of four hours operating and maintenance training for each unique piece of equipment provided. The contractor shall submit a course outline with associated material to the COR for review and approval prior to scheduling training to ensure the subject matter covers the expectations of the VA and the contractual requirements. The Department of Veterans Affairs reserves the right to request the removal of, and substitution for, any instructor who, in the opinion of the COR, does not demonstrate sufficient qualifications in accordance with requirements for instructors above.

#### **1.21 RELOCATED EQUIPMENT/ITEMS**

- A. Contractor shall disconnect, dismantle as necessary, remove and reinstall in new location, all existing equipment and items indicated or otherwise shown to be relocated by the Contractor.
- B. Perform relocation of such equipment or items at such times and in such a manner as directed by the COR.

- C. Suitably cap existing service lines, such as steam, condensate return, water, drain, gas, air, vacuum and/or electrical, whenever such lines are disconnected from equipment to be relocated. Remove abandoned lines in finished areas and cap as specified herein before under paragraph "Abandoned Lines".
- D. Provide all mechanical and electrical service connections, fittings, fastenings and any other materials necessary for assembly and installation of relocated equipment; and leave such equipment in proper operating condition.

- - - E N D - - -

**SECTION 01 32 16.15  
PROJECT SCHEDULES**

**PART 1- GENERAL**

**1.1 DESCRIPTION:**

- A. The Contractor understands that time is of the essence in this project and that the development of, and adherence to, a realistic and achievable project schedule is critical to the Government. The Contractor shall develop a written project narrative and project schedule demonstrating fulfillment of the contract requirements (Project Schedule), and shall keep the Project Schedule up-to-date in accordance with the requirements of this section and shall utilize the plan for scheduling, coordinating and monitoring work under this contract (including all activities of subcontractors, equipment vendors and suppliers). Gantt Scheduling technique shall be utilized to satisfy both time and cost applications.

**1.2 CONTRACTOR'S REPRESENTATIVE:**

- A. The Contractor shall designate an authorized representative who shall serve as the Project Superintendent responsible for the all contractual aspects of the project, including Project Schedule preparation, review and progress reporting with and to the Contracting Officer's Representative (COR). The Contractor shall submit the individual's name and qualifications to the Contracting Officer within 10 calendar days of notice to proceed. Qualifications shall include a representative sample of at least three construction projects within the past five years, for which the proposed individual has performed complete superintendent and scheduling services. These representative samples shall be of similar size and scope to this project.
- B. The Project Superintendent shall have direct project control and complete authority to act on behalf of the Contractor in fulfilling the requirements of this contract.
- C. The Project Superintendent shall have the option of developing the project schedule within their organization or to engage the services of an outside consultant. If an outside scheduling consultant is utilized, Section 1.3 of this specification will apply.

**1.3 THE COMPLETE PROJECT SCHEDULE SUBMITTAL**

- A. Within 45 calendar days after receipt of Notice to Proceed, the Contractor shall submit for the Contracting Officer's review the proposed schedule. The submittal shall also include a computer-produced activity/event ID schedule showing project duration; phase completion dates; and other data, including event cost. Each activity/event on the computer-produced schedule shall contain as a minimum, but not limited to, activity/event ID, activity/event description, duration, budget amount, early start date, early finish date, late start date, late finish date and total float. Work activity/event relationships shall be restricted to finish-to-start or start-to-start without lead or lag constraints. Activity/event date constraints, not required by the contract, will not be accepted unless submitted to and approved by the Contracting Officer. The contractor shall make a

separate written detailed request to the Contracting Officer identifying these date constraints and secure the Contracting Officer's written approval before incorporating them into the schedule.

The Contracting Officer's separate approval of the Project Schedule shall not excuse the contractor of this requirement. Logic events (non-work) will be permitted where necessary to reflect proper logic among work events, but must have zero duration. The complete working schedule shall reflect the Contractor's approach to scheduling the complete project. **The final Project Schedule in its original form shall contain no contract changes or delays and shall reflect the entire contract duration as defined in the bid documents.**

- B. Within 30 calendar days after receipt of the complete project interim Project Schedule and the complete final Project Schedule, the Contracting Officer or his representative, will do one or both of the following:
  - 1. Notify the Contractor concerning his actions, opinions, and/or objections.
  - 2. A meeting with the Contractor at or near the job site for joint review, correction or adjustment of the proposed plan will be scheduled if required. Within 14 calendar days after the joint review, the Contractor shall revise and shall submit a revised Project Schedule, three copies of the revised computer-produced activity/event ID schedule and a revised electronic file as specified by the Contracting Officer. The revised submission will be reviewed by the Contracting Officer and, if found to be as previously agreed upon, will be approved.
- C. The approved baseline schedule and the computer-produced schedule(s) generated there from shall constitute the approved baseline schedule until subsequently revised in accordance with the requirements of this section.
- D. The Complete Project Schedule shall contain all significant work activities/events. The Contractor may provide submittals for review and stage approved equipment and materials, but the Contractor shall not be approved to start work until the project schedule has been approved.

#### **1.4 WORK ACTIVITY/EVENT COST DATA**

- A. The Contractor shall cost load all work activities/events except procurement activities. The cumulative amount of all cost loaded work activities/events (including alternates) shall equal the total contract price. Prorate overhead, profit and general conditions on all work activities/events for the entire project length. The contractor shall generate from this information cash flow curves indicating graphically the total percentage of work activity/event dollar value scheduled to be in place on early finish, late finish. These cash flow curves will be used by the Contracting Officer to assist him in determining approval or disapproval of the cost loading. Negative work activity/event cost data will not be acceptable, except on VA issued contract changes.
- B. The Contractor shall cost load work activities/events for guarantee period services, test, balance and adjust various systems in accordance with the provisions in Article, FAR 52.232 – 5

(PAYMENT UNDER FIXED-PRICE CONSTRUCTION CONTRACTS) and VAAR 852.236 – 83 (PAYMENT UNDER FIXED-PRICE CONSTRUCTION CONTRACTS).

- C. In accordance with FAR 52.236 – 1 (PERFORMANCE OF WORK BY THE CONTRACTOR) and VAAR 852.236 – 72 (PERFORMANCE OF WORK BY THE CONTRACTOR), the Contractor shall submit, simultaneously with the cost per work activity/event of the construction schedule required by this Section, a responsibility code for all activities/events of the project for which the Contractor's forces will perform the work.
- D. The Contractor shall cost load work activities/events for all BID ITEMS including ASBESTOS ABATEMENT. The sum of each BID ITEM work shall equal the value of the bid item in the Contractors' bid.

### **1.5 PROJECT SCHEDULE REQUIREMENTS**

- A. Show on the project schedule the sequence of work activities/events required for complete performance of all items of work. The Contractor Shall:
  - 1. Show activities/events as:
    - a. Contractor's time required for submittal of shop drawings, templates, fabrication, delivery and similar pre-construction work.
    - b. Contracting Officer's and Architect-Engineer's review and approval of shop drawings, equipment schedules, samples, template, or similar items.
    - c. Interruption of VA Facilities utilities, delivery of Government furnished equipment, and rough-in drawings, project phasing and any other specification requirements.
    - d. Test, balance and adjust various systems and pieces of equipment, maintenance and operation manuals, instructions and preventive maintenance tasks.
    - e. VA inspection and acceptance activity/event with a minimum duration of five work days at the end of each phase and immediately preceding any VA move activity/event required by the contract phasing for that phase.
  - 2. Show not only the activities/events for actual construction work for each trade category of the project, but also trade relationships to indicate the movement of trades from one area, floor, or building, to another area, floor, or building, for at least five trades who are performing major work under this contract.
  - 3. Break up the work into activities/events of a duration no longer than 20 work days each or one reporting period, except as to non-construction activities/events (i.e., procurement of materials, delivery of equipment, concrete and asphalt curing) and any other activities/events for which the COR may approve the showing of a longer duration. While the VA will attempt to quickly process submittal review, the duration for VA approval of any submittal will not be less than 20 work days.

4. Describe work activities/events clearly, so the work is readily identifiable for assessment of completion. Activities/events labeled "start," "continue," or "completion," are not specific and will not be allowed. Lead and lag time activities will not be acceptable.
  5. The schedule shall be generally numbered in such a way to reflect either discipline, phase or location of the work.
- B. The Contractor shall submit the following supporting data in addition to the project schedule:
1. The appropriate project calendar including working days and holidays.
  2. The planned number of shifts per day.
  3. The number of hours per shift.
- Failure of the Contractor to include this data shall delay the review of the submittal until the Contracting Officer is in receipt of the missing data.
- C. To the extent that the Project Schedule or any revised Project Schedule shows anything not jointly agreed upon, it shall not be deemed to have been approved by the COR. Failure to include any element of work required for the performance of this contract shall not excuse the Contractor from completing all work required within any applicable completion date of each phase regardless of the COR's approval of the Project Schedule.
- D. Compact Disk Requirements: Submit to the VA an electronic file(s) containing one file of the data required to produce a schedule, reflecting all the activities/events of the complete project schedule being submitted.

#### **1.6 PAYMENT TO THE CONTRACTOR:**

- A. Monthly, the contractor shall submit the AIA application and certificate for payment documents G702 & G703 reflecting updated schedule activities and cost data in accordance with the provisions of the following Article, PAYMENT AND PROGRESS REPORTING, as the basis upon which progress payments will be made pursuant to Article, FAR 52.232 – 5 (PAYMENT UNDER FIXED-PRICE CONSTRUCTION CONTRACTS) and VAAR 852.236 – 83 (PAYMENT UNDER FIXED-PRICE CONSTRUCTION CONTRACTS). The Contractor shall be entitled to a monthly progress payment upon approval of estimates as determined from the currently approved updated project schedule. Monthly payment requests shall include: a listing of all agreed upon project schedule changes and associated data; and an electronic file (s) of the resulting monthly updated schedule.
- B. Approval of the Contractor's monthly Application for Payment shall be contingent, among other factors, on the submittal of a satisfactory monthly update of the project schedule.

#### **1.7 PROGRESS REPORTING**

- A. Bi-weekly schedule update meetings will be held on dates mutually agreed to by the COR and the Contractor. Contractor and the person responsible for the Project Schedule shall attend all schedule update/construction meetings. The Contractor shall accurately update the Project

Schedule and all other data required and provide this information to the COR three work days in advance of the schedule update meeting. Job progress will be reviewed to verify:

1. Actual start and/or finish dates for updated/completed activities/events.
2. Remaining duration for each activity/event started, or scheduled to start, but not completed.
3. Logic, time and cost data for change orders, and supplemental agreements that are to be incorporated into the Project Schedule.
4. Changes in activity/event sequence and/or duration which have been made.
5. Completion percentage for all completed and partially completed activities/events.
6. Logic and duration revisions required by this section of the specifications.
7. Activity/event duration and percent complete shall be updated independently.

### **1.8 RESPONSIBILITY FOR COMPLETION**

- A. If it becomes apparent from the current revised monthly progress schedule that phasing or contract completion dates will not be met, the Contractor will develop a specific action plan to recover lost time and return the project back to the original schedule. The Contractor shall execute some or all of the following remedial actions:
  1. Increase construction manpower in such quantities and crafts as necessary to eliminate the backlog of work.
  2. Increase the number of working hours per shift, shifts per working day, working days per week, the amount of construction equipment, or any combination of the foregoing to eliminate the backlog of work.
  3. Reschedule the work in conformance with the specification requirements.
- B. Prior to proceeding with any of the above actions, the Contractor shall notify and obtain approval from the COR for the proposed schedule changes. If such actions are approved, the representative schedule revisions shall be incorporated by the Contractor into the Project Schedule before the next update, at no additional cost to the Government.

### **1.9 CHANGES TO THE SCHEDULE**

- A. Within 7 calendar days after VA acceptance and approval of any updated project schedule, the Contractor shall submit a revised electronic file (s) and a list of any activity/event changes including predecessors and successors for any of the following reasons:
  1. Delay in completion of any activity/event or group of activities/events, which may be involved with contract changes, strikes, unusual weather, and other delays will not relieve the Contractor from the requirements specified unless the conditions are shown on the CPM as the direct cause for delaying the project beyond the acceptable limits.
  2. Delays in submittals, or deliveries, or work stoppage are encountered which make rescheduling of the work necessary.
  3. The schedule does not represent the actual prosecution and progress of the project.

4. When there is, or has been, a substantial revision to the activity/event costs regardless of the cause for these revisions.
- B. COR's approval for the revised project schedule and all relevant data is contingent upon compliance with all other paragraphs of this section and any other previous agreements by the Contracting Officer or the VA representative.
- C. The cost of revisions to the project schedule resulting from contract changes will be included in the proposal for changes in work as specified in FAR 52.243 – 4 (Changes) and VAAR 852.236 – 88 (Changes – Supplemental), and will be based on the complexity of the revision or contract change, man hours expended in analyzing the change, and the total cost of the change.
- D. The cost of revisions to the Project Schedule not resulting from contract changes is the responsibility of the Contractor.

#### **1.10 ADJUSTMENT OF CONTRACT COMPLETION**

- A. The contract completion time will be adjusted only for causes specified in this contract. Request for an extension of the contract completion date by the Contractor shall be supported with a justification and supporting evidence as the COR may deem necessary for determination as to whether or not the Contractor is entitled to an extension of time under the provisions of the contract. Submission of proof based on revised activity/event logic, durations (in work days) and costs is obligatory to any approvals. The schedule must clearly display that the Contractor has used, in full, all the float time available for the work involved in this request. The Contracting Officer's determination as to the total number of days of contract extension will be based upon the current schedule for the time period in question and all other relevant information.
- B. Actual delays in activities/events which, according to the computer- produced calendar-dated schedule, do not affect the extended and predicted contract completion dates shown by the critical path in the network, will not be the basis for a change to the contract completion date. The Contracting Officer will within a reasonable time after receipt of such justification and supporting evidence, review the facts and advise the Contractor in writing of the Contracting Officer's decision.
- C. The Contractor shall submit each request for a change in the contract completion date to the Contracting Officer in accordance with the provisions specified under FAR 52.243 – 4 (Changes) and VAAR 852.236 – 88 (Changes – Supplemental). The Contractor shall include, as a part of each change order proposal, a sketch showing all CPM logic revisions, duration (in work days) changes, and cost changes, for work in question and its relationship to other activities on the approved network diagram.
- D. All delays due to non-work activities/events such as RFI's, WEATHER, STRIKES, and similar non-work activities/events shall be analyzed on a month by month basis.

--- E N D ---

**SECTION 01 33 23**  
**SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES**

- 1-1. Refer to Articles titled SPECIFICATIONS AND DRAWINGS FOR CONSTRUCTION (FAR 52.236-21) and, SPECIAL NOTES (VAAR 852.236-91).
- 1-2. For the purposes of this contract, samples, test reports, certificates, and manufacturers' literature and data shall also be subject to the previously referenced requirements. The following text refers to all items collectively as SUBMITTALS.
- 1-3. Submit for approval, all of the items specifically mentioned under the separate sections of the specification, with information sufficient to evidence full compliance with contract requirements. Materials, fabricated articles and the like to be installed in permanent work shall equal those of approved submittals. After an item has been approved, no change in brand or make will be permitted unless:
  - A. Satisfactory written evidence is presented to, and approved by Contracting Officer, that manufacturer cannot make scheduled delivery of approved item or;
  - B. Item delivered has been rejected and substitution of a suitable item is an urgent necessity or;
  - C. Other conditions become apparent which indicates approval of such substitute item to be in best interest of the Government.
- 1-4. Forward submittals in sufficient time to permit proper consideration and approval action by Government. Time submission to assure adequate lead time for procurement of contract - required items. Delays attributable to untimely and rejected submittals will not serve as a basis for extending contract time for completion.
- 1-5. Submittals will be reviewed for compliance with contract requirements by Architect-Engineer, and action thereon will be taken by COR on behalf of the Contracting Officer.
- 1-6. Upon receipt of submittals, Architect-Engineer will assign a file number thereto. Contractor, in any subsequent correspondence, shall refer to this file and identification number to expedite replies relative to previously approved or disapproved submittals.
- 1-7. The Government reserves the right to require additional submittals, whether or not particularly mentioned in this contract. If additional submittals beyond those required by the contract are furnished pursuant to request therefor by Contracting Officer, adjustment in contract price and time will be made in accordance with Articles titled CHANGES (FAR 52.243-4) and CHANGES - SUPPLEMENT (VAAR 852.236-88).
- 1-8. Schedules called for in specifications and shown on shop drawings shall be submitted for use and information of Department of Veterans Affairs and Architect-Engineer. However, the Contractor shall assume responsibility for coordinating and verifying schedules. The Contracting

Officer and Architect- Engineer assumes no responsibility for checking schedules or layout drawings for exact sizes, exact numbers and detailed positioning of items.

- 1-9. Submittals must be submitted by Contractor only and shipped prepaid. Contracting Officer assumes no responsibility for checking quantities or exact numbers included in such submittals.
- A. Submit samples in single units unless otherwise specified. Submit shop drawings, schedules, manufacturers' literature and data, and certificates ELECTRONICALLY VIA EMAIL (5MB OR LESS). If files are too large to email, Architect-Engineer will set up FTP site for contractor use.
  - B. Submittals will receive consideration only when covered by a transmittal letter signed by Contractor. Email shall be sent and shall contain the list of items, name of Medical Center, name of Contractor, contract number, applicable specification paragraph numbers, applicable drawing numbers (and other information required for exact identification of location for each item), manufacturer and brand, ASTM or Federal Specification Number (if any) and such additional information as may be required by specifications for particular item being furnished. In addition, catalogs shall be marked to indicate specific items submitted for approval.
    - 1. A copy of letter must be enclosed with items, and any items received without identification letter will be considered "unclaimed goods" and held for a limited time only.
    - 2. Each sample, certificate, manufacturers' literature and data shall be labeled to indicate the name and location of the Medical Center, name of Contractor, manufacturer, brand, contract number and ASTM or Federal Specification Number as applicable and location(s) on project.
    - 3. Required certificates shall be signed by an authorized representative of manufacturer or supplier of material, and by Contractor.
  - C. If submittal samples have been disapproved, resubmit new samples as soon as possible after notification of disapproval. Such new samples shall be marked "Resubmitted Sample" in addition to containing other previously specified information required on label and in transmittal letter.
  - D. Approved samples will be kept on file by the COR at the site until completion of contract, at which time such samples will be delivered to Contractor as Contractor's property. Where noted in technical sections of specifications, approved samples in good condition may be used in their proper locations in contract work. At completion of contract, samples that are not approved will be returned to Contractor only upon request and at Contractor's expense. Such request should be made prior to completion of the contract. Disapproved samples that are not requested for return by Contractor will be discarded after completion of contract.
  - E. Submittal drawings (shop, erection or setting drawings) and schedules, required for work of various trades, shall be checked before submission by technically qualified employees of Contractor for accuracy, completeness and compliance with contract requirements. These drawings and schedules shall be stamped and signed by Contractor certifying to such check.

1. Each drawing shall have marked thereon, proper descriptive title, including Medical Center location, project number, manufacturer's number, reference to contract drawing number, detail Section Number, and Specification Section Number.
  2. A space 120 mm by 125 mm (4-3/4 by 5 inches) shall be reserved on each drawing to accommodate approval or disapproval stamp.
  3. Submit drawings, ROLLED WITHIN A MAILING TUBE, fully protected for shipment.
  4. One reproducible print of approved or disapproved shop drawings will be forwarded to Contractor.
  5. When work is directly related and involves more than one trade, shop drawings shall be submitted to Architect-Engineer under one cover.
- 1-10. Samples, shop drawings, test reports, certificates and manufacturers' literature and data, shall be submitted for approval to

Heapy Engineering (Emailed to Matt Graham, [msgraham@heapy.com](mailto:msgraham@heapy.com) with copy to COR)

(Architect-Engineer)

1400 West Dorothy lane

(A/E P.O. Address)

Dayton, OH 45005

(City, State and Zip Code)

- 1-11. At the time of transmittal to the Architect-Engineer, the Contractor shall also send a copy of the complete submittal directly to the COR.

--- E N D ---

**SECTION 01 42 19  
REFERENCE STANDARDS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section specifies the availability and source of references and standards specified in the project manual under paragraphs APPLICABLE PUBLICATIONS and/or shown on the drawings.

**1.2 AVAILABILITY OF SPECIFICATIONS LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS FPMR PART 101-29 (FAR 52.211-1) (AUG 1998)**

- A. The GSA Index of Federal Specifications, Standards and Commercial Item Descriptions, FPMR Part 101-29 and copies of specifications, standards, and commercial item descriptions cited in the solicitation may be obtained for a fee by submitting a request to – GSA Federal Supply Service, Specifications Section, Suite 8100, 470 East L'Enfant Plaza, SW, Washington, DC 20407, Telephone (202) 619-8925, Facsimile (202) 619-8978.
- B. If the General Services Administration, Department of Agriculture, or Department of Veterans Affairs issued this solicitation, a single copy of specifications, standards, and commercial item descriptions cited in this solicitation may be obtained free of charge by submitting a request to the addressee in paragraph (a) of this provision. Additional copies will be issued for a fee.

**1.3 AVAILABILITY FOR EXAMINATION OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS (FAR 52.211-4) (JUN 1988)**

The specifications and standards cited in this solicitation can be examined at the following location:

DEPARTMENT OF VETERANS AFFAIRS  
Office of Construction & Facilities Management  
Facilities Quality Service (00CFM1A)  
425 Eye Street N.W, (sixth floor)  
Washington, DC 20001  
Telephone Numbers: (202) 632-5249 or (202) 632-5178  
Between 9:00 AM - 3:00 PM

**1.4 AVAILABILITY OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS (FAR 52.211-3) (JUN 1988)**

The specifications cited in this solicitation may be obtained from the associations or organizations listed below.

- AA Aluminum Association Inc.  
<http://www.aluminum.org>
- AABC Associated Air Balance Council  
<http://www.aabchq.com>

AAMA	American Architectural Manufacturer's Association <a href="http://www.aamanet.org">http://www.aamanet.org</a>
AAN	American Nursery and Landscape Association <a href="http://www.anla.org">http://www.anla.org</a>
AASHTO	American Association of State Highway and Transportation Officials <a href="http://www.aashto.org">http://www.aashto.org</a>
AATCC	American Association of Textile Chemists and Colorists <a href="http://www.aatcc.org">http://www.aatcc.org</a>
ACGIH	American Conference of Governmental Industrial Hygienists <a href="http://www.acgih.org">http://www.acgih.org</a>
ACI	American Concrete Institute <a href="http://www.aci-int.net">http://www.aci-int.net</a>
ACPA	American Concrete Pipe Association <a href="http://www.concrete-pipe.org">http://www.concrete-pipe.org</a>
ACPPA	American Concrete Pressure Pipe Association <a href="http://www.acppa.org">http://www.acppa.org</a>
ADC	Air Diffusion Council <a href="http://flexibleduct.org">http://flexibleduct.org</a>
AGA	American Gas Association <a href="http://www.aga.org">http://www.aga.org</a>
AGC	Associated General Contractors of America <a href="http://www.agc.org">http://www.agc.org</a>
AGMA	American Gear Manufacturers Association, Inc. <a href="http://www.agma.org">http://www.agma.org</a>
AHAM	Association of Home Appliance Manufacturers <a href="http://www.aham.org">http://www.aham.org</a>
AISC	American Institute of Steel Construction <a href="http://www.aisc.org">http://www.aisc.org</a>
AISI	American Iron and Steel Institute <a href="http://www.steel.org">http://www.steel.org</a>
AITC	American Institute of Timber Construction <a href="http://www.aitc-glulam.org">http://www.aitc-glulam.org</a>
AMCA	Air Movement and Control Association, Inc. <a href="http://www.amca.org">http://www.amca.org</a>
ANLA	American Nursery & Landscape Association <a href="http://www.anla.org">http://www.anla.org</a>

ANSI	American National Standards Institute, Inc. <a href="http://www.ansi.org">http://www.ansi.org</a>
APA	The Engineered Wood Association <a href="http://www.apawood.org">http://www.apawood.org</a>
ARI	Air-Conditioning and Refrigeration Institute <a href="http://www.ari.org">http://www.ari.org</a>
ASAE	American Society of Agricultural Engineers <a href="http://www.asae.org">http://www.asae.org</a>
ASCE	American Society of Civil Engineers <a href="http://www.asce.org">http://www.asce.org</a>
ASHRAE	American Society of Heating, Refrigerating, and Air-Conditioning Engineers <a href="http://www.ashrae.org">http://www.ashrae.org</a>
ASME	American Society of Mechanical Engineers <a href="http://www.asme.org">http://www.asme.org</a>
ASSE	American Society of Sanitary Engineering <a href="http://www.asse-plumbing.org">http://www.asse-plumbing.org</a>
ASTM	American Society for Testing and Materials <a href="http://www.astm.org">http://www.astm.org</a>
AWI	Architectural Woodwork Institute <a href="http://www.awinet.org">http://www.awinet.org</a>
AWS	American Welding Society <a href="http://www.aws.org">http://www.aws.org</a>
AWWA	American Water Works Association <a href="http://www.awwa.org">http://www.awwa.org</a>
BHMA	Builders Hardware Manufacturers Association <a href="http://www.buildershardware.com">http://www.buildershardware.com</a>
BIA	Brick Institute of America <a href="http://www.bia.org">http://www.bia.org</a>
CAGI	Compressed Air and Gas Institute <a href="http://www.cagi.org">http://www.cagi.org</a>
CGA	Compressed Gas Association, Inc. <a href="http://www.cganet.com">http://www.cganet.com</a>
CI	The Chlorine Institute, Inc. <a href="http://www.chlorineinstitute.org">http://www.chlorineinstitute.org</a>
CISCA	Ceilings and Interior Systems Construction Association <a href="http://www.cisca.org">http://www.cisca.org</a>

CISPI	Cast Iron Soil Pipe Institute <a href="http://www.cispi.org">http://www.cispi.org</a>
CLFMI	Chain Link Fence Manufacturers Institute <a href="http://www.chainlinkinfo.org">http://www.chainlinkinfo.org</a>
CPMB	Concrete Plant Manufacturers Bureau <a href="http://www.cpmb.org">http://www.cpmb.org</a>
CRA	California Redwood Association <a href="http://www.calredwood.org">http://www.calredwood.org</a>
CRSI	Concrete Reinforcing Steel Institute <a href="http://www.crsi.org">http://www.crsi.org</a>
CTI	Cooling Technology Institute <a href="http://www.cti.org">http://www.cti.org</a>
DHI	Door and Hardware Institute <a href="http://www.dhi.org">http://www.dhi.org</a>
EGSA	Electrical Generating Systems Association <a href="http://www.egsa.org">http://www.egsa.org</a>
EEI	Edison Electric Institute <a href="http://www.eei.org">http://www.eei.org</a>
EPA	Environmental Protection Agency <a href="http://www.epa.gov">http://www.epa.gov</a>
ETL	ETL Testing Laboratories, Inc. <a href="http://www.et1.com">http://www.et1.com</a>
FAA	Federal Aviation Administration <a href="http://www.faa.gov">http://www.faa.gov</a>
FCC	Federal Communications Commission <a href="http://www.fcc.gov">http://www.fcc.gov</a>
FPS	The Forest Products Society <a href="http://www.forestprod.org">http://www.forestprod.org</a>
GANNA	Glass Association of North America <a href="http://www.cssinfo.com/info/ganna.html/">http://www.cssinfo.com/info/ganna.html/</a>
FM	Factory Mutual Insurance <a href="http://www.fmglobal.com">http://www.fmglobal.com</a>
GA	Gypsum Association <a href="http://www.gypsum.org">http://www.gypsum.org</a>
GSA	General Services Administration <a href="http://www.gsa.gov">http://www.gsa.gov</a>

HI	Hydraulic Institute <a href="http://www.pumps.org">http://www.pumps.org</a>
HPVA	Hardwood Plywood & Veneer Association <a href="http://www.hpva.org">http://www.hpva.org</a>
ICBO	International Conference of Building Officials <a href="http://www.icbo.org">http://www.icbo.org</a>
ICEA	Insulated Cable Engineers Association Inc. <a href="http://www.icea.net">http://www.icea.net</a>
ICAC	Institute of Clean Air Companies <a href="http://www.icac.com">http://www.icac.com</a>
IEEE	Institute of Electrical and Electronics Engineers <a href="http://www.ieee.org">http://www.ieee.org</a>
IMSA	International Municipal Signal Association <a href="http://www.imsasafety.org">http://www.imsasafety.org</a>
IPCEA	Insulated Power Cable Engineers Association
NBMA	Metal Buildings Manufacturers Association <a href="http://www.mbma.com">http://www.mbma.com</a>
MSS	Manufacturers Standardization Society of the Valve and Fittings Industry Inc. <a href="http://www.mss-hq.com">http://www.mss-hq.com</a>
NAAMM	National Association of Architectural Metal Manufacturers <a href="http://www.naamm.org">http://www.naamm.org</a>
NAPHCC	Plumbing-Heating-Cooling Contractors Association <a href="http://www.phccweb.org.org">http://www.phccweb.org.org</a>
NBS	National Bureau of Standards See - NIST
NBBPVI	National Board of Boiler and Pressure Vessel Inspectors <a href="http://www.nationboard.org">http://www.nationboard.org</a>
NEC	National Electric Code See - NFPA National Fire Protection Association
NEMA	National Electrical Manufacturers Association <a href="http://www.nema.org">http://www.nema.org</a>
NFPA	National Fire Protection Association <a href="http://www.nfpa.org">http://www.nfpa.org</a>
NHLA	National Hardwood Lumber Association <a href="http://www.natlhardwood.org">http://www.natlhardwood.org</a>
NIH	National Institute of Health <a href="http://www.nih.gov">http://www.nih.gov</a>

NIST	National Institute of Standards and Technology <a href="http://www.nist.gov">http://www.nist.gov</a>
NLMA	Northeastern Lumber Manufacturers Association, Inc. <a href="http://www.nelma.org">http://www.nelma.org</a>
NPA	National Particleboard Association 18928 Premiere Court Gaithersburg, MD 20879 (301) 670-0604
NSF	National Sanitation Foundation <a href="http://www.nsf.org">http://www.nsf.org</a>
NWWDA	Window and Door Manufacturers Association <a href="http://www.nwwda.org">http://www.nwwda.org</a>
OSHA	Occupational Safety and Health Administration Department of Labor <a href="http://www.osha.gov">http://www.osha.gov</a>
PCA	Portland Cement Association <a href="http://www.portcement.org">http://www.portcement.org</a>
PCI	Precast Prestressed Concrete Institute <a href="http://www.pci.org">http://www.pci.org</a>
PPI	The Plastic Pipe Institute <a href="http://www.plasticpipe.org">http://www.plasticpipe.org</a>
PEI	Porcelain Enamel Institute, Inc. <a href="http://www.porcelainenamel.com">http://www.porcelainenamel.com</a>
PTI	Post-Tensioning Institute <a href="http://www.post-tensioning.org">http://www.post-tensioning.org</a>
RFCI	The Resilient Floor Covering Institute <a href="http://www.rfci.com">http://www.rfci.com</a>
RIS	Redwood Inspection Service See - CRA
RMA	Rubber Manufacturers Association, Inc. <a href="http://www.rma.org">http://www.rma.org</a>
SCMA	Southern Cypress Manufacturers Association <a href="http://www.cypressinfo.org">http://www.cypressinfo.org</a>
SDI	Steel Door Institute <a href="http://www.steeldoor.org">http://www.steeldoor.org</a>
IGMA	Insulating Glass Manufacturers Alliance <a href="http://www.igmaonline.org">http://www.igmaonline.org</a>

- SJI Steel Joist Institute  
<http://www.steeljoist.org>
- SMACNA Sheet Metal and Air-Conditioning Contractors  
National Association, Inc.  
<http://www.smacna.org>
- SSPC The Society for Protective Coatings  
<http://www.sspc.org>
- STI Steel Tank Institute  
<http://www.steeltank.com>
- SWI Steel Window Institute  
<http://www.steelwindows.com>
- TCA Tile Council of America, Inc.  
<http://www.tileusa.com>
- TEMA Tubular Exchange Manufacturers Association  
<http://www.tema.org>
- TPI Truss Plate Institute, Inc.  
583 D'Onofrio Drive; Suite 200  
Madison, WI 53719  
(608) 833-5900
- UBC The Uniform Building Code  
See ICBO
- UL Underwriters' Laboratories Incorporated  
<http://www.ul.com>
- ULC Underwriters' Laboratories of Canada  
<http://www.ulc.ca>
- WCLIB West Coast Lumber Inspection Bureau  
6980 SW Varns Road, P.O. Box 23145  
Portland, OR 97223  
(503) 639-0651
- WRCLA Western Red Cedar Lumber Association  
P.O. Box 120786  
New Brighton, MN 55112  
(612) 633-4334
- WWPA Western Wood Products Association  
<http://www.wwpa.org>

--- E N D ---

**SECTION 01 74 19**  
**CONSTRUCTION WASTE MANAGEMENT**

**PART 1 – GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the requirements for the management of non-hazardous building construction and demolition waste.
- B. Waste disposal in landfills shall be minimized to the greatest extent possible. Of the inevitable waste that is generated, as much of the waste material as economically feasible shall be salvaged, recycled or reused.
- C. Contractor shall use all reasonable means to divert construction and demolition waste from landfills and incinerators, and facilitate their salvage and recycle not limited to the following:
  - 1. Waste Management Plan development and implementation.
  - 2. Techniques to minimize waste generation.
  - 3. Sorting and separating of waste materials.
  - 4. Salvage of existing materials and items for reuse or resale.
  - 5. Recycling of materials that cannot be reused or sold.
- D. At a minimum the following waste categories shall be diverted from landfills:
  - 1. Soil.
  - 2. Inerts (eg, concrete, masonry and asphalt).
  - 3. Clean dimensional wood and palette wood.
  - 4. Green waste (biodegradable landscaping materials).
  - 5. Engineered wood products (plywood, particle board and I-joists, etc).
  - 6. Metal products (eg, steel, wire, beverage containers, copper, etc).
  - 7. Cardboard, paper and packaging.
  - 8. Bitumen roofing materials.
  - 9. Plastics (eg, ABS, PVC).
  - 10. Carpet and/or pad.
  - 11. Gypsum board.
  - 12. Insulation.
  - 13. Paint.
  - 14. Fluorescent lamps.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.

**1.3 QUALITY ASSURANCE**

- A. Contractor shall practice efficient waste management when sizing, cutting and installing building products. Processes shall be employed to ensure the generation of as little waste as possible. Construction /Demolition waste includes products of the following:

1. Excess or unusable construction materials.
  2. Packaging used for construction products.
  3. Poor planning and/or layout.
  4. Construction error.
  5. Over ordering.
  6. Weather damage.
  7. Contamination.
  8. Mishandling.
  9. Breakage.
- B. Establish and maintain the management of non-hazardous building construction and demolition waste set forth herein. Conduct a site assessment to estimate the types of materials that will be generated by demolition and construction.
- C. Contractor shall develop and implement procedures to recycle construction and demolition waste to a minimum of 50 percent.
- D. Contractor shall be responsible for implementation of any special programs involving rebates or similar incentives related to recycling. Any revenues or savings obtained from salvage or recycling shall accrue to the contractor.
- E. Contractor shall provide all demolition, removal and legal disposal of materials. Contractor shall ensure that facilities used for recycling, reuse and disposal shall be permitted for the intended use to the extent required by local, state, federal regulations. The Whole Building Design Guide website <http://www.wbdg.org/tools/cwm.php> provides a Construction Waste Management Database that contains information on companies that haul, collect, and process recyclable debris from construction projects.
- F. Contractor shall assign a specific area to facilitate separation of materials for reuse, salvage, recycling, and return. Such areas are to be kept neat and clean and clearly marked in order to avoid contamination or mixing of materials.
- G. Contractor shall provide on-site instructions and supervision of separation, handling, salvaging, recycling, reuse and return methods to be used by all parties during waste generating stages.
- H. Record on daily reports any problems in complying with laws, regulations and ordinances with corrective action taken.

#### **1.4 TERMINOLOGY**

- A. Class III Landfill: A landfill that accepts non-hazardous resources such as household, commercial and industrial waste resulting from construction, remodeling, repair and demolition operations.
- B. Clean: Untreated and unpainted; uncontaminated with adhesives, oils, solvents, mastics and like products.
- C. Construction and Demolition Waste: Includes all non-hazardous resources resulting from construction, remodeling, alterations, repair and demolition operations.

- D. Dismantle: The process of parting out a building in such a way as to preserve the usefulness of its materials and components.
- E. Disposal: Acceptance of solid wastes at a legally operating facility for the purpose of land filling (includes Class III landfills and inert fills).
- F. Inert Backfill Site: A location, other than inert fill or other disposal facility, to which inert materials are taken for the purpose of filling an excavation, shoring or other soil engineering operation.
- G. Inert Fill: A facility that can legally accept inert waste, such as asphalt and concrete exclusively for the purpose of disposal.
- H. Inert Solids/Inert Waste: Non-liquid solid resources including, but not limited to, soil and concrete that does not contain hazardous waste or soluble pollutants at concentrations in excess of water-quality objectives established by a regional water board, and does not contain significant quantities of decomposable solid resources.
- I. Mixed Debris: Loads that include commingled recyclable and non-recyclable materials generated at the construction site.
- J. Mixed Debris Recycling Facility: A solid resource processing facility that accepts loads of mixed construction and demolition debris for the purpose of recovering re-usable and recyclable materials and disposing non-recyclable materials.
- K. Permitted Waste Hauler: A company that holds a valid permit to collect and transport solid wastes from individuals or businesses for the purpose of recycling or disposal.
- L. Recycling: The process of sorting, cleansing, treating, and reconstituting materials for the purpose of using the altered form in the manufacture of a new product. Recycling does not include burning, incinerating or thermally destroying solid waste.
  - 1. On-site Recycling – Materials that are sorted and processed on site for use in an altered state in the work, i.e. concrete crushed for use as a sub-base in paving.
  - 2. Off-site Recycling – Materials hauled to a location and used in an altered form in the manufacture of new products.
- M. Recycling Facility: An operation that can legally accept materials for the purpose of processing the materials into an altered form for the manufacture of new products. Depending on the types of materials accepted and operating procedures, a recycling facility may or may not be required to have a solid waste facilities permit or be regulated by the local enforcement agency.
- N. Reuse: Materials that are recovered for use in the same form, on-site or off-site.
- O. Return: To give back reusable items or unused products to vendors for credit.
- P. Salvage: To remove waste materials from the site for resale or re-use by a third party.
- Q. Source-Separated Materials: Materials that are sorted by type at the site for the purpose of reuse and recycling.
- R. Solid Waste: Materials that have been designated as non-recyclable and are discarded for the purposes of disposal.

- S. Transfer Station: A facility that can legally accept solid waste for the purpose of temporarily storing the materials for re-loading onto other trucks and transporting them to a landfill for disposal, or recovering some materials for re-use or recycling.

### **1.5 SUBMITTALS**

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES, furnish the following:
- B. Prepare and submit to the COR a written demolition debris management plan. The plan shall include, but not be limited to, the following information:
  - 1. Procedures to be used for debris management.
  - 2. Techniques to be used to minimize waste generation.
  - 3. Analysis of the estimated job site waste to be generated:
    - a. List of each material and quantity to be salvaged, reused, recycled.
    - b. List of each material and quantity proposed to be taken to a landfill.
  - 4. Detailed description of the Means/Methods to be used for material handling.
    - a. On site: Material separation, storage, protection where applicable.
    - b. Off site: Transportation means and destination. Include list of materials.
      - 1) Description of materials to be site-separated and self-hauled to designated facilities.
      - 2) Description of mixed materials to be collected by designated waste haulers and removed from the site.
    - c. The names and locations of mixed debris reuse and recycling facilities or sites.
    - d. The names and locations of trash disposal landfill facilities or sites.
    - e. Documentation that the facilities or sites are approved to receive the materials.
- C. Designated Manager responsible for instructing personnel, supervising, documenting and administer over meetings relevant to the Waste Management Plan.
- D. Monthly summary of construction and demolition debris diversion and disposal, quantifying all materials generated at the work site and disposed of or diverted from disposal through recycling.

### **1.6 APPLICABLE PUBLICATIONS**

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced by the basic designation only. In the event that criteria requirements conflict, the most stringent requirements shall be met.

### **1.7 RECORDS**

Maintain records to document the quantity of waste generated; the quantity of waste diverted through sale, reuse, or recycling; and the quantity of waste disposed by landfill or incineration.

## **PART 2 - PRODUCTS**

### **2.1 MATERIALS**

- A. List of each material and quantity to be salvaged, recycled, reused.
- B. List of each material and quantity proposed to be taken to a landfill.

- C. Material tracking data: Receiving parties, dates removed, transportation costs, weight tickets, tipping fees, manifests, invoices, net total costs or savings.

### **PART 3 - EXECUTION**

#### **3.1 COLLECTION**

- A. Provide all necessary containers, bins and storage areas to facilitate effective waste management.
- B. Clearly identify containers, bins and storage areas so that recyclable materials are separated from trash and can be transported to respective recycling facility for processing.
- C. Hazardous wastes shall be separated, stored, disposed of according to local, state, federal regulations.

#### **3.2 DISPOSAL**

- A. Contractor shall be responsible for transporting and disposing of materials that cannot be delivered to a source-separated or mixed materials recycling facility to a transfer station or disposal facility that can accept the materials in accordance with state and federal regulations.
- B. Construction or demolition materials with no practical reuse or that cannot be salvaged or recycled shall be disposed of at a landfill or incinerator.

#### **3.3 REPORT**

- A. With each application for progress payment, submit a summary of construction and demolition debris diversion and disposal including beginning and ending dates of period covered.
- B. Quantify all materials diverted from landfill disposal through salvage or recycling during the period with the receiving parties, dates removed, transportation costs, weight tickets, manifests, invoices. Include the net total costs or savings for each salvaged or recycled material.
- C. Quantify all materials disposed of during the period with the receiving parties, dates removed, transportation costs, weight tickets, tipping fees, manifests, invoices. Include the net total costs for each disposal.

--- E N D ---

**SECTION 02 82 13.19**  
**ASBESTOS FLOOR TILE AND MASTIC ABATEMENT**

**TABLE OF CONTENTS**

PART 1 - GENERAL .....	1
1.1 SUMMARY OF THE WORK .....	1
1.1.1 CONTRACT DOCUMENTS AND RELATED REQUIREMENTS .....	1
1.1.2 EXTENT OF WORK .....	1
1.1.3 RELATED WORK .....	1
1.1.4 TASKS .....	1
1.1.5 ABATEMENT CONTRACTOR USE OF PREMISES .....	2
1.2 VARIATIONS IN QUANTITY .....	2
1.3 STOP ASBESTOS REMOVAL .....	2
1.4 DEFINITIONS .....	3
1.4.1 GENERAL .....	3
1.4.2 GLOSSARY .....	3
1.4.3 REFERENCED STANDARDS ORGANIZATIONS .....	8
1.5 APPLICABLE CODES AND REGULATIONS .....	9
1.5.1 GENERAL APPLICABILITY OF CODES, REGULATIONS, AND STANDARDS .....	9
1.5.2 CONTRACTOR RESPONSIBILITY .....	9
1.5.3 FEDERAL REQUIREMENTS .....	9
1.5.4 STATE REQUIREMENTS .....	10
1.5.5 LOCAL REQUIREMENTS .....	10
1.5.6 STANDARDS .....	10
1.5.7 EPA GUIDANCE DOCUMENTS .....	10
1.5.8 NOTICES .....	10
1.5.9 PERMITS/LICENSES .....	11
1.5.10 POSTING AND FILING OF REGULATIONS .....	11
1.5.11 VA RESPONSIBILITIES .....	11
1.5.12 SITE SECURITY .....	11
1.5.13 EMERGENCY ACTION PLAN AND ARRANGEMENTS .....	11
1.5.14 PRE-construction MEETING .....	12
1.6 PROJECT COORDINATION .....	13
1.6.1 PERSONNEL .....	13
1.7 RESPIRATORY PROTECTION .....	14
1.7.1 GENERAL - RESPIRATORY PROTECTION PROGRAM .....	14

1.7.2 RESPIRATORY PROTECTION PROGRAM COORDINATOR .....	14
1.7.3 SELECTION AND USE OF RESPIRATORS .....	14
1.7.4 MINIMUM RESPIRATORY PROTECTION .....	14
1.7.5 MEDICAL WRITTEN OPINION .....	14
1.7.6 RESPIRATOR FIT TEST .....	14
1.7.7 RESPIRATOR FIT CHECK .....	14
1.7.8 MAINTENANCE AND CARE OF RESPIRATORS .....	14
1.8 WORKER PROTECTION .....	15
1.8.1 TRAINING OF ABATEMENT PERSONNEL .....	15
1.8.2 MEDICAL EXAMINATIONS .....	15
1.8.3 PERSONAL PROTECTIVE EQUIPMENT .....	15
1.8.4 REGULATED AREA ENTRY PROCEDURE .....	15
1.8.5 DECONTAMINATION PROCEDURE .....	15
1.8.6 REGULATED AREA REQUIREMENTS .....	15
PART 2 - PRODUCTS, MATERIALS AND EQUIPMENT .....	18
2.1 MATERIALS AND EQUIPMENT .....	18
2.1.1 GENERAL REQUIREMENTS (all abatement projects) .....	18
2.1.2 NEGATIVE PRESSURE FILTRATION SYSTEM .....	19
2.1.3 DESIGN AND LAYOUT .....	20
2.1.4 NEGATIVE AIR MACHINES (HEPA UNITS) .....	20
2.1.5 PRESSURE DIFFERENTIAL .....	21
2.2 CONTAINMENT BARRIERS AND COVERINGS IN THE REGULATED AREA .....	21
2.2.1 GENERAL .....	21
2.2.3 CONTROLLING ACCESS TO THE REGULATED AREA .....	21
2.2.4 CRITICAL BARRIERS .....	21
2.2.5 secondary barriers .....	21
2.2.6 EXTENSION OF THE REGULATED AREA .....	21
2.3 MONITORING, INSPECTION AND TESTING .....	22
2.3.1 GENERAL .....	22
2.3.2 SCOPE OF SERVICES OF THE VPIH/CIH CONSULTANT .....	23
2.3.3 MONITORING, INSPECTION AND TESTING BY CONTRACTOR CPIH/CIH .....	23
2.4 asbestos hazard abatement plan .....	24
2.5 SUBMITTALS .....	24
2.5.1 PRE-start MEETING SUBMITTALS .....	24
2.5.2 SUBMITTALS DURING ABATEMENT .....	26

2.5.3 SUBMITTALS AT COMPLETION OF ABATEMENT .....	26
PART 3 - EXECUTION .....	26
3.1 PRE-ABATEMENT ACTIVITIES .....	26
3.1.1 PRE-ABATEMENT MEETING .....	26
3.1.2 PRE-ABATEMENT INSPECTIONS AND PREPARATIONS .....	26
3.1.3 PRE-ABATEMENT CONSTRUCTION AND OPERATIONS .....	27
3.2 REGULATED AREA PREPARATIONS .....	27
3.2.1 OSHA DANGER SIGNS .....	27
3.2.2 CONTROLLING ACCESS TO THE REGULATED AREA .....	27
3.2.3 SHUT DOWN - LOCK OUT ELECTRICAL .....	28
3.2.4 SHUT DOWN - LOCK OUT HVAC .....	28
3.2.5 SANITARY FACILITIES .....	28
3.2.7 PREPARATION PRIOR TO SEALING OFF .....	28
3.2.8 Critical Barriers .....	28
3.2.10 PRE-CLEANING MOVABLE OBJECTS .....	28
3.2.11 PRE-CLEANING FIXED OBJECTS .....	29
3.2.12 PRE-CLEANING SURFACES IN THE REGULATED AREA .....	29
3.2.13 EXTENSION OF THE REGULATED AREA .....	29
3.3 REMOVAL OF CLASS II FLOORING MATERIALS .....	29
3.3.1 GENERAL .....	29
3.3.2 REMOVAL OF flooring materials .....	29
3.3.3 REMOVAL OF MASTIC .....	30
3.4 DISPOSAL OF CLASS ii WASTE MATERIAL .....	30
3.4.1 GENERAL .....	30
3.5 PROJECT DECONTAMINATION .....	30
3.5.1 GENERAL .....	30
3.5.2 REGULATED AREA CLEARANCE .....	30
3.5.3 WORK DESCRIPTION .....	31
3.5.4 PRE-DECONTAMINATION CONDITIONS .....	31
3.5.5 CLEANING .....	31
3.6 VISUAL INSPECTION AND AIR CLEARANCE TESTING .....	31
3.6.1 GENERAL .....	31
3.6.2 VISUAL INSPECTION .....	31
3.6.3 AIR CLEARANCE TESTING .....	31
3.6.4 final AIR CLEARANCE PROCEDURES .....	32

3.7 ABATEMENT CLOSEOUT AND CERTIFICATE OF COMPLIANCE .....	32
3.7.1 COMPLETION OF ABATEMENT WORK .....	32
3.7.2 CERTIFICATE OF COMPLETION BY CONTRACTOR .....	32
3.7.3 WORK SHIFTS .....	32
ATTACHMENT #1 .....	33
ATTACHMENT #2 .....	34
ATTACHMENT #3 .....	35
ATTACHMENT #4 .....	36

**SECTION 02 82 13.19**

**ASBESTOS FLOOR TILE AND MASTIC ABATEMENT SPECIFICATIONS**

**PART 1 - GENERAL**

**1.1 SUMMARY OF THE WORK**

**1.1.1 CONTRACT DOCUMENTS AND RELATED REQUIREMENTS**

Drawings, general provisions of the contract, including general and supplementary conditions and other Division 01 specifications, shall apply to the work of this section. The contract documents show the work to be done under the contract and related requirements and conditions impacting the project. Related requirements and conditions include applicable codes and regulations, notices and permits, existing site conditions and restrictions on use of the site, requirements for partial owner occupancy during the work, coordination with other work and the phasing of the work. In the event the Asbestos Abatement Contractor discovers a conflict in the contract documents and/or requirements or codes, the conflict must be brought to the immediate attention of the Contracting Officer for resolution. Whenever there is a conflict or overlap in the requirements, the most stringent shall apply. Any actions taken by the Contractor without obtaining guidance from the Contracting Officer shall become the sole risk and responsibility of the Asbestos Abatement Contractor. All costs incurred due to such action are also the responsibility of the Asbestos Abatement Contractor.

**1.1.2 EXTENT OF WORK**

- A. Below is a brief description of the estimated quantities of asbestos-containing flooring materials to be abated. These quantities are for informational purposes only and are based on the best information available at the time of the specification preparation. The Contractor shall satisfy himself as the actual quantities to be abated. Nothing in this section may be interpreted as limiting the extent of work otherwise required by this contract and related documents.
- B. Removal, clean-up and disposal of the following asbestos-containing flooring materials:
  - Approximately 50 total square feet of asbestos-containing black mastic (contains 3.8% chrysotile asbestos) and its associated non-asbestos-containing floor tile (12"x12" cream with tan streak) where a new electrical closet will be created on the second floor at corridor C2-14 and existing storage closet 2E-115. See Exhibit 1 attached at the end of this specification for approximate location.
  - The Contractor will be responsible for obtaining a professional industrial hygienist (PIH) to perform the role of the contractor professional industrial hygienist (CPIH) during abatement activities. The role of the CPIH is described in Section 2.3 of this specification. The CPIH will report to the Contractor.
  - The Contractor will also be responsible for obtaining a separate and independent PIH to perform the role of the VA professional industrial hygienist (VPIH) during asbestos abatement activities. The role of the VPIH is described in Section 2.3 of this specification. The VPIH will report to the VA COR.

**1.1.3 RELATED WORK**

- A. Section 07 84 00, FIRESTOPPING.

**1.1.4 TASKS**

The work tasks are summarized briefly as follows:

- A. Pre-abatement activities including pre-abatement meeting(s), inspection(s), notifications, permits, submittal approvals, regulated area preparations, emergency procedures arrangements, and Asbestos Hazard Abatement Plans for asbestos abatement work.
- B. Abatement activities including removal, clean-up, and disposal of ACM waste, recordkeeping, security, monitoring, and inspections.
- C. Cleaning and decontamination activities including final visual inspection, air monitoring and certification of decontamination.

### 1.1.5 ABATEMENT CONTRACTOR USE OF PREMISES

- A. The Contractor and Contractor's personnel shall cooperate fully with the VA representative/consultant to facilitate efficient use of buildings and areas within buildings. The Contractor shall perform the work in accordance with the VA specifications, drawings, phasing plan and in compliance with any/all applicable Federal, State and Local regulations and requirements.
- B. The Contractor shall use the existing facilities in the building strictly within the limits indicated in contract documents as well as the approved VA Design Construction Procedure. VA Design Construction Procedure drawings of partially occupied buildings will show the limits of regulated areas; the placement of decontamination facilities; the temporary location of bagged waste ACM; the path of transport to outside the building; and the temporary waste storage area for each building/regulated area. Any variation from the arrangements shown on drawings shall be secured in writing from the VA representative through the pre-abatement plan of action.

### 1.2 VARIATIONS IN QUANTITY

The quantities and locations of ACM as indicated on the drawings and the extent of work included in this section are estimated which are limited by the physical constraints imposed by occupancy of the buildings and accessibility to ACM. Accordingly, minor variations (+/- 25%) in quantities of ACM within the regulated area are considered as having no impact on contract price and time requirements of this contract. Where additional work is required beyond the above variation, the contractor shall provide unit prices for newly discovered ACM and those prices shall be used for additional work required under the contractor.

### 1.3 STOP ASBESTOS REMOVAL

If the Contracting Officer; their field representative; (the facility Safety Officer/Manager or their designee, or the VA Professional Industrial Hygienist/Certified Industrial Hygienist (VPIH/CIH) presents a verbal **Stop Asbestos Removal Order**, the Contractor/Personnel shall immediately stop all asbestos removal and maintain HEPA filtered negative pressure air flow in the containment and adequately wet any exposed ACM. If a verbal Stop Asbestos Removal Order is issued, the VA shall follow-up with a written order to the Contractor as soon as it is practicable. The Contractor shall not resume any asbestos removal activity until authorized to do so in writing by the VA Contracting Officer. A stop asbestos removal order may be issued at any time the VA Contracting Officer determines abatement conditions/activities are not within VA specification, regulatory requirements or that an imminent hazard exists to human health or the environment. Work stoppage will continue until conditions have been corrected to the satisfaction of the VA. Standby time and costs for corrective actions will be borne by the Contractor, including the VPIH/CIH time. The occurrence of any of the following events shall be reported immediately by the Contractor's competent person to the VA Contracting Office or field representative using the most expeditious means (e.g., verbal or telephonic), followed up with written notification to the Contracting Officer as soon as practical. The Contractor shall immediately stop asbestos removal/disturbance activities and initiate fiber reduction activities:

- A. Airborne PCM analysis results equal to or greater than 0.01 f/cc outside a regulated area or >0.05 f/cc inside a regulated area;
- B. breach or break in regulated area containment barrier(s);
- C. less than -0.02" WCG pressure in the regulated area;
- D. serious injury/death at the site;
- E. fire/safety emergency at the site;
- F. respiratory protection system failure;
- G. power failure or loss of wetting agent; or
- H. any visible emissions observed outside the regulated area.

## 1.4 DEFINITIONS

### 1.4.1 GENERAL

Definitions and explanations here are neither complete nor exclusive of all terms used in the contract documents, but are general for the work to the extent they are not stated more explicitly in another element of the contract documents. Drawings must be recognized as diagrammatic in nature and not completely descriptive of the requirements indicated therein.

### 1.4.2 GLOSSARY

**Abatement** - Procedures to control fiber release from asbestos-containing materials. Includes removal, encapsulation, enclosure, demolition, and renovation activities related to asbestos containing materials (ACM).

**Aerosol** - Solid or liquid particulate suspended in air.

**Adequately wet** - Sufficiently mixed or penetrated with liquid to prevent the release of particulates. If visible emissions are observed coming from the ACM, then that material has not been adequately wetted.

**Aggressive method** - Removal or disturbance of building material by sanding, abrading, grinding, or other method that breaks, crumbles, or disintegrates intact ACM.

**Aggressive sampling** - EPA AHERA defined clearance sampling method using air moving equipment such as fans and leaf blowers to aggressively disturb and maintain in the air residual fibers after abatement.

**AHERA** - Asbestos Hazard Emergency Response Act. Asbestos regulations for schools issued in 1987.

**Aircell** - Pipe or duct insulation made of corrugated cardboard which contains asbestos.

**Air monitoring** - The process of measuring the fiber content of a known volume of air collected over a specified period of time. The NIOSH 7400 Method, Issue 2 is used to determine the fiber levels in air. For personal samples and clearance air testing using Phase Contrast Microscopy (PCM) analysis. NIOSH Method 7402 can be used when it is necessary to confirm fibers counted by PCM as being asbestos. The AHERA TEM analysis may be used for background, area samples and clearance samples when required by this specification, or at the discretion of the VPIH/CIH as appropriate.

**Air sample filter** - The filter used to collect fibers which are then counted. The filter is made of mixed cellulose ester membrane for PCM (Phase Contrast Microscopy) and polycarbonate for TEM (Transmission Electron Microscopy)

**Amended water** - Water to which a surfactant (wetting agent) has been added to increase the penetrating ability of the liquid.

**Asbestos** - Includes chrysotile, amosite, crocidolite, tremolite asbestos, anthophyllite asbestos, actinolite asbestos, and any of these minerals that have been chemically treated or altered. Asbestos also includes PACM, as defined below.

**Asbestos Hazard Abatement Plan (AHAP)** - Asbestos work procedures required to be submitted by the contractor before work begins.

**Asbestos-containing material (ACM)** - Any material containing more than one percent of asbestos.

**Asbestos contaminated elements (ACE)** - Building elements such as ceilings, walls, lights, or ductwork that are contaminated with asbestos.

**Asbestos-contaminated soil (ACS)** - Soil found in the work area or in adjacent areas such as crawlspaces or pipe tunnels which is contaminated with asbestos-containing material debris and cannot be easily separated from the material.

**Asbestos-containing waste (ACW) material** - Asbestos-containing material or asbestos contaminated objects requiring disposal.

**Asbestos Project Monitor** - Some states require that any person conducting asbestos abatement clearance inspections and clearance air sampling be licensed as an asbestos project monitor.

**Asbestos waste decontamination facility** - A system consisting of drum/bag washing facilities and a temporary storage area for cleaned containers of asbestos waste. Used as the exit for waste and equipment leaving the regulated area. In an emergency, it may be used to evacuate personnel.

**Assigned Protection factor** - A value assigned by OSHA/NIOSH to indicate the expected protection provided by each respirator class, when the respirator is properly selected and worn correctly. The number indicates the reduction of exposure level from outside to inside the respirator facepiece.

**Authorized person** - Any person authorized by the VA, the Contractor, or government agency and required by work duties to be present in regulated areas.

**Authorized visitor** - Any person approved by the VA; the contractor; or any government agency representative having jurisdiction over the regulated area (e.g., OSHA, Federal and State EPA0..

**Barrier** - Any surface that isolates the regulated area and inhibits fiber migration from the regulated area.

**Containment Barrier** - An airtight barrier consisting of walls, floors, and/or ceilings of sealed plastic sheeting which surrounds and seals the outer perimeter of the regulated area.

**Critical Barrier** - The barrier responsible for isolating the regulated area from adjacent spaces, typically constructed of plastic sheeting secured in place at openings such as doors, windows, or any other opening into the regulated area.

**Primary Barrier** - Plastic barriers placed over critical barriers and exposed directly to abatement work.

**Secondary Barrier** - Any additional plastic barriers used to isolate and provide protection from debris during abatement work.

**Breathing zone** - The hemisphere forward of the shoulders with a radius of about 150 - 225 mm (6 - 9 inches) from the worker's nose.

**Bridging encapsulant** - An encapsulant that forms a layer on the surface of the ACM.

**Building/facility owner** - The legal entity, including a lessee, which exercises control over management and recordkeeping functions relating to a building and/or facility in which asbestos activities take place.

**Bulk testing** - The collection and analysis of suspect asbestos containing materials.

**Certified Industrial Hygienist (CIH)** - A person certified in the comprehensive practice of industrial hygiene by the American Board of Industrial Hygiene.

**Class I asbestos work** - Activities involving the removal of Thermal System Insulation (TSI) and surfacing ACM and Presumed Asbestos Containing Material (PACM).

**Class II asbestos work** - Activities involving the removal of ACM which is not thermal system insulation or surfacing material. This includes, but is not limited to, the removal of asbestos-containing wallboard, floor tile and sheeting, roofing and siding shingles, and construction mastic.

**Clean room/Changing room** - An uncontaminated room having facilities for the storage of employee's street clothing and uncontaminated materials and equipment.

**Clearance sample** - The final air sample taken after all asbestos work has been done and visually inspected. Performed by the VA's professional industrial hygiene consultant/Certified Industrial Hygienist (VPIH/CIH).

**Closely resemble** - The major workplace conditions which have contributed to the levels of historic asbestos exposure, are no more protective than conditions of the current workplace.

**Competent person** - In addition to the definition in 29 CFR 1926.32(f), one who is capable of identifying existing asbestos hazards in the workplace and selecting the appropriate control strategy for asbestos exposure, who has the authority to take prompt corrective measures to eliminate them, as specified in 29 CFR 1926.32(f); in addition, for Class I and II work who is specially trained in a training course which meets the criteria of EPA's Model Accreditation Plan (40 CFR 763) for supervisor.

**Contractor's Professional Industrial Hygienist (CPIH/CIH)** - The asbestos abatement contractor's industrial hygienist. The industrial hygienist must meet the qualification requirements of a PIH and may be a certified industrial hygienist (CIH).

**Count** - Refers to the fiber count or the average number of fibers greater than five microns in length with a length-to-width (aspect) ratio of at least 3 to 1, per cubic centimeter of air.

**Crawlspace** - An area which can be found either in or adjacent to the work area. This area has limited access and egress and may contain asbestos materials and/or asbestos contaminated soil.

**Decontamination area/unit** - An enclosed area adjacent to and connected to the regulated area and consisting of an equipment room, shower room, and clean room, which is used for the decontamination of workers, materials, and equipment that are contaminated with asbestos.

**Demolition** - The wrecking or taking out of any load-supporting structural member and any related razing, removing, or stripping of asbestos products.

**VA Total** – means a building or substantial part of the building is completely removed, torn or knocked down, bulldozed, flattened, or razed, including removal of building debris.

**Disposal bag** - Typically 6 mil thick sift-proof, dustproof, leak-tight container used to package and transport asbestos waste from regulated areas to the approved landfill. Each bag/container must be labeled/marked in accordance with EPA, OSHA and DOT requirements.

**Disturbance** - Activities that disrupt the matrix of ACM or PACM, crumble or pulverize ACM or PACM, or generate visible debris from ACM or PACM. Disturbance includes cutting away small amounts of ACM or PACM, no greater than the amount that can be contained in one standard sized glove bag or waste bag in order to access a building component. In no event shall the amount of ACM or PACM so disturbed exceed that which can be contained in one glove bag or disposal bag which shall not exceed 60 inches in length or width.

**Drum** - A rigid, impermeable container made of cardboard fiber, plastic, or metal which can be sealed in order to be sift-proof, dustproof, and leak-tight.

**Employee exposure** - The exposure to airborne asbestos that would occur if the employee were not wearing respiratory protection equipment.

**Encapsulant** - A material that surrounds or embeds asbestos fibers in an adhesive matrix and prevents the release of fibers.

**Encapsulation** - Treating ACM with an encapsulant.

**Enclosure** - The construction of an air tight, impermeable, permanent barrier around ACM to control the release of asbestos fibers from the material and also eliminate access to the material.

**Equipment room** - A contaminated room located within the decontamination area that is supplied with impermeable bags or containers for the disposal of contaminated protective clothing and equipment.

**Fiber** - A particulate form of asbestos, 5 microns or longer, with a length to width (aspect) ratio of at least 3 to 1.

**Fibers per cubic centimeter (f/cc)** - Abbreviation for fibers per cubic centimeter, used to describe the level of asbestos fibers in air.

**Filter** - Media used in respirators, vacuums, or other machines to remove particulate from air.

**Firestopping** - Material used to close the open parts of a structure in order to prevent a fire from spreading.

**Friable asbestos containing material** - Any material containing more than one (1) percent or asbestos as determined using the method specified in appendix A, Subpart F, 40 CFR 763, section 1, Polarized Light Microscopy, that, when dry, can be crumbled, pulverized, or reduced to powder by hand pressure.

**Glovebag** - Not more than a 60 x 60 inch impervious plastic bag-like enclosure affixed around an asbestos-containing material, with glove-like appendages through which materials and tools may be handled.

**High efficiency particulate air (HEPA) filter** – An ASHRAE MERV 17 filter capable of trapping and retaining at least 99.97 percent of all mono-dispersed particles of 0.3 micrometers in diameter.

**HEPA vacuum** - Vacuum collection equipment equipped with a HEPA filter system capable of collecting and retaining asbestos fibers.

**Homogeneous area** - An area of surfacing, thermal system insulation or miscellaneous ACM that is uniform in color, texture and date of application.

**HVAC** - Heating, Ventilation and Air Conditioning

**Industrial hygienist (IH)** - A professional qualified by education, training, and experience to anticipate, recognize, evaluate and develop controls for occupational health hazards. Meets definition requirements of the American Industrial Hygiene Association (AIHA).

**Industrial hygienist technician (IH Technician)** - A person working under the direction of an IH or CIH who has special training, experience, certifications and licenses required for the industrial hygiene work assigned. Some states require that an industrial hygienist technician conducting

asbestos abatement clearance inspection and clearance air sampling be licensed as an asbestos project monitor.

**Intact** - The ACM has not crumbled, been pulverized, or otherwise deteriorated so that the asbestos is no longer likely to be bound with its matrix.

**Lockdown** - Applying encapsulant, after a final visual inspection, on all abated surfaces at the conclusion of ACM removal prior to removal of critical barriers.

**National Emission Standards for Hazardous Air Pollutants (NESHAP)** - EPA's rule to control emissions of asbestos to the environment (40 CFR Part 61, Subpart M).

**Negative initial exposure assessment** - A demonstration by the employer which complies with the criteria in 29 CFR 1926.1101 (f)(2)(iii), that employee exposure during an operation is expected to be consistently below the PELs.

**Negative pressure** - Air pressure which is lower than the surrounding area, created by exhausting air from a sealed regulated area through HEPA equipped filtration units. OSHA requires maintaining -0.02" water column gauge inside the negative pressure enclosure.

**Negative pressure respirator** - A respirator in which the air pressure inside the facepiece is negative during inhalation relative to the air pressure outside the respirator facepiece.

**Non-friable ACM** - Material that contains more than 1 percent asbestos but cannot be crumbled, pulverized, or reduced to powder by hand pressure.

**Organic vapor cartridge** - The type of cartridge used on air purifying respirators to remove organic vapor hazardous air contaminants.

**Outside air** - The air outside buildings and structures, including, but not limited to, the air under a bridge or in an open ferry dock.

**Owner/operator** - Any person who owns, leases, operates, controls, or supervises the facility being demolished or renovated or any person who owns, leases, operates, controls, or supervises the demolition or renovation operation, or both.

**Penetrating encapsulant** - Encapsulant that is absorbed into the ACM matrix without leaving a surface layer.

**Personal protective equipment (PPE)** – equipment designed to protect user from injury and/or specific job hazard. Such equipment may include protective clothing, hard hats, safety glasses, and respirators.

**Personal sampling/monitoring** - Representative air samples obtained in the breathing zone for one or workers within the regulated area using a filter cassette and a calibrated air sampling pump to determine asbestos exposure.

**Permissible exposure limit (PEL)** - The level of exposure OSHA allows for an 8 hour time weighted average. For asbestos fibers, the eight (8) hour time weighted average PEL is 0.1 fibers per cubic centimeter (0.1 f/cc) of air and the 30-minute Excursion Limit is 1.0 fibers per cubic centimeter (1 f/cc).

**Pipe Tunnel** – An area, typically located adjacent to mechanical spaces or boiler rooms in which the pipes servicing the heating system in the building are routed to allow the pipes to access heating elements. These areas may contain asbestos pipe insulation, asbestos fittings, or asbestos-contaminated soil.

**Polarized light microscopy (PLM)** - Light microscopy using dispersion staining techniques and refractive indices to identify and quantify the type(s) of asbestos present in a bulk sample.

**Polyethylene sheeting** - Strong plastic barrier material 4 to 6 mils thick, semi-transparent, flame retardant per NFPA 241.

**Positive/negative fit check** - A method of verifying the seal of a facepiece respirator by temporarily occluding the filters and breathing in (inhaling) and then temporarily occluding the exhalation valve and breathing out (exhaling) while checking for inward or outward leakage of the respirator respectively.

**Presumed ACM (PACM)** - Thermal system insulation, surfacing, and flooring material installed in buildings prior to 1981. If the building owner has actual knowledge, or should have known through the exercise of due diligence that other materials are ACM, they too must be treated as PACM. The designation of PACM may be rebutted pursuant to 29 CFR 1926.1101 (b).

**Professional IH** - An IH who meets the definition requirements of AIHA; meets the definition requirements of OSHA as a "Competent Person" at 29 CFR 1926.1101 (b); has completed two specialized EPA approved courses on management and supervision of asbestos abatement

projects; has formal training in respiratory protection and waste disposal; and has a minimum of four projects of similar complexity with this project of which at least three projects serving as the supervisory IH. The PIH may be either the VA's PIH (VPIH) or Contractor's PIH (CPIH/CIH).

**Project designer** - A person who has successfully completed the training requirements for an asbestos abatement project designer as required by 40 CFR 763 Appendix C, Part I; (B)(5).

**Qualitative fit test (QLFT)** - A fit test using a challenge material that can be sensed by the wearer if leakage in the respirator occurs.

**Quantitative fit test (QNFT)** - A fit test using a challenge material which is quantified outside and inside the respirator thus allowing the determination of the actual fit factor.

**Regulated area** - An area established by the employer to demarcate where Class I, II, and III asbestos work is conducted, and any adjoining area where debris and waste from such asbestos work may accumulate; and a work area within which airborne concentrations of asbestos exceed, or there is a reasonable possibility they may exceed the PEL.

**Regulated ACM (RACM)** - Friable ACM; Category I non-friable ACM that has become friable; Category I non-friable ACM that will be or has been subjected to sanding, grinding, cutting, or abrading or; Category II non-friable ACM that has a high probability of becoming or has become crumbled, pulverized, or reduced to powder by the forces expected to act on the material in the course of the demolition or renovation operation.

**Removal** - All operations where ACM, PACM and/or RACM is taken out or stripped from structures or substrates, including demolition operations.

**Renovation** - Altering a facility or one or more facility components in any way, including the stripping or removal of asbestos from a facility component which does not involve demolition activity.

**Repair** - Overhauling, rebuilding, reconstructing, or reconditioning of structures or substrates, including encapsulation or other repair of ACM or PACM attached to structures or substrates.

**Shower room** - The portion of the PDF where personnel shower before leaving the regulated area.

**Supplied air respirator (SAR)** - A respiratory protection system that supplies minimum Grade D respirable air per ANSI/Compressed Gas Association Commodity Specification for Air, G-7.1-1989.

**Surfacing ACM** - A material containing more than 1 percent asbestos that is sprayed, troweled on or otherwise applied to surfaces for acoustical, fireproofing and other purposes.

**Surfactant** - A chemical added to water to decrease water's surface tension thus making it more penetrating into ACM.

**Thermal system ACM** - A material containing more than 1 percent asbestos applied to pipes, fittings, boilers, breeching, tanks, ducts, or other structural components to prevent heat loss or gain.

**Transmission electron microscopy (TEM)** - A microscopy method that can identify and count asbestos fibers.

**VA Professional Industrial Hygienist (VPIH/CIH)** - The Department of Veterans Affairs Professional Industrial Hygienist must meet the qualifications of a PIH, and may be a Certified Industrial Hygienist (CIH).

**VA Representative** - The VA official responsible for on-going project work.

**Visible emissions** - Any emissions, which are visually detectable without the aid of instruments, coming from ACM/PACM/RACM/ACS or ACM waste material.

**Waste/Equipment decontamination facility (W/EDF)** - The area in which equipment is decontaminated before removal from the regulated area.

**Waste generator** - Any owner or operator whose act or process produces asbestos-containing waste material.

**Waste shipment record** - The shipping document, required to be originated and signed by the waste generator, used to track and substantiate the disposition of asbestos-containing waste material.

**Wet cleaning** - The process of thoroughly eliminating, by wet methods, any asbestos contamination from surfaces or objects.

### 1.4.3 REFERENCED STANDARDS ORGANIZATIONS

The following acronyms or abbreviations as referenced in contract/ specification documents are defined to mean the associated names. Names and addresses may be subject to change.

- A. VA Department of Veterans Affairs  
810 Vermont Avenue, NW  
Washington, DC 20420
- B. AIHA American Industrial Hygiene Association  
2700 Prosperity Avenue, Suite 250  
Fairfax, VA 22031  
703-849-8888
- C. ANSI American National Standards Institute  
1430 Broadway  
New York, NY 10018  
212-354-3300
- D. ASTM American Society for Testing and Materials  
1916 Race St.  
Philadelphia, PA 19103  
215-299-5400
- E. CFR Code of Federal Regulations  
Government Printing Office  
Washington, DC 20420
- F. CGA Compressed Gas Association  
1235 Jefferson Davis Highway  
Arlington, VA 22202  
703-979-0900
- G. CS Commercial Standard of the National Institute of Standards and Technology (NIST)  
U. S. Department of Commerce  
Government Printing Office  
Washington, DC 20420
- H. EPA Environmental Protection Agency  
401 M St., SW  
Washington, DC 20460  
202-382-3949
- I. MIL-STD Military Standards/Standardization Division  
Office of the Assistant Secretary of Defense  
Washington, DC 20420
- I. NEC National Electrical Code (by NFPA)
- J. NEMA National Electrical Manufacturer's Association  
2101 L Street, NW  
Washington, DC 20037
- K. NFPA National Fire Protection Association  
1 Batterymarch Park

P.O. Box 9101  
Quincy, MA 02269-9101  
800-344-3555

- L. NIOSH National Institutes for Occupational Safety and Health  
4676 Columbia Parkway  
Cincinnati, OH 45226  
513-533-8236
- M. OSHA Occupational Safety and Health Administration  
U.S. Department of Labor  
Government Printing Office  
Washington, DC 20402
- N. UL Underwriters Laboratory  
333 Pfingsten Rd.  
Northbrook, IL 60062  
312-272-8800

## **1.5 APPLICABLE CODES AND REGULATIONS**

### **1.5.1 GENERAL APPLICABILITY OF CODES, REGULATIONS, AND STANDARDS**

- A. All work under this contract shall be done in strict accordance with all applicable Federal, State, and local regulations, standards and codes governing asbestos abatement, and any other trade work done in conjunction with the abatement. All applicable codes, regulations and standards are adopted into this specification and will have the same force and effect as this specification.
- B. The most recent edition of any relevant regulation, standard, document or code shall be in effect. Where conflict among the requirements or with these specifications exists, the most stringent requirement(s) shall be utilized.
- C. Copies of all standards, regulations, codes and other applicable documents, including this specification and those listed in Section 1.5 shall be available at the worksite in the clean change area of the worker decontamination system.

### **1.5.2 CONTRACTOR RESPONSIBILITY**

The Asbestos Abatement Contractor (Contractor) shall assume full responsibility and liability for compliance with all applicable Federal, State and Local regulations related to any and all aspects of the asbestos abatement project. The Contractor is responsible for providing and maintaining training, accreditations, medical exams, medical records, personal protective equipment (PPE) including respiratory protection including respirator fit testing, as required by applicable Federal, State and Local regulations. The Contractor shall hold the VA and VPIH/CIH consultants harmless for any Contractor's failure to comply with any applicable work, packaging, transporting, disposal, safety, health, or environmental requirement on the part of himself, his employees, or his subcontractors. The Contractor will incur all costs of the CPIH/CIH, including all sampling/analytical costs to assure compliance with OSHA/EPA/State requirements related to failure to comply with the regulations applicable to the work.

### **1.5.3 FEDERAL REQUIREMENTS**

Federal requirements which govern some aspect of asbestos abatement include, but are not limited to, the following regulations.

- A. Occupational Safety and Health Administration (**OSHA**)
  - 1. Title 29 CFR 1926.1101 - Construction Standard for Asbestos
  - 2. Title 29 CFR 1910.132 - Personal Protective Equipment
  - 3. Title 29 CFR 1910.134 - Respiratory Protection
  - 4. Title 29 CFR 1926 - Construction Industry Standards
  - 5. Title 29 CFR 1910.20 - Access to Employee Exposure and Medical Records

6. Title 29 CFR 1910.1200 - Hazard Communication
7. Title 29 CFR 1910.151 - Medical and First Aid
- B. Environmental Protection Agency (EPA)
  1. 40 CFR 61 Subpart A and M (Revised Subpart B) - National Emission Standard for Hazardous Air Pollutants - Asbestos.
  2. 40 CFR 763.80 - Asbestos Hazard Emergency Response Act (AHERA)
- C. Department of Transportation (DOT)  
Title 49 CFR 100 - 185 – Transportation

#### 1.5.4 STATE REQUIREMENTS

State requirements that apply to the asbestos abatement work, disposal, clearance, etc., include, but are not limited to, the following:

Ohio Environmental Protection Agency (EPA)

1. Ohio Administrative Code (OAC), Chapter 3745-20

Ohio Department of Health (ODH)

1. Ohio Administrative Code (OAC), Chapter 3701-34

#### 1.5.5 LOCAL REQUIREMENTS

If local requirements are more stringent than federal or state standards, the local standards are to be followed.

#### 1.5.6 STANDARDS

- A. Standards which govern asbestos abatement activities include, but are not limited to, the following:
  1. American National Standards Institute (ANSI) Z9.2-79 - Fundamentals Governing the Design and Operation of Local Exhaust Systems Z88.2 - Practices for Respiratory Protection.
  2. Underwriters Laboratories (UL) 586-90 - UL Standard for Safety of HEPA filter Units, 7th Edition.
- B. Standards which govern encapsulation work include, but are not limited to, the following:
  1. American Society for Testing and Materials (ASTM)
- C. Standards which govern the fire and safety concerns in abatement work include, but are not limited to, the following:
  1. National Fire Protection Association (NFPA) 241 - Standard for Safeguarding Construction, Alteration, and Demolition Operations.
  2. NFPA 701 - Standard Methods for Fire Tests for Flame Resistant Textiles and Film.
  3. NFPA 101 - Life Safety Code

#### 1.5.7 EPA GUIDANCE DOCUMENTS

- A. EPA guidance documents which discuss asbestos abatement work activities are listed below. These documents are made part of this section by reference. EPA publications can be ordered from (800) 424-9065.
- B. Guidance for Controlling ACM in Buildings (Purple Book) EPA 560/5-85-024
- C. Asbestos Waste Management Guidance EPA 530-SW-85-007
- D. A Guide to Respiratory Protection for the Asbestos Abatement Industry EPA-560-OPTS-86-001
- E. Guide to Managing Asbestos in Place (Green Book) TS 799 20T July 1990

#### 1.5.8 NOTICES

- A. State and Local agencies: Send written notification as required by state and local regulations including the local fire department prior to beginning any work on ACM as follows:
- B. Copies of notifications shall be submitted to the VA for the facility's records in the same time frame notification are given to EPA, State, and Local authorities.

### 1.5.9 PERMITS/LICENSES

- A. The contractor shall apply for and have all required permits and licenses to perform asbestos abatement work as required by Federal, State, and Local regulations.

### 1.5.10 POSTING AND FILING OF REGULATIONS

- A. Maintain two (2) copies of applicable federal, state, and local regulations. Post one copy of each at the regulated area where workers will have daily access to the regulations and keep another copy in the Contractor's office.

### 1.5.11 VA RESPONSIBILITIES

Prior to commencement of work:

- A. Notify occupants adjacent to regulated areas of project dates and requirements for relocation, if needed. Arrangements must be made prior to starting work for relocation of desks, files, equipment, and personal possessions to avoid unauthorized access into the regulated area. **Note: Notification of adjacent personnel is required by OSHA in 29 CFR 1926.1101 (k) to prevent unnecessary or unauthorized access to the regulated area.**
- B. Submit to the Contractor results of background air sampling; including location of samples, person who collected the samples, equipment utilized, calibration data and method of analysis. During abatement, submit to the Contractor, results of bulk material analysis and air sampling data collected during the course of the abatement. This information shall not release the Contractor from any responsibility for OSHA compliance.

### 1.5.12 SITE SECURITY

- A. Regulated area access is to be restricted only to authorized, trained/accredited and protected personnel. These may include the Contractor's employees, employees of Subcontractors, VA employees and representatives, State and local inspectors, and any other designated individuals. A list of authorized personnel shall be established prior to commencing the project and be posted in the clean room of the decontamination unit.
- B. Entry into the regulated area by unauthorized individuals shall be reported immediately to the Competent Person by anyone observing the entry. The Competent person shall immediately notify the VA.
- C. A log book shall be maintained in the clean room of the decontamination unit. Anyone who enters the regulated area must record their name, affiliation, time in, and time out for each entry.
- D. Access to the regulated area shall be through of a critical barrier doorway. All other access (doors, windows, hallways, etc.) shall be sealed or locked to prevent entry to or exit from the regulated area. The only exceptions for this requirement are the waste/equipment load-out area which shall be sealed except during the removal of containerized asbestos waste from the regulated area, and emergency exits. Emergency exits shall not be locked from the inside; however, they shall be sealed with poly sheeting and taped until needed.
- E. The Contractor's Competent Person shall control site security during abatement operations in order to isolate work in progress and protect adjacent personnel. A 24 hour security system shall be provided at the entrance to the regulated area to assure that all entrants are logged in/out and that only authorized personnel are allowed entrance.
- F. The Contractor will have the VA's assistance in notifying adjacent personnel of the presence, location and quantity of ACM in the regulated area and enforcement of restricted access by the VA's employees.
- G. The regulated area shall be locked during non-working hours.

### 1.5.13 EMERGENCY ACTION PLAN AND ARRANGEMENTS

- A. An Emergency Action Plan shall be developed prior to commencing abatement activities and shall be agreed to by the Contractor and the VA. The Plan shall meet the requirements of 29 CFR 1910.38 (a);(b).

- B. Emergency procedures shall be in written form and prominently posted in the clean room and equipment room of the decontamination unit. Everyone, prior to entering the regulated area, must read and sign these procedures to acknowledge understanding of the regulated area layout, location of emergency exits and emergency procedures.
- C. Emergency planning shall include written notification of police, fire, and emergency medical personnel of planned abatement activities; work schedule; layout of regulated area; and access to the regulated area, particularly barriers that may affect response capabilities.
- D. Emergency planning shall include consideration of fire, explosion, hazardous atmospheres, electrical hazards, slips/trips and falls, confined spaces, and heat stress illness. Written procedures for response to emergency situations shall be developed and employee training in procedures shall be provided.
- E. Employees shall be trained in regulated area/site evacuation procedures in the event of workplace emergencies.
  - 1. For non-life-threatening situations - employees injured or otherwise incapacitated shall decontaminate following normal procedures with assistance from fellow workers, if necessary, before exiting the regulated area to obtain proper medical treatment.
  - 2. For life-threatening injury or illness, worker decontamination shall take least priority after measures to stabilize the injured worker, remove them from the regulated area, and secure proper medical treatment.
- F. Telephone numbers of any/all emergency response personnel shall be prominently posted in the clean room, along with the location of the nearest telephone.
- G. The Contractor shall provide verification of first aid/CPR training for personnel responsible for providing first aid/CPR. OSHA requires medical assistance within 3-4 minutes of a life-threatening injury/illness. Bloodborne Pathogen training shall also be verified for those personnel required to provide first aid/CPR.
- H. The Emergency Action Plan shall provide for a Contingency Plan in the event that an incident occurs that may require the modification of the Asbestos Hazard Abatement Plans during abatement. Such incidents include, but are not limited to, fire; accident; power failure; negative pressure failure; and supplied air system failure. The Contractor shall detail procedures to be followed in the event of an incident assuring that asbestos abatement work is stopped and wetting is continued until correction of the problem.

#### **1.5.14 PRE-CONSTRUCTION MEETING**

Prior to commencing the work, the Contractor shall meet with the VA Professional Industrial Hygienist (VPIH) to present and review, as appropriate, the items following this paragraph. The Contractor's Competent Person(s) who will be on-site shall participate in the pre-start meeting. The pre-start meeting is to discuss and determine procedures to be used during the project. At this meeting, the Contractor shall provide:

- A. Proof of Contractor licensing.
- B. Proof the Competent Person(s) is trained and accredited and approved for working in this State. Verification of the experience of the Competent Person(s) shall also be presented.
- C. A list of all workers who will participate in the project, including experience and verification of training and accreditation.
- D. A list of and verification of training for all personnel who have current first-aid/CPR training. A minimum of one person per shift must have adequate training.
- E. Current medical written opinions for all personnel working on-site meeting the requirements of 29 CFR 1926.1101 (m).
- F. Current fit-tests for all personnel wearing respirators on-site meeting the requirements of 29 CFR 1926.1101 (h) and Appendix C.
- G. A copy of the Asbestos Hazard Abatement Plan. In these procedures, the following information must be detailed, specific for this project.
  - 1. Regulated area preparation procedures;
  - 2. Notification requirements procedure of Contractor as required in 29 CFR 1926.1101 (d);
  - 3. Decontamination area set-up/layout and decontamination procedures for employees;
  - 4. Abatement methods/procedures and equipment to be used;

- 5. Personal protective equipment to be used;
- H. At this meeting the Contractor shall provide all submittals as required.
- I. Procedures for handling, packaging and disposal of asbestos waste.
- J. Emergency Action Plan and Contingency Plan Procedures.

## 1.6 PROJECT COORDINATION

The following are the minimum administrative and supervisory personnel necessary for coordination of the work.

### 1.6.1 PERSONNEL

- A. Administrative and supervisory personnel shall consist of a qualified Competent Person(s) as defined by OSHA in the Construction Standards and the Asbestos Construction Standard; Contractor Professional Industrial Hygienist and Industrial Hygiene Technicians. These employees are the Contractor's representatives responsible for compliance with these specifications and all other applicable requirements.
- B. Non-supervisory personnel shall consist of an adequate number of qualified personnel to meet the schedule requirements of the project. Personnel shall meet required qualifications. Personnel utilized on-site shall be pre-approved by the VA representative. A request for approval shall be submitted for any person to be employed during the project giving the person's name; social security number; qualifications; accreditation card with color picture; Certificate of Worker's Acknowledgment; and Affidavit of Medical Surveillance and Respiratory Protection and current Respirator Fit Test.
- C. Minimum qualifications for Contractor and assigned personnel are:
  - 1. The Contractor has conducted within the last three (3) years, three (3) projects of similar complexity and dollar value as this project; has not been cited and penalized for serious violations of federal (and state as applicable) EPA and OSHA asbestos regulations in the past three (3) years; has adequate liability/occurrence insurance for asbestos work as required by the state; is licensed in applicable states; has adequate and qualified personnel available to complete the work; has comprehensive Asbestos Hazard Abatement Plans for asbestos work; and has adequate materials, equipment and supplies to perform the work.
  - 2. The Competent Person has three (3) years of abatement experience of which two (2) years were as the Competent Person on the project; meets the OSHA definition of a Competent Person; has been the Competent Person on two (2) projects of similar size and complexity as this project within the past three (3) years; has completed EPA AHERA/OSHA/State/Local training requirements/accreditation(s) and refreshers; and has all required OSHA documentation related to medical and respiratory protection.
  - 3. The Contractor Professional Industrial Hygienist/CIH (CPIH/CIH) and/or his/her technician shall have three (3) years of monitoring experience and supervision of asbestos abatement projects; has participated as senior IH on five (5) abatement projects, three (3) of which are similar in size and complexity as this project; has developed at least one complete Asbestos Hazard Abatement Plan or specification for asbestos abatement; has specialized EPA AHERA/OSHA training in asbestos abatement management, respiratory protection, waste disposal and asbestos inspection; has completed the NIOSH 582 Course or equivalent, Contractor/Supervisor course or Asbestos Abatement Designer course, Building/Inspector Management Planner course; and has appropriate medical/respiratory protection records/documentation.
  - 4. The Abatement Personnel shall have completed the EPA AHERA/OSHA abatement worker course; have training on the Asbestos Hazard Abatement Plans of the Contractor; has one year of asbestos abatement experience within the past three (3) years of similar size and complexity; has applicable medical and respiratory protection documentation; and has certificate of training/current refresher and State accreditation/license.

All personnel should be in compliance with OSHA construction safety training as applicable and submit certification.

## **1.7 RESPIRATORY PROTECTION**

### **1.7.1 GENERAL - RESPIRATORY PROTECTION PROGRAM**

The Contractor shall develop and implement a written Respiratory Protection Program (RPP) which is in compliance with the January 8, 1998 OSHA requirements found at 29 CFR 1926.1101 and 29 CFR 1910.Subpart I;134. ANSI Standard Z88.2-1992 provides excellent guidance for developing a respiratory protection program. All respirators used must be NIOSH approved for asbestos abatement activities. The written RPP shall, at a minimum, contain the basic requirements found at 29 CFR 1910.134 (c)(1)(i - ix) - Respiratory Protection Program.

### **1.7.2 RESPIRATORY PROTECTION PROGRAM COORDINATOR**

The Respiratory Protection Program Coordinator (RPPC) must be identified and shall have two (2) years of experience coordinating RPP of similar size and complexity. The RPPC must submit a signed statement attesting to the fact that the program meets the above requirements.

### **1.7.3 SELECTION AND USE OF RESPIRATORS**

The procedure for the selection and use of respirators must be submitted to the VA as part of the Contractor's qualifications. The procedure must be written clearly enough for workers to understand. A copy of the Respiratory Protection Program must be available in the clean room of the decontamination unit for reference by employees or authorized visitors.

### **1.7.4 MINIMUM RESPIRATORY PROTECTION**

Minimum respiratory protection shall be a half face, HEPA filtered, air purifying respirator when fiber levels are maintained consistently at or below 0.1 f/cc. A higher level of respiratory protection may be provided or required, depending on fiber levels. Respirator selection shall meet the requirements of 29 CFR 1926.1101 (h); Table 1, except as indicated in this paragraph. Abatement personnel must have a respirator for their exclusive use.

### **1.7.5 MEDICAL WRITTEN OPINION**

No employee shall be allowed to wear a respirator unless a physician or other licensed health care professional has provided a written determination they are medically qualified to wear the class of respirator to be used on the project while wearing whole body impermeable garments and subjected to heat or cold stress.

### **1.7.6 RESPIRATOR FIT TEST**

All personnel wearing respirators shall have a current qualitative/quantitative fit test which was conducted in accordance with 29 CFR 1910.134 (f) and Appendix A. Quantitative fit tests shall be done for PAPRs which have been put into a motor/blower failure mode.

### **1.7.7 RESPIRATOR FIT CHECK**

The Competent Person shall assure that the positive/negative pressure user seal check is done each time the respirator is donned by an employee. Head coverings must cover respirator head straps. Any situation that prevents an effective facepiece to face seal as evidenced by failure of a user seal check shall preclude that person from wearing a respirator inside the regulated area until resolution of the problem.

### **1.7.8 MAINTENANCE AND CARE OF RESPIRATORS**

The Respiratory Protection Program Coordinator shall submit evidence and documentation showing compliance with 29 CFR 1910.134 (h) Maintenance and Care of Respirators.

### **1.7.9 SUPPLIED AIR SYSTEMS**

If a supplied air system is used, the system shall meet all requirements of 29 CFR 1910.134 and the ANSI/Compressed Gas Association (CGA) Commodity Specification for Air current requirements for Type 1 - Grade D breathing air. Low pressure systems are not allowed to be used on asbestos abatement projects. Supplied Air respirator use shall be in accordance with EPA/NIOSH publication EPA-560-OPTS-86-001 "A Guide to Respiratory Protection for the Asbestos Abatement Industry". The competent person on site will be responsible for the supplied air system to ensure the safety of the worker.

### **1.8 WORKER PROTECTION**

#### **1.8.1 TRAINING OF ABATEMENT PERSONNEL**

Prior to beginning any abatement activity, all personnel shall be trained in accordance with OSHA 29 CFR 1926.1101 (k)(9) and any additional State/Local requirements. Training must include, at a minimum, the elements listed at 29 CFR 1926.1101 (k)(9)(viii). Training shall have been conducted by a third party, EPA/State approved trainer meeting the requirements of EPA 40 CFR 763 Appendix C (AHERA MAP). Initial training certificates and current refresher and accreditation proof must be submitted for each person working at the site.

#### **1.8.2 MEDICAL EXAMINATIONS**

Medical examinations meeting the requirements of 29 CFR 1926.1101 (m) shall be provided for all personnel working in the regulated area, regardless of exposure levels. A current physician's written opinion as required by 29 CFR 1926.1101 (m)(4) shall be provided for each person and shall include in the medical opinion the person has been evaluated for working in a heat and cold stress environment while wearing personal protective equipment (PPE) and is able to perform the work without risk of material health impairment.

#### **1.8.3 PERSONAL PROTECTIVE EQUIPMENT**

Provide whole body clothing, head coverings, foot coverings and any other personal protective equipment as determined by conducting the hazard assessment required by OSHA at 29 CFR 1910.132 (d). The Competent Person shall ensure the integrity of personal protective equipment worn for the duration of the project. Duct tape shall be used to secure all suit sleeves to wrists and to secure foot coverings at the ankle. Worker protection shall meet the most stringent requirements.

#### **1.8.4 REGULATED AREA ENTRY PROCEDURE**

The Competent Person shall ensure that each time workers enter the regulated area they remove ALL street clothes in the clean room of the decontamination unit and put on new disposable coveralls, head coverings, a clean respirator, and then proceed through the shower room to the equipment room where they put on non-disposable required personal protective equipment.

#### **1.8.5 DECONTAMINATION PROCEDURE**

The Competent Person shall require all personnel to adhere to following decontamination procedures whenever they leave the regulated area.

- A. When exiting the regulated area, remove all disposable PPE and dispose of in a disposal bag provided in the regulated area.
- B. Carefully decontaminate and clean the respirator. Put in a clean container/bag.

#### **1.8.6 REGULATED AREA REQUIREMENTS**

The Competent Person shall meet all requirements of 29 CFR 1926.1101 (o) and assure that all requirements for Class I regulated areas at 29 CFR 1926.1101 (e) are met applicable to Class II work. All personnel in the regulated area shall not be allowed to eat, drink, smoke, chew tobacco or gum, apply cosmetics, or in any way interfere with the fit of their respirator.

## **1.9 DECONTAMINATION FACILITIES**

### **1.9.1 DESCRIPTION**

Provide each regulated area with separate personnel decontamination facilities (PDF) and waste/equipment decontamination facilities (W/EDF). Ensure that the PDF are the only means of ingress and egress to the regulated area and that all equipment, bagged waste, and other material exit the regulated area only through the W/EDF.

### **1.9.2 GENERAL REQUIREMENTS**

All personnel entering or exiting a regulated area must go through the PDF and shall follow the requirements at 29 CFR 1926.1101 (j)(1) and these specifications. All waste, equipment and contaminated materials must exit the regulated area through the W/EDF and be decontaminated in accordance with these specifications. Walls and ceilings of the PDF and W/EDF must be constructed of a minimum of 3 layers of 6 mil opaque fire retardant polyethylene sheeting and be securely attached to existing building components and/or an adequate temporary framework. A minimum of 3 layers of 6 mil poly shall also be used to cover the floor under the PDF and W/EDF units. Construct doors so that they overlap and secure to adjacent surfaces. Weight inner doorway sheets with layers of duct tape so that they close quickly after release. Put arrows on sheets so they show direction of travel and overlap. If the building adjacent area is occupied, construct a solid barrier on the occupied side(s) to protect the sheeting and reduce potential for non-authorized personnel entering the regulated area.


### **1.9.3 TEMPORARY FACILITIES TO THE PDF AND W/EDF**

The Competent Person shall provide temporary water service connections to the PDF and W/EDF. Backflow prevention must be provided at the point of connection to the VA system. Water supply must be of adequate pressure and meet requirements of 29 CFR 1910.141 (d)(3). Provide adequate temporary overhead electric power with ground fault circuit interruption (GFCI) protection. Provide a sub-panel equipped with GFCI protection for all temporary power in the clean room. Provide adequate lighting to provide a minimum of 50 foot candles in the PDF and W/EDF. Provide temporary heat, if needed, to maintain 70°F throughout the PDF and W/EDF.

### **1.9.4 PERSONNEL DECONTAMINATION FACILITY (PDF)**

1. Clean Room: The clean room must be physically and visually separated from the rest of the building to protect the privacy of personnel changing clothes. The clean room shall be constructed of at least 3 layers of 6 mil opaque fire retardant poly to provide an air tight room. Provide a minimum of 2 - 900 mm (3 foot) wide 6 mil poly opaque fire retardant doorways. One doorway shall be the entry from outside the PDF and the second doorway shall be to the shower room of the PDF. The floor of the clean room shall be maintained in a clean, dry condition. Shower overflow shall not be allowed into the clean room. Provide 1 storage locker per person. A portable fire extinguisher, minimum 10 pounds capacity, Type ABC, shall be provided in accordance with OSHA and NFPA Standard 10. All persons entering the regulated area shall remove all street clothing in the clean room and dress in disposable protective clothing and respiratory protection. Any person entering the clean room does so either from the outside with street clothing on or is coming from the shower room completely naked and thoroughly washed. Females required to enter the regulated area shall be ensured of their privacy throughout the entry/exit process by posting guards at both entry points to the PDF so no male can enter or exit the PDF during her stay in the PDF.
2. Shower Room: The Competent Person shall assure that the shower room is a completely water tight compartment to be used for the movement of all personnel from the clean room to the equipment room and for the showering of all personnel going from the equipment room to the clean room. Each shower shall be constructed so water runs down the walls of the shower and into a drip pan. Install a freely draining smooth floor on top of the shower pan.

- The shower room shall be separated from the rest of the building and from the clean room and equipment room using air tight walls made from at least 3 layers of 6 mil opaque fire retardant poly. The shower shall be equipped with a shower head and controls, hot and cold water, drainage, soap dish and continuous supply of soap, and shall be maintained in a sanitary condition throughout its use. The controls shall be arranged so an individual can shower without assistance. Provide a flexible hose shower head, hose bibs and all other items shown on Shower Schematic. Waste water will be pumped to a drain after being filtered through a minimum of a 100 micron sock in the shower drain; a 20 micron filter; and a final 5 micron filter. Filters will be changed a minimum of daily or more often as needed. Filter changes must be done in the shower to prevent loss of contaminated water. Hose down all shower surfaces after each shift and clean any debris from the shower pan. Residue is to be disposed of as asbestos waste.
3. Equipment Room: The Competent Person shall provide an equipment room which shall be an air tight compartment for the storage of work equipment/tools, reusable personal protective equipment, except for a respirator and for use as a gross decontamination area for personnel exiting the regulated area. The equipment room shall be separated from the regulated area by a minimum 3 foot wide door made with 2 layers of 6 mil opaque fire retardant poly. The equipment room shall be separated from the regulated area, the shower room and the rest of the building by air tight walls and ceiling constructed of a minimum of 3 layers of 6 mil opaque fire retardant poly. Damp wipe all surfaces of the equipment room after each shift change. Provide an additional loose layer of 6 mil fire retardant poly per shift change and remove this layer after each shift. If needed, provide a temporary electrical sub-panel equipped with GFCI in the equipment room to accommodate any equipment required in the regulated area.
  4. The PDF shall be as follows: Clean room at the entrance followed by a shower room followed by an equipment room leading to the regulated area. Each doorway in the PDF shall be a minimum of 2 layers of 6 mil opaque fire retardant poly.

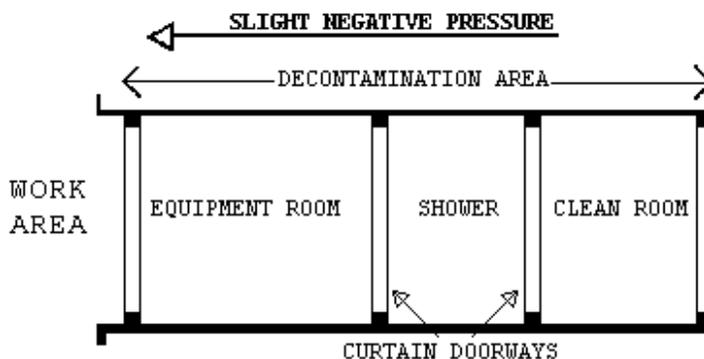


### 1.9.5 WASTE/EQUIPMENT DECONTAMINATION FACILITY (W/EDF)

The Competent Person shall provide an W/EDF consisting of a wash room, holding room, and clean room for removal of waste, equipment and contaminated material from the regulated area. Personnel shall not enter or exit the W/EDF except in the event of an emergency. Clean debris and residue in the W/EDF daily. All surfaces in the W/EDF shall be wiped/hosed down after each shift and all debris shall be cleaned from the shower pan. The W/EDF shall consist of the following:

1. Wash Down Station: Provide an enclosed shower unit in the regulated area just outside the Wash Room as an equipment bag and container cleaning station.
2. Wash Room: Provide a wash room for cleaning of bagged or containerized asbestos containing waste materials passed from the regulated area. Construct the wash room using 50 x 100 mm (2" x 4") wood framing and 3 layers of 6 mil fire retardant poly. Locate the wash room so that packaged materials, after being wiped clean, can be passed to the Holding

- Room. Doorways in the wash room shall be constructed of 2 layers of 6 mil fire retardant poly.
3. Holding Room: Provide a holding room as a drop location for bagged materials passed from the wash room. Construct the holding room using 50 x 100 mm (2" x 4") wood framing and 3 layers of 6 mil fire retardant poly. The holding room shall be located so that bagged material cannot be passed from the wash room to the clean room unless it goes through the holding room. Doorways in the holding room shall be constructed of 2 layers of 6 mil fire retardant poly.
  4. Clean Room: Provide a clean room to isolate the holding room from the exterior of the regulated area. Construct the clean room using 2 x 4 wood framing and 2 layers of 6 mil fire retardant poly. The clean room shall be located so as to provide access to the holding room from the building exterior. Doorways to the clean room shall be constructed of 2 layers of 6 mil fire retardant poly. When a negative pressure differential system is used, a rigid enclosure separation between the W/EDF clean room and the adjacent areas shall be provided.
  5. The W/EDF shall be as follows: Wash Room leading to a Holding Room followed by a Clean Room leading to outside the regulated area. See diagram.

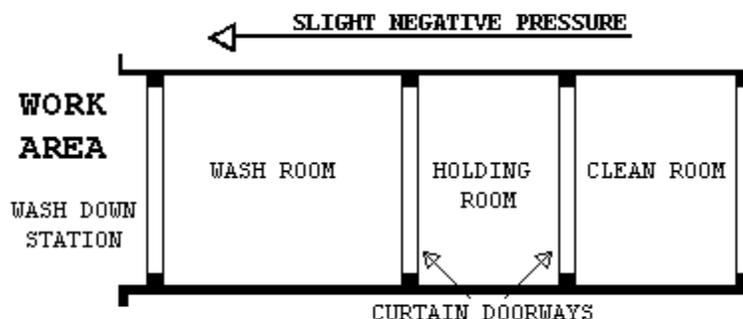

### 1.9.6 WASTE/EQUIPMENT DECONTAMINATION PROCEDURES

At the washdown station in the regulated area, thoroughly wet clean contaminated equipment and/or sealed polyethylene bags and pass into Wash Room after visual inspection. When passing anything into the Wash Room, close all doorways of the W/EDF, other than the doorway between the washdown station and the Wash Room. Keep all outside personnel clear of the W/EDF. Once inside the Wash Room, wet clean the equipment and/or bags. After cleaning and inspection, pass items into the Holding Room. Close all doorways except the doorway between the Holding Room and the Clean Room. Workers from the Clean Room/Exterior shall enter the Holding Room and remove the decontaminated/cleaned equipment/bags for removal and disposal. These personnel will not be required to wear PPE. At no time shall personnel from the clean side be allowed to enter the Wash Room.

## PART 2 - PRODUCTS, MATERIALS AND EQUIPMENT

### 2.1 MATERIALS AND EQUIPMENT

#### 2.1.1 GENERAL REQUIREMENTS (ALL ABATEMENT PROJECTS)

Prior to the start of work, the contractor shall provide and maintain a sufficient quantity of materials and equipment to assure continuous and efficient work throughout the duration of the project. Work shall not start unless the following items have been delivered to the site and the CPIH/CIH has submitted verification to the VA's representative.

- A. All materials shall be delivered in their original package, container or bundle bearing the name of the manufacturer and the brand name (where applicable).
- B. Store all materials subject to damage off the ground, away from wet or damp surfaces and under cover sufficient enough to prevent damage or contamination. Flammable and combustible

- materials cannot be stored inside buildings. Replacement materials shall be stored outside of the regulated area until abatement is completed.
- C. The Contractor shall not block or hinder use of buildings by patients, staff, and visitors to the VA in partially occupied buildings by placing materials/equipment in any unauthorized location.
  - D. The Competent Person shall inspect for damaged, deteriorating or previously used materials. Such materials shall not be used and shall be removed from the worksite and disposed of properly.
  - E. Polyethylene sheeting for walls in the regulated area shall be a minimum of 4-mils. For floors and all other uses, sheeting of at least 6-mil shall be used in widths selected to minimize the frequency of joints. Fire retardant poly shall be used throughout.
  - F. The method of attaching polyethylene sheeting shall be agreed upon in advance by the Contractor and the VA and selected to minimize damage to equipment and surfaces. Method of attachment may include any combination of moisture resistant duct tape furring strips, spray glue, staples, nails, screws, lumber and plywood for enclosures or other effective procedures capable of sealing polyethylene to dissimilar finished or unfinished surfaces under both wet and dry conditions.
  - G. Polyethylene sheeting utilized for the PDF shall be opaque white or black in color, 6 mil fire retardant poly.
  - H. Installation and plumbing hardware, showers, hoses, drain pans, sump pumps and waste water filtration system shall be provided by the Contractor.
  - I. An adequate number of HEPA vacuums, scrapers, sprayers, nylon brushes, brooms, disposable mops, rags, sponges, staple guns, shovels, ladders and scaffolding of suitable height and length as well as meeting OSHA requirements, fall protection devices, water hose to reach all areas in the regulated area, airless spray equipment, and any other tools, materials or equipment required to conduct the abatement project. All electrically operated hand tools, equipment, electric cords shall be connected to GFCI protection.
  - J. Special protection for objects in the regulated area shall be detailed (e.g., plywood over carpeting or hardwood floors to prevent damage from scaffolds, water and falling material).
  - K. Disposal bags – 2 layers of 6 mil poly for asbestos waste shall be pre-printed with labels, markings and address as required by OSHA, EPA and DOT regulations.
  - L. The VA shall be provided an advance copy of the MSDS as required for all hazardous chemicals under OSHA 29 CFR 1910.1200 - Hazard Communication in the pre-project submittal. Chlorinated compounds shall not be used with any spray adhesive, mastic remover or other product. Appropriate encapsulant(s) shall be provided.
  - M. OSHA DANGER demarcation signs, as many and as required by OSHA 29 CFR 1926.1101(k)(7) shall be provided and placed by the Competent Person. All other posters and notices required by Federal and State regulations shall be posted in the Clean Room.
  - N. Adequate and appropriate PPE for the project and number of personnel/shifts shall be provided. All personal protective equipment issued must be based on a written hazard assessment conducted under 29 CFR 1910.132(d).

### 2.1.2 NEGATIVE PRESSURE FILTRATION SYSTEM

The Contractor shall provide enough HEPA negative air machines to continuously maintain a pressure differential of -0.02" water column gauge (WCG). The Competent Person shall determine the number of units needed for the regulated area by dividing the cubic feet in the regulated area by 15 and then dividing that result by the cubic feet per minute (CFM) for each unit to determine the number of units needed to continuously maintain a pressure differential of -0.02" WCG. Provide a standby unit in the event of machine failure and/or emergency in an adjacent area.

NIOSH has done extensive studies and has determined that negative air machines typically operate at ~50% efficiency. The contractor shall consider this in their determination of number of units needed to continuously maintain a pressure differential of -0.02" WCG. The contractor shall use 8 air changes per hour or double the number of machines, based on their calculations, or submit proof their machines operate at stated capacities, at a 2" pressure drop across the filters.

### 2.1.3 DESIGN AND LAYOUT

- A. Before start of work submit the design and layout of the regulated area and the negative air machines. The submittal shall indicate the number of, location of and size of negative air machines. The point(s) of exhaust, air flow within the regulated area, anticipated negative pressure differential, and supporting calculations for sizing shall be provided. In addition, submit the following:
  - 1. Method of supplying power to the units and designation/location of the panels.
  - 2. Description of testing method(s) for correct air volume and pressure differential.
  - 3. If auxiliary power supply is to be provided for the negative air machines, provide a schematic diagram of the power supply and manufacturer's data on the generator and switch.

### 2.1.4 NEGATIVE AIR MACHINES (HEPA UNITS)

- A. Negative Air Machine Cabinet: The cabinet shall be constructed of steel or other durable material capable of withstanding potential damage from rough handling and transportation. The width of the cabinet shall be less than 30" in order to fit in standard doorways. The cabinet must be factory sealed to prevent asbestos fibers from being released during use, transport, or maintenance. Any access to and replacement of filters shall be from the inlet end. The unit must be on casters or wheels.
- B. Negative Air Machine Fan: The rating capacity of the fan must indicate the CFM under actual operating conditions. Manufacturer's typically use "free-air" (no resistance) conditions when rating fans. The fan must be a centrifugal type fan.
- C. Negative Air Machine Final Filter: The final filter shall be a HEPA filter. The filter media must be completely sealed on all edges within a structurally rigid frame. The filter shall align with a continuous flexible gasket material in the negative air machine housing to form an air tight seal. Each HEPA filter shall be certified by the manufacturer to have an efficiency of not less than 99.97%. Testing shall have been done in accordance with Military Standard MIL-STD-282 and Army Instruction Manual 136-300-175A. Each filter must bear a UL586 label to indicate ability to perform under specified conditions. Each filter shall be marked with the name of the manufacturer, serial number, air flow rating, efficiency and resistance, and the direction of test air flow.
- D. Negative Air Machine Pre-filters: The pre-filters, which protect the final HEPA filter by removing larger particles, are required to prolong the operating life of the HEPA filter. Two stages of pre-filtration are required. A first stage pre-filter shall be a low efficiency type for particles 10 micron or larger. A second stage pre-filter shall have a medium efficiency effective for particles down to 5 micron or larger. Pre-filters shall be installed either on or in the intake opening of the NAM and the second stage filter must be held in place with a special housing or clamps.
- E. Negative Air Machine Instrumentation: Each unit must be equipped with a gauge to measure the pressure drop across the filters and to indicate when filters have become loaded and need to be changed. A table indicating the cfm for various pressure readings on the gauge shall be affixed near the gauge for reference or the reading shall indicate at what point the filters shall be changed, noting cfm delivery. The unit must have an elapsed time meter to show total hours of operation.
- F. Negative Air Machine Safety and Warning Devices: An electrical/ mechanical lockout must be provided to prevent the fan from being operated without a HEPA filter. Units must be equipped with an automatic shutdown device to stop the fan in the event of a rupture in the HEPA filter or blockage in the discharge of the fan. Warning lights are required to indicate normal operation; too high a pressure drop across filters; or too low of a pressure drop across filters.
- G. Negative Air Machine Electrical: All electrical components shall be approved by the National Electrical Manufacturer's Association (NEMA) and Underwriters Laboratories (UL). Each unit must be provided with overload protection and the motor, fan, fan housing, and cabinet must be grounded.
- H. It is essential that replacement HEPA filters be tested using an "in-line" testing method, to ensure the seal around the periphery was not damaged during replacement. Damage to the outer HEPA filter seal could allow contaminated air to bypass the HEPA filter and be discharged to an

inappropriate location. Contractor will provide written documentation of test results for negative air machine units with HEPA filters changed by the contractor or documentation when changed and tested by the contractor filters.

### **2.1.5 PRESSURE DIFFERENTIAL**

The fully operational negative air system within the regulated area shall continuously maintain a pressure differential of -0.02" water column gauge. Before any disturbance of any asbestos material, this shall be demonstrated to the VA by use of a pressure differential meter/manometer as required by OSHA 29 CFR 1926.1101(e)(5)(i). The Competent Person shall be responsible for providing, maintaining, and documenting the negative pressure and air changes as required by OSHA and this specification.

## **2.2 CONTAINMENT BARRIERS AND COVERINGS IN THE REGULATED AREA**

### **2.2.1 GENERAL**

- A. Using critical barriers, seal off the perimeter to the regulated area to completely isolate the regulated area from adjacent spaces. All surfaces in the regulated area must be covered to prevent contamination and to facilitate clean-up. Should adjacent areas become contaminated as a result of the work, shall immediately stop work and clean up the contamination at no additional cost to the VA. Provide firestopping and identify all fire barrier penetrations due to abatement work as specified in Section 2.2.7; FIRESTOPPING.
- B. Place all tools, scaffolding, materials and equipment needed for working in the regulated area prior to erecting any plastic sheeting. All uncontaminated removable furniture, equipment and/or supplies shall be removed by the VA from the regulated area before commencing work. Any objects remaining in the regulated area shall be completely covered with 2 layers of 6-mil fire retardant poly sheeting and secured with duct tape. Lock out and tag out any HVAC/electrical systems in the regulated area.

### **2.2.3 CONTROLLING ACCESS TO THE REGULATED AREA**

Access to the regulated area is allowed only through the personnel decontamination facility (PDF). All other means of access shall be eliminated and OSHA DANGER demarcation signs posted as required by OSHA. If the regulated area is adjacent to, or within view of an occupied area, provide a visual barrier of 6 mil opaque fire retardant poly to prevent building occupant observation. If the adjacent area is accessible to the public, the barrier must be solid and capable of withstanding the negative pressure.

### **2.2.4 CRITICAL BARRIERS**

Completely separate any operations in the regulated area from adjacent areas using 2 layers of 6 mil fire retardant poly and duct tape. Individually seal with 2 layers of 6 mil poly and duct tape all HVAC openings into the regulated area. Individually seal all lighting fixtures, clocks, doors, windows, convectors, speakers, or any other objects/openings in the regulated area. Heat must be shut off any objects covered with poly.

### **2.2.5 SECONDARY BARRIERS**

A loose layer of 6 mil poly shall be used as a drop cloth to protect the primary layers from debris generated during the abatement. This layer shall be replaced as needed during the work and at a minimum once per work day.

### **2.2.6 EXTENSION OF THE REGULATED AREA**

If the enclosure of the regulated area is breached in any way that could allow contamination to occur, the affected area shall be included in the regulated area and constructed as per this section. Decontamination measures must be started immediately and continue until air monitoring indicates background levels are met.

## **2.2.7 FIRESTOPPING**

- A. Through penetrations caused by cables, cable trays, pipes, sleeves, conduits, etc. must be firestopped with a fire-rated firestop system providing an air tight seal.
- B. Firestop materials that are not equal to the wall or ceiling penetrated shall be brought to the attention of the VA Representative. The contractor shall list all areas of penetration, the type of sealant used, and whether or not the location is fire rated. Any discovery of penetrations during abatement shall be brought to the attention of the VA representative immediately. All walls, floors and ceilings are considered fire rated unless otherwise determined by the VA Representative or Fire Marshall.
- C. Any visible openings whether or not caused by a penetration shall be reported by the Contractor to the VA Representative for a sealant system determination. Firestops shall meet ASTM E814 and UL 1479 requirements for the opening size, penetrant, and fire rating needed.

## **2.3 MONITORING, INSPECTION AND TESTING**

### **2.3.1 GENERAL**

- A. Perform throughout abatement work monitoring, inspection and testing inside and around the regulated area in accordance with the OSHA requirements and these specifications. OSHA requires that the Employee exposure to asbestos must not exceed 0.1 fibers per cubic centimeter (f/cc) of air, averaged over an 8-hour work shift. The CPIH/CIH is responsible for and shall inspect and oversee the performance of the Contractor IH Technician. The IH Technician shall continuously inspect and monitor conditions inside the regulated area to ensure compliance with these specifications. In addition, the CPIH/CIH shall personally manage air sample collection, analysis, and evaluation for personnel, regulated area, and adjacent area samples to satisfy OSHA requirements. Additional inspection and testing requirements are also indicated in other parts of this specification.
- B. The Contractor will employ an independent industrial hygienist (VPIH/CIH) consultant. The VA also reserves the right to use its own IH to perform various services on behalf of the VA. The VPIH/CIH will perform the necessary monitoring, inspection, testing, and other support services to ensure that VA patients, employees, and visitors will not be adversely affected by the abatement work, and that the abatement work proceeds in accordance with these specifications, that the abated areas or abated buildings have been successfully decontaminated. The work of the VPIH/CIH consultant in no way relieves the Contractor from their responsibility to perform the work in accordance with contract/specification requirements, to perform continuous inspection, monitoring and testing for the safety of their employees, and to perform other such services as specified. The cost of the VPIH/CIH and their services will be borne by the Contractor, including any repeat of final inspection and testing that may be required due to unsatisfactory initial results. Any repeated final inspections and/or testing, if required, will be paid for by the Contractor.
- C. If fibers counted by the VPIH/CIH during abatement work, either inside or outside the regulated area, utilizing the NIOSH 7400 air monitoring method, exceed the specified respective limits, the Contractor shall stop work. The Contractor may request confirmation of the results by analysis of the samples by TEM. Request must be in writing and submitted to the VA's representative. Cost for the confirmation of results will be borne by the Contractor for both the collection and analysis of samples and for the time delay that may/does result for this confirmation. Confirmation sampling and analysis will be the responsibility of the CPIH/CIH with review and approval of the VPIH/CIH. An agreement between the CPIH/CIH and the VPIH/CIH shall be reached on the exact details of the confirmation effort, in writing, including such things as the number of samples, location, collection, quality control on-site, analytical laboratory, interpretation of results and any follow-up actions. This written agreement shall be co-signed by the IH's and delivered to the VA's representative.

### 2.3.2 SCOPE OF SERVICES OF THE VPIH/CIH CONSULTANT

- A. The purpose of the work of the VPIH/CIH is to: assure quality; adherence to the specification; resolve problems; prevent the spread of contamination beyond the regulated area; and assure clearance at the end of the project. In addition, their work includes performing the final inspection and testing to determine whether the regulated area or building has been adequately decontaminated. All air monitoring is to be done utilizing PCM/TEM. The VPIH/CIH will perform the following tasks:
  - 1. Task 1: Establish background levels before abatement begins by collecting background samples. Retain samples for possible TEM analysis.
  - 2. Task 2: Perform continuous air monitoring, inspection, and testing outside the regulated area during actual abatement work to detect any faults in the regulated area isolation and any adverse impact on the surroundings from regulated area activities.
  - 3. Task 3: Perform unannounced visits to spot check overall compliance of work with contract/specifications. These visits may include any inspection, monitoring, and testing inside and outside the regulated area and all aspects of the operation except personnel monitoring.
  - 4. Task 4: Provide support to the VA representative such as evaluation of submittals from the Contractor, resolution of conflicts, interpret data, etc.
  - 5. Task 5: Perform, in the presence of the VA representative, final inspection and testing of a decontaminated regulated area at the conclusion of the abatement to certify compliance with all regulations and VA requirements/specifications.
  - 6. Task 6: Issue certificate of decontamination for each regulated area and project report.
- B. All documentation, inspection results and testing results generated by the VPIH/CIH will be available to the Contractor for information and consideration. The Contractor shall cooperate with and support the VPIH/CIH for efficient and smooth performance of their work.
- C. The monitoring and inspection results of the VPIH/CIH will be used by the VA to issue any Stop Removal orders to the Contractor during abatement work and to accept or reject a regulated area or building as decontaminated.

### 2.3.3 MONITORING, INSPECTION AND TESTING BY CONTRACTOR CPIH/CIH

The Contractor's CPIH/CIH is responsible for managing all monitoring, inspections, and testing required by these specifications, as well as any and all regulatory requirements adopted by these specifications. The CPIH/CIH is responsible for the continuous monitoring of all subsystems and procedures which could affect the health and safety of the Contractor's personnel. Safety and health conditions and the provision of those conditions inside the regulated area for all persons entering the regulated area is the exclusive responsibility of the Contractor/Competent Person. The person performing the area air monitoring inside the regulated area shall be an IH Technician, who shall be trained and shall have specialized field experience in sampling and analysis. The IH Technician shall have successfully completed a NIOSH 582 Course or equivalent and provide documentation. The IH Technician shall participate in the AIHA Asbestos Analysis Registry or participate in the Proficiency Analytic Testing program of AIHA for fiber counting quality control assurance. The IH Technician shall also be an accredited EPA AHERA/State Contractor/Supervisor or Abatement Project Designer and Building Inspector/Management Planner. The IH Technician shall have participated in five abatement projects collecting personal and area samples as well as responsibility for documentation on substantially similar projects in size and scope. The analytic laboratory used by the Contractor to analyze the samples shall be AIHA accredited for asbestos PAT and approved by the VA prior to start of the project. A daily log shall be maintained by the CPIH/CIH or IH Technician, documenting all OSHA requirements for air personal monitoring for asbestos in 29 CFR 1926.1101 (f), (g) and Appendix A. This log shall be made available to the VA representative and the VPIH/CIH upon request. The log will contain, at a minimum, information on personnel or area samples, other persons represented by the sample, the date of sample collection, start and stop times for sampling, sample volume, flow rate, and fibers/cc. The CPIH/CIH shall collect and analyze samples for each representative job being done in the regulated area, i.e., removal, wetting, clean-up, and load-out. No fewer than two personal samples per shift shall be collected

and one area sample per 1,000 square feet of regulated area where abatement is taking place and one sample per shift in the clean room area shall be collected. In addition to the continuous monitoring required, the CPIH/CIH will perform inspection and testing at the final stages of abatement for each regulated area as specified in the CPIH/CIH responsibilities. Additionally, the CPIH/CIH will monitor and record pressure readings within the containment daily with a minimum of two readings at the beginning and at the end of a shift, and submit the data in the daily report.

## 2.4 ASBESTOS HAZARD ABATEMENT PLAN

The Contractor shall have established Asbestos Hazard Abatement Plan (AHAP) in printed form and loose leaf folder consisting of simplified text, diagrams, sketches, and pictures that establish and explain clearly the procedures to be followed during all phases of the work by the Contractor's personnel. The AHAP must be modified as needed to address specific requirements of this project and the specifications. The AHAP(s) shall be submitted for review and approval to the VA prior to the start of any abatement work. The minimum topics and areas to be covered by the AHAP(s) are:

- A. Minimum Personnel Qualifications
- B. Emergency Action Plan/Contingency Plans and Arrangements
- C. Security and Safety Procedures
- D. Respiratory Protection/Personal Protective Equipment Program and Training
- E. Medical Surveillance Program and Recordkeeping
- F. Regulated Area Requirements - Containment Barriers/Isolation of Regulated Area
- G. Decontamination Facilities and Entry/Exit Procedures (PDF and W/EDF)
- H. Negative Pressure Systems Requirements
- I. Monitoring, Inspections, and Testing
- J. Removal Procedures for ACM
- K. Removal of Contaminated Soil (if applicable)
- L. Encapsulation Procedures for ACM
- M. Disposal of ACM waste/equipment
- N. Regulated Area Decontamination/Clean-up
- O. Regulated Area Visual and Air Clearance
- P. Project Completion/Closeout

## 2.5 SUBMITTALS

### 2.5.1 PRE-START MEETING SUBMITTALS

Submit to the VA a minimum of 14 days prior to the pre-start meeting the following for review and approval. Meeting this requirement is a prerequisite for the pre-start meeting for this project:

- A. Submit a detailed work schedule for the entire project reflecting contract documents and the phasing/schedule requirements from the CPM chart.
- B. Submit a staff organization chart showing all personnel who will be working on the project and their capacity/function. Provide their qualifications, training, accreditations, and licenses, as appropriate. Provide a copy of the completed "Certificate of Worker's Acknowledgment" and the "Affidavit of Medical Surveillance and Respiratory Protection" for each person (see Attachments 2 and 3).
- C. Submit Asbestos Hazard Abatement Plan developed specifically for this project, incorporating the requirements of the specifications, prepared, signed and dated by the CPIH/CIH.
- D. Submit the specifics of the materials and equipment to be used for this project with manufacturer names, model numbers, performance characteristics, pictures/diagrams, and number available for the following:
  - 1. Supplied air system, negative air machines, HEPA vacuums, air monitoring pumps, calibration devices, pressure differential monitoring device and emergency power generating system.
  - 2. Waste water filtration system, shower system, containment barriers.
  - 3. Encapsulants, surfactants, hand held sprayers, airless sprayers, and fire extinguishers.
  - 4. Respirators, protective clothing, personal protective equipment.
  - 5. Fire safety equipment to be used in the regulated area.

- E. Submit the name, location, and phone number of the approved landfill; proof/verification the landfill is approved for ACM disposal; the landfill's requirements for ACM waste; the type of vehicle to be used for transportation; and name, address, and phone number of subcontractor, if used. Proof of asbestos training for transportation personnel shall be provided.
- F. Submit required notifications and arrangements made with regulatory agencies having regulatory jurisdiction and the specific contingency/emergency arrangements made with local health, fire, ambulance, hospital authorities and any other notifications/arrangements.
- G. Submit the name, location and verification of the laboratory and/or personnel to be used for analysis of air and/or bulk samples. Personal air monitoring must be done in accordance with OSHA 29 CFR 1926.1101(f) and Appendix A. And area or clearance air monitoring in accordance with EPA AHERA protocols.
- H. Submit qualifications verification: Submit the following evidence of qualifications. Make sure that all references are current and verifiable by providing current phone numbers and documentation.
  - 1. Asbestos Abatement Company: Project experience within the past 3 years; listing projects first most similar to this project: Project Name; Type of Abatement; Duration; Cost; Reference Name/Phone Number; Final Clearance; and Completion Date
  - 2. List of project(s) halted by owner, A/E, IH, regulatory agency in the last 3 years: Project Name; Reason; Date; Reference Name/Number; Resolution
  - 3. List asbestos regulatory citations (e.g., OSHA), notices of violations (e.g., Federal and state EPA), penalties, and legal actions taken against the company including and of the company's officers (including damages paid) in the last 3 years. Provide copies and all information needed for verification.
- I. Submit information on personnel: Provide a resume; address each item completely; copies of certificates, accreditations, and licenses. Submit an affidavit signed by the CPIH/CIH stating that all personnel submitted below have medical records in accordance with OSHA 29 CFR 1926.1101(m) and 29 CFR 1910.20 and that the company has implemented a medical surveillance program and written respiratory protection program, and maintains recordkeeping in accordance with the above regulations. Submit the phone number and doctor/clinic/hospital used for medical evaluations.
  - 1. CPIH/CIH and IH Technician: Name; years of abatement experience; list of projects similar to this one; certificates, licenses, accreditations for proof of AHERA/OSHA specialized asbestos training; professional affiliations; number of workers trained; samples of training materials; samples of AHAP(s) or specifications developed; medical opinion; and current respirator fit test.
  - 2. Competent Person(s)/Supervisor(s): Number; names; social security numbers; years of abatement experience as Competent Person/Supervisor; list of similar projects in size/complexity as Competent Person/Supervisor; as a worker; certificates, licenses, accreditations; proof of AHERA/OSHA specialized asbestos training; maximum number of personnel supervised on a project; medical opinion (asbestos surveillance and respirator use); and current respirator fit test.
  - 3. Workers: Numbers; names; social security numbers; years of abatement experience; certificates, licenses, accreditations; training courses in asbestos abatement and respiratory protection; medical opinion (asbestos surveillance and respirator use); and current respirator fit test.
- J. Submit copies of State license for asbestos abatement; copy of insurance policy, including exclusions with a letter from agent stating in plain language the coverage provided and the fact that asbestos abatement activities are covered by the policy; copy of the AHAP incorporating the requirements of this specification; information on who provides your training, how often; who provides medical surveillance, how often; who performs and how is personal air monitoring of abatement workers conducted; a list of references of independent laboratories/IH's familiar with your air monitoring and Asbestos Hazard Abatement Plans; copies of monitoring results of the five referenced projects listed and analytical method(s) used.
- K. Rented equipment must be decontaminated prior to returning to the rental agency.
- L. Submit, before the start of work, the manufacturer's technical data for all types of encapsulants, all MSDS, and application instructions.

- M. Submit a completed and original copy of Attachment #4 – “Abatement Contractor/Competent Person(s) Review and Acceptance of the VA’s Asbestos Specifications”

### **2.5.2 SUBMITTALS DURING ABATEMENT**

- A. The Competent Person shall maintain and submit a daily log at the regulated area documenting the dates and times of the following: purpose, attendees and summary of meetings; all personnel entering/exiting the regulated area; document and discuss the resolution of unusual events such as barrier breaching, equipment failures, emergencies, and any cause for stopping work; representative air monitoring and results/TWAs/ELs. Submit this information daily to the VPIH/CIH.
- B. The CPIH/CIH shall document and maintain the inspection and approval of the regulated area preparation prior to start of work and daily during work.
1. Removal of any poly barriers.
  2. Visual inspection/testing by the CPIH/CIH or IH Technician prior to application of lockdown encapsulant.
  3. Packaging and removal of ACM waste from regulated area.
  4. Disposal of ACM waste materials; copies of Waste Shipment Records/landfill receipts to the VA’s representative on a weekly basis.

### **2.5.3 SUBMITTALS AT COMPLETION OF ABATEMENT**

The CPIH/CIH shall submit a project report consisting of the daily log book requirements and documentation of events during the abatement project including Waste Shipment Records signed by the landfill's agent. It will also include information on the containment and transportation of waste from the containment with applicable Chain of Custody forms. The report shall include a certificate of completion, signed and dated by the CPIH/CIH, in accordance with Attachment #1. All clearance and perimeter area samples must be submitted. The VA Representative will retain the abatement report after completion of the project and provide copies of the abatement report to VAMC Office of Engineer and the Safety Office.

## **PART 3 - EXECUTION**

### **3.1 PRE-ABATEMENT ACTIVITIES**

#### **3.1.1 PRE-ABATEMENT MEETING**

The VA representative, upon receipt, review, and substantial approval of all pre-abatement submittals and verification by the CPIH/CIH that all materials and equipment required for the project are on the site, will arrange for a pre-abatement meeting between the Contractor, the CPIH/CIH, Competent Person(s), the VA representative(s), and the VPIH/CIH. The purpose of the meeting is to discuss any aspect of the submittals needing clarification or amplification and to discuss any aspect of the project execution and the sequence of the operation. The Contractor shall be prepared to provide any supplemental information/documentation to the VA’s representative regarding any submittals, documentation, materials or equipment. Upon satisfactory resolution of any outstanding issues, the VA’s representative will issue a written order to proceed to the Contractor. No abatement work of any kind described in the following provisions shall be initiated prior to the VA written order to proceed.

#### **3.1.2 PRE-ABATEMENT INSPECTIONS AND PREPARATIONS**

Before any work begins on the construction of the regulated area, the Contractor will:

- A. Conduct a space-by-space inspection with an authorized VA representative and prepare a written inventory of all existing damage in those spaces where asbestos abatement will occur. Still or video photography may be used to supplement the written damage inventory. Document will be signed and certified as accurate by both parties.
- B. The VA Representative, the Contractor, and the VPIH/CIH must be aware of VA A/E Quality Alert 07/09 indicating the failure to identify asbestos in the areas listed as well as common issues when preparing specifications and contract documents. This is especially critical when demolition is

planned, because AHERA surveys are non-destructive, and ACM may remain undetected. A NESHAPS (destructive) ACM inspection should be conducted on all building structures that will be demolished. Ensure the following areas are inspected on the project: Lay-in ceilings concealing ACM; ACM behind walls/windows from previous renovations; inside utility chases/walls; transite piping/ductwork/sheets; behind radiators; lab fume hoods; transite lab countertops; roofing materials; below window sills; water/sewer lines; electrical conduit coverings; crawl spaces( previous abatement contamination); flooring/mastic covered by carpeting/new flooring; exterior insulated wall panels; on underground fuel tanks; and steam line trench coverings.

- C. Ensure that all furniture, machinery, equipment, curtains, drapes, blinds, and other movable objects required to be removed from the regulated area have been cleaned and removed or properly protected from contamination.
- D. If present and required, remove and dispose of carpeting from floors in the regulated area. If ACM floor tile is attached to the carpet while the Contractor is removing the carpet that section of the carpet will be disposed of as asbestos waste.
- E. Inspect existing firestopping in the regulated area. Correct as needed.

### **3.1.3 PRE-ABATEMENT CONSTRUCTION AND OPERATIONS**

- A. Perform all preparatory work for the first regulated area in accordance with the approved work schedule and with this specification.
- B. Upon completion of all preparatory work, the CPIH/CIH will inspect the work and systems and will notify the VA's representative when the work is completed in accordance with this specification. The VA's representative may inspect the regulated area and the systems with the VPIH/CIH and may require that upon satisfactory inspection, the Contractor's employees perform all major aspects of the approved AHAP, especially worker protection, respiratory systems, contingency plans, decontamination procedures, and monitoring to demonstrate satisfactory operation. The operational systems for respiratory protection and the negative pressure system shall be demonstrated for proper performance.
- C. The CPIH/CIH shall document the pre-abatement activities described above and deliver a copy to the VA's representative.
- D. Upon satisfactory inspection of the installation of and operation of systems the VA's representative will notify the Contractor in writing to proceed with the asbestos abatement work in accordance with this specification and all applicable regulations.

## **3.2 REGULATED AREA PREPARATIONS**

### **3.2.1 OSHA DANGER SIGNS**

Post OSHA DANGER signs meeting the specifications of OSHA 29 CFR 1926.1101 at any location and approaches to the regulated area where airborne concentrations of asbestos may exceed the PEL. Signs shall be posted at a distance sufficiently far enough away from the regulated area to permit any personnel to read the sign and take the necessary measures to avoid exposure. Additional signs will be posted following construction of the regulated area enclosure.

### **3.2.2 CONTROLLING ACCESS TO THE REGULATED AREA**

Access to the regulated area is allowed only through the personnel decontamination facility (PDF), if required. All other means of access shall be eliminated and OSHA Danger demarcation signs posted as required by OSHA. If the regulated area is adjacent to or within view of an occupied area, provide a visual barrier of 6 mil opaque fire retardant poly sheeting to prevent building occupant observation. If the adjacent area is accessible to the public, the barrier must be solid

### **3.2.3 SHUT DOWN - LOCK OUT ELECTRICAL**

Shut down and lock out/tag out electric power to the regulated area. Provide temporary power and lighting. Insure safe installation including GFCI of temporary power sources and equipment by compliance with all applicable electrical code requirements and OSHA requirements for temporary electrical systems. Electricity shall be provided by the VA.

### **3.2.4 SHUT DOWN - LOCK OUT HVAC**

Shut down and lock out/tag out heating, cooling, and air conditioning system (**HVAC**) components that are in, supply or pass through the regulated area. Investigate the regulated area and agree on pre-abatement condition with the VA's representative. Seal all intake and exhaust vents in the regulated area with duct tape and 2 layers of 6-mil poly. Also, seal any seams in system components that pass through the regulated area. Remove all contaminated HVAC system filters and place in labeled 6-mil poly disposal bags for disposal as asbestos waste.

### **3.2.5 SANITARY FACILITIES**

The Contractor shall provide sanitary facilities for abatement personnel and maintain them in a clean and sanitary condition throughout the abatement project.

### **3.2.6 WATER FOR ABATEMENT**

The VA will provide water for abatement purposes. The Contractor shall connect to the existing VA system. The service to the shower(s) shall be supplied with backflow prevention.

### **3.2.7 PREPARATION PRIOR TO SEALING OFF**

Place all tools, materials and equipment needed for working in the regulated area prior to erecting any plastic sheeting. Remove all uncontaminated removable furniture, equipment and/or supplies from the regulated area before commencing work, or completely cover with 2 layers of 6-mil fire retardant poly sheeting and secure with duct tape. Lock out and tag out any HVAC systems in the regulated area.

### **3.2.8 CRITICAL BARRIERS**

Completely separate any openings into the regulated area from adjacent areas using fire retardant poly at least 6 mils thick and duct tape. Individually seal with 2 layers of 6 mil poly and duct tape all HVAC openings into the regulated area. Individually seal all lighting fixtures, clocks, doors, windows, convectors, speakers, or any other objects in the regulated area. Heat must be shut off any objects covered with poly

### **3.2.9 FLOOR BARRIERS**

For areas of flooring not being removed, but which may be located inside the regulated area, all floors in the regulated area shall be covered with 2 layers of 6 mil fire retardant poly and brought up the wall 12 inches

### **3.2.10 PRE-CLEANING MOVABLE OBJECTS**

Pre-cleaning of ACM contaminated items shall be performed after the enclosure has been erected and negative pressure has been established in the work area. After items have been pre-cleaned and decontaminated, they may be removed from the work area for storage until the completion of abatement in the work area.

Pre-clean all movable objects within the regulated area using a HEPA filtered vacuum and/or wet cleaning methods as appropriate. After cleaning, these objects shall be removed from the regulated area and carefully stored in an uncontaminated location.

### **3.2.11 PRE-CLEANING FIXED OBJECTS**

Pre-cleaning of ACM contaminated items shall be performed after the enclosure has been erected and negative pressure has been established in the work area

Pre-clean all fixed objects in the regulated area using HEPA filtered vacuums and/or wet cleaning techniques as appropriate. Careful attention must be paid to machinery behind grills or gratings where access may be difficult but contamination may be significant. Also, pay particular attention to wall, floor and ceiling penetration behind fixed items. After pre-cleaning, enclose fixed objects with 2 layers of 6-mil poly and seal securely in place with duct tape. Objects (e.g., permanent fixtures, shelves, electronic equipment, laboratory tables, sprinklers, alarm systems, closed circuit TV equipment and computer cables) which must remain in the regulated area and that require special ventilation or enclosure requirements should be designated here along with specified means of protection. Contact the manufacturer for special protection requirements.

### **3.2.12 PRE-CLEANING SURFACES IN THE REGULATED AREA**

Pre-cleaning of ACM contaminated items shall be performed after the enclosure has been erected and negative pressure has been established in the work area

Pre-clean all surfaces in the regulated area using HEPA filtered vacuums and/or wet cleaning methods as appropriate. Do not use any methods that would raise dust such as dry sweeping or vacuuming with equipment not equipped with HEPA filters. Do not disturb asbestos-containing materials during this pre-cleaning phase.

### **3.2.13 EXTENSION OF THE REGULATED AREA**

If the regulated area barrier is breached in any manner that could allow the passage of asbestos fibers or debris, the Competent Person shall immediately stop work, continue wetting, and proceed to extend the regulated area to enclose the affected area as per procedures described in this specification. If the affected area cannot be enclosed, decontamination measures and cleanup shall start immediately. All personnel shall be isolated from the affected area until decontamination/cleanup is completed as verified by visual inspection and air monitoring. Air monitoring at completion must indicate background levels.

## **3.3 REMOVAL OF CLASS II FLOORING MATERIALS**

### **3.3.1 GENERAL**

All applicable requirements of OSHA, EPA, and DOT shall be followed during OSHA Class II asbestos work. Keep materials intact; do not disturb; wet while working with it; wrap as soon as possible with 2 layers of 6 mil plastic for disposal.

### **3.3.2 REMOVAL OF FLOORING MATERIALS**

- A. All requirements of OSHA Flooring agreement provisions shall be followed:
  1. The Contractor shall provide enough HEPA negative air machines to effect  $> - 0.02''$  WCG pressure. Provide a standby unit in the event of machine failure and/or emergency in an adjacent area. The contractor shall use double the number of machines, based on their calculations, or submit proof their machines operate at stated capacities, at a 2" pressure drop across the filters.
  2. Flooring shall be first wetted and removed intact, as much as possible. Do not rip or tear flooring.
  3. Mechanical chipping or sanding is not allowed. Dry sweeping is prohibited.
  4. If the flooring begins to chip into pieces smaller than 4 square inches during work commencement, the flooring shall be removed with an infra-red heating unit operated by trained personnel following the manufacturer's instructions.
  5. Wet clean and HEPA vacuum the floor before and after removal of flooring.

6. Place a 6 mil poly layer 4' by 10' adjacent to the regulated area for use as a decontaminated area. All waste must be contained in the regulated area.
7. Package all waste in double 6 mil poly disposal bags. Waste bags shall be filled with a manageable quantity of waste; bags shall not be filled to the extent that prevents ease of movement and to prevent breakthrough.

### **3.3.3 REMOVAL OF MASTIC**

- A. All chemical mastic removers must be low in volatile organic compound (VOC) content, have a flash point greater than 200° Fahrenheit, contain no chlorinated solvents, and comply with California Air Resources Board (CARB) thresholds for VOCs (effective January 1, 2010).
- B. A negative air machine as required under flooring removal shall be provided.
- C. Follow all manufacturers' instructions in the use of the mastic removal material. An inert material such as wood fiber sawdust shall be used as an absorbent.
- D. Package all waste in double 6 mil poly disposal bags. Waste bags shall be filled with a manageable quantity of waste; bags shall not be too heavy as to prevent ease of movement and to prevent breakthrough.
- E. Prior to application of any liquid material, check the floor for penetrations and seal before removing mastic.

### **3.4 DISPOSAL OF CLASS II WASTE MATERIAL**

#### **3.4.1 GENERAL**

Wastes must be immediately bagged and sealed upon removal (prompt cleanup); no wastes shall be allowed to accumulate or be stored within the work area or project site. Wastes shall not be transported or stored in open containers. Gondolas used to transport waste at from the project location to transport vehicle must be lined and covered with 6-mil poly. Transport vehicles and/or disposal/storage containers must be lined with 6-mil poly; proper OSHA demarcation must be utilized during active loading and unloading in regard to transport and disposal/storage containers. Transport and/or storage containers shall be left unattended unless locked. Use of public elevators to transport waste is prohibited. Dispose of waste ACM and debris which is packaged in accordance with these specifications, OSHA, EPA and DOT. The landfill requirements for packaging must also be met. Transport will be in compliance with 49 CFR 100–185 regulations. Disposal shall be done at an approved landfill. Disposal of friable and non-friable ACM shall be done in accordance with applicable regulations.

### **3.5 PROJECT DECONTAMINATION**

#### **3.5.1 GENERAL**

- A. The VA must be notified at least 24 hours in advance of any waste removed from the containment,
- B. The entire work related to project decontamination shall be performed under the close supervision and monitoring of the CPIH/CIH.
- C. If the asbestos abatement work is in an area which was contaminated prior to the start of abatement, the decontamination will be done by cleaning the primary barrier poly prior to its removal and cleanings of the surfaces of the regulated area after the primary barrier removal.
- D. If the asbestos abatement work is in an area which was uncontaminated prior to the start of abatement, the decontamination will be done by cleaning the primary barrier poly prior to its removal, thus preventing contamination of the building when the regulated area critical barriers are removed.

#### **3.5.2 REGULATED AREA CLEARANCE**

Air testing and other requirements which must be met before release of the Contractor and re-occupancy of the regulated area space are specified in Final Testing Procedures.

### 3.5.3 WORK DESCRIPTION

Decontamination includes the clearance air testing in the regulated area and the decontamination and removal of the enclosures/facilities installed prior to the abatement work including primary/critical barriers, PDF and W/EDF facilities, and negative pressure systems.

### 3.5.4 PRE-DECONTAMINATION CONDITIONS

- A. Before decontamination starts, all ACM waste from the regulated area shall be removed, all waste collected and removed, and the secondary barrier of poly removed and disposed of along with any gross debris generated by the work.
- B. At the start of decontamination, the following shall be in place:
  - 1. Critical barriers over all openings consisting of two layers of 6 mil poly which is the sole barrier between the regulated area and the rest of the building or outside.
  - 2. Decontamination facilities, if required for personnel and equipment in operating condition.

### 3.5.5 CLEANING

Carry out a first cleaning of all surfaces of the regulated area including items of remaining poly sheeting, tools, scaffolding, ladders/staging by wet methods and/or HEPA vacuuming. Do not use dry dusting/sweeping/air blowing methods. Use each surface of a wetted cleaning cloth one time only and then dispose of as contaminated waste. Continue this cleaning until there is no visible residue from abated surfaces or poly or other surfaces. Remove all filters in the air handling system and dispose of as ACM waste in accordance with these specifications. The negative pressure system shall remain in operation during this time. Additional cleaning(s) may be needed as determined by the CPIH/VPIH/CIH.

## 3.6 VISUAL INSPECTION AND AIR CLEARANCE TESTING

### 3.6.1 GENERAL

Notify the VA representative 24 hours in advance for the performance of the final visual inspection and testing. The final visual inspection and testing will be performed by the VPIH/CIH after the final cleaning.

### 3.6.2 VISUAL INSPECTION

Final visual inspection will include the entire regulated area, the PDF, all poly sheeting, seals over HVAC openings, doorways, windows, and any other openings. If any debris, residue, dust or any other suspect material is detected, the final cleaning shall be repeated at no cost to the VA. Dust/material samples may be collected and analyzed at no cost to the VA at the discretion of the VPIH/CIH to confirm visual findings. When the regulated area is visually clean the final testing can be done.

### 3.6.3 AIR CLEARANCE TESTING

- A. After an acceptable final visual inspection by the VPIH/CIH, the VPIH/CIH will perform the final clearance testing. Air samples will be collected and analyzed in accordance with procedures for AHERA in this specification. If work is less than 260 lf/160 sf/35 cf, 5 PCM samples shall be collected for clearance and a minimum of one field blank. If work is equal to or more than 260 lf/160 sf/35 cf, AHERA TEM sampling shall be performed for clearance. TEM analysis shall be done in accordance with procedures for EPA AHERA in this specification. If the release criteria are not met, the Contractor shall repeat the final cleaning and continue decontamination procedures until clearance is achieved. **All additional inspection and testing costs will be borne by the Contractor.**
- B. If release criteria are met, proceed to perform the abatement closeout and to issue the certificate of completion in accordance with these specifications.

### 3.6.4 FINAL AIR CLEARANCE PROCEDURES

- A. Contractor's Release Criteria: Work in a regulated area is complete when the regulated area is visually clean and airborne fiber levels have been reduced to or below 0.01 f/cc as measured by the AHERA PCM protocol, or 70 AHERA structures per square millimeter (s/mm<sup>2</sup>) by AHERA TEM.
- B. Air Monitoring and Final Clearance Sampling: To determine if the elevated airborne fiber counts encountered during abatement operations have been reduced to the specified level, the VPIH/CIH will secure samples and analyze them according to the following procedures:
  - 1. Fibers Counted: "Fibers" referred to in this section shall be either all fibers regardless of composition as counted in the NIOSH 7400 PCM method or asbestos fibers counted using the AHERA TEM method.
  - 2. Aggressive Sampling: All final air testing samples shall be collected using aggressive sampling techniques except where soil is not encapsulated or enclosed. Samples will be collected on 0.8 $\mu$  MCE filters for PCM analysis and 0.45 $\mu$  Polycarbonate filters for TEM. A minimum of 1200 Liters of using calibrated pumps shall be collected for clearance samples. Before pumps are started, initiate aggressive air mixing sampling as detailed in 40 CFR 763 Subpart E (AHERA) Appendix A (III)(B)(7)(d). Air samples will be collected in areas subject to normal air circulation away from corners, obstructed locations, and locations near windows, doors, or vents. After air sampling pumps have been shut off, circulating fans shall be shut off. The negative pressure system shall continue to operate.

### 3.7 ABATEMENT CLOSEOUT AND CERTIFICATE OF COMPLIANCE

#### 3.7.1 COMPLETION OF ABATEMENT WORK

- A. After thorough decontamination, complete asbestos abatement work upon meeting the regulated area clearance criteria and fulfilling the following:
  - 1. Remove all equipment, materials, and debris from the project area.
  - 2. Package and dispose of all asbestos waste as required.
  - 3. Repair or replace all interior finishes damaged during the abatement work.
  - 4. Fulfill other project closeout requirements as specified elsewhere in this specification.

#### 3.7.2 CERTIFICATE OF COMPLETION BY CONTRACTOR

The CPIH shall complete and sign the "Certificate of Completion" in accordance with Attachment 1 at the completion of the abatement and decontamination of the regulated area.

#### 3.7.3 WORK SHIFTS

All work in non-mechanical/electrical spaces will be performed outside of normal business hours (5pm-5am M-F and anytime Sat-Sun). Work performed during normal business hours must NOT interrupt services or produce noise that would transfer to occupied portions of the building. ALL cutovers must be done outside of normal business hours and coordinated with COR 3 weeks in advance. Building 330 (main hospital) will remain occupied continuously and construction must be coordinated with COR extensively.

**ATTACHMENT #1**

**CERTIFICATE OF COMPLETION**

DATE: \_\_\_\_\_ VA Project #: \_\_\_\_\_

PROJECT NAME: \_\_\_\_\_ Abatement Contractor: \_\_\_\_\_

VAMC/ADDRESS: \_\_\_\_\_

1. I certify that I have personally inspected, monitored and supervised the abatement work of (specify regulated area or Building):  
which took place from / / to / /
2. That throughout the work all applicable requirements/regulations and the VA's specifications were met.
3. That any person who entered the regulated area was protected with the appropriate personal protective equipment and respirator and that they followed the proper entry and exit procedures and the proper operating procedures for the duration of the work.
4. That all employees of the Abatement Contractor engaged in this work were trained in respiratory protection, were experienced with abatement work, had proper medical surveillance documentation, were fit-tested for their respirator, and were not exposed at any time during the work to asbestos without the benefit of appropriate respiratory protection.
5. That I performed and supervised all inspection and testing specified and required by applicable regulations and VA specifications.
6. That the conditions inside the regulated area were always maintained in a safe and healthy condition and the maximum fiber count never exceeded 0.5 f/cc, except as described below.
7. That all abatement work was done in accordance with OSHA requirements and the manufacturer's recommendations.

CPIH/CIH Signature/Date: \_\_\_\_\_

CPIH/CIH Print Name: \_\_\_\_\_

Abatement Contractor Signature/Date: \_\_\_\_\_

Abatement Contractor Print Name: \_\_\_\_\_

**ATTACHMENT #2**

**CERTIFICATE OF WORKER'S ACKNOWLEDGMENT**

PROJECT NAME: \_\_\_\_\_ DATE: \_\_\_\_\_

PROJECT ADDRESS: \_\_\_\_\_

ABATEMENT CONTRACTOR'S NAME: \_\_\_\_\_

**WORKING WITH ASBESTOS CAN BE HAZARDOUS TO YOUR HEALTH. INHALING ASBESTOS HAS BEEN LINKED WITH VARIOUS TYPES OF CANCERS. IF YOU SMOKE AND INHALE ASBESTOS FIBERS, YOUR CHANCES OF DEVELOPING LUNG CANCER IS GREATER THAN THAT OF THE NON-SMOKING PUBLIC.**

Your employer's contract with the owner for the above project requires that: You must be supplied with the proper personal protective equipment including an adequate respirator and be trained in its use. You must be trained in safe and healthy work practices and in the use of the equipment found at an asbestos abatement project. You must receive/have a current medical examination for working with asbestos. These things shall be provided at no cost to you. By signing this certificate you are indicating to the owner that your employer has met these obligations.

**RESPIRATORY PROTECTION:** I have been trained in the proper use of respirators and have been informed of the type of respirator to be used on the above indicated project. I have a copy of the written Respiratory Protection Program issued by my employer. I have been provided for my exclusive use, at no cost, with a respirator to be used on the above indicated project.

**TRAINING COURSE:** I have been trained by a third party, State/EPA accredited trainer in the requirements for an AHERA/OSHA Asbestos Abatement Worker training course, 32 hours minimum duration. I currently have a valid State accreditation certificate. The topics covered in the course include, as a minimum, the following:

- Physical Characteristics and Background Information on Asbestos
- Potential Health Effects Related to Exposure to Asbestos
- Employee Personal Protective Equipment
- Establishment of a Respiratory Protection Program
- State of the Art Work Practices
- Personal Hygiene
- Additional Safety Hazards
- Medical Monitoring
- Air Monitoring
- Relevant Federal, State and Local Regulatory Requirements, Procedures, and Standards
- Asbestos Waste Disposal

**MEDICAL EXAMINATION:** I have had a medical examination within the past 12 months which was paid for by my employer. This examination included: health history, occupational history, pulmonary function test, and may have included a chest x-ray evaluation. The physician issued a positive written opinion after the examination.

Signature: \_\_\_\_\_

Printed Name: \_\_\_\_\_

Social Security Number: \_\_\_\_\_

Witness: \_\_\_\_\_

**ATTACHMENT #3**

**AFFIDAVIT OF MEDICAL SURVEILLANCE, RESPIRATORY PROTECTION AND  
TRAINING/ACCREDITATION**

VA PROJECT NAME AND NUMBER: \_\_\_\_\_

VA MEDICAL FACILITY: \_\_\_\_\_

ABATEMENT CONTRACTOR'S NAME AND ADDRESS: \_\_\_\_\_

1. I verify that the following individual

Name: \_\_\_\_\_ Social Security Number: \_\_\_\_\_

who is proposed to be employed in asbestos abatement work associated with the above project by the named Abatement Contractor, is included in a medical surveillance program in accordance with 29 CFR 1926.1101(m), and that complete records of the medical surveillance program as required by 29 CFR 1926.1101(m)(n) and 29 CFR 1910.20 are kept at the offices of the Abatement Contractor at the following address.

Address: \_\_\_\_\_

2. I verify that this individual has been trained, fit-tested and instructed in the use of all appropriate respiratory protection systems and that the person is capable of working in safe and healthy manner as expected and required in the expected work environment of this project.

3. I verify that this individual has been trained as required by 29 CFR 1926.1101(k). This individual has also obtained a valid State accreditation certificate. Documentation will be kept on-site.

4. I verify that I meet the minimum qualifications criteria of the VA specifications for a CPIH.

Signature of CPIH/CIH: \_\_\_\_\_ Date: \_\_\_\_\_

Printed Name of CPIH/CIH: \_\_\_\_\_

Signature of Contractor: \_\_\_\_\_ Date: \_\_\_\_\_

Printed Name of Contractor: \_\_\_\_\_

**ATTACHMENT #4**

**ABATEMENT CONTRACTOR/COMPETENT PERSON(S) REVIEW AND ACCEPTANCE OF THE VA'S ASBESTOS SPECIFICATIONS**

VA Project Location: \_\_\_\_\_

VA Project #: \_\_\_\_\_

VA Project Description: \_\_\_\_\_

This form shall be signed by the Asbestos Abatement Contractor Owner and the Asbestos Abatement Contractor's Competent Person(s) prior to any start of work at the VA related to this Specification. If the Asbestos Abatement Contractor's/Competent Person(s) has not signed this form, they shall not be allowed to work on-site.

I, the undersigned, have read VA's Asbestos Specification regarding the asbestos abatement requirements. I understand the requirements of the VA's Asbestos Specification and agree to follow these requirements as well as all required rules and regulations of OSHA/EPA/DOT and State/Local requirements. I have been given ample opportunity to read the VA's Asbestos Specification and have been given an opportunity to ask any questions regarding the content and have received a response related to those questions. I do not have any further questions regarding the content, intent and requirements of the VA's Asbestos Specification.

At the conclusion of the asbestos abatement, I will certify that all asbestos abatement work was done in accordance with the VA's Asbestos Specification and all ACM was removed properly and no fibrous residue remains on any abated surfaces.


Abatement Contractor Owner's Signature \_\_\_\_\_ Date \_\_\_\_\_

Abatement Contractor Competent Person(s) \_\_\_\_\_ Date \_\_\_\_\_

UPGRADE ELECTRICAL BRANCH LINES B310  
VAMC DAYTON, OHIO

ASBESTOS FLOOR TILE  
AND MASTIC ABATEMENT  
07-11

**-- END SECTION 02 82 13.19 --**

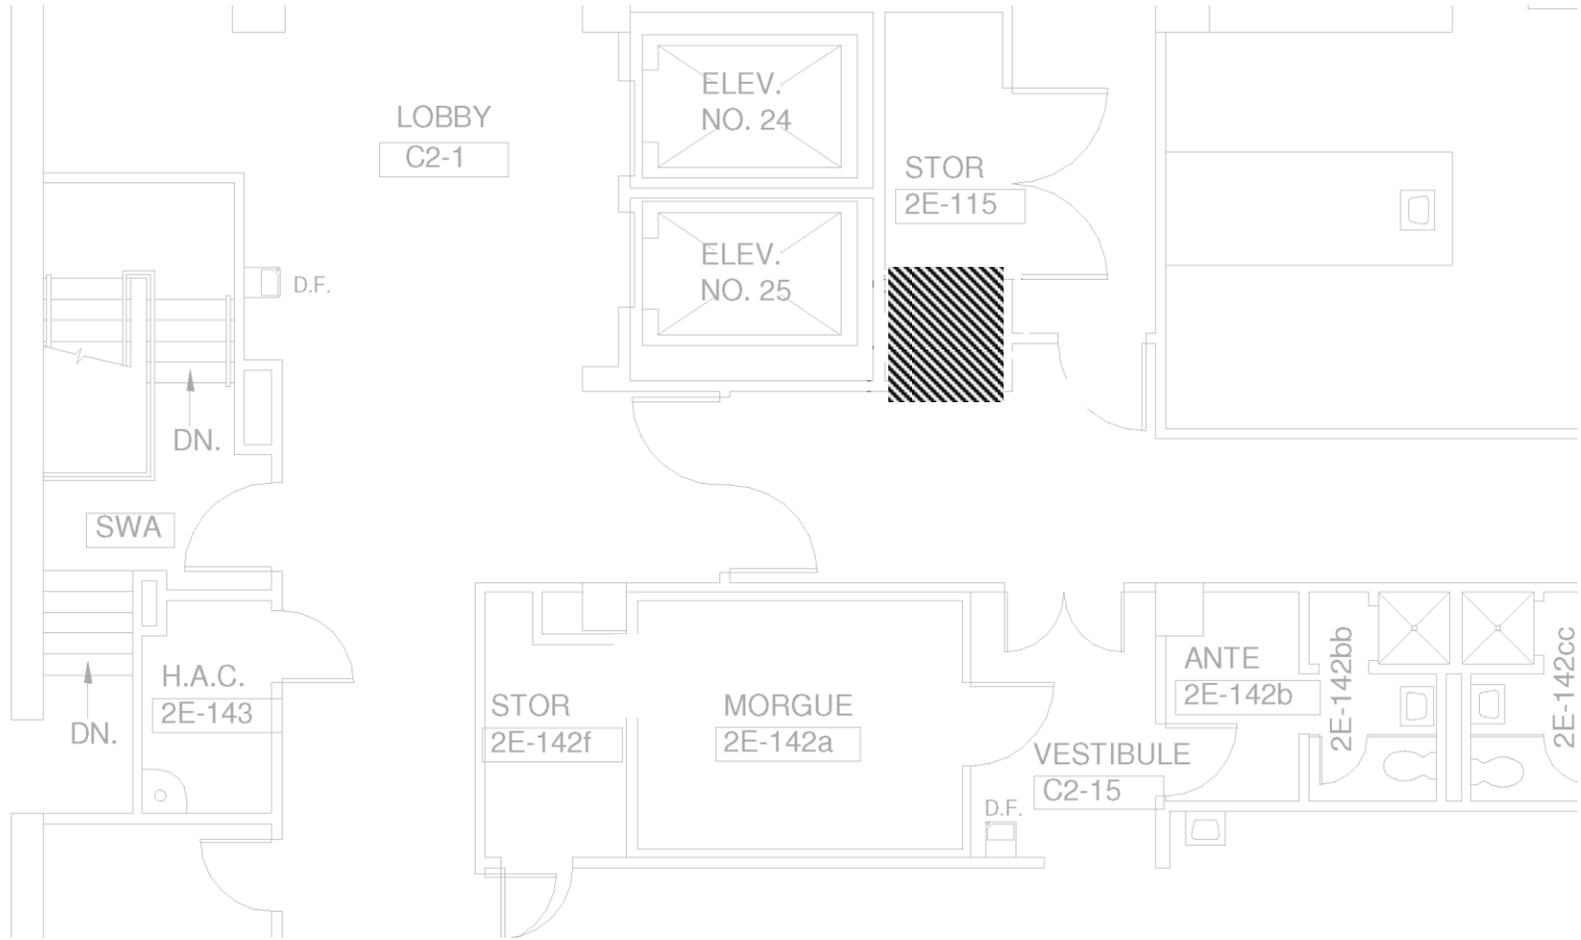

Indicates approximate location of asbestos-containing mastic (including associated 12"x12" cream with tan streak floor tile) to be abated per Section 02 82 13.19.

Terracon Project No.
N1147045
Scale:
Not to Scale
Abatement Designer:
JAT
Date:
4/22/14

**Terracon**  
Consulting Engineers and Scientists

611 Lunken Park Drive Cincinnati, Ohio 45226  
Phone: (513) 321 5816 www.terracon.com

2<sup>ND</sup> FLOOR – BUILDING 310  
Asbestos Abatement Location Diagram

---

UPGRADE ELECTRICAL BRANCH LINES BUILDING 310  
VA PROJCT #552-15-206  
Dayton VA Medical Center  
4100 West Third Street  
Dayton, Montgomery County, Ohio

EXHIBIT
1



**SECTION 07 84 00  
FIRESTOPPING**

**PART 1 GENERAL**

**1.1 DESCRIPTION**

- A. Closures of openings in walls, floors, and roof decks against penetration of flame, heat, and smoke or gases in fire resistant rated construction.
- B. Closure of openings in walls against penetration of gases or smoke in smoke partitions.

**1.2 RELATED WORK**

- A. Not applicable.

**1.3 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturers literature, data, and installation instructions for types of firestopping and smoke stopping used.
- C. List of FM, UL, or WH classification number of systems installed.
- D. Certified laboratory test reports for ASTM E814 tests for systems not listed by FM, UL, or WH proposed for use.

**1.4 DELIVERY AND STORAGE**

- A. Deliver materials in their original unopened containers with manufacturer's name and product identification.
- B. Store in a location providing protection from damage and exposure to the elements.

**1.5 WARRANTY**

Firestopping work subject to the terms of the Article "Warranty of Construction", FAR clause 52.246-21, except extend the warranty period to five years.

**1.6 QUALITY ASSURANCE**

FM, UL, or WH or other approved laboratory tested products will be acceptable.

**1.7 APPLICABLE PUBLICATIONS**

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):
  - E84-10..... Surface Burning Characteristics of Building Materials
  - E814-11..... Fire Tests of Through-Penetration Fire Stops
- C. Factory Mutual Engineering and Research Corporation (FM):
  - Annual Issue Approval Guide Building Materials
- D. Underwriters Laboratories, Inc. (UL):
  - Annual Issue Building Materials Directory
  - Annual Issue Fire Resistance Directory

1479-10 ..... Fire Tests of Through-Penetration Firestops

- E. Warnock Hersey (WH):  
Annual Issue Certification Listings

## **PART 2 - PRODUCTS**

### **2.1 FIRESTOP SYSTEMS**

- A. Use either factory built (Firestop Devices) or field erected (through-Penetration Firestop Systems) to form a specific building system maintaining required integrity of the fire barrier and stop the passage of gases or smoke.
- B. Through-penetration firestop systems and firestop devices tested in accordance with ASTM E814 or UL 1479 using the "F" or "T" rating to maintain the same rating and integrity as the fire barrier being sealed. "T" ratings are not required for penetrations smaller than or equal to 100 mm (4 in) nominal pipe or 0.01 m<sup>2</sup> (16 sq. in.) in overall cross sectional area.
- C. Products requiring heat activation to seal an opening by its intumescence shall exhibit a demonstrated ability to function as designed to maintain the fire barrier.
- D. Firestop sealants used for firestopping or smoke sealing shall have following properties:
  - 1. Contain no flammable or toxic solvents.
  - 2. Have no dangerous or flammable out gassing during the drying or curing of products.
  - 3. Water-resistant after drying or curing and unaffected by high humidity, condensation or transient water exposure.
  - 4. When used in exposed areas, shall be capable of being sanded and finished with similar surface treatments as used on the surrounding wall or floor surface.
- E. Firestopping system or devices used for penetrations by glass pipe, plastic pipe or conduits, unenclosed cables, or other non-metallic materials shall have following properties:
  - 1. Classified for use with the particular type of penetrating material used.
  - 2. Penetrations containing loose electrical cables, computer data cables, and communications cables protected using firestopping systems that allow unrestricted cable changes without damage to the seal.
  - 3. Intumescent products which would expand to seal the opening and act as fire, smoke, toxic fumes, and, water sealant.
- F. Maximum flame spread of 25 and smoke development of 50 when tested in accordance with ASTM E84.
- G. FM, UL, or WH rated or tested by an approved laboratory in accordance with ASTM E814.
- H. Materials to be asbestos free.

### **2.2 SMOKE STOPPING IN SMOKE PARTITIONS**

- A. Use silicone sealant in smoke partitions.
- B. Use mineral fiber filler and bond breaker behind sealant.

- C. Sealants shall have a maximum flame spread of 25 and smoke developed of 50 when tested in accordance with E84.
- D. When used in exposed areas capable of being sanded and finished with similar surface treatments as used on the surrounding wall or floor surface.

### **PART 3 - EXECUTION**

#### **3.1 EXAMINATION**

Submit product data and installation instructions, as required by article, submittals, after an on site examination of areas to receive firestopping.

#### **3.2 PREPARATION**

- A. Remove dirt, grease, oil, loose materials, or other substances that prevent adherence and bonding or application of the firestopping or smoke stopping materials.
- B. Remove insulation on insulated pipe for a distance of 150 mm (six inches) on either side of the fire rated assembly prior to applying the firestopping materials unless the firestopping materials are tested and approved for use on insulated pipes.

#### **3.3 INSTALLATION**

- A. Do not begin work until the specified material data and installation instructions of the proposed firestopping systems have been submitted and approved.
- B. Install firestopping systems with smoke stopping in accordance with FM, UL, WH, or other approved system details and installation instructions.
- C. Install smoke stopping seals in smoke partitions.

#### **3.4 CLEAN-UP AND ACCEPTANCE OF WORK**

- A. As work on each floor is completed, remove materials, litter, and debris.
- B. Do not move materials and equipment to the next-scheduled work area until completed work is inspected and accepted by the COR.
- C. Clean up spills of liquid type materials.

--- E N D ---

**SECTION 21 05 11**  
**COMMON WORK RESULTS FOR FIRE SUPPRESSION**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. The requirements of this Section apply to all sections of Division 21.
- B. Definitions:
  - 1. Exposed: Piping and equipment exposed to view in finished rooms.
  - 2. Option or optional: Contractor's choice of an alternate material or method.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 07 84 00, FIRESTOPPING.

**1.3 QUALITY ASSURANCE**

- A. Products Criteria:
  - 1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture of the products for at least 3 years. See other specification sections for any exceptions.
  - 2. Equipment Service: Products shall be supported by a service organization which maintains a complete inventory of repair parts and is located reasonably close to the site.
  - 3. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be products of one manufacturer.
  - 4. Assembled Units: Manufacturers of equipment assemblies, which use components made by others, assume complete responsibility for the final assembled product.
  - 5. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
  - 6. Asbestos products or equipment or materials containing asbestos shall not be used.
- B. Manufacturer's Recommendations: Where installation procedures or any part thereof are required to be in accordance with the recommendations of the manufacturer of the material being installed, printed copies of these recommendations shall be furnished to the COR prior to installation. Installation of the item will not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations can be cause for rejection of the material.
- C. Guaranty: In GENERAL REQUIREMENTS.
- D. Supports for sprinkler piping shall be in conformance with NFPA 13.

#### 1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data: Submit under the pertinent section rather than under this section.
  - 1. Equipment and materials identification.
  - 2. Fire-stopping materials.
  - 3. Hangers, inserts, supports and bracing. Provide load calculations for variable spring and constant support hangers.
  - 4. Wall, floor, and ceiling plates.

#### 1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):
  - A36/A36M-2001 ..... Carbon Structural Steel
  - A575-96..... Steel Bars, Carbon, Merchant Quality, M-Grades R (2002)
  - E84-2003..... Standard Test Method for Burning Characteristics of Building Materials
  - E119-2000..... Standard Test Method for Fire Tests of Building Construction and Materials
- C. National Fire Protection Association (NFPA):
  - 90A-96..... Installation of Air Conditioning and Ventilating Systems
  - 101-97 ..... Life Safety Code

### PART 2 - PRODUCTS

#### 2.1 EQUIPMENT AND MATERIALS IDENTIFICATION

- A. Use symbols, nomenclature specified and shown on the drawings.
- B. Valve Tags and Lists:
  - 1. Valve tags: Engraved black filled numbers and letters not less than 13 mm (1/2-inch) high for number designation, and not less than 6.4 mm (1/4-inch) for service designation on 19 gage 38 mm (1-1/2 inches) round brass disc, attached with brass "S" hook or brass chain.
  - 2. Valve lists: Typed or printed plastic coated card(s), sized 216 mm (8-1/2 inches) by 280 mm (11 inches) showing tag number, valve function and area of control, for each service or system. Punch sheets for a 3-ring notebook.
  - 3. Provide detailed plan for each floor of the building indicating the location and valve number for each valve. Identify location of each valve with a color coded thumb tack in ceiling.

## **2.2 FIRESTOPPING**

- A. Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping.

## **2.3 GALVANIZED REPAIR COMPOUND**

- A. Mil. Spec. DOD-P-21035B, paint form.

## **2.4 PIPE PENETRATIONS**

- A. Install sleeves during construction for other than blocked out floor openings for risers in mechanical bays.
- B. Penetrations are not allowed through beams or ribs, but may be installed in concrete beam flanges. Any deviation from this requirement must receive prior approval of the COR.
- C. Sheet Metal, Plastic, or Moisture-resistant Fiber Sleeves: Provide for pipe passing interior walls and partitions, unless brass or steel pipe sleeves are specifically called for below.
- D. Galvanized Steel or an alternate Black Iron Pipe with asphalt coating Sleeves: Provide for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for.
- E. Sleeves are not required in drywall construction.
- F. Sleeve Clearance: Sleeve through walls, partitions, and beam flanges shall be one inch greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation. Interior openings shall be caulked tight with fire stopping material and sealant to prevent the spread of fire, smoke, and gases.

## **2.5 TOOLS AND LUBRICANTS**

- A. Furnish, and turn over to the COR, special tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.

## **2.6 WALL, FLOOR AND CEILING PLATES**

- A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.
- B. Thickness: For wall and ceiling plates, not less than 0.64 mm (0.025-inch) for up to 80 mm (3-inch pipe), 0.89 mm (0.035-inch) for larger pipe.
- C. Locations: Use where pipe penetrates walls and ceilings in exposed locations, in finished areas only. Use also where insulation ends on exposed water supply pipe drop from overhead. Provide a watertight joint in spaces where brass or steel pipe sleeves are specified.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Coordinate location of piping, sleeves, inserts, and hangers. Locate piping, sleeves, inserts, and hangers clear of windows, doors, openings, light outlets, and other services and utilities. Follow manufacturer's published recommendations for installation methods not otherwise specified.

- B. Protection and Cleaning:
  - 1. Materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the COR. Damaged or defective items in the opinion of the COR, shall be replaced.
- C. Install gages, valves, and other devices with due regard for ease in reading or operating and maintaining said devices. Locate and position gages to be easily read by operator or staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.
- D. Work in Existing Building:
  - 1. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).
  - 2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will least interfere with normal operation of the facility.
  - 3. Cut required openings through existing masonry and reinforced concrete using diamond core drills. Use of pneumatic hammer type drills, impact type electric drills, and hand or manual hammer type drills, will be permitted only with approval of the COR. Locate openings that will least effect structural slabs, columns, ribs or beams. Refer to the COR for determination of proper design for openings through structural sections and opening layouts approval, prior to cutting or drilling into structure. After COR's approval, carefully cut opening through construction no larger than absolutely necessary for the required installation.
- E. Switchgear Drip Protection: Every effort shall be made to eliminate the installation of pipe above electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints.
- F. Inaccessible Equipment:
  - 1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost to the Government.
  - 2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as motors, fans, pumps, belt guards, transformers, high voltage lines, piping, and ductwork.

### **3.2 OPERATING AND PERFORMANCE TESTS**

- A. Prior to the final inspection, perform required tests as specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TESTS and submit the test reports and records to the COR.
- B. Should evidence of malfunction in any tested system or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.
- C. When completion of certain work or system occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then make performance tests for heating systems and for cooling systems respectively during first actual seasonal use of respective systems following completion of work.

### **3.3 INSTRUCTIONS TO VA PERSONNEL**

- A. Provide in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.

--- E N D ---

**SECTION 21 13 13**  
**WET-PIPE SPRINKLER SYSTEMS**

**PART 1 - GENERAL**

**1.1 SCOPE OF WORK**

- A. Design, installation and testing shall be in accordance with NFPA 13 except for specified exceptions.
- B. Modification of the existing sprinkler system as indicated on the drawings and as further required by these specifications.

**1.2 RELATED WORK**

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Section 07 84 00, FIRESTOPPING, Treatment of penetrations through rated enclosures.
- C. Section 21 05 11 COMMON WORK RESULTS FOR FIRE SUPPRESSION

**1.3 QUALITY ASSURANCE**

- A. Installer Reliability: The installer shall possess a valid State of Ohio fire sprinkler contractor's license. The installer shall have been actively and successfully engaged in the installation of commercial automatic sprinkler systems for the past ten years.
- B. Materials and Equipment: All equipment and devices shall be of a make and type listed by UL and approved by FM, or other nationally recognized testing laboratory for the specific purpose for which it is used. All materials, devices, and equipment shall be approved by the VA.
- C. Submittals: Submit as one package in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Prepare detailed working drawings that are signed by a NICET Level III or Level IV Sprinkler Technician or stamped by a Registered Professional Engineer practicing in the field of Fire Protection Engineering. As Government review is for technical adequacy only, the installer remains responsible for correcting any conflicts with other trades and building construction that arise during installation. Material submittals shall be approved prior to the purchase or delivery to the job site. Suitably bind submittals in notebooks or binders and provide index referencing the appropriate specification section. Submittals shall include, but not be limited to, the following:
  - 1. Qualifications:
    - a. Provide a copy of the installing contractors' fire sprinkler and state contractor's license.
    - b. Provide a copy of the NICET certification for the NICET Level III or Level IV Sprinkler Technician who prepared and signed the detailed working drawings unless the drawings are stamped by a Registered Professional Engineer practicing in the field of Fire Protection Engineering.
  - 2. Drawings: Submit detailed 1:100 (1/8 inch) scale (minimum) working drawings conforming to NFPA 13. Include a site plan showing the piping to the water supply test location.
  - 3. Manufacturers Data Sheets:

- a. Provide for materials and equipment proposed for use on the system. Include listing information and installation instructions in data sheets. Where data sheet describes items in addition to that item being submitted, clearly identify proposed item on the sheet.
4. Final Document Submittals: Provide as-built drawings, testing and maintenance instructions in accordance with the requirements in Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Submittals shall include, but not be limited to, the following:
  - a. One complete set of reproducible as-built drawings showing the installed system with the specific interconnections between the waterflow switch or pressure switch and the fire alarm equipment.
  - b. Complete, simple, understandable, step-by-step, testing instructions giving recommended and required testing frequency of all equipment, methods for testing all equipment, and a complete trouble shooting manual. Provide maintenance instructions on replacing any components of the system including internal parts, periodic cleaning and adjustment of the equipment and components with information as to the address and telephone number of both the manufacturer and the local supplier of each item.
  - c. Material and Testing Certificate: Upon completion of the sprinkler system installation or any partial section of the system, including testing and flushing, provide a copy of a completed Material and Testing Certificate as indicated in NFPA 13.
  - d. Certificates shall document all parts of the installation.
  - e. Instruction Manual: Provide one copy of the instruction manual covering the system in a flexible protective cover and mount in an accessible location adjacent to the riser.
- D. Design Basis Information: Provide design, materials, equipment, installation, inspection, and testing of the automatic sprinkler system in accordance with the requirements of NFPA 13. Recommendations in appendices shall be treated as requirements.
  1. Sprinkler Protection: To determine spacing and sizing, apply the following coverage classifications:
    - a. Light Hazard Occupancies: Patient care, treatment, and customary access areas.
    - b. Ordinary Hazard Group 1 Occupancies: Mechanical Equipment Rooms, Transformer Rooms, Electrical Switchgear Rooms, Electric Closets, Elevator Shafts, Elevator Machine Rooms.
    - c. Ordinary Hazard Group 2 Occupancies: Storage rooms, trash rooms, clean and soiled linen rooms, pharmacy and associated storage, laundry, kitchens, kitchen storage areas, retail stores, retail store storage rooms, storage areas, building management storage, file storage areas for the entire area of the space up to 140 square meters (1500 square feet) and Supply Processing and Distribution (SPD).
    - d. Request clarification from the Government for any hazard classification not identified.

## 1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Fire Protection Association (NFPA):
  - 13-2010 ..... Installation of Sprinkler Systems
  - 101-2009 ..... Safety to Life from Fire in Buildings and Structures (Life Safety Code)
  - 170-2009 ..... Fire Safety Symbols
- C. Underwriters Laboratories, Inc. (UL):
  - Fire Protection Equipment Directory – 2001
- D. Factory Mutual Engineering Corporation (FM):
  - Approval Guide – 2001
- E. International Building Code – 2009
- F. Foundation for Cross-Connection Control and Hydraulic Research-2005

## PART 2 PRODUCTS

### 2.1 GENERAL

- A. All devices and equipment shall be Underwriter Laboratories Inc. listed for their intended purpose. All sprinklers shall be UL listed and Factory Mutual approved.

### 2.2 PIPING & FITTINGS

- A. Piping all sizes shall be schedule 40 with threaded or flanged fittings, ANSIB1 6.3 cast iron, Class 125 minimum. Threaded fittings are not permitted on pipe with wall thickness less than schedule 40.
- B. Piping 2" size and larger sprinkler piping downstream of the system isolation valves on wet-pipe systems may be black steel, schedule 10 minimum with mechanical roll grooved fittings.
- C. Piping materials Standards:
  - 1. Ferrous piping – follow ASTM A-795 Standard
  - 2. Welded and seamless steel pipe – follow ANSI/ASTM A 53
  - 3. Wrought steel pipe – follow ANSI/ASME B36-10M
  - 4. Electrical resistance welded steel pipe – follow ASTM A 135
- D. Fitting Material Standards:
  - 1. Cast iron threaded fitting, Class 125 and 250 – follow ASME B16.4
  - 2. Cast iron pipe flanges and flanged fittings – follow ASME B16.1
  - 3. Malleable iron threaded fittings, Class 150 and 300 steel – follow ASME B16.3
  - 4. Factory made wrought steel butt-weld fittings – follow ASME B16.9
  - 5. Buttwelding ends for pipe, valves, flanges and fittings – follow ASME B16.25

### 2.3 VALVES

- A. Valves in accordance with NFPA 13.

## **2.4 SPRINKLERS**

- A. All sprinklers shall be UL listed and FM approved. Provide quick response sprinklers in all areas, except where specifically prohibited by their listing or approval.
- B. Temperature Ratings: In accordance with NFPA 13.

## **2.5 PIPE HANGERS AND SUPPORTS**

- A. Supports, hangers, etc., of an approved pattern placement to conform to NFPA 13. System piping shall be substantially supported to the building structure. The installation of hangers and supports shall adhere to the requirements set forth in NFPA 13, Standard for Installation of Sprinkler Systems. Materials used in the installation or construction of hangers and supports shall be listed and approved for such application. Hangers or supports not specifically listed for service shall be designed and bear the seal of a professional engineer.

## **2.6 WALL PLATES**

- A. Provide chrome plated steel escutcheon plates for exposed piping passing through walls.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Installation shall be accomplished by the licensed fire suppression contractor. Provide a qualified technician, experienced in the installation and operation of the type of system being installed, to supervise the installation and testing of the system.
- B. Installation of Piping: Accurately cut pipe to measurements established by the installer and work into place without springing or forcing. In any situation where bending of the pipe is required, use a standard pipe-bending template. Install concealed piping in spaces that have finished ceilings. Where ceiling mounted equipment exists, such as in operating and radiology rooms, install sprinklers so as not to obstruct the movement or operation of the equipment. Sidewall heads may need to be utilized. Locate piping in stairways as near to the ceiling as possible to prevent tampering by unauthorized personnel, and to provide a minimum headroom clearance of 2250 mm (seven feet six inches). To prevent an obstruction to egress, provide piping clearances in accordance with NFPA 101.
- C. Welding: Conform to the requirements and recommendations of NFPA 13.
- D. Affix cutout disks, which are created by cutting holes in the walls of pipe for flow switches and non-threaded pipe connections to the respective waterflow switch or pipe connection near to the pipe from where they were cut.
- E. Sleeves: Provide for pipes passing through masonry or concrete. Provide space between the pipe and the sleeve in accordance with NFPA 13. Seal this space with a UL Listed through penetration fire stop material in accordance with Section 07 84 00, FIRESTOPPING. Where core drilling is used in lieu of sleeves, also seal space. Seal penetrations of walls, floors and ceilings of other types of construction, in accordance with Section 07 84 00, FIRESTOPPING.
- F. Firestopping shall comply with Section 07 84 00, FIRESTOPPING.

- G. Repairs: Repair damage to the building or equipment resulting from the installation of the sprinkler system by the installer at no additional expense to the Government.
- H. Interruption of Service: There shall be no interruption of the existing sprinkler protection, water, electric, or fire alarm services without prior permission of the Contracting Officer. Contractor shall develop an interim fire protection program where interruptions involve in occupied spaces. Request in writing at least one week prior to the planned interruption.

### **3.2 INSPECTION AND TEST**

- A. Preliminary Testing: Flush newly installed systems prior to performing hydrostatic tests in order to remove any debris which may have been left as well as ensuring piping is unobstructed. Hydrostatically test system, including the fire department connections, as specified in NFPA 13, in the presence of the COR or his designated representative. Test and flush underground water line prior to performing these hydrostatic tests.
- B. Final Inspection and Testing: Subject system to tests in accordance with NFPA 13, and when all necessary corrections have been accomplished, advise COR to schedule a final inspection and test. Connection to the fire alarm system shall have been in service for at least ten days prior to the final inspection, with adjustments made to prevent false alarms. Furnish all instruments, labor and materials required for the tests and provide the services of the installation foreman or other competent representative of the installer to perform the tests. Correct deficiencies and retest system as necessary, prior to the final acceptance. Include the operation of all features of the systems under normal operations in test.

### **3.3 INSTRUCTIONS**

- A. Furnish the services of a competent instructor for not less than two hours for instructing personnel in the operation and maintenance of the system, on the dates requested by the COR.

--- E N D ---

**SECTION 23 05 11**  
**COMMON WORK RESULTS FOR HVAC**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. The requirements of this Section apply to all sections of Division 23.
- B. Definitions:
  - 1. Exposed: Piping, ductwork, and equipment exposed to view in finished rooms.
  - 2. Option or optional: Contractor's choice of an alternate material or method.
  - 3. COR: Contracting Officer's Representative.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES
- C. Section 07 84 00, FIRESTOPPING
- D. Section 23 81 00, DECENTRALIZED UNITARY HVAC EQUIPMENT
- E. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS

**1.3 QUALITY ASSURANCE**

- A. Mechanical, electrical and associated systems shall be safe, reliable, efficient, durable, easily and safely operable and maintainable, easily and safely accessible, and in compliance with applicable codes as specified. The systems shall be comprised of high quality institutional-class and industrial-class products of manufacturers that are experienced specialists in the required product lines. All construction firms and personnel shall be experienced and qualified specialists in industrial and institutional HVAC.
- B. Equipment Vibration Tolerance:
  - 1. Equipment shall be factory-balanced to this tolerance and re-balanced on site, as necessary.
- C. Products Criteria:
  - 1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture of the products for at least 3 years (or longer as specified elsewhere). The design, model and size of each item shall have been in satisfactory and efficient operation on at least three installations for approximately three years. However, digital electronics devices, software and systems such as controls, instruments, computer work station, shall be the current generation of technology and basic design that has a proven satisfactory service record of at least three years. See other specification sections for any exceptions and/or additional requirements.
  - 2. All items furnished shall be free from defects that would adversely affect the performance, maintainability and appearance of individual components and overall assembly.
  - 3. Conform to codes and standards as required by the specifications. Conform to local codes, if required by local authorities such as the natural gas supplier, if the local codes are more

- stringent than those specified. Refer any conflicts to the Contracting Officer's Representative (COR).
4. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be products of one manufacturer.
  5. Assembled Units: Manufacturers of equipment assemblies, which use components made by others, assume complete responsibility for the final assembled product.
  6. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
  7. Asbestos products or equipment or materials containing asbestos shall not be used.
- D. Equipment Service Organizations:
1. HVAC: Products and systems shall be supported by service organizations that maintain a complete inventory of repair parts and are located within 50 miles to the site.
- E. HVAC Mechanical Systems Welding: Before any welding is performed, contractor shall submit a certificate certifying that welders comply with the following requirements:
1. Qualify welding processes and operators for piping according to ASME "Boiler and Pressure Vessel Code", Section IX, "Welding and Brazing Qualifications".
  2. Comply with provisions of ASME B31 series "Code for Pressure Piping".
  3. Certify that each welder has passed American Welding Society (AWS) qualification tests for the welding processes involved, and that certification is current.
- F. Execution (Installation, Construction) Quality:
1. Apply and install all items in accordance with manufacturer's written instructions. Refer conflicts between the manufacturer's instructions and the contract drawings and specifications to the COR for resolution. Provide written hard copies or computer files of manufacturer's installation instructions to the COR at least two weeks prior to commencing installation of any item. Installation of the item will not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations is a cause for rejection of the material.
  2. Provide complete layout drawings required by Paragraph, SUBMITTALS. Do not commence construction work on any system until the layout drawings have been approved.
- G. Upon request by Government, provide lists of previous installations for selected items of equipment. Include contact persons who will serve as references, with telephone numbers and e-mail addresses.

#### **1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, and with requirements in the individual specification sections.

- B. Contractor shall make all necessary field measurements and investigations to assure that the equipment and assemblies will meet contract requirements.
- C. If equipment is submitted which differs in arrangement from that shown, provide drawings that show the rearrangement of all associated systems. Approval will be given only if all features of the equipment and associated systems, including accessibility, are equivalent to that required by the contract.
- D. Prior to submitting shop drawings for approval, contractor shall certify in writing that manufacturers of all major items of equipment have each reviewed drawings and specifications, and have jointly coordinated and properly integrated their equipment and controls to provide a complete and efficient installation.
- E. Submittals and shop drawings for interdependent items, containing applicable descriptive information, shall be furnished together and complete in a group. Coordinate and properly integrate materials and equipment in each group to provide a completely compatible and efficient installation.
- F. Samples: Samples will not be required, except where materials offered differ from specification requirements. Samples shall be accompanied by full description of characteristics different from specification. The Government, at the Government's expense, will perform evaluation and testing if necessary. The Contractor may submit samples of additional material at the Contractor's option; however, if additional samples of materials are submitted later, pursuant to Government request, adjustment in contract price and time will be made as provided in the GENERAL CONDITIONS.
- G. Mock-ups: Mock-ups are required for critical items and typical component installations replicated numerous times throughout the project as directed by the COR. The COR and Medical Center Representatives shall review and approve the mock-up prior to installation of additional applicable components.
- H. Manufacturer's Literature and Data: Submit under the pertinent section rather than under this section.
  - 1. Equipment and materials identification.
  - 2. Fire-stopping materials.
  - 3. Hangers, inserts, supports and bracing. Provide load calculations for variable spring and constant support hangers.
  - 4. Wall, floor, and ceiling plates.
- I. HVAC Maintenance Data and Operating Instructions:
  - 1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment.

2. Provide a listing of recommended replacement parts for keeping in stock supply, including sources of supply, for equipment. Include in the listing belts for equipment: Belt manufacturer, model number, size and style, and distinguished whether of multiple belt sets.

### 1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Conditioning, Heating and Refrigeration Institute (AHRI):  
430-2009 ..... Central Station Air-Handling Units
- C. American National Standard Institute (ANSI):  
B31.1-2007 ..... Power Piping
- D. Rubber Manufacturers Association (ANSI/RMA):  
IP-20-2007 ..... Specifications for Drives Using Classical V-Belts and Sheaves  
IP-21-2009 ..... Specifications for Drives Using Double-V (Hexagonal) Belts  
IP-22-2007 ..... Specifications for Drives Using Narrow V-Belts and Sheaves
- E. Air Movement and Control Association (AMCA):  
410-96 ..... Recommended Safety Practices for Air Moving Devices
- F. American Society of Mechanical Engineers (ASME):  
Boiler and Pressure Vessel Code (BPVC):  
Section I-2007 ..... Power Boilers  
Section IX-2007 ..... Welding and Brazing Qualifications  
Code for Pressure Piping:  
B31.1-2007 ..... Power Piping
- G. American Society for Testing and Materials (ASTM):  
A36/A36M-08 ..... Standard Specification for Carbon Structural Steel  
A575-96(2007) ..... Standard Specification for Steel Bars, Carbon, Merchant Quality,  
M-Grades  
E84-10 ..... Standard Test Method for Surface Burning Characteristics of  
Building Materials  
E119-09c ..... Standard Test Methods for Fire Tests of Building Construction  
and Materials
- H. Manufacturers Standardization Society (MSS) of the Valve and Fittings Industry, Inc:  
SP-58-2009 ..... Pipe Hangers and Supports-Materials, Design and Manufacture,  
Selection, Application, and Installation  
SP 69-2003 ..... Pipe Hangers and Supports-Selection and Application  
SP 127-2001 ..... Bracing for Piping Systems, Seismic – Wind – Dynamic, Design,  
Selection, Application
- I. National Electrical Manufacturers Association (NEMA):

MG-1-2009.....Motors and Generators

J. National Fire Protection Association (NFPA):

31-06 .....Standard for Installation of Oil-Burning Equipment

54-09 .....National Fuel Gas Code

70-08 .....National Electrical Code

85-07 .....Boiler and Combustion Systems Hazards Code

90A-09.....Standard for the Installation of Air Conditioning and Ventilating  
Systems

101-09 .....Life Safety Code

**1.6 DELIVERY, STORAGE AND HANDLING**

A. Protection of Equipment:

1. Equipment and material placed on the job site shall remain in the custody of the Contractor until phased acceptance, whether or not the Government has reimbursed the Contractor for the equipment and material. The Contractor is solely responsible for the protection of such equipment and material against any damage.
2. Place damaged equipment in first class, new operating condition; or, replace same as determined and directed by the COR. Such repair or replacement shall be at no additional cost to the Government.
3. Protect interiors of new equipment and piping systems against entry of foreign matter. Clean both inside and outside before painting or placing equipment in operation.
4. Existing equipment and piping being worked on by the Contractor shall be under the custody and responsibility of the Contractor and shall be protected as required for new work.

B. Cleanliness of Piping and Equipment Systems:

1. Exercise care in storage and handling of equipment and piping material to be incorporated in the work. Remove debris arising from cutting, threading and welding of piping.
2. Piping systems shall be flushed, blown or pigged as necessary to deliver clean systems.
3. Contractor shall be fully responsible for all costs, damage, and delay arising from failure to provide clean systems.

**1.7 JOB CONDITIONS – WORK IN EXISTING BUILDING**

- A. Building Operation: Government employees will be continuously operating and managing all facilities, including temporary facilities, that serve the medical center.
- B. Maintenance of Service: Schedule all work to permit continuous service as required by the medical center.
- C. Phasing of Work: Comply with all requirements shown on drawings or specified.
- D. Building Working Environment: Maintain the architectural and structural integrity of the building and the working environment at all times. Maintain the interior of building at 18 degrees C (65 degrees F) minimum. Limit the opening of doors, windows or other access openings to brief

periods as necessary for rigging purposes. No storm water or ground water leakage permitted. Provide daily clean-up of construction and demolition debris on all floor surfaces and on all equipment being operated by VA.

- E. Acceptance of Work for Government Operation: As new facilities are made available for operation and these facilities are of beneficial use to the Government, inspections will be made and tests will be performed. Based on the inspections, a list of contract deficiencies will be issued to the Contractor. After correction of deficiencies as necessary for beneficial use, the Contracting Officer will process necessary acceptance and the equipment will then be under the control and operation of Government personnel.

## **PART 2 - PRODUCTS**

### **2.1 FACTORY-ASSEMBLED PRODUCTS**

- A. Provide maximum standardization of components to reduce spare part requirements.
- B. Manufacturers of equipment assemblies that include components made by others shall assume complete responsibility for final assembled unit.
  - 1. All components of an assembled unit need not be products of same manufacturer.
  - 2. Constituent parts that are alike shall be products of a single manufacturer.
  - 3. Components shall be compatible with each other and with the total assembly for intended service.
  - 4. Contractor shall guarantee performance of assemblies of components, and shall repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly.
- C. Components of equipment shall bear manufacturer's name and trademark, model number, serial number and performance data on a name plate securely affixed in a conspicuous place, or cast integral with, stamped or otherwise permanently marked upon the components of the equipment.
- D. Major items of equipment, which serve the same function, must be the same make and model. Exceptions will be permitted if performance requirements cannot be met.

### **2.2 COMPATIBILITY OF RELATED EQUIPMENT**

Equipment and materials installed shall be compatible in all respects with other items being furnished and with existing items so that the result will be a complete and fully operational plant that conforms to contract requirements.

### **2.3 EQUIPMENT AND MATERIALS IDENTIFICATION**

- A. Use symbols, nomenclature and equipment numbers specified, shown on the drawings and shown in the maintenance manuals.
- B. Interior (Indoor) Equipment: Engraved nameplates, with letters not less than 48 mm (3/16-inch) high of brass with black-filled letters, or rigid black plastic with white letters permanently fastened to the equipment.

- C. Exterior (Outdoor) Equipment: Brass nameplates, with engraved black filled letters, not less than 48 mm (3/16-inch) high riveted or bolted to the equipment.

## **2.4 FIRESTOPPING**

Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping and ductwork. Refer to Section 23 07 11, HVAC AND BOILER PLANT INSULATION, for firestop pipe and duct insulation.

## **2.5 GALVANIZED REPAIR COMPOUND**

Mil. Spec. DOD-P-21035B, paint form.

## **2.6 HVAC PIPE AND EQUIPMENT SUPPORTS AND RESTRAINTS**

- A. Supports for Roof Mounted Items:
  - 1. Equipment: Equipment rails shall be galvanized steel, minimum 1.3 mm (18 gauge), with integral baseplate, continuous welded corner seams, factory installed 50 mm by 100 mm (2 by 4) treated wood nailer, 1.3 mm (18 gauge) galvanized steel counter flashing cap with screws, built-in cant strip, (except for gypsum or tectum deck), minimum height 280 mm (11 inches). For surface insulated roof deck, provide raised cant strip to start at the upper surface of the insulation.
  - 2. Pipe/duct pedestals: Provide a galvanized Unistrut channel welded to U-shaped mounting brackets which are secured to side of rail with galvanized lag bolts.
- B. Pipe Supports: Comply with MSS SP-58. Type Numbers specified refer to this standard. For selection and application comply with MSS SP-69.
- C. Attachment to Concrete Building Construction:
  - 1. Concrete insert: MSS SP-58, Type 18.
  - 2. Self-drilling expansion shields and machine bolt expansion anchors: Permitted in concrete not less than 102 mm (four inches) thick when approved by the COR for each job condition.
  - 3. Power-driven fasteners: Not permitted.
- D. Attachment to Steel Building Construction:
  - 1. Welded attachment: MSS SP-58, Type 22.
  - 2. Beam clamps: MSS SP-58, Types 20, 21, 28 or 29. Type 23 C-clamp may be used for individual copper tubing up to 23mm (7/8-inch) outside diameter.
- E. Attachment to existing structure: Support from existing floor/roof frame.
- F. Attachment to Wood Construction: Wood screws or lag bolts.
- G. Hanger Rods: Hot-rolled steel, ASTM A36 or A575 for allowable load listed in MSS SP-58. For piping, provide adjustment means for controlling level or slope. Types 13 or 15 turn-buckles shall provide 38 mm (1-1/2 inches) minimum of adjustment and incorporate locknuts. All-thread rods are acceptable.
- H. Hangers Supporting Multiple Pipes (Trapeze Hangers): Galvanized, cold formed, lipped steel channel horizontal member, not less than 41 mm by 41 mm (1-5/8 inches by 1-5/8 inches), 2.7

mm (No. 12 gage), designed to accept special spring held, hardened steel nuts. Not permitted for steam supply and condensate piping.

1. Allowable hanger load: Manufacturers rating less 91kg (200 pounds).
  2. Guide individual pipes on the horizontal member of every other trapeze hanger with 6 mm (1/4-inch) U-bolt fabricated from steel rod. Provide Type 40 insulation shield, secured by two 13mm (1/2-inch) galvanized steel bands, or preinsulated calcium silicate shield for insulated piping at each hanger.
- I. Supports for Piping Systems:
1. Select hangers sized to encircle insulation on insulated piping. To protect insulation, provide Type 39 saddles for roller type supports or preinsulated calcium silicate shields. Provide Type 40 insulation shield or preinsulated calcium silicate shield at all other types of supports and hangers including those for preinsulated piping.
  2. Piping Systems except High and Medium Pressure Steam (MSS SP-58):
    - a. Standard clevis hanger: Type 1; provide locknut.
    - b. Riser clamps: Type 8.
    - c. Wall brackets: Types 31, 32 or 33.
    - d. Roller supports: Type 41, 43, 44 and 46.
    - e. Saddle support: Type 36, 37 or 38.
    - f. Turnbuckle: Types 13 or 15. Preinsulate.
    - g. U-bolt clamp: Type 24.
    - h. Copper Tube:
      - 1) Hangers, clamps and other support material in contact with tubing shall be painted with copper colored epoxy paint, plastic coated or taped with non adhesive isolation tape to prevent electrolysis.
      - 2) For vertical runs use epoxy painted or plastic coated riser clamps.
      - 3) For supporting tube to strut: Provide epoxy painted pipe straps for copper tube or plastic inserted vibration isolation clamps.
      - 4) Insulated Lines: Provide pre-insulated calcium silicate shields sized for copper tube.

## 2.7 PIPE PENETRATIONS

- A. Install sleeves during construction.
- B. Penetrations are not allowed through beams or ribs, but may be installed in concrete beam flanges. Any deviation from these requirements must receive prior approval of COR.
- C. Sheet Metal, Plastic, or Moisture-resistant Fiber Sleeves: Provide for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.
- D. Cast Iron or Zinc Coated Pipe Sleeves: Provide for pipe passing through exterior walls below grade. Make space between sleeve and pipe watertight with a modular or link rubber seal. Seal shall be applied at both ends of sleeve.

- E. Galvanized Steel or an alternate Black Iron Pipe with asphalt coating Sleeves: Provide for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. Provide sleeve for pipe passing through floor of mechanical rooms. Except in mechanical rooms, connect sleeve with floor plate.
- F. Brass Pipe Sleeves: Provide for pipe passing through quarry tile, terrazzo or ceramic tile floors. Connect sleeve with floor plate.
- G. Sleeves are not required for wall hydrants for fire department connections or in drywall construction.
- H. Sleeve Clearance: Sleeve through floors, walls, partitions, and beam flanges shall be one inch greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation. Interior openings shall be caulked tight with fire stopping material and sealant to prevent the spread of fire, smoke, and gases.

## **2.8 DUCT PENETRATIONS**

- A. Provide curbs for roof mounted piping, ductwork and equipment. Curbs shall be 18 inches high with continuously welded seams, built-in cant strip, interior baffle with acoustic insulation, curb bottom, hinged curb adapter.
- B. Provide firestopping for openings through fire and smoke barriers, maintaining minimum required rating of floor, ceiling or wall assembly. See section 07 84 00, FIRESTOPPING.

## **2.9 SPECIAL TOOLS AND LUBRICANTS**

- A. Furnish, and turn over to the COR, tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.
- B. Grease Guns with Attachments for Applicable Fittings: One for each type of grease required for each motor or other equipment.
- C. Refrigerant Tools: Provide system charging/Evacuation equipment, gauges, fittings, and tools required for maintenance of furnished equipment.
- D. Tool Containers: Hardwood or metal, permanently identified for intended service and mounted, or located, where directed by the COR.
- E. Lubricants: A minimum of 0.95 L (one quart) of oil, and 0.45 kg (one pound) of grease, of equipment manufacturer's recommended grade and type, in unopened containers and properly identified as to use for each different application.

## **2.10 WALL, FLOOR AND CEILING PLATES**

- A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.
- B. Thickness: Not less than 2.4 mm (3/32-inch) for floor plates. For wall and ceiling plates, not less than 0.64 mm (0.025-inch) for up to 80 mm (3-inch pipe), 0.89 mm (0.035-inch) for larger pipe.

- C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Provide a watertight joint in spaces where brass or steel pipe sleeves are specified.

## **2.11 ASBESTOS**

Materials containing asbestos are not permitted.

## **PART 3 - EXECUTION**

### **3.1 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING**

- A. Coordinate location of piping, sleeves, inserts, hangers, ductwork and equipment. Locate piping, sleeves, inserts, hangers, ductwork and equipment clear of windows, doors, openings, light outlets, and other services and utilities. Follow manufacturer's published recommendations for installation methods not otherwise specified.
- B. Operating Personnel Access and Observation Provisions: Select and arrange all equipment and systems to provide clear view and easy access, without use of portable ladders, for maintenance and operation of all devices including, but not limited to: all equipment items, valves, filters, strainers, transmitters, sensors, control devices. All gages and indicators shall be clearly visible by personnel standing on the floor or on permanent platforms. Do not reduce or change maintenance and operating space and access provisions that are shown on the drawings.
- C. Equipment and Piping Support: Coordinate structural systems necessary for pipe and equipment support with pipe and equipment locations to permit proper installation.
- D. Location of pipe sleeves, trenches and chases shall be accurately coordinated with equipment and piping locations.
- E. Cutting Holes:
  - 1. Cut holes through concrete and masonry by rotary core drill. Pneumatic hammer, impact electric, and hand or manual hammer type drill will not be allowed, except as permitted by COR where working area space is limited.
  - 2. Locate holes to avoid interference with structural members such as beams or grade beams. Holes shall be laid out in advance and drilling done only after approval by COR. If the Contractor considers it necessary to drill through structural members, this matter shall be referred to COR for approval.
  - 3. Do not penetrate membrane waterproofing.
- F. Interconnection of Instrumentation or Control Devices: Generally, electrical and pneumatic interconnections are not shown but must be provided.
- G. Minor Piping: Generally, small diameter pipe runs from drips and drains, water cooling, and other service are not shown but must be provided.
- H. Electrical and Pneumatic Interconnection of Controls and Instruments: This generally not shown but must be provided. This includes interconnections of sensors, transmitters, transducers, control devices, control and instrumentation panels, instruments and computer workstations. Comply with NFPA-70.

- I. Protection and Cleaning:
  - 1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the COR. Damaged or defective items in the opinion of the COR, shall be replaced.
  - 2. Protect all finished parts of equipment, such as shafts and bearings where accessible, from rust prior to operation by means of protective grease coating and wrapping. Close pipe openings with caps or plugs during installation. Tightly cover and protect fixtures and equipment against dirt, water chemical, or mechanical injury. At completion of all work thoroughly clean fixtures, exposed materials and equipment.
- J. Install gages, thermometers, valves and other devices with due regard for ease in reading or operating and maintaining said devices. Locate and position thermometers and gages to be easily read by operator or staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.
- K. Work in Existing Building:
  - 1. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).
  - 2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will least interfere with normal operation of the facility.
  - 3. Cut required openings through existing masonry and reinforced concrete using diamond core drills. Use of pneumatic hammer type drills, impact type electric drills, and hand or manual hammer type drills, will be permitted only with approval of the COR. Locate openings that will least effect structural slabs, columns, ribs or beams. Refer to the COR for determination of proper design for openings through structural sections and opening layouts approval, prior to cutting or drilling into structure. After COR's approval, carefully cut opening through construction no larger than absolutely necessary for the required installation.
- L. Switchgear/Electrical Equipment Drip Protection: Every effort shall be made to eliminate the installation of pipe above electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints. Installation of piping, ductwork, leak protection apparatus or other installations foreign to the electrical installation shall not be located in the space equal to the width and depth of the equipment and extending from the floor to a height of 1.8 m (6 ft.) above the equipment or to structural ceiling, whichever is lower (NFPA 70).

M. Inaccessible Equipment:

1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost to the Government.
2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as motors, fans, pumps, belt guards, transformers, high voltage lines, piping, and ductwork.

**3.2 PIPE AND EQUIPMENT SUPPORTS**

- A. Where hanger spacing does not correspond with joist or rib spacing, use structural steel channels secured directly to joist and rib structure that will correspond to the required hanger spacing, and then suspend the equipment and piping from the channels. Drill or burn holes in structural steel only with the prior approval of the COR.
- B. Use of chain, wire or strap hangers; wood for blocking, stays and bracing; or, hangers suspended from piping above will not be permitted. Replace or thoroughly clean rusty products and paint with zinc primer.
- C. Use hanger rods that are straight and vertical. Turnbuckles for vertical adjustments may be omitted where limited space prevents use. Provide a minimum of 15 mm (1/2-inch) clearance between pipe or piping covering and adjacent work.
- D. HVAC Horizontal Pipe Support Spacing: Refer to MSS SP-69. Provide additional supports at valves, strainers, in-line pumps and other heavy components. Provide a support within one foot of each elbow.
- E. HVAC Vertical Pipe Supports:
1. Up to 150 mm (6-inch pipe), 9 m (30 feet) long, bolt riser clamps to the pipe below couplings, or welded to the pipe and rest supports securely on the building structure.
  2. Vertical pipe larger than the foregoing, support on base elbows or tees, or substantial pipe legs extending to the building structure.
- F. Overhead Supports:
1. The basic structural system of the building is designed to sustain the loads imposed by equipment and piping to be supported overhead.
  2. Provide steel structural members, in addition to those shown, of adequate capability to support the imposed loads, located in accordance with the final approved layout of equipment and piping.
  3. Tubing and capillary systems shall be supported in channel troughs.
- G. Floor Supports:
1. Provide concrete bases, concrete anchor blocks and pedestals, and structural steel systems for support of equipment and piping. Anchor and dowel concrete bases and structural

systems to resist forces under operating and seismic conditions (if applicable) without excessive displacement or structural failure.

2. Do not locate or install bases and supports until equipment mounted thereon has been approved. Size bases to match equipment mounted thereon plus 50 mm (2 inch) excess on all edges. Refer to structural drawings. Bases shall be neatly finished and smoothed, shall have chamfered edges at the top, and shall be suitable for painting.
3. All equipment shall be shimmed, leveled, firmly anchored, and grouted with epoxy grout. Anchor bolts shall be placed in sleeves, anchored to the bases. Fill the annular space between sleeves and bolts with a granular material to permit alignment and realignment.

### **3.3 CLEANING AND PAINTING**

- A. Prior to final inspection and acceptance of the facilities for beneficial use by the Government, the facilities, equipment and systems shall be thoroughly cleaned.
- B. In addition, the following special conditions apply:
  1. Cleaning shall be thorough. Use solvents, cleaning materials and methods recommended by the manufacturers for the specific tasks. Remove all rust prior to painting and from surfaces to remain unpainted. Repair scratches, scuffs, and abrasions prior to applying prime and finish coats.
  2. Final result shall be smooth, even-colored, even-textured factory finish on all items. Completely repaint the entire piece of equipment if necessary to achieve this.

### **3.4 IDENTIFICATION SIGNS**

- A. Provide laminated plastic signs, with engraved lettering not less than 5 mm (3/16-inch) high, designating functions, for all equipment, switches, motor controllers, relays, meters, control devices, including automatic control valves. Nomenclature and identification symbols shall correspond to that used in maintenance manual, and in diagrams specified elsewhere. Attach by chain, adhesive, or screws.
- B. Factory Built Equipment: Metal plate, securely attached, with name and address of manufacturer, serial number, model number, size, performance.

### **3.5 LUBRICATION**

- A. Lubricate all devices requiring lubrication prior to initial operation. Field-check all devices for proper lubrication.
- B. Equip all devices with required lubrication fittings or devices. Provide a minimum of one liter (one quart) of oil and 0.5 kg (one pound) of grease of manufacturer's recommended grade and type for each different application; also provide 12 grease sticks for lubricated plug valves. Deliver all materials to COR in unopened containers that are properly identified as to application.
- C. Provide a separate grease gun with attachments for applicable fittings for each type of grease applied.

- D. All lubrication points shall be accessible without disassembling equipment, except to remove access plates.

**3.6 STARTUP**

Start up equipment as described in equipment specifications. Verify that vibration is within specified tolerance prior to extended operation.

**3.7 OPERATING AND PERFORMANCE TESTS**

- A. Prior to the final inspection, perform required tests as specified in Section 01 00 00, GENERAL REQUIREMENTS and submit the test reports and records to the COR.
- B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.
- C. When completion of certain work or system occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then make performance tests for heating systems and for cooling systems respectively during first actual seasonal use of respective systems following completion of work.

**3.8 INSTRUCTIONS TO VA PERSONNEL**

Provide in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.

--- E N D ---

**SECTION 23 81 00**  
**DECENTRALIZED UNITARY HVAC EQUIPMENT**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies split-system heat pumps.
- B. Definitions:
  - 1. Energy Efficiency Ratio (EER): The ratio of net cooling capacity in Btu/h to total rate of electricity input in watts under designated operating conditions (Btu hour/Watt).
  - 2. Seasonal Energy Efficiency Ratio (SEER): The ratio of the total cooling output of an air conditioner during its normal annual usage period for cooling in Btu/h divided by total electric energy input in watts during the same period (Btu hour/Watt).
  - 3. Unitary: A Unitary Air Conditioner consists of one or more factory-made assemblies which normally include an evaporator or cooling coil, a compressor and condenser combination, and may include a heating function as well.
  - 4. Where such equipment is provided in more than one assembly the separated assemblies are to be designed to be used together and the requirements of rating are based upon use of matched assemblies.

**1.2 RELATED WORK**

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC: General mechanical requirements and items, which are common to more than one section of Division 23.

**1.3 QUALITY ASSURANCE**

- A. Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Safety Standards: ASHRAE Standard 15, Safety Code for Mechanical Refrigeration.

**1.4 SUBMITTALS**

- A. Submit in accordance with specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES
- B. Manufacturer's literature and data:
  - 1. Sufficient information, including capacities, pressure drops and piping connections clearly presented, shall be included to determine compliance with drawings and specifications for units noted below:
    - a. Unitary air conditioners:
      - 1) Split systems
  - 2. Unit Dimensions required clearances, operating weights accessories and start-up instructions.
  - 3. Electrical requirements, wiring diagrams, interlocking and control wiring showing factory installed and portions to be field installed.

- 4. Mounting and flashing of the roof curb to the roofing structure with coordinating requirements for the roof membrane system.
- C. Certification: Submit proof of specified ARI Certification.
- D. Performance Rating: Submit catalog selection data showing equipment ratings and compliance with required sensible-to-total-heat-ratio, energy efficiency ratio (EER), and coefficient of performance (COP).
- E. Operating and Maintenance Manual: Submit three copies of Operating and Maintenance manual to COR three weeks prior to final inspection.

**1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Federal Specifications (Fed. Spec.):  
A-A-50502-90.....Air conditioner (Unitary Heat Pump) Air to Air (3000-300,000 Btu)
- C. Military Specifications (Mil. Specs.):  
MIL-PRF-26915D-06.....Primer Coating, for Steel Surfaces
- D. Air-Conditioning, Heating, and Refrigeration Institute (AHRI):  
210/240-08.....Performance Rating of Unitary Air-Conditioning and Air-Source Heat Pump Equipment  
270-08.....Sound Rating of Outdoor Unitary Equipment  
310/380-04.....Standard for Packaged Terminal Air-Conditioners and Heat Pumps (CSA-C744-04)  
340/360-07.....Performance Rating of Commercial and Industrial Unitary Air-Conditioning and Heat Pump Equipment  
520-04.....Performance Rating of Positive Displacement Condensing Units
- E. Air Movement and Control Association (AMCA):  
210-07.....Laboratory Methods of Testing Fans for Aerodynamic Performance Rating (ANSI)  
410-96.....Recommended Safety Practices for Users and Installers of Industrial and Commercial Fans
- F. American National Standards Institute (ANSI):  
S12.51-02(R2007).....Acoustics - Determination of Sound Power Levels of Noise Sources Using Sound Pressure - Precision Method for Reverberation Rooms (same as ISO 3741:1999)
- G. American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE):  
2008 Handbook.....HVAC Systems and Equipment  
15-10.....Safety Standard for Refrigeration Systems (ANSI)

- H. American Society of Testing and Materials (ASTM):  
B117-09.....Standard Practice for Operating Salt Spray (Fog) Apparatus
- I. American Society of Civil Engineers (ASCE)  
ASCE 7-10 .....Minimum Design Loads for Buildings and Other Structures
- J. National Electrical Manufacturer's Association (NEMA):  
MG 1-09 (R2010) .....Motors and Generators (ANSI)  
ICS 1-00 (R2005, R2008) ..... Industrial Controls and Systems: General Requirements
- K. National Fire Protection Association (NFPA) Publications:  
90A-09.....Standard for the Installation of Air-Conditioning and Ventilating  
Systems

## **PART 2 - PRODUCTS**

### **2.1 UNITARY AIR CONDITIONERS - GENERAL**

- A. Applicable ARI Standards:
  - 1. Cooling Capacity 39.6 kW (135,000 Btu/h) and More: AHRI 340/ 360.
  - 2. Cooling Capacity Less Than 39.6 kW (135,000 Btu/h): AHRI 210/240. Units shall be listed in the ARI Directory of Certified Unitary Air-Conditioners.
- B. Performance Rating: Cooling capacity of units shall meet the sensible heat and total heat requirements shown in the contract documents. In selecting unit size, make true allowance for "sensible to total heat ratio" to satisfy required sensible cooling capacity.
- C. Machinery Guards: Provide guards as shown in AMCA 410 for belts, chains, couplings, pulleys, sheaves, shafts, gears and other moving parts regardless of height above the floor. Drive guards may be excluded where motors and drives are inside factory fabricated casings.

### **2.2 SPLIT-SYSTEM HEAT PUMP AIR CONDITIONERS**

- A. Description: Factory assembled and tested, wall-mounted unit, with an air-cooled remote condensing unit, and field-installed refrigeration piping.
- B. Wall-Mounting, Evaporator-Fan Components:
  - 1. Cabinet: Enameled steel with removable panels on front and ends in color selected by VA, and discharge drain pans with drain connection.
  - 2. Airstream Surfaces: Surfaces in contact with the airstream shall comply with requirements in ASHRAE 62.1-2007.
  - 3. Drain Pan and Drain Connection: Comply with ASHRAE 62.1-2007.
  - 4. Refrigerant Coil: Copper tube, with mechanically bonded aluminum fins, complying with AHRI 210/240, and with thermal-expansion valve.
  - 5. Fan: Direct drive, centrifugal fan.
  - 6. Fan Motors: Comply with requirements in Division 26 specifications for multi-tapped, multi-speed motors with internal thermal protection and permanent lubrication.
  - 7. Filters: Disposable, with MERV rating of 7 or higher according to ASHRAE 52.2.

8. Accessories:
  - a. Condensate Pump
  - b. Wall Bracket
- C. Air-Cooled, Compressor-Condenser Components:
  1. Casing: Steel, finished with baked enamel in color selected by Architect, with removable panels for access to controls, weep holes for water drainage, and mounting holes in base. Service valves, fittings, and gage ports shall be brass and located outside of the casing.
  2. Compressor: Hermetically sealed inverter driven scroll with crankcase heater and mounted on vibration isolation. Compressor motor shall have thermal- and current-sensitive overload devices, start capacitor, relay, and contactor.
  3. Compressor motor with manual-reset, high-pressure switch and automatic-reset, low-pressure switch.
  4. Refrigerant: R-410A unless otherwise indicated.
  5. Refrigerant Coil: Copper tube, with mechanically bonded aluminum fins, complying with AHRI 210/240, and with liquid subcooler.
  6. Heat Pump Components: Reversing valve and low-temperature-air cut-off thermostat.
  7. Fan: Aluminum, propeller type, directly connected to motor.
  8. Motor: Permanently lubricated, with integral thermal-overload protection.
  9. Low Ambient Kit: Permit operation down to 7 deg C (45 deg F).
  10. Mounting Base: Polyethylene, wall bracket or roof curbs, as required.
  11. Minimum Energy Efficiency: Comply with ASHRAE/IESNA 90.1-2004, "Energy Standard for Buildings except Low-Rise Residential Buildings."

## **2.3 REFRIGERANT PIPING**

- A. Refrigerant piping shall be sized, selected, and designed either by the equipment manufacturer or in strict accordance with the manufacturer's published instructions.
- B. Provide refrigerant piping linesets per manufacturers recommendations.
- C. Insulate all refrigerant piping per manufacturer's recommendations.
- D. Apply two coats of weather-resistant finish as recommended by the manufacturer to insulation exposed to outdoor weather.

## **2.4 SPECIAL TOOLS**

- A. If any part of equipment furnished under these specifications requires a special tool for assembly, adjustment, setting, or maintenance and the tool is not readily available from the commercial tool market, furnish the necessary tools with equipment as a standard accessory.

## **PART 3 EXECUTION**

### **3.1 INSTALLATION**

- A. Install all wind restraints according to manufacturer's written instructions.

- B. Install units level and plumb maintaining manufacturer's recommended clearances and tolerances.
- C. Install ground-mounting, compressor-condenser components on polyethylene mounting base.
- D. Install roof-mounting compressor-condenser components on equipment support roof curbs.
- E. Install and anchor wall-mounting, compressor-condenser components on equipment support wall mounts anchored to wall per manufacturer's recommendations.
- F. Install and connect precharged refrigerant tubing to component's quick-connect fittings. Install tubing to allow access to unit.
- G. Install wall sleeves in finished wall assembly and weatherproof. Install and anchor wall sleeves to withstand, without damage seismic forces as required by code.

### **3.2 CONNECTIONS**

- A. Verify condensate drainage requirements.
- B. Install condensate drain, minimum connection size, with trap and indirect connection to nearest roof drain or area drain if not specifically shown on drawings.
- C. Install piping adjacent to units to allow service and maintenance.
- D. Ground equipment and install power wiring, switches, and controls for self contained and split systems.
- E. Connect refrigerant piping to coils with shutoff valves on the suction and liquid lines at the coil and a union or flange at each connection at the coil and condenser.
- F. Connect piping with shutoff duty valves on the supply and return side of the coil.

### **3.3 FIELD QUALITY CONTROL**

- A. Perform tests and inspections and prepare test reports.
- B. Tests and Inspections: After installing units and after electrical circuitry has been energized, test units for compliance with requirements. Inspect for and remove shipping bolts, blocks, and tie-down straps. After electrical circuitry has been energized, start units to confirm proper motor rotation and unit operation. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment. Remove and replace malfunctioning units and retest as specified above.

---END---

**SECTION 26 05 11  
REQUIREMENTS FOR ELECTRICAL INSTALLATIONS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section applies to all sections of Division 26.
- B. Furnish and install electrical systems, materials, equipment, and accessories in accordance with the specifications and drawings. Capacities and ratings of motors, transformers, conductors and cable, switchboards, panelboards, generators, automatic transfer switches, and other items and arrangements for the specified items are shown on the drawings.
- C. Conductor ampacities specified or shown on the drawings are based on copper conductors, with the conduit and raceways sized per NEC. Aluminum conductors are prohibited.

**1.2 MINIMUM REQUIREMENTS**

- A. The International Building Code (IBC), National Electrical Code (NEC), Underwriters Laboratories, Inc. (UL), and National Fire Protection Association (NFPA) codes and standards are the minimum requirements for materials and installation.
- B. The drawings and specifications shall govern in those instances where requirements are greater than those stated in the above codes and standards.

**1.3 TEST STANDARDS**

- A. All materials and equipment shall be listed, labeled, or certified by a Nationally Recognized Testing Laboratory (NRTL) to meet Underwriters Laboratories, Inc. (UL), standards where test standards have been established. Materials and equipment which are not covered by UL standards will be accepted, providing that materials and equipment are listed, labeled, certified or otherwise determined to meet the safety requirements of a NRTL. Materials and equipment which no NRTL accepts, certifies, lists, labels, or determines to be safe, will be considered if inspected or tested in accordance with national industrial standards, such as ANSI, NEMA, and NETA. Evidence of compliance shall include certified test reports and definitive shop drawings.
- B. Definitions:
  - 1. Listed: Materials and equipment included in a list published by an organization that is acceptable to the Authority Having Jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production or listed materials and equipment or periodic evaluation of services, and whose listing states that the materials and equipment either meets appropriate designated standards or has been tested and found suitable for a specified purpose.
  - 2. Labeled: Materials and equipment to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the Authority Having Jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled

materials and equipment, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

3. Certified: Materials and equipment which:
  - a. Have been tested and found by a NRTL to meet nationally recognized standards or to be safe for use in a specified manner.
  - b. Are periodically inspected by a NRTL.
  - c. Bear a label, tag, or other record of certification.
4. Nationally Recognized Testing Laboratory: Testing laboratory which is recognized and approved by the Secretary of Labor in accordance with OSHA regulations.

#### **1.4 QUALIFICATIONS (PRODUCTS AND SERVICES)**

- A. Manufacturer's Qualifications: The manufacturer shall regularly and currently produce, as one of the manufacturer's principal products, the materials and equipment specified for this project, and shall have manufactured the materials and equipment for at least three years.
- B. Product Qualification:
  1. Manufacturer's materials and equipment shall have been in satisfactory operation, on three installations of similar size and type as this project, for at least three years.
  2. The Government reserves the right to require the Contractor to submit a list of installations where the materials and equipment have been in operation before approval.
- C. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within four hours of receipt of notification that service is needed. Submit name and address of service organizations.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. Applicable publications listed in all Sections of Division 26 are the latest issue, unless otherwise noted.
- B. Products specified in all sections of Division 26 shall comply with the applicable publications listed in each section.

#### **1.6 MANUFACTURED PRODUCTS**

- A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, and for which replacement parts shall be available.
- B. When more than one unit of the same class or type of materials and equipment is required, such units shall be the product of a single manufacturer.
- C. Equipment Assemblies and Components:
  1. Components of an assembled unit need not be products of the same manufacturer.
  2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
  3. Components shall be compatible with each other and with the total assembly for the intended service.

4. Constituent parts which are similar shall be the product of a single manufacturer.
- D. Factory wiring and terminals shall be identified on the equipment being furnished and on all wiring diagrams.
- E. When Factory Testing Is Specified:
  1. The Government shall have the option of witnessing factory tests. The Contractor shall notify the Government through the COR a minimum of 15 working days prior to the manufacturer's performing the factory tests.
  2. Four copies of certified test reports shall be furnished to the COR two weeks prior to final inspection and not more than 90 days after completion of the tests.
  3. When materials and equipment fail factory tests, and re-testing and re-inspection is required, the Contractor shall be liable for all additional expenses for the Government to witness re-testing.

### **1.7 VARIATIONS FROM CONTRACT REQUIREMENTS**

- A. Where the Government or the Contractor requests variations from the contract requirements, the connecting work and related components shall include, but not be limited to additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.

### **1.8 MATERIALS AND EQUIPMENT PROTECTION**

- A. Materials and equipment shall be protected during shipment and storage against physical damage, vermin, dirt, corrosive substances, fumes, moisture, cold and rain.
  1. Store materials and equipment indoors in clean dry space with uniform temperature to prevent condensation.
  2. During installation, equipment shall be protected against entry of foreign matter, and be vacuum-cleaned both inside and outside before testing and operating. Compressed air shall not be used to clean equipment. Remove loose packing and flammable materials from inside equipment.
  3. Damaged equipment shall be repaired or replaced, as determined by the COR.
  4. Painted surfaces shall be protected with factory installed removable heavy kraft paper, sheet vinyl or equal.
  5. Damaged paint on equipment shall be refinished with the same quality of paint and workmanship as used by the manufacturer so repaired areas are not obvious.

### **1.9 WORK PERFORMANCE**

- A. All electrical work shall comply with the requirements of NFPA 70 (NEC), NFPA 70B, NFPA 70E, OSHA Part 1910 subpart J – General Environmental Controls, OSHA Part 1910 subpart K – Medical and First Aid, and OSHA Part 1910 subpart S – Electrical, in addition to other references required by contract.
- B. Job site safety and worker safety is the responsibility of the Contractor.

- C. Electrical work shall be accomplished with all affected circuits or equipment de-energized. When an electrical outage cannot be accomplished in this manner for the required work, the following requirements are mandatory:
  - 1. Electricians must use full protective equipment (i.e., certified and tested insulating material to cover exposed energized electrical components, certified and tested insulated tools, etc.) while working on energized systems in accordance with NFPA 70E.
  - 2. Before initiating any work, a job specific work plan must be developed by the Contractor with a peer review conducted and documented by the COR and Medical Center staff. The work plan must include procedures to be used on and near the live electrical equipment, barriers to be installed, safety equipment to be used, and exit pathways.
  - 3. Work on energized circuits or equipment cannot begin until prior written approval is obtained from the COR.
- D. For work that affects existing electrical systems, arrange, phase and perform work to assure minimal interference with normal functioning of the facility. Refer to Article OPERATIONS AND STORAGE AREAS under Section 01 00 00, GENERAL REQUIREMENTS.
- E. New work shall be installed and connected to existing work neatly, safely and professionally. Disturbed or damaged work shall be replaced or repaired to its prior conditions, as required by Section 01 00 00, GENERAL REQUIREMENTS.
- F. Coordinate location of equipment and conduit with other trades to minimize interference.

#### **1.10 EQUIPMENT INSTALLATION AND REQUIREMENTS**

- A. Equipment location shall be as close as practical to locations shown on the drawings.
- B. Working clearances shall not be less than specified in the NEC.
- C. Inaccessible Equipment:
  - 1. Where the Government determines that the Contractor has installed equipment not readily accessible for operation and maintenance, the equipment shall be removed and reinstalled as directed at no additional cost to the Government.
  - 2. "Readily accessible" is defined as being capable of being reached quickly for operation, maintenance, or inspections without the use of ladders, or without climbing or crawling under or over obstacles such as, but not limited to, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.

#### **1.11 EQUIPMENT IDENTIFICATION**

- A. In addition to the requirements of the NEC, install an identification sign which clearly indicates information required for use and maintenance of items such as switchboards and switchgear, panelboards, cabinets, motor controllers, fused and non-fused safety switches, generators, automatic transfer switches, separately enclosed circuit breakers, individual breakers and controllers in switchboards, switchgear and motor control assemblies, control devices and other significant equipment.

- B. Identification signs for Normal Power System equipment shall be laminated black phenolic resin with a white core with engraved lettering. Identification signs for Essential Electrical System (EES) equipment, as defined in the NEC, shall be laminated red phenolic resin with a white core with engraved lettering. Lettering shall be a minimum of 12 mm (1/2 inch) high. Identification signs shall indicate equipment designation, rated bus amperage, voltage, number of phases, number of wires, and type of EES power branch as applicable. Secure nameplates with screws.
- C. Install adhesive arc flash warning labels on all equipment as required by NFPA 70E. Label shall indicate the arc hazard boundary (inches), working distance (inches), arc flash incident energy at the working distance (calories/cm<sup>2</sup>), required PPE category and description including the glove rating, voltage rating of the equipment, limited approach distance (inches), restricted approach distance (inches), prohibited approach distance (inches), equipment/bus name, date prepared, and manufacturer name and address.

### 1.12 SUBMITTALS

- A. Submit to the COR in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. The Government's approval shall be obtained for all materials and equipment before delivery to the job site. Delivery, storage or installation of materials and equipment which has not had prior approval will not be permitted.
- C. All submittals shall include six copies of adequate descriptive literature, catalog cuts, shop drawings, test reports, certifications, samples, and other data necessary for the Government to ascertain that the proposed materials and equipment comply with drawing and specification requirements. Catalog cuts submitted for approval shall be legible and clearly identify specific materials and equipment being submitted.
- D. Submittals for individual systems and equipment assemblies which consist of more than one item or component shall be made for the system or assembly as a whole. Partial submittals will not be considered for approval.
  - 1. Mark the submittals, "SUBMITTED UNDER SECTION\_\_\_\_\_".
  - 2. Submittals shall be marked to show specification reference including the section and paragraph numbers.
  - 3. Submit each section separately.
- E. The submittals shall include the following:
  - 1. Information that confirms compliance with contract requirements. Include the manufacturer's name, model or catalog numbers, catalog information, technical data sheets, shop drawings, manuals, pictures, nameplate data, and test reports as required.
  - 2. Elementary and interconnection wiring diagrams for communication and signal systems, control systems, and equipment assemblies. All terminal points and wiring shall be identified on wiring diagrams.

3. Parts list which shall include information for replacement parts and ordering instructions, as recommended by the equipment manufacturer.
- F. Maintenance and Operation Manuals:
1. Submit as required for systems and equipment specified in the technical sections. Furnish in hardcover binders or an approved equivalent.
  2. Inscribe the following identification on the cover: the words "MAINTENANCE AND OPERATION MANUAL," the name and location of the system, material, equipment, building, name of Contractor, and contract name and number. Include in the manual the names, addresses, and telephone numbers of each subcontractor installing the system or equipment and the local representatives for the material or equipment.
  3. Provide a table of contents and assemble the manual to conform to the table of contents, with tab sheets placed before instructions covering the subject. The instructions shall be legible and easily read, with large sheets of drawings folded in.
  4. The manuals shall include:
    - a. Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of the equipment.
    - b. A control sequence describing start-up, operation, and shutdown.
    - c. Description of the function of each principal item of equipment.
    - d. Installation instructions.
    - e. Safety precautions for operation and maintenance.
    - f. Diagrams and illustrations.
    - g. Periodic maintenance and testing procedures and frequencies, including replacement parts numbers.
    - h. Performance data.
    - i. Pictorial "exploded" parts list with part numbers. Emphasis shall be placed on the use of special tools and instruments. The list shall indicate sources of supply, recommended spare and replacement parts, and name of servicing organization.
    - j. List of factory approved or qualified permanent servicing organizations for equipment repair and periodic testing and maintenance, including addresses and factory certification qualifications.
- G. Approvals will be based on complete submission of shop drawings, manuals, test reports, certifications, and samples as applicable.
- H. After approval and prior to installation, furnish the COR with one sample of each of the following:
1. A minimum 300 mm (12 inches) length of each type and size of wire and cable along with the tag from the coils or reels from which the sample was taken. The length of the sample shall be sufficient to show all markings provided by the manufacturer.
  2. Each type of conduit coupling, bushing, and termination fitting.

3. Conduit hangers, clamps, and supports.
4. Duct sealing compound.
5. Each type of receptacle, toggle switch, lighting control sensor, outlet box, manual motor starter, device wall plate, engraved nameplate, wire and cable splicing and terminating material, and branch circuit single pole molded case circuit breaker.

#### **1.13 SINGULAR NUMBER**

- A. Where any device or part of equipment is referred to in these specifications in the singular number (e.g., "the switch"), this reference shall be deemed to apply to as many such devices as are required to complete the installation as shown on the drawings.

#### **1.14 ACCEPTANCE CHECKS AND TESTS**

- A. The Contractor shall furnish the instruments, materials, and labor for tests.
- B. Where systems are comprised of components specified in more than one section of Division 26, the Contractor shall coordinate the installation, testing, and adjustment of all components between various manufacturer's representatives and technicians so that a complete, functional, and operational system is delivered to the Government.
- C. When test results indicate any defects, the Contractor shall repair or replace the defective materials or equipment, and repeat the tests. Repair, replacement, and retesting shall be accomplished at no additional cost to the Government.

#### **1.15 WARRANTY**

- A. All work performed and all equipment and material furnished under this Division shall be free from defects and shall remain so for a period of one year from the date of acceptance of the entire installation by the Contracting Officer for the Government.

#### **1.16 INSTRUCTION**

- A. Instruction to designated Government personnel shall be provided for the particular equipment or system as required in each associated technical specification section.
- B. Furnish the services of competent instructors to give full instruction in the adjustment, operation, and maintenance of the specified equipment and system, including pertinent safety requirements. Instructors shall be thoroughly familiar with all aspects of the installation, and shall be trained in operating theory as well as practical operation and maintenance procedures.
- C. A training schedule shall be developed and submitted by the Contractor and approved by the COR at least 30 days prior to the planned training.

#### **1.17 DRAWINGS AND SPECIFICATIONS**

- A. The drawings indicate the general arrangement of the work and are to be followed insofar as possible. The word "provide", as used, shall mean "furnish and install". If significant deviations from the layout are necessitated by field conditions, detailed layouts of the proposed departures shall be submitted to the COR for approval before proceeding with the work.

- B. Make all necessary field measurements to ensure correct fitting. Coordinate work with all other trades in such a manner as to cause a minimum of conflict or delay.
- C. The drawings and specifications shall be carefully studied during the course of bidding and construction. Any errors, omissions or discrepancies encountered shall be referred immediately to the COR for interpretation or correction, so that misunderstandings at a later date may be avoided. The contract drawings are not intended to show every vertical or horizontal offset which may be necessary to complete the systems. Having bus duct, wireways and fittings fabricated and delivered in advance of making actual measurements shall not be sufficient cause to avoid making offsets and minor changes as may be necessary to install bus duct, wireways, fittings and equipment.
- D. The COR shall reserve the right to make minor adjustment in locations of system runs and components where he considers such adjustments desirable in the interest of protecting and concealing work or presenting a better appearance where exposed. Any such changes shall be anticipated and requested sufficiently in advance as to not cause extra work, or unduly delay the work. Coordinate work in advance with all other trades and report immediately any difficulties which can be anticipated.
- E. Equipment, ductwork and piping shall not be installed in the dedicated electrical space above or in the working space required around electrical switchgear, motor control centers or panelboards as identified by NEC 110.26 Spaces About Electrical Equipment – 600 Volts Nominal or Less. For equipment rated over 600 volts nominal – 110.32 Work Space About Equipment – 110.33 Entrance and Access to Work Space – 110.34 Work Space and Guarding. The Electrical Contractor shall caution other trades to comply with this stipulation.
- F. Where any system runs and components are so placed as to cause or contribute to a conflict, it shall be readjusted at the expense of the contractor causing such conflict. The COR's decision shall be final in regard to the arrangement of bus duct, conduit, etc., where conflict arises.
- G. Provide offsets in system runs, additional fittings, necessary conduit, pull boxes, conductors, switches and devices required to complete the installation, or for the proper operation of the system. Each Contractor shall exercise due and particular caution to determine that all parts of the work are made quickly and easily accessible.
- H. Should overlap of work among the trades become evident, this shall be called to the attention of the COR. In such event, none of the trades or their suppliers shall assume that he is relieved of the work which is specified under his branch until instructions in writing are received from the COR.

#### **1.18 RECORD DRAWINGS**

- A. The Electrical Contractor shall maintain a separate set of prints of the contract documents and shall show all changes or variations, in a manner to be clearly discernible, which are made during construction. Upon completion of the work, these drawings shall be turned over to the Architect.

This shall apply particularly to underground and concealed work, and to other systems where the installation varies to a degree which would justify recording the change.

#### **1.19 FINAL INSPECTION AND PUNCH LIST**

- A. As the time of work completion approaches, the Contractor shall survey and inspect his work and develop his own punch list to confirm that it is complete and finished. He shall then notify the COR and request that a final inspection be made. It shall not be considered the COR's obligation to perform a final inspection until the Contractor has inspected the work and so states at the time of the request for the final inspection.
- B. Requests to the COR for final inspection may be accompanied by a limited list of known deficiencies in completion, with appropriate explanation and schedule for completing these; this is in the interest of expediting acceptance for beneficial occupancy.
- C. The Engineer will inspect the work and prepare a punch list of items requiring correction, completion or verification. Corrective action shall be taken by the Contractor to the satisfaction of Engineer within 30 days of receipt of the Engineer's punch list.

#### **1.20 REMOVALS**

- A. Remove ALL existing work which will be superfluous when the new system is installed and made operational. Not all items that need to be removed are necessarily shown on the drawings. Void unused conduit behind walls or below floors as necessary or as directed. No wire or conduit shall be removed which will impair the functioning of the remaining work unless first replaced with a rerouted section of wire or conduit to ensure continuity. Remove inactive wiring back to the last active junction box, panelboard or piece of equipment.
- B. Upon completion, no unused conduit or stub shall extend thru floors, walls or ceilings in finished areas. Abandoned conduit where remaining in place shall have any unused wiring removed. All accessible unused conduit shall be removed.
- C. When it is necessary to reroute a section of an active circuit, the rerouted section shall be installed before removing the existing in order to minimize system down time. Rerouted sections shall be installed as required for new work.

**PART 2 - PRODUCTS (NOT USED)**

**PART 3 - EXECUTION (NOT USED)**

---END---

**SECTION 26 05 19**  
**LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of the electrical conductors and cables for use in electrical systems rated 600 V and below, indicated as cable(s), conductor(s), wire, or wiring in this section.

**1.2 RELATED WORK**

- A. Section 07 84 00, FIRESTOPPING: Sealing around penetrations to maintain the integrity of fire-resistant rated construction.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits for conductors and cables.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 FACTORY TESTS**

- A. Conductors and cables shall be thoroughly tested at the factory per NEMA to ensure that there are no electrical defects. Factory tests shall be certified.

**1.5 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
  - 1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Submit the following data for approval:
      - 1) Electrical ratings and insulation type for each conductor and cable.
      - 2) Splicing materials and pulling lubricant.
  - 2. Certifications: Two weeks prior to final inspection, submit the following.
    - a. Certification by the manufacturer that the conductors and cables conform to the requirements of the drawings and specifications.
    - b. Certification by the Contractor that the conductors and cables have been properly installed, adjusted, and tested.

## 1.6 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are reference in the text by designation only.
- B. American Society of Testing Material (ASTM):
  - D2301-10 ..... Standard Specification for Vinyl Chloride Plastic Pressure-Sensitive Electrical Insulating Tape
  - D2304-10 ..... Test Method for Thermal Endurance of Rigid Electrical Insulating Materials
  - D3005-10 ..... Low-Temperature Resistant Vinyl Chloride Plastic Pressure-Sensitive Electrical Insulating Tape
- C. National Electrical Manufacturers Association (NEMA):
  - WC 70-09 ..... Power Cables Rated 2000 Volts or Less for the Distribution of Electrical Energy
- D. National Fire Protection Association (NFPA):
  - 70-11 ..... National Electrical Code (NEC)
- E. Underwriters Laboratories, Inc. (UL):
  - 44-10 ..... Thermoset-Insulated Wires and Cables
  - 83-08 ..... Thermoplastic-Insulated Wires and Cables
  - 467-07 ..... Grounding and Bonding Equipment
  - 486A-486B-03 ..... Wire Connectors
  - 486C-04 ..... Splicing Wire Connectors
  - 486D-05 ..... Sealed Wire Connector Systems
  - 486E-09 ..... Equipment Wiring Terminals for Use with Aluminum and/or Copper Conductors
  - 493-07 ..... Thermoplastic-Insulated Underground Feeder and Branch Circuit Cables
  - 514B-04 ..... Conduit, Tubing, and Cable Fittings

## PART 2 - PRODUCTS

### 2.1 CONDUCTORS AND CABLES

- A. Conductors and cables shall be in accordance with NEMA, UL, as specified herein, and as shown on the drawings.
- B. All conductors shall be copper.
- C. Single Conductor and Cable:
  - 1. No. 12 AWG: Minimum size, except where smaller sizes are specified herein or shown on the drawings.
  - 2. No. 12 AWG and larger: Stranded.

3. Insulation: THHN-THWN and XHHW-2. XHHW-2 shall be used for isolated power systems.

D. Color Code:

1. No. 10 AWG and smaller: Solid color insulation or solid color coating.
2. No. 8 AWG and larger: Color-coded using one of the following methods:
  - a. Solid color insulation or solid color coating.
  - b. Stripes, bands, or hash marks of color specified.
  - c. Color using 19 mm (0.75 inches) wide tape.
4. For modifications and additions to existing wiring systems, color coding shall conform to the existing wiring system.
5. Conductors shall be color-coded as follows:

208/120 V	Phase	480/277 V
Black	A	Brown
Red	B	Orange
Blue	C	Yellow
White	Neutral	Gray *
* or white with colored (other than green) tracer.		

6. Lighting circuit "switch legs", and 3-way and 4-way switch "traveling wires," shall have color coding that is unique and distinct (e.g., pink and purple) from the color coding indicated above. The unique color codes shall be solid and in accordance with the NEC. Coordinate color coding in the field with the COR.
7. Color code for isolated power system wiring shall be in accordance with the NEC.

## 2.2 SPLICES

- A. Splices shall be in accordance with NEC and UL.
- B. Above Ground Splices for No. 10 AWG and Smaller:
  1. Solderless, screw-on, reusable pressure cable type, with integral insulation, approved for copper and aluminum conductors.
  2. The integral insulator shall have a skirt to completely cover the stripped conductors.
  3. The number, size, and combination of conductors used with the connector, as listed on the manufacturer's packaging, shall be strictly followed.
- C. Above Ground Splices for 8 AWG and Larger:
  1. Long barrel "butt-splice" or "sleeve" type compression connectors, with minimum of two compression indents per wire, listed for use with copper and aluminum conductors.
  2. Insulate with materials approved for the particular use, location, voltage, and temperature. Insulation level shall be not less than the insulation level of the conductors being joined.
  3. Splice and insulation shall be product of the same manufacturer.
- D. Plastic electrical insulating tape: Per ASTM D2304, flame-retardant, cold and weather resistant.

## **2.3 CONNECTORS AND TERMINATIONS**

- A. Mechanical type of high conductivity and corrosion-resistant material, listed for use with copper and aluminum conductors.
- B. Long barrel compression type of high conductivity and corrosion-resistant material, with minimum of two compression indents per wire, listed for use with copper and aluminum conductors.
- C. All bolts, nuts, and washers used to connect connections and terminations to bus bars or other termination points shall be zinc-plated steel.

## **2.4 CONTROL WIRING**

- A. Unless otherwise specified elsewhere in these specifications, control wiring shall be as specified herein, except that the minimum size shall be not less than No. 14 AWG.
- B. Control wiring shall be sized such that the voltage drop under in-rush conditions does not adversely affect operation of the controls.

## **2.5 WIRE LUBRICATING COMPOUND**

- A. Lubricating compound shall be suitable for the wire insulation and conduit, and shall not harden or become adhesive.
- B. Shall not be used on conductors for isolated power systems.

## **PART 3 - EXECUTION**

### **3.1 GENERAL**

- A. Install conductors in accordance with the NEC, as specified, and as shown on the drawings.
- B. Install all conductors in raceway systems.
- C. Splice conductors only in outlet boxes, junction boxes, pullboxes, or handholes.
- D. Conductors of different systems (e.g., 120 V and 277 V) shall not be installed in the same raceway.
- E. Install cable supports for all vertical feeders in accordance with the NEC. Provide split wedge type which firmly clamps each individual cable and tightens due to cable weight.
- F. In panelboards, cabinets, wireways, switches, enclosures, and equipment assemblies, neatly form, train, and tie the conductors with non-metallic ties.
- G. For connections to motors, transformers, and vibrating equipment, stranded conductors shall be used only from the last fixed point of connection to the motors, transformers, or vibrating equipment.
- H. Use expanding foam or non-hardening duct-seal to seal conduits entering a building, after installation of conductors.
- I. Conductor and Cable Pulling:
  - 1. Provide installation equipment that will prevent the cutting or abrasion of insulation during pulling. Use lubricants approved for the cable.
  - 2. Use nonmetallic pull ropes.

3. Attach pull ropes by means of either woven basket grips or pulling eyes attached directly to the conductors.
  4. All conductors in a single conduit shall be pulled simultaneously.
  5. Do not exceed manufacturer's recommended maximum pulling tensions and sidewall pressure values.
- J. No more than three branch circuits shall be installed in any one conduit.
- K. When stripping stranded conductors, use a tool that does not damage the conductor or remove conductor strands.

### **3.2 SPLICE AND TERMINATION INSTALLATION**

- A. Splices and terminations shall be mechanically and electrically secure, and tightened to manufacturer's published torque values using a torque screwdriver or wrench.
- B. Where the Government determines that unsatisfactory splices or terminations have been installed, replace the splices or terminations at no additional cost to the Government.

### **3.3 CONDUCTOR IDENTIFICATION**

- A. When using colored tape to identify phase, neutral, and ground conductors larger than No. 8 AWG, apply tape in half-overlapping turns for a minimum of 75 mm (3 inches) from terminal points, and in junction boxes, pullboxes, and manholes. Apply the last two laps of tape with no tension to prevent possible unwinding. Where cable markings are covered by tape, apply tags to cable, stating size and insulation type.

### **3.4 FEEDER CONDUCTOR IDENTIFICATION**

- A. In each interior pullbox and each underground manhole and handhole, install brass tags on all feeder conductors to clearly designate their circuit identification and voltage. The tags shall be the embossed type, 40 mm (1-1/2 inches) in diameter and 40 mils thick. Attach tags with plastic ties.

### **3.5 EXISTING CONDUCTORS**

- A. Unless specifically indicated on the plans, existing conductors shall not be reused.

### **3.6 CONTROL WIRING INSTALLATION**

- A. Unless otherwise specified in other sections, install control wiring and connect to equipment to perform the required functions as specified or as shown on the drawings.
- B. Install a separate power supply circuit for each system, except where otherwise shown on the drawings.

### **3.7 CONTROL WIRING IDENTIFICATION**

- A. Install a permanent wire marker on each wire at each termination.
- B. Identifying numbers and letters on the wire markers shall correspond to those on the wiring diagrams used for installing the systems.
- C. Wire markers shall retain their markings after cleaning.
- D. In each manhole and handhole, install embossed brass tags to identify the system served and function.

### **3.8 ACCEPTANCE CHECKS AND TESTS**

- A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:
1. Visual Inspection and Tests: Inspect physical condition.
  2. Electrical tests:
    - a. After installation but before connection to utilization devices, such as fixtures, motors, or appliances, test conductors phase-to-phase and phase-to-ground resistance with an insulation resistance tester. Existing conductors to be reused shall also be tested.
    - b. Applied voltage shall be 500 V DC for 300 V rated cable, and 1000 V DC for 600 V rated cable. Apply test for one minute or until reading is constant for 15 seconds, whichever is longer. Minimum insulation resistance values shall not be less than 25 megohms for 300 V rated cable and 100 megohms for 600 V rated cable.
    - c. Perform phase rotation test on all three-phase circuits.

---END---

**SECTION 26 05 26**  
**GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of grounding and bonding equipment, indicated as grounding equipment in this section.
- B. "Grounding electrode system" refers to grounding electrode conductors and all electrodes required or allowed by NEC, as well as made, supplementary, and lightning protection system grounding electrodes.
- C. The terms "connect" and "bond" are used interchangeably in this section and have the same meaning.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Low-voltage conductors.
- C. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit and boxes.
- D. Section 26 22 00, LOW-VOLTAGE TRANSFORMERS: Low-voltage transformers.
- E. Section 26 24 16, PANELBOARDS: Low-voltage panelboards.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
  - 1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Submit plans showing the location of system grounding electrodes and connections, and the routing of aboveground and underground grounding electrode conductors.
  - 2. Test Reports:
    - a. Two weeks prior to the final inspection, submit ground resistance field test reports to the COR.
  - 3. Certifications:
    - a. Certification by the Contractor that the grounding equipment has been properly installed and tested.

## 1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American Society for Testing and Materials (ASTM):
  - B1-07 ..... Standard Specification for Hard-Drawn Copper Wire
  - B3-07 ..... Standard Specification for Soft or Annealed Copper Wire
  - B8-11 ..... Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft
- C. Institute of Electrical and Electronics Engineers, Inc. (IEEE):
  - 81-83 ..... IEEE Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System Part 1: Normal Measurements
- D. National Fire Protection Association (NFPA):
  - 70-11 ..... National Electrical Code (NEC)
  - 70E-12 ..... National Electrical Safety Code
  - 99-12 ..... Health Care Facilities
- E. Underwriters Laboratories, Inc. (UL):
  - 44-10 ..... Thermoset-Insulated Wires and Cables
  - 83-08 ..... Thermoplastic-Insulated Wires and Cables
  - 467-07 ..... Grounding and Bonding Equipment

## PART 2 - PRODUCTS

### 2.1 GROUNDING AND BONDING CONDUCTORS

- A. Equipment grounding conductors shall be insulated stranded copper, except that sizes No. 10 AWG and smaller shall be solid copper. Insulation color shall be continuous green for all equipment grounding conductors, except that wire sizes No. 4 AWG and larger shall be identified per NEC.
- B. Bonding conductors shall be bare stranded copper, except that sizes No. 10 AWG and smaller shall be bare solid copper. Bonding conductors shall be stranded for final connection to motors, transformers, and vibrating equipment.
- C. Conductor sizes shall not be less than shown on the drawings, or not less than required by the NEC, whichever is greater.
- D. Insulation: THHN-THWN and XHHW-2. XHHW-2 shall be used for isolated power systems.

### 2.2 GROUND CONNECTIONS

- A. Below Grade and Inaccessible Locations: Exothermic-welded type connectors.
- B. Above Grade:

1. Bonding Jumpers: Listed for use with aluminum and copper conductors. For wire sizes No. 8 AWG and larger, use compression-type connectors. For wire sizes smaller than No. 8 AWG, use mechanical type lugs. Connectors or lugs shall use zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.
2. Connection to Building Steel: Exothermic-welded type connectors.
3. Connection to Grounding Bus Bars: Listed for use with aluminum and copper conductors. Use mechanical type lugs, with zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.
4. Connection to Equipment Rack and Cabinet Ground Bars: Listed for use with aluminum and copper conductors. Use mechanical type lugs, with zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.

### **2.3 EQUIPMENT RACK AND CABINET GROUND BARS**

- A. Provide solid copper ground bars designed for mounting on the framework of open or cabinet-enclosed equipment racks. Ground bars shall have minimum dimensions of 6.3 mm (0.25 inch) thick x 19 mm (0.75 inch) wide, with length as required or as shown on the drawings. Provide insulators and mounting brackets.

### **2.4 GROUND TERMINAL BLOCKS**

- A. At any equipment mounting location (e.g., backboards and hinged cover enclosures) where rack-type ground bars cannot be mounted, provide mechanical type lugs, with zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.

### **2.5 GROUNDING BUS BAR**

- A. Pre-drilled rectangular copper bar with stand-off insulators, minimum 6.3 mm (0.25 inch) thick x 100 mm (4 inches) high in cross-section, length as shown on the drawings, with hole size, quantity, and spacing per detail shown on the drawings. Provide insulators and mounting brackets.

## **PART 3 - EXECUTION**

### **3.1 GENERAL**

- A. Install grounding equipment in accordance with the NEC, as shown on the drawings, and as specified herein.
- B. System Grounding:
  1. Separately derived systems (transformers downstream from the service entrance): Ground the secondary neutral.
  2. Isolation transformers and isolated power systems shall not be system grounded.
- C. Equipment Grounding: Metallic piping, building structural steel, electrical enclosures, raceways, junction boxes, outlet boxes, cabinets, machine frames, and other conductive items in close proximity with electrical circuits, shall be bonded and grounded.
- D. For patient care area electrical power system grounding, conform to NFPA 99 and NEC.

### **3.2 INACCESSIBLE GROUNDING CONNECTIONS**

- A. Make grounding connections, which are normally buried or otherwise inaccessible, by exothermic weld.

### **3.3 SECONDARY VOLTAGE EQUIPMENT AND CIRCUITS**

- A. Metallic Piping, Building Structural Steel, and Supplemental Electrode(s):
  - 1. Provide a grounding electrode conductor sized per NEC between the service equipment ground bus and all metallic water pipe systems, building structural steel, and supplemental or made electrodes. Provide jumpers across insulating joints in the metallic piping.
  - 2. Provide a supplemental ground electrode as shown on the drawings and bond to the grounding electrode system.
- B. Switchgear, Switchboards, Panelboards, Engine-Generators, Automatic Transfer Switches, and other electrical equipment:
  - 1. Connect the equipment grounding conductors to the ground bus.
  - 2. Connect metallic conduits by grounding bushings and equipment grounding conductor to the equipment ground bus.
- C. Transformers:
  - 1. Exterior: Exterior transformers supplying interior service equipment shall have the neutral grounded at the transformer secondary. Provide a grounding electrode at the transformer.
  - 2. Separately derived systems (transformers downstream from service equipment): Ground the secondary neutral at the transformer. Provide a grounding electrode conductor from the transformer to the nearest component of the grounding electrode system.

### **3.4 RACEWAY**

- A. Conduit Systems:
  - 1. Ground all metallic conduit systems. All metallic conduit systems shall contain an equipment grounding conductor.
  - 2. Non-metallic conduit systems, except non-metallic feeder conduits that carry a grounded conductor from exterior transformers to interior or building-mounted service entrance equipment, shall contain an equipment grounding conductor.
  - 3. Metallic conduit that only contains a grounding conductor, and is provided for its mechanical protection, shall be bonded to that conductor at the entrance and exit from the conduit.
  - 4. Metallic conduits which terminate without mechanical connection to an electrical equipment housing by means of locknut and bushings or adapters, shall be provided with grounding bushings. Connect bushings with a equipment grounding conductor to the equipment ground bus.
- B. Feeders and Branch Circuits: Install equipment grounding conductors with all feeders, and power and lighting branch circuits.
- C. Boxes, Cabinets, Enclosures, and Panelboards:

1. Bond the equipment grounding conductor to each pullbox, junction box, outlet box, device box, cabinets, and other enclosures through which the conductor passes (except for special grounding systems for intensive care units and other critical units shown).
  2. Provide lugs in each box and enclosure for equipment grounding conductor termination.
- D. Wireway Systems:
1. Bond the metallic structures of wireway to provide electrical continuity throughout the wireway system, by connecting a No. 6 AWG bonding jumper at all intermediate metallic enclosures and across all section junctions.
  2. Install insulated No. 6 AWG bonding jumpers between the wireway system, bonded as required above, and the closest building ground at each end and approximately every 16 M (50 feet).
  3. Use insulated No. 6 AWG bonding jumpers to ground or bond metallic wireway at each end for all intermediate metallic enclosures and across all section junctions.
  4. Use insulated No. 6 AWG bonding jumpers to ground cable tray to column-mounted building ground plates (pads) at each end and approximately every 15 M (49 feet).
- E. Receptacles shall not be grounded through their mounting screws. Ground receptacles with a jumper from the receptacle green ground terminal to the device box ground screw and a jumper to the branch circuit equipment grounding conductor.
- F. Ground lighting fixtures to the equipment grounding conductor of the wiring system. Fixtures connected with flexible conduit shall have a green ground wire included with the power wires from the fixture through the flexible conduit to the first outlet box.
- G. Fixed electrical appliances and equipment shall be provided with a ground lug for termination of the equipment grounding conductor.
- H. Panelboard Bonding in Patient Care Areas: The equipment grounding terminal buses of the normal and essential branch circuit panel boards serving the same individual patient vicinity shall be bonded together with an insulated continuous copper conductor not less than No. 10 AWG, installed in rigid metal conduit.

### **3.5 CORROSION INHIBITORS**

- A. When making grounding and bonding connections, apply a corrosion inhibitor to all contact surfaces. Use corrosion inhibitor appropriate for protecting a connection between the metals used.

### **3.6 CONDUCTIVE PIPING**

- A. Bond all conductive piping systems, interior and exterior, to the grounding electrode system. Bonding connections shall be made as close as practical to the equipment ground bus.
- B. In operating rooms and at intensive care and coronary care type beds, bond the medical gas piping and medical vacuum piping at the outlets directly to the patient ground bus.

### **3.7 GROUND RESISTANCE**

- A. Grounding system resistance to ground shall not exceed 5 ohms. Make any modifications or additions to the grounding electrode system necessary for compliance without additional cost to the Government. Final tests shall ensure that this requirement is met.
- B. Grounding system resistance shall comply with the electric utility company ground resistance requirements.

### **3.8 ACCEPTANCE CHECKS AND TESTS**

- A. Resistance of the grounding electrode system shall be measured using a four-terminal fall-of-potential method as defined in IEEE 81. Ground resistance measurements shall be made before the electrical distribution system is energized or connected to the electric utility company ground system, and shall be made in normally dry conditions not fewer than 48 hours after the last rainfall.
- B. Resistance measurements of separate grounding electrode systems shall be made before the systems are bonded together. The combined resistance of separate systems may be used to meet the required resistance, but the specified number of electrodes must still be provided.

---END---

**SECTION 26 05 33**  
**RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of conduit, fittings, and boxes, to form complete, coordinated, grounded raceway systems. Raceways are required for all wiring unless shown or specified otherwise.
- B. Definitions: The term conduit, as used in this specification, shall mean any or all of the raceway types specified.

**1.2 RELATED WORK**

- A. Section 07 84 00, FIRESTOPPING: Sealing around penetrations to maintain the integrity of fire rated construction.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.

**1.3 QUALITY ASSURANCE**

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:

- A. Manufacturer's Literature and Data: Showing each cable type and rating. The specific item proposed and its area of application shall be identified on the catalog cuts.
- B. Shop Drawings:
  - 1. Size and location of main feeders.
  - 2. Size and location of panels and pull-boxes.
  - 3. Layout of required conduit penetrations through structural elements.
- C. Certifications:
  - 1. Two weeks prior to the final inspection, submit four copies of the following certifications to the COR:
    - a. Certification by the manufacturer that the material conforms to the requirements of the drawings and specifications.
    - b. Certification by the contractor that the material has been properly installed.

## 1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American National Standards Institute (ANSI):
- C80.1-05 ..... Electrical Rigid Steel Conduit
  - C80.3-05 ..... Steel Electrical Metal Tubing
  - C80.6-05 ..... Electrical Intermediate Metal Conduit
- C. National Fire Protection Association (NFPA):
- 70-11 ..... National Electrical Code (NEC)
- D. Underwriters Laboratories, Inc. (UL):
- 1-05 ..... Flexible Metal Conduit
  - 5-04 ..... Surface Metal Raceway and Fittings
  - 6-07 ..... Electrical Rigid Metal Conduit - Steel
  - 50-95 ..... Enclosures for Electrical Equipment
  - 360-093 ..... Liquid-Tight Flexible Steel Conduit
  - 467-07 ..... Grounding and Bonding Equipment
  - 514A-04 ..... Metallic Outlet Boxes
  - 514B-04 ..... Conduit, Tubing, and Cable Fittings
  - 514C-96 ..... Nonmetallic Outlet Boxes, Flush-Device Boxes and Covers
  - 651-05 ..... Schedule 40 and 80 Rigid PVC Conduit and Fittings
  - 651A-00 ..... Type EB and A Rigid PVC Conduit and HDPE Conduit
  - 797-07 ..... Electrical Metallic Tubing
  - 1242-06 ..... Electrical Intermediate Metal Conduit - Steel
- E. National Electrical Manufacturers Association (NEMA):
- TC-2-03 ..... Electrical Polyvinyl Chloride (PVC) Tubing and Conduit
  - TC-3-04 ..... PVC Fittings for Use with Rigid PVC Conduit and Tubing
  - FB1-07 ..... Fittings, Cast Metal Boxes and Conduit Bodies for Conduit, Electrical Metallic Tubing and Cable

## PART 2 - PRODUCTS

### 2.1 MATERIAL

- A. Conduit Size: In accordance with the NEC, but not less than 0.75 in unless otherwise shown. Where permitted by the NEC, 0.5 in [13 mm] flexible conduit may be used for tap connections to recessed lighting fixtures.
- B. Conduit:
1. Rigid steel: Shall conform to UL 6 and ANSI C80.1.
  2. Rigid intermediate steel conduit (IMC): Shall conform to UL 1242 and ANSI C80.6.

3. Electrical metallic tubing (EMT): Shall conform to UL 797 and ANSI C80.3. Maximum size not to exceed 4 in [105 mm] and shall be permitted only with cable rated 600 V or less.
  4. Flexible galvanized steel conduit: Shall conform to UL 1.
  5. Liquid-tight flexible metal conduit: Shall conform to UL 360.
  6. Surface metal raceway: Shall conform to UL 5.
- C. Conduit Fittings:
1. Rigid steel and IMC conduit fittings:
    - a. Fittings shall meet the requirements of UL 514B and NEMA FB1.
    - b. Standard threaded couplings, locknuts, bushings, conduit bodies, and elbows: Only steel or malleable iron materials are acceptable. Integral retractable type IMC couplings are also acceptable.
    - c. Locknuts: Bonding type with sharp edges for digging into the metal wall of an enclosure.
    - d. Bushings: Metallic insulating type, consisting of an insulating insert, molded or locked into the metallic body of the fitting. Bushings made entirely of metal or nonmetallic material are not permitted.
    - e. Erickson (union-type) and set screw type couplings: Approved for use in concrete are permitted for use to complete a conduit run where conduit is installed in concrete. Use set screws of case-hardened steel with hex head and cup point to firmly seat in conduit wall for positive ground. Tightening of set screws with pliers is prohibited.
    - f. Sealing fittings: Threaded cast iron type. Use continuous drain-type sealing fittings to prevent passage of water vapor. In concealed work, install fittings in flush steel boxes with blank cover plates having the same finishes as that of other electrical plates in the room.
  2. Electrical metallic tubing fittings:
    - a. Fittings and conduit bodies shall meet the requirements of UL 514B, ANSI C80.3, and NEMA FB1.
    - b. Only steel or malleable iron materials are acceptable.
    - c. Compression couplings and connectors: Concrete-tight and rain-tight, with connectors having insulated throats for conduit 2" and smaller.
    - d. Setscrew couplings and connectors: Use setscrews of case-hardened steel with hex head and cup point, to firmly seat in wall of conduit for positive grounding for conduit over 2".
    - e. Indent-type connectors or couplings are prohibited.
    - f. Die-cast or pressure-cast zinc-alloy fittings or fittings made of "pot metal" are prohibited.
  4. Flexible steel conduit fittings:
    - a. Conform to UL 514B. Only steel or malleable iron materials are acceptable.
    - b. Clamp-type, with insulated throat.

5. Liquid-tight flexible metal conduit fittings:
  - a. Fittings shall meet the requirements of UL 514B and NEMA FB1.
  - b. Only steel or malleable iron materials are acceptable.
  - c. Fittings must incorporate a threaded grounding cone, a steel or plastic compression ring, and a gland for tightening. Connectors shall have insulated throats.
6. Surface metal raceway fittings: As recommended by the raceway manufacturer. Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, conduit entry fittings, accessories, and other fittings as required for complete system.
7. Expansion and deflection couplings:
  - a. Conform to UL 467 and UL 514B.
  - b. Accommodate a 0.75 in [19 mm] deflection, expansion, or contraction in any direction, and allow 30 degree angular deflections.
  - c. Include internal flexible metal braid, sized to guarantee conduit ground continuity and a low-impedance path for fault currents, in accordance with UL 467 and the NEC tables for equipment grounding conductors.
  - d. Jacket: Flexible, corrosion-resistant, watertight, moisture and heat-resistant molded rubber material with stainless steel jacket clamps.
- D. Conduit Supports:
  1. Parts and hardware: Zinc-coat or provide equivalent corrosion protection.
  2. Individual Conduit Hangers: Designed for the purpose, having a pre-assembled closure bolt and nut, and provisions for receiving a hanger rod.
  3. Multiple conduit (trapeze) hangers: Not less than 1.5 x 1.5 in [38 mm x 38 mm], 12-gauge steel, cold-formed, lipped channels; with not less than 0.375 in [9 mm] diameter steel hanger rods.
  4. Solid Masonry and Concrete Anchors: Self-drilling expansion shields, or machine bolt expansion.
- E. Outlet, Junction, and Pull Boxes:
  1. UL-50 and UL-514A.
  2. Cast metal where required by the NEC or shown, and equipped with rustproof boxes.
  3. Sheet metal boxes: Galvanized steel, except where otherwise shown.
  4. Flush-mounted wall or ceiling boxes shall be installed with raised covers so that the front face of raised cover is flush with the wall. Surface-mounted wall or ceiling boxes shall be installed with surface-style flat or raised covers.
- F. Wireways: Equip with hinged covers, except where removable covers are shown. Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, and other fittings to match and mate with wireways as required for a complete system.

### **PART 3 - EXECUTION**

#### **3.1 PENETRATIONS**

- A. Cutting or Holes:
  - 1. Cut holes in advance where they should be placed in the structural elements, such as ribs or beams. Obtain the approval of the COR prior to drilling through structural elements.
  - 2. Cut holes through concrete and masonry in new and existing structures with a diamond core drill or concrete saw. Pneumatic hammers, impact electric, hand, or manual hammer-type drills are not allowed, except where permitted by the COR as required by limited working space.
- B. Firestop: Where conduits, wireways, and other electrical raceways pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING.
- C. Waterproofing: At floor, exterior wall, and roof conduit penetrations, completely seal clearances around the conduit and make watertight.

#### **3.2 INSTALLATION, GENERAL**

- A. In accordance with UL, NEC, as shown, and as specified herein.
- B. Essential (Emergency) raceway systems shall be entirely independent of other raceway systems, except where shown on drawings.
- C. Install conduit as follows:
  - 1. In complete mechanically and electrically continuous runs before pulling in cables or wires.
  - 2. Unless otherwise indicated on the drawings or specified herein, installation of all conduits shall be concealed within finished walls, floors, and ceilings.
  - 3. Flattened, dented, or deformed conduit is not permitted. Remove and replace the damaged conduits with new undamaged material.
  - 4. Assure conduit installation does not encroach into the ceiling height head room, walkways, or doorways.
  - 5. Cut square, ream, remove burrs, and draw up tight.
  - 6. Independently support conduit at 8 ft [2.4 M] on centers. Do not use other supports, i.e., suspended ceilings, suspended ceiling supporting members, lighting fixtures, conduits, mechanical piping, or mechanical ducts.
  - 7. Support within 12 in [300 mm] of changes of direction, and within 12 in [300 mm] of each enclosure to which connected.
  - 8. Close ends of empty conduit with plugs or caps at the rough-in stage until wires are pulled in, to prevent entry of debris.
  - 9. Conduit installations under fume and vent hoods are prohibited.

10. Secure conduits to cabinets, junction boxes, pull-boxes, and outlet boxes with bonding type locknuts. For rigid and IMC conduit installations, provide a locknut on the inside of the enclosure, made up wrench tight. Do not make conduit connections to junction box covers.
  11. Conduit bodies shall only be used for changes in direction, and shall not contain splices.
- D. Conduit Bends:
1. Make bends with standard conduit bending machines.
  2. Conduit hickey may be used for slight offsets and for straightening stubbed out conduits.
  3. Bending of conduits with a pipe tee or vise is prohibited.
- E. Layout and Homeruns:
1. Install conduit with wiring, including homeruns, as shown on drawings.
  2. Deviations: Make only where necessary to avoid interferences and only after drawings showing the proposed deviations have been submitted approved by the COR.
- F. Conduit shall be run concealed in all finished areas of new construction and elsewhere unless specifically indicated or upon specific permission by the COR. All conduit shall parallel building lines.
- G. Conduit shall be run overhead and shall not be run below concrete slabs unless specifically indicated on the drawings and in the legend on the drawings.
- H. Contractor shall record carefully on a set of "as built" prints the exact location of all feeder conduits.
- I. Unless noted otherwise on the drawings, a maximum of 8 conductors shall be installed in a branch circuit conduit. This maximum is a count of all phase and neutral conductors only - ground conductors are not counted when determining maximum fill for this purpose.

### **3.3 CONCEALED WORK INSTALLATION**

- A. In Concrete:
1. Conduit: Rigid steel, IMC, or EMT. Do not install EMT in concrete slabs that are in contact with soil, gravel, or vapor barriers.
  2. Align and run conduit in direct lines.
  3. Install conduit through concrete beams only:
    - a. Where shown on the structural drawings.
    - b. As approved by the COR prior to construction, and after submittal of drawing showing location, size, and position of each penetration.
  4. Make couplings and connections watertight. Use thread compounds that are UL approved conductive type to ensure low resistance ground continuity through the conduits. Tightening setscrews with pliers is prohibited.
- B. Above Furred or Suspended Ceilings and in Walls:
1. Conduit for conductors 600 V and below: Rigid steel, IMC, or EMT. Mixing different types of conduits indiscriminately in the same system is prohibited.

2. Align and run conduit parallel or perpendicular to the building lines.
3. Connect recessed lighting fixtures to conduit runs with maximum 6 ft [1.8 M] of flexible metal conduit extending from a junction box to the fixture.
4. Tightening setscrews with pliers is prohibited.

### **3.4 EXPOSED WORK INSTALLATION**

- A. Unless otherwise indicated on the drawings, exposed conduit is only permitted in mechanical and electrical rooms.
- B. Conduit for Conductors 600 V and Below: Rigid steel, IMC, or EMT. Mixing different types of conduits indiscriminately in the system is prohibited.
- C. Align and run conduit parallel or perpendicular to the building lines.
- D. Install horizontal runs close to the ceiling or beams and secure with conduit straps.
- E. Support horizontal or vertical runs at not over 8 ft [2.4 M] intervals.
- F. Surface metal raceways: Use only where shown.
- G. Painting:
  1. Paint exposed conduit.

### **3.5 WET OR DAMP LOCATIONS**

- A. Unless otherwise shown, use conduits of rigid steel or IMC.
- B. Provide sealing fittings to prevent passage of water vapor where conduits pass from warm to cold locations, i.e., refrigerated spaces, constant-temperature rooms, air-conditioned spaces, building exterior walls, roofs, or similar spaces.
- C. Unless otherwise shown, use rigid steel or IMC conduit within 5 ft [1.5 M] of the exterior and below concrete building slabs in contact with soil, gravel, or vapor barriers. Conduit shall be half-lapped with 10 mil PVC tape before installation. After installation, completely recoat or retape any damaged areas of coating.

### **3.6 MOTORS AND VIBRATING EQUIPMENT**

- A. Use flexible metal conduit for connections to motors and other electrical equipment subject to movement, vibration, misalignment, cramped quarters, or noise transmission.
- B. Use liquid-tight flexible metal conduit for installation in exterior locations, moisture or humidity laden atmosphere, corrosive atmosphere, water or spray wash-down operations, inside airstream of HVAC units, and locations subject to seepage or dripping of oil, grease, or water. Provide a green equipment grounding conductor with flexible metal conduit.

### **3.7 EXPANSION JOINTS**

- A. Conduits 3 in [75 mm] and larger that are secured to the building structure on opposite sides of a building expansion joint require expansion and deflection couplings. Install the couplings in accordance with the manufacturer's recommendations.
- B. Provide conduits smaller than 3 in [75 mm] with junction boxes on both sides of the expansion joint. Connect conduits to junction boxes with sufficient slack of flexible conduit to produce 5 in

[125 mm] vertical drop midway between the ends. Flexible conduit shall have a bonding jumper installed. In lieu of this flexible conduit, expansion and deflection couplings as specified above for conduits 15 in [375 mm] and larger are acceptable.

- C. Install expansion and deflection couplings where shown.

### **3.8 CONDUIT SUPPORTS, INSTALLATION**

- A. Safe working load shall not exceed one-quarter of proof test load of fastening devices.
- B. Use pipe straps or individual conduit hangers for supporting individual conduits.
- C. Support multiple conduit runs with trapeze hangers. Use trapeze hangers that are designed to support a load equal to or greater than the sum of the weights of the conduits, wires, hanger itself, and 200 lbs [90 kg]. Attach each conduit with U-bolts or other approved fasteners.
- D. Support conduit independently of junction boxes, pull-boxes, fixtures, suspended ceiling T-bars, angle supports, and similar items.
- E. Fasteners and Supports in Solid Masonry and Concrete:
  - 1. New Construction: Use steel or malleable iron concrete inserts set in place prior to placing the concrete.
  - 2. Existing Construction:
    - a. Steel expansion anchors not less than 0.25 in [6 mm] bolt size and not less than 1.125 in [28 mm] embedment.
    - b. Power set fasteners not less than 0.25 in [6 mm] diameter with depth of penetration not less than 3 in [75 mm].
    - c. Use vibration and shock-resistant anchors and fasteners for attaching to concrete ceilings.
- E. Hollow Masonry: Toggle bolts.
- F. Bolts supported only by plaster or gypsum wallboard are not acceptable.
- G. Metal Structures: Use machine screw fasteners or other devices specifically designed and approved for the application.
- H. Attachment by wood plugs, rawl plug, plastic, lead or soft metal anchors, or wood blocking and bolts supported only by plaster is prohibited.
- I. Chain, wire, or perforated strap shall not be used to support or fasten conduit.
- J. Spring steel type supports or fasteners are prohibited for all uses except horizontal and vertical supports/fasteners within walls.
- K. Vertical Supports: Vertical conduit runs shall have riser clamps and supports in accordance with the NEC and as shown. Provide supports for cable and wire with fittings that include internal wedges and retaining collars.

### **3.9 BOX INSTALLATION**

- A. Boxes for Concealed Conduits:
  - 1. Flush-mounted.

2. Provide raised covers for boxes to suit the wall or ceiling, construction, and finish.
- B. In addition to boxes shown, install additional boxes where needed to prevent damage to cables and wires during pulling-in operations.
- C. Remove only knockouts as required and plug unused openings. Use threaded plugs for cast metal boxes and snap-in metal covers for sheet metal boxes.
- D. Outlet boxes mounted back-to-back in the same wall are prohibited. A minimum 24 in [600 mm] center-to-center lateral spacing shall be maintained between boxes.
- E. Minimum size of outlet boxes for ground fault interrupter (GFI) receptacles is 4 in [100 mm] square x 2.125 in [55 mm] deep, with device covers for the wall material and thickness involved.
- F. Stencil or install phenolic nameplates on covers of the boxes identified on riser diagrams; for example "SIG-FA JB No. 1."
- G. On all branch circuit junction box covers, identify the circuits with black marker.

- - - E N D - - -

**SECTION 26 05 73**  
**OVERCURRENT PROTECTIVE DEVICE COORDINATION STUDY**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the overcurrent protective device coordination study, indicated as the study in this section.
- B. A short-circuit, arc flash and selective coordination study shall be prepared for the electrical overcurrent devices to be installed under this project.
- C. The study shall present a well-coordinated time-current analysis of each overcurrent protective device from the largest breaker in each panelboard/motor 10HP and above up to utility source serving the campus and the on-site generator sources.
- D. Scope shall include Building 310 and all buildings fed from Building 310. Building 330 and chiller plant are excluded.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements that are common to more than one section of Division 26.
- B. Section 26 24 16, PANELBOARDS: Low-voltage panelboards.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. The study shall be prepared by the equipment manufacturer.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
  - 1. Product data on the software program to be used for the study. Software shall be in mainstream use in the industry, shall provide device settings and ratings, and shall show selective coordination by time-current drawings.
  - 2. Complete study as described below. Submittal of the study shall be well-coordinated with submittals of the shop drawings for equipment in related specification sections.
  - 3. Certifications: Two weeks prior to final inspection, submit the following.
    - a. Certification by the Contractor that the overcurrent protective devices have been set in accordance with the approved study.

**1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. Institute of Electrical and Electronics Engineers (IEEE):

242-01 ..... Protection and Coordination of Industrial and Commercial Power  
Systems  
399-97 ..... Industrial and Commercial Power Systems Analysis  
1584a-04 ..... Guide for Performing Arc-Flash Hazard Calculations

### 1.6 STUDY REQUIREMENTS

- A. The study shall include one line diagram, short-circuit, arc flash and ground fault analysis, and protective coordination plots for all overcurrent protective devices.
- B. One Line Diagram:
  - 1. Show all electrical equipment and wiring to be protected by the overcurrent devices.
  - 2. Show the following specific information:
    - a. Calculated fault impedance, X/R ratios, and short-circuit values at each feeder and branch circuit bus.
    - b. Relay, circuit breaker, and fuse ratings.
    - c. Generator kW/kVA and transformer kVA and voltage ratings, percent impedance, X/R ratios, and wiring connections.
    - d. Voltage at each bus.
    - e. Identification of each bus, matching the identification on the drawings.
    - f. Conduit, conductor, and busway material, size, length, and X/R ratios.
- C. Short-Circuit Study:
  - 1. The study shall be performed using computer software designed for this purpose. Pertinent data and the rationale employed in developing the calculations shall be described in the introductory remarks of the study.
  - 2. Calculate the fault impedance to determine the available short-circuit and ground fault currents at each bus. Incorporate applicable motor and/or generator contribution in determining the momentary and interrupting ratings of the overcurrent protective devices.
  - 3. Present the results of the short-circuit study in a table. Include the following:
    - a. Device identification.
    - b. Operating voltage.
    - c. Overcurrent protective device type and rating.
    - d. Calculated short-circuit current.
- D. Coordination Curves:
  - 1. Prepare the coordination curves to determine the required settings of overcurrent protective devices to demonstrate selective coordination. Graphically illustrate on log-log paper that adequate time separation exists between devices, including the utility company upstream device if applicable. Plot the specific time-current characteristics of each overcurrent protective device in such a manner that all devices are clearly depicted.
  - 2. The following specific information shall also be shown on the coordination curves:

- a. Device identification.
  - b. Potential transformer and current transformer ratios.
  - c. Three-phase and single-phase ANSI damage points or curves for each cable, transformer, or generator.
  - d. Applicable circuit breaker or protective relay characteristic curves.
  - e. No-damage, melting, and clearing curves for fuses.
  - f. Transformer in-rush points.
3. Develop a table to summarize the settings selected for the overcurrent protective devices. Include the following in the table:
- a. Device identification.
  - b. Protective relay or circuit breaker potential and current transformer ratios, sensor rating, and available and suggested pickup and delay settings for each available trip characteristic.
  - c. Fuse rating and type.

#### **1.7 ANALYSIS**

- A. Analyze the short-circuit calculations, and highlight any equipment determined to be underrated as specified. Propose solutions to effectively protect the underrated equipment.

#### **1.8 ADJUSTMENTS, SETTINGS, AND MODIFICATIONS**

- A. Final field settings and minor modifications of the overcurrent protective devices shall be made to conform with the study, without additional cost to the Government.
- B. Apply arc flash labels to equipment with all calculated values indicated.

#### **PART 2 - PRODUCTS (NOT USED)**

#### **PART 3 - EXECUTION (NOT USED)**

---END---

**SECTION 26 22 00**  
**LOW-VOLTAGE TRANSFORMERS**

**PART 1 – GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of low-voltage dry-type general-purpose transformers, indicated as transformers in this section.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Low-voltage conductors.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit.

**1.3 QUALITY ASSURANCE**

Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
  - 1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Include electrical ratings, dimensions, mounting details, materials, required clearances, terminations, weight, temperature rise, wiring and connection diagrams, plan, front, side, and rear elevations, accessories, and device nameplate data.
  - 2. Manuals:
    - a. Submit, simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals including technical data sheets and wiring diagrams.
      - 1) Schematic signal and control diagrams, with all terminals identified, matching terminal identification in the transformers.
      - 2) Include information for testing, repair, troubleshooting, assembly, disassembly, and factory recommended/required periodic maintenance procedures and frequency.
    - b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
  - 3. Certifications: Two weeks prior to final inspection, submit the following.



- b. Transformers below 30 kVA: Same as for 30 kVA and larger or UL rated 185 °C (365 °F) system with an average maximum rise by resistance of 115 °C (239 °F) in a maximum ambient of 40 °C (104 °F).
- 6. Core and coil assemblies:
  - a. Rigidly braced to withstand the stresses caused by short-circuit currents and rough handling during shipment.
  - b. Cores shall be grain-oriented, non-aging, and silicon steel.
  - c. Coils shall be continuous windings without splices except for taps.
  - d. Coil loss and core loss shall be minimized for efficient operation.
  - e. Primary and secondary tap connections shall be brazed or pressure type.
  - f. Coil windings shall have end filters or tie-downs for maximum strength.
- 7. Certified sound levels, determined in accordance with NEMA, shall not exceed the following:

Transformer Rating	Sound Level Rating
0 - 9 KVA	40 dB
10 - 50 KVA	45 dB
51 - 150 KVA	50 dB
151 - 300 KVA	55 dB
301 - 500 KVA	60 dB

- 8. If not shown on drawings, nominal impedance shall be as permitted by NEMA.
- 9. Single phase transformers rated 15 kVA through 25 kVA shall have two 5% full capacity taps below normal rated primary voltage. All transformers rated 30 kVA and larger shall have two 2.5% full capacity taps above, and four 2.5% full capacity taps below normal rated primary voltage.
- 10. Core assemblies shall be grounded to their enclosures with adequate flexible ground straps.
- 11. Enclosures:
  - a. Comprised of not less than code gauge steel.
  - b. Outdoor enclosures shall be NEMA 3R.
  - c. Temperature rise at hottest spot shall conform to NEMA Standards, and shall not bake and peel off the enclosure paint after the transformer has been placed in service.
  - d. Ventilation openings shall prevent accidental access to live components.
  - e. The enclosure at the factory shall be thoroughly cleaned and painted with manufacturer's prime coat and standard finish.
- 12. Standard NEMA features and accessories, including ground pad, lifting provisions, and nameplate with the wiring diagram and sound level indicated.
- 13. Dimensions and configurations shall conform to the spaces designated for their installations.

14. Transformers shall meet the minimum energy efficiency values per NEMA TP1 as listed below:

kVA Rating	Output efficiency (%)
15	97
30	97.5
45	97.7
75	98
112.5	98.2
150	98.3
225	98.5
300	98.6
500	98.7
750	98.8

## 2.2 NONLINEAR TRANSFORMERS

- A. Shall be as specified in Paragraph 2.1, with additional features as specified below.
- B. Transformers shall be designed to withstand the overheating effects caused by harmonics resulting from non-linear (non-sinusoidal) loads.
- C. Neutral rating shall be 200% of rated secondary phase current.
- D. Minimum efficiency designed to supply circuits with a harmonic profile equal to or less than a K factor of 13, without exceeding specified temperature rise. Transformers with K factor of 13 shall be provided, if K factor is not shown on contract drawings. Table below applies to K-13 transformers only.

Harmonic	K-13 (%)
Fundamental	100
3 <sup>rd</sup>	70
5 <sup>th</sup>	42
7 <sup>th</sup>	5
9 <sup>th</sup>	3
11 <sup>th</sup>	3
13 <sup>th</sup>	1
15 <sup>th</sup>	0.7
17 <sup>th</sup>	0.6

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Installation of transformers shall be in accordance with the NEC, as recommended by the equipment manufacturer and as shown on the drawings.
- B. Anchor transformers with rustproof bolts, nuts, and washers, in accordance with manufacturer's instructions, and as shown on drawings.
- C. Install transformers with manufacturer's recommended clearance from wall and adjacent equipment for air circulation. Minimum clearance shall be 150 mm (6 inches).

#### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform tests in accordance with the manufacturer's recommendations. In addition, include the following:
  - 1. Visual Inspection and Tests:
    - a. Compare equipment nameplate data with specifications and approved shop drawings.
    - b. Inspect physical and mechanical condition.
    - c. Inspect all field-installed bolted electrical connections, using the calibrated torque-wrench method to verify tightness of accessible bolted electrical connections.
    - d. Perform specific inspections and mechanical tests as recommended by manufacturer.
    - e. Verify correct equipment grounding.
    - f. Verify proper secondary phase-to-phase and phase-to-neutral voltage after energization and prior to connection to loads.

#### **3.3 FOLLOW-UP VERIFICATION**

- A. Upon completion of acceptance checks, settings, and tests, the contractor shall demonstrate that the transformers are in good operating condition, and properly performing the intended function.

---END---

**SECTION 26 24 16  
PANELBOARDS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of panelboards.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Low-voltage conductors.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits.
- E. Section 26 05 73, OVERCURRENT PROTECTIVE DEVICE COORDINATION STUDY: Short circuit and coordination study, and requirements for a coordinated electrical system.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Include electrical ratings, dimensions, mounting details, materials, required clearances, terminations, weight, circuit breakers, wiring and connection diagrams, accessories, and nameplate data.
  2. Manuals:
    - a. Submit, simultaneously with the shop drawings, complete maintenance and operating manuals including technical data sheets, wiring diagrams, and information for ordering circuit breakers and replacement parts.
      - 1) Include schematic diagrams, with all terminals identified, matching terminal identification in the panelboards.
      - 2) Include information for testing, repair, troubleshooting, assembly, and disassembly.
    - b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.

3. Certifications: Two weeks prior to final inspection, submit the following.
  - a. Certification by the manufacturer that the panelboards conform to the requirements of the drawings and specifications.
  - b. Certification by the Contractor that the panelboards have been properly installed, adjusted, and tested.

### 1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. International Code Council (ICC):  
IBC-12 ..... International Building Code
- C. National Electrical Manufacturers Association (NEMA):  
PB 1-11 ..... Panelboards  
250-08 ..... Enclosures for Electrical Equipment (1,000V Maximum)
- D. National Fire Protection Association (NFPA):  
70-11 ..... National Electrical Code (NEC)  
70E-12 ..... Standard for Electrical Safety in the Workplace
- E. Underwriters Laboratories, Inc. (UL):  
50-95 ..... Enclosures for Electrical Equipment  
67-09 ..... Panelboards  
489-09 ..... Molded Case Circuit Breakers and Circuit Breaker Enclosures

## PART 2 - PRODUCTS

### 2.1 GENERAL REQUIREMENTS

- A. Panelboards shall be in accordance with NEC, NEMA, UL, as specified, and as shown on the drawings.
- B. Panelboards shall have main breaker or main lugs, bus size, voltage, phases, number of circuit breaker mounting spaces, top or bottom feed, flush or surface mounting, branch circuit breakers, and accessories as shown on the drawings.
- C. Panelboards shall be completely factory-assembled with molded case circuit breakers and integral accessories as shown on the drawings or specified herein.
- D. Non-reduced size copper bus bars, rigidly supported on molded insulators, and fabricated for bolt-on type circuit breakers.
- E. Bus bar connections to the branch circuit breakers shall be the "distributed phase" or "phase sequence" type.
- F. Mechanical lugs furnished with panelboards shall be cast, stamped, or machined metal alloys listed for use with the conductors to which they will be connected.
- G. Neutral bus shall be 100% rated, mounted on insulated supports.

- H. Grounding bus bar shall be equipped with screws or lugs for the connection of equipment grounding conductors.
- I. Bus bars shall be braced for the available short-circuit current as shown on the drawings, but not be less than 10,000 A symmetrical for 120/208 V and 120/240 V panelboards, and 14,000 A symmetrical for 277/480 V panelboards.
- J. Panelboard sections with tapped bus or crossover bus are not acceptable.
- K. Series-rated panelboards are not permitted.

## **2.2 ENCLOSURES AND TRIMS**

- A. Enclosures:
  - 1. Provide galvanized steel enclosures, with NEMA rating as shown on the drawings or as required for the environmental conditions in which installed.
  - 2. Enclosures shall not have ventilating openings.
  - 3. Enclosures may be of one-piece formed steel or of formed sheet steel with end and side panels welded, riveted, or bolted as required.
  - 4. Provide manufacturer's standard option for prepunched knockouts on top and bottom endwalls.
  - 5. Include removable inner dead front cover, independent of the panelboard cover.
- B. Trims:
  - 1. Hinged "door-in-door" type.
  - 2. Interior hinged door with hand-operated latch or latches, as required to provide access only to circuit breaker operating handles, not to energized parts.
  - 3. Outer hinged door shall be securely mounted to the panelboard enclosure with factory bolts, screws, clips, or other fasteners, requiring a key or tool for entry. Hand-operated latches are not acceptable.
  - 4. Inner and outer doors shall open left to right.
  - 5. Trims shall be flush or surface type as shown on the drawings.

## **2.3 MOLDED CASE CIRCUIT BREAKERS**

- A. Circuit breakers shall be per UL, NEC, as shown on the drawings, and as specified.
- B. Circuit breakers shall be bolt-on type.
- C. Circuit breakers shall have minimum interrupting rating as required to withstand the available fault current, but not less than:
  - 1. 120/208 V Panelboard: 10,000 A symmetrical.
  - 2. 120/240 V Panelboard: 10,000 A symmetrical.
  - 3. 277/480 V Panelboard: 14,000 A symmetrical.
- D. Circuit breakers shall have automatic, trip free, non-adjustable, inverse time, and instantaneous magnetic trips for less than 400 A frame. Circuit breakers with 400 A frames and above shall have magnetic trip, adjustable from 5x to 10x. Breaker trip setting shall be set in the field, based

on the approved protective device study as specified in Section 26 05 71, ELECTRICAL SYSTEM PROTECTIVE DEVICE STUDY.

- E. Circuit breaker features shall be as follows:
1. A rugged, integral housing of molded insulating material.
  2. Silver alloy contacts.
  3. Arc quenchers and phase barriers for each pole.
  4. Quick-make, quick-break, operating mechanisms.
  5. A trip element for each pole, thermal magnetic type with long time delay and instantaneous characteristics, a common trip bar for all poles and a single operator.
  6. Electrically and mechanically trip free.
  7. An operating handle which indicates closed, tripped, and open positions.
  8. An overload on one pole of a multi-pole breaker shall automatically cause all the poles of the breaker to open.
  9. Ground fault current interrupting breakers, shunt trip breakers, lighting control breakers (including accessories to switch line currents), or other accessory devices or functions shall be provided where shown on the drawings.
  10. For circuit breakers being added to existing panelboards, coordinate the breaker type with existing panelboards. Modify the panel directory accordingly.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Installation shall be in accordance with the manufacturer's instructions, the NEC, as shown on the drawings, and as specified.
- B. Locate panelboards so that the present and future conduits can be conveniently connected.
- C. Install a printed schedule of circuits in each panelboard after approval by the COR. Schedules shall reflect final load descriptions, room numbers, and room names connected to each circuit breaker. Schedules shall be printed on the panelboard directory cards and be installed in the appropriate panelboards
- E. Mount panelboards such that the maximum height of the top circuit breaker above the finished floor shall not exceed 1980 mm (78 inches).
- F. Provide blank cover for each unused circuit breaker mounting space.
- G. Rust and scale shall be removed from the inside of existing enclosures where new interior components are to be installed. Paint inside of enclosures with rust-preventive paint before the new interior components are installed. Provide new trim. Trim shall fit tight to the enclosure.

#### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:
  1. Visual Inspection and Tests:

- a. Compare equipment nameplate data with specifications and approved shop drawings.
- b. Inspect physical, electrical, and mechanical condition.
- c. Verify appropriate anchorage and required area clearances.
- d. Verify that circuit breaker sizes and types correspond to approved shop drawings.
- e. To verify tightness of accessible bolted electrical connections, use the calibrated torque-wrench method or perform thermographic survey after energization.
- f. Vacuum-clean enclosure interior. Clean enclosure exterior.
- g. **All retrofitted panelboards shall be UL Field Inspected and provided with a UL Field Label.**

### 3.3 FOLLOW-UP VERIFICATION

- A. Upon completion of acceptance checks, settings, and tests, the Contractor shall demonstrate that the panelboards are in good operating condition and properly performing the intended function.

---END---

**SECTION 26 27 26**  
**WIRING DEVICES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of wiring devices.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements that are common to more than one section of Division 26.
- B. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit and boxes.
- C. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Cables and wiring.
- D. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.
- E. Section 26 51 00, INTERIOR LIGHTING: Fluorescent ballasts and LED drivers for use with manual dimming controls.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
  - 1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Include electrical ratings, dimensions, mounting details, construction materials, grade, and termination information.
  - 2. Manuals:
    - a. Submit, simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals, including technical data sheets and information for ordering replacement parts.
    - b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
  - 3. Certifications: Two weeks prior to final inspection, submit the following.
    - a. Certification by the manufacturer that the wiring devices conform to the requirements of the drawings and specifications.

- b. Certification by the Contractor that the wiring devices have been properly installed and adjusted.

### 1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.
- B. National Fire Protection Association (NFPA):
  - 70-11 ..... National Electrical Code (NEC)
  - 99-12 ..... Health Care Facilities
- C. National Electrical Manufacturers Association (NEMA):
  - WD 1-10 ..... General Color Requirements for Wiring Devices
  - WD 6-08 ..... Wiring Devices – Dimensional Specifications
- D. Underwriter's Laboratories, Inc. (UL):
  - 5-11 ..... Surface Metal Raceways and Fittings
  - 20-10 ..... General-Use Snap Switches
  - 231-07 ..... Power Outlets
  - 467-07 ..... Grounding and Bonding Equipment
  - 498-07 ..... Attachment Plugs and Receptacles
  - 943-11 ..... Ground-Fault Circuit-Interrupters
  - 1449-07 ..... Surge Protective Devices
  - 1472-96 ..... Solid State Dimming Controls

## PART 2 - PRODUCTS

### 2.1 RECEPTACLES

- A. General: All receptacles shall comply with NEMA, NFPA, UL, and as shown on the drawings.
  - 1. Mounting straps shall be plated steel, with break-off plaster ears and shall include a self-grounding feature. Terminal screws shall be brass, brass plated or a copper alloy metal.
  - 2. Receptacles shall have provisions for back wiring with separate metal clamp type terminals (four minimum) and side wiring from four captively held binding screws.
- B. Duplex Receptacles: Hospital-grade, single phase, 20 ampere, 120 volts, 2-pole, 3-wire, NEMA 5-20R, with break-off feature for two-circuit operation.
  - 1. Bodies shall be ivory in color.
  - 2. Switched duplex receptacles shall be wired so that only the top receptacle is switched. The lower receptacle shall be unswitched.
  - 3. Duplex Receptacles on Emergency Circuit:
    - a. In rooms without emergency powered general lighting, the emergency receptacles shall be of the self-illuminated type.

4. Ground Fault Interrupter Duplex Receptacles: Shall be an integral unit, hospital-grade, suitable for mounting in a standard outlet box, with end-of-life indication and provisions to isolate the face due to improper wiring.
  - a. Ground fault interrupter shall be consist of a differential current transformer, solid state sensing circuitry and a circuit interrupter switch. Device shall have nominal sensitivity to ground leakage current of 4-6 milliamperes and shall function to interrupt the current supply for any value of ground leakage current above five milliamperes (+ or – 1 milliampere) on the load side of the device. Device shall have a minimum nominal tripping time of 0.025 second.
  - b. Ground Fault Interrupter Duplex Receptacles (not hospital-grade) shall be the same as ground fault interrupter hospital-grade receptacles except for the hospital-grade listing.
- C. Weatherproof Receptacles: Shall consist of a duplex receptacle, mounted in box with a gasketed, weatherproof, cast metal cover plate and cap over each receptacle opening. The cap shall be permanently attached to the cover plate by a spring-hinged flap. The weatherproof integrity shall not be affected when heavy duty specification or hospital grade attachment plug caps are inserted. Cover plates on outlet boxes mounted flush in the wall shall be gasketed to the wall in a watertight manner.

## **2.2 TOGGLE SWITCHES**

- A. Toggle switches shall be totally enclosed tumbler type with nylon bodies. Handles shall be ivory in color unless otherwise specified or shown on the drawings.
  1. Switches installed in hazardous areas shall be explosion-proof type in accordance with the NEC and as shown on the drawings.
  2. Shall be single unit toggle, butt contact, quiet AC type, heavy-duty general-purpose use with an integral self grounding mounting strap with break-off plaster ears and provisions for back wiring with separate metal wiring clamps and side wiring with captively held binding screws.
  3. Switches shall be rated 20 amperes at 120-277 Volts AC.

## **2.3 WALL PLATES**

- A. Wall plates for switches and receptacles shall be type 302 stainless steel. Oversize plates are not acceptable.
- B. For receptacles or switches mounted adjacent to each other, wall plates shall be common for each group of receptacles or switches.
- C. In areas requiring tamperproof wiring devices, wall plates shall be type 302 stainless steel, and shall have tamperproof screws and beveled edges.
- D. Duplex Receptacles on Emergency Circuit: Wall plates shall be type 302 stainless steel, with the word "EMERGENCY" engraved in 6 mm (1/4 inch) red letters.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Installation shall be in accordance with the NEC and as shown as on the drawings.
- B. Install wiring devices after wall construction and painting is complete.
- C. The ground terminal of each wiring device shall be bonded to the outlet box with an approved green bonding jumper, and also connected to the branch circuit equipment grounding conductor.
- D. Outlet boxes for toggle switches and manual dimming controls shall be mounted on the strike side of doors.
- E. Provide barriers in multigang outlet boxes to comply with the NEC.
- F. Coordinate the electrical work with the work of other trades to ensure that wiring device flush outlets are positioned with box openings aligned with the face of the surrounding finish material. Pay special attention to installations in cabinet work, and in connection with laboratory equipment.
- G. Exact field locations of floors, walls, partitions, doors, windows, and equipment may vary from locations shown on the drawings. Prior to locating sleeves, boxes and chases for roughing-in of conduit and equipment, the Contractor shall coordinate exact field location of the above items with other trades.
- H. Install wall switches 1.2 M (48 inches) above floor, with the toggle OFF position down.
- I. Install wall dimmers 1.2 M (48 inches) above floor.
- J. Install receptacles 450 mm (18 inches) above floor, and 152 mm (6 inches) above counter backsplash or workbenches. Install specific-use receptacles at heights shown on the drawings.
- K. Label device plates with a permanent adhesive label listing panel and circuit feeding the wiring device.

#### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform manufacturer's required field checks in accordance with the manufacturer's recommendations. In addition, include the following:
  - 1. Visual Inspection and Tests:
    - a. Inspect physical and electrical condition.
    - b. Vacuum-clean surface metal raceway interior. Clean metal raceway exterior.
    - c. Test wiring devices for damaged conductors, high circuit resistance, poor connections, inadequate fault current path, defective devices, or similar problems using a portable receptacle tester. Correct circuit conditions, remove malfunctioning units and replace with new, and retest as specified above.
    - d. Test GFCI receptacles.
  - 2. Healthcare Occupancy Tests:
    - a. Test hospital grade receptacles for retention force per NFPA 99.

---END---

**SECTION 26 29 21**  
**ENCLOSED SWITCHES AND CIRCUIT BREAKERS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of fused and unfused disconnect switches (indicated as switches in this section), and separately-enclosed circuit breakers for use in electrical systems rated 600 V and below.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Low-voltage conductors.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground faults.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits.
- E. Section 26 24 16, PANELBOARDS: Molded-case circuit breakers.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
  - 1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Submit the following data for approval:
      - 1) Electrical ratings, dimensions, mounting details, materials, required clearances, terminations, weight, fuses, circuit breakers, wiring and connection diagrams, accessories, and device nameplate data.
  - 2. Manuals:
    - a. Submit complete maintenance and operating manuals including technical data sheets, wiring diagrams, and information for ordering fuses, circuit breakers, and replacement parts.
      - 1) Include schematic diagrams, with all terminals identified, matching terminal identification in the enclosed switches and circuit breakers.
      - 2) Include information for testing, repair, troubleshooting, assembly, and disassembly.

- b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
- 3. Certifications: Two weeks prior to final inspection, submit the following.
  - a. Certification by the manufacturer that the enclosed switches and circuit breakers conform to the requirements of the drawings and specifications.
  - b. Certification by the Contractor that the enclosed switches and circuit breakers have been properly installed, adjusted, and tested.

### 1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. International Code Council (ICC):
  - IBC-12 ..... International Building Code
- C. National Electrical Manufacturers Association (NEMA):
  - FU I-07 ..... Low Voltage Cartridge Fuses
  - KS I-06 ..... Enclosed and Miscellaneous Distribution Equipment Switches  
(600 Volts Maximum)
- D. National Fire Protection Association (NFPA):
  - 70-11 ..... National Electrical Code (NEC)
- E. Underwriters Laboratories, Inc. (UL):
  - 98-07 ..... Enclosed and Dead-Front Switches
  - 248-00 ..... Low Voltage Fuses
  - 489-09 ..... Molded Case Circuit Breakers and Circuit Breaker Enclosures

## PART 2 - PRODUCTS

### 2.1 FUSED SWITCHES RATED 600 AMPERES AND LESS

- A. Switches shall be in accordance with NEMA, NEC, UL, as specified, and as shown on the drawings.
- B. Shall be NEMA classified Heavy Duty (HD).
- C. Shall be horsepower (HP) rated.
- D. Shall have the following features:
  - 1. Switch mechanism shall be the quick-make, quick-break type.
  - 2. Copper blades, visible in the open position.
  - 3. An arc chute for each pole.
  - 4. External operating handle shall indicate open and closed positions, and have lock-open padlocking provisions.

5. Mechanical interlock shall permit opening of the door only when the switch is in the open position, defeatable to permit inspection.
6. Fuse holders for the sizes and types of fuses specified.
7. Solid neutral for each switch being installed in a circuit which includes a neutral conductor.
8. Ground lugs for each ground conductor.
9. Enclosures:
  - a. Shall be the NEMA types shown on the drawings.
  - b. Where the types of switch enclosures are not shown, they shall be the NEMA types most suitable for the ambient environmental conditions.
  - c. Shall be finished with manufacturer's standard gray baked enamel paint over pretreated steel.

## **2.2 UNFUSED SWITCHES RATED 600 AMPERES AND LESS**

- A. Shall be the same as fused switches, but without provisions for fuses.

## **2.3 FUSED SWITCHES RATED OVER 600 AMPERES TO 1200 AMPERES**

- A. Shall be the same as fused switches, and shall be NEMA classified Heavy Duty (HD).

## **2.4 SEPARATELY-ENCLOSED CIRCUIT BREAKERS**

- A. Provide circuit breakers in accordance with the applicable requirements in Section 26 24 16, PANELBOARDS.
- B. Enclosures shall be the NEMA types shown on the drawings. Where the types are not shown, they shall be the NEMA type most suitable for the ambient environmental conditions.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Installation shall be in accordance with the manufacturer's instructions, the NEC, as shown on the drawings, and as specified.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:
  1. Visual Inspection and Tests:
    - a. Compare equipment nameplate data with specifications and approved shop drawings.
    - b. Inspect physical, electrical, and mechanical condition.
    - c. Verify tightness of accessible bolted electrical connections by calibrated torque-wrench method.
    - d. Vacuum-clean enclosure interior. Clean enclosure exterior.

---END---

**SECTION 26 36 24**  
**ENERGY MONITORING AND CONTROL SYSTEM (EMCS)**

**PART 1 - GENERAL**

**1.1 SYSTEM DESCRIPTION**

- A. Furnish and install a complete Energy Monitoring and Control System (EMCS) with reporting, in compliance with The Joint Commission (TJC) specifications EC.02.05, NFPA99, and NFPA110, as detailed on the drawings and as described in this specification. The system is defined to include, but not be limited to, remote devices for monitoring, control and protection, device communication interface hardware, inter-communication wiring, personal computer workstations, software, printer where specified, generator controllers, and ancillary equipment.
- B. The EMCS vendor shall demonstrate the system is not a prototype and that at least 20 similar systems have been field installed and successfully operated for at least three years. The EMCS vendor shall have full responsibility for insuring that the EMCS system performs as specified. Vendors not meeting the qualification requirements will not be considered. All components shall be UL Listed.
- C. The EMCS shall utilize Ethernet as the high-speed backbone network that supports direct connection of an unlimited number of personal computer workstations anywhere on the network.
- D. Each Personal Computer Workstation (PCW) connected to the network shall have web based access to the power monitoring system information. Authorized users shall have the ability to view system information and publish documentation for the required monthly THE JOINT COMMISSION (TJC) testing of the emergency power supply system (EPSS).
- E. The Energy Monitoring and Control System (EMCS) shall be provided under base bid. Refer to 01 00 00 GENERAL REQUIREMENTS and drawings for deduct alternate descriptions.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section in Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Cables and wiring.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personal safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAYS AND BOXES FOR ELECTRICAL SYSTEMS: Raceways for power and control wiring.
- E. SECTION 27 15 00, COMMUNICATIONS HORIZONTAL CABLING: Communications media for interconnecting automatic transfer switches and remote control and annunciation components.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

- B. A factory-authorized representative shall maintain a service center capable of providing emergency maintenance and repair services at the project site within an 24 hour maximum response time.

#### 1.4 SUBMITTALS

- A. Submit in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Shop Drawings:
  - 1. Clearly present sufficient information to determine compliance with drawings and specifications.
  - 2. Include electrical ratings (including withstand), dimensions, weights, mounting details, conduit entry provisions front view, side view, equipment and device arrangement, elementary and interconnection wiring diagrams, factory relay settings, and accessories.
  - 3. Submit to NEMA ICS 1 indicating control panel layouts, wiring connections and diagrams, dimensions, support points.
  - 4. Complete nameplate data, including manufacturer's name and catalog number.
  - 5. EPSS Report: Submit a sample THE JOINT COMMISSION (TJC) report demonstrating compliance with this specification.
  - 6. Indicate electrical characteristics and connection requirements. When EMCS components are installed by the ATS manufacturer, the power equipment shop drawings shall clearly identify the components, the internal connections, and all contractor connections. The EMCS drawings shall show all EMCS components and indicate external wiring requirements. Drawings shall identify terminal blocks used for interconnections and wire type to be used.
- C. Manuals:
  - 1. When submitting the shop drawings, submit companion copies of complete maintenance and operating and maintenance manuals, including technical data sheets, wiring diagrams and information, such as telephone number, fax number and web sites, for ordering replacement parts.
  - 2. Two weeks prior to final inspection, submit four copies of a final updated maintenance and operating manual to the COR.
    - a. Include complete "As Installed" diagrams that indicate all pieces of equipment and their interconnecting wiring.
    - b. Include complete diagrams of the internal wiring for each piece of equipment, including "As Installed" revisions of the diagrams.
    - c. The wiring diagrams shall identify the terminals to facilitate installation, maintenance, operation, and testing.
- D. Certifications:
  - 1. Two weeks prior to final inspection, submit four copies of the following to the COR:

- a. Certification by the manufacturer that the equipment conforms to the requirements of the drawings and specifications.
- b. Certification by the contractor that the equipment has been properly installed, adjusted, and tested.

**1.6 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only:
- B. Institute of Electrical and Electronic Engineers (IEEE):
  - 446-95 ..... Recommended Practice for Design and Maintenance of Emergency and Standby Power Systems
  - C37.90.1-02 ..... Surge Withstand Capability (SWC) Tests for Relays and Relay Systems Associated with Electric Power Apparatus
  - C62.41.1-02 ..... Guide on the Surges Environment in Low-Voltage (1000 V and Less) AC Power Circuits
  - C62.41.2..... Recommended Practice on Characterization of Surges in Low-Voltage (1000 V and Less) AC Power Circuits
- C. National Electrical Manufacturers Association (NEMA):
  - 250-03 ..... Enclosure for Electrical Equipment (1000 Volts Maximum)
  - ICS 6-06 ..... Enclosures
  - IC3 4-05 ..... Industrial Control and Systems: Terminal Blocks
  - MG 1-07 ..... Motors and Generators
- D. National Fire Protection Association (NFPA):
  - 70-11 ..... National Electrical Code (NEC)
  - 99-05 ..... Health Care Facilities
  - 110-10 ..... Emergency and Standby Power Systems
- E. Underwriters Laboratories, Inc. (UL):
  - 50-95 ..... Enclosures for Electrical Equipment
  - 508-99 ..... Industrial Control Equipment
  - 891-05 ..... Dead-Front Switchboards
  - 1008-96 ..... Transfer Switch Equipment

**1.7 SYSTEM COORDINATION**

- A. The Energy Monitoring & Control System (EMCS), existing ATS and Generator vendors shall coordinate their offerings to assure full compatibility. The following interfaces are to be provided for the EMCS:
  - 1. Generator Main Breaker metering (CM-ADV)
  - 2. Generator “Run” status contact to CM-ADV digital input
  - 3. ATS switch metering (ATS-MONITOR)

4. ATS Status contacts to ATS-MONITOR digital inputs to include:
  - a. ATS "Normal" switch position status contact
  - b. ATS "Emergency" switch position status contact
  - c. ATS "Engine Test" switch status contact
  - d. ATS "Normal Source Available" status contact
  - e. ATS "Emergency Source Available" status contact
  - f. ATS "In Bypass-Normal" status contact
  - g. ATS "In Bypass-Emergency" status contact
  - h. ATS "Automatic Transfer Section-Connected" status contact
  - i. ATS "Test without transfer" status contact

## **PART 2 - PRODUCTS**

### **2.1 ATS-MONITOR**

- A. The ATS Monitor provides comprehensive metering, status monitoring and onboard data logging of automatic transfer switches (ATS).
- B. Coordination:
  1. An ATS Monitor shall be provided on all new or existing ATS switches as indicated on the drawings.
  2. ATS Monitor shall be installed in a separate enclosure.
  3. ATS Status contacts to ATS-MONITOR digital inputs to include:
    - a. ATS "Normal" switch position status contact
    - b. ATS "Emergency" switch position status contact
    - c. ATS "Test" switch status contact
    - d. ATS "Normal Source Available" status contact
    - e. ATS "Emergency Source Available" status contact
    - f. ATS "In Bypass-Normal" status contact
    - g. ATS "In Bypass-Emergency" status contact
    - h. ATS "Automatic Transfer Section-Connected" status contact
    - i. ATS "Engine Test without transfer" status contact
    - j. Contractor shall provide contacts in existing ATS's to accomplish functions listed above. Coordinate with existing ATS manufacturer closely to provide these components.
- C. The ATS Monitor shall provide the following features:
  1. Accuracy of 0.075% of reading plus 0.025% of full scale for voltage and current sensing, and 0.15% of reading plus 0.025% of full scale for power and energy, accurate through the 63rd harmonic.
  2. No annual recalibration by users shall be required to maintain these accuracies.
  3. Shall be rated for an operating temperature range of -25°C to 70°C.

4. The metering inputs shall utilize current transformers for the current inputs. It shall be rated 5A nominal and 10A full scale.
  5. The device shall not require potential transformers or control power transformers when applied at 600V or less.
  6. The ATS-MONITOR shall accept a continuous control power over a range of 100-415Vac, 50, 60, or 400 HZ, or 100-300Vdc.
  7. Provide UPS in meter enclosures for generator ride through to EM power.
  8. Each ATS-MONITOR shall have built-in RS-485 Modbus RTU data communications.
  9. Each ATS-MONITOR shall be equipped with a backlit, LCD display capable of displaying three phases and neutral values at the same time.
  10. The real-time information provided by the ATS-MONITOR shall include the following:
    - a. Current, per-phase
    - b. Neutral current measurements
    - c. Voltage, phase-to-phase & phase-neutral
    - d. Real Power (kW), per phase & three-phase total
    - e. Reactive Power (kVAR), per phase & three phase total
    - f. Apparent Power (kVA), per phase & three phase total
    - g. Power Factor (true), per-phase & three-phase total
    - h. Frequency readings
    - i. Real Energy (kWh), three phase total
    - j. Reactive Energy (kVARh), three phase total
    - k. Apparent Energy (kVAh), three phase total
    - l. Energy Accumulation modes, signed, absolute, energy in, energy out
    - m. Demand Current, per-phase & neutral, present & peak
    - n. Real Power Demand (kWd) readings, three phase total, present & peak
    - o. Reactive Power Demand (kVARd) readings, three phase total, present & peak
    - p. Apparent Power Demand (kVAd) readings, three phase total, present & peak
    - q. Total Harmonic Distortion (THD) readings, voltage & current, per phase
- D. The event recording, alarming, and control features include:
1. Date and Time Stamping, peak demands, power up/restart and resets
  2. Alarms for over/under voltages (per phase L-L, L-N), over/under currents (per phase, neutral), over/under frequency, current unbalance (per phase), and voltage unbalance (per phase L-L, L-N) displayable from the EMCS
  3. Minimum and maximum readings - I,V,F,PF,THD
  4. 800K Onboard memory provided
  5. Relay output capability provided

## 2.2 ENGINE CONTROL PANEL INTERFACE (GEN-MONITOR)

- A. The GEN-Monitor shall interface with the Emergency Power Supply (EPS) generator(s) to monitor and log engine and generator parameters.
- B. Coordination:
  - 1. The EMCS and existing generator manufacturers shall coordinate their bid packages to assure complete compatibility with the EMCS monitoring and EPSS reporting features described in this specification.
  - 2. The existing generators are equipped with an intelligent electronic engine control package with remote Modbus RTU communications to interface with the EMCS. Where not present, provide communications connections for future use (for controller alarms, sensors, etc).
  - 3. Install all required cabling between the engine controller and the GEN-Monitor.
- C. The Generator Control Module package shall provide the following information via communications to the EMCS Gen-Monitor:
  - 1. Generator Current, per-phase
  - 2. Generator Voltage, phase-to-phase & phase-neutral
  - 3. Generator Real Power (kW), per phase & three-phase total
  - 4. Generator Reactive Power (kVAR), per phase & three phase total
  - 5. Generator Apparent Power (kVA), per phase & three phase total
  - 6. Generator Power Factor (true), per-phase & three-phase total
  - 7. Generator Frequency readings
  - 8. Engine RPM
  - 9. Engine Oil Pressure
  - 10. Engine Oil Temperature
  - 11. Engine Coolant Temperature
  - 12. Engine Run Hours
  - 13. Battery Voltage
  - 14. Engine Exhaust Temperature
  - 15. Fuel consumption
- D. Test Control – the GEN-Monitor shall include a controller to provide supervision of the EPSS testing as described in Section 1.02 B.4
  - 1. The GEN-Monitor shall maintain the EPSS testing until the requirements (NFPA110) are satisfied
  - 2. The operator shall have the ability to override the extended test and return the loads to the normal power source. This will result in the test report indicating a “failed” monthly EPSS test.
  - 3. The Test Control shall re-transfer ATS switches (Test Method 1) or re-close Main breaker (Test Method 2) at the completion of the EPSS test.

4. The test controller shall be programmable to allow additional customized features to be added.
  5. The Test Control Option shall not interfere or impair the emergency standby operation of the EPSS system or the ability of the operators to control generators or ATS switches.
  6. Provide "test without transfer" of load feature.
- E. The Gen-MONITOR shall provide an interface to the generator control panel(s) and connect to the EMCS via Modbus RTU or Modbus TCP, as indicated on the project drawings.
- F. The Gen-MONITOR shall operate in ambient temperatures of -30 to 80° C, ambient storage

### **2.3 EMCS PC & APPLICATION SOFTWARE**

#### **A. General**

1. The EMCS server shall serve as central monitoring station for the devices in the system, recording events, indicating alarm conditions, logging and displaying system reports.
2. Engineering Client workstations are required to initiate a remote test and to create reports. Once created, existing reports can be modified in the Web Client.
3. The software shall be developed by the manufacturer of the monitoring devices, and shall be designed specifically for power monitoring and control.
4. The software shall be configured, not programmed. All software shall be configured by the vendor and delivered ready to use. This configuration shall include preparation of all graphics, displays, and interactive one-line diagrams required as a part of this project.
5. Configuration shall be to the point that when additional monitoring devices are added, the user shall only need to convey to the software the communications address and type of the new device. The software shall then be able to display all data from that device in a format identical to that used for other devices of the same type.
6. The software shall be supported by the manufacturer by regular maintenance upgrades either by remote support or service personnel.
7. The manufacturer shall provide regularly scheduled classes to provide instruction to the user on the operation of the software. Training will include but not be limited to: the addition of future devices to the system, proper use and setup of reports and alarming, and other operations associated with the operation of the EMCS.
8. The software vendor shall offer a Technical Support program to offer technical assistance on using the software and associated monitoring devices to manage the EMCS. The vendor shall have the ability to connect remotely to the EMCS to troubleshoot and diagnose any problems.
9. System shall be sized to pick up entire campus as shown on EMCS riser diagram and campus site plan.

#### **B. Personal Computer Workstation (PCW)**

1. The most current technology rack mounted server, software and hardware as recommended by Manufacturer.

C. System Server Rack Equipment

1. 42U Enclosed Server Rack, ventilated with lockable door.
2. Redundant XDA cooling.
3. Redundant power supply.
4. LC Fiber patch panel.
5. CAT 6 copper patch panel.
6. Managed Gigabit switches.
7. Rack mount UPS
8. Monitoring software.
9. Reporting and analytics package.
10. Windows server
11. Unlimited SQL server. Two copies required for dual-core processor.
12. LCD, Keyboard console tray.
13. Wire management.
14. Enterprise server:
  - a. Dual 6 core processor
  - b. Redundant Raid 10TB hard drive
  - c. Redundant 10/1000Mbps network ports
  - d. Redundant 1100W power supply.

D. EMCS Software

1. Shall reside on the PCW connected to the network able to poll and support the number of devices shown in the table above and communicate to other web client PCs on the LAN/WAN if required.
2. EMCS Software shall support a minimum of 100 simultaneous web clients.
3. Software shall support the following communications and protocols:
  - a. Modbus TCP/IP (Ethernet) @ 100Mbps
  - b. Serial Modbus RTU RS-485 @115k Baud with the use of an EMCS supplier RS-486 to Ethernet converter.
4. The EMCS software shall use the Microsoft SQL database.
5. Shall provide multiple levels of security to protect system data, i.e. Monitor, Controller and Administrator. Advanced Encryption Standard (AES 128 bit) per NIST.
6. Shall support unlimited user accounts, each with a unique name and password.
7. Shall provide three privilege access levels that determine which functions each user/account can access.
8. Set up and control functions shall be password protected and the control function shall prompt for a password from all monitor and control level user.
9. Shall permit device setup including configuration of data, alarm and waveform logs. Shall allow the user to define alarms and configure relay operation.

10. Shall allow devices and quantities to be organized into logical groups (function, location, department, etc.). Groups shall be user defined, each group having a unique name.
11. Shall include an on-line, context sensitive help system.
12. Alarms/Events shall be recorded in an Alarm Log view.
13. Alarm Log shall be capable of holding at least 10,000 events. The number of viewable events shall be user defined and only limited by size of storage drive.
14. The Alarm Log shall record date/time of the event, event description, and user name (if applicable).
15. The Alarm Log shall record occurrences that are related to the operation of the software such as breakers opening, or closing, loss of power, loss of device communications, user logon, changes to system setup, etc.
16. Shall monitor for real-time alarm conditions detected by each device and indicate the alarm at the PCW.
17. Shall provide waveform capture of graphical displays and analysis including:
  - a. Waveform Captures (up to 512 samples per cycle)
  - b. Transient Captures (200 nanosecond resolution / 10,000VL-L Peak)
  - c. 3-Phase Voltages L-L, L-N
  - d. 3-Phase Currents
  - e. Neutral Currents
  - f. Residual (Ground) Current
  - g. 3-Phase Voltage & 3-Phase Current WFC Overlays
  - h. Per phase Voltage/Current Overlays
  - i. Harmonic Analysis for each waveform (through 255th harmonic)
  - j. Harmonic Spectrum Plot for each waveform (through 255th harmonic)
  - k. RMS Plot for each waveform
  - l. Zoom-In & Zoom-Out Features
18. Shall provide real time, user friendly tabular displays of electric plant information.
19. Shall provide nominal device ratings including amperage, voltage, and power as part of the displayed system information.
20. Shall provide the capability to report sums, differences, and percentages of real-time readings for multiple devices. This data shall be available for real-time reporting, logging and trending, and alarm functions.
21. EMCS Standard Reporting shall provide standard report templates that include:
  - a. Test Report, as per NFPA 110
  - b. Outage Report, as per NFPA 110
  - c. Energy Report, as per NEC 220.87
  - d. Historical Log Report
  - e. Alarm Analytics Report

- f. Settings Report
    - g. User activity report
  - 22. Report presentation shall be available in a number of graphics formats:
    - a. Trends
    - b. Tables
    - c. Histograms
    - d. Pareto Charts
    - e. Pie Charts
    - f. Bar Charts
  - 23. Graphics shall be customizable by changing colors, text, headings, size, graphic plot styles (bar graphs, line graphs, etc).
  - 24. Statistics on trending data for devices in the EMCS system which includes minimum and maximum values and their associated date and time stamps, average value.
  - 25. Reports shall be exportable in PDF, Excel, CSV, Rich Text and TIFF file formats.
  - 26. Users shall have the ability to Email reports.
  - 27. Users shall be able to generate either on demand or as a scheduled task to run automatically at specified intervals to which the report is then emailed to user configured as recipients.
- E. Web-Enabled Interactive Graphics Client
- 1. The Web-Enabled Interactive Graphics Client shall only reside on the PCW, Client PCW's shall be web browser and resolution independent.
  - 2. Shall be a color graphics Web application that allows display of real-time information collected by the network server from the power monitoring devices on custom drawings including single line drawings, site plans or pictorial backgrounds.
  - 3. Software shall include a graphics software package to assist with the creation of graphics pages
  - 4. The Interactive Graphics software shall allow the user to scale, and scroll the drawings to the desired degree of magnification. User selectable zoom.
  - 5. The software shall be capable of displaying status of circuit breakers (open/closed/tripped), status of automatic transfer switches (normal/emergency/bypass), generator status (run/stopped), and other information available on the EMCS network. The data shall be available in multiple formats value blocks, meters, and bar charts.
  - 6. From within any drawing the user shall have the ability to link and display drawings in a hierarchical fashion to allow quick access to related drawings.
  - 7. Components shown on one-line diagrams shall be color-coded based on the on/off status signals from the device.
  - 8. User shall have the ability to upload drawings in PDF or picture format to a dashboard screen.

9. The software shall be able to display various file types in the directory structure to permit the user to view relevant documentation from the interface(for example-Acrobat and Word files)

F. E-mail Notification Function

1. The E-Mail notification function shall be an integrated function to the EMCS software to provide message capabilities to the EMCS system.
  - a. The e-mail notification function shall consolidate all alarms into a single e-mail from the time of the first alarm to an administrator defined duration minimizing e-mail traffic.
  - b. All alarm conditions shall be configurable to receive e-mail notification.

**2.4 EPSS REPORTING MODULE**

- A. The EPSS Reporting Module uses the information from the EMCS database and operator entries to provide a single, comprehensive monthly testing and maintenance report for emergency power supply system.
- B. The EPSS Reporting module shall be a standard software product that is configured, not programmed.
- C. The EPSS Report is accessed through a user friendly “wizard” style interface
- D. Reports shall be automatically e-mailed to all configured users at the end of the test.
- E. Report generation shall be simplified by the automatically filling report fields from previous sessions. The report fields filled include:
  1. Organization name.
  2. Operator Name.
  3. Generator Nameplate Data
  4. Test Set-Point KW Values
  5. Minimum Test Duration
- F. The EPSS Test Report Module shall publish reports with the following content:
  1. Title Page– with title-of-report, company name, technician, test date, and a list of ATS devices and generators used in the test.
  2. ATS & Gen Activity Log – Time/Date events for ATS switches and Generators included in the test, including:
    - a. ATS Switch List
    - b. ATS Transfer time in seconds
    - c. ATS Transfer Time (10 second) pass/fail verification
    - d. Gen Run time stamped
    - e. Gen Stop time stamped
    - f. ATS Switches Transfer time stamped
    - g. ATS Switches Re-transfer time stamped
  3. Generator Summary provided for each generator involved in the test. Information provided includes:
    - a. Generator Name

- b. Generator Nameplate Rating
  - c. Generator Start Time
  - d. Generator Stop Time
  - e. Gen Pass/Fail Verification for testing per NFPA110
  - f. Gen KW, KVA Trend Plot for Test with Indication of 30% Nameplate Setpoint
  - g. Engine Runtime Readings
  - h. Generator Current Readings (per phase & average)
  - i. Generator Voltage Readings (L-L, L-N)
4. Operator Comments Page – Technician area to document test observations, maintenance, and any repairs completed.

## 2.5 EMCS NETWORK

- A. All EMCS devices, equipped with RS485 Modbus or Modbus Ethernet communications, shall be wired in a daisy-chain or homerun configuration. The devices shall be connected to an EMCS Ethernet interfaces as indicated on the drawings.
- B. Provide add-on Ethernet cards for all meters and Ethernet Gateways as indicated on the drawings.
  - 1. The Ethernet interfaces shall allow all monitored equipment to communicate over the new dedicated EMCS fiber Ethernet LAN.
  - 2. The Ethernet communication shall be fully TCP/IP compliant thereby allowing the power monitoring software access to power monitoring information from anywhere on the local area network (LAN) or via the Wide Area Network (WAN).
  - 3. The protocol used over Ethernet shall be Modbus/TCP an international industry standard which is an open and well-defined protocol.
  - 4. Setup of the Ethernet communication shall be accomplished via the on-board Ethernet port and a web browser. It shall also be possible via the Ethernet port to upgrade the firmware of the Ethernet communication card in the field to accommodate new system features.
  - 5. All Ethernet cabling shall be installed by a qualified data communications cable installer or the electrical contractor qualified to install data communications equipment. All communications cabling shall be Category 5 rated for 100baseT, or Fiber Optics rated for 100baseFX.
  - 6. Ethernet communication cards shall derive control power directly from the power monitoring devices they are attached to.
  - 7. The Ethernet Gateway requires a separate 120 VAC power source.
  - 8. The Ethernet communication interfaces shall be UL Listed, and CE and CSA certified.
- C. Additional Network Media Options

1. Fiber optics shall be installed where shown on the project drawings. Fiber optic modems and interface hardware shall be provided by the EMCS vendor as required. Use of fiber optics shall be transparent to EMCS software and monitoring devices.
2. All EMCS components shall work with existing Ethernet Gateway, Router, and Hub technology. Where required, the EMCS vendor shall supply the hubs, switches, etc. to connect to the existing facility LAN. Use of Ethernet shall be transparent to EMCS software and monitoring devices.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. EMCS components, including ATS Monitors, Generator Monitors, and Controllers shall be installed and wired per the manufacturers requirements
- B. Separate EMCS device enclosures may be provided where installation into the power equipment is not practical.
- C. All control power, CT, PT and data communications wire shall be factory wired when shipped inside the power equipment or will be field wired by a licensed electrical per manufacturer's instructions when the monitoring equipment is shipped separate from the power equipment.
- D. Where external circuit connections are required, terminal blocks shall be provided and the manufacturer's drawings must clearly identify the interconnection requirements including wire type to be used.
- E. Providing and install all conduit and cabling between EMCS devices and EMCS Gateways.
- F. Contractor interconnection wiring requirements shall be clearly identified on the EMCS system drawings.

#### **3.2 SYSTEM START-UP AND TRAINING**

- A. On-site start-up and commissioning of the EMCS system shall be provided by the EMCS supplier.
- B. On-site training of the EMCS shall be included in the project bid.
- C. Start-up shall include a complete working demonstration of the EMCS with simulation of possible operating conditions that may be encountered.
- D. Training shall include any documentation and hands-on exercises necessary to enable electrical operations personnel to assume full operating responsibility for the EMCS after completion of the training period.
- E. The project bid shall include 5 days minimum start-up assistance and 2 days training.
- F. Factory training tuition shall also be included for two persons. A complete list of courses offered shall be supplied with the submittals.

#### **3.3 RECORD DRAWINGS & MANUALS**

- A. Following EMCS commissioning, a system drawing indicating all EMCS devices, communications wiring, devices addresses, and LAN connections shall be provided.

- B. Operation & Maintenance manuals for each EMCS device and the EMCS software shall be compiled and provided – 5 sets are required.

### **3.4 SUPPORT SERVICES**

- A. The EMCS vendor shall staff a Technical Support Center with call-in and internet based support for the monitoring system provided.
- B. A 1 year software support agreement shall be included with the bid. The support agreement shall include:
  - 1. Free software updates for the EMCS software, Graphics Module, and EPSS Reporting Module
  - 2. Toll free access to the Technical Support Center
  - 3. Web-ex™ online support services

### **3.5 WARRANTY**

- A. The EMCS manufacturer shall warranty all products to be free of defect for a period of no less than 12 months from the date of system commissioning.
- B. The EMCS manufacturer shall replace or repair (at their option) any product found to be defective during the warranty period.

--- E N D ---

**SECTION 26 43 13**  
**SURGE PROTECTIVE DEVICES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of Type 2 Surge Protective Devices, as defined in NFPA 70, and indicated as transient voltage surge suppression or TVSS in this section.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- B. Section 26 24 16, PANELBOARDS: For factory-installed or external TVSS.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
  - 1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Include electrical ratings and device nameplate data.
  - 2. Manuals:
    - a. Submit, simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals including technical data sheets, wiring diagrams, and information for ordering replacement parts.
    - b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
  - 3. Certifications: Two weeks prior to final inspection, submit the following.
    - a. Certification by the manufacturer that the TVSS conforms to the requirements of the drawings and specifications.
    - b. Certification by the Contractor that the TVSS has been properly installed.

**1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplement and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. Institute of Engineering and Electronic Engineers (IEEE):

- IEEE C62.41.2-02 ..... Recommended Practice on Characterization of Surges in Low-Voltage (1000 V and Less) AC Power Circuits
- IEEE C62.45-03 ..... Recommended Practice on Surge Testing for Equipment Connected to Low-Voltage (1000 V and Less) AC Power Circuits

C. National Fire Protection Association (NFPA):

- 70-11 ..... National Electrical Code (NEC)

D. Underwriters Laboratories, Inc. (UL):

- UL 1283-05 ..... Electromagnetic Interference Filters
- UL 1449-06 ..... Surge Protective Devices

**PART 2 - PRODUCTS**

**2.1 PANELBOARD TVSS**

A. General Requirements:

1. Comply with UL 1449 and IEEE C62.41.2.
2. Modular design with field-replaceable modules, or non-modular design.
3. Fuses, rated at 200 kA interrupting capacity.
4. Bolted compression lugs for internal wiring.
5. Integral disconnect switch.
6. Redundant suppression circuits.
7. LED indicator lights for power and protection status.
8. Audible alarm, with silencing switch, to indicate when protection has failed.
9. Form-C contacts rated at 5 A and 250-V ac, one normally open and one normally closed, for remote monitoring of protection status. Contacts shall reverse on failure of any surge diversion module or on opening of any current-limiting device.
10. Four-digit transient-event counter.

B. Surge Current per Phase: Minimum 120kA per phase.

**2.2 ENCLOSURES**

A. Enclosures: NEMA 1.

**PART 3 - EXECUTION**

**3.1 INSTALLATION**

- A. Factory-installed TVSS: Switchgear, switchboard, or panelboard manufacturer shall install TVSS at the factory.
- B. Field-installed TVSS: Contractor shall install TVSS with conductors or buses between TVSS and points of attachment as short and straight as possible. Do not exceed manufacturer's recommended lead length. Do not bond neutral and ground.
  1. Provide a circuit breaker as a dedicated disconnecting means for TVSS as shown on drawings.

- C. Do not perform insulation resistance tests on switchgear, switchboards, panelboards, or feeders with the TVSS connected. Disconnect TVSS before conducting insulation resistance tests, and reconnect TVSS immediately after insulation resistance tests are complete.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:
  - 1. Visual Inspection and Tests:
    - a. Compare equipment nameplate data with specifications and approved shop drawings.
    - b. Inspect physical, electrical, and mechanical condition.
    - c. Verify that disconnecting means and feeder size and maximum length to TVSS corresponds to approved shop drawings.
    - d. Verifying tightness of accessible bolted electrical connections by calibrated torque-wrench method.
    - e. Vacuum-clean enclosure interior. Clean enclosure exterior.
    - f. Verify the correct operation of all sensing devices, alarms, and indicating devices.

### **3.3 FOLLOW-UP VERIFICATION**

- A. After completion of acceptance checks and tests, the Contractor shall show by demonstration in service that TVSS are in good operating condition and properly performing the intended function.

### **3.4 INSTRUCTION**

- A. Provide the services of a factory-trained technician for one 2-hour training period for instructing personnel in the maintenance and operation of the TVSS, on the date requested by the COR.

---END---

**SECTION 26 51 00  
INTERIOR LIGHTING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION:**

- A. This section specifies the furnishing, installation, and connection of the interior lighting systems. The terms "lighting fixture," "fixture," and "luminaire" are used interchangeably.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Low-voltage conductors.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.
- D. Section 26 27 26, WIRING DEVICES: Wiring devices used for control of the lighting systems.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
  - 1. Shop Drawings:
    - a. Submit the following information for each type of lighting fixture designated on the LIGHTING FIXTURE SCHEDULE, arranged in order of lighting fixture designation.
    - b. Material and construction details, include information on housing and optics system.
    - c. Physical dimensions and description.
    - d. Wiring schematic and connection diagram.
    - e. Installation details.
    - f. Energy efficiency data.
    - g. Photometric data based on laboratory tests complying with IES Lighting Measurements testing and calculation guides.
    - h. Lamp data including lumen output (initial and mean), color rendition index (CRI), rated life (hours), and color temperature (degrees Kelvin).
    - i. Ballast data including ballast type, starting method, ambient temperature, ballast factor, sound rating, system watts, and total harmonic distortion (THD).
  - 2. Manuals:

- a. Submit, simultaneously with the shop drawings, complete maintenance and operating manuals, including technical data sheets, wiring diagrams, and information for ordering replacement parts.
  - b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
3. Certifications: Two weeks prior to final inspection, submit the following.
- a. Certification by the Contractor that the interior lighting systems have been properly installed and tested.

### 1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American National Standards Institute (ANSI):
  - C78.1-91 ..... Fluorescent Lamps - Rapid-Start Types - Dimensional and Electrical Characteristics
  - C78.376-01 ..... Chromaticity of Fluorescent Lamps
- C. American Society for Testing and Materials (ASTM):
  - C635-07 ..... Manufacture, Performance, and Testing of Metal Suspension Systems for Acoustical Tile and Lay-in Panel Ceilings
- D. Environmental Protection Agency (EPA):
  - 40 CFR 261 ..... Identification and Listing of Hazardous Waste
- E. Federal Communications Commission (FCC):
  - CFR Title 47, Part 15 ..... Radio Frequency Devices
  - CFR Title 47, Part 18 ..... Industrial, Scientific, and Medical Equipment
- F. Illuminating Engineering Society (IES):
  - LM-79-08 ..... Electrical and Photometric Measurements of Solid-State Lighting Products
  - LM-80-08 ..... Measuring Lumen Maintenance of LED Light Sources
  - LM-82-12 ..... Characterization of LED Light Engines and LED Lamps for Electrical and Photometric Properties as a Function of Temperature
- G. Institute of Electrical and Electronic Engineers (IEEE):
  - C62.41-91 ..... Surge Voltages in Low Voltage AC Power Circuits
- H. International Code Council (ICC):
  - IBC-12 ..... International Building Code
- I. National Fire Protection Association (NFPA):

- 70-11 ..... National Electrical Code (NEC)
- 101-12 ..... Life Safety Code
- J. National Electrical Manufacturer's Association (NEMA):
  - C82.1-04 ..... Lamp Ballasts – Line Frequency Fluorescent Lamp Ballasts
  - C82.2-02 ..... Method of Measurement of Fluorescent Lamp Ballasts
  - C82.11-11 ..... Lamp Ballasts - High Frequency Fluorescent Lamp Ballasts
- K. Underwriters Laboratories, Inc. (UL):
  - 496-08 ..... Lampholders
  - 542-0599 ..... Fluorescent Lamp Starters
  - 844-12 ..... Luminaires for Use in Hazardous (Classified) Locations
  - 924-12 ..... Emergency Lighting and Power Equipment
  - 935-01 ..... Fluorescent-Lamp Ballasts
  - 1598-08 ..... Luminaires

## **PART 2 - PRODUCTS**

### **2.1 LIGHTING FIXTURES**

- A. Shall be in accordance with NFPA, UL, as shown on drawings, and as specified.
- B. Sheet Metal:
  - 1. Shall be formed to prevent warping and sagging. Housing, trim and lens frame shall be true, straight (unless intentionally curved), and parallel to each other as designed.
  - 2. Wireways and fittings shall be free of burrs and sharp edges, and shall accommodate internal and branch circuit wiring without damage to the wiring.
  - 3. When installed, any exposed fixture housing surface, trim frame, door frame, and lens frame shall be free of light leaks.
  - 4. Hinged door frames shall operate smoothly without binding. Latches shall function easily by finger action without the use of tools.
- C. Ballasts and lamps shall be serviceable while the fixture is in its normally installed position. Ballasts shall not be mounted to removable reflectors or wireway covers unless so specified.
- D. Lamp Sockets:
  - 1. Fluorescent: Single slot entry type, requiring a one-quarter turn of the lamp after insertion. Lampholder contacts shall be the biting edge type.
- E. Recessed fixtures mounted in an insulated ceiling shall be listed for use in insulated ceilings.
- F. Mechanical Safety: Lighting fixture closures (lens doors, trim frame, hinged housings, etc.) shall be retained in a secure manner by captive screws, chains, aircraft cable, captive hinges, or fasteners such that they cannot be accidentally dislodged during normal operation or routine maintenance.
- G. Metal Finishes:

1. The manufacturer shall apply standard finish (unless otherwise specified) over a corrosion-resistant primer, after cleaning to free the metal surfaces of rust, grease, dirt and other deposits. Edges of pre-finished sheet metal exposed during forming, stamping or shearing processes shall be finished in a similar corrosion resistant manner to match the adjacent surface(s). Fixture finish shall be free of stains or evidence of rusting, blistering, or flaking, and shall be applied after fabrication.
  2. Interior light reflecting finishes shall be white with not less than 85 percent reflectances, except where otherwise shown on the drawing.
  3. Exterior finishes shall be as shown on the drawings.
- H. Lighting fixtures shall have a specific means for grounding metallic wireways and housings to an equipment grounding conductor.
- I. Light Transmitting Components for Fluorescent Fixtures:
1. Shall be 100 percent virgin acrylic.
  2. Flat lens panels shall have not less than 3 mm (1/8 inch) of average thickness.
  3. Unless otherwise specified, lenses, reflectors, diffusers, and louvers shall be retained firmly in a metal frame by clips or clamping ring in such a manner as to allow expansion and contraction without distortion or cracking.

## **2.2 BALLASTS**

- A. Linear Fluorescent Lamp Ballasts: Multi-voltage (120 – 277V), electronic instant-start type, designed for type and quantity of lamps indicated. Ballasts shall be designed for full light output unless dimmer or bi-level control is indicated. Ballasts shall include the following features:
1. Lamp end-of-life detection and shutdown circuit (T5 lamps only).
  2. Automatic lamp starting after lamp replacement.
  3. Sound Rating: Class A.
  4. Total Harmonic Distortion (THD): 10 percent or less.
  5. Transient Voltage Protection: IEEE C62.41.1 and IEEE C62.41.2, Category A or better.
  6. Operating Frequency: 20 kHz or higher.
  7. Lamp Current Crest Factor: 1.7 or less.
  8. Ballast Factor: 0.87 or higher unless otherwise indicated.
  9. Power Factor: 0.98 or higher.
  10. EMR/RFI Interference: Comply with CFR Title 47 Part 18 for limitations on electromagnetic and radio-frequency interference for non-consumer equipment.

## **2.3 LAMPS**

- A. Linear and U-shaped T8 Fluorescent Lamps:
1. Except as indicated below, lamps shall be low-mercury energy saving type, have a color temperature between of 4100°K, a Color Rendering Index (CRI) equal or greater than 80, average rated life equal to or greater than 24,000 hours when used with an instant start

ballast and 30,000 hours when used with a programmed or rapid start ballast (based on 3 hour starts), and be suitable for use with dimming ballasts, unless otherwise indicated.

2. Lamps shall comply with EPA Toxicity Characteristic Leachate Procedure (TCLP) requirements.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Installation shall be in accordance with the NEC, manufacturer's instructions, and as shown on the drawings or specified.
- B. Align, mount, and level the lighting fixtures uniformly.
- C. Lighting fixtures shall not be attached directly to gypsum board.
- D. Lighting Fixture Supports:
  1. Shall provide support for all of the fixtures. Supports may be anchored to channels of the ceiling construction, to the structural slab or to structural members within a partition, or above a suspended ceiling.
  2. Shall maintain the fixture positions after cleaning and relamping.
  3. Shall support the lighting fixtures without causing the ceiling or partition to deflect.
  4. Hardware for recessed fluorescent fixtures:
    - a. Where the suspended ceiling system is supported at the four corners of the fixture opening, hardware devices shall clamp the fixture to the ceiling system structural members, or plaster frame at not less than four points in such a manner as to resist spreading of the support members and safely lock the fixture into the ceiling system.
    - b. Where the suspended ceiling system is not supported at the four corners of the fixture opening, hardware devices shall independently support the fixture from the building structure at four points.
  5. Hardware for surface mounting fluorescent fixtures to suspended ceilings:
    - a. In addition to being secured to any required outlet box, fixtures shall be bolted to a grid ceiling system at four points spaced near the corners of each fixture. The bolts shall be not less than 6 mm (1/4 inch) secured to channel members attached to and spanning the tops of the ceiling structural grid members. Non-turning studs may be attached to the ceiling structural grid members or spanning channels by special clips designed for the purpose, provided they lock into place and require simple tools for removal.
    - b. In addition to being secured to any required outlet box, fixtures shall be bolted to ceiling structural members at four points spaced near the corners of each fixture. Pre-positioned 6 mm (1/4 inch) studs or threaded plaster inserts secured to ceiling structural members shall be used to bolt the fixtures to the ceiling. In lieu of the above, 6 mm (1/4 inch) toggle bolts may be used on new or existing ceiling provided the plaster and lath can safely support the fixtures without sagging or cracking.

6. Surface mounted lighting fixtures:
  - a. Fixtures shall be bolted against the ceiling independent of the outlet box at four points spaced near the corners of each unit. The bolts (or stud-clips) shall be minimum 6 mm (1/4 inch) bolt, secured to main ceiling runners and/or secured to cross runners.  
Non-turning studs may be attached to the main ceiling runners and cross runners with special non-friction clip devices designed for the purpose, provided they bolt through the runner, or are also secured to the building structure by 12 gauge safety hangers. Studs or bolts securing fixtures weighing in excess of 25 kg (56 pounds) shall be supported directly from the building structure.
  - b. Where ceiling cross runners are installed for support of lighting fixtures, they must have a carrying capacity equal to that of the main ceiling runners and be rigidly secured to the main runners.
  - c. Fixtures less than 6.8 kg (15 pounds) in weight and occupying less than 3715 sq cm (two square feet) of ceiling area may, when designed for the purpose, be supported directly from the outlet box when all the following conditions are met.
    - 1) Screws attaching the fixture to the outlet box pass through round holes (not key-hole slots) in the fixture body.
    - 2) The outlet box is attached to a main ceiling runner (or cross runner) with approved hardware.
    - 3) The outlet box is supported vertically from the building structure.
  - d. Fixtures mounted in open construction shall be secured directly to the building structure with approved bolting and clamping devices.
7. Single or double pendant-mounted lighting fixtures:
  - a. Each stem shall be supported by an approved outlet box mounted swivel joint and canopy which holds the stem captive and provides spring load (or approved equivalent) dampening of fixture oscillations. Outlet box shall be supported vertically from the building structure.
8. Outlet boxes for support of lighting fixtures (where permitted) shall be secured directly to the building structure with approved devices or supported vertically in a hung ceiling from the building structure with a nine gauge wire hanger, and be secured by an approved device to a main ceiling runner or cross runner to prevent any horizontal movement relative to the ceiling.
- E. Furnish and install the new lamps as specified for all lighting fixtures installed under this project, and for all existing lighting fixtures reused under this project.
- F. The electrical and ceiling trades shall coordinate to ascertain that approved lighting fixtures are furnished in the proper sizes and installed with the proper devices (hangers, clips, trim frames, flanges, etc.), to match the ceiling system being installed.

- G. Bond lighting fixtures to the grounding system as specified in Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- H. At completion of project, replace all defective components of the lighting fixtures at no cost to the Government.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform the following:
  - 1. Visual Inspection:
    - a. Verify proper operation by operating the lighting controls.
    - b. Visually inspect for damage to fixtures, lenses, reflectors, diffusers, and louvers. Clean fixtures, lenses, reflectors, diffusers, and louvers that have accumulated dust, dirt, or fingerprints during construction.
  - 2. Electrical tests:
    - a. Burn-in all lamps that require specific aging period to operate properly, prior to occupancy by Government. Burn-in period to be 40 hours minimum, unless specifically recommended otherwise by the lamp manufacturer. Burn-in dimmed fluorescent and compact fluorescent lamps for at least 100 hours at full voltage, unless specifically recommended otherwise by the lamp manufacturer. Replace any lamps and ballasts which fail during burn-in.

### **3.3 FOLLOW-UP VERIFICATION**

- A. Upon completion of acceptance checks and tests, the Contractor shall show by demonstration in service that the lighting systems are in good operating condition and properly performing the intended function.

---END---

**SECTION 27 15 00**  
**COMMUNICATIONS HORIZONTAL CABLING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This Section specifies the furnishing, installing, certification, testing, and guaranty of a complete and operating Voice and Digital Cable Distribution System (here-in-after referred to as "*the System*"), and associated equipment and hardware to be installed in the VA Medical Center here-in-after referred to as "the Facility". The System shall include, but not be limited to: equipment cabinets, interface enclosures, and relay racks; necessary combiners, traps, and filters; and necessary passive devices such as: splitters, couplers, cable "patch", "punch down", and cross-connector blocks or devices, voice and data distribution sub-systems, and associated hardware. The System shall additionally include, but not be limited to: telecommunication closets (TC); telecommunications outlets (TCO); copper and fiber optic distribution cables, connectors, "patch" cables, and/or "break out" devices.
- B. The System shall be delivered free of engineering, manufacturing, installation, and functional defects. It shall be designed, engineered and installed for ease of operation, maintenance, and testing.
- C. The term "provide", as used herein, shall be defined as: designed, engineered, furnished, installed, certified, and tested, by the Contractor.
- D. The Voice and Digital Telecommunication Distribution Cable Equipment and System provides the media which voice and data information travels over and connects to the Telephone System which is defined as an Emergency Critical Care Communication System by the National Fire Protection Association (NFPA). Therefore, since the System connects to or extends the telephone system, the System's installation and operation shall adhere to all appropriate National, Government, and/or Local Life Safety and/or Support Codes, which ever are the more stringent for this Facility. At a minimum , the System shall be installed according to NFPA, Section 70, National Electrical Code (NEC), Article 517 and Chapter 7; NFPA, Section 99, Health Care Facilities, Chapter 3-4; NFPA, Section 101, Life Safety Code, Chapters 7, 12, and/or 13; Joint Commission on Accreditation of Health Care Organization (JCAHCO), Manual for Health Care Facilities, all necessary Life Safety and/or Support guidelines; this specification; and the original equipment manufacturer's (OEM) suggested installation design, recommendations, and instructions. The OEM and Contractor shall ensure that all management, sales, engineering, and installation personnel have read and understand the requirements of this specification before the System is designed, engineered, delivered, and provided.
- E. The VA Project Manager (PM) and/or if delegated, COR (COR) are the approving authorities for all contractual and mechanical changes to the System. The Contractor is cautioned to obtain in

writing, all approvals for system changes relating to the published contract specifications and drawings, from the PM and/or the COR before proceeding with the change.

F. System Performance:

1. At a minimum, the System shall be able to support the following voice and data operations for Category 5e Certified Telecommunication Service:
  - a. Provide the following interchange (or interface) capabilities:
    - 1) Basic Rate (BRI).
    - 2) Primary Rate (PRI).
  - b. ISDN :
    - 1) Narrow Band BRI:
      - a) B Channel: 64 kilo-Bits per second (kBps), minimum.
      - b) D Channel: 16 kBps, minimum.
      - c) H Channel: 384 kBps, minimum.
    - 2) Narrow Band PRI:
      - a) B Channel: 64 kBps, minimum.
      - b) D Channel: 64 kBps, minimum.
      - c) H Channel: 1,920 kBps, minimum.
    - 3) Wide (or Broad) Band: All channels: 140 mega(m)-Bps, minimum, capable to 565 mBps at "T" reference.
  - c. ATM operation and interface: ATM 155 mBps .
  - d. Frame Relay.
  - e. Integrated Data Communications Utility (IDCU) operation and interface.
  - f. Government Open Systems Interconnection Profile (GOSSIP) compliant.
  - g. Fiberoptic Distributed Data Interface (FDDI): A minimum 100 mBps to a maximum of 1.8 giga(g)-Bps data bit stream speed (shall be Synchronous Optical Network SONET compliant).
2. At a minimum the System shall support the following operating parameters:
  - a. EPBX connection:
    - 1) System speed: 1.0 gBps per second, minimum.
    - 2) Impedance: 600 Ohms.
    - 3) Cross Modulation: -60 deci-Bel (dB).
    - 4) Hum Modulation: -55 dB.
    - 5) System data error: 10 to the -10 Bps, minimum.
    - 6) Loss: Measured at the frame output with reference Zero (0) deciBel measured (dBm) at 1,000 Hertz (Hz) applied to the frame input.
      - a) Trunk to station: 1.5 dB, maximum.
      - b) Station to station: 3.0 dB, maximum.

- c) Internal switch crosstalk: -60 dB when a signal of  $\pm 10$  deciBel measured (dBm), 500-2,500 Hz range is applied to the primary path.
- d) Idle channel noise: 25 dBm "C" or 3.0 dBm "O" above reference (terminated) ground noise, whichever is greater.
- e) Traffic Grade of Service for Voice and Data:
  - (1) A minimum grade of service of P-01 with an average traffic load of 7.0 CCS per station per hour and a traffic overload in the data circuits will not interfere with, or degrade, the voice service.
  - (2) Average CCS per voice station: The average CCS capacity per voice station shall be maintained at 7.0 CCS when the EPBX is expanded up to the projected maximum growth as stated herein.
- b. Telecommunications Outlet (TCO):
  - 1) Voice:
    - a) Isolation (outlet-outlet): 24 dB.
    - b) Impedance: 600 Ohms, balanced (BAL).
    - c) Signal Level: 0 deciBel per mili-Volt (dBmV)  $\pm 0.1$  dBmV.
    - d) System speed: 100 mBps, minimum.
    - e) System data error: 10 to the -6 Bps, minimum.
  - 2) Data:
    - a) Isolation (outlet-outlet): 24 dB.
    - b) Impedance: 600 Ohms, BAL.
    - c) Signal Level: 0 dBmV  $\pm 0.1$  dBmV.
    - d) System speed: 120 mBps, minimum.
    - e) System data error: 10 to the -8 Bps, minimum.
  - 3) Fiber optic:
    - a) Isolation (outlet-outlet): 36 dB.
    - b) Signal Level: 0 dBmV  $\pm 0.1$  dBmV.
    - c) System speed: 540 mBps, minimum.
    - d) System data error: 10 to the -6 bps, minimum.

## 1.2 RELATED WORK

- A. Specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

## 1.3 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in text by basic designation only. Except for a specific date given the issue in effect (including amendments, addenda, revisions, supplements, and errata) on the date the system's submittal is technically approved by VA, shall be enforced.

B. National Fire Protection Association (NFPA):

70	NATIONAL ELECTRICAL CODE (NEC)
75	Protection of Electronic Computer/Data Processing Equipment
77	Recommended Practice on Static Electricity
	Standard for Health Care Facilities
101	Life Safety Code
1221	Emergency Services Communication Systems

C. Underwriters Laboratories, Inc. (UL):

65	Wired Cabinets
96	Lightning Protection Components
96A	INSTALLATION REQUIREMENTS FOR LIGHTNING PROTECTION SYSTEMS
467	Grounding and Bonding Equipment
497/497A/497B	PROTECTORS FOR PAIRED CONDUCTORS/ COMMUNICATIONS CIRCUITS/DATA COMMUNICATIONS AND FIRE ALARM CIRCUITS
884	Underfloor Raceways and Fittings

D. ANSI/EIA/TIA Publications:

568B	Commercial Building Telecommunications Wiring Standard
569B	Commercial Building Standard for Telecommunications Pathways and Spaces
606A	ADMINISTRATION STANDARD FOR THE TELECOMMUNICATIONS INFRASTRUCTURE OF COMMERCIAL BUILDINGS
607A	Grounding and Bonding Requirements for Telecommunications in Commercial Buildings
758	Grounding and Bonding Requirements for Telecommunications in Commercial Buildings

- E. Lucent Technologies: Document 900-200-318 "Outside Plant Engineering Handbook".
- F. International Telecommunication Union – Telecommunication Standardization Sector (ITU-T).
- G. Federal Information Processing Standards (FIPS) Publications.
- H. Federal Communications Commission (FCC) Publications: Standards for telephone equipment and systems.
- I. United States Air Force: Technical Order 33K-I-100 Test Measurement and Diagnostic Equipment (TMDE) Interval Reference Guide.

- J. Joint Commission on Accreditation of Health Care Organization (JCAHO): Comprehensive Accreditation Manual for Hospitals.
- K. National and/or Government Life Safety Code(s): The more stringent of each listed code.

#### **1.4 QUALITY ASSURANCE**

- A. The authorized representative of the OEM, shall be responsible for the design, satisfactory total operation of the System, and its certification.
- B. The OEM shall meet the minimum requirements identified in Paragraph 2.1.A. Additionally, the Contractor shall have had experience with three or more installations of systems of comparable size and complexity with regards to coordinating, engineering, testing, certifying, supervising, training, and documentation. Identification of these installations shall be provided as a part of the submittal as identified in Paragraph 1.5.
- C. The System Contractor shall submit certified documentation that they have been an authorized distributor and service organization for the OEM for a minimum of three (3) years. The System Contractor shall be authorized by the OEM to certify and warranty the installed equipment. In addition, the OEM and System Contractor shall accept complete responsibility for the design, installation, certification, operation, and physical support for the System. This documentation, along with the System Contractor and OEM certification must be provided in writing as part of the Contractor's Technical Submittal.
- D. All equipment, cabling, terminating hardware, TCOs, and patch cords shall be sourced from the certifying OEM or at the OEM's direction, and support the System design, the OEM's quality control and validity of the OEM's warranty.
- E. The Contractor's Telecommunications Technicians assigned to the System shall be fully trained, qualified, and certified by the OEM on the engineering, installation, and testing of the System. The Contractor shall provide formal written evidence of current OEM certification(s) for the installer(s) as a part of the submittal or to the COR before being allowed to commence work on the System.

#### **1.5 SUBMITTALS**

- A. Provide submittals in accordance with Specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. The COR shall retain one copy for review and approval.
  - 1. If the submittal is approved the COR shall retain one copy for Official Records and return three (3) copies to the Contractor.
  - 2. If the submittal is disapproved, three (3) copies will be returned to the Contractor with a written explanation attached that indicates the areas the submittal deviated from the System specifications. The COR shall retain one copy for Official Records.
- B. Documents: The submittal shall be separated into sections for each subsystem and shall contain the following:
  - 1. Title page to include:

- a. VA Medical Center.
  - b. Contractor's name, address, and telephone (including FAX) numbers.
  - c. Date of Submittal.
  - d. VA Project No.
2. List containing a minimum of three locations of installations of similar size and complexity as identified herein. These locations shall contain the following:
    - a. Installation Location and Name.
    - b. Owner's or User's name, address, and telephone (including FAX) numbers.
    - c. Date of Project Start and Date of Final Acceptance by Owner.
    - d. System Project Number.
    - e. Brief (three paragraphs minimum) description of each system's function, operation, and installation.
  3. Narrative Description of the system.
  4. A List of the equipment to be furnished. The quantity, make, and model number of each item is required. The following is the minimum equipment required by the system:

QUANTITY	UNIT
As required	Cabinet Assembly(s)
As required	Equipment (Radio Relay) Rack
As required	Wire Management System/Equipment
As required	Telecommunications Outlets (TCO)
As Required	Distribution Cables
As required	TCO Connection Cables
As required	System Connectors
As required	Telecommunications Closets (TC)

5. Equipment technical literature detailing the electrical and technical characteristics of each item of equipment to be furnished.
- C. Test Equipment List:
1. The Contractor is responsible for furnishing all test equipment required to test the system in accordance with the parameters specified. Unless otherwise stated, the test equipment shall not be considered part of the system. The Contractor shall furnish test equipment of accuracy better than the parameters to be tested.
  2. The test equipment furnished by the Contractor shall have a calibration tag of an acceptable calibration service dated not more than 12 months prior to the test. As part of the submittal, a test equipment list shall be furnished that includes the make and model number of the following type of equipment as a minimum:

- a. Spectrum Analyzer.
  - b. Signal Level Meter.
  - c. Volt-Ohm Meter.
  - d. Time Domain Reflectometer (TDR) with strip chart recorder (Data and Optical Measuring).
  - e. Bit Error Test Set (BERT).
- D. Certifications:
1. Submit written certification from the OEM indicating that the proposed supervisor of the installation and the proposed provider of the contract maintenance are authorized representatives of the OEM. Include the individual's exact name and address and OEM credentials in the certification.
  2. Submit written certification from the OEM that the wiring and connection diagrams meet National and/or Government Life Safety Guidelines, NFPA, NEC, UL, this specification, and JCAHCO requirements and instructions, requirements, recommendations, and guidance set forth by the OEM for the proper performance of the System as described herein. The VA will not approve any submittal without this certification.
  3. Preacceptance Certification: This certification shall be made in accordance with the test procedure outlined in paragraph 3.2.B.
- E. Equipment Manuals: Fifteen (15) working days prior to the scheduled acceptance test, the Contractor shall deliver four complete sets of commercial operation and maintenance manuals for each item of equipment furnished as part of the System to the COR. The manuals shall detail the theory of operation and shall include narrative descriptions, pictorial illustrations, block and schematic diagrams, and parts list.
- F. Record Wiring Diagrams:
1. Fifteen (15) working days prior to the acceptance test, the Contractor shall deliver four complete sets of the Record Wiring Diagrams of the System to the COR. The diagrams shall show all inputs and outputs of electronic and passive equipment correctly identified according to the markers installed on the interconnecting cables, Equipment and room/area locations.
  2. The Record Wiring Diagrams shall be in hard copy and two compact disk (CD) copies properly formatted to match the Facility's current operating version of Computer Aided Drafting (AutoCAD) system. The COR shall verify and inform the Contractor of the version of AutoCAD being used by the Facility.

## **PART 2 - PRODUCTS**

### **2.1 EQUIPMENT AND MATERIALS**

- A. System Requirements:
1. The System shall provide the following minimum services that are designed in accordance with and supported by an Original Equipment Manufacturer (OEM), and as specified herein.

The System shall provide continuous inter and/or intra-Facility voice and data, service. The System shall be capacity sized so that loss of connectivity to external telephone systems shall not affect the Facilities operation in specific designated locations. The System shall:

- a. Be capable of inter-connecting and functioning fully with the existing Local Telephone Exchange (LEC) Network(s), Federal Telephone System (FTS) Inter-city Network(s), Inter-exchange Carriers, Integrated Services Digital Network (ISDN), Electronic Private Branch Exchange (EPBX) switches, asynchronous/synchronous data terminals and circuits including Automatic Transfer Mode (ATM), Frame Relay, and local area networks (LAN), at a minimum.
  - b. Be a voice and data cable distribution system that is based on a physical "Star" Topology.
  - c. Be compatible with and able to provide direct digital connection to trunk level equipment including, but, not limited to: directly accessing trunk level equipment including the telephone system, audio paging, Industry Standard "T" and/or "DS" carrier services and external protocol converters. Additionally, connections to "T" and/or "DS" access/equipment or Customer Service Units (CSU) that are used in FTS and other trunk applications shall be included in the System design. Provide T-1 access/equipment (or CSU), as required for use, in FTS and other trunk applications by system design if this equipment is not provided by the existing telephone system and/or will be deactivated by the installation of the System. The Contractor shall provide all T-1 equipment necessary to terminate and make operational the quantity of circuits designated. The CSU's shall be connected to the System's emergency battery power supply. The System shall be fully capable of operating in the Industry Standard "DS" protocol and provide that service when required.
2. Cable Systems - Twisted Pair and Fiber optic:
- a. General:
    - 1) The Contractor shall be responsible for providing a new system conforming to current and accepted telephone and digital industrial/commercial cable distribution standards. The distribution cable installation shall be fully coordinated with the Facility, the PM, the COR and the Contractor prior to the start of installation.
    - 2) The Contractor is responsible for complete knowledge of the space and cable pathways (i.e. equipment rooms, TCs, conduits, wireways, etc.) of the Facility. The Contractor shall at a minimum design and install the System using the Pathway Design Handbook H-088C3, TIA/EIA Telecommunications Building Wiring Standards, and Facility Chief of Information Resource Management's (IRM) instructions, as approved in writing by the PM and/or COR.
    - 3) The System cables shall be fully protected by cable duct, trays, wireways, conduit (rigid, thin wall, or flex), and when specifically approved, flexible innerduct. It is the

responsibility of the Contractor to confirm all contract drawings and the Facility's physical layout to determine the necessary cable protective devices to be provided. If flexible innerduct is used, it shall be installed in the same manner as conduit.

- 4) Cable provided in the system (i.e. backbone, outside plant, inside plant, and station cabling) shall conform to accepted industry and OEM standards with regards to size, color code, and insulation. The pair twists of any pair shall not be exactly the same as any other pair within any unit or sub-unit of cables that are bundled in twenty-five (25) pairs or less. The absence of specifications regarding details shall imply that best general industry practices shall prevail and that first quality material and workmanship shall be provided. Certification Standards, (i.e., EIA, CCITT, FIPPS, and NFPA) shall prevail.
- 5) Some areas of this Facility may be considered "plenum". All wire and cable used in support of the installation in those areas (if any) shall be in compliance with national and local codes pertaining to plenum environments. It is the responsibility of the Contractor to review the VA's cable and wire requirements with the COR and the IRM prior to installation to confirm the type of environment present at each location.
- 6) The Contractor shall provide outside and inside plant cables that furnishes the number of cable pairs required in accordance with the System requirements described herein. The Contractor shall fully coordinate and obtain approval of the design with the OEM, COR and the IRM prior to installation.
- 7) All metallic cable sheaths, etc. shall be grounded by the Contractor (i.e.: risers, underground, station wiring, etc.) as described herein.
- 8) If temporary cable and wire pairs are used, they shall be installed so as to not present a pedestrian safety hazard and the Contractor shall be responsible for all work associated with the temporary installation and for their removal when no longer necessary. Temporary cable installations are not required to meet Industry Standards; but, must be reviewed and approved by the COR and the IRM prior to installation.
- 9) Conductors shall be cabled to provide protection against induction in voice and data circuits. Crosstalk attenuation within the System shall be in excess of -80 dB throughout the frequency ranges specified.
- 10) Measures shall be employed by the Contractor to minimize the radiation of RF noise generated by the System equipment so as not to interfere with audio, video, data, computer main distribution frame (MDF), telephone customer service unit (CSU), and electronic private branch exchange (EPBX) equipment the System may service.
- 11) The System's cables shall be labeled on each end and been fully tested and certified in writing by the Contractor to the COR before proof of performance testing can be

conducted. The as-installed drawings shall identify each cable as labeled, used cable, and bad cable pairs. Minimum test requirements are for impedance compliance, inductance, capacitance, signal level compliance, opens, shorts, cross talk, noise, and distortion, and split pairs on all cables in the frequency ranges specified. The tests required for data cable must be made to guarantee the operation of this cable at not less than 10 mega (m) Hertz (Hz) full bandwidth, fully channel loaded and a Bit Error Rate of a minimum of 10<sup>-6</sup> at the maximum rate of speed. All cable installation and test records shall be made available at acceptance testing by the COR or Contractor and thereafter maintained in the Facility's Telephone Switch Room. All changes (used pair, failed pair, etc.) shall be posted in these records as the change occurs.

- 12) The Contractor shall coordinate with the LEC to install the telephone entrance cable to the nearest point of entry into the Facility and as shown on the drawings. The Contractor shall coordinate with the COR and the LEC to provide all cable pairs/circuits from the Facility point of entry to the Telephone Switch Room all telephone, FTS, DHCP, ATM, Frame Relay, data, pay stations, patient phones, and any low voltage circuits as described herein.
  - 13) The Contractor shall coordinate with the COR to install the computer interface cable to the Facility Telephone Switch Room from the Facility's Computer Room for all data, DHCP, FTS, ATM, Frame Relay, and telephone circuits and as shown on the drawings.
  - 14) The Contractor shall coordinate with the COR to provide all cable pairs/circuits from the Facility Telephone Switch Room and establish circuits throughout the Facility for all voice, data, computer alarm (except fire alarm), private maintenance line, Radio Paging, PA, LAN, DHCP, and any low voltage circuits as described herein.
  - 15) The Contractor shall provide proper test equipment to guarantee that cable pairs meet each OEM's standard transmission requirements, and guarantee the cable will carry data transmissions at the required speeds, frequencies, and fully loaded bandwidth.
- b. Telecommunications Closets (TC): In TC's that are served with both a UTP backbone cable and a fiber optic backbone cable, the UTP cable shall be terminated on separate RJ-45, 8-pin connectors with 110A or equivalent type punch down blocks located on the back or front of a 48-port modular patch panel dedicated to data applications. Only the UTP backbone cable pairs, identified as being connected to the fiber optic backbone, shall be extended to the fiber optic interface device. All connecting cables required to extend these cables (i.e. patch cords, twenty-five pair connectors, etc.), to the fiber optic

interface device, in the TC's shall also be provided by the Contractor to insure a complete and operational fiber optic distribution system:

- 1) In TC's, which are only served by a UTP backbone cable, the cable shall be terminated on separate modular connecting devices (110A or equivalent) that are dedicated to data applications. In order to provide full service to all data cable pairs as identified in each TC/cabinet including spare capacity noted herein, the size of all vertical (riser) cables and/or outside cables serving these TC's shall be increased as required.
- c. Riser Cable:
- 1) All communication riser cables shall be listed as being suitable for the purpose and marked accordingly per Articles 517, 700, and 800 of the NEC.
  - 2) All voice and data communication (analog RF coaxial cable is not to be provided in riser systems) riser cables shall be Unshielded Twisted Pair (UTP), minimum 24 American Wire Gauge (AWG) solid, thermoplastic insulated conductors. They shall be enclosed with a thermoplastic outer jacket.
  - 3) The Contractor shall provide and install inside riser cables to insure full service to all voice cable pairs identified in each TC terminating enclosure plus not less than 50% additional spare capacity.
  - 4) The complete riser cabling system shall be labeled and tested as described herein.
- d. Horizontal and Station Cable:
- 1) A Four (4) UTP 24 AWG (in thermoplastic jacket unless otherwise specified by COR) station wiring cable shall be installed from each TCO RJ-45 jacks (shall conform to EIA/TIA 568 Standard "T568A" and NFPA) to the TC and shall be of a type designed to support Category 5e communications.
- e. Telecommunication Outlets (TCO), Jacks: All TCO's shall have RJ-45 type jacks. The jacks shall be eight pin RJ-45 type unkeyed (sometimes called center keyed) jacks, labeled, and designated for data.
- f. Fiber Optics:
- 1) A complete fiber optic cable distribution system shall be provided as a part of the System. The Contractor shall provide a fiber optic cable that meets the minimum bandwidth requirements for FDDI, ATM, and Frame Relay services. This fiber optic cable shall be a 62.5/125 micron multi-mode, and shall not exceed a distance of 2,000 Meters (M), or 6,560 feet (ft.) in a single run. Tight buffered fiber cable shall be used for indoor runs. The multimode fibers shall be terminated and secured at both ends in "ST" type female stainless steel connectors installed in an appropriate patch or breakout panel with a cable management system. A 610 mm (2 ft.) cable loop (minimum) shall be provided at each end to allow for future movement.

- 2) The fiber optic backbone shall use a conventional hierarchical "star" design where each TC is wired to the primary hub (main cross-connect system) or a secondary hub (intermediate cross-connect system) and then to the primary hub. There shall be no more than two hierarchical levels of cross-connects in the backbone wiring. Each primary hub shall be connected and terminated to a CCS in the Telephone Switch Room. Additionally, a parallel separate fiber optic interconnection shall be provided between the Telephone Switch Room CCS and the MDF in the Main Computer Room.
  - 3) In the TC's, Telephone Switch Room, and Main Computer Room, all fiber optic cables shall be installed in a CCS and/or MDF rack mounted fiber optic cable distribution component/splice case (Contractor provided and installed rack), patch, or breakout panel in accordance with industry standards. Female "ST" connectors shall be provided and installed on the appropriate panel for termination of each strand.
  - 4) The Contractor shall test each fiber optic strand. Cable transmission performance specifications shall be in accordance with EIA/TIA standards. Attenuation shall be measured in accordance with EIA fiber optic test procedures EIA/TIA-455-46, -61, or -53 and NFPA. Information transmission capacity shall be measured in accordance with EIA/TIA-455-51 or -30 and NFPA. The written results shall be provided to the COR for review and approval.
3. Specific Subsystem Requirements: The System shall consist, as a minimum, of the following independent sub-systems to comprise a complete and functional voice and digital telecommunications cabling system: "vertical" (or "riser") trunk cabling system; "horizontal" (or "lateral") sub-trunk cabling system, vertical and horizontal cross-connection (VCC and HCC respectively) cabling systems, and TCO's with RJ-45 jacks for the appropriate telephone, Data connections, and additional jacks, connectors, drop and patch cords, terminators, and adapters provided.
- a. Telecommunication Closet (TC):
    - 1) There shall be a minimum of one TC for the MTC, each building IMTC, and each RTC per building floor location. However, in large building(s), where the horizontal distance to the farthest voice and digital work area may exceed 90 Meters (M) (or 295 feet ft), additional TC's shall be provided as described herein. The maximum DC resistance per cable pair shall be no more than 28.6 Ohms per 305 M (1,000 feet). Each TC shall be centrally located to cover the maximum amount of local floor space. The TC's house in cabinets or enclosures, on relay racks, and/or on backboards, various telecommunication data equipment, controllers, multiplexers, bridges, routers, LAN hub(s), telephone cross-connecting, active and passive equipment.

- 2) Additionally, the TC's may house fire alarm, nurses call, code one (or blue), video, public address, radio entertainment, intercom, and radio paging equipment. Regardless of the method of installation, mounting, termination, or cross-connecting used, all backbone, vertical, and horizontal copper and fiber optic cables shall be terminated on appropriate cross-connection systems (CCS) containing patch panel(s), punch blocks, and/or breakout devices provided in enclosures and tested as described herein. A cable and/or wire management system shall be a part of each CCS.
  - a) A minimum of three 110-120 VAC active quad outlets shall be provided, each with "U" grounded receptacles at a minimum of one outlet for each front, side and back wall. These outlets shall be separately protected by an AC circuit breaker provided in the designated Government Emergency Critical Care AC power panel, that is connected to the Facilities Emergency AC Power Distribution System. For larger building TC applications, a minimum of one additional quad AC outlet shall be provided for every 800M<sup>2</sup> (or 8,000 ft<sup>2</sup>) of useable floor space. Additional outlets shall be equally spaced along the wall.
  - b) Climate control shall be provided in each TC 24 hours a day, seven days per week and 52 week per year to prevent failure of electronic components and for mission critical functional applications. The COR are responsible for informing the Contractor regarding the minimum climate control requirements.
- b. Cross-connect Systems (CCS):
  - 1) The CCS shall be selected based on the following criteria: requires the use of a single tool, has the fewest amount of parts, and requires the least amount of assembly or projected trouble shooting time during the life of the system.
  - 2) The CCS system used at the MTC, each IMTC, and each TC shall force cross-connect cable slack management through adherence to the OEM's installation methods, provided cable management systems, and as described herein, so that moves, adds, and changes can be administered easily and cost effectively.
  - 3) Copper Cables: The MTC, each IMTC, and TC shall contain a copper CCS sized to support the System TCO's and connections served by each individual TC and as shown on the drawings. The System layout shall allow for a minimum of 50% anticipated growth. Additionally, each CCS must provide maximum flexibility, while maintaining performance, in order to meet system-changing requirements that are likely to occur throughout its useful life.

- 4) Fiber Optic Cables:
  - a) The MTC and each TC shall contain a fiber CCS sized to support the System and connections served by each individual TC and as shown on the drawings. The System layout shall allow for a minimum of 50% anticipated growth.
  - b) Each fiber CCS must provide maximum flexibility and cable management while maintaining performance in order to meet changing requirements that are likely to occur throughout the expected life of the system. All fiber optic cable slack shall be stored in protective enclosures.
- 5) The Contractor shall not "cross-connect" the copper or fiber optic cabling systems and subsystems even though appropriate "patch" cords are to be provided for each "patch", "punch", or "breakout" panel. In addition, the Contractor shall not provide active electronic distribution or interface equipment as a part of the System.
- 6) Grounding: Proper grounding and bonding shall be provided for each TC and all internal equipment. Reference shall be made to proper codes and standards, such that all grounding systems must comply with all applicable National, Regional, and Local Building and Electrical codes. The most stringent code of these governing bodies shall apply.
  - a) If local grounding codes do not exist for the System location, then at a minimum, a #6 American Wire Gauge (AWG) stranded copper wire, or equivalent copper braid, shall be connected to a separate earth grounding system for each TC (the looping of TC's in a general location is allowed as long as the specifications contained herein are met). Under no circumstance shall the AC neutral be used for this ground. See PART 3 – EXECUTION for specific grounding instructions.
  - b) Each copper UTP or STP cable that enters a TC from the outside of a building (regardless if the cable is installed underground or aerial) shall be provided with a surge protector and grounded an to earth ground at each cable's entry point in and out of the MTC and each IMTC.
- c. Voice (or Telephone) Cable Cross-Connection Subsystem:
  - 1) Due to the usually high number of copper cable termination's required at the MCCS, Insulation Displacement Connection (IDC) hardware shall be used. Termination options shall include the following for a Category 6 Cabling System: IDC termination of cross-connection wire(s), IDC patch cord connector to IDC patch cord connector, and hybrid modular cord to IDC patch cord connector shall be the minimum provided.
  - 2) Additionally, due to the large or many MCCS (at initial installation and over the life of the System) copper termination points, the CCS that makes the best use of real estate while still following the OEM design and installation guidelines, and meeting the specifications described herein, shall be provided.

- 3) For ease of maintenance purposes, all terminations shall be accessible without the need for disassembly of the IDC wafer. IDC wafers shall be removable from their mounts to facilitate testing on either side of the connector. Designation strips or labels shall be removable to allow for inspection of the terminations. The maximum number of terminations on a wall or on a rack frame or panel shall comply with the OEM recommendations and guidelines, and as described herein. A cable management system shall be provided as a part of the IDC.
  - 4) IDC connectors shall be capable of supporting cable re-terminations without damaging the connector and shall support a minimum of 200 (telephone equipment standard compliant) IDC insertions or withdrawals on either side of the connector panel.
  - 5) A non-impact termination method using a full-cycle terminating tool having both a tactile and an audible feedback to indicate proper termination is required. For personnel safety and ease of use in day to day administration, high impact installation tools shall not be used.
  - 6) All system "inputs" from the EPBX, FTS, Local Telephone System, or diverse routed voice distribution systems shall appear on the "left" side of the IDC (110A blocks with RJ45 connections are acceptable alternates to the IDC) of the MCCS.
  - 7) All system "outputs" from the MCCS to the voice backbone cable distribution system shall appear on the "right" side of the same IDC (or 110A blocks) of the MCCS.
  - 8) The splitting of pairs within cables between different jacks or connections shall not be allowed. In the case of ISDN and/or ATM and /or Frame Relay applications, terminating resistors shall be provided externally to the patch panel connector or jack.
  - 9) UTP or STP cross connecting wires shall be provided for each "pair" of connection terminals plus an additional 50% spare.
- d. Data Cross-Connection Subsystems:
- 1) The MCCS shall be a Main Distribution Terminating (MDT) data unit and shall be provided in the MTC. The MDT shall consist of a "patch" panel(s) provided with modular RJ45 female connectors for cross-connection of all copper data cable terminations. The panels shall provide for system grounding (where no dielectric cables are used) and be provided with a cable management system.
  - 2) Each panel shall conform to EIA dimensions and be suitable for mounting in standard equipment racks, have the RJ45 jacks aligned in two horizontal rows (up to a maximum of 48 jacks per panel), and shall not exceed the OEM's recommendations. Each RJ45 jack shall be of modular design and capable of accepting and functioning with other modular (i.e. RJ11) plugs without damaging the jack. It is not necessary to

- provide a jack for unused positions that are not part of the 50% expansion requirement.
- a) All data system inputs from the server(s), data LAN, bridge, or interface distribution systems shall appear on the "top" row of jacks of the appropriate patch panel.
  - b) All System outputs or backbone cable connections shall appear on the "bottom" row of jacks of the same patch panel.
  - c) The splitting of pairs within cables between different jacks shall not be allowed. In the case of ISDN and/or ATM and/or Frame Relay applications, terminating resistors shall be provided externally to the patch panel connector or jack.
- 3) A patch cord shall be provided for each system "pair" of connection jacks. Each patch cord shall have modular RJ45 connectors provided on each end to match the panel's modular RJ45 female jack's being provided.
- e. Fiber optic Cross-Connection Subsystems: The MTC shall be provided with a separate fiber MCCS. Each TC shall be provided with a rack mounted patch or distribution panel that is installed inside a lockable cabinet or "breakout enclosure" that accommodates multimode fiber. A cable management system shall be provided for each panel.
- 1) The panel(s) shall contain a minimum of 12 female "ST" connectors, be able to accommodate splices and field mountable connectors and have capacity for additional connectors to be added up to the OEM's maximum standard panel size for this type of use. All patch panel sides, including the front and back, shall be protected by a cabinet or enclosure.
  - 2) The panel(s) shall conform to EIA dimensions and be suitable for installation in standard racks, cabinets, and enclosures. The panels shall provide for system grounding (where no dielectric cables are used).
  - 3) The patch panel with the highest OEM approved density of fiber "ST" termination's (maximum of 72 each), while maintaining a high level of manageability, shall be selected. Patch cables, with proper "ST" connectors installed on each end shall be provided for each pair of fiber optic cable "ST" connectors.
    - a) All System "inputs" from interface equipment or distribution systems shall appear on the "top" row of connectors of the appropriate patch panel.
    - b) All System "outputs" or backbone cable connections shall appear on the "bottom" row of connectors of the same patch panel.
  - 4) In order to achieve a high level of reliability that approximates that of an OEM connector, field installable connectors shall have an OEM specified physical contact polish. Every fiber cable shall be terminated with the appropriate connector, and tested to ensure compliance to OEM and specifications outlines herein. Where a

local fiber optic system connector standard, Industry Standard fiber optic "ST" female connector terminated with a fiber optic cable, shall be used. But, if the fiber optic cable is not used (or "dark"), a "ST" male terminating "cap" shall be provided for each unused "ST" female connector.

- f. Horizontal (or Station) Cabling (HC): The HC distribution cabling systems connects the distribution field of the voice and data HCCS, in a "Star" Topology, to each TCO or connector and as shown on the drawings via the sub-trunk system.
- 1) Horizontal cables shall consist of insulated, UTP or STP conductors that are rated for Category 5e telecommunications service for voice and data systems.
  - 2) The number of UTP distribution pairs dedicated to each floor from the HC shall be sufficient to accommodate all the horizontal voice and data circuits served by the distribution cable to each TCO.
    - a) A minimum of four pairs for voice shall be connected to the "right" side of the IDC (or 110A block) that the VCCS "input" connections appear in the RTC.
    - b) A minimum of two separate sets of four pairs each for data shall be connected to the "bottom" row of RJ45 jacks that the VCCS "input" connections appear in the RTC.
  - 3) The horizontal cable length to the farthest system outlet shall be limited to a maximum of 90M (or 295 ft). These maximum lengths must be derated, adjusted and reduced to include cross-connection and distribution system losses. Additional TC(s) shall be provided on large floor areas of buildings to limit the horizontal distribution to a maximum of 90M (or 295 ft).
  - 4) The splitting of pairs within a cable between different jacks shall not be permitted.
  - 5) The installation of the HC shall conform to appropriate OEM recommendations and standards outlined herein. This requirement will insure adequate protection for Electro-Magnetic Interference (EMI) sources.
  - 6) A system design where "looping" the HC distribution cables from room to room shall not be permitted.
- g. System Telecommunication Outlets (TCO): The System shall be capable of receiving the specified telephone (or voice) and data signals acquired from the LEC, FTS contracted carrier and computer system, and shall process and distribute them to the designated TCO's and as shown on the drawings..
- 1) Each TCO shall consist of modular RJ45 jacks, designated for data service, . Each TCO with appropriate jacks installed shall be provided by the Contractor in each designated location and as shown on the drawings.
  - 2) The Contractor shall connect each TCO data multipin modular RJ45 jack to a separate lower row jack on the HCCS "patch panel" in each associated RTC. The

Contractor is not to "cross-connect" VCCS and HCCS data distribution cables or provides active electronic data distribution equipment as a part of the System.

- 3) A non-impact termination method, using either a stuffer cap with installation tool or full-cycle terminating tool having both tactile and audible feedback to indicate proper termination shall be used. High impact installation tools shall not be used.
- 4) Each terminated conductor end shall be properly trimmed to assure a minimum clearance of 6.35 mm (0.250 in) clearance between the conductors of adjacent modules.
- 5) The multipin RJ45 jack shall be modular in construction that will accept and operate with a modular UTP and STP RJ45 connector and its pin assignments.

B. System Performance:

1. At a minimum, the System shall be able to support the following voice and data operations for Category 5e Certified Telecommunication Service:
  - a. Provide the following interchange (or interface) capabilities:
    - 1) Basic Rate (BRI).
    - 2) Primary Rate (PRI).
  - b. ISDN :
    - 1) Narrow Band BRI.
      - a) B Channel: 64 kilo-Bits per second (kBps), minimum.
      - b) D Channel: 16 kBps, minimum.
      - c) H Channel: 384 kBps, minimum.
    - 2) Narrow Band PRI:
      - a) B Channel: 64 kBps, minimum.
      - b) D Channel: 64 kBps, minimum.
      - c) H Channel: 1,920 kBps, minimum.
    - 3) Wide (or Broad) Band:
      - a) All channels: 140 mega(m)-Bps, minimum, capable to 565 mBps at "T" reference.
  - c. ATM operation and interface: ATM 155 mBps.
  - d. Frame Relay.
  - e. Integrated Data Communications Utility (IDCU) operation and interface.
  - f. Government Open Systems Interconnection Profile (GOSSIP) compliant.
  - g. Fiberoptic Distributed Data Interface (FDDI): A minimum 100 mBps to a maximum of 1.8 giga(g)-Bps data bit stream speed (shall be Synchronous Optical Network Sonet compliant).
2. At a minimum the System shall support the following operating parameters:
  - a. EPBX connection:
    - 1) System speed: 1.0 gBps per second, minimum.

- 2) Impedance: 600 Ohms.
  - 3) Cross Modulation: -60 deci-Bel (dB).
  - 4) Hum Modulation: -55 Db.
  - 5) System data error: 10 to the -10 Bps, minimum loss measured at the frame output with reference Zero (0) deciBel measured (dBm) at 1,000 Hertz (Hz) applied to the frame input.
    - a) Trunk to station: 1.5 dB, maximum.
    - b) Station to station: 3.0 dB, maximum.
    - c) Internal switch crosstalk: -60 dB when a signal of  $\pm 10$  deciBel measured (dBm), 500-2,500 Hz range is applied to the primary path.
    - d) Idle channel noise: 25 dBm "C" or 3.0 dBm "O" above reference (terminated) ground noise, whichever is greater.
    - e) Traffic Grade of Service for Voice and Data:
      - (1) A minimum grade of service of P-01 with an average traffic load of 7.0 CCS per station per hour and a traffic overload in the data circuits will not interfere with, or degrade, the voice service.
      - (2) Average CCS per voice station: The average CCS capacity per voice station shall be maintained at 7.0 CCS when the EPBX is expanded up to the projected maximum growth as stated herein.
- b. Telecommunications Outlet (TCO):
- 1) Voice:
    - a) Isolation (outlet-outlet): 24 dB.
    - b) Impedance: 600 Ohms, balanced (BAL).
    - c) Signal Level: 0 deciBel per mili-Volt (dBmV)  $\pm 0.1$  dBmV.
    - d) System speed: 100 mBps, minimum.
    - e) System data error: 10 to the -6 Bps, minimum.
  - 2) Data:
    - a) Isolation (outlet-outlet): 24 dB.
    - b) Impedance: 600 Ohms, BAL.
    - c) Signal Level: 0 dBmV  $\pm 0.1$  dBmV.
    - d) System speed: 120 mBps, minimum.
    - e) System data error: 10 to the -8 Bps, minimum.
  - 3) Fiber optic:
    - a) Isolation (outlet-outlet): 36 dB.
    - b) Signal Level: 0 dBmV  $\pm 0.1$  dBmV.
    - c) System speed: 540 mBps, minimum.
    - d) System data error: 10 to the -6 BPS, minimum.

C. General:

1. All equipment to be supplied under this specification shall be new and the current model of a standard product of an OEM or record. An OEM of record shall be defined as a company whose main occupation is the manufacture for sale of the items of equipment supplied and which:
  - a. Maintains a stock of replacement parts for the item submitted.
  - b. Maintains engineering drawings, specifications, and operating manuals for the items submitted.
  - c. Has published and distributed descriptive literature and equipment specifications on the items of equipment submitted at least 30 days prior to the Invitation for Bid.
2. Specifications of equipment as set forth in this document are minimum requirements, unless otherwise stated, and shall not be construed as limiting the overall quality, quantity, or performance characteristics of items furnished in the System. When the Contractor furnishes an item of equipment for which there is a specification contained herein, the item of equipment shall meet or exceed the specification for that item of equipment.
3. The Contractor shall provide written verification, in writing to the COR at time of installation, that the type of wire/cable being provided is recommended and approved by the OEM. The Contractor is responsible for providing the proper size and type of cable duct and/or conduit and wiring even though the actual installation may be by another subcontractor.
4. Active electronic component equipment shall consist of solid state components, be rated for continuous duty service, comply with the requirements of FCC standards for telephone equipment, systems, and service.
5. All passive distribution equipment shall meet or exceed -80 dB radiation shielding specifications.
6. Color code all distribution wiring to conform to the Telephone Industry standard, EIA/TIA, and this document, which ever is the more stringent. At a minimum, all equipment, cable duct and/or conduit, enclosures, wiring, terminals, and cables shall be clearly and permanently labeled according to and using the provided record drawings, to facilitate installation and maintenance. .
7. Plug-in connectors shall be provided to connect all equipment, except coaxial cables and interface points. Coaxial cable distribution points and RF transmission lines shall use coaxial cable connections recommended by the cable OEM and approved by the System OEM. Base- band cable systems shall utilize barrier terminal screw type connectors, at a minimum. Crimp type connectors installed with a ratchet type installation tool are and acceptable alternate as long as the cable dress, pairs, shielding, grounding, and connections and labeling are provided the same as the barrier terminal strip connectors. Tape of any type, wire nuts, or solder type connections are unacceptable and will not be approved.

8. All equipment faceplates utilized in the System shall be stainless steel, anodized aluminum, or UL approved cyclac plastic for the areas where provided.

D. Equipment Functional Characteristics:

<b>FUNCTIONS</b>	<b>CHARACTERISTICS</b>
Input Voltage	105 to 130 VAC
POWER LINE FREQUENCY	60 HZ $\pm$ 2.0 HZ
Operating Temperature	0 to 50 degrees ( $^{\circ}$ ) Centigrade (C)
Humidity	80 percent (%) minimum rating

E. Equipment Standards and Testing:

1. The System has been defined herein as connected to systems identified as Critical Care performing Life Support Functions. Therefore, at a minimum, the system shall conform to all aforementioned National and/or Local Life Safety Codes (which ever are the more stringent), NFPA, NEC, this specification, JCAHCO Life Safety Accreditation requirements, and the OEM recommendations, instructions, and guidelines.
2. All supplies and materials shall be listed, labeled or certified by UL or a nationally recognized testing laboratory where such standards have been established for the supplies, materials or equipment. .
3. The provided active and passive equipment required by the System design and approved technical submittal must conform with each UL standard in effect for the equipment, as of the date of the technical submittal (or the date when the COR approved system equipment necessary to be replaced) was technically reviewed and approved by VA. Where a UL standard is in existence for equipment to be used in completion of this contract, the equipment must bear the approved UL seal.
4. Each item of electronic equipment to be provided under this contract must bear the approved UL seal or the seal of the testing laboratory that warrants the equipment has been tested in accordance with, and conforms to the specified standards.

## 2.2 DISTRIBUTION EQUIPMENT AND SYSTEMS

A. Telecommunication Outlet (TCO):

1. The TCO shall consist of data multipin jacks mounted in a steel outlet box. A separate 100mm (4in.) x 100mm (4in.) x 63mm (2.5in.) steel outlet box with a labeled stainless steel faceplate will be used. A second 100mm (4in.) x 100mm (4in.) x 63mm (2.5in.) steel outlet box with a labeled faceplate shall be provided as required adjacent to the first box to ensure system connections and expandability requirements are met.
2. All data multipin connections shall be RJ-45 female types.

3. The TCO shall be fed from the appropriate CCS located in the respective RTC in a manner to provide a uniform and balanced distribution system.
  4. Interface of the data multipin jacks to appropriate patch panels (or approved “punch down” blocks) in the associated RTC, is the responsibility of the Contractor. The Contractor shall not extend data cables from the RTCs to data terminal equipment or install data terminal equipment.
  5. The wall outlet shall be provided with a stainless steel or approve alternate cover plate to fit the data multi- pin jacks and the outlet box provided (100mm (4in.) x 100mm (4in.) for single and 100mm (4in.) x 200mm (8in.) for dual outlet box applications). For PBPU installations, the cover plate shall be stainless steel.
- B. Distribution Cables: Each cable shall meet or exceed the following specifications for the specific type of cable. Each cable reel shall be sweep tested and certified by the OEM by tags affixed to each reel. The Contractor shall turn over all sweep tags to the COR or PM.
1. Data Multi-Conductor:
    - a. The cable shall be multi-conductor, shielded or unshielded cable with stranded conductors. The cable shall be able to handle the power and voltage used over the distance required. It shall meet Category 5e service at a minimum.
    - b. Technical Characteristics:

Wire size	22 AWG, minimum
Working shield	350 V
Bend radius	10X the cable outside diameter
Impedance	100 Ohms $\pm$ 15%, BAL
Bandwidth	100 mHz, minimum
DC RESISTANCE	10.0 Ohms/100M, maximum
Shield coverage	
Overall Outside (if OEM specified)	100%
Individual Pairs (if OEM specified)	100%
Attenuation	
Frequency in mHz	dB per 305 M (1,000ft.), maximum
0.7	5.2
1.0	6.5
4.0	14.0
8.0	19.0
16.0	26.0
20.0	29.0

25.0	33.0
31.0	36.0
62.0	52.0
100.0	68.0

2. Fiber Optic:

a. Multimode Fiber:

- 1) The general purpose multimode fiber optic cable shall be a dual window type installed in conduit for all system locations. A load-bearing support braid shall surround the inner tube for strength during cable installation.

2) Technical Characteristics:

Bend radius	6.0", minimum Outer jacket, As required
FIBER DIAMETER	62.5 MICRONS
Cladding	125 microns
Attenuation	
850 nM	4.0 dB per kM, maximum
1,300 nM	2.0 dB per kM, maximum
Bandwidth	
850 nM	160 mHz, minimum
1,300 nM	500 mHz, minimum
Connectors	Stainless steel

3. AC Power Cable: AC power cable(s) shall be 3-conductor, no. 12 AWG minimum, and rated for 13A-125V and 1,625W. Master AC power, installation specification and requirements, are given in the NEC and herein.

C. Outlet Connection Cables:

1. Data:

- a. The Contractor shall provide a connection cable for each TCO data jack in the system with 10% spares. The data connection cable shall connect a data instrument to the TCO data jack. The Contractor shall not provide data terminal(s)/equipment.
- b. Technical Characteristics:

Length	1.8M (6 ft.), minimum
--------	-----------------------

Cable	Data grade Category 5e
Connector	RJ-45 male on each end
Color coding	Required, data industry standard
Size	24 AWG, minimum

2. Fiber Optic:

a. The Contractor shall provide a connection cable for each TCO fiber optic connector in the System with 10% spares. The data connection cable shall connect a fiber optic instrument to the TCO fiber optic jack. The Contractor shall not provide fiber optic instrument(s)/equipment.

b. Technical Characteristics:

Length	1.8M (6 ft.), minimum
Cable	Flexible single conductor with jacket
Connector	ST male on each end
Size	To fit single mode or multimode cable

D. System Connectors:

1. Modular (RJ-45/11 and RJ-45): The connectors shall be commercial types for voice and high speed data transmission applications. The connector shall be compatible with telephone instruments, computer terminals, and other type devices requiring linking through the modular telecommunications outlet to the System. The connector shall be compatible with UTP and STP cables.

a. Technical Characteristics:

Type	Number of Pins
RJ-11/45	Compatible with RJ45
RJ-45	Eight
Dielectric	Surge
Voltage	1,000V RMS, 60 Hz @ one minute, minimum
Current	2.2A RMS @ 30 Minutes or 7.0A RMS @ 5.0 seconds
Leakage	100 $\mu$ A, maximum
Connectability	
Initial contact resistance	20 mili-Ohms, maximum

Insulation displacement	10 mili-Ohms, maximum
Interface	Must interface with modular jacks from a variety of OEMs. RJ-11/45 plugs shall provide connection when used in RJ-45 jacks.
Durability	200 insertions/withdrawals, minimum

2. Fiber Optic: The connectors shall be commercial types for voice and high speed data transmission applications. The connector shall be compatible with telephone instruments, computer terminals, and other type devices requiring linking through the modular telecommunications outlet to the system. The connector shall be compatible with UTP and STP cables.

E. Terminators:

1. Fiber Optic:

- a. These units shall be metal-housed precision types in the frequency ranges selected. They shall be the screw-on type that has low VSWR when installed and the proper impedance to terminate the required system unit or fiber optic cable.
- b. Technical Characteristics:

Frequency	Lightwave
Power blocking	As required
Return loss	25 dB
Connectors	"ST", minimum
Construction	Stainless steel
Impedance	As required

**2.3 TELECOMMUNICATIONS CLOSET REQUIREMENTS**

Refer to VA Handbook H-088C3, Telephone System Requirements, for specific TC guidelines for size, power input, security, and backboard mounting requirements. It is the Contractors responsibility to ensure TC compliance with the System Requirements.

**2.4 INSTALLATION KIT**

The kit shall be provided that, at a minimum, includes all connectors and terminals, labeling systems, audio spade lugs, barrier strips, punch blocks or wire wrap terminals, heat shrink tubing, cable ties, solder, hangers, clamps, bolts, conduit, cable duct, and/or cable tray, etc., required to accomplish a neat and secure installation. All wires shall terminate in a spade lug and barrier strip, wire wrap terminal or punch block. Unfinished or unlabeled wire connections shall not be allowed. Turn over to the COR all unused and partially opened installation kit boxes, coaxial,

fiberoptic, and twisted pair cable reels, conduit, cable tray, and/or cable duct bundles, wire rolls, physical installation hardware. The following are the minimum required installation sub-kits:

- A. System Grounding:
  - 1. The grounding kit shall include all cable and installation hardware required. All radio equipment shall be connected to earth ground via internal building wiring, according to the NEC.
  - 2. This includes, but is not limited to:
    - a. Coaxial Cable Shields.
    - b. Control Cable Shields.
    - c. Data Cable Shields.
    - d. Equipment Racks.
    - e. Equipment Cabinets.
    - f. Conduits.
    - g. Duct.
    - h. Cable Trays.
    - i. Power Panels.
    - j. Connector Panels.
    - k. Grounding Blocks.
- B. Coaxial Cable: The coaxial cable kit shall include all coaxial connectors, cable tying straps, heat shrink tabbing, hangers, clamps, etc., required to accomplish a neat and secure installation.
- C. Wire and Cable: The wire and cable kit shall include all connectors and terminals, audio spade lugs, barrier straps, punch blocks, wire wrap strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.
- D. Conduit, Cable Duct, and Cable Tray: The kit shall include all conduit, duct, trays, junction boxes, back boxes, cover plates, feed through nipples, hangers, clamps, other hardware required to accomplish a neat and secure conduit, cable duct, and/or cable tray installation in accordance with the NEC and this document.
- E. Equipment Interface: The equipment kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface the systems with the identified sub-system(s) according to the OEM requirements and this document.
- F. Labels: The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to completely and correctly label each subsystem according to the OEM requirements, as-installed drawings, and this document.
- G. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment, maintenance, and operation manuals, and OEM materials needed to completely and correctly provide the system documentation as required by this document and explained herein.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

#### **A. Product Delivery, Storage and Handling:**

1. Delivery: Deliver materials to the job site in OEM's original unopened containers, clearly labeled with the OEM's name and equipment catalog numbers, model and serial identification numbers. The COR may inventory the cable, patch panels, and related equipment.
2. Storage and Handling: Store and protect equipment in a manner, which will preclude damage as directed by the COR.

#### **B. System Installation:**

1. After the contract's been awarded, and within the time period specified in the contract, the Contractor shall deliver the total system in a manner that fully complies with the requirements of this specification. The Contractor shall make no substitutions or changes in the System without written approval from the COR and PM.
2. The Contractor shall install all equipment and systems in a manner that complies with accepted industry standards of good practice, OEM instructions, the requirements of this specification, and in a manner which does not constitute a safety hazard. The Contractor shall insure that all installation personnel understands and complies with all the requirements of this specification.
3. The Contractor shall install suitable filters, traps, directional couplers, splitters, TC's, and pads for minimizing interference and for balancing the System. Items used for balancing and minimizing interference shall be able to pass telephone and data signals in the frequency bands selected, in the direction specified, with low loss, and high isolation, and with minimal delay of specified frequencies and signals. The Contractor shall provide all equipment necessary to meet the requirements of Paragraph 2.1.C and the System performance standards.
4. All passive equipment shall be connected according to the OEM's specifications to insure future correct termination, isolation, impedance match, and signal level balance at each telephone/data outlet.
5. Where TCOs are installed adjacent to each other, install one outlet for each instrument.
6. All lines shall be terminated in a suitable manner to facilitate future expansion of the System. There shall be a minimum of one spare 25 pair cable at each distribution point on each floor.
7. All vertical and horizontal copper and fiber optic cables shall be terminated so any future changes only requires modifications of the existing EPBX or signal closet equipment only.
8. Terminating resistors or devices shall be used to terminate all unused branches, outlets, equipment ports of the System, and shall be devices designed for the purpose of terminating fiber optic or twisted pair signals in telephone and data and lightwave systems.

#### **C. Conduit and Signal Ducts:**

1. Conduit:

- a. The Contractor shall employ the latest installation practices and materials. The Contractor shall provide conduit, junction boxes, connectors, sleeves, weatherheads, pitch pockets, and associated sealing materials not specifically identified in this document as GFE. Conduit penetrations of walls, ceilings, floors, interstitial space, fire barriers, etc., shall be sleeved and sealed. The minimum conduit size shall be 19 mm (3/4 in.).
- b. All cables shall be installed in separate conduit and/or signal ducts (exception from the separate conduit requirement to allow telephone cables to be installed in partitioned cable tray with data cables may be granted in writing by the COR if requested.) Conduits shall be provided in accordance with NEC Articles 517 for Critical Care and 800 for Communications systems, at a minimum.
- c. When metal, plastic covered, etc., flexible cable protective armor or systems are specifically authorized to be provided for use in the System, their installation guidelines and standards shall be as specified herein, d. When "innerduct" flexible cable protective systems is specifically authorized to be provided for use in the System, its installation guidelines and standards shall be as the specified herein.
- e. Conduit (including GFE) fill shall not exceed 40%. Each conduit end shall be equipped with a protective insulator or sleeve to cover the conduit end, connection nut or clamp, to protect the wire or cable during installation and remaining in the conduit. Electrical power conduit shall be installed in accordance with the NEC. AC power conduit shall be run separate from signal conduit.
- f. When metal, plastic covered, etc., flexible cable protective armor or systems are specifically authorized to be provided for use in the System, their installation guidelines and standards shall be as specified herein, and the NEC.

2. Signal Duct, Cable Duct, or Cable Tray:

- a. The Contractor shall use existing signal duct, cable duct, and/or cable tray, when identified and approved by the COR.
- b. Approved signal and/or cable duct shall be a minimum size of 100 mm x 100 mm (4 in. X 4 in.) inside diameter with removable tops or sides, as appropriate. Protective sleeves, guides or barriers are required on all sharp corners, openings, anchors, bolts or screw ends, junction, interface and connection points.
- c. Approved cable tray shall be fully covered, mechanically and physically partitioned for multiple electronic circuit use, and be UL certified and labeled for use with telecommunication circuits and/or systems. The COR shall approve width and height dimensions.

D. Distribution System Signal Wires and Cables:

1. Wires and cables shall be provided in the same manner and use like construction practices as Fire Protective and other Emergency Systems that are identified and outlined in NFPA 101, Life Safety Code, Chapters 7, 12, and/or 13, NFPA 70, National Electrical Code, Chapter 7, Special Conditions. The wires and cables shall be able to withstand adverse environmental conditions in their respective location without deterioration. Wires and cables shall enter each equipment enclosure, console, cabinet or rack in such a manner that all doors or access panels can be opened and closed without removal or disruption of the cables.
  - a. Each wire and cable shall terminate on an item of equipment by direct connection. Spare or unused wire and cable shall be provided with appropriate connectors (female types) that are installed in appropriate punch blocks, barrier strips, patch, or bulkhead connector panels.
  - b. Fiber optic cables that are spare, unused or dark shall be provided with Industry Standard "ST" type female connectors installed in appropriate break out, patch, or bulkhead connector panels provided in enclosure(s) and shall be protected from the environment.
  - c. Coaxial cables that are spare, unused or dark shall be provided with the cable OEM specified type female connectors installed in appropriate break out, patch, or bulkhead connector panels provided in enclosure(s) and shall be protected from the environment.
  - d. All cable junctions and taps shall be accessible. Provide an 8" X 8" X 4" (minimum) junction box attached to the cable duct or raceway for installation of distribution system passive equipment. Ensure all equipment and tap junctions are accessible.
2. Routing and Interconnection:
  - a. Wires or cables between consoles, cabinets, racks and other equipment shall be in an approved conduit, signal duct, cable duct, or cable tray that is secured to building structure.
  - b. Wires and cables shall be insulated to prevent contact with signal or current carrying conductors. Wires or cables used in assembling consoles, panels, equipment cabinets and racks shall be formed into harnesses that are bundled and tied. Harnessed wires or cables shall be combed straight, formed and dressed in either a vertical or horizontal relationship to equipment, controls, components or terminations.
  - c. Harnesses with intertwined members are not acceptable. Each wire or cable that breaks out from a harness for connection or termination shall have been tied off at that harness or bundle point, and be provided with a neatly formed service loop.
  - d. Wires and cables shall be grouped according to service (i.e.: AC, grounds, signal, DC, control, etc.). DC, control and signal cables may be included with any group. Wires and cables shall be neatly formed and shall not change position in the group throughout the conduit run. Wires and cables in approved signal duct, conduit, cable ducts, or cable

trays shall be neatly formed, bundled, tied off in 600 mm to 900 mm (24 in. to 36 in.) lengths and shall not change position in the group throughout the run. Concealed splices are not allowed.

- e. Separate, organize, bundle, and route wires or cables to restrict EMI, channel crosstalk, or feedback oscillation inside any enclosure. Looking at any enclosure from the rear (wall mounted enclosures, junction, pull or interface boxes from the front), locate AC power, DC and speaker wires or cables on the left; coaxial, control, microphone and line level audio and data wires or cables, on the right. This installation shall be accomplished with ties and/or fasteners that will not damage or distort the wires or cables. Limit spacing between tied off points to a maximum of 150 mm (6 inches).
- f. Do not pull wire or cable through any box, fitting or enclosure where change of cable tray or signal or cable duct alignment or direction occurs. Ensure the proper bend radius is maintained for each wire or cable as specified by it's OEM.
- g. Employ temporary guides, sheaves, rollers, and other necessary items to protect the wire or cable from excess tension or damage from bending during installation. Abrasion to wire or cable jackets is not acceptable and will not be allowed. Replace all cables whose jacket has been abraded. The discovery of any abraded and/or damaged cables during the proof of performance test shall be grounds for declaring the entire system unacceptable and the termination of the proof of performance test. Completely cover edges of wire or cable passing through holes in chassis, cabinets or racks, enclosures, pull or junction boxes, conduit, etc., with plastic or nylon grommeting.
- h. Cable runs shall be splice free between conduit junction and interface boxes and equipment locations.
- i. Cables shall be installed and fastened without causing sharp bends or rubbing of the cables against sharp edges. Cables shall be fastened with hardware that will not damage or distort them.
- j. Cables shall be labeled with permanent markers at the terminals of the electronic and passive equipment and at each junction point in the System. The lettering on the cables shall correspond with the lettering on the record diagrams.
- k. Completely test all of the cables after installation and replace any defective cables.
- l. Wires or cables that are installed outside of buildings shall be in conduit, secured to solid building structures. If specifically approved, on a case by case basis, to be run outside of conduit, the wires or cables shall be installed, as described herein. The bundled wires or cables must: Be tied at not less than 460 mm (18 in.) intervals to a solid building structure; have ultra violet protection and be totally waterproof (including all connections). The laying of wires or cables directly on roof tops, ladders, drooping down walls, walkways, floors, etc. is not allowed and will not be approved.

- m. Wires or cables installed outside of conduit, cable trays, wireways, cable duct, etc.
  - 1) Only when specifically authorized as described herein, will wires or cables be identified and approved to be installed outside of conduit. The wire or cable runs shall be UL rated plenum and OEM certified for use in air plenums.
  - 2) Wires and cables shall be hidden, protected, fastened and tied at 600 mm (24 in.) intervals, maximum, as described herein to building structure.
  - 3) Closer wire or cable fastening intervals may be required to prevent sagging, maintain clearance above suspended ceilings, remove unsightly wiring and cabling from view and discourage tampering and vandalism. Wire or cable runs, not provided in conduit, that penetrate outside building walls, supporting walls, and two hour fire barriers shall be sleeved and sealed with an approved fire retardant sealant.
  - 4) Wire or cable runs to system components installed in walls (i.e.: volume attenuators, circuit controllers, signal, or data outlets, etc.) may, when specifically authorized by the COR, be fished through hollow spaces in walls and shall be certified for use in air plenum areas.
- n. Wires or cables installed in underground conduit, duct, etc.
  - 1) Wires or cables installed in underground installations shall be waterproofed by the inclusion of a water protective barrier (i.e. gel, magma, etc.) or flooding compound between the outside jacket and first shield. Each underground connection shall be accessible in a manhole, recessed ground level junction box, above ground pedestal, etc., and shall be provided with appropriate waterproof connectors to match the cable being installed. Once the System has been tested and found to meet the System performance standards and accepted by VA, the Contractor shall provide waterproof shrink tubing or approved mastic to fully encompass each wire or cable connection and overlay at least 150 mm (6 inches) above each wire or cable jacket trim point.
  - 2) It is not acceptable to connect waterproofed cable directly to an inside CCS punch block or directly to an equipment connection port. When an underground cable enters a building, it shall be routed directly to the closest TC that has been designated as the building's IMTC. The Contractor shall provide a "transition" splice in this TC where the "water proofed" cable enters on one side and "dry" cable exits on the other side. The "transition" splice shall be fully waterproof and be capable of reentry for system servicing. Additionally, the transition splice shall not allow the waterproofing compound to migrate from the water proof cable to the dry cable.
  - 3) Warning tape shall be continuously placed 300 mm (12 inches) above buried conduit, cable, etc.

E. Outlet Boxes, Back Boxes, and Faceplates:

1. Outlet Boxes: Signal, power, interface, connection, distribution, and junction boxes shall be provided as required by the system design, on-site inspection, and review of the contract drawings.
  2. Back Boxes: Back boxes shall be provided as directed by the OEM as required by the approved system design, on-site inspection, and review of the contract drawings.
  3. Face Plates (or Cover Plates): Faceplates shall be of a standard type, stainless steel, anodized aluminum or UL approved cycloc plastic construction and provided by the Contractor for each identified system outlet location. Connectors and jacks appearing on the faceplate shall be clearly and permanently marked.
- F. Connectors: Circuits, transmission lines, and signal extensions shall have continuity, correct connection and polarity. A uniform polarity shall be maintained between all points in the system.
1. Wires:
    - a. Wire ends shall be neatly formed and where insulation has been cut, heat shrink tubing shall be employed to secure the insulation on each wire. Tape of any type is not acceptable.
    - b. Audio spade lugs shall be installed on each wire (including spare or unused) end and connect to screw terminals of appropriate size barrier strips. AC barrier strips shall be provided with a protective cover to prevent accidental contact with wires carrying live AC current. Punch blocks are approved for signal, not AC wires. Wire Nut or "Scotch Lock" connectors are not acceptable for signal wire installation.
  2. Cables: Each connector shall be designed for the specific size cable being used and installed with the OEM's approved installation tool. Typical system cable connectors include; but, are not limited to: Audio spade lug, punch block, wirewrap, etc.
- G. AC Power: AC power wiring shall be run separately from signal cable.
- H. Grounding:
1. General: The Contractor shall ground all Contractor Installed Equipment and identified Government Furnished Equipment to eliminate all shock hazards and to minimize, to the maximum extent possible, all ground loops, common mode returns, noise pickup, crosstalk, etc. The total ground resistance shall be 0.1 Ohm or less.
    - a. The Contractor shall install lightning arrestors and grounding in accordance with the NFPA and this specification.
    - b. Under no conditions shall the AC neutral, either in a power panel or in a receptacle outlet, be used for system control, subcarrier or audio reference ground.
    - c. The use of conduit, signal duct or cable trays as system or electrical ground is not acceptable and will not be permitted. These items may be used only for the dissipation of internally generated static charges (not to be confused with externally generated lightning) that may applied or generated outside the mechanical and/or physical confines

of the System to earth ground. The discovery of improper system grounding shall be grounds to declare the System unacceptable and the termination of all system acceptance testing.

2. Cabinet Buss: A common ground buss of at least #10 AWG solid copper wire shall extend throughout each equipment cabinet and be connected to the system ground. Provide a separate isolated ground connection from each equipment cabinet ground buss to the system ground. Do not tie equipment ground busses together.
  3. Equipment: Equipment shall be bonded to the cabinet bus with copper braid equivalent to at least #12 AWG. Self grounding equipment enclosures, racks or cabinets, that provide OEM certified functional ground connections through physical contact with installed equipment, are acceptable alternates.
  4. Cable Shields: Cable shields shall be bonded to the cabinet ground buss with #12 AWG minimum stranded copper wire at only one end of the cable run. Cable shields shall be insulated from each other, faceplates, equipment racks, consoles, enclosures or cabinets; except, at the system common ground point. Coaxial and audio cables, shall have one ground connection at the source; in all cases, cable shield ground connections shall be kept to a minimum.
- I. Labeling: Provide labeling in accordance with ANSI/EIA/TIA-606-A. All lettering for voice and data circuits shall be stenciled using laser printers . Handwritten labels are not acceptable.
1. Cable and Wires (Hereinafter referred to as "Cable"): Cables shall be labeled at both ends in accordance with ANSI/EIA/TIA-606-A. Labels shall be permanent in contrasting colors. Cables shall be identified according to the System "Record Wiring Diagrams".
  2. Equipment: System equipment shall be permanently labeled with contrasting plastic laminate or bakelite material. System equipment shall be labeled on the face of the unit corresponding to its source.
  3. Conduit, Cable Duct, and/or Cable Tray: The Contractor shall label all conduit, duct and tray, including utilized GFE, with permanent marking devices or spray painted stenciling a minimum of 3 meters (10 ft.) identifying it as the System. In addition, each enclosure shall be labeled according to this standard.
  4. Termination Hardware: The Contractor shall label workstation outlets and patch panel connections using color coded labels with identifiers in accordance with ANSI/EIA/TIA-606-A and the "Record Wiring Diagrams".

### 3.2 TESTS

- C. Acceptance Test: After the System has been pretested and the Contractor has submitted the pretest results and certification to the COR, then the Contractor shall schedule an acceptance test date and give the COR 30 days written notice prior to the date the acceptance test is expected to begin. The System shall be tested in the presence of a Government Representative

and an OEM certified representative. The System shall be tested utilizing the approved test equipment to certify proof of performance and Life Safety compliance. The test shall verify that the total System meets the requirements of this specification. The notification of the acceptance test shall include the expected length (in time) of the test.

D. Verification Tests:

1. Test the UTP backbone copper cabling for DC loop resistance, shorts, opens, intermittent faults, and polarity between conductors, and between conductors and shield, if cable has an overall shield. Test the operation of shorting bars in connection blocks. Test cables after termination and prior to cross-connection.
2. Multimode Fiber Optic Cable: Perform end-to-end attenuation tests in accordance with ANSI/EIA/TIA-568-B.3 and ANSI/EIA/TIA-526-14A using Method A, Optical Power Meter and Light Source . Perform verification acceptance test.

E. Performance Testing:

1. Perform Category 5e tests in accordance with ANSI/EIA/TIA-568-B.1 and ANSI/EIA/TIA-568-B.2. Test shall include the following: wire map, length, insertion loss, return loss, NEXT, PSNEXT, ELFEXT, PSELFEXT, propagation delay and delay skew.
2. Fiber Optic Links: Perform end-to-end fiber optic cable link tests in accordance with ANSI/EIA/TIA-568-B.3.

F. Total System Acceptance Test: The Contractor shall perform verification tests for UTP copper cabling system(s) and the multimode fiber optic cabling system(s) after the complete telecommunication distribution system and workstation outlet are installed.

1. Voice Testing: Connect to the network interface device at the demarcation point. Go off-hook and receive dial tone from the LEC. If a test number is available, place and receive a local, long distance, and FTS telephone call.
2. Data Testing: Connect to the network interface device at the demarcation point. Log onto the network to ensure proper connection to the network is achieved.

### 3.3 WARRANTY

A. Comply with FAR clause 52.246-21, except that warranty shall be as follows:

1. The Contractor shall warranty that all installed material and equipment will be free from defects, workmanship, and will remain so for a period of one year from date of final acceptance of the System by the VA. The Contractor shall provide OEM's equipment warranty documents, to the COR (or Facility Contracting Officer if the Facility has taken possession of the building(s)), that certifies each item of equipment installed conforms to OEM published specifications.
2. The Contractor's maintenance personnel shall have the ability to contact the Contractor and OEM for emergency maintenance and logistic assistance, remote diagnostic testing, and

assistance in resolving technical problems at any time. The Contractor and OEM shall provide this contact capability at no additional cost to the VA.

3. All Contractor installation, maintenance, and supervisor personnel shall be fully qualified by the OEM and must provide two (2) copies of current and qualified OEM training certificates and OEM certification upon request.
- B. Work Not Included: Maintenance and repair service shall not include the performance of any work due to improper use, accidents, other vendor, contractor, owner tampering or negligence, for which the Contractor is not directly responsible and does not control. The Contractor shall immediately notify the COR or Facility Contracting Officer in writing upon the discovery of these incidents. The COR or Facility Contracting Officer will investigate all reported incidents and render findings concerning any Contractor's responsibility.

--- E N D ---