


three inches = one foot
one and one half inches = one foot
one inch = one foot
three quarters inch = one foot
one half inch = one foot
three eighths inch = one foot
one quarter inch = one foot
one eighth inch = one foot
one eighth inch = one foot

GENERAL NOTES

1. SPRINKLER HEADS SHOWN ARE FOR GENERAL PURPOSES ONLY. INSTALL IN ACCORDANCE WITH PERFORMANCE SPEC. MUST MEET ALL NFPA REQUIREMENTS.
2. PROVIDE NEW FLOW TEST FOR CITY WATER SUPPLY AND FIRE PUMP FLOW.

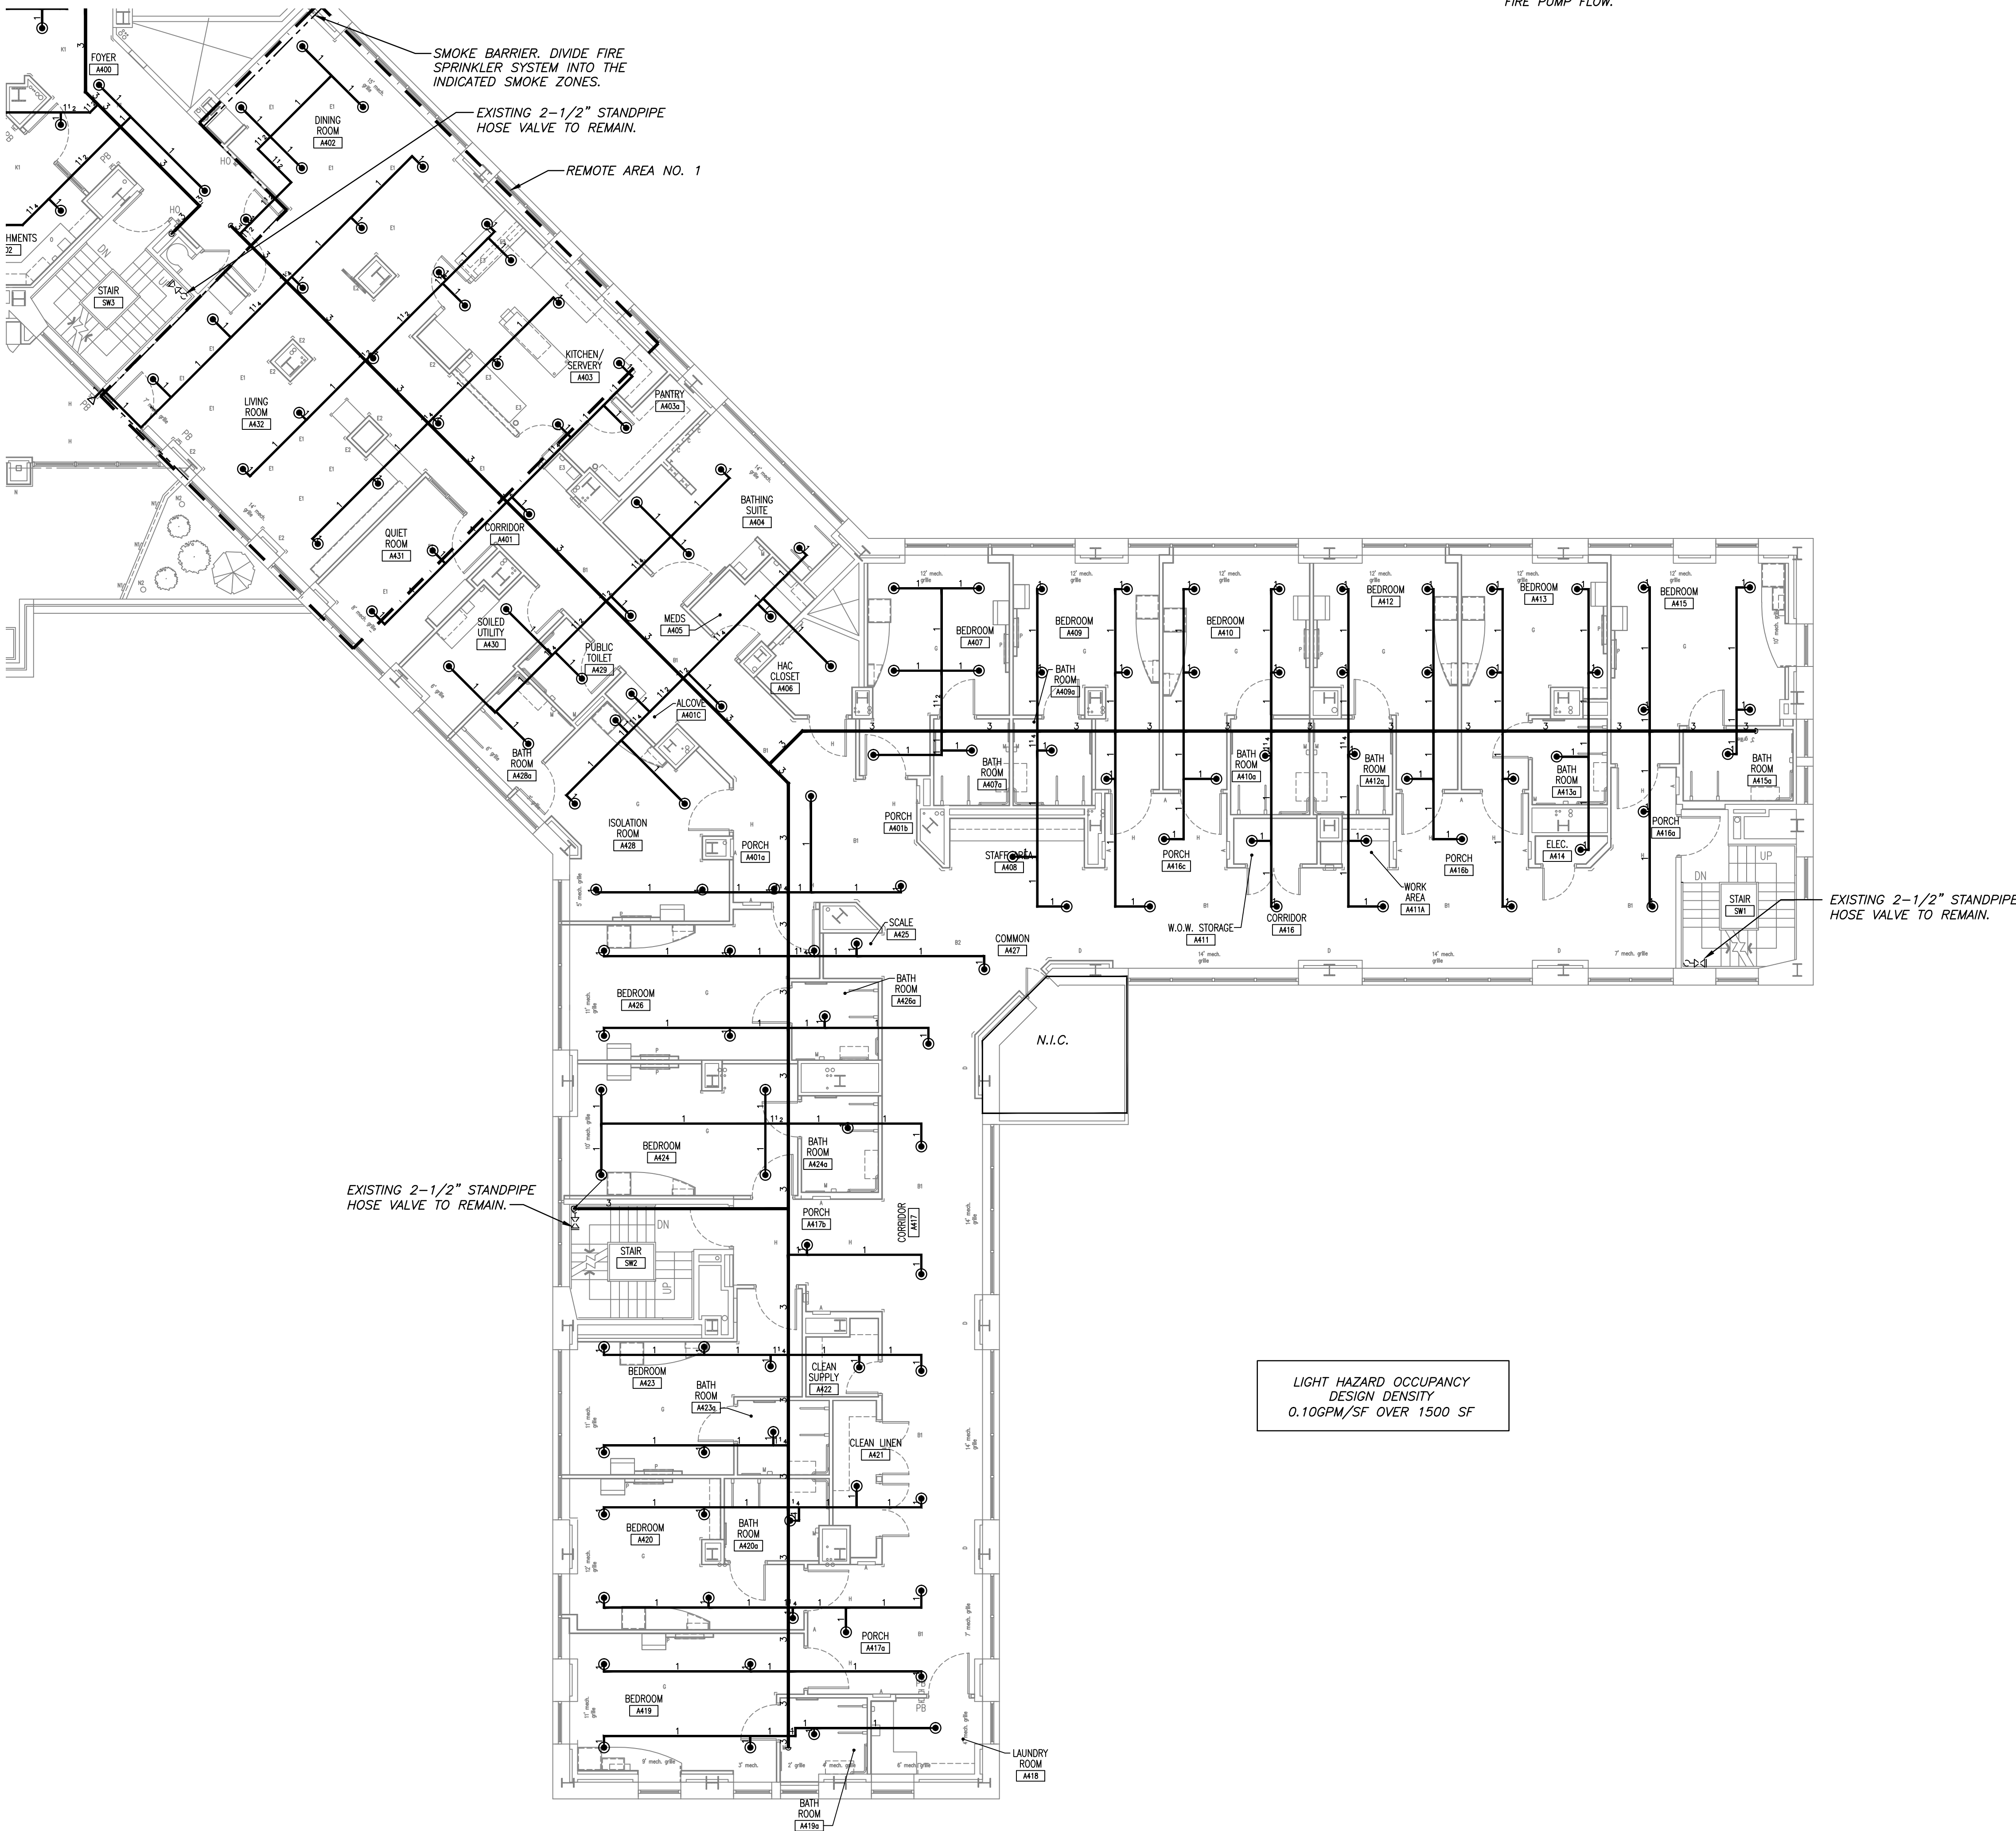

1 4TH FLOOR FIRE SPRINKLER PLAN - WING A
F2.1 SCALE: 1/8" = 1'-0"

REVISIONS	DATE
100% SUBMISSION	10/22/14
REVISED PER COMMENTS	4/30/15

CONSULTANTS:

Hyman Hayes
1511 Route 22 - Suite C-24
Brewster, New York 10509
p: 845.278.7710 f: 845.278.7750
adelaidelc.com

Adelaide
Environmental Health Associates, Inc.

ENGINEERING VENTURES PC
208 Flynn Avenue, Suite 2A Burlington, VT 05401
tel: 802.863.6225 • fax: 802.863.6286
85 Mechanic Street, Suite 350A, Lebanon, NH 03766
tel: 603.442.9330 • fax: 603.442.9331



ARCHITECT/ENGINEERS:

Sigma Psi Consulting
Mechanical, Electrical, Plumbing Engineers, PLLC
4 Collamer Road, Malta, NY 12020 PH (518) 581-9428 FX (518) 580-9325

Drawing Title
4TH FLOOR FIRE SPRINKLER PLAN - WING A

Approved Project Director
Chris Fure

Project Title
Renovate 4A for Community Living Center (CLC)
Stratton VA Medical Center

Location
Albany, New York

Date
10-22-2014

Checked
Drawn

Project Number
VA 528A8-12-801

Building Number
1

Drawing Number
F2.1

Dwg. 64 of 17

Office of Construction and Facilities Management

Department of Veterans Affairs