


three inches = one foot
 one and one half inches = one foot
 one inch = one foot
 three quarters inch = one foot
 one half inch = one foot
 three eighths inch = one foot
 one quarter inch = one foot
 one eighth inch = one foot

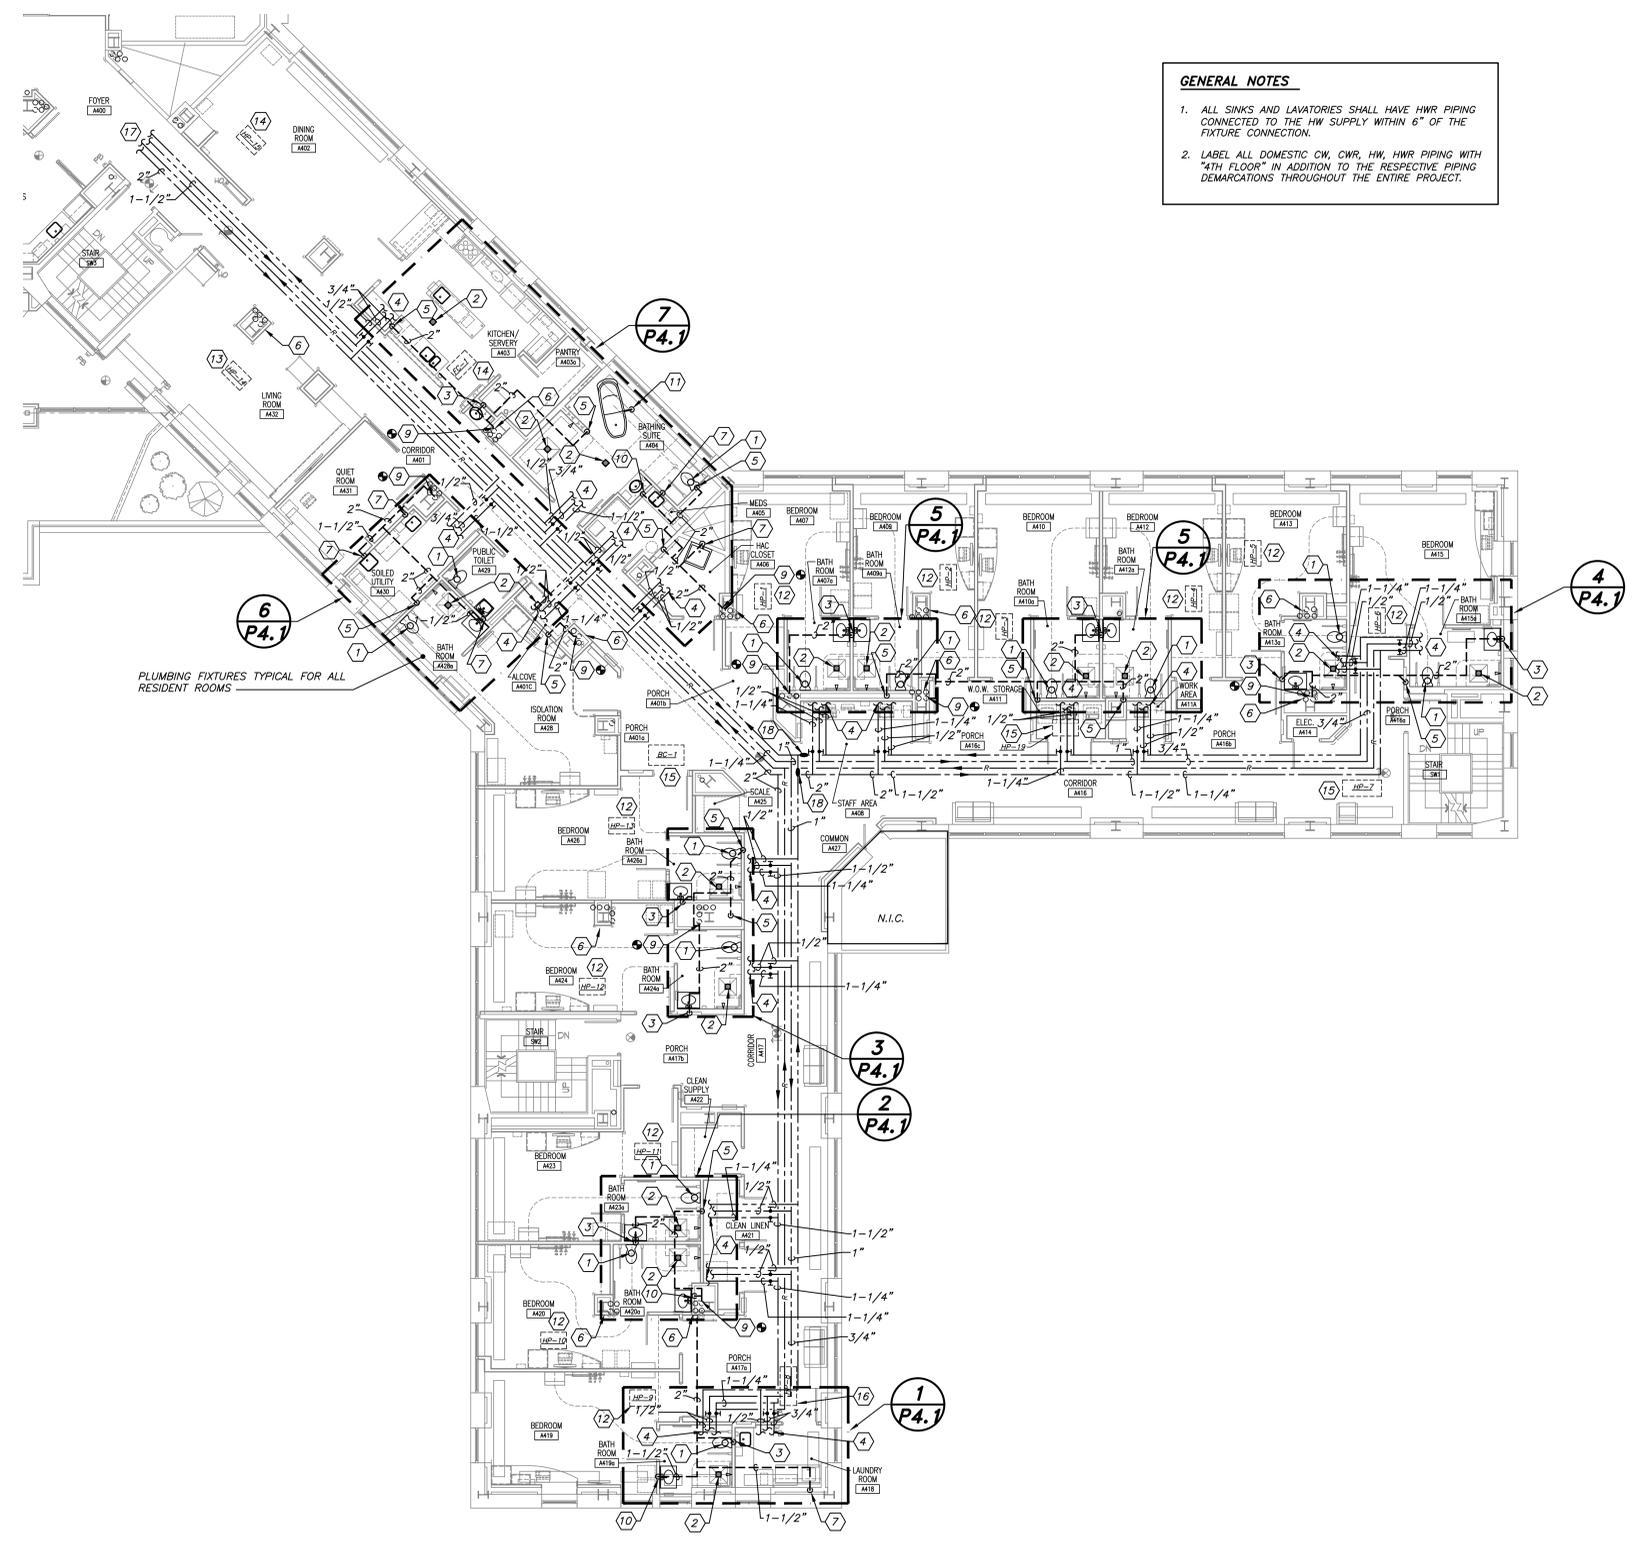

GENERAL NOTES


1. ALL SINKS AND LAVATORIES SHALL HAVE HWR PIPING CONNECTED TO THE HW SUPPLY WITHIN 6" OF THE FIXTURE CONNECTION.
2. LABEL ALL DOMESTIC CW, CWR, HW, HWR PIPING WITH "4TH FLOOR" IN ADDITION TO THE RESPECTIVE PIPING DEMARICATIONS THROUGHOUT THE ENTIRE PROJECT.

- KEYED NOTES FOR DWG P2.3**
- 1 4" SOIL - DN
 - 2 3" WASTE - DN
 - 3 2" WET VENT - DN & RISE
 - 4 CONT. ON PART PLAN
 - 5 2" VENT - DN & RISE
 - 6 COORDINATE W/CG. TO OFFSET AND/OR ENCLOSE EXISTING PIPING. NOTIFY ARCH/ENGINEER OF ANY DISCREPANCIES.
 - 7 2" WASTE - DN, 1-1/2" VENT - RISE
 - 8 CAP PIPING FOR FUTURE
 - 9 CONNECT TO EXISTING VENT STACK
 - 10 1-1/2" WASTE - DN, 1-1/2" VENT - RISE
 - 11 2" WASTE - DN, CONNECT 1-1/2" DRAIN TO TUB PER MANUFACTURER'S INSTRUCTIONS.
 - 12 PIPE 1" CONDENSATE DRAIN TO ARM ABOVE BATHROOM LAVATORY TRAP. CONNECT PER DETAIL 4/PO.3
 - 13 PIPE 1" CONDENSATE DRAIN TO ARM ABOVE SOILED UTILITY ROOM SINK TRAP. CONNECT PER DETAIL 4/PO.3
 - 14 COMBINE HP-15 & FC-1 CONDENSATE DRAINS. PIPE 1" CONDENSATE DRAIN TO CORRIDOR SINK TRAP. CONNECT PER DETAIL 4/PO.3.
 - 15 COMBINE CORRIDOR HEAT PUMP CONDENSATE DRAIN PIPING WITH BEDROOM HEAT PUMP CONDENSATE DRAIN PIPING. PIPE 1" CONDENSATE DRAIN TO ARM ABOVE BATHROOM LAVATORY TRAP. CONNECT PER DETAIL 4/PO.3
 - 16 PIPE 1" CONDENSATE DRAIN TO ARM ABOVE LAUNDRY ROOM SINK TRAP. CONNECT PER DETAIL 4/PO.3
 - 17 PIPING CONT. ON DRAWING P2.4.
 - 18 HOT WATER BALANCING STATION - SEE DETAIL 3/PO.3

PLUMBING FIXTURES TYPICAL FOR ALL RESIDENT ROOMS

1 4TH FLOOR PLUMBING PLAN - WING A
 P2.3 SCALE: 1/8" = 1'-0"

FINAL DESIGN (100%)

| | | | | | | | | | | | | | |
|--|--|--|--|--|--|--|--|--|--|---|--|---|--|
| CONSULTANTS: Hyman Hayes 6 WEMBLEY COURT, ALBANY, NEW YORK 12205 (518) 452-3470 Adelaide Environmental Health Associates, Inc. 1511 Route 22 - Suite C-24 Brewster, New York 10899 p: 845.278.7710 f: 845.278.7750 adalidelc.com | | ENGINEERING VENTURES PC 208 Ryan Avenue, Suite 2A Burlington, VT 05401 tel: 802.863.6225 fax: 802.863.6286 85 Mechanics Street, Suite 305A, Lebanon, NH 03766 tel: 603.442.9330 fax: 603.442.9331 | | ARCHITECT/ENGINEERS: Sigma Psi Consulting Mechanical, Electrical, Plumbing Engineers, PLLC 4 Collamer Road, Malta, NY 12020 PH (518) 581-9428 FX (518) 580-9325 | | Drawing Title 4TH FLOOR PLUMBING PLAN - WING A Approved Project Director  | | Project Title Renovate 4A for Community Living Center (CLC) Stratton VA Medical Center Location Albany, New York Date 10-22-2014 | | Project Number VA 528A8-12-801 Building Number 1 Drawing Number P2.3 Dwg 74 of 117 | | Office of Construction and Facilities Management  Department of Veterans Affairs | |
|--|--|--|--|--|--|--|--|--|--|---|--|---|--|